

Dames & Moore

To: Susan Knap  
 Firm: Alameda City Health Agency  
 Facsimile: 510.327.9335  
 From: Lee Dodge  
 Date: 5-25-01  
 Page 1 of: 3

Job or Task Number: Powell St. Plaza

Subject: MTBE Sampling

Message: I've attached 2 pages; 1 shows the MW locations the other the well status as of 7/97. (TABLE 1)


BASED upon our knowledge of tank locations (approx. midway between MW-4 and MW-14 and considering that there are abandoned wells, we propose sampling MW-14 and MW-3. If free product is encountered in MW-14 the sample will not be analyzed since any MTBE would be masked by the high HC concentrations. We would sample on May 29. Please notify us if you concur with our choice. We will analyze for MTBE only using method 8260. Thanks for your help.

Lee D 415.243.3752

cc:

URS Corporation  
 Dames & Moore  
 221 Main Street, Suite 600  
 San Francisco, CA 94105  
 Phone: 415-896-5858  
 Fax: 415-882-9261

**CONFIDENTIALITY NOTICE**  
 The information in this facsimile transmission is intended solely for the stated recipient of this transmission. If you have received this fax in error, please notify the sender immediately by telephone. If you are not the intended recipient, please be advised that dissemination, distribution, or copying of the information contained in this fax is strictly prohibited.

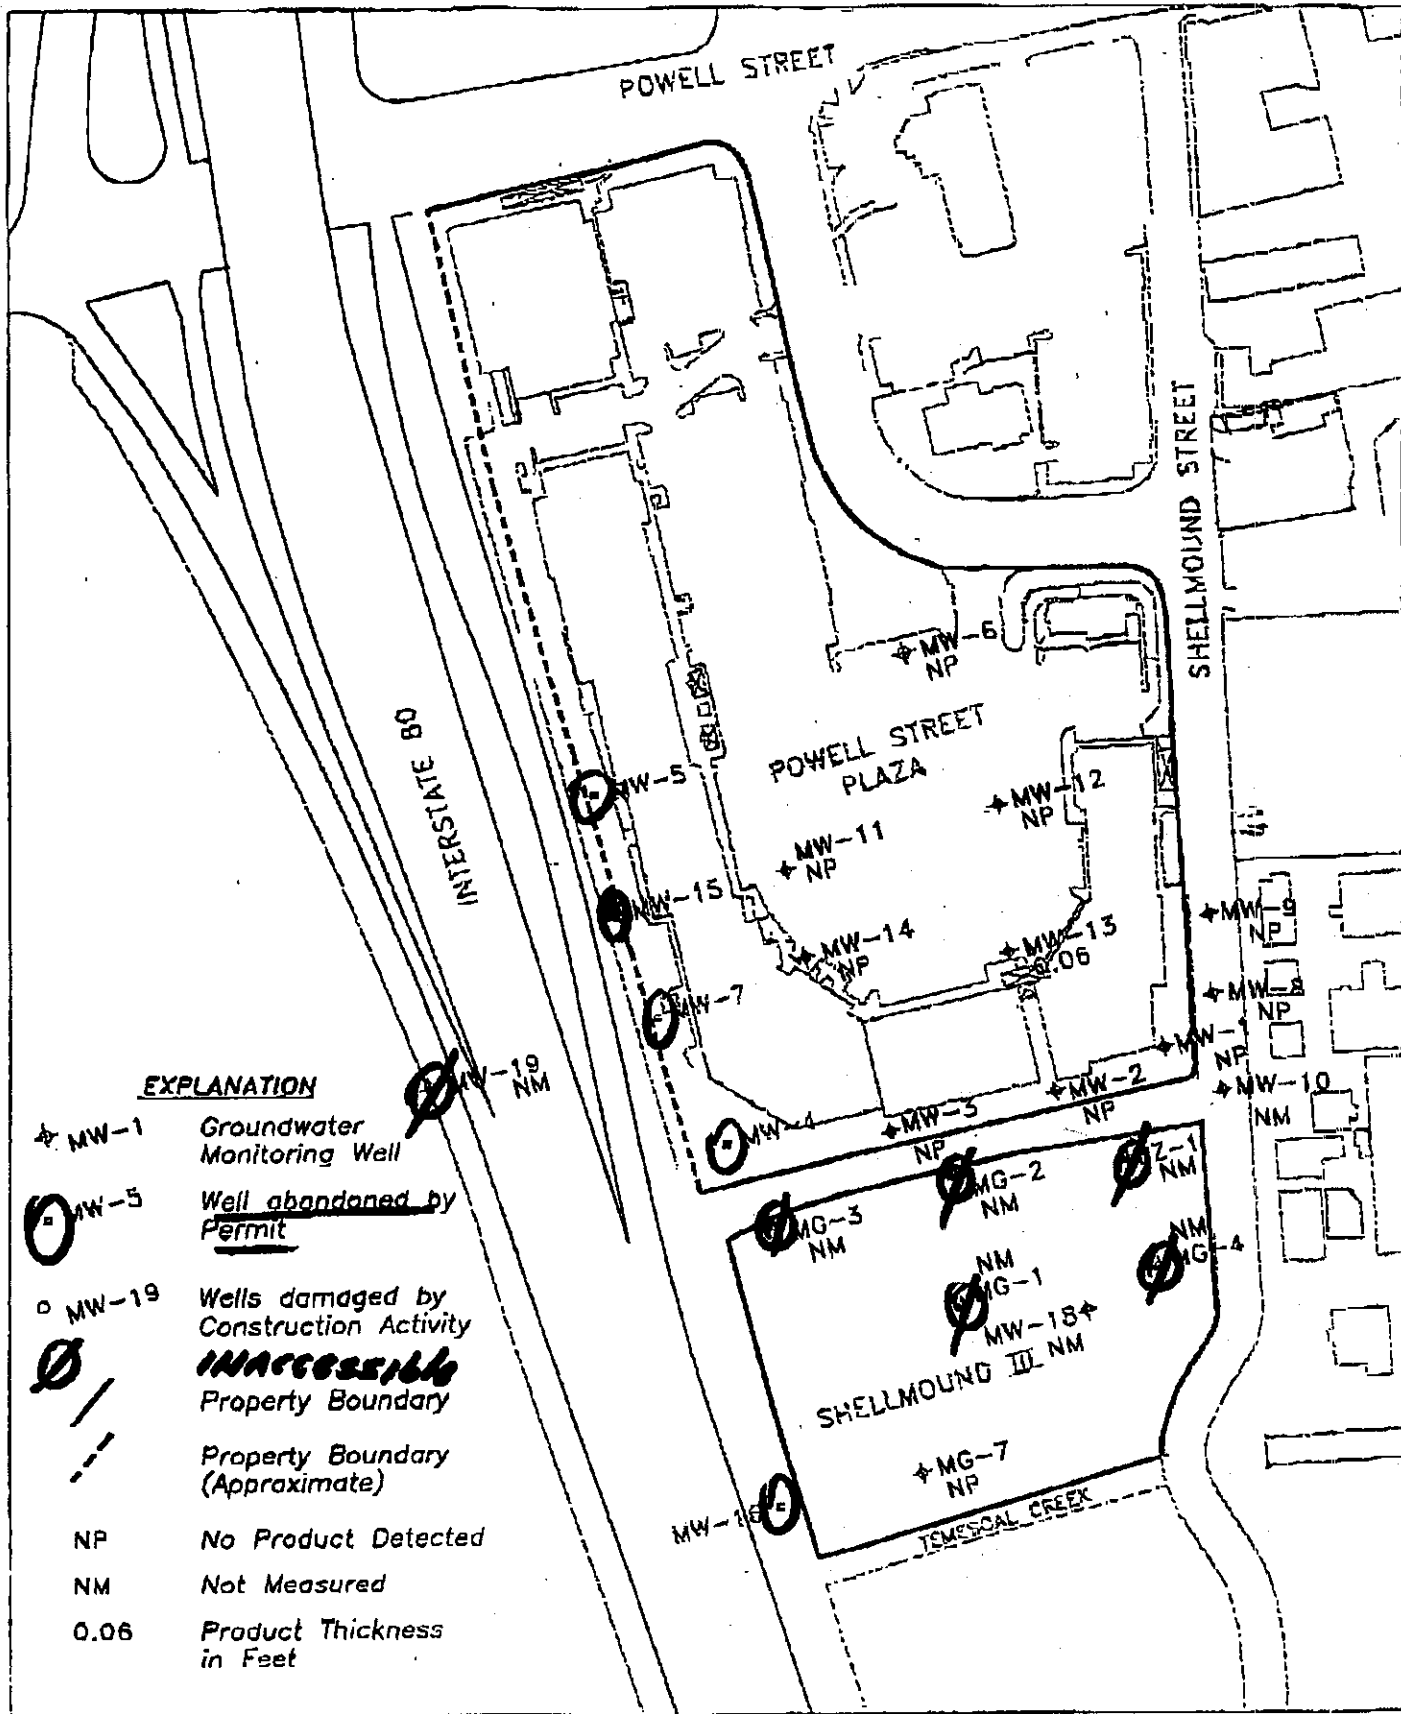

**PES Environmental, Inc.**  
 Engineering & Environmental Services

Free-Phase Product Thickness on May 23, 1997  
 Powell Street Plaza and  
 Shellmound III Sites  
 Emeryville, California

PLATE  
**3**

**TABLE 1**  
**Summary of Wells Sampled**  
**May 23, 1997**  
**Powell Street Plaza and Shellmound III Sites**  
**Emeryville, California**

| Well ID    | Semi-Annual Sampling Required | Sample Number | Status of Wells Not Sampled        |
|------------|-------------------------------|---------------|------------------------------------|
| MW-1       | X                             | 97210001      |                                    |
| MW-2       | X                             | 97210002      |                                    |
| MW-3       |                               | NS            | Eliminated from sampling schedule. |
| MW-4       |                               | NS            | Abandoned by permit.               |
| MW-5       |                               | NS            | Abandoned by permit.               |
| MW-6       |                               | NS            | Eliminated from sampling schedule. |
| MW-7       |                               | NS            | Abandoned by permit.               |
| MW-8       |                               | NS            | Eliminated from sampling schedule. |
| MW-9       |                               | NS            | Eliminated from sampling schedule. |
| MW-10      |                               | NS            | Eliminated from sampling schedule. |
| MW-11      | X                             | 97210011      |                                    |
| MW-12      | X                             | 97210012      |                                    |
| MW-13      |                               | NS            | Free-product present.              |
| MW-14      |                               | NS            | Eliminated from sampling schedule. |
| MW-15      |                               | NS            | Abandoned by permit.               |
| MW-16      |                               | NS            | Abandoned by permit.               |
| MW-18      |                               | NS            | Eliminated from sampling schedule. |
| MW-19      | X                             | NS            | Inaccessible.                      |
| MG-1       |                               | NS            | Inaccessible.                      |
| MG-2       | X                             | NS            | Inaccessible.                      |
| MG-3       |                               | NS            | Inaccessible.                      |
| MG-4       | X                             | NS            | Inaccessible.                      |
| MG-7       | X                             | 97210107      |                                    |
| PZ-1       | X                             | NS            | Inaccessible.                      |
| Trip Blank |                               | 97210000      |                                    |

**Note:**

NS = Not sampled