



GETTLER-RYAN INC.

MAY 16 2002

TRANSMITTAL

April 29, 2002

G-R #386499

TO: Mr. James Brownell
Delta Environmental Consultants, Inc.
3164 Gold Camp Drive, Suite 200
Rancho Cordova, California 95670

CC: Ms. Karen Streich
Chevron Products Company
P.O. Box 6004
San Ramon, California 94583

FROM: Deanna L. Harding
Project Coordinator
Gettler-Ryan Inc.
6747 Sierra Court, Suite J
Dublin, California 94568

RE: **Former Chevron Service Station
#9-0020
1633 Harrison Street
Oakland, California**

WE HAVE ENCLOSED THE FOLLOWING:

COPIES	DATED	DESCRIPTION
1	April 25, 2002	Groundwater Monitoring and Sampling Report First Semi-Annual - Event of March 15, 2002

COMMENTS:

This report is being sent for your review. Please provide any comments/changes and propose any groundwater monitoring modifications for the next event prior to **May 13, 2002**, at which time the final report will be distributed to the following:

cc: Mr. Don Hwang, Alameda County Health Care Services, Dept. of Environmental Health, 1131 Harbor Bay Pkwy.,
Suite 250, Alameda, CA 94502-6577
Mr. Greg Gurss, Gettler-Ryan Inc., 3140 Gold Camp Drive, Suite 170, Rancho Cordova, CA 95670
Mr. Howard Davis, The Oakland Housing Authority, 1619 Harrison Street, Oakland, CA 94612

Enclosures

Trans/9-0020-TB

6747 Sierra Court, Suite J • Dublin, California 94568 • (925) 551-7555



GETTLER-RYAN INC.

April 25, 2002
G-R Job #386499

Ms. Karen Streich
Chevron Products Company
P.O. Box 6004
San Ramon, CA 94583

MAY 16 2002

RE: First Semi-Annual Event of March 15, 2002
Groundwater Monitoring & Sampling Report
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

Dear Ms. Streich:


This report documents the most recent groundwater monitoring and sampling event performed by Gettler-Ryan Inc. (G-R) at the referenced site. All field work was conducted in accordance with G-R Standard Operating Procedure - Groundwater Sampling (attached).


Static groundwater levels were measured and the wells were checked for the presence of separate-phase hydrocarbons. Static water level data, groundwater elevations, and separate-phase hydrocarbon thickness (if any) are presented in the attached Table 1. A Potentiometric Map is included as Figure 1.

Groundwater samples were collected from the monitoring wells and submitted to a state certified laboratory for analyses. The field data sheets for this event are attached. Analytical results are presented in the table(s) listed below. The chain of custody document and laboratory analytical report are also attached.


Please call if you have any questions or comments regarding this report. Thank you.

Sincerely,

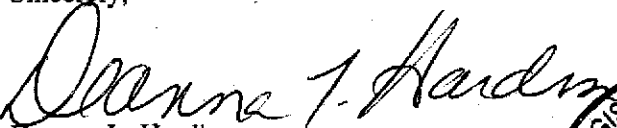

Deanna L. Harding
Project Coordinator



Douglas J. Lee
Senior Geologist, R.G. No. 6882

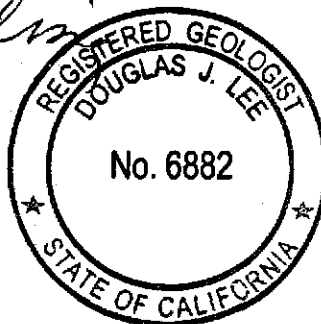

- Figure 1: Potentiometric Map
- Table 1: Groundwater Monitoring Data and Analytical Results
- Table 2: Groundwater Analytical Results
- Table 3: Groundwater Analytical Results
- Attachments: Standard Operating Procedure - Groundwater Sampling
Field Data Sheets
Chain of Custody Document and Laboratory Analytical Reports

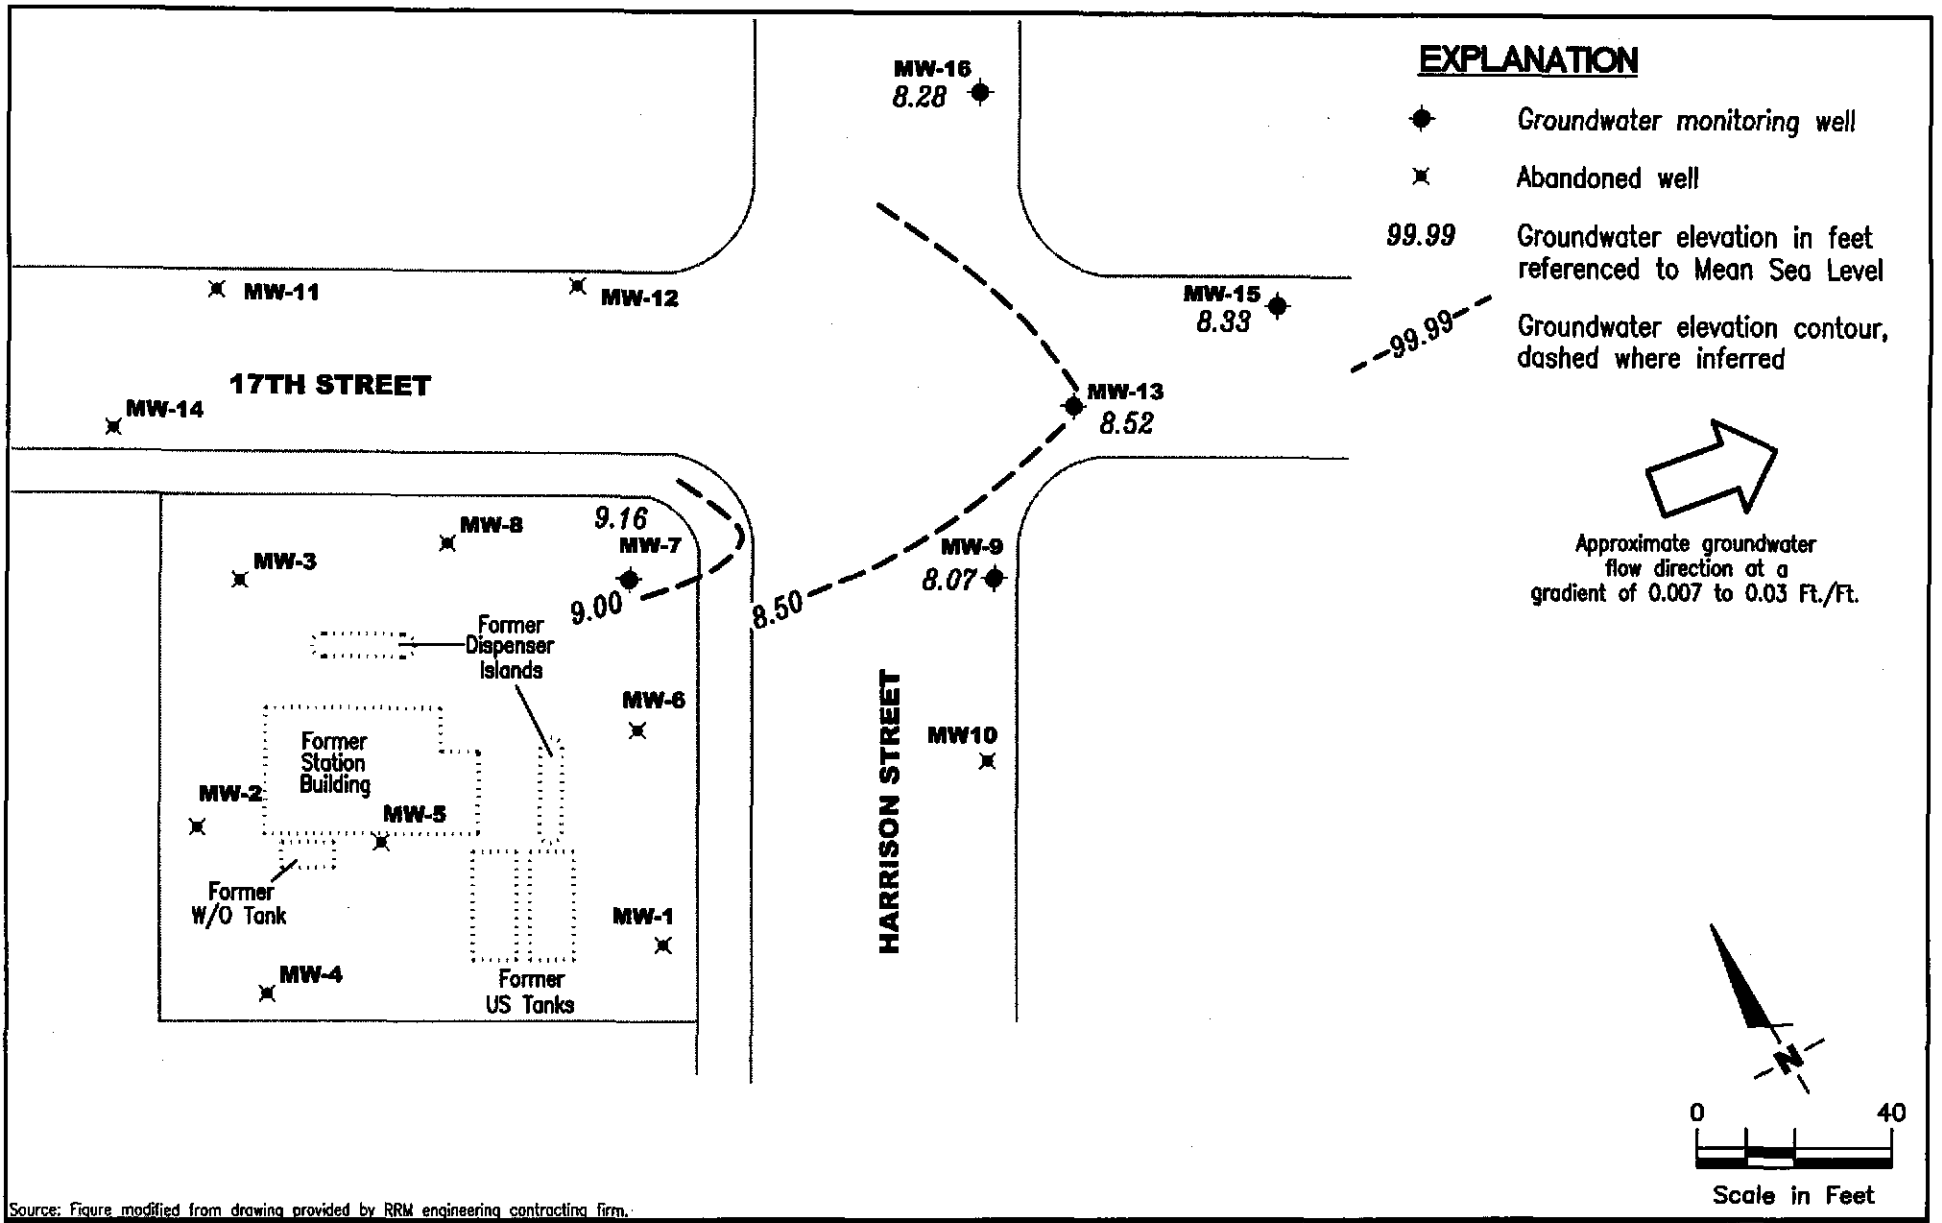

Source: Figure modified from drawing provided by RRM engineering contracting firm.

GETTLER - RYAN INC.
 6747 Sierra Ct., Suite J
 Dublin, CA 94568 (925) 551-7555

POTENTIOMETRIC MAP
 Former Chevron Service Station #9-0020
 1633 Harrison Street
 Oakland, California

FIGURE
1

PROJECT NUMBER
386499

REVIEWED BY

DATE
 March 15, 2002

REVISED DATE

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (fl.)	GWE (msl)	DTW (fl.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-1										
11/03/88	29.82	9.42	20.40	<1000	<1.0	<1.0	<1.0	<1.0	--	--
02/02/89	29.82	9.11	20.71	--	--	--	--	--	--	--
02/10/89	29.82	--	--	<100	<0.2	<0.2	<0.2	<0.4	--	--
04/23/89	29.82	9.48	20.34	--	--	--	--	--	--	--
04/24/89	29.82	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3000
07/28/89	29.82	9.24	20.58	<50	<0.1	<0.5	<0.2	<0.5	--	<3000
10/30/89	29.82	9.30	20.52	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	29.82	9.05	20.77	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	29.82	8.87	20.95	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	29.82	8.82	21.00	--	--	--	--	--	--	--
08/09/90	29.82	8.88	20.94	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	29.82	8.84	20.98	<50	<0.5	<0.5	<0.5	<0.5	--	--
05/15/91	29.82	9.18	20.64	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	29.82	9.03	20.79	110	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	29.82	9.07	20.75	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	29.82	8.92	20.90	<50	0.5	0.6	<0.5	0.9	--	--
06/15/92	29.82	9.18	20.64	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	29.82	8.98	20.84	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	29.82	9.91	19.91	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	29.82	9.97	19.85	--	--	--	--	--	--	--
09/10/93	29.82	--	--	--	--	--	--	--	--	--
09/27/93	29.82	9.47	20.35	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/17/93	29.82	9.14	20.68	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	29.82	9.25	20.57	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/16/94	29.82	9.27	20.55	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	29.82	9.13	20.69	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	29.82	9.59	20.23	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	29.82	10.37	19.45	<50	<0.5	<0.5	<0.5	<0.5	--	--

ABANDONED

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-2										
11/03/88	30.59	9.70	20.89	<1000	<1.0	<1.0	<1.0	<1.0	--	--
02/02/89	30.59	9.38	21.21	--	--	--	--	--	--	--
02/10/89	30.59	--	--	<100	<0.2	<0.2	<0.2	<0.4	--	--
04/23/89	30.59	9.77	20.82	--	--	--	--	--	--	--
04/24/89	30.59	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3000
07/28/89	30.59	9.57	21.02	<100	<0.2	<1.0	<0.2	<0.5	--	<3000
10/30/89	30.59	9.63	20.96	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	30.59	9.34	21.25	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	30.59	9.06	21.53	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	30.59	9.02	21.57	--	--	--	--	--	--	--
08/09/90	30.59	9.04	21.55	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	30.59	9.05	21.54	<50	<0.5	0.8	<0.5	0.9	--	--
05/15/91	30.59	9.44	21.15	83	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	30.59	9.32	21.27	97	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	30.59	9.29	21.30	<50	0.5	1.5	0.8	3.6	--	--
02/20/92	30.59	9.13	21.43	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/15/92	30.59	9.41	21.18	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	30.56	9.09	21.47	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	30.56	10.03	20.53	66	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	30.56	10.11	20.45	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	30.56	--	--	--	--	--	--	--	--	--
09/27/93	30.56	9.59	20.97	--	--	--	--	--	--	--
12/17/93	30.56	9.25	21.31	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	30.56	9.33	21.23	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/16/94	30.56	9.35	21.21	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	30.56	9.22	21.34	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	30.56	9.66	20.90	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	30.56	10.22	20.34	<50	<0.5	<0.5	<0.5	<0.5	--	--

ABANDONED

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-3										
11/03/88	30.09	9.55	20.54	<1000	<1.0	<1.0	<1.0	<1.0	--	--
02/02/89	30.09	9.24	20.85	--	--	--	--	--	--	--
02/10/89	30.09	--	--	<100	<0.2	<0.2	<0.2	<0.4	--	--
04/23/89	30.09	9.66	20.43	--	--	--	--	--	--	--
04/24/89	30.09	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3000
07/28/89	30.09	9.45	20.64	<100	<0.2	<1.0	<0.2	<0.4	--	<3000
10/30/89	30.09	9.48	20.61	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	30.09	9.21	20.88	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	30.09	8.94	21.15	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	30.09	8.89	21.20	--	--	--	--	--	--	--
08/09/90	30.09	8.91	21.18	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	30.09	8.94	21.15	51	<0.5	<0.5	<0.5	<0.5	--	--
05/15/91	30.09	9.18	20.91	85	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	30.09	9.20	20.89	91	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	30.09	9.07	21.02	<50	<0.5	0.7	<0.5	1.3	--	--
02/20/92	30.09	9.02	21.07	<50	<0.5	<0.5	<0.5	0.9	--	--
06/15/92	30.09	9.27	20.82	50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	30.08	9.07	21.07	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	30.08	9.95	20.13	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	30.08	10.03	20.05	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	30.08	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/27/93	30.08	9.50	20.58	--	--	--	--	--	--	--
12/17/93	30.08	9.07	21.01	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	30.08	9.22	20.86	<50	<0.5	<0.5	<0.5	1.1	--	--
06/16/94	30.08	9.21	20.87	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	30.08	9.11	20.97	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	30.08	10.45	19.63	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	30.08	10.27	19.81	<50	<0.5	<0.5	<0.5	<0.5	--	--
ABANDONED										

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-4										
04/23/89	31.17	9.84	21.33	--	--	--	--	--	--	--
04/24/89	31.17	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3000
07/28/89	31.17	9.59	21.58	<50	<0.1	<0.5	<0.1	<0.2	--	<3000
10/30/89	31.17	9.63	21.54	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	31.17	9.35	21.82	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	31.17	9.08	22.09	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	31.17	9.05	22.12	--	--	--	--	--	--	--
08/09/90	31.17	9.06	22.11	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	31.17	9.07	22.10	<50	<0.5	1.0	0.5	1.0	--	--
05/15/91	31.17	9.46	21.71	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	31.17	9.30	21.87	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	31.17	9.37	21.80	97	<0.5	0.9	<0.5	1.9	--	--
02/20/92	31.17	9.18	21.99	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/15/92	31.17	9.43	21.74	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	31.17	9.12	22.05	<50	0.7	0.5	0.5	1.3	--	--
04/07/93	31.17	10.06	21.11	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	31.17	--	--	--	--	--	--	--	--	--
09/10/93	31.17	--	--	--	--	--	--	--	--	--
09/27/93	31.17	9.63	21.54	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/17/93	31.17	9.28	21.89	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	31.17	--	--	--	--	--	--	--	--	--
06/16/94	31.17	10.63	20.54	--	--	--	--	--	--	--
09/07/94	31.17	9.27	21.90	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	31.17	9.83	21.34	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/21/95	31.17	10.55	20.62	<50	<0.5	<0.5	<0.5	<0.5	--	--
ABANDONED										

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-5										
04/23/89	30.28	9.66	20.62	--	--	--	--	--	--	--
04/24/89	30.28	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3000
07/28/89	30.28	9.42	20.86	<100	<0.2	<1.0	<0.2	<0.4	--	<3000
10/30/89	30.28	9.46	20.82	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	30.28	9.21	21.07	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	30.28	8.93	21.35	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	30.28	8.90	21.38	--	--	--	--	--	--	--
08/09/90	30.28	8.92	21.36	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	30.28	8.93	21.35	<50	<0.5	1.0	<0.5	1.0	--	--
05/15/91	30.28	8.99	21.29	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	30.28	9.17	21.11	94	3.0	5.0	1.5	5.5	--	--
11/15/91	30.28	9.10	21.18	<50	0.9	1.7	<0.5	2.2	--	--
02/20/92	30.28	9.03	21.25	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/15/92	30.28	9.28	21.00	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	30.28	9.05	21.23	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	30.28	9.97	20.31	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	30.28	--	--	--	--	--	--	--	--	--
09/10/93	30.28	--	--	--	--	--	--	--	--	--
09/27/93	30.28	9.52	20.76	--	--	--	--	--	--	--
ABANDONED										
MW-6										
04/23/89	29.46	9.41	20.05	--	--	--	--	--	--	--
04/24/89	29.46	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	<3.0
07/28/89	29.46	9.16	20.30	<100	<0.2	<1.0	<0.2	<0.4	--	<3.0
10/30/89	29.46	9.14	20.32	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	29.46	8.95	20.51	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	29.46	8.74	20.72	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	29.46	8.69	20.77	--	--	--	--	--	--	--
08/09/90	29.46	8.72	20.74	<50	<0.3	<0.3	<0.3	<0.6	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-6 (cont)										
11/13/90	29.46	8.71	20.75	<50	3.0	5.0	0.5	2.0	--	--
05/15/91	29.46	8.85	20.61	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	29.46	8.93	20.53	180	6.1	12	3.8	14	--	--
11/15/91	29.46	8.93	20.53	<50	<0.5	0.6	<0.5	<0.5	--	--
02/20/92	29.46	8.77	20.69	<50	0.9	1.1	<0.5	1.4	--	--
06/15/92	29.46	9.08	20.38	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	29.45	8.88	20.57	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	29.45	9.86	19.59	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	29.45	9.95	19.50	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	29.45	--	--	--	--	--	--	--	--	--
09/27/93	29.45	9.38	20.07	--	--	--	--	--	--	--
ABANDONED										
MW-7										
04/23/89	29.01	10.02	18.99	--	--	--	--	--	--	--
04/24/89	29.01	--	--	8400	100	260	160	1300	--	<3.0
07/28/89	29.01	9.07	19.94	7000	230	90	70	440	--	<3000
07/28/89 (D)	29.01	--	--	6000	280	180	58	430	--	--
10/30/89	29.01	9.04	19.97	10,000	570	55	160	400	--	--
10/30/89 (D)	29.01	--	--	9900	520	82	180	410	--	--
01/09/90	29.01	8.86	20.15	3400	290	72	9.0	200	--	--
04/18/90	29.01	8.64	20.37	6800	350	140	110	400	--	--
06/22/90	29.01	8.61	20.40	--	--	--	--	--	--	--
08/09/90	29.01	8.63	20.38	11,000	360	130	14	660	--	--
11/13/90	29.01	8.60	20.41	6500	230	110	97	460	--	--
05/15/91	29.01	8.54	20.47	4600	180	55	46	300	--	--
08/27/91	29.01	8.87	20.14	7000	220	53	63	340	--	--
11/15/91	29.01	8.79	20.22	3300	150	19	4.9	200	--	--
02/20/92	29.01	8.69	20.32	5200	520	150	100	380	--	--
06/15/92	29.01	9.03	19.98	10,000	760	430	320	1100	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-7 (cont)										
12/16/92	29.01	8.87	20.14	11,000	810	350	280	1100	--	--
04/07/93	29.01	9.87	19.14	150	1.4	0.9	0.9	4.5	--	--
06/09/93	29.01	9.96	19.05	180	4.0	1.0	1.0	3.0	--	--
09/10/93	29.01	--	--	--	--	--	--	--	--	--
09/27/93	29.01	--	--	--	--	--	--	--	--	--
12/17/93	29.01	--	--	--	--	--	--	--	--	--
03/10/94	29.01	--	--	--	--	--	--	--	--	--
06/16/94	29.01	--	--	--	--	--	--	--	--	--
09/07/94	29.01	--	--	--	--	--	--	--	--	--
11/30/94	29.01	INACCESSIBLE	--	--	--	--	--	--	--	--
01/17/95	29.01	17.39	11.62	2700	140	65	44	200	--	--
03/22/95	29.01	11.33	17.68	160	3.4	<0.5	1.1	0.77	--	--
06/27/95	29.01	9.75	19.26	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/28/95	29.01	9.67	19.34	1500	84	24	26	130	--	--
12/30/95	29.01	9.85	19.16	200	1.6	<0.5	1.3	5.9	5.5	--
02/28/96	29.01	10.57	18.44	650	14	1.3	4.2	16	34	--
06/27/96	29.01	10.29	18.72	640	140	10	9.8	14	55	--
09/13/96	29.01	9.61	19.40	1400	100	30	24	66	130	--
12/16/96	29.01	8.91	20.10	2600	140	72	51	180	<50	--
03/20/97	29.01	10.06	18.95	64	1.7	2.4	<0.5	0.67	<2.5	--
09/08/97	29.01	9.34	19.67	590	45	<1.0	7.7	<1.0	46	--
02/16/98	29.01	10.41	18.60	120	8.7	7.5	1.9	11	4.4	--
08/25/98	29.01	9.61	19.40	160	6.2	33	0.84	2.0	<2.5	--
03/09/99	29.01	13.01	16.00	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/29/99	29.01	12.12	16.89	276	35.1	2.54	2.17	5.43	<5.0/<2.0 ¹	--
03/27/00	29.01	9.42	19.59	721	38.5	1.06	6.31	9.38	7.75	--
09/18/00 ³	29.01	8.99	20.02	88 ⁴	2.5	0.92	<0.50	1.3	8.7	--
03/27/01 ³	29.01	9.16	19.85	<50.0	<0.500	<0.500	<0.500	<0.500	<0.500	--
09/05/01 ³	29.01	8.60	20.41	220	1.9	2.3	<0.50	<3.0	<2.5	--
03/15/02 ³	29.01	9.16	19.85	NOT SAMPLED - DUE TO INSUFFICIENT WATER				--	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-8										
04/23/89	29.57	9.43	20.14	--	--	--	--	--	--	--
04/24/89	29.57	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	3000
04/24/89 ¹	29.57	--	--	<50	<0.5	<1.0	<1.0	<1.0	--	--
07/28/89	29.57	9.20	20.37	<100	<0.2	<1.0	<0.2	<0.4	--	<3000
10/30/89	29.57	9.25	20.32	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	29.57	8.97	20.60	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	29.57	8.70	20.87	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	29.57	9.23	20.34	--	--	--	--	--	--	--
08/09/90	29.57	8.68	20.89	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	29.57	8.71	20.86	<50	<0.5	0.8	<0.5	2.0	--	--
05/15/91	29.57	9.08	20.49	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	29.57	8.97	20.60	73	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	29.57	8.95	20.62	<50	<0.5	0.7	<0.5	2.1	--	--
02/20/92	29.57	8.77	20.80	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/15/92	29.57	9.09	20.48	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	29.57	8.89	20.68	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	29.57	9.87	19.70	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	29.57	9.97	19.60	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	29.57	--	--	--	--	--	--	--	--	--
09/27/93	29.57	9.35	20.22	--	--	--	--	--	--	--
ABANDONED										
MW-9										
06/22/90	28.67	7.87	20.80	5700	47	31	280	530	--	<1000
08/09/90	28.67	7.93	20.74	8000	<0.3	17	210	480	--	--
11/13/90	28.67	7.89	20.78	6400	<3.0	20	240	450	--	--
05/15/91	28.67	8.19	20.48	5700	2.0	16	190	390	--	--
08/27/91	28.67	8.12	20.55	6700	<3.0	31	180	350	--	--
11/15/91	28.67	8.10	20.57	4000	8.8	26	150	280	--	--
02/20/92	28.67	6.90	21.77	3400	13	30	230	460	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-9 (cont)										
06/15/92	28.67	8.30	20.37	4500	19	72	280	560	--	--
12/16/92	28.68	8.39	20.29	9900	380	220	380	1300	--	--
04/07/93	28.68	9.36	19.32	8700	51	150	360	1000	--	--
06/09/93	28.68	9.52	19.16	8900	170	160	350	1100	--	--
09/10/93	28.68	--	--	4600	110	63	190	350	--	--
09/27/93	28.68	8.74	19.94	--	--	--	--	--	--	--
12/17/93	28.68	8.37	20.31	4600	92	85	180	300	--	--
03/10/94	28.68	8.38	20.30	3300	8.0	29	120	170	--	--
06/16/94	28.68	8.42	20.26	2900	4.8	16	85	64	--	--
09/07/94	28.68	8.27	20.41	2900	<0.5	9.9	70	75	--	--
11/30/94	28.68	8.70	19.98	2100	<5.0	<5.0	53	51	--	--
03/22/95	28.68	9.27	19.41	2200	<5.0	5.3	26	69	--	--
06/27/95	28.68	9.28	19.40	2900	7.4	10	68	99	--	--
09/28/95	28.68	9.13	19.55	4000	32	<10	36	44	--	--
12/30/95	28.68	8.88	19.80	3800	<5.0	13	<5.0	120	120	--
02/28/96	28.68	8.93	19.75	2000	9.9	<5.0	46	30	<25	--
06/27/96	28.68	9.13	19.55	2400	36	7.1	65	72	<50	--
09/13/96	28.68	8.86	19.82	2500	26	8.4	53	39	36	--
12/16/96	28.68	7.91	20.77	1200	3.5	2.4	12	14	<10	--
03/20/97	28.68	9.28	19.40	2400	25	5.8	26	22	<25	--
09/08/97	28.68	8.59	20.09	1800	9.5	8.1	22	21	12	--
02/16/98	28.68	9.45	19.23	950	5.6	3.1	13	13	18	--
08/25/98	28.68	9.18	19.50	2100	2.5	6.4	35	51	8.9	--
03/09/99	28.68	8.87	19.81	1400	12	7.8	8.8	16	8.8	--
07/19/99 ²	28.68	--	--	--	--	--	--	--	--	--
09/29/99	28.68	8.27	20.41	217	1.36	1.14	1.56	1.49	<5.0/<2.0 ¹	--
03/27/00	28.68	INACCESSIBLE	--	--	--	--	--	--	--	--
09/18/00 ³	28.68	8.63	20.05	<50	<0.50	<0.50	<0.50	<0.50	<2.5	--
03/27/01 ³	28.68	8.84	19.84	718	<0.500	<0.500	3.31	12.3	<0.500	--
09/05/01 ³	28.68	8.39	20.29	1,500	<0.50	2.9	11	25	<2.5	--
03/15/02 ³	28.68	8.07	20.61	740	0.56	<0.50	4.0	5.3	<2.5	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-10										
06/22/90	28.60	8.12	20.48	<50	<0.5	<0.5	<0.5	<0.5	--	<1000
08/09/90	28.60	8.15	20.45	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	28.60	8.13	20.47	<50	<0.5	2.0	0.5	2.0	--	--
05/15/91	28.60	8.45	20.15	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	28.60	8.33	20.27	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	28.60	8.27	20.33	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	28.60	7.15	21.45	<50	2.0	2.2	<0.5	2.1	--	--
06/15/92	28.60	7.30	21.30	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	28.62	8.45	20.17	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	28.62	9.41	19.26	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	28.62	9.55	19.07	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	28.62	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/24/93	28.62	8.90	19.72	--	--	--	--	--	--	--
12/17/93	28.62	8.55	20.07	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	28.62	8.65	19.97	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/16/94	28.62	8.64	19.98	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	28.62	8.50	20.12	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	28.62	8.92	19.70	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	28.62	9.70	18.92	<50	<0.5	<0.5	<0.5	<0.5	--	--
ABANDONED										
MW-11										
06/22/90	29.37	8.34	21.03	<50	<0.5	<0.5	<0.5	<0.5	--	<1000
08/09/90	29.37	8.35	21.02	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	29.37	8.44	20.93	76	0.6	1.0	0.9	4.0	--	--
05/15/91	29.37	8.76	20.61	78	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	29.37	8.67	20.70	110	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	29.37	8.69	20.68	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	29.37	7.46	21.91	<50	1.9	2.1	1.0	4.4	--	--
06/15/92	29.37	8.81	20.56	--	--	--	--	--	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-11 (cont)										
12/16/92	29.39	8.64	20.75	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	29.39	9.56	19.83	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	29.39	9.72	19.67	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	29.39	--	--	--	--	--	--	--	--	--
09/27/93	29.39	9.06	20.33	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/17/93	29.39	8.66	20.73	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	29.39	8.70	20.69	--	--	--	--	--	--	--
06/16/94	29.39	8.83	20.56	<50	<0.5	<0.5	<0.5	<0.5	--	--
ABANDONED										
MW-12										
06/22/90	28.43	7.98	20.45	<50	<0.5	<0.5	<0.5	<0.5	--	<1000
08/09/90	28.43	8.00	20.43	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	28.43	7.98	20.45	<50	<0.5	<0.5	<0.5	<0.5	--	--
05/15/91	28.43	8.36	20.07	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	28.43	8.28	20.15	56	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	28.43	8.18	20.25	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	28.43	7.06	21.37	<50	2.5	3.1	0.7	3.0	--	--
06/15/92	28.43	8.53	19.90	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	28.43	8.63	19.80	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	28.43	9.68	18.75	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	28.43	--	--	--	--	--	--	--	--	--
09/10/93	28.43	--	--	--	--	--	--	--	--	--
09/27/93	28.43	8.80	19.63	--	--	--	--	--	--	--
ABANDONED										

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-13										
11/15/91	28.63	7.56	21.07	3100	68	40	110	270	--	--
02/20/92	28.63	6.46	22.17	3100	120	50	240	400	--	--
06/15/92	28.63	7.96	20.67	3200	35	33	210	300	--	--
12/16/92	28.62	8.28	20.34	87,000	1400	540	2400	11,000	--	--
04/07/93	28.62	9.21	19.41	1500	72	12	70	160	--	--
06/09/93	28.62	9.42	19.20	210	6.0	2.0	7.0	16	--	--
09/10/93	28.62	--	--	73	3.0	<0.5	2.0	3.0	--	--
09/27/93	28.62	8.27	20.35	--	--	--	--	--	--	--
12/17/93	28.62	7.86	20.76	640	43	12	12	37	--	--
03/10/94	28.62	7.93	20.69	540	44	22	10	69	--	--
06/16/94	28.62	7.95	20.67	1800	63	12	18	64	--	--
09/07/94	28.62	7.79	20.83	1400	59	12	22	50	--	--
11/30/94	28.62	8.21	20.41	700	36	4.4	18	31	--	--
03/22/95	28.62	8.80	19.82	190	1.4	1.4	<0.5	<0.5	--	--
06/27/95	28.62	8.86	19.76	220	1.8	<0.5	<0.5	0.84	--	--
09/28/95	28.62	8.58	20.04	160	3.2	<0.5	0.97	2.2	--	--
12/30/95	28.62	8.32	20.30	190	0.94	<0.5	0.74	1.1	<2.5	--
02/28/96	28.62	8.73	19.89	130	<0.5	<0.5	<0.5	<0.5	<2.5	--
06/27/96	28.62	8.64	19.98	280	<0.5	1.4	<0.5	3.8	9.4	--
09/13/96	28.62	8.34	20.28	170	<0.5	<0.5	<0.5	0.89	2.7	--
12/16/96	28.62	8.15	20.47	170	<0.5	0.51	0.6	3.0	<2.5	--
03/20/97	28.62	8.72	19.90	290	1.6	0.78	1.1	1.5	3.4	--
09/08/97	28.62	8.13	20.49	140	0.52	1.5	<0.5	1.2	<2.5	--
02/16/98	28.62	8.87	19.75	64	<0.5	<0.5	<0.5	<0.5	<2.5	--
08/25/98	28.62	8.60	20.02	99	<0.5	<0.5	<0.5	1.7	<2.5	--
03/09/99	28.62	8.62	20.00	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/29/99	28.62	8.13	20.49	<50	<0.5	<0.5	<0.5	<0.5	<5.0/<2.0 ¹	--
03/27/00	28.62	8.58	20.04	89.5	0.765	0.682	<0.5	0.688	4.04	--
09/18/00	28.62	8.13	20.49	1,300 ⁵	6.9	2.8	14	28	12	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-13 (cont)										
03/27/01	28.62	8.34	20.28	<50.0	<0.500	<0.500	<0.500	<0.500	<0.500	--
09/05/01	28.62	7.96	20.66	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--
03/15/02	28.62	8.52	20.10	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--
MW-14										
11/15/91	29.46	9.13	20.33	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	29.46	8.05	21.41	<50	1.3	1.8	1.1	5.2	--	--
06/15/92	29.46	--	--	--	--	--	--	--	--	--
12/16/92	29.45	8.79	20.66	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	29.45	--	--	--	--	--	--	--	--	--
06/09/93	29.45	--	--	--	--	--	--	--	--	--
09/10/93	29.45	--	--	--	--	--	--	--	--	--
09/27/93	29.45	9.19	20.26	--	--	--	--	--	--	--
ABANDONED										
MW-15										
12/16/92	28.04	8.30	19.74	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	28.04	9.24	18.80	<50	1.3	<0.5	<0.5	<1.5	--	--
06/09/93	28.04	9.44	18.60	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	28.04	--	--	--	--	--	--	--	--	--
09/27/93	28.04	8.11	19.93	<50	2.0	<0.5	<0.5	<0.5	--	--
12/17/93	28.04	7.72	20.32	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	28.04	7.75	20.29	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/16/94	28.04	7.73	20.31	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	28.04	7.61	20.43	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	28.04	8.03	20.01	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	28.04	8.57	19.47	69	4.9	<0.5	<0.5	<0.5	--	--
06/27/95	28.04	8.70	19.34	<50	3.9	<0.5	1.4	<0.5	--	--
09/28/95	28.04	8.38	19.66	<50	0.82	<0.5	<0.5	<0.5	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (<i>ft.</i>)	GWE (<i>msl</i>)	DTW (<i>ft.</i>)	TPH-G (<i>ppb</i>)	B (<i>ppb</i>)	T (<i>ppb</i>)	E (<i>ppb</i>)	X (<i>ppb</i>)	MTBE (<i>ppb</i>)	TOG (<i>ppb</i>)
MW-15 (cont)										
12/30/95	28.04	8.10	19.94	160	7.0	1.4	<0.5	1.8	14	--
02/28/96	28.04	8.41	19.63	81	1.7	<0.5	<0.5	<0.5	<2.5	--
06/27/96	28.04	8.44	19.60	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
09/13/96	28.04	8.14	19.90	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
12/16/96	28.04	7.81	20.23	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
03/20/97	28.04	8.52	19.52	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/08/97	28.04	7.86	20.18	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
02/16/98	28.04	8.67	19.37	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
08/25/98	28.04	8.34	19.70	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
03/09/99	28.04	8.35	19.69	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/29/99	28.04	7.92	20.12	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
03/27/00	28.04	8.37	19.67	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/18/00	28.04	7.91	20.13	<50	<0.50	<0.50	<0.50	<0.50	<2.5	--
03/27/01	28.04	8.13	19.91	<50.0	<0.500	<0.500	<0.500	<0.500	<0.500	--
09/05/01	28.04	7.76	20.28	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--
03/15/02	28.04	8.33	19.71	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--
MW-16										
12/16/92	28.32	8.74	19.58	--	--	--	--	--	--	--
12/21/92	28.32	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	28.32	9.91	18.41	<50	<0.5	6.8	<0.5	<0.5	--	--
06/09/93	28.32	10.07	18.25	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	28.32	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/27/93	28.32	8.16	20.16	--	--	--	--	--	--	--
12/17/93	28.32	--	--	--	--	--	--	--	--	--
03/10/94	28.32	7.77	20.55	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/16/94	28.32	7.67	20.65	<50	0.9	0.7	<0.5	<0.5	--	--
09/07/94	28.32	7.59	20.73	150	1.3	0.8	1.2	3.6	--	--
11/30/94	28.32	8.04	20.28	4200	300	<5.0	34	350	--	--
03/22/95	28.32	8.65	19.67	2900	180	5.7	21	91	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
MW-16 (cont)										
06/27/95	28.32	8.72	19.60	2000	330	10	27	48	--	--
09/28/95	28.32	INACCESSIBLE		--	--	--	--	--	--	--
12/30/95	28.32	8.06	20.26	3100	770	39	30	80	<12	--
02/28/96	28.32	8.48	19.84	1600	320	15	11	21	<25	--
06/27/96	28.32	8.45	19.87	2900	670	48	54	86	280	--
09/13/96	28.32	8.17	20.15	1400	18	4.0	8.6	16	<10	--
12/16/96	28.32	7.53	20.79	3100	500	25	23	52	<25	--
03/20/97	28.32	8.52	19.80	3800	550	23	14	8.4	140	--
09/08/97	28.32	7.97	20.35	2800	470	28	24	41	<10	--
02/16/98	28.32	8.40	19.92	3100	570	35	27	54	<25	--
08/25/98	28.32	8.12	20.20	3500	520	43	57	75	<12	--
03/09/99	28.32	8.15	20.17	4900	750	55	40	120	<50	--
09/29/99	28.32	7.77	20.55	5480	717	45.3	44	100	<125/<10 ¹	--
03/27/00	28.32	INACCESSIBLE		--	--	--	--	--	--	--
09/18/00 ³	28.32	7.85	20.47	--	--	--	--	--	--	--
03/27/01	28.32	INACCESSIBLE		--	--	--	--	--	--	--
09/05/01 ³	28.32	8.70	19.62	6,500	710	72	45	94	<20	--
03/15/02 ³	28.32	8.28	20.04	5,800	520	60	28	68	<2.5	--
TRIP BLANK										
11/03/88	--	--	--	--	<1.0	<1.0	<1.0	<1.0	--	--
02/10/89	--	--	--	<50	<0.1	<0.1	<0.1	<0.2	--	--
04/24/89	--	--	--	<50	<0.5	<0.5	<1.0	<1.0	--	--
07/28/89	--	--	--	<50	<0.1	<0.1	<0.1	<0.2	--	--
10/30/89	--	--	--	<500	<0.3	<0.3	<0.3	<0.6	--	--
01/09/90	--	--	--	<50	<0.3	<0.3	<0.3	<0.6	--	--
04/18/90	--	--	--	<50	<0.3	<0.3	<0.3	<0.6	--	--
06/22/90	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/09/90	--	--	--	<50	<0.3	<0.3	<0.3	<0.6	--	--
11/13/90	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
TRIP BLANK (cont)										
05/15/91	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
08/27/91	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/15/91	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/20/92	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/15/92	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/92	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
04/07/93	--	--	--	<50	<0.5	<0.5	<0.5	<1.5	--	--
06/09/93	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/10/93	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/27/93	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/17/93	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/10/94	--	--	--	<50	<0.5	0.6	<0.5	0.6	--	--
06/16/94	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/07/94	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
11/30/94	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
01/17/95	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
03/22/95	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
06/27/95	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
09/28/95	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/30/95	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
02/28/96	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
06/27/96	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
09/13/96	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	--	--
12/16/96	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
03/20/97	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/08/97	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
02/16/98	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
08/25/98	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
03/09/99	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--
09/29/99	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
03/27/00	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<2.5	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	TOC (ft.)	GWE (msl)	DTW (ft.)	TPH-G (ppb)	B (ppb)	T (ppb)	E (ppb)	X (ppb)	MTBE (ppb)	TOG (ppb)
TRIP BLANK (cont)										
09/18/00	--	--	--	<50	<0.50	<0.50	<0.50	<0.50	<2.5	--
03/27/01	--	--	--	<50.0	<0.500	<0.500	<0.500	<0.500	<0.500	--
09/05/01	--	--	--	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--
QA										
03/15/02	--	--	--	<50	<0.50	<0.50	<0.50	<1.5	<2.5	--

Table 1
Groundwater Monitoring Data and Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

EXPLANATIONS:

Groundwater monitoring data and analytical results prior to September 18, 2000, were compiled from reports prepared by Blaine Tech Services, Inc.

TOC = Top of Casing

(ft.) = Feet

GWE = Groundwater Elevation

(msl) = Mean sea level

DTW = Depth to Water

TPH-G = Total Petroleum Hydrocarbons as Gasoline

B = Benzene

T = Toluene

E = Ethylbenzene

X = Xylenes

MTBE = Methyl tertiary butyl ether

TOG = Total Oil and Grease

(ppb) = Parts per billion

-- = Not Measured/Not Analyzed

(D) = Duplicate

QA = Quality Assurance

- 1 Confirmation run.
- 2 ORC installed.
- 3 ORC in well.
- 4 Laboratory report indicates gasoline C6-C12.
- 5 Laboratory report indicates gasoline C6-C12 + unidentified hydrocarbons C6-C12.

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1,2-DCE (ppb)	t-1,2-DCE (ppb)	c-1,2-DCE (ppb)	1,1,1-TCA (ppb)	1,2-DCA (ppb)	1,2-DCP (ppb)	1,1-DCE (ppb)
MW-1											
11/03/88	18	7.0	<1.0	<1.0	--	<1.0	--	<1.0	<1.0	--	--
02/10/89	17	6.0	<0.2	<0.2	--	<0.2	<0.2	<0.2	<0.2	--	--
04/24/89	16	6.0	<1.0	<1.0	<1.0	--	--	<1.0	<1.0	--	--
07/28/89	20	6.4	<0.1	<0.1	--	<0.1	<0.1	0.3	<0.1	--	--
10/30/89	11	4.9	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
01/09/90	24	7.2	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
04/18/90	23	5.5	<0.5	<0.5	<0.5	--	--	1.4	<0.5	<0.5	<0.5
08/09/90	32	11	0.7	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	24	7.0	60.7	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05/15/91	15	5.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
08/27/91	18	4.2	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	21	7.9	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	24	7.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	10	3.2	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-2											
11/03/88	3.0	2.0	34	3.0	--	10	--	<1.0	<1.0	--	--
02/10/89	1.4	1.0	17.2	<0.2	--	<0.2	6.3	<0.2	<0.2	--	--
04/24/89	2.0	2.0	38	3.0	9.0	--	--	<1.0	<1.0	--	--
07/28/89	3.7	2.0	46	2.6	--	<0.2	<0.2	<0.2	<0.2	--	--
10/30/89	1.4	2.6	53	1.1	14	--	--	<0.5	<0.5	--	--
01/09/90	3.6	3.9	78	5.3	16	--	--	<0.5	<0.5	--	--
04/18/90	1.5	2.7	130	3.9	19	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	2.1	2.1	74	6.1	15	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	<0.5	2.0	40	4.0	--	<0.5	10	<0.5	<0.5	<0.5	<0.5
05/15/91	2.0	2.0	56	6.0	--	<0.5	15	<0.5	<0.5	<0.5	<0.5
08/27/91	1.1	0.9	46	3.9	--	--	8.0	<0.5	<0.5	<0.5	<0.5
11/15/91	0.6	1.1	58	3.1	--	<0.5	6.3	<0.5	<0.5	<0.5	<0.5
02/20/92	11	<2.5	62	3.1	--	<2.5	4.3	<2.5	<2.5	<2.5	<2.5
06/15/92	<0.5	1.2	45	3.1	--	<0.5	4.8	<0.5	<0.5	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1,2-DCE (ppb)	1,1,2-DCE (ppb)	c-1,2-DCE (ppb)	1,1,1-TCA (ppb)	1,2-DCA (ppb)	1,2-DCP (ppb)	1,1-DCE (ppb)
MW-3											
11/03/88	8.0	6.0	84	3.0	--	5.0	--	<1.0	<1.0	--	--
02/10/89	5.8	4.0	53	1.9	--	<0.2	9.0	<0.2	<0.2	--	--
04/24/89	7.0	6.0	110	3.0	11	--	--	<1.0	<1.0	--	--
07/28/89	8.6	5.0	49	2.1	--	<0.2	11	<0.2	<0.1	--	--
10/30/89	5.6	5.3	62	0.7	8.2	--	--	<0.5	<0.5	--	--
01/09/90	8.6	6.1	81	73.8	8.7	--	--	<0.5	<0.5	--	--
04/18/90	7.6	5.8	120	2.4	11	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	11	6.7	81	5.1	11	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	7.0	5.0	43	4.0	--	<0.5	9.0	<0.5	<0.5	<0.5	<0.5
05/15/91	6.0	4.0	46	3.0	--	<0.5	8.0	<0.5	<0.5	<0.5	<0.5
08/27/91	5.5	3.8	43	2.6	--	--	8.1	<0.5	<0.5	<0.5	<0.5
11/15/91	6.3	5.0	67	3.4	--	0.8	7.4	0.9	<0.5	<0.5	<0.5
02/20/92	2.8	4.0	96	3.0	--	<2.5	6.1	<2.5	<2.5	<2.5	<2.5
06/15/92	5.0	3.9	86	2.9	--	<0.5	7.5	<0.5	<0.5	<0.5	<0.5
MW-4											
04/24/89	35	11	<1.0	<1.0	<1.0	--	--	<1.0	<1.0	--	--
07/28/89	32	9.3	<0.1	<0.1	--	<0.1	<0.1	<0.1	<0.1	--	--
10/30/89	32	8.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
01/09/90	36	9.8	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
04/18/90	41	9.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	38	11	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	40	11	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05/15/91	35	10	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
08/27/91	28	6.1	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	23	9.1	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	400	140	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	38	11	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1,2-DCE (ppb)	c-1,2-DCE (ppb)	e-1,2-DCE (ppb)	1,1,1-TCA (ppb)	1,2-DCA (ppb)	1,2-DCP (ppb)	1,1-DCE (ppb)
MW-5											
04/24/89	4.0	5.0	4.0	<1.0	2.0	--	--	<1.0	<1.0	--	--
07/28/89	5.6	4.0	5.3	0.3	--	<0.2	2.3	0.5	<0.2	--	--
10/30/89	2.9	2.0	2.7	<0.5	0.86	--	--	<0.5	<0.5	--	--
01/09/90	8.2	4.6	7.8	0.6	3.1	--	--	<0.5	<0.5	--	--
04/18/90	6.3	2.8	2.6	<0.5	1.7	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	11	4.8	6.0	<0.5	2.3	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	7.0	3.0	5.0	<0.5	--	<0.5	1	<0.5	<0.5	<0.5	<0.5
05/15/91	4.0	2.0	3.0	<0.5	--	<0.5	0.8	<0.5	<0.5	<0.5	<0.5
08/27/91	3.3	1.1	2.3	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	5.7	2.8	5.5	<0.5	--	<0.5	1.7	<0.5	<0.5	<0.5	<0.5
02/20/92	4.0	2.0	3.9	<0.5	--	<0.5	0.7	<0.5	<0.5	<0.5	<0.5
06/15/92	4.0	2.0	5.0	<0.5	--	<0.5	1.4	<0.5	<0.5	<0.5	<0.5
MW-6											
04/24/89	13	7.0	<1.0	<1.0	<1.0	--	--	<1.0	<1.0	--	--
07/28/89	9.6	4.0	<0.2	<0.2	--	<0.2	<0.2	0.5	0.6	--	--
10/30/89	8.2	3.6	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
01/09/90	10	4.2	<0.5	<0.5	<0.5	--	--	<0.5	1.8	--	--
04/18/90	11	3.8	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	20	6.6	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	15	5.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05/15/91	11	4.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
08/27/91	8.0	2.2	2.4	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	13	5.4	<0.5	<0.5	--	<0.5	<0.5	<0.5	0.8	<0.5	<0.5
02/20/92	11	4.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	9.6	4.2	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1, 2-DCE (ppb)	1-1, 2-DCE (ppb)	c-1, 2-DCE (ppb)	1, 1, 1-TCA (ppb)	1,2-DCA (ppb)	1, 2-DCP (ppb)	1,1-DCE (ppb)
MW-7											
04/24/89	3.0	9.0	<1.0	<1.0	<1.0	--	--	<1.0	<1.0	--	--
07/28/89	<2.0	<10	<2.0	<2.0	--	<2.0	<2.0	<10	6.0	--	--
07/28/89	<5.0	<20	<5.0	<5.0	--	<5.0	<0.5	<5.0	<5.0	--	--
10/30/89	<1.0	3.9	<1.0	<1.0	<1.0	--	--	<1.0	6.4	--	--
10/30/89	<1.0	3.1	<1.0	<1.0	<1.0	--	--	<1.0	6.2	--	--
01/09/90	<0.5	3.0	<0.5	<0.5	<0.5	--	--	<0.5	8.4	--	--
04/18/90	<0.5	3.2	<0.5	<0.5	<0.5	--	--	<0.5	7.7	0.6	0.6
08/09/90	3.3	7.7	<0.5	<0.5	<0.5	--	--	<0.5	8.4	<0.5	<0.5
11/13/90	0.6	3.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	4.0	<0.5	<0.5
05/15/91	2.0	2.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	3.0	<0.5	<0.5
08/27/91	0.7	2.8	<0.5	<0.5	--	--	<0.5	<0.5	2.7	<0.5	<0.5
11/15/91	0.8	2.7	<0.5	<0.5	--	<0.5	<0.5	<0.5	3.1	<0.5	<0.5
02/20/92	2.2	1.9	<0.5	<0.5	--	<0.5	<0.5	<0.5	3.3	<0.5	<0.5
06/15/92	1.1	1.8	<0.5	<0.5	--	<0.5	<0.5	<0.5	4.5	<0.5	<0.5
MW-8											
04/24/89	2.0	3.0	6.0	<1.0	4.0	--	--	<1.0	<1.0	--	--
04/24/89	2.0	2.0	6.0	<1.0	3.0	--	--	<1.0	<1.0	--	--
07/28/89	2.3	2.0	5.6	<0.2	--	<0.2	3.8	<0.2	<0.2	--	--
10/30/89	2.5	2.6	8.0	<0.5	5.5	--	--	<0.5	<0.5	--	--
01/09/90	4.9	3.9	19	0.9	6.6	--	--	<0.5	<0.5	--	--
04/18/90	3.8	2.8	17	0.6	5.7	--	--	<0.5	<0.5	<0.5	<0.5
08/09/90	5.3	4.4	27	1.2	9.2	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	3.0	2.0	21	0.7	--	<0.5	6.0	<0.5	<0.5	<0.5	<0.5
05/15/91	2.0	2.0	30	0.9	--	<0.5	6.0	<0.5	<0.5	<0.5	<0.5
08/27/91	1.4	1.1	32	1.0	--	--	4.7	<0.5	<0.5	<0.5	<0.5
11/15/91	1.5	1.9	50	<0.5	--	<0.5	5.8	<0.5	<0.5	2.0	2.0
02/20/92	1.3	2.3	68	2.4	--	<0.5	7.6	<0.5	<0.5	<0.5	<0.5
06/15/92	0.7	1.9	46	1.6	--	<0.5	5.6	<0.5	--	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1,2-DCE (ppb)	t-1,2-DCE (ppb)	c-1,2-DCE (ppb)	1,1,1-TCA (ppb)	1,2-DCA (ppb)	1,2-DCP (ppb)	1,1-DCE (ppb)
MW-9											
06/22/90	<0.5	<0.5	<0.5	<0.5	--	<0.5	--	<0.5	<0.5	<0.5	<0.5
08/09/90	<0.5	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	0.71	<0.5	<0.5
11/13/90	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	1.0	<0.5	<0.5
05/15/91	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	0.5	<0.5	<0.5
08/27/91	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	0.6	<0.5	<0.5
02/20/92	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-10											
06/22/90	9.6	8.9	<0.5	<0.5	--	<0.5	--	<0.5	<0.5	<0.5	<0.5
08/09/90	11	7.8	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	5.0	4.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05/15/91	5.0	4.0	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
08/27/91	6.9	3.4	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5
11/15/91	2.7	3.3	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	3.3	3.4	3.0	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	4.5	2.9	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-11											
06/22/90	4.6	6.5	73	1.3	--	<0.5	8.9	<0.5	<0.5	<0.5	<0.5
08/09/90	8.1	6.8	84	2.0	4.6	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	<0.5	<0.5	39	<0.5	--	<0.5	2.0	5	<0.5	<0.5	<0.5
05/15/91	1.0	3.0	7	0.5	--	<0.5	2.0	<0.5	<0.5	<0.5	<0.5
08/27/91	4.1	3.3	73	1.0	--	--	2.4	<0.5	<0.5	<0.5	<0.5
11/15/91	3.3	3.6	64	0.9	--	<0.5	2.3	<0.5	<0.5	<0.5	<0.5
02/20/92	<2.5	<2.5	62	<2.5	--	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5
06/15/92	--	--	--	--	--	--	--	--	--	--	--

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1,2-DCE (ppb)	i-1,2-DCE (ppb)	c-1,2-DCE (ppb)	1,1,1-TCA (ppb)	1,2-DCA (ppb)	1,2-DCP (ppb)	1,1-DCE (ppb)
MW-12											
06/22/90	6.0	7.3	7.4	<0.5	--	<0.5	13	<0.5	<0.5	<0.5	<0.5
08/09/90	8.0	7.0	6.7	<0.5	5.8	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	<0.5	<0.5	9.0	<0.5	--	<0.5	3.0	3.0	<0.5	<0.5	<0.5
05/15/91	4.0	4.0	10	<0.5	--	<0.5	3.0	<0.5	<0.5	<0.5	<0.5
08/27/91	3.1	2.6	10	<0.5	--	--	2.3	<0.5	<0.5	<0.5	<0.5
11/15/91	1.9	3.5	8.9	<0.5	--	<0.5	5.9	<0.5	<0.5	<0.5	<0.5
02/20/92	3.3	3.4	3.7	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	2.2	3.7	13	<0.5	--	<0.5	4.5	<0.5	<0.5	<0.5	<0.5
MW-13											
11/15/91	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-14											
11/15/91	<0.5	5.5	33	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	<0.5	4.3	38	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	--	--	--	--	--	--	--	--	--	--	--
TRIP BLANK											
11/03/88	<1.0	<1.0	<1.0	<1.0	--	<1.0	--	<1.0	<1.0	--	--
02/10/89	<0.1	<0.5	<0.1	<0.1	--	<0.1	<0.1	<0.1	<0.1	--	--
04/24/89	<1.0	<1.0	<1.0	<1.0	<1.0	--	--	<1.0	<1.0	--	--
07/28/89	<0.1	<0.5	<0.1	<0.5	<0.1	--	<0.1	<0.1	<0.1	--	--
10/30/89	<0.5	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
01/09/90	<0.5	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	--	--
04/18/90	<0.5	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
06/22/90	<0.5	<0.5	<0.5	<0.5	--	<0.5	--	<0.5	<0.5	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	Carbon Tet (ppb)	Chloroform (ppb)	PCE (ppb)	TCE (ppb)	1, 2,-DCE (ppb)	i-1, 2-DCE (ppb)	c-1, 2-DCE (ppb)	1, 1, 1-TCA (ppb)	1,2-DCA (ppb)	1, 2-DCP (ppb)	1,1-DCE (ppb)
TRIP BLANK (cont)											
08/09/90	<0.5	<0.5	<0.5	<0.5	<0.5	--	--	<0.5	<0.5	<0.5	<0.5
11/13/90	<0.5	0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05/15/91	--	--	--	--	--	--	--	--	--	--	--
08/27/91	--	--	--	--	--	--	--	--	--	--	--
11/15/91	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02/20/92	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06/15/92	<0.5	<0.5	<0.5	<0.5	--	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5

Table 2
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

EXPLANATIONS:

Groundwater analytical results were compiled from reports prepared by Blaine Tech Services, Inc.

Carbon Tet = Carbon Tetrachloride

PCE = Tetrachloroethene

TCE = Trichloroethene

1,2-DCE = 1,2-Dichloroethene

t-1,2-DCE = trans-1,2-Dichloroethene

c-1,2-DCE = cis-1,2-Dichloroethene

1,1,1-TCA = 1,1,1-Trichloroethane

1,2-DCA = 1,2-Dichloroethane

1,2-DCP = 1,2-Dichloropropane

1,1-DCE = 1,1-Dichloroethene

MC = Methylene chloride

-- = Not Analyzed

Table 3
Groundwater Analytical Results
Former Chevron Service Station #9-0020
1633 Harrison Street
Oakland, California

WELL ID/ DATE	2-butanone	Acetone	1,1- DCE	1,1- DCA	Chloro- benzene
MW-3 08/27/91	--	--	1.3	0.5	0.7
MW-7 04/24/89	160	5.0	--	--	--
MW-13 11/15/91	--	--	--	0.6	--

EXPLANATIONS:

Groundwater analytical results were compiled from reports prepared by Blaine Tech Services, Inc.

1,1-DCE = 1,1-Dichloroethene

1,1-DCA = 1,1-Dichloroethane

MC = Methylene chloride

-- = Not Analyzed

STANDARD OPERATING PROCEDURE - GROUNDWATER SAMPLING

Gettler-Ryan Inc. field personnel adhere to the following procedures for the collection and handling of groundwater samples prior to analysis by the analytical laboratory. Prior to sample collection, the type of analysis to be performed is determined. Loss prevention of volatile compounds is controlled and sample preservation for subsequent analysis is maintained.

Prior to sampling, the presence or absence of free-phase hydrocarbons is determined using an interface probe. Product thickness, if present, is measured to the nearest 0.01 foot and is noted in the field notes. In addition, static water level measurements are collected with the interface probe and are also recorded in the field notes.

After water levels are collected and prior to sampling, each well is purged a minimum of three well casing volumes of water using pre-cleaned pumps (stack, suction, Grundfos), or polyvinyl chloride bailers. Temperature, pH and electrical conductivity are measured a minimum of three times during the purging. Purging continues until these parameters stabilize.

Groundwater samples are collected using Chevron-designated disposable bailers. The water samples are transferred from the bailer into appropriate containers. Pre-preserved containers, supplied by analytical laboratories, are used when possible. When pre-preserved containers are not available, the laboratory is instructed to preserve the sample as appropriate. Duplicate samples are collected for the laboratory to use in maintaining quality assurance/quality control standards. The samples are labeled to include the job number, sample identification, collection date and time, analysis, preservation (if any), and the sample collector's initials. The water samples are placed in a cooler, maintained at 4°C for transport to the laboratory. Once collected in the field, all samples are maintained under chain of custody until delivered to the laboratory.

The chain of custody document includes the job number, type of preservation, if any, analysis requested, sample identification, date and time collected, and the sample collector's name. The chain of custody is signed and dated (including time of transfer) by each person who receives or surrenders the samples, beginning with the field personnel and ending with the laboratory personnel.

A laboratory supplied trip blank accompanies each sampling set. For sampling sets greater than 20 samples, 5% trip blanks are included. The trip blank is analyzed for some or all of the same compounds as the groundwater samples.

As requested by Chevron Products Company, the purge water and decontamination water generated during sampling activities is transported by IWM to McKittrick Waste Management located in McKittrick, California.

WELL MONITORING/SAMPLING
FIELD DATA SHEET.

DE-WATERED

CHEVRON
Facility # 9-0020
Address: 1633 Harrison St.
City: Oakland, CA

Job#: 386499
Date: 3/15/02
Sampler: TL

Well ID MW-7
Well Diameter 2 1/4 in.
Total Depth 26.00 ft.
Depth to Water 19.85 ft.

Well Condition: o.k
Hydrocarbon Thickness: 0 (feet) Amount Bailed (product/water): 0 (Gallons)
Volume Factor (VF) 2" = 0.17 3" = 0.38 4" = 0.66
6" = 1.50 12" = 5.80

6.15 x VF .66 = 4.0 x 3 (case volume) = Estimated Purge Volume: 12.0 (gal.)

Purge Equipment: Disposable Bailer
Bailer
~~Stack~~
Suction
Grundfos
Other: _____

Sampling Equipment: ~~Disposable Bailer~~
~~Bailer~~
~~Pressure Bailer~~
~~Grab Sample~~
Other: _____
well DE-WATERED

Starting Time: 0736
Sampling Time: N/A
Purging Flow Rate: 2.0 gpm.
Did well de-water? yes

Weather Conditions: Partly Cloudy
Water Color: _____ Odor: _____
Sediment Description: _____
If yes; Time: 0738 Volume: 4.0 (gal.)

Time	Volume (gal.)	pH	Conductivity μ mhos/cm	Temperature $^{\circ}$ F	D.O. (mg/L)	ORP (mV)	Alkalinity (ppm)
<u>0738</u>	<u>4.0</u>	<u>7.40</u>	<u>1264</u>	<u>68.4</u>			
<u>/</u>	<u>8.0</u>	<u>/</u>	<u>/</u>	<u>/</u>			
<u>/</u>	<u>12.0</u>	<u>/</u>	<u>/</u>	<u>/</u>			

LABORATORY INFORMATION

SAMPLE ID	(#) - CONTAINER	REFRIG.	PRESERV. TYPE	LABORATORY	ANALYSES
<u>MW-7</u>	<u>3 X VOA VIAL</u>	<u>Y</u>	<u>HCl</u>	<u>LANCASTER</u>	<u>TPH(GI)/bTEX/mTBE</u>

COMMENTS: Took total well depth. / ORC IN WELL. / well DE-WATERED
waited almost 1hr AND well DID NOT RECOVER. UNABLE TO
probe AND sample well.

**WELL MONITORING/SAMPLING
FIELD DATA SHEET.**

CHEVRON

Facility # 9-0020

Job#: 386499

Address: 1633 Harrison St.

Date: 3/15/02

City: Oakland, CA

Sampler: TC

Well ID MW-9

Well Condition: ok

Well Diameter 8 1/4 in.

Hydrocarbon Thickness: 0 (feet) Amount Bailed (product/water): 0 (Gallons)

Total Depth 23.95 ft.

Depth to Water 20.61 ft.

Volume Factor (VF)	2" = 0.17	3" = 0.38	4" = 0.66
	6" = 1.50	12" = 5.80	

3.34 x VF .17 = .56 X 3 (case volume) = Estimated Purge Volume: 1.5 (gal.)

Purge Equipment: Disposable Bailer
 Bailer
 Stack
 Suction
 Grundfos
 Other: _____

Sampling Equipment: Disposable Bailer
 Bailer
 Pressure Bailer
 Grab Sample
 Other: _____

Starting Time: 0849
 Sampling Time: 0855
 Purging Flow Rate: _____ gpm.
 Did well de-water? NO

Weather Conditions: clear
 Water Color: cloudy Odor: yes
 Sediment Description: _____
 If yes; Time: _____ Volume: _____ (gal.)

Time	Volume (gal.)	pH	Conductivity $\mu\text{mhos/cm}$	Temperature $^{\circ}\text{F}$	D.O. (mg/L)	ORP (mV)	Alkalinity (ppm)
<u>0848</u>	<u>.50</u>	<u>7.26</u>	<u>1248</u>	<u>69.2</u>			
<u>0849</u>	<u>1.0</u>	<u>7.12</u>	<u>1262</u>	<u>68.6</u>			
<u>0850</u>	<u>1.50</u>	<u>7.06</u>	<u>1271</u>	<u>68.0</u>			

LABORATORY INFORMATION

SAMPLE ID	(#) CONTAINER	REFRIG.	PRESERV. TYPE	LABORATORY	ANALYSES
<u>MW-9</u>	<u>3 X VOA VIAL</u>	<u>Y</u>	<u>HCL</u>	<u>LANCASTER</u>	<u>TPH(G)/bTEX/mtbe</u>

COMMENTS: TOOK TOTAL WELL DEPTH / ORC IN WELL.

**WELL MONITORING/SAMPLING
FIELD DATA SHEET.**

CHEVRON

Facility # 9-0020

Job#: 386499

Address: 1633 Heerison St.

Date: 3/15/02

City: Oakland, CA

Sampler: TC

Well ID MW-13

Well Condition: o.k / 1-Broken FLANGE

Well Diameter ⑤ 1.4 in.

Hydrocarbon Thickness: 0 (feet) Amount Bailed (product/water): 0 (Gallons)

Total Depth 26.50 ft.

Depth to Water 20.10 ft.

Volume Factor (VF)	2" = 0.17	3" = 0.38	4" = 0.66
	6" = 1.50	12" = 5.80	

6.40 x VF .17 = 1.0 x 3 (case volume) = Estimated Purge Volume: 3.0 (gal.)

Purge Equipment: Disposable Bailer
 Bailer
 Stack
 Suction
 Grundfos
 Other: _____

Sampling Equipment: Disposable Bailer
 Bailer
 Pressure Bailer
 Grab Sample
 Other: _____

Starting Time: 0910

Weather Conditions: clear

Sampling Time: 0920

Water Color: cloudy Odor: SLIGHT

Purging Flow Rate: _____ gpm.

Sediment Description: _____

Did well de-water? no

If yes; Time: _____ Volume: _____ (gal.)

Time	Volume (gal.)	pH	Conductivity μ mhos/cm	Temperature $^{\circ}$ F	D.O. (mg/L)	ORP (mV)	Alkalinity (ppm)
<u>0912</u>	<u>1.0</u>	<u>7.16</u>	<u>1164</u>	<u>68.2</u>	_____	_____	_____
<u>0914</u>	<u>2.0</u>	<u>7.12</u>	<u>1296</u>	<u>67.4</u>	_____	_____	_____
<u>0916</u>	<u>3.0</u>	<u>7.01</u>	<u>1288</u>	<u>67.6</u>	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____	_____

LABORATORY INFORMATION

SAMPLE ID	(#) CONTAINER	REFRIG.	PRESERV. TYPE	LABORATORY	ANALYSES
<u>MW-13</u>	<u>3 X VOA VIAL</u>	<u>Y</u>	<u>HCL</u>	<u>LANCASTER</u>	<u>TPH(G)/ttx/mrbe</u>
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____

COMMENTS: well has 1-Broken FLANGE. old type - EMCO WILKATON A721-00
Took TOTAL well Depth.

**WELL MONITORING/SAMPLING
FIELD DATA SHEET.**

CHEVRON

Facility # 9-0020

Job#: 386499

Address: 1633 Harrison St.

Date: 3/15/02

City: Oakland, CA

Sampler: TC

Well ID MW-15

Well Condition: MISSING LID, LID TYPE UNUSUAL VALUE SEE PICTURES NO 65 12

Well Diameter Ø 14 in.

Hydrocarbon Thickness: Ø (feet) Amount Bailed (product/water): Ø (Gallons)

Total Depth 26.05 ft.

Depth to Water 19.71 ft.

Volume Factor (VF)	2" = 0.17	3" = 0.38	4" = 0.66
	6" = 1.50	12" = 5.80	

6.34 x VF 0.17 = 1.0 x 3 (case volume) = Estimated Purge Volume: 3.0 (gal.)

Purge Equipment: Disposable Bailer
Bailer
Stack
Suction
Grundfos
Other: _____

Sampling Equipment: Disposable Bailer
Bailer
Pressure Bailer
Grab Sample
Other: _____

Starting Time: 0934

Weather Conditions: Partly Cloudy

Sampling Time: 0745

Water Color: Cloudy Odor: NO

Purging Flow Rate: _____ gpm.

Sediment Description: _____

Did well de-water? NO

If yes: Time: _____ Volume: _____ (gal.)

Time	Volume (gal.)	pH	Conductivity $\mu\text{mhos/cm}$	Temperature $^{\circ}\text{F}$	D.O. (mg/L)	ORP (mV)	Alkalinity (ppm)
<u>0936</u>	<u>1.0</u>	<u>7.14</u>	<u>1226</u>	<u>67.4</u>			
<u>0738</u>	<u>2.0</u>	<u>7.02</u>	<u>1388</u>	<u>67.9</u>			
<u>0740</u>	<u>3.0</u>	<u>6.98</u>	<u>1396</u>	<u>67.6</u>			

LABORATORY INFORMATION

SAMPLE ID	INSTR. CONTAINER	REFRIG.	PRESERV. TYPE	LABORATORY	ANALYSES
<u>MW-15</u>	<u>3 X VOA VIAL</u>	<u>Y</u>	<u>HCL</u>	<u>LANCASTER</u>	<u>TPH(G)/TEX/MTBE</u>

COMMENTS: ARRIVED ON SITE AND FOUND THAT LID WAS MISSING AND WELL BOX WAS FULL OF WATER, LOCK AND PLUG ARE INTACT, LID TYPE IS UNUSUAL VALUE W/ 2 BOLT HOLES NO. 65 12 *SEE PICTURES OF MW-15? 16
WELL BOX IS O.K. TOOK TOTAL WELL DEPTH,

**WELL MONITORING/SAMPLING
FIELD DATA SHEET.**

CHEVRON

Facility # 9-0020

Job#: 386499

Address: 1633 Harrison St.

Date: 3/15/02

City: Oakland, CA

Sampler: RC

Well ID MW-16

Well Condition: O.K. 1-Broken Flange

Well Diameter 2.14 in.

Hydrocarbon Thickness: 0 (feet) Amount Bailed (product/water): 0 (Gallons)

Total Depth 25.41 ft.

Depth to Water 20.04 ft.

Volume Factor (VF)	2" = 0.17	3" = 0.38	4" = 0.66
	6" = 1.50	12" = 5.80	

5.37 x VF .17 = .91 x 3 (case volume) = Estimated Purge Volume: 2.5 (gal.)

Purge Equipment: Disposable Bailer
 Bailer
 Stack
 Suction
 Grundfos
 Other: _____

Sampling Equipment: Disposable Bailer
 Bailer
 Pressure Bailer
 Grab Sample
 Other: _____

Starting Time: 0951

Weather Conditions: Partly Cloudy

Sampling Time: 1004

Water Color: cloudy Odor: YES

Purging Flow Rate: _____ gpm.

Sediment Description: _____

Did well de-water? NO

If yes; Time: _____ Volume: _____ (gal.)

Time	Volume (gal.)	pH	Conductivity $\mu\text{mhos/cm}$	Temperature $^{\circ}\text{F}$	D.O. (mg/L)	ORP (mV)	Alkalinity (ppm)
<u>0953</u>	<u>1.0</u>	<u>7.42</u>	<u>1288</u>	<u>66.9</u>			
<u>0955</u>	<u>2.0</u>	<u>7.31</u>	<u>1299</u>	<u>67.2</u>			
<u>0958</u>	<u>2.5</u>	<u>7.26</u>	<u>1315</u>	<u>67.0</u>			

LABORATORY INFORMATION

SAMPLE ID	(#): CONTAINER	REFRIG.	PRESERV. TYPE	LABORATORY	ANALYSES
<u>MW-16</u>	<u>3 X VOA VIAL</u>	<u>Y</u>	<u>HCL</u>	<u>LANCASTER</u>	<u>TPH(G)/tex/mtbe</u>

COMMENTS: ORC IN well / 1-Broken Flange Universal Valve /
TOOK TOTAL well Depth.

Chevron California Region Analysis Request/Chain of Custody



180302-008

Acct. #: 10905 For Lancaster Laboratories use only
 Sample #: 3790761-55 SCR#: _____

Facility #: <u>9-0020</u> Job # <u>386499</u> Global ID # <u>T0600100304</u>			Matrix <input type="checkbox"/> Potable <input type="checkbox"/> NPDES <input type="checkbox"/> Water <input type="checkbox"/> Oil <input type="checkbox"/> Air <input type="checkbox"/>			Analyses Requested										Preservative Codes H = HCl T = Thiosulfate N = HNO ₃ B = NaOH S = H ₂ SO ₄ O = Other																																		
Site Address: <u>1633 HARRISON ST., OAKLAND, CA</u>						Preservation Codes																																												
Chevron PM: <u>Tom Bauhs</u> Lead Consultant: <u>Delta/G-R</u>			Total Number of Containers			<input checked="" type="checkbox"/> BTEX + MTBE 8260 <input type="checkbox"/> 8021 <input type="checkbox"/> TPH 8015 MOD GRO <input type="checkbox"/> Silica Gel Cleanup <input type="checkbox"/> TPH 8015 MOD DRO <input type="checkbox"/> 8260 full scan <input type="checkbox"/> Oxygenates <input type="checkbox"/> Lead 7420 <input type="checkbox"/> 7421										<input type="checkbox"/> J value reporting needed <input type="checkbox"/> Must meet lowest detection limits possible for 8260 compounds 8021 MTBE Confirmation <input type="checkbox"/> Confirm highest hit by 8260 <input type="checkbox"/> Confirm all hits by 8260 <input type="checkbox"/> Run ___ oxy s on highest hit <input type="checkbox"/> Run ___ oxy s on all hits																																		
Consultant/Office: <u>G-R, Inc., 6747 Sierra Court, Dublin, Ca 94568</u>																																																		
Consultant Prj. Mgr.: <u>Deanna L. Harding</u> (Deanna@grinc.com)			Grab <input type="checkbox"/> Composite <input type="checkbox"/>			Sample Identification										Comments / Remarks																																		
Consultant Phone #: <u>925-551-7555</u> Fax #: <u>925-551-7899</u>																																																		
Sampler: <u>TONY CAMARDA</u>			Date Collected			Time Collected			<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>DA</th> <th>MW-9</th> <th>MW-13</th> <th>MW-15</th> <th>MW-16</th> </tr> </thead> <tbody> <tr> <td>3/15/02</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>0855</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>0920</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>0945</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>1004</td> <td></td> <td></td> <td></td> </tr> </tbody> </table>										DA	MW-9	MW-13	MW-15	MW-16	3/15/02						0855					0920					0945					1004				Service Order #: _____ <input type="checkbox"/> Non SAR: _____	
DA	MW-9	MW-13																	MW-15	MW-16																														
3/15/02																																																		
	0855																																																	
	0920																																																	
	0945																																																	
	1004																																																	
Turnaround Time Requested (TAT) (please circle)																																																		
<u>STD. TAT</u> 72 hour 48 hour 24 hour 4 day 5 day			Relinquished by: <u>[Signature]</u> Date: <u>3/15/02</u> Time: <u>1320</u>			Received by: <u>[Signature]</u> Date: <u>3/18/02</u> Time: <u>1223</u>																																												
Data Package Options (please circle if required)			Relinquished by: <u>[Signature]</u> Date: <u>3/18/02</u> Time: <u>1405</u>			Received by: <u>Andreas Amayze</u> Date: <u>3-18-02</u> Time: <u>1405</u>																																												
QC Summary Type I — Full Type VI (Raw Data) <input type="checkbox"/> Coelt Deliverable not needed WIP (RWQCB) Disk			Relinquished by: <u>[Signature]</u> Date: <u>3-18-02</u> Time: <u>1530</u>			Received by: <u>Airborne</u> Date: <u>3-18-02</u> Time: _____																																												
Relinquished by Commercial Carrier: <u>Airborne</u>			Received by: <u>[Signature]</u> Date: <u>03/19/02</u> Time: <u>0855</u>			Temperature Upon Receipt: <u>1-2.5 °C</u>			Custody Seals Intact? <u>Yes</u> No																																									



ANALYTICAL RESULTS

Prepared for:

Chevron Products Company
6001 Bollinger Canyon Road
Building L PO Box 6004
San Ramon CA 94583-0904
925-842-8582

Prepared by:

Lancaster Laboratories
2425 New Holland Pike
Lancaster, PA 17605-2425

RECEIVED

MAR 20 2002

GETTLER-RYAN INC.
GENERAL CONTRACTORS

SAMPLE GROUP

The sample group for this submittal is 800814. Samples arrived at the laboratory on Tuesday, March 19, 2002. The PO# for this group is 99011184 and the release number is BAUHS.

Client Description

QA-T-020315	NA	Water
MW-9-W-020315	Grab	Water
MW-13-W-020315	Grab	Water
MW-15-W-020315	Grab	Water
MW-16-W-020315	Grab	Water

Lancaster Labs Number

3790751
3790752
3790753
3790754
3790755

METHODOLOGY

The specific methodologies used in obtaining the enclosed analytical results are indicated on the laboratory chronicles.

1 COPY TO

Delta C/O Gettler-Ryan

Attn: Deanna L. Harding



Lancaster Laboratories, Inc.
2425 New Holland Pike
PO Box 12425
Lancaster, PA 17605-2425
717-656-2300 Fax: 717-656-2681



Questions? Contact your Client Services Representative
Teresa M Lis at (717) 656-2300.

Respectfully Submitted,

Victoria M Martell
Victoria M. Martell
Chemist



Lancaster Laboratories, Inc.
2425 New Holland Pike
PO Box 12425
Lancaster, PA 17605-2425
717-656-2300 Fax: 717-656-2681



Lancaster Laboratories Sample No. WW 3790751

Collected: 03/15/2002 00:00

Account Number: 10905

Submitted: 03/19/2002 08:50
 Reported: 03/27/2002 at 21:08
 Discard: 04/27/2002
 QA-T-020315 NA Water

Chevron Products Company
 6001 Bollinger Canyon Road
 Building L PO Box 6004
 San Ramon CA 94583-0904

Facility# 90020 Job# 386499 GRD
 1633 HARRISON-OAKLAND T0600100304 QA

CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit	Units	Dilution Factor
01729	TPH-GRO - Waters					
01730	TPH-GRO - Waters	n.a.	N.D.	50.	ug/l	1
	The reported concentration of TPH-GRO does not include MTBE or other gasoline constituents eluting prior to the C6 (n-hexane) TPH-GRO range start time.					
	A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.					
08214	BTEX, MTBE (8021)					
00776	Benzene	71-43-2	N.D.	0.50	ug/l	1
00777	Toluene	108-88-3	N.D.	0.50	ug/l	1
00778	Ethylbenzene	100-41-4	N.D.	0.50	ug/l	1
00779	Total Xylenes	1330-20-7	N.D.	1.5	ug/l	1
00780	Methyl tert-Butyl Ether	1634-04-4	N.D.	2.5	ug/l	1
	A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.					

State of California Lab Certification No. 2116

Laboratory Chronicle

CAT No.	Analysis Name	Method	Trial#	Analysis Date and Time	Analyst	Dilution Factor
01729	TPH-GRO - Waters	N. CA LUFT Gasoline Method	1	03/23/2002 04:39	John B Kiser	1
08214	BTEX, MTBE (8021)	SW-846 8021B	1	03/23/2002 04:39	John B Kiser	1
01146	GC VOA Water Prep	SW-846 5030B	1	03/23/2002 04:39	John B Kiser	n.a.

#=Laboratory Method Detection Limit exceeded target detection limit
 N.D.=Not detected by the Reporting Limit



Lancaster, PA 17605-2425
 717-656-2300 Fax: 717-656-2681



Lancaster Laboratories Sample No. **WW 3790752**

Collected: 03/15/2002 08:55 by **TC**

Account Number: 10905

Submitted: 03/19/2002 08:50
 Reported: 03/27/2002 at 21:08
 Discard: 04/27/2002

Chevron Products Company
 6001 Bollinger Canyon Road
 Building L PO Box 6004
 San Ramon CA 94583-0904

MW-9-W-020315 Grab Water

Facility# 90020 Job# 386499 GRD
 1633 HARRISON-OAKLAND T0600100304 MW-9


CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit	Units	Dilution Factor
01729	TPH-GRO - Waters					
01730	TPH-GRO - Waters	n.a.	740.	50.	ug/l	1
The reported concentration of TPH-GRO does not include MTBE or other gasoline constituents eluting prior to the C6 (n-hexane) TPH-GRO range start time. A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						
08214	BTEX, MTBE (8021)					
00776	Benzene	71-43-2	0.56	0.50	ug/l	1
00777	Toluene	108-88-3	N.D.	0.50	ug/l	1
00778	Ethylbenzene	100-41-4	4.0	0.50	ug/l	1
00779	Total Xylenes	1330-20-7	5.3	1.5	ug/l	1
00780	Methyl tert-Butyl Ether	1634-04-4	N.D.	2.5	ug/l	1
A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						

State of California Lab Certification No. 2116

Laboratory Chronicle

CAT No.	Analysis Name	Method	Trial#	Analysis Date and Time	Analyst	Dilution Factor
01729	TPH-GRO - Waters	N. CA LUFT Gasoline Method	1	03/23/2002 07:20	John B Kiser	1
08214	BTEX, MTBE (8021)	SW-846 8021B	1	03/23/2002 07:20	John B Kiser	1
01146	GC VOA Water Prep	SW-846 5030B	1	03/23/2002 07:20	John B Kiser	n.a.

#=Laboratory Method Detection Limit exceeded target detection limit
 N.D.=Not detected or above the Reporting Limit





Lancaster Laboratories Sample No. **WW 3790753**

Collected: 03/15/2002 09:20 by **TC**

Account Number: 10905

Submitted: 03/19/2002 08:50

Chevron Products Company

Reported: 03/27/2002 at 21:09

6001 Bollinger Canyon Road

Discard: 04/27/2002

Building L PO Box 6004

MW-13-W-020315

Grab Water

San Ramon CA 94583-0904

Facility# 90020 Job# 386499 GRD

1633 HARRISON-OAKLAND T0600100304 MW-13


CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit	Units	Dilution Factor
01729	TPH-GRO - Waters					
01730	TPH-GRO - Waters	n.a.	N.D.	50.	ug/l	1
The reported concentration of TPH-GRO does not include MTBE or other gasoline constituents eluting prior to the C6 (n-hexane) TPH-GRO range start time.						
A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						
08214	BTEX, MTBE (8021)					
00776	Benzene	71-43-2	N.D.	0.50	ug/l	1
00777	Toluene	108-88-3	N.D.	0.50	ug/l	1
00778	Ethylbenzene	100-41-4	N.D.	0.50	ug/l	1
00779	Total Xylenes	1330-20-7	N.D.	1.5	ug/l	1
00780	Methyl tert-Butyl Ether	1634-04-4	N.D.	2.5	ug/l	1
A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						

State of California Lab Certification No. 2116

Laboratory Chronicle

CAT No.	Analysis Name	Method	Trial#	Analysis Date and Time	Analyst	Dilution Factor
01729	TPH-GRO - Waters	N. CA LUFT Gasoline Method	1	03/23/2002 11:36	John B Kiser	1
08214	BTEX, MTBE (8021)	SW-846 8021B	1	03/25/2002 08:10	John B Kiser	1
01146	GC VOA Water Prep	SW-846 5030B	1	03/25/2002 08:10	John B Kiser	n.a.

#=Laboratory Method Detection Limit exceeded target detection limit
 N.D.=Not detected above the Reporting Limit





Lancaster Laboratories Sample No. **WW 3790754**

Collected: 03/15/2002 09:45 by **TC**

Account Number: 10905

Submitted: 03/19/2002 08:50
 Reported: 03/27/2002 at 21:09
 Discard: 04/27/2002

Chevron Products Company
 6001 Bollinger Canyon Road
 Building L PO Box 6004
 San Ramon CA 94583-0904

MW-15-W-020315 Grab Water

Facility# 90020 Job# 386499 GRD
 1633 HARRISON-OAKLAND T0600100304 MW-15

CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit	Units	Dilution Factor
01729	TPH-GRO - Waters					
01730	TPH-GRO - Waters	n.a.	N.D.	50.	ug/l	1
The reported concentration of TPH-GRO does not include MTBE or other gasoline constituents eluting prior to the C6 (n-hexane) TPH-GRO range start time.						
A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						
08214	BTEX, MTBE (8021)					
00776	Benzene	71-43-2	N.D.	0.50	ug/l	1
00777	Toluene	108-88-3	N.D.	0.50	ug/l	1
00778	Ethylbenzene	100-41-4	N.D.	0.50	ug/l	1
00779	Total Xylenes	1330-20-7	N.D.	1.5	ug/l	1
00780	Methyl tert-Butyl Ether	1634-04-4	N.D.	2.5	ug/l	1
A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.						

State of California Lab Certification No. 2116

Laboratory Chronicle

CAT No.	Analysis Name	Method	Trial#	Analysis		Analyst	Dilution Factor
				Date and Time			
01729	TPH-GRO - Waters	N. CA LUFT Gasoline Method	1	03/23/2002 12:09		John B Kiser	1
08214	BTEX, MTBE (8021)	SW-846 8021B	1	03/23/2002 12:09		John B Kiser	1
01146	GC VOA Water Prep	SW-846 5030B	1	03/23/2002 12:09		John B Kiser	n.a.

#=Laboratory Method Detection Limit exceeded target detection limit

N.D.=Not detected or above the Reporting Limit



7425 New Holland Pike
 PO Box 12425
 Lancaster, PA 17605-2425
 717-656-2300 Fax: 717-656-2681



Lancaster Laboratories Sample No. **WW 3790755**

Collected: 03/15/2002 10:04 by TC

Account Number: 10905

Submitted: 03/19/2002 08:50
 Reported: 03/27/2002 at 21:09
 Discard: 04/27/2002

Chevron Products Company
 6001 Bollinger Canyon Road
 Building L PO Box 6004
 San Ramon CA 94583-0904

MW-16-W-020315 Grab Water

Facility# 90020 Job# 386499 GRD
 1633 HARRISON-OAKLAND T0600100304 MW-16

CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit	Units	Dilution Factor
01729	TPH-GRO - Waters					
01730	TPH-GRO - Waters	n.a.	5,800.	250.	ug/l	5
	The reported concentration of TPH-GRO does not include MTBE or other gasoline constituents eluting prior to the C6 (n-hexane) TPH-GRO range start time.					
	A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.					
08214	BTEX, MTBE (8021)					
00776	Benzene	71-43-2	520.	1.0	ug/l	5
00777	Toluene	108-88-3	60.	1.0	ug/l	5
00778	Ethylbenzene	100-41-4	28.	1.0	ug/l	5
00779	Total Xylenes	1330-20-7	68.	3.0	ug/l	5
00780	Methyl tert-Butyl Ether	1634-04-4	N.D.	2.5	ug/l	5
	A site-specific MSD sample was not submitted for the project. A LCS/LCSD was performed to demonstrate precision and accuracy at a batch level.					

State of California Lab Certification No. 2116

Laboratory Chronicle

CAT No.	Analysis Name	Method	Trial#	Analysis Date and Time	Analyst	Dilution Factor
01729	TPH-GRO - Waters	N. CA LUFT Gasoline Method	1	03/23/2002 08:24	John B Kiser	5
08214	BTEX, MTBE (8021)	SW-846 8021B	1	03/23/2002 08:24	John B Kiser	5
01146	GC VOA Water Prep	SW-846 5030B	1	03/23/2002 08:24	John B Kiser	n.a.

#=Laboratory Method Detection Limit exceeded target detection limit
 N.D.=Not detected
 M.E.M.B. = Method Error
 R.F. = Reporting Factor



Lancaster, PA 17605-2425
 717-656-2300 Fax: 717-656-2681



Client Name: Chevron Products Company
 Reported: 03/27/02 at 09:09 PM

Group Number: 800814

Laboratory Compliance Quality Control

Analysis Name	Blank Result	Blank MDL	Report Units	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Batch number: 02081A16A Sample number(s): 3790751-3790752, 3790755								
Benzene	N.D.	0.5	ug/l	106	109	80-118	3	30
Toluene	N.D.	0.5	ug/l	106	108	82-119	2	30
Ethylbenzene	N.D.	0.5	ug/l	105	107	81-119	2	30
Total Xylenes	N.D.	1.5	ug/l	106	108	82-120	2	30
Methyl tert-Butyl Ether	N.D.	2.5	ug/l	100	102	79-127	2	30
TPH-GRO - Waters	N.D.	50.	ug/l	91	87	76-126	5	30
Batch number: 02081A16B Sample number(s): 3790753-3790754								
Benzene	N.D.	0.5	ug/l	106	109	80-118	3	30
Toluene	N.D.	0.5	ug/l	106	108	82-119	2	30
Ethylbenzene	N.D.	0.5	ug/l	105	107	81-119	2	30
Total Xylenes	N.D.	1.5	ug/l	106	108	82-120	2	30
Methyl tert-Butyl Ether	N.D.	2.5	ug/l	100	102	79-127	2	30
TPH-GRO - Waters	N.D.	50.	ug/l	91	87	76-126	5	30
Batch number: 02081A16C Sample number(s): 3790753								
Benzene	N.D.	0.5	ug/l	106	109	80-118	3	30
Toluene	N.D.	0.5	ug/l	106	108	82-119	2	30
Ethylbenzene	N.D.	0.5	ug/l	105	107	81-119	2	30
Total Xylenes	N.D.	1.5	ug/l	106	108	82-120	2	30
Methyl tert-Butyl Ether	N.D.	2.5	ug/l	100	102	79-127	2	30

Sample Matrix Quality Control

Analysis Name	MS %REC	MSD %REC	MS/MSD Limits	RPD	BKG MAX	DUP Conc	DUP RPD	Dup RPD Max
Batch number: 02081A16A Sample number(s): 3790751-3790752, 3790755								
Benzene	111		77-131					
Toluene	111		80-128					
Ethylbenzene	110		76-132					
Total Xylenes	110		76-132					
Methyl tert-Butyl Ether	99		61-144					
TPH-GRO - Waters	104		74-132					
Batch number: 02081A16B Sample number(s): 3790753-3790754								
Benzene	111		77-131					
Toluene	111		80-128					
Ethylbenzene	110		76-132					
Total Xylenes	110		76-132					
Methyl tert-Butyl Ether	99		61-144					
TPH-GRO - Waters	104		74-132					
Batch number: 02081A16C Sample number(s): 3790753								
Benzene	111		77-131					
Toluene	111		80-128					
Ethylbenzene	110		76-132					

*- Outside of specification

- (1) The result for one or both determinations was less than five times the LOQ.
- (2) The background result was more than four times the spike added.





Lancaster Laboratories

Where quality is a science.

Quality Control Summary

Client Name: Chevron Products Company
 Reported: 03/27/02 at 09:09 PM

Group Number: 800814

Sample Matrix Quality Control

Analysis Name	MS	MSD	MS/MSD	RPD	BKG	DUP	DUP	Dup
	<u>%REC</u>	<u>%REC</u>	<u>Limits</u>	<u>RPD</u>	<u>MAX</u>	<u>Conc</u>	<u>Conc</u>	<u>RPD</u>
								<u>Max</u>
Total Xylenes	110		76-132					
Methyl tert-Butyl Ether	99		61-144					

Surrogate Quality Control

Analysis Name: TPH-GRO - Waters
 Batch number: 02081A16A

	Trifluorotoluene-F	Trifluorotoluene-P
3790751	82	104
3790752	116	103
3790755	123	119
Blank	80	105
LCS	121	104
LCSD	119	103
MS	123	103
<hr/>		
Limits:	67-135	71-130

Analysis Name: TPH-GRO - Waters
 Batch number: 02081A16B

	Trifluorotoluene-F	Trifluorotoluene-P
3790753	80	
3790754	80	105
Blank	81	105
LCS	121	104
LCSD	119	103
MS	123	103
<hr/>		
Limits:	67-135	71-130

Analysis Name: TPH-GRO - Waters
 Batch number: 02081A16C

	Trifluorotoluene-F	Trifluorotoluene-P
3790753		103
Blank		104
LCS	121	104
LCSD	119	103
MS	123	103
<hr/>		
Limits:	67-135	71-130

*- Outside of specification

- (1) The result for one or both determinations was less than five times the LOQ.
- (2) The background result was more than four times the spike added.



Lancaster Laboratories, Inc.
 2425 New Holland Pike
 PO Box 12425
 Lancaster, PA 17605-2425
 717-656-2300 Fax: 717-656-2681