

✓ 20157

Alameda County
FEB 11 2003
Environmental Health



**UNDERGROUND STORAGE
TANK REMOVAL AND
SOIL AND WATER REMEDIATION REPORT**

**HERTZ SERVICE CENTER
ONE AIRPORT DRIVE
OAKLAND, CALIFORNIA**

Prepared for:

Mr. Roland Costanzo
Hertz Corporation
225 Brae Boulevard
Park Ridge, NJ 07656-0713

Prepared by:

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, California 94588

1.0 INTRODUCTION

This report describes activities for the removal of two underground storage tanks (USTs) and soil/groundwater remediation at The Hertz Corporation (Hertz) former car rental facility located at One Airport Drive, Oakland, California. The site is located at Oakland International Airport, which is under the ownership, jurisdiction and authority of the Port of Oakland (*Figure 1*). Operations at the service center included fueling and vehicle maintenance. Unleaded gasoline was stored in one 12,000-gallon UST and waste oil was stored in one 500-gallon UST. The work described in this report was part of a larger project that included the demolition of the Hertz Car Rental facility and the restoration of the site to a parking lot to be used by the Port of Oakland.

1.1 Background Information

In 1988, three UST's were removed from a tank pit located approximately 20 feet north of the dispenser island. A new 12,000-gallon gasoline UST was installed approximately 20 feet north and east of the old tank pit (see *Figure 2*). In addition, a new underground distribution line was installed from the new UST to the existing dispenser island.

Assessment activities began subsequent to tank removal activities in 1988. Nine monitoring wells were installed as part of the assessment activities conducted between 1991 and 1993. Between 1993 and 1999, 12 groundwater monitoring events were conducted. During this time frame, concentrations of petroleum hydrocarbons decreased across the site. The highest concentration of impacted groundwater was located near the dispenser area (monitoring well MW-4).

In-situ groundwater remediation was conducted in 1999 and 2001. In 1999, oxygen releasing compound (ORC) socks were placed in monitoring well MW-4. In 2001, ORC was injected into 34 locations (push probe locations) in the dispenser area.

In 2002, Hertz began demolition activities at their facility. As part of the demolition activities, the USTs and associated piping were scheduled for removal. Hertz requested the impacted soil near MW-4 be excavated as part of source removal. In addition, the impacted groundwater in the excavation would be in-situ chemically oxidized instead of removal and treatment.

On March 5, 2002, a work plan was submitted (and subsequently approved) to the Alameda County Environmental Health Services Agency (ACEHSA) to remove the two USTs, over excavate the impacted soils around the dispenser area, and treat the groundwater in the excavation using chemical oxidation.

2.0 UST REMOVAL, SOIL EXCAVATION, AND LABORATORY RESULTS

2.1 UST Removal Activities

Prior to removing the USTs and piping, the dispensers were removed as part of the facility's general demolition activities. On May 21, 2002, American Construction Inc. (ACI) removed both USTs (one 12,000-gallon unleaded gasoline UST and one 500-gallon waste oil UST) from the property under the direction of an Oakland Fire Service Agency, Office of Emergency Services (OFSA) Inspector, Mr. Keith L. Matthews. Additionally, Mr. Dale Klettke of the Port of Oakland and Mr. Barney Chan of ACEHSA were present during the UST removals. The UST locations are shown in *Figure 2*. Copies of UST removal related permits and documents are included in *Appendix A*.



Product still present in the USTs was removed and the USTs were then cleaned and rinsed. Both USTs were inerted with dry ice. The atmosphere inside each tank was verified using a Lower Explosion Limit/Oxygen (LEL/O₂) meter prior to moving the tanks. ACI removed the overburden of the USTs, removed soil from around the piping and stockpiled the excavated materials, which consisted primarily of pea gravel. Upon removal of the USTs, water filled the excavations to three feet of the ground surface.

No holes were observed in either of the USTs. The tanks appeared to be in good condition. Additionally, the piping that led from 12,000-gallon gasoline USTs to the dispensers was removed. The USTs and piping were loaded directly onto a truck supplied by Ecology Control Industries, Inc., who hauled them to their recycling/disposal facility in Richmond, California. Copies of the UST hazardous waste manifests and certificates of destruction are provided in *Appendix B*.

2.2 Soil Excavation

UST and Piping Areas

During UST removal, monitoring for impacted soils was performed using an organic vapor analyzer (OVA) and visual evidence. If impact was observed, the soils would be excavated for treatment. No visual or olfactory observations of impacted soils were made during either UST removal. However, impacted soil was encountered in the pipe trench near the dispensers. This impacted area was part of the dispenser over-excavation activities.

Dispenser Area

As previously described, impacted soil and groundwater was previously documented in the area of the dispensers. ATC initially anticipated an area 20 feet wide by 40 feet long by 8 feet deep to be excavated as part of the tank removal activities. During excavation activities, impacted soils were observed and removed. The resultant excavation was approximately 20 feet wide by 35 feet long by 9 feet deep. The extent of the southern edge of the excavation was restricted due to the presence of a chain link fence and an underground electrical line located south of the dispenser area. *Figure 3* illustrates the extent of excavation.

Following the completion of the excavation, small amounts of groundwater were observed to be infiltrating into the excavation at a depth of approximately eight feet below ground surface (bgs). On May 22, the groundwater in the excavation equilibrated at a depth of approximately six feet bgs. The impacted soil was staged on-site until analytical results were received. Following the treatment of the groundwater (section 3) in the excavation, the ACEHSA approved backfilling. Soil impacted with petroleum hydrocarbons was stockpiled, profiled and transported as non-hazardous material to Forward Landfill in Manteca, California. Copies of non-hazardous waste manifests are included in *Appendix B*.

2.3 Sampling and Analysis

ATC personnel collected soil and groundwater samples subsequent to UST and piping removal and post excavation activities. Soil sampling protocol consisted of driving a soil sampler lined with brass tubes into the materials to be sampled, extracting the sampler and tubes, removing the tubes from the sampler, and capping both ends of the selected tubes with Teflon™-tape and non-reactive plastic end caps. Groundwater sampling protocol consisted of bringing the pre-cleaned glass container to the surface and transferring the water into appropriate laboratory-supplied containers. The containers were then labeled, placed into Ziploc™-type plastic bags, and the sampling information was recorded on chain-of-custody records. The plastic bags containing the samples were then placed in an ice filled cooler and shipped to the laboratory. Strict chain-of-custody protocols were followed during sampling, handling and



transporting of the samples to the laboratory.

The following sections summarize the sample locations, analytical parameters for the soil and groundwater and the analytical results for each area. For reference purposes, the following analytical methods were used for soil and groundwater:

Gasoline Parameters

- Total Petroleum Hydrocarbons as Gasoline (TPHg), Method 8015
- Benzene, Toluene, Ethylbenzene, Total Xylenes (BTEX compounds) and Methyl Tertiary Butyl Ether (MTBE), Method 8020

Waste Oil Parameters

- TPH, Method 8015
- Oil and Grease, Method 413.1
- Polynuclear Aromatic Hydrocarbons (PAHs), Method 8270
- Volatile Organic Compounds (VOCs), Method 8260
- Polychlorinated biphenyls, Method 8081
- LUFT Metals, Method 6010

ATC has included, within each table of analytical results, the appropriate local, state, and federal regulatory citation. The referenced regulatory citations are provided in *Appendix C*.

Gasoline UST Area

Two soil samples (G-N and G-S) were collected from the gasoline UST excavation at three feet below ground surface (bgs) (see *Figure 2*). Additionally, seven discrete soil samples (P-1 through P-7) were collected at approximately 20-foot intervals beneath the gasoline UST piping (*Figure 2*), and one groundwater sample was collected from each of the UST excavations.

Soil samples collected from the gasoline UST excavation and from under the piping were analyzed for TPH-g, BTEX, and MTBE. Neither of the soil samples collected from the gasoline UST excavation contained detectable quantities of TPH-g, BTEX or MTBE (*Table 1*). Of the seven piping samples collected, only one (P-7) contained detectable quantities of TPH-g (520 milligrams per kilogram [mg/kg]), toluene (4.7 mg/kg), ethylbenzene (6.3 mg/kg) and total xylenes (41 mg/kg). As previously mentioned, this soil was removed as part of the dispenser area excavation. Laboratory reports are provided in *Appendix D* and summarized in *Table 1*.

The groundwater sample (G-1) collected from the gasoline UST excavation was analyzed for TPH-g, BTEX, and MTBE. The sample did not contain detectable concentrations of TPH-g, benzene, toluene and ethylbenzene. Total xylenes (1,500 micrograms per liter [$\mu\text{g/L}$]) and MTBE (23,000 $\mu\text{g/L}$) were detected in the sample. Laboratory reports are provided in *Appendix D* and summarized in *Table 2*.

Waste Oil UST

One discrete soil sample (WO-1) was collected from the waste oil UST excavation above the water table (approximately three feet bgs) near the fill end of the UST. The soil sample was analyzed for organic parameters (TPH-g, TPH-d, BTEX, MTBE, oil and grease, VOCs, PCBs, PAHs) and inorganic



parameters (LUFT metals). Laboratory results showed non-detectable concentrations for the organic constituents. Of the inorganic analytes, total chromium (20 mg/kg), nickel (15 mg/kg) and zinc (14 mg/kg) were detected in the soil samples. Laboratory reports are provided in *Appendix D* and summarized in *Table 1*.

The groundwater sample (WO-1) collected from the waste oil excavation was analyzed for TPH-g, BTEX, MTBE, oil and grease, VOCs, PCBs, PAHs and LUFT metals. The sample did not contain detectable concentrations of TPH-g, benzene, ethylbenzene, xylenes, oil and grease, PCBs and/or PAHs. TPH-d (130 µg/L), toluene (0.9 µg/L) and MTBE (7.6 µg/L) were detected in the groundwater sample. Total chromium (5.5 µg/L), nickel (88 µg/L) and zinc (130 µg/L) were also detected in the groundwater sample. Neither cadmium nor lead was detected in the sample. Laboratory reports are provided in *Appendix D* and summarized in *Table 2*.

Dispenser Area Excavation

Soil samples were collected from each sidewall and bottom of the excavation (EX-N, EX-E, EX-S, EX-W, and EX-B). The samples were analyzed for TPH-g, BTEX, and MTBE. TPH-g (29 mg/kg), toluene (0.077 mg/kg), ethylbenzene (0.13 mg/kg), and xylenes (1.08 mg/kg) were detected in the sample from the southern wall of the excavation (EX-S). No petroleum analytes were detected in the remaining soil samples collected. Laboratory reports are provided in *Appendix D* and summarized in *Table 1*.

The groundwater sample from the dispenser area excavation (EW-1) was analyzed for TPH-g, BTEX, and fuel oxygenates, including MTBE. The results indicate TPH-g (30,000 µg/L), benzene (840 µg/L), toluene (4,200 µg/L), ethylbenzene (990 µg/L), and xylenes (6,300 µg/L) were detected. Laboratory results are provided in *Appendix D* and summarized in *Table 2*.

Stockpile

Two composite samples (A & B) from the excavated soil stockpile were analyzed for TPH-G, BTEX, MTBE, and lead. Both samples contained detectable concentrations of TPH-g, (30 and 3.4 mg/kg), xylenes (0.41 and 0.126 mg/kg), and lead (both samples at 2.5 mg/kg). In addition, sample B contained 0.028 mg/kg of toluene. The soils were loaded and shipped to Forward Landfill in Manteca, California for disposal. Copies of the nonhazardous waste manifests are provided in *Appendix B*.



3.0 GROUNDWATER TREATMENT

3.1 Treatment Technology

On June 7, 2002, ATC treated the groundwater in the pit associated with the dispenser area excavation. The groundwater in the gasoline and waste oil UST excavations was also treated on July 12, 2002. Prior to the implementation of field activities, the site-specific Health and Safety Plan (HASP) was updated to describe the hazards and safety procedures for dispensing chemicals in the field. Personal protective equipment (PPE) was upgraded to include: chemical resistant boots or boot covers, chemical resistant gloves, chemical resistant apron, splash goggles, and face shields.

The Fenton process utilizes hydrogen peroxide and a catalyst (ferrous iron) to create hydroxyl free radicals (equation 1). The hydroxyl free radical (OH•) is a powerful oxidizer of organic compounds and is capable of oxidizing even the most complex organic compounds (equation 2). The organic compounds are successively broken down into non-hazardous carbon dioxide and water. Residual hydrogen peroxide and iron are rapidly broken down into water and oxygen or precipitated as ferric iron.





The reaction is most efficient with a pH range of 3 to 5.5. ATC used sulfuric acid to aid in the lowering of the pH.

The following procedures were utilized:

- A small double diaphragm pump was setup to assist in circulating and mixing the chemicals and water in the excavation.
- Approximately 4 gallons of sulfuric acid (50%) was added to the excavation water. For safety reasons, the acid was diluted prior to addition to the excavation. The acid lowered the pH of the water to 5.5.
- Approximately 50 pounds of iron sulfate was then mixed into a solution with water and added to the excavation.
- Finally, hydrogen peroxide (50%) solution was diluted to five percent and added to the water in the excavation.

Upon the addition of the hydrogen peroxide, the reaction was clearly visible.

3.2 Post Treatment Sampling

Groundwater samples were collected from each excavation after treatment. The protocol for groundwater sampling is discussed in Section 2.3. The samples were analyzed for TPHg, BTEX, and MTBE. Laboratory results are provided in *Appendix D* and summarized in *Table 2*. The chemical oxidation treatment reduced the petroleum compounds in the groundwater greater than 98 percent. These reduced levels were sufficient to place backfill into each excavation in preparation for site closure.

On July 11, 2002, the ACHCSA acknowledged, in a letter to Hertz (*Appendix E*), “the treatment of the former pump island area with Fenton’s reagent has apparently been successful in oxidizing residual TPH contamination in groundwater.” In addition, the ACHCSA requested groundwater samples be collected from the monitoring well network (in order to facilitate site closure). The groundwater data from the subsequent monitoring will be provided in a separate report.

4.0 CONCLUSIONS AND RECOMMENDATIONS

The facility was used as a car rental operation for more than 15 years. As part of the operations, petroleum products were stored and dispensed. Assessment activities conducted in the early 1990’s included the installation of a monitoring well network. Groundwater samples collected from the monitoring well network over the past 10 years indicate the plume remained defined and petroleum analytes decreasing in concentrations. During this time frame, two events of ORC socks/injection were performed to aid in decreasing the petroleum analytes.




In early 2002, Hertz began demolition activities at the site to make way for airport expansion and parking. A work plan for tank removal, source removal, and in-situ chemical oxidation was submitted and approved by the ACEHSA. This plan was implemented between May and August 2002. Confirmatory soil and groundwater samples were collected and indicate the source of impacted soil and groundwater was removed or treated in-situ.


Based on the activities conducted, ATC recommends one groundwater monitoring event be conducted. If the data were consistent with previous sampling events, ATC would recommend the site be closed.

5.0 CERTIFICATION

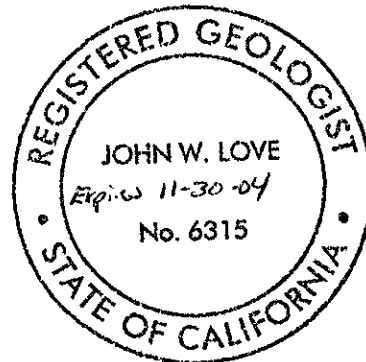
We certify that, to the best of our knowledge, all information provided in this report is true and correct.



Paul Warmus
National Program Manager



John Love, RG
Senior Project Manager



**Table 1
Soil Analytical Data**

Area	Sample ID	Gasoline Analytes (mg/kg)						Waste Oil Analytes (mg/kg)										
		TPH-g	Benzene	Toluene	Ethylbenzene	Xylenes	MTBE	TPH-g	VOCS	SOCS	PCBS	PAHS	Cr	S	Pb	Ni	Zn	
1	G-N	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	G-S	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
2	P-1	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	P-2	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	P-3	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	P-4	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	P-5	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	P-6	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	P-7	520	<0.5	4.7	6.3	41	<5	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
3	EX-N	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	EX-S	29	<0.025	0.077	0.13	1.08	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	EX-E	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	EX-W	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	EX-B	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
4	WO-1	<2.5	<0.025	<0.025	<0.025	<0.025	<0.25	<1.0	ND	<25	<0.1	ND	<1	20	<1	15	14	
5	A	30	<0.025	<0.025	<0.025	0.41	<0.25	NA	NA	NA	NA	NA	NA	NA	2.5	NA	NA	
	B	3.4	<0.025	0.028	<0.025	0.126	<0.25	NA	NA	NA	NA	NA	NA	NA	2.5	NA	NA	
PRG		n/a	1.3	520	20	420	36	1	Varies	n/a	0.74	Varies	7.4	450	150	20000	100000	
RBSL		400	0.18	8.4	24	1	1	500	Varies	n/a	0.22	Varies	1.7	13	200	150	600	
TTLC		n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	100	2500	1000	2000	5000	

Bold indicates above referenced levels

PRG - Preliminary Remediation Goal—Industrial Soil

RBSL - Tier 1 Risk Based Screening Level for surface soil (<3 meters deep). Groundwater is not a drinking water source.

TTLC - State of California Title 22 Total Threshold Limit Concentration

Area 1 - Gasoline Tank Pit

Area 2 - Gasoline Piping Trench

NA - Not Analyzed

Area 3 - Dispenser Excavation

n/a - not applicable

Area 4 - Waste Oil Tank Pit

Area 5 - Soil Stockpile

**Table 2
Groundwater Analytical Data**

Area	Sample ID	Gasoline Analyses (µg/l)						Trace Oil Analyses (µg/l)									
		TPH-g	Benzene	Toluene	Ethylbenzene	Xylenes	MTBE	TPH-g	VOCs	SCC	PCBs	PAHs	Cr	Co	Pb	Ni	Zn
3	EW-1	30000	840	4200	990	6300	<500	NA	82/56*	NA	NA	NA	NA	NA	NA	NA	NA
	Pitt	63	1.5	3.0	<0.5	5.5	<5.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
1	G-1	<10000	<100	<100	<100	1500	23000	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	G-EX	<50	<0.5	<0.5	<0.5	<0.5	46	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
2	WO-1	<50	<0.5	0.9	<0.5	<1	7.6	130	5.3**	<0.005	ND	ND	<5	55	<15	88	130
	WO-EX	<50	<0.5	0.53	<0.5	<0.5	<5.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
MCL		n/a	1.0	1000	680	1750	13	n/a	Varies	n/a	0.5	Varies	5.0	50	15	100	5000
RBSL		500	46	130	290	13	1800	640	Varies	n/a	0.014	Varies	1.1	180	3.2	8.2	23

Bold type indicates compound reported above MCL and/or RBSL.

µg/l - micrograms per liter

NA - Not Analyzed

n/a - not applicable

*tert-butanol/MTBE

**MTBE

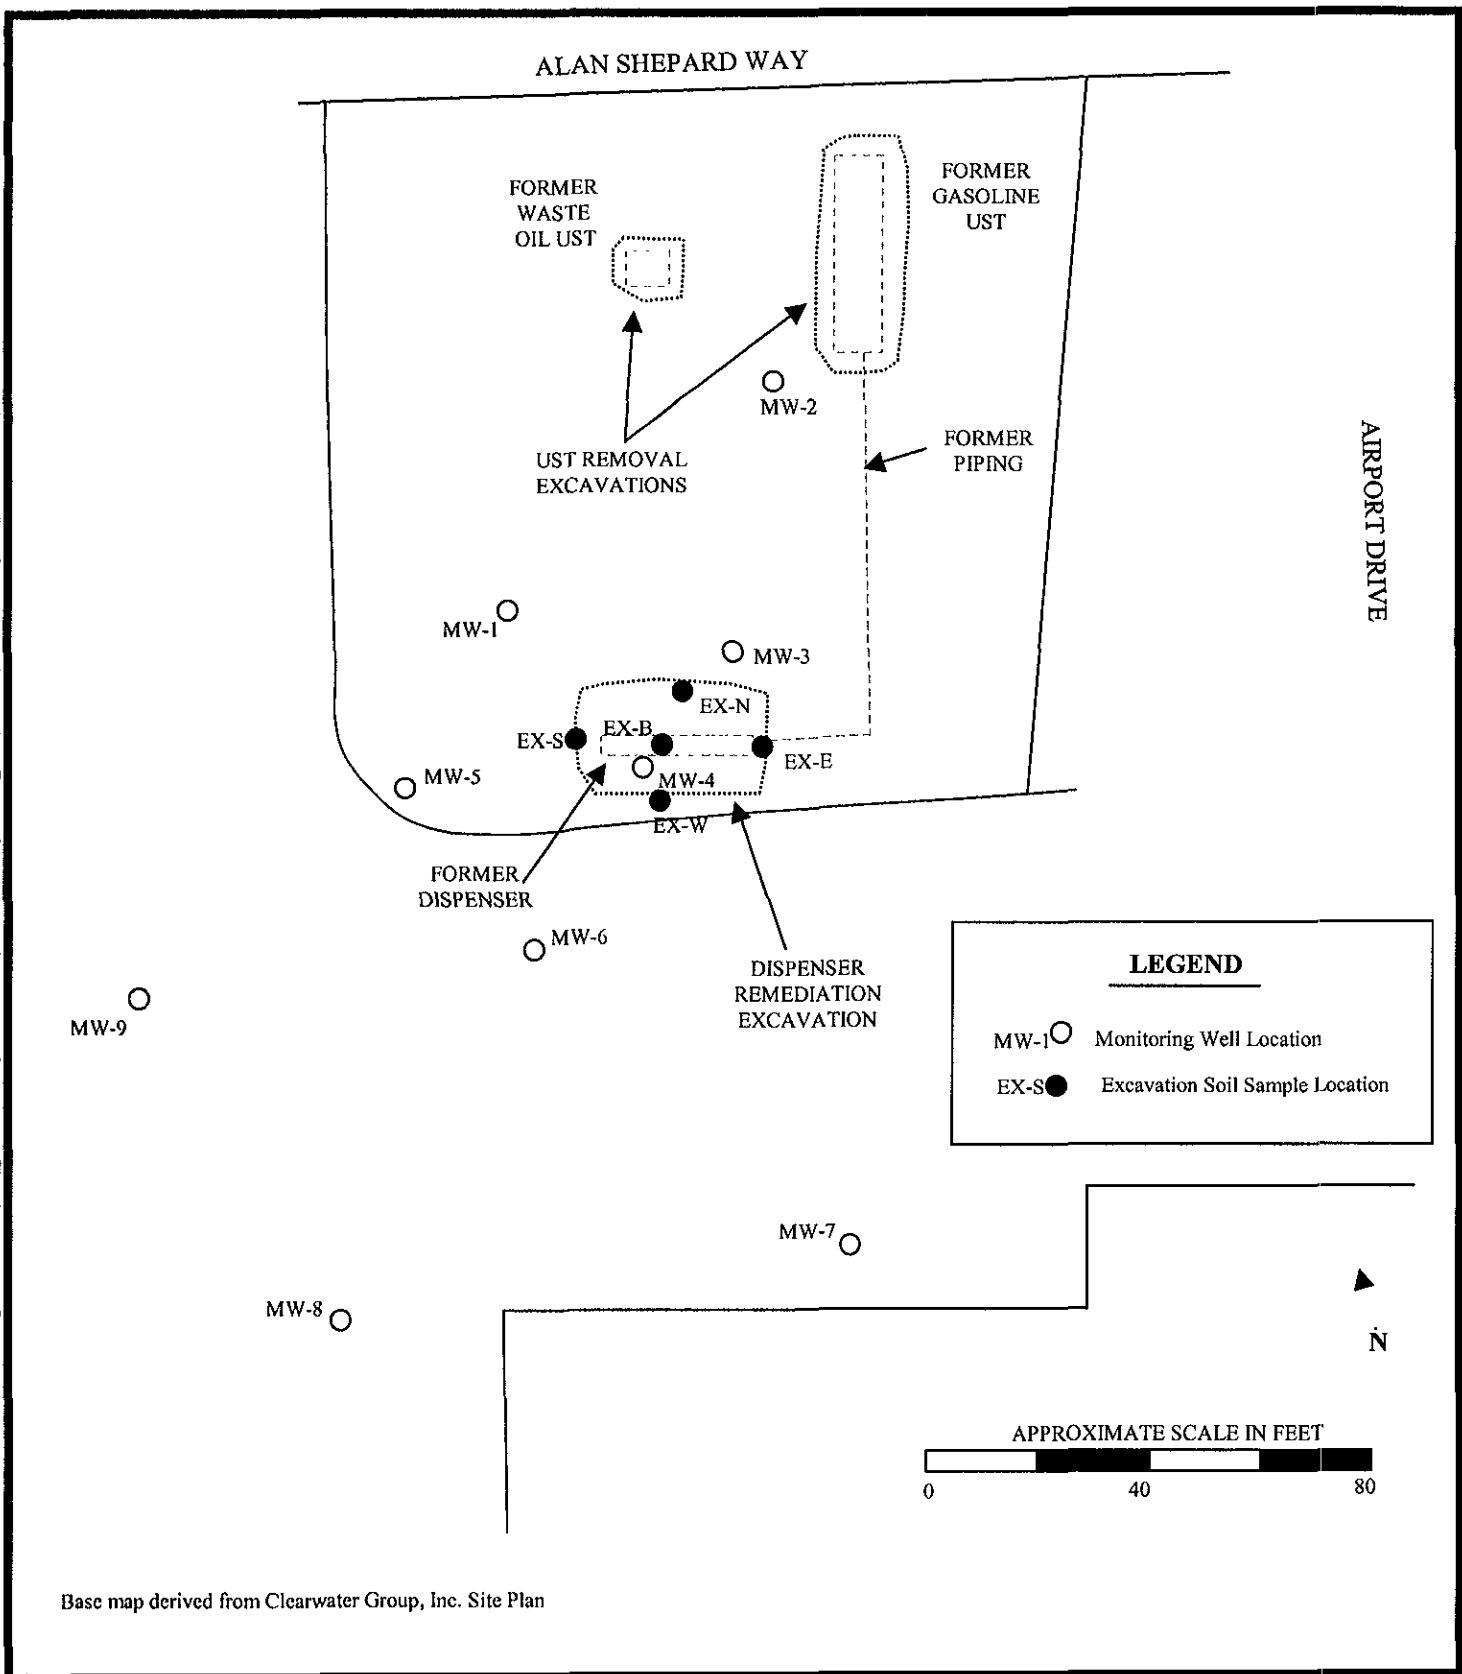
MCL - maximum contaminant level established for drinking water.

RBSL - Tier 1 Risk-Based Screening Level. Groundwater is not a drinking water source.

Area 3 - Dispenser Excavation

Area 1 - Gasoline Tank Pit

Area 2 - Waste Oil Tank Pit



Base map derived from Clearwater Group, Inc. Site Plan



6602 Owens Drive, Suite 100
 Pleasanton, CA 94588
 (925) 460-5300

PROJECT NO: 75.75015.0001

DESIGNED BY: JL

SCALE: NTS

REVIEWED BY: DT

DRAWN BY: JL

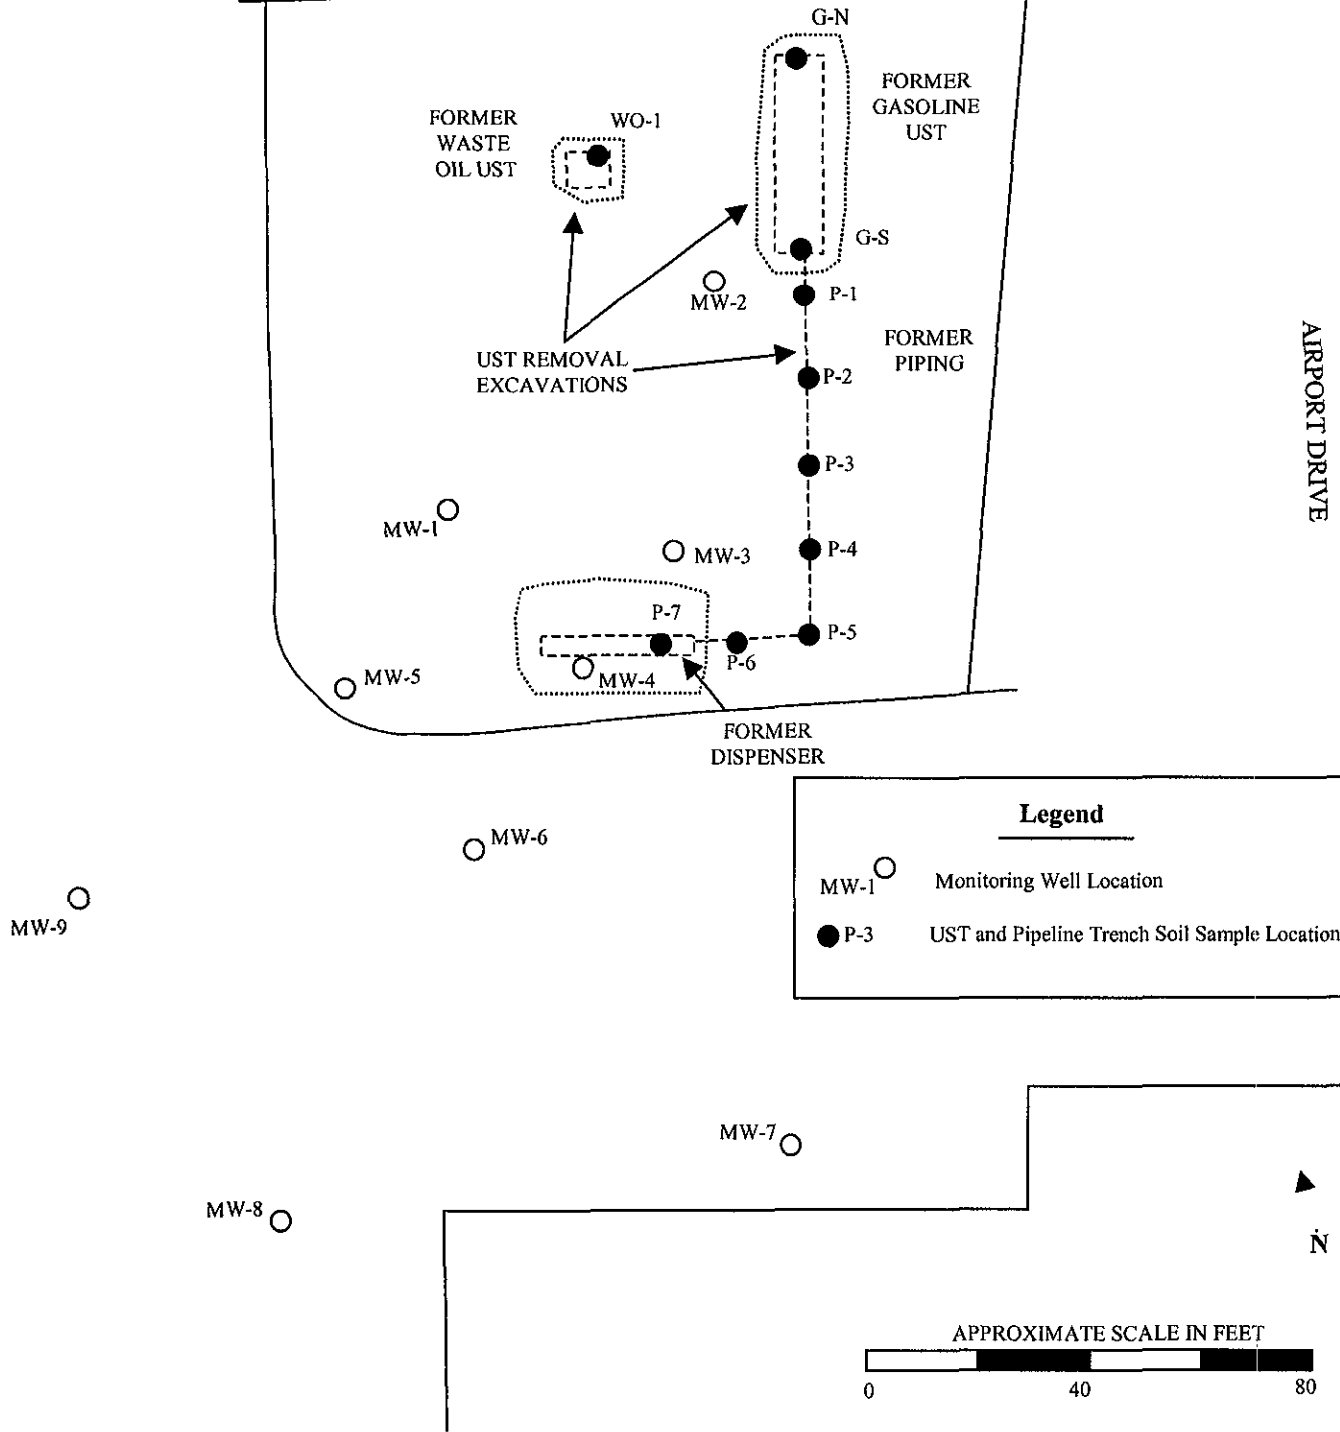
DATE: 09/02

FILE: MAP (REVISED)

FIGURE 3
**DISPENSER AREA SOIL
 SAMPLE LOCATIONS**
 FORMER HERTZ SERVICE CENTER
 ONE AIRPORT DRIVE
 OAKLAND, CALIFORNIA

ALAN SHEPARD WAY

AIRPORT DRIVE



Legend

- MW-1 ○ Monitoring Well Location
- P-3 UST and Pipeline Trench Soil Sample Location

Base map derived from Clearwater Group, Inc. Site Plan

FIGURE 2

UST REMOVAL SAMPLING LOCATIONS

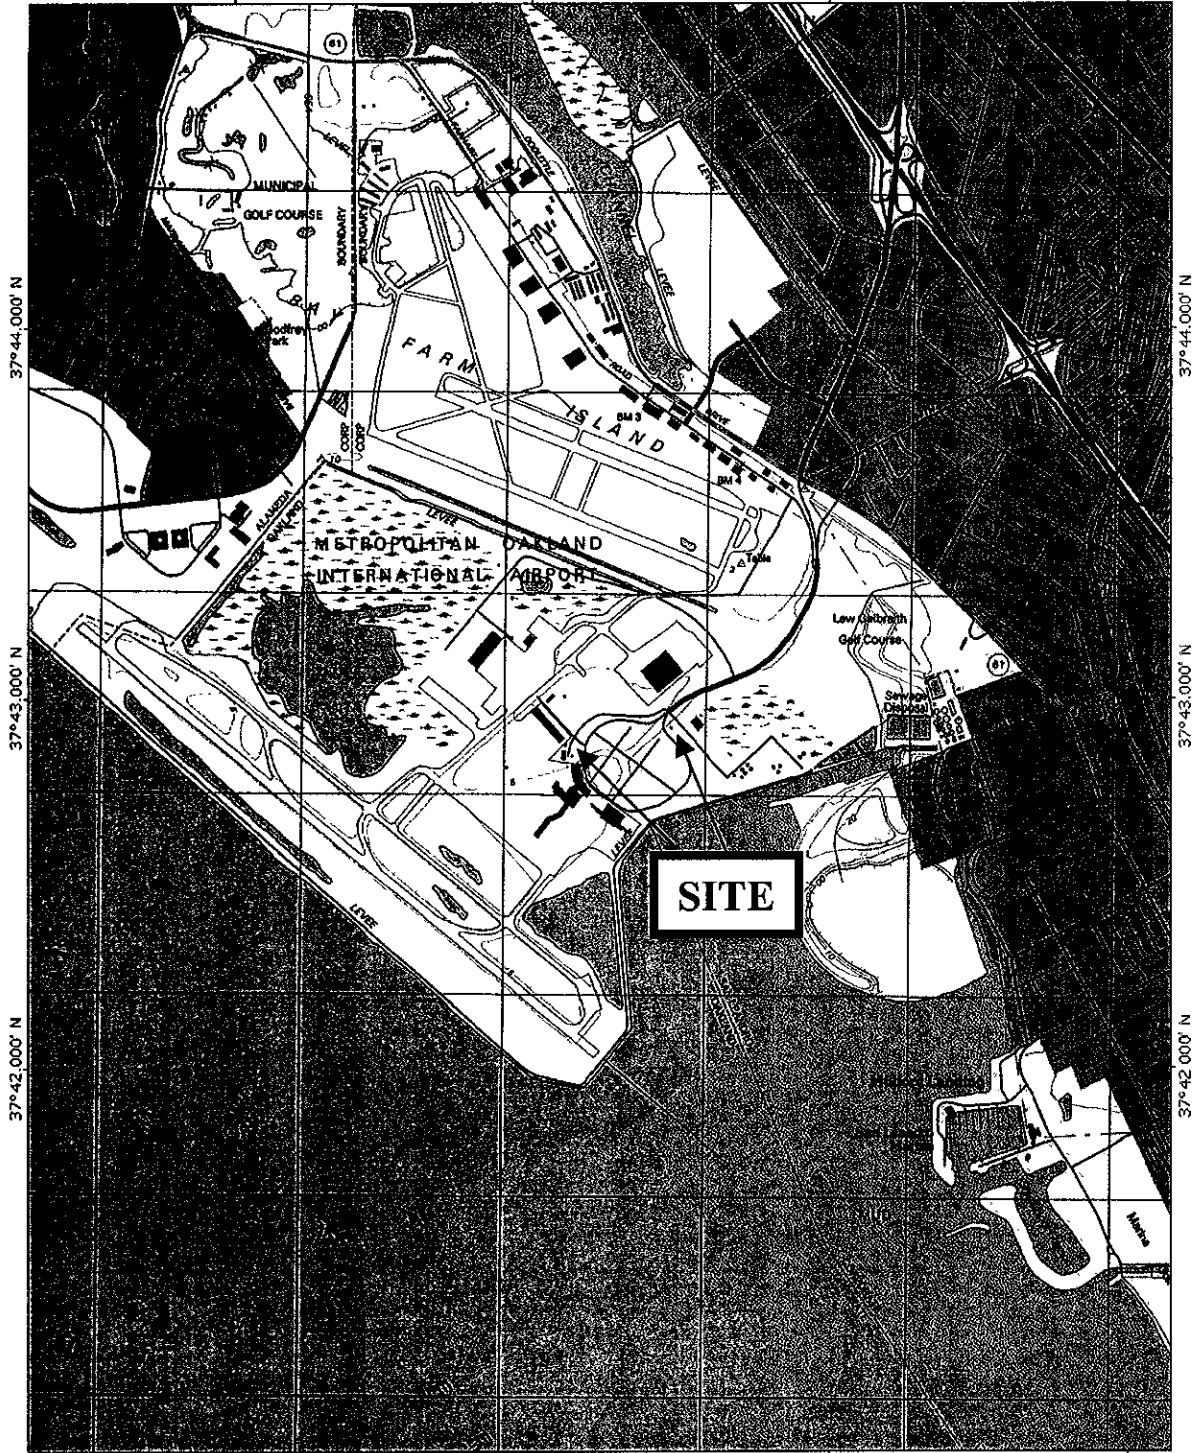
FORMER HERTZ SERVICE CENTER
 ONE AIRPORT DRIVE
 OAKLAND, CALIFORNIA



6602 Owens Drive, Suite 100
 Pleasanton, CA 94588
 (925) 460-5300

PROJECT NO: 75.75015.0001

DESIGNED BY: JL	SCALE: NTS	REVIEWED BY: DT
DRAWN BY: JL	DATE: 09/02	FILE: MAP (REVISED)



6602 Owens Drive, Suite 100
 Pleasanton, CA 94588
 (925) 460-5300

PROJECT NO: 75.75015.0001

DESIGNED BY: JL

SCALE: NTS

REVIEWED BY: DT


DRAWN BY: JL

DATE: 09/02

FILE: MAP (REVISED)

FIGURE 1
SITE VICINITY MAP

FORMER HERTZ SERVICE CENTER
 ONE AIRPORT DRIVE
 OAKLAND, CALIFORNIA



ALAMEDA COUNTY PUBLIC WORKS AGENCY

WATER RESOURCES SECTION
 399 ELMHURST ST. HAYWARD CA 94544-1395
 PHONE (510) 670-5554
 FAX (510) 782-1939

DRILLING PERMIT APPLICATION

FOR APPLICANT TO COMPLETE

FOR OFFICE USE

LOCATION OF PROJECT One Airport Drive
Oakland, CA 94621

PERMIT NUMBER W02-0312
 WELL NUMBER _____
 APN _____

CLIENT
 Name Hertz Corp.
 Address 3838 Sheffield Cir. Phone (925) 736-0760
 City Oakville Zip 94506

PERMIT CONDITIONS
 Circled Permit Requirements Apply

A. GENERAL.

1. A permit application should be submitted so as to arrive at the ACPWA office five days prior to proposed starting date.
2. Submit to ACPWA within 60 days after completion of permitted original Department of Water Resources Well Completion Report.
3. Permit is void if project not begun within 90 days of approval date.

APPLICANT
 Name ATC Associates
 Address 6602 Owens Dr. #100 Fax (925) 463-2559
 City Pleasanton Phone (925) 460-5300
 Zip 94588

B. WATER SUPPLY WELLS

1. Minimum surface seal thickness is two inches of cement grout placed by trowel.
2. Minimum seal depth is 30 feet for municipal and industrial wells or 20 feet for domestic and irrigation wells unless a lesser depth is specially approved.

C. GROUNDWATER MONITORING WELLS INCLUDING PIEZOMETERS

1. Minimum surface seal thickness is two inches of cement grout placed by trowel.
2. Minimum seal depth for monitoring wells is the maximum depth practicable or 20 feet.

D. GEOTECHNICAL

Backfill bore hole by trowel with cement grout or cement grout/sand mixture. Upper two-three feet replaced in kind or with compacted cuttings.

E. CATHODIC

Fill hole anode zone with concrete placed by trowel.

F. WELL DESTRUCTION - excavation

Send a map of work site. A separate permit is required for wells deeper than 45 feet.

G. SPECIAL CONDITIONS

NOTE: One application must be submitted for each well or well destruction. Multiple borings on one application are acceptable for geotechnical and contamination investigations.

TYPE OF PROJECT

- Well Construction
- Cathodic Protection
- Water Supply
- Monitoring
- Geotechnical Investigation
- General Contamination
- Well Destruction AW-4 will be removed via air excavation

PROPOSED WATER SUPPLY WELL USE

- New Domestic
- Municipal
- Industrial
- Replacement Domestic
- Irrigation
- Other

DRILLING METHOD:

- Mud Rotary
- Cable
- Air Rotary
- Other
- Auger

DRILLER'S NAME _____

DRILLER'S LICENSE NO _____

WELL PROJECTS

Drill Hole Diameter _____ in. Maximum
 Casing Diameter _____ in. Depth _____ ft.
 Surface Seal Depth _____ ft. Owner's Well Number _____

GEOTECHNICAL PROJECTS

Number of Borings _____ Maximum
 Hole Diameter _____ in. Depth _____ ft.

ESTIMATED STARTING DATE March 25, 2002

ESTIMATED COMPLETION DATE same

I hereby agree to comply with all requirements of this permit and Alameda County Ordinance No. 73-68.

APPLICANT'S SIGNATURE [Signature] DATE _____

PLEASE PRINT NAME John Love Rev. 5-13-00

APPROVED [Signature] DATE 3-14-02

OAKLAND FIRE DEPARTMENT, OES UNDERGROUND STORAGE TANK CLOSURE/REMOVAL FIELD INSPECTION REPORT

Site Address: <u>1- Airport Drive</u>	Name of Facility: <u>Hotz Rentals</u>
Inspector: <u>Scott M. ...</u>	Contact on site: <u>Don Kubic</u>
Date and Time of Arrival: <u>21 May 01 14:00</u>	Contractor/Consultant: <u>Don Kubic / ATC ASSOCIATES</u>

General Requirements	Yes	No	N/A
Approved closure plan on site.	✓		
Changes to approved plan noted.			✓
Residuals properly stored/transported.			✓
Receipt for adequate dry ice noted.			

General Requirements	Yes	No	N/A
Site Safety Plan properly signed.	✓		
40B:C fire extinguisher on site.	✓		
"No Smoking" signs posted.	✓		
Gas detector challenged by inspector.	✓		

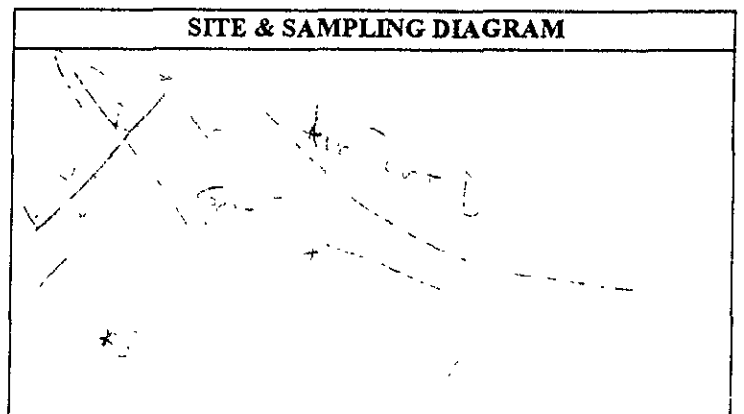
Tank Observations	T #1	T #2	T #3	T #4
Tank Capacity (gallons)	<u>12K</u>	<u>500</u>		
Material last stored	<u>Gas</u>	<u>Gas</u>		
Dry ice used (pounds)	<u>400</u>	<u>50</u>		
Combustible gas concentration as %LEL. (Note time & sampling point)				
(1)	<u>0</u>	<u>0</u>		
(2)				
(3)				
Oxygen concentration as % volume. (Note time & sampling point.)				
(1)	<u>4.5</u>	<u>11.2</u>		
(2)				
(3)				
Tank Material				
Wrapping/Coating, if any				
Obvious holes?				

Tank Observations	T #1	T #2	T #3	T #4
Obvious corrosion?	<u>No</u>	<u>No</u>		
Obvious odors from tank?	<u>No</u>	<u>No</u>		
Seams intact?	<u>Yes</u>	<u>Yes</u>		
Tank bed backfill material	<u>Yes</u>	<u>Yes</u>		
Obvious discoloration?	<u>NA</u>	<u>NA</u>		
Obvious odors ex tank bed?	<u>NA</u>	<u>NA</u>		
Water in excavation?	<u>Yes</u>	<u>Yes</u>		
Sheen/product on water?	<u>No</u>	<u>No</u>		
Tank tagged by transporter?	<u>Yes</u>	<u>Yes</u>		
Tank wrapped for transport?	<u>Yes</u>	<u>Yes</u>		
Tank plugged w/ vent cap?	<u>Yes</u>	<u>Yes</u>		
Date/time tank hauled off?	<u>21 May 01 @ 14:00</u>			
No. of soil samples taken?	<u>2</u>	<u>1</u>		
Depth of soil samples (ft. bgs)	<u>5' surface</u>	<u>5' surface</u>		

Piping Removal	Yes	No	N/A
All piping removed hauled off w/ tanks?	<u>Yes</u>		
Obvious holes on pipes?		X	
Obvious odors from pipes?		X	
Obvious soil discoloration in piping trench?		X	
Obvious odors from piping trench?	<u>Yes</u>	X	X
Water in piping trench?	<u>Yes</u>	X	
Number & depth of soil samples from piping trench?	<u>7 @ 2' in backfill</u>		
Number & depth of water samples from piping trench?	<u>N/A</u>		

General Observations	Yes	No	N/A
Leak from any tank suspected?		X	
"Leak Report" form given to the operator?		X	
Obviously contaminated soil excavated?		X	
Soil stockpile sampled?	X		
Stockpile lined AND covered?	X		
Water in excavation sampled?	X		
Number/depth of water samples taken?	<u>3 @ 5' in water</u>		
All samples properly preserved for transport?	X		

Additional Observations	Yes	No	N/A
Soil/water sampling protocols acceptable?	✓		
Sampling "chain of custody" noted?	✓		
Tank pit filled in or covered?			
Tank pit fenced or barricaded?			
Transporter a registered HW hauler?			
Uniform HW Manifest completed?			
Contractor/Consultant reminded of complete UST Removal Report due within 30 days?			
Date/Time removal/closure operations completed?			
OT hours or additional charges due from contractor?			



Notes/Comments: Remove tank #1 - 12K
Remove tank #2 - 500
Remove tank #3 - 500
Remove tank #4 - 500

City Of Oakland
FIRE PREVENTION BUREAU
 250 Frank Ogawa Plaza, Ste. 3341
 Oakland California 94612-2032
 510-238-3851



*Permit To Excavate And Install, Repair,
 Or Remove Inflammable Liquid Tanks*

Oakland, California April 16, 2002

Tank Permit Number: 22-02

Permission Is Hereby Granted To:

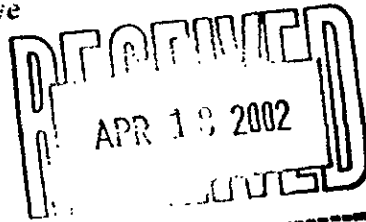
Remove gasoline & waste oil Tank And Excavate Commencing: Feet Inside: Property Line.

On The: NW side of Airport Drive

Site Address: 1 Airport Drive

Owner: Hertz Corp.

Applicant: ATC Associates



Present Storage: Gasoline & Waste Oil

Address: 225 Brae Blvd., Park Ridge, NJ, 07656

Phone:

Address: 6602 Owens Dr. Pleasanton, CA 94588

Phone: (925) 466-5300

Dimensions Of Street (sidewalk) Surface To Be Disturbed: X No. Of Tanks 2 Capacity see below Gallons, Each

Remarks (1) 12,000 gallon tank & (1) 500 gallon tank

This Permit Is Granted In Accordance With Existing City Ordinances. Owner Hereby Agrees To Remove Tanks On Discontinuance Of Use Or When Notified By The City Authorities When Installing, Removing Or Repairing Tanks, No Open Flame To Be On Or Near Premises.

CERTIFICATE OF TANK AND EQUIPMENT INSPECTION

Type Of Inspection: UST Removal

Inspected And Passed On: 2/16/02

By: [Signature]

Approved: [Signature]
 Fire Marshal

UST/AST Installations/modifications:

Pressure Test: Inspected By: _____ Date: _____

Primary Piping Test: Inspected By: _____ Date: _____

Inspection Fee Paid: \$ 650.00

Secondary Containment & Sump Testing:

Inspected By: _____ Date: _____

Final: Inspected By: _____ Date: _____

Received By: [Signature]

Before Covering Tanks, Above Certification Must Be Signed When Ready For Inspection Notify Fire Prevention Bureau 238-3851

THIS PERMIT MUST BE LEFT ON THE WORK SITE AS AUTHORITY THEREFORE

CONFIDENTIAL

STATE OF CALIFORNIA DWR
WELL COMPLETION REPORT
(WELL LOGS)

REMOVED

UNIFORM HAZARDOUS WASTE MANIFEST

1. Generator's US EPA ID No. **CA0982916698951321** Manifest Document No. **21395152** 2. Page 1 of 1
 Information in the shaded areas is not required by Federal law.

3. Generator's Name and Mailing Address
**255 Port Blvd
 Richmond CA 94801**
 A. State Manifest Document Number **21395152**
 B. State Generator's ID

4. Generator's Phone **(925) 736-6760**
 5. Transporter 1 Company Name **California Waste Services** 6. US EPA ID Number **CA0982916698951321**
 C. State Transporter's ID [Reserved]
 D. Transporter's Phone **(510) 235-1393**

7. Transporter 2 Company Name 8. US EPA ID Number
 E. State Transporter's ID [Reserved]
 F. Transporter's Phone

9. Designated Facility Name and Site Address
**255 Port Blvd
 Richmond CA 94801**
 10. US EPA ID Number **CA0982916698951321**
 G. State Facility's ID
 H. Facility's Phone **(510) 235-1393**

11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number)
Non-RCRA hazardous waste, solid (waste empty storage tank)
 12. Containers No. **1012** Type **TP** 13. Total Quantity **0.62450** 14. Unit Wt/Val **P**
 I. Waste Number State **CA** EPA/Other **9000**

b. State EPA/Other

c. State EPA/Other

d. State EPA/Other

13. Additional Descriptions for Materials Listed Above
TANKS HAVE BEEN INJECTED WITH HELIUM TO FILL TO FULL CAPACITY
 K. Handling Codes for Wastes Listed Above
 a. **99** b. c. d.

14. Special Handling Instructions and Additional Information
24 Hour emergency contact: (925) 736-6760
24 Hour emergency telephone number: (925) 736-6760
DOT ERG 1.1 and 1.2

16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations.
 If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.

Printed/Typed Name **David Spitzer** Signature **[Signature]** Month **11** Day **12** Year **1997**

17. Transporter 1 Acknowledgement of Receipt of Materials
 Printed/Typed Name **William [Signature]** Signature **[Signature]** Month **11** Day **12** Year **1997**

18. Transporter 2 Acknowledgement of Receipt of Materials
 Printed/Typed Name Signature Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19.
 Printed/Typed Name **[Signature]** Signature **[Signature]** Month **11** Day **12** Year **1997**

DO NOT WRITE BELOW THIS LINE.

IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802. WITHIN CALIFORNIA, CALL 1-800-852-7550

DAY OR NIGHT
TELEPHONE
(510) 235-1393

CERTIFICATE CERTIFIED SERVICES COMPANY

255 Parr Boulevard • Richmond, California 94801

NO. 37701

CUSTOMER
JOB NO. 9243952
SPEELMAN H&C

FOR: ECOLOGIX CONTROL INDUST TANK NO. 10745

LOCATION: RICHMOND, CA DATE: 09/20/02 TIME: 5:23.55

TEST METHOD VISUAL GAS TECH/1314 SMPN LAST PRODUCT UG

This is to certify that I have personally determined that this tank is in accordance with the American Petroleum Institute and have found the condition to be in accordance with its assigned designation. This certificate is based on conditions existing at the time the inspection herein set forth was completed and is issued subject to compliance with all qualifications and instructions.

TANK SIZE 1200G CONDITION SAFE FOR FIRE

REMARKS: OXYGEN 20.9% LOWER EXPLOSIVE LIMIT LESS THAN 0.1% ECOLOGIX CONTROL INDUSTRIES
HEREBY CERTIFIES THAT THE ABOVE NUMBERED TANK HAS BEEN DETONATED, PROCESSED
AND THEREFORE DESTROYED AT OUR PERMITTED HAZARDOUS WASTE FACILITY
ECOLOGIX CONTROL INDUSTRIES HAS THE APPROPRIATE PERMITS FOR, AND HAS ACCEPTED
THE TANK SHIPPED TO US FOR PROCESSING

In the event of any physical or atmospheric changes affecting the gas-free conditions of the above tanks, or if in any doubt, immediately stop all hot work and contact the undersigned. This permit is valid for 24 hours if no physical or atmospheric changes occur.

STANDARD SAFETY DESIGNATION

SAFE FOR MEN: Means that in the compartment or space so designated (a) The oxygen content of the atmosphere is at least 19.5 percent by volume; and that (b) Toxic materials in the atmosphere are within permissible concentrations; and (c) In the judgment of the Inspector, the residues are not capable of producing toxic materials under existing atmospheric conditions while maintained as directed on the Inspector's certificate.

SAFE FOR FIRE: Means that in the compartment so designated (a) The concentration of flammable materials in the atmosphere is below 10 percent of the lower explosive limit; and that (b) In the judgment of the Inspector, the residues are not capable of producing a higher concentration than permitted under existing atmospheric conditions in the presence of fire and while maintained as directed on the Inspector's certificate, and further, (c) All adjacent spaces have either been cleaned sufficiently to prevent the spread of fire, are satisfactorily inerted, or in the case of fuel tanks, have been treated as deemed necessary by the Inspector.

The undersigned representative acknowledges receipt of this certificate and understands the conditions and limitations under which it was issued.

James Wilcox
REPRESENTATIVE

TITLE

[Signature]
INSPECTOR

DAY OR NIGHT
TELEPHONE
(510) 235-1393

CERTIFICATE CERTIFIED SERVICES COMPANY

255 Parr Boulevard • Richmond, California 94801

NO. 37704

CUSTOMER
JOB NO. 5243952
SPEELMAN INC

FOR: ECI CITY CONTROL INSTANK NO. 20746

LOCATION: RICHMOND, CA DATE: 6/24/02 TIME: 4:50:00

TEST METHOD VISUAL GAS TECH/1214 SMPN LAST PRODUCT UG

This is to certify that I have personally determined that this tank is in accordance with the American Petroleum Institute and have found the condition to be in accordance with its assigned designation. This certificate is based on conditions existing at the time the inspection herein set forth was completed and is issued subject to compliance with all qualifications and instructions.

SAFE FOR FIRE

TANK SIZE _____ CONDITION _____

REMARKS: PERCY CERTIFIES THAT THE ABOVE NUMBERED TANK HAS BEEN CUT OPEN, PROCESSED,
AND THEREFORE DESTROYED AT OUR PERMITTED HAZARDOUS WASTE FACILITY
UNLESS CONTACT INDICATED IN THE ADJACENT SPACES CONTAINING ADJACENT
THE TANK SHIPPED TO US FOR PROCESSING

In the event of any physical or atmospheric changes affecting the gas-free conditions of the above tanks, or if in any doubt, immediately stop all hot work and contact the undersigned. This permit is valid for 24 hours if no physical or atmospheric changes occur.

STANDARD SAFETY DESIGNATION

SAFE FOR MEN: Means that in the compartment or space so designated (a) The oxygen content of the atmosphere is at least 19.5 percent by volume; and that (b) Toxic materials in the atmosphere are within permissible concentrations; and (c) In the judgment of the inspector, the residues are not capable of producing toxic materials under existing atmospheric conditions while maintained as directed on the inspector's certificate.

SAFE FOR FIRE: Means that in the compartment so designated (a) The concentration of flammable materials in the atmosphere is below 10 percent of the lower explosive limit; and that (b) In the judgment of the inspector, the residues are not capable of producing a higher concentration that permitted under existing atmospheric conditions in the presence of fire and while maintained as directed on the inspector's certificate, and further, (c) All adjacent spaces have either been cleaned sufficiently to prevent the spread of fire, are satisfactorily inerted, or in the case of fuel tanks, have been treated as deemed necessary by the inspector.

The undersigned representative acknowledges receipt of this certificate and understands the conditions and limitations under which it was issued.

James Wilcox REPRESENTATIVE TITLE INSPECTOR [Signature]

NON-HAZARDOUS WASTE MANIFEST

1. Generator's US EPA ID No.

N/A

Manifest Doc. No.

2.9.98.1

2. Page 1

of 1

10/14/2002

3. Generator's Name and Mailing Address

HERTZ CORPORATION
225 BRAE BLVD.
PARK RIDGE, NJ 07656

4. Generator's Phone (973) 465-6942

5. Transporter 1 Company Name

FOSS ENVIRONMENTAL SERVICES

6. US EPA ID Number

C.A.R.0.0.0.0.3.0.1.1.4

A. Transporter's Phone

(510)749-1390

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address

D/K ENVIRONMENTAL
3650 E. 26TH ST.
VERNON, CA 90023

10. US EPA ID Number

C.A.T.0.8.0.0.3.3.6.8.1

C. Facility's Phone

(323)268-5056

11. Waste Shipping Name and Description

a. NON-HAZARDOUS WASTE, LIQUID (PURGE WATER)

12. Containers

No. Type

13. Total Quantity

14. Unit Wt/Vol

0.06 D.M 0.0330 G

D. Additional Descriptions for Materials Listed Above

11A) 321015-41 (6x55)

Site:
1 Airport Dr.
Oakland, CA 94621

E. Handling Codes for Wastes Listed Above

15. Special Handling Instructions and Additional Information

USE APPROPRIATE PERSONAL PROTECTIVE EQUIPMENT

24-HR. EMERGENCY CONTACT:
FOSS ENVIRONMENTAL (510)749-1390

JOB#: A2998

PO#: A2998-01

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name

Signature

Month Day Year

X *[Signature]*

[Signature]

10 14 02

17. Transporter 1 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

DANIEL FETROW

[Signature]

10 14 02

18. Transporter 2 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name

Signature

Month Day Year

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
PHONE		SPECIAL HANDLING PROCEDURES:	
CONTACT PERSON		RECEIVING FACILITY	
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE		
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
TRANSPORTER		NOTES: VEHICLE LICENSE NUMBER TRUCK NUMBER	
ADDRESS			
CITY, STATE, ZIP			
PHONE		<input type="checkbox"/> END DUMP <input type="checkbox"/> BOTTOM DUMP <input type="checkbox"/> TRANSFER <input type="checkbox"/> ROLL-OFF(S) <input type="checkbox"/> FLAT-BED <input type="checkbox"/> VAN <input type="checkbox"/> DRUMS	
SIGNATURE OF AUTHORIZED AGENT OR DRIVER		DATE	
I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE OTHER	
SIGNATURE OF AUTHORIZED AGENT		<input type="checkbox"/> SOIL <input type="checkbox"/> CONSTRUCTION DEBRIS <input type="checkbox"/> NON-FRIABLE ASBESTOS <input type="checkbox"/> WOOD <input type="checkbox"/> ASH <input type="checkbox"/> SPECIAL OTHER	
DATE			

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR HERTZ		WASTE ACCEPTANCE NO. SWTC 2240	
MAILING ADDRESS 225 BRAD BLVD		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP DARLENGE 9107653		<input type="checkbox"/> GLOVES <input type="checkbox"/> SOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
PHONE 925-735-0750		SPECIAL HANDLING PROCEDURES:	
CONTACT PERSON FRED WEAVER		RECEIVING FACILITY	
SIGNATURE OF AUTHORIZED AGENT / TITLE <i>[Signature]</i>	DATE 2/9/02		
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations: AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE: <input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY 1 AIRPORT DR. OAKLAND			
TRANSPORTER [Signature]	NOTES:	VEHICLE LICENSE NUMBER 9B34213	TRUCK NUMBER # P607
ADDRESS STATE ROUTE 101			
CITY, STATE, ZIP ORLANDO FL 32707			
PHONE 1 321 957-5349		END DUMP BOTTOM DUMP TRANSFER	
SIGNATURE OF AUTHORIZED AGENT OR DRIVER <i>[Signature]</i>	DATE 02-09-02	ROLL-OFF(S) FLAT-BED VAN DRUMS	
I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
REMARKS		DISPOSE	OTHER
FACILITY TICKET NUMBER		<input type="checkbox"/> SOIL	
SIGNATURE OF AUTHORIZED AGENT <i>[Signature]</i>		<input type="checkbox"/> CONSTRUCTION DEBRIS	
DATE 2/9/02		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
San Jose, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

OX Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
HERTZ		SWIC 2240	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
225 BRAE BLVD		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CITY, STATE, ZIP		SPECIAL HANDLING PROCEDURES:	
PARKRIDGE CA 94756			
PHONE			
925-736-0760			
CONTACT PERSON			
FRED WEAVER			
SIGNATURE OF AUTHORIZED AGENT / TITLE			
* <i>[Signature]</i>			
DATE			
8/9/02			
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.		RECEIVING FACILITY	
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR. OAKLAND			

TRANSPORTER		NOTES:		VEHICLE LICENSE NUMBER	TRUCK NUMBER
James Byrds Trucking				TR/4/07	35
ADDRESS					
2000 W. ...					
CITY, STATE, ZIP					
CARRISON CA					
PHONE					
925-635-7886					
SIGNATURE OF AUTHORIZED AGENT OR DRIVER					
* <i>[Signature]</i>					
DATE					
8/9/02					
		END DUMP		BOTTOM DUMP	
		<input checked="" type="checkbox"/>		<input type="checkbox"/>	
		ROLL-OFF(S)		FLAT-BED	
		<input type="checkbox"/>		<input type="checkbox"/>	
		VAN		DRUMS	
		<input type="checkbox"/>		<input type="checkbox"/>	

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
		18	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
		<input checked="" type="checkbox"/> SOIL <input type="checkbox"/> DISPOSE <input type="checkbox"/> OTHER <input type="checkbox"/> CONSTRUCTION DEBRIS <input type="checkbox"/> NON-FRIABLE ASBESTOS <input type="checkbox"/> WOOD <input type="checkbox"/> ASH <input type="checkbox"/> SPECIAL OTHER	
FACILITY TICKET NUMBER			
SIGNATURE OF AUTHORIZED AGENT			
* <i>[Signature]</i>			
DATE			
8/9/02			

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon Sanitary Landfill
 901 Bailey Road
 Pittsburg, CA 94565
 Phone (925) 458-9800
 Fax (925) 458-9891

Ox Mountain Sanitary Landfill
 12310 San Mateo Road
 Half Moon Bay, CA 94019
 Phone (650) 726-1819
 Fax (650) 726-9183

Newby Island Sanitary Landfill
 1601 Dixon Landing Road
 Milpitas, CA 95035
 Phone (408) 945-2800
 Fax (408) 262-2871

Forward Landfill
 9999 S. Austin Road
 Manteca, CA 95336
 Phone (209) 982-4298
 Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
PHONE		SPECIAL HANDLING PROCEDURES:	
CONTACT PERSON		RECEIVING FACILITY	
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE		
* <i>[Signature]</i>	7/7/05		
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR. OAKLAND			

TRANSPORTER KRIS GAARE		NOTES:	
ADDRESS 1940 Kenton Pl		VEHICLE LICENSE NUMBER	TRUCK NUMBER
CITY, STATE, ZIP		4137337	4
PHONE		END DUMP	BOTTOM DUMP
SIGNATURE OF AUTHORIZED AGENT OR DRIVER		<input checked="" type="checkbox"/>	<input type="checkbox"/>
* KRIS GAARE		ROLL-OFF(S)	VAN
DATE 8-0-05		<input type="checkbox"/>	<input type="checkbox"/>
		<input type="checkbox"/>	<input type="checkbox"/>

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
		DISPOSE	OTHER
FACILITY TICKET NUMBER		<input type="checkbox"/> SOIL	
SIGNATURE OF AUTHORIZED AGENT		<input type="checkbox"/> CONSTRUCTION DEBRIS	
* <i>[Signature]</i>		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
DATE 8/9/05		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT	
PHONE		<input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CONTACT PERSON		SPECIAL HANDLING PROCEDURES:	
SIGNATURE OF AUTHORIZED AGENT / TITLE		RECEIVING FACILITY	
DATE			
<p>GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.</p>			
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR., OAKLAND			

TRANSPORTER	NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER
ADDRESS		9A94293	#106
CITY, STATE, ZIP			
PHONE			
SIGNATURE OF AUTHORIZED AGENT OR DRIVER			
DATE			
		END DUMP	BOTTOM DUMP
		ROLL-OFF(S)	FLAT-BED
			VAN
			DRUMS

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE	
SIGNATURE OF AUTHORIZED AGENT		OTHER	
DATE		<input type="checkbox"/> SOIL	
		<input type="checkbox"/> CONSTRUCTION DEBRIS	
		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

SCHEDULING MUST BE MADE PRIOR TO 3:00 PM THE DAY PRIOR TO EXPECTED ARRIVAL. ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE. TRANSPORTER COPY MANIFEST # 167102

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT	
PHONE		<input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CONTACT PERSON		SPECIAL HANDLING PROCEDURES:	
SIGNATURE OF AUTHORIZED AGENT / TITLE		RECEIVING FACILITY	
DATE			
* <i>[Signature]</i>			
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE			
<input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD			
<input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER			
<input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR.. OAKLAND			
TRANSPORTER <i>OR TRUCKING</i>		NOTES:	VEHICLE LICENSE NUMBER
ADDRESS <i>229 E. 11th St</i>			<i>R312</i>
CITY, STATE, ZIP <i>2212 St 95612</i>			<i>TPO5520</i>
PHONE: <i>24 249-119</i>		END DUMP	BOTTOM DUMP
SIGNATURE OF AUTHORIZED AGENT OR DRIVER		<input checked="" type="checkbox"/>	<input type="checkbox"/>
DATE		ROLL-OFF(S)	FLAT-BED
* <i>Richard Bay</i>		<input type="checkbox"/>	<input type="checkbox"/>
		VAN	DRUMS
		<input type="checkbox"/>	<input type="checkbox"/>
I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE	
SIGNATURE OF AUTHORIZED AGENT		OTHER	
DATE		<input type="checkbox"/> SOIL	
* <i>[Signature]</i>		<input type="checkbox"/> CONSTRUCTION DEBRIS	
		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL. ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR HERTZ		WASTE ACCEPTANCE NO.	
MAILING ADDRESS 225 BR...			
CITY, STATE, ZIP ...		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
PHONE ...		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CONTACT PERSON FRANZ...		SPECIAL HANDLING PROCEDURES:	
SIGNATURE OF AUTHORIZED AGENT / TITLE <i>* [Signature]</i>		DATE 8/1/02	
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 269 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:		RECEIVING FACILITY	
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY 1 AIRPORT DR. OAKLAND			

TRANSPORTER CORPORATION		NOTES:	VEHICLE LICENSE NUMBER 9R63584	TRUCK NUMBER (R311)
ADDRESS ...				
CITY, STATE, ZIP ...				
PHONE ...				
SIGNATURE OF AUTHORIZED AGENT OR DRIVER <i>* Marcos Rivera</i>		DATE 8-3-02		
		END DUMP <input checked="" type="checkbox"/>	BOTTOM DUMP <input type="checkbox"/>	TRANSFER <input type="checkbox"/>
		ROLL-OFF(S) <input type="checkbox"/>	FLAT-BED <input type="checkbox"/>	VAN <input type="checkbox"/>
			DRUMS <input type="checkbox"/>	

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE	OTHER
SIGNATURE OF AUTHORIZED AGENT <i>[Signature]</i>		<input type="checkbox"/> SOIL	
DATE 8/1/02		<input type="checkbox"/> CONSTRUCTION DEBRIS	
		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
		<input type="checkbox"/> WOOD	
		<input checked="" type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

Keller Canyon Sanitary Landfill
 901 Bailey Road
 Pittsburg, CA 94565
 Phone (925) 458-9800
 Fax (925) 458-9891

Ox Mountain Sanitary Landfill
 12310 San Mateo Road
 Half Moon Bay, CA 94019
 Phone (650) 726-1819
 Fax (650) 726-9183

Newby Island Sanitary Landfill
 1601 Dixon Landing Road
 Milpitas, CA 95035
 Phone (408) 945-2800
 Fax (408) 262-2871

Forward Landfill
 9999 S. Austin Road
 Manteca, CA 95336
 Phone (209) 982-4298
 Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
HERTZ		SWIC 22-40	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
133 DRAE BLVD		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CITY, STATE, ZIP		SPECIAL HANDLING PROCEDURES:	
PARKRIDGE, CA 97654			
PHONE 925-736-0760			
CONTACT PERSON			
FRED WEAVER			
SIGNATURE OF AUTHORIZED AGENT / TITLE		DATE	
*			

GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261

WASTE TYPE:

<input type="checkbox"/> DISPOSAL	<input type="checkbox"/> SLUDGE
<input type="checkbox"/> CONSTRUCTION	<input type="checkbox"/> WOOD
<input type="checkbox"/> DEBRIS	<input type="checkbox"/> OTHER
<input type="checkbox"/> SPECIAL WASTE	

GENERATING FACILITY
 1 AIRPORT DR. OAKLAND

RECEIVING FACILITY

TRANSPORTER Tony Hood

ADDRESS 2180 Keith way

CITY, STATE, ZIP Folsom CA

PHONE 209 632 5735

SIGNATURE OF AUTHORIZED AGENT OR DRIVER Tony Hood

DATE 8/9/02

NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER
	9B39R94	Z
END DUMP	BOTTOM DUMP	TRANSFER
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
ROLL-OFF(S)	FLAT-BED	VAN
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		DRUMS
		<input type="checkbox"/>

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.

REMARKS

FACILITY TICKET NUMBER

SIGNATURE OF AUTHORIZED AGENT

DATE 8/9/02

CUBIC YARDS

DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)

	DISPOSE	OTHER
<input type="checkbox"/> SOIL		
<input type="checkbox"/> CONSTRUCTION DEBRIS		
<input type="checkbox"/> NON-FRIABLE ASBESTOS		
<input type="checkbox"/> WOOD		
<input type="checkbox"/> ASH		
<input type="checkbox"/> SPECIAL OTHER		

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR HERTZ		WASTE ACCEPTANCE NO. SWTC 2240	
MAILING ADDRESS 25 ERAE BLVD		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP PARK RIDGE, NJ 07656		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT	
PHONE 925-750-0500		<input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CONTACT PERSON FRED MEYER		SPECIAL HANDLING PROCEDURES:	
SIGNATURE OF AUTHORIZED AGENT / TITLE <i>[Signature]</i>		DATE 2/9/02	
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.		RECEIVING FACILITY	
WASTE TYPE: <input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY 1 AIRPORT DR. OAKLAND			

TRANSPORTER <i>[Signature]</i>	NOTES:	VEHICLE LICENSE NUMBER 1997946	TRUCK NUMBER 71
ADDRESS <i>[Address]</i>			
CITY, STATE, ZIP <i>[City, State, ZIP]</i>			
PHONE <i>[Phone]</i>	END DUMP <input type="checkbox"/>	BOTTOM DUMP <input type="checkbox"/>	TRANSFER <input type="checkbox"/>
SIGNATURE OF AUTHORIZED AGENT OR DRIVER <i>[Signature]</i>	DATE 2/9/02	ROLL-OFF(S) <input type="checkbox"/>	FLAT-BED <input type="checkbox"/>
		VAN <input type="checkbox"/>	DRUMS <input type="checkbox"/>

<p>I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.</p> <p>REMARKS</p> <p>FACILITY TICKET NUMBER</p> <p>SIGNATURE OF AUTHORIZED AGENT <i>[Signature]</i></p> <p>DATE 2/9/02</p>	CUBIC YARDS		
	DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)		
		DISPOSE	OTHER
	<input type="checkbox"/> SOIL		
	<input type="checkbox"/> CONSTRUCTION DEBRIS		
	<input type="checkbox"/> NON-FRIABLE ASBESTOS		
<input type="checkbox"/> WOOD			
<input type="checkbox"/> ASH			
<input type="checkbox"/> SPECIAL OTHER			

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
BERTZ		SWAC 2240	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
125 BRAD BLVD		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CITY, STATE, ZIP		SPECIAL HANDLING PROCEDURES:	
DUNDYVILLE, NJ 07656			
PHONE			
925-736-0760			
CONTACT PERSON			
FRED WEAVER			
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE		
*			
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:		RECEIVING FACILITY	
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR., OAKLAND			
TRANSPORTER	NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER
RON BLAND		9B94/339	99
ADDRESS			
CITY, STATE, ZIP			
LOS ANGELES, CA			
PHONE		END DUMP	BOTTOM DUMP
209-826-2555		<input checked="" type="checkbox"/>	<input type="checkbox"/>
SIGNATURE OF AUTHORIZED AGENT OR DRIVER	DATE	TRANSFER	
* [Signature]	8-8-02	ROLL-OFF(S)	FLAT-BED
		<input type="checkbox"/>	<input type="checkbox"/>
		VAN	DRUMS
		<input type="checkbox"/>	<input type="checkbox"/>
I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE OTHER	
SIGNATURE OF AUTHORIZED AGENT		<input type="checkbox"/> SOIL	
DATE		<input type="checkbox"/> CONSTRUCTION DEBRIS	
* [Signature]		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
9/4/02		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.


Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891


Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183


Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
HERIZ		SUITE 2240	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
225 BRAE BLVD		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
CITY, STATE, ZIP		SPECIAL HANDLING PROCEDURES:	
PARK RIDGE NJ 07656			
PHONE			
925-736-0760			
CONTACT PERSON			
FRIDY WEAVER			
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE		
* 	8/6/07		
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.		RECEIVING FACILITY	
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
L AIRPORT DR. OAKLAND			

TRANSPORTER	NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER
Real B LAND		1XL859	00
ADDRESS			
14286 CRISWELL RD			
CITY, STATE, ZIP			
LOS BANOS CA 93635			
PHONE	END DUMP	BOTTOM DUMP	TRANSFER
209-826-0555	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
SIGNATURE OF AUTHORIZED AGENT OR DRIVER	ROLL-OFF(S)	FLAT-BED	VAN DRUMS
* 	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
DATE			
8-9-07			

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.	CUBIC YARDS	
	19	
REMARKS	DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
	DISPOSE	OTHER
	<input type="checkbox"/> SOIL	
	<input type="checkbox"/> CONSTRUCTION DEBRIS	
	<input type="checkbox"/> NON-FRIABLE ASBESTOS	
	<input type="checkbox"/> WOOD	
	<input type="checkbox"/> ASH	
SIGNATURE OF AUTHORIZED AGENT	DATE	<input type="checkbox"/> SPECIAL OTHER
* 	8/9/07	

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill

901, Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill

12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill

1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill

9999 S. Austin Road
Manteca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR		WASTE ACCEPTANCE NO.	
MAILING ADDRESS		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
CITY, STATE, ZIP		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
PHONE		SPECIAL HANDLING PROCEDURES:	
CONTACT PERSON		RECEIVING FACILITY	
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE		
* <i>[Signature]</i>	2/1/02		
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:			
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY			
1 AIRPORT DR.. OAKLAND			

TRANSPORTER <i>DAVID ACEVEDO</i>	NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER
ADDRESS <i>2610 E. 8th St</i>		<i>9-651170</i>	<i>781-131</i>
CITY, STATE, ZIP <i>Stockton CA</i>			
PHONE <i>209-466-5154</i>			
SIGNATURE OF AUTHORIZED AGENT OR DRIVER	DATE	END DUMP	BOTTOM DUMP
* <i>David Acevedo</i>	<i>08-08-02</i>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		ROLL-OFF(S)	FLAT-BED
		<input type="checkbox"/>	<input type="checkbox"/>
		VAN	DRUMS
		<input type="checkbox"/>	<input type="checkbox"/>

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.		CUBIC YARDS	
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
FACILITY TICKET NUMBER		DISPOSE OTHER	
SIGNATURE OF AUTHORIZED AGENT		<input type="checkbox"/> SOIL	
DATE		<input type="checkbox"/> CONSTRUCTION DEBRIS	
* <i>[Signature]</i>		<input type="checkbox"/> NON-FRIABLE ASBESTOS	
<i>8/9/02</i>		<input type="checkbox"/> WOOD	
		<input type="checkbox"/> ASH	
		<input type="checkbox"/> SPECIAL OTHER	

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL. ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE. TRANSPORTER COPY MANIFEST 167102

Keller Canyon Sanitary Landfill
 901 Bailey Road
 Pittsburg, CA 94565
 Phone (925) 458-9800
 Fax (925) 458-9891

Ox Mountain Sanitary Landfill
 12310 San Mateo Road
 Half Moon Bay, CA 94019
 Phone (650) 726-1819
 Fax (650) 726-9183

Newby Island Sanitary Landfill
 1601 Dixon Landing Road
 Milpitas, CA 95035
 Phone (408) 945-2800
 Fax (408) 262-2871

Forward Landfill
 9999 S. Austin Road
 Manteca, CA 95336
 Phone (209) 982-4298
 Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR HERTZ		WASTE ACCEPTANCE NO. 2240																						
MAILING ADDRESS 225 BRAE BLVD		REQUIRED PERSONAL PROTECTIVE EQUIPMENT																						
CITY, STATE, ZIP PARK RIDGE, NJ 07656		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT <input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER																						
PHONE 925-756-0760		SPECIAL HANDLING PROCEDURES:																						
CONTACT PERSON FREY/WEAVER		RECEIVING FACILITY																						
SIGNATURE OF AUTHORIZED AGENT / TITLE	DATE																							
<i>[Signature]</i>	2/1/02																							
<p>GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.</p>																								
WASTE TYPE:																								
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE																								
GENERATING FACILITY LAUREL DR... OAKLAND																								
TRANSPORTER	NOTES:	VEHICLE LICENSE NUMBER	TRUCK NUMBER																					
<i>[Handwritten]</i>		7262-31	305																					
ADDRESS																								
CITY, STATE, ZIP																								
PHONE																								
SIGNATURE OF AUTHORIZED AGENT OR DRIVER	DATE	END DUMP	BOTTOM DUMP																					
<i>[Signature]</i>	2-1-02	<input checked="" type="checkbox"/>	<input type="checkbox"/>																					
		TRANSFER	ROLL-OFF(S)																					
		<input type="checkbox"/>	<input type="checkbox"/>																					
		FLAT-BED	VAN																					
		<input type="checkbox"/>	<input type="checkbox"/>																					
		DRUMS	<input type="checkbox"/>																					
		<input type="checkbox"/>	<input type="checkbox"/>																					
<p>I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.</p>		CUBIC YARDS																						
REMARKS		DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)																						
		<table border="1"> <tr> <td></td> <td>DISPOSE</td> <td>OTHER</td> </tr> <tr> <td><input type="checkbox"/> SOIL</td> <td></td> <td></td> </tr> <tr> <td><input type="checkbox"/> CONSTRUCTION DEBRIS</td> <td></td> <td></td> </tr> <tr> <td><input type="checkbox"/> NON-FRIABLE ASBESTOS</td> <td></td> <td></td> </tr> <tr> <td><input type="checkbox"/> WOOD</td> <td></td> <td></td> </tr> <tr> <td><input type="checkbox"/> ASH</td> <td></td> <td></td> </tr> <tr> <td><input type="checkbox"/> SPECIAL OTHER</td> <td></td> <td></td> </tr> </table>			DISPOSE	OTHER	<input type="checkbox"/> SOIL			<input type="checkbox"/> CONSTRUCTION DEBRIS			<input type="checkbox"/> NON-FRIABLE ASBESTOS			<input type="checkbox"/> WOOD			<input type="checkbox"/> ASH			<input type="checkbox"/> SPECIAL OTHER		
	DISPOSE	OTHER																						
<input type="checkbox"/> SOIL																								
<input type="checkbox"/> CONSTRUCTION DEBRIS																								
<input type="checkbox"/> NON-FRIABLE ASBESTOS																								
<input type="checkbox"/> WOOD																								
<input type="checkbox"/> ASH																								
<input type="checkbox"/> SPECIAL OTHER																								
FACILITY TICKET NUMBER																								
SIGNATURE OF AUTHORIZED AGENT	DATE																							
<i>[Signature]</i>	2/1/02																							

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

Keller Canyon
Sanitary Landfill
901 Bailey Road
Pittsburg, CA 94565
Phone (925) 458-9800
Fax (925) 458-9891

Ox Mountain
Sanitary Landfill
12310 San Mateo Road
Half Moon Bay, CA 94019
Phone (650) 726-1819
Fax (650) 726-9183

Newby Island
Sanitary Landfill
1601 Dixon Landing Road
Milpitas, CA 95035
Phone (408) 945-2800
Fax (408) 262-2871

Forward
Landfill
9999 S. Austin Road
Maritaca, CA 95336
Phone (209) 982-4298
Fax (209) 982-1009

NON-HAZARDOUS WASTE MANIFEST

GENERATOR MERCZ		WASTE ACCEPTANCE NO. SWIC 2247	
MAILING ADDRESS 225 BIRCH BLVD			
CITY, STATE, ZIP PARKBRIDGE NJ 07656		REQUIRED PERSONAL PROTECTIVE EQUIPMENT	
PHONE 925-736-0760		<input type="checkbox"/> GLOVES <input type="checkbox"/> GOGGLES <input type="checkbox"/> RESPIRATOR <input type="checkbox"/> HARD HAT	
CONTACT PERSON FRIM WEAVER		<input type="checkbox"/> TY-VEK <input type="checkbox"/> OTHER	
SIGNATURE OF AUTHORIZED AGENT / TITLE <i>[Signature]</i>		SPECIAL HANDLING PROCEDURES:	
DATE 2/9/02			
GENERATOR'S CERTIFICATION: I hereby certify that the above named material is not a hazardous waste as defined by 40 CFR Part 261 or title 22 of the California code of regulations, has been properly described, classified and packaged, and is in proper condition for transportation according to applicable regulations; AND, if the waste is a treatment residue of a previously restricted hazardous waste subject to the Land Disposal Restrictions, I certify and warrant that the waste has been treated in accordance with the requirements of 40 CFR Part 268 and is no longer a hazardous waste as defined by 40 CFR Part 261.			
WASTE TYPE:		RECEIVING FACILITY	
<input type="checkbox"/> DISPOSAL <input type="checkbox"/> SLUDGE <input type="checkbox"/> CONSTRUCTION <input type="checkbox"/> WOOD <input type="checkbox"/> DEBRIS <input type="checkbox"/> OTHER <input type="checkbox"/> SPECIAL WASTE			
GENERATING FACILITY 1 AIRPORT DR. OAKLAND			

TRANSPORTER PORT	NOTES:	VEHICLE LICENSE NUMBER 9A612PP	TRUCK NUMBER 2
ADDRESS 4750 S...			
CITY, STATE, ZIP			
PHONE 502-883-0206	END DUMP <input checked="" type="checkbox"/>	BOTTOM DUMP <input type="checkbox"/>	TRANSFER <input type="checkbox"/>
SIGNATURE OF AUTHORIZED AGENT OR DRIVER <i>[Signature]</i>	ROLL-OFF(S) <input type="checkbox"/>	FLAT-BED <input type="checkbox"/>	VAN <input type="checkbox"/>
DATE 2-9-02			DRUMS <input type="checkbox"/>

I hereby certify that the above named material has been accepted and to the best of my knowledge the foregoing is true and accurate.	CUBIC YARDS	
	DISPOSAL METHOD: (TO BE COMPLETED BY LANDFILL)	
	DISPOSE	OTHER
	<input type="checkbox"/> SOIL	
	<input type="checkbox"/> CONSTRUCTION DEBRIS	
	<input type="checkbox"/> NON-FRIABLE ASBESTOS	
REMARKS	<input type="checkbox"/> WOOD	
FACILITY TICKET NUMBER	<input type="checkbox"/> ASH	
SIGNATURE OF AUTHORIZED AGENT <i>[Signature]</i>	<input type="checkbox"/> SPECIAL OTHER	
DATE 2-9-02		

SCHEDULING MUST BE MADE PRIOR TO 3:00 P.M. THE DAY PRIOR TO EXPECTED ARRIVAL • ANY UNSCHEDULED LOADS ARE SUBJECT TO REFUSAL UPON ARRIVAL. ONGOING DAILY DELIVERIES MUST BE SCHEDULED WITH THE LANDFILL THE DAY BEFORE.

References

- California Regional Water Quality Control Board, San Francisco Bay Region, 2001, *Application of Risk-Based Screening Levels and Decision Making to Sites with Impacted Soil and Groundwater (Interim Final)*. December.
- Leaking Underground Fuel Tank Task Force, 1989, *California Leaking Underground Fuel Tank (LUFT) Field Manual: Guidelines for Site Assessment, Cleanup and Underground Storage Tank Closure*. California State Water Resources Control Board. October.
- United States Environmental Protection Agency Region IX, 2002, *Preliminary Remediation Goals (PRGs)*. November



6602 Owens Drive, Suite 100
 Pleasanton, CA 94588
 Main Line: (925) 460-5300
 Facsimile: (925) 463-2559

CHAIN OF CUSTODY FORM

Project Name: Hertz OAK
 Project Number: 7575015-0002
 Project Address: 1 Airport Drive, Oakland CA
 Laboratory: East 4
 Lab Address/Phone: _____
 ATC Project Manager: Don Kubik
 ATC PM Ph. No.: (925) 225-7830
 ATC Sampler: DAIS
 Client: Hertz
 Task: 4
 Contact: _____
 Email: KUBIK75@atc-enviro.com
 Phone: (925) 225-7830

Turnaround 10 day 3 day 2-8 hr
 Time: 7 day 2 day other
 (working days) 5 day X 24 hr

Analyses Requested

ATC Sample ID	Sample Information					Container Information			Comments / Field Notes	TPH/IBTEX/MTBE (8015M/8020)	Fuel Oxygenates (8260)	TPHd (8015M)	HVOcs (8010)	VOCs (8020)	VOCs (8260)	PP Metals (low detect) (7000/6010)	Cyanide, Total (335.2)				
	Date	Time	Matrix			No.	Type	Preservative													
			Soil	Water	Vapor																
EX-N	5/21/02	1630	X			1	Brass		30083-001	X											
EX-S	5/21/02	1635	X			1	Brass		002	X											
EX-E	5/21/02	1640	X			1	Brass		003	X											
EX-W	5/21/02	1645	X			1	Brass		004	X											
EX-B	5/21/02	1650	X			1	Brass		005	X											

24 HR RUSH

Additional Comments:

Relinquished By: [Signature] Date/Time: 5/22/02 1505 Received By: [Signature] Date/Time: 5/22/02 2:50
 Relinquished By: _____ Date/Time: _____ Received By: _____ Date/Time: 5/22/02 1630
 Relinquished By: _____ Date/Time: _____ Received By: _____ Date/Time: _____
 Sample Condition Good? Yes No On Ice? Yes No Cooler Temp _____ Transportation Method: _____

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

RECEIVED
MAY 31 2002

May 24, 2002

Don Kubik
ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588

Order: 30083
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
Project Notes:

Date Collected: 5/21/2002
Date Received: 5/22/2002
P.O. Number: 75.75015.0002 T4


On May 22, 2002, samples were received under documented chain of custody. Results for the following analyses are attached:

<u>Matrix</u>	<u>Test</u>	<u>Method</u>
Solid	Gas/BTEX/MTBE	EPA 8015 MOD. (Purgeable) EPA 8020

Chemical analysis of these samples has been completed. Summaries of the data are contained on the following pages. USEPA protocols for sample storage and preservation were followed.

Entech Analytical Labs, Inc. is certified by the State of California (#2346). If you have any questions regarding procedures or results, please call me at 408-588-0200.

Sincerely,



Patti Sandrock
QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30083

Lab Sample ID: 30083-001

Client Sample ID: EX-N

Sample Time: 4:30 PM

Sample Date: 5/21/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	ND		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							104.4		65 - 135	
Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							104.4		65 - 135	
Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							113.0		65 - 135	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30083

Lab Sample ID: 30083-002

Client Sample ID: EX-S

Sample Time: 4:35 PM

Sample Date: 5/21/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	0.077		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	0.13		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	0.33		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	0.75		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							132.8		65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							132.8		65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	29		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							133.1		65 - 135	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30083

Lab Sample ID: 30083-003

Client Sample ID: EX-E

Sample Time: 4:40 PM

Sample Date: 5/21/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	ND		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			103.5			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			103.5			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			113.5			65 - 135	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30083

Lab Sample ID: 30083-004

Client Sample ID: EX-W

Sample Time: 4:45 PM

Sample Date: 5/21/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	ND		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			103.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			103.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			111.4			65 - 135	

DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30083

Lab Sample ID: 30083-005

Client Sample ID: EX-B

Sample Time: 4:50 PM

Sample Date: 5/21/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	ND		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		106.1		65 - 135		

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		106.1		65 - 135		

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		111.0		65 - 135		


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SGC12448
Matrix: Solid

Units: mg/kg
Date Analyzed: 5/23/2002

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.832	LCS	97.2			65.0 - 135.0
Surrogate			Surrogate Recovery			Control Limits (%)					
4-Bromofluorobenzene			119.4			65 - 135					
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.332	LCS	83.0			55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.372	LCS	93.0			58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.339	LCS	84.8			56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.121	LCS	93.4			64.9 - 130.0
Surrogate			Surrogate Recovery			Control Limits (%)					
4-Bromofluorobenzene			106.7			65 - 135					
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.787	LCSD	96.5	0.77	30.00	65.0 - 135.0
Surrogate			Surrogate Recovery			Control Limits (%)					
4-Bromofluorobenzene			112.7			65 - 135					
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.359	LCSD	89.8	7.81	30.00	55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.397	LCSD	99.3	6.50	30.00	58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.37	LCSD	92.5	8.74	30.00	56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.193	LCSD	99.4	6.22	30.00	64.9 - 130.0
Surrogate			Surrogate Recovery			Control Limits (%)					
4-Bromofluorobenzene			106.5			65 - 135					

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

June 06, 2002

Don Kubik
ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588

RECEIVED
JUN 12 2002

Order: 30086
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
Project Notes:

Date Collected: 05/21/02
Date Received: 05/22/02
P.O. Number: 75.75015.0002 T4


On May 22, 2002, samples were received under documented chain of custody. Results for the following analyses are attached:

<u>Matrix</u>	<u>Test</u>	<u>Method</u>	
Liquid	EPA 8081A	EPA 8081A	
	EPA 8260B	EPA 8260B	
	EPA 8270C PAH	EPA 8270C	
	Gas/BTEX/MTBE	EPA 8015 MOD (Purgeable)	
		EPA 8020	
	LUFT Metals	EPA 200.7	
	Oil & Grease-IR	EPA 413.2	
	TPH as Diesel	EPA 8015 MOD. (Extractable)	
	Solid	EPA 8081A	EPA 8081A
		EPA 8260B	EPA 8260B
EPA 8270C PAH		EPA 8270C	
Gas/BTEX/MTBE		EPA 8015 MOD. (Purgeable)	
		EPA 8020	
LUFT Metals		EPA 6010B	
Oil & Grease-IR		SM 5520 C	
TPH as Diesel		EPA 8015 MOD. (Extractable)	

Chemical analysis of these samples has been completed. Summaries of the data are contained on the following pages. USEPA protocols for sample storage and preservation were followed.

Entech Analytical Labs, Inc. is certified by the State of California (#2346). If you have any questions regarding procedures or results, please call me at 408-588-0200.

Sincerely,



Patti Sandrock
QA/QC Manager

Entech Analytical Labs, Inc.

RECEIVED

JUL 05 2002

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

July 02, 2002

Don Kubik
ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588

Order:	30086	Date Collected:	05/21/02
Project Name:	Hertz Oak	Date Received:	05/22/02
Project Number:	75.75015.0002 T4	P.O. Number:	75.75015.0002 T4
Project Notes:	Report amended 7/2/02. See narrative.		

On May 22, 2002, samples were received under documented chain of custody. Results for the following analyses are attached:


<u>Matrix</u>	<u>Test</u>	<u>Method</u>
Liquid	EPA 8082A	EPA 8082A
Solid		EPA 8082A

Case Narrative: Report amended 7/2/02 to include originally requested analytical results for PCB's on samples 30086-004 (WO-1) and 30086-005 (WO-1). Although the samples were extracted on 5/24/02, due to a laboratory error, the sample extracts were not analyzed until 7/2/02. The holding time for analysis of extracts is 40 days. No analysis exceeded holding time requirements. Due to the laboratory error, these results are not subject to invoicing.

Chemical analysis of these samples has been completed. Summaries of the data are contained on the following pages. USEPA protocols for sample storage and preservation were followed.

Entech Analytical Labs, Inc. is certified by the State of California (#2346). If you have any questions regarding procedures or results, please call me at 408-588-0200.

Sincerely,



Patti Sandrock
QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086	Lab Sample ID: 30086-004	Client Sample ID: WO-1								
Sample Time: 3:00 PM	Sample Date: 05/21/02	Matrix: Solid								
Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Diesel	ND		1	1	1	mg/Kg	05/28/02	05/29/02	DS4158A	EPA 8015 MOD. (Extractable)
					Surrogate o-Terphenyl			Surrogate Recovery 86.0		Control Limits (%) 37 - 124

Order ID: 30086	Lab Sample ID: 30086-005	Client Sample ID: WO-1								
Sample Time: 3:15 PM	Sample Date: 05/21/02	Matrix: Liquid								
Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Diesel	130	x	1	50	50	µg/L	05/23/02	05/29/02	DW4184A	EPA 8015 MOD. (Extractable)
					Surrogate o-Terphenyl			Surrogate Recovery 94.0		Control Limits (%) 38 - 133

Comment: Not a TPH as Diesel pattern; Value due to a higher boiling hydrocarbon mixture, possibly Hydraulic Oil, overlapping into the Diesel range.

DF = Dilution Factor ND = Not Detected DLR = Detection Limit Reported PQL = Practical Quantitation Limit
Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		104.4		65 - 135			

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		104.4		65 - 135			

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		108.4		65 - 135			


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
1,1,1,2-Tetrachloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1,1-Trichloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1,2,2-Tetrachloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1,2-Trichloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1-Dichloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1-Dichloroethene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,1-Dichloropropene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2,3-Trichlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2,3-Trichloropropane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2,4-Trichlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2,4-Trimethylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2-Dibromo-3-Chloropropane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2-Dibromoethane (EDB)	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2-Dichlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2-Dichloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,2-Dichloropropane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,3,5-Trimethylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,3-Dichlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,3-Dichloropropane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
1,4-Dichlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
2,2-Dichloropropane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
2-Butanone (MEK)	ND		1	20	20	µg/Kg	05/24/02	SMS11573B	EPA 8260B
2-Chloroethyl-vinyl Ether	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
2-Chlorotoluene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
2-Hexanone	ND		1	20	20	µg/Kg	05/24/02	SMS11573B	EPA 8260B
4-Chlorotoluene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
4-Methyl-2-Pentanone(MIBK)	ND		1	20	20	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Acetone	ND		1	100	100	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Benzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Bromobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Bromochloromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Bromodichloromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Bromoform	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Bromomethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Carbon Disulfide	ND		1	15	15	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Carbon Tetrachloride	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Chlorobenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Chloroethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Chloroform	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Chloromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
cis-1,2-Dichloroethene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
cis-1,3-Dichloropropene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Dibromochloromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Dibromomethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Dichlorodifluoromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Diisopropyl Ether	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Ethyl Benzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Hexachlorobutadiene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Isopropylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Methyl-t-butyl Ether	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Methylene Chloride	ND		1	25	25	µg/Kg	05/24/02	SMS11573B	EPA 8260B
n-Butylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
n-Propylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Naphthalene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
p-Isopropyltoluene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
sec-Butylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Styrene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
tert-Amyl Methyl Ether	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
tert-Butanol	ND		1	20	20	µg/Kg	05/24/02	SMS11573B	EPA 8260B
tert-Butyl Ethyl Ether	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
tert-Butylbenzene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Tetrachloroethene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Toluene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
trans-1,2-Dichloroethene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
trans-1,3-Dichloropropene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Trichloroethene	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Trichlorofluoromethane	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Vinyl Chloride	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B
Xylenes, Total	ND		1	5	5	µg/Kg	05/24/02	SMS11573B	EPA 8260B

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	82.0	73 - 151
Dibromofluoromethane	133.0	57 - 156
Toluene-d8	124.0	77 - 150


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Chlordane (technical)	ND		1	0.1	0.1	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Alpha-BHC	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Gamma-BHC (Lindane)	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Beta-BHC	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Heptachlor	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
delta-BHC	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Aldrin	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Heptachlor Epoxide	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endosulfan I	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
4,4'-DDE	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Dieldrin	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endrin	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
4,4'-DDD	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endosulfan II	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
4,4-DDT	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endrin Aldehyde	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endosulfan Sulfate	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Methoxychlor	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Endrin Ketone	ND		1	0.05	0.05	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A
Toxaphene	ND		1	0.1	0.1	mg/Kg	05/24/02	05/29/02	PS6071	EPA 8081A

Surrogate	Surrogate Recovery	Control Limits (%)
Decachlorobiphenyl	90.8	43 - 156


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Naphthalene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
2-Methylnaphthalene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
2-Chloronaphthalene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Acenaphthylene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Acenaphthene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Fluorene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Phenanthrene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Anthracene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Fluoranthene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Pyrene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Benzo(a)anthracene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Chrysene	ND		1	0.66	0.66	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Benzo(b)fluoranthene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Benzo(k)fluoranthene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Benzo(a)pyrene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Indeno(1,2,3-cd)pyrene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Dibenz(a,h)anthracene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C
Benzo(g,h,i)perylene	ND		1	0.33	0.33	mg/Kg	05/24/02	05/24/02	BS5117A	EPA 8270C

Surrogate	Surrogate Recovery	Control Limits (%)
2-Fluorobiphenyl	64.0	30 - 115
Nitrobenzene-d5	68.0	23 - 120
p-Terphenyl-d14	79.5	18 - 137


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 7/2/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Order ID: 30086			Lab Sample ID: 30086-004			Client Sample ID: WO-1				
Sample Time: 3:00 PM			Sample Date: 05/21/02			Matrix: Solid				
Aroclor 1016	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1221	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1232	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1242	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1248	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1254	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1260	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1262	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Aroclor 1268	ND		1	0.1	0.1	mg/Kg	05/24/02	07/02/02	PS6071	EPA 8082A
Surrogate							Surrogate Recovery		Control Limits (%)	
Decachlorobiphenyl							74.8		50 - 142	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Order ID: 30086			Lab Sample ID: 30086-005			Client Sample ID: WO-1				
Sample Time: 3:15 PM			Sample Date: 05/21/02			Matrix: Liquid				
Aroclor 1016	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1221	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1232	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1242	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1248	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1254	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1260	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B -	EPA 8082A
Aroclor 1262	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Aroclor 1268	ND		1	0.1	0.1	µg/L	05/23/02	07/02/02	PW6068B	EPA 8082A
Surrogate							Surrogate Recovery		Control Limits (%)	
Decachlorobiphenyl							58.5		42 - 127	

DF = Dilution Factor ND = Not Detected DLR = Detection Limit Reported PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Oil and Grease, Total	ND	1	25	25	mg/Kg	05/29/02	SOGIR020529	SM 5520 C

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Oil and Grease, Total	ND	1	5	5	mg/L	05/29/02	WOGIR020529	EPA 413.2


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-004

Client Sample ID: WO-1

Sample Time: 3:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	DF	PQL	DLR	Units	PrepDate	Analysis Date	QC Batch ID	Method
Cadmium	ND	1	1	1	mg/Kg	05/22/02	05/31/02	SM8182	EPA 6010B
Chromium	20	1	1	1	mg/Kg	05/22/02	05/31/02	SM8182	EPA 6010B
Lead	ND	1	1	1	mg/Kg	05/22/02	06/04/02	SM8182	EPA 6010B
Nickel	15	1	1	1	mg/Kg	05/22/02	05/31/02	SM8182	EPA 6010B
Zinc	14	1	1	1	mg/Kg	05/22/02	05/31/02	SM8182	EPA 6010B

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	DF	PQL	DLR	Units	PrepDate	Analysis Date	QC Batch ID	Method
Cadmium	ND	1	0.005	0.005	mg/L	05/22/02	06/06/02	WM8230	EPA 200.7
Chromium	0.055	1	0.005	0.005	mg/L	05/22/02	06/06/02	WM8230	EPA 200.7
Lead	ND	1	0.015	0.015	mg/L	05/22/02	06/06/02	WM8230	EPA 200.7
Nickel	0.088	1	0.005	0.005	mg/L	05/22/02	06/06/02	WM8230	EPA 200.7
Zinc	0.13	1	0.005	0.005	mg/L	05/22/02	06/06/02	WM8230	EPA 200.7


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.5	0.5	µg/L	N/A	05/23/02	WGC12450	EPA 8020
Toluene	0.90		1	0.5	0.5	µg/L	N/A	05/23/02	WGC12450	EPA 8020
Ethyl Benzene	ND		1	0.5	0.5	µg/L	N/A	05/23/02	WGC12450	EPA 8020
Xylenes, Total	ND		1	1	1	µg/L	N/A	05/23/02	WGC12450	EPA 8020

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

96.5

65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	7.6		1	5	5	µg/L	N/A	05/15/02	WGC12450	EPA 8020

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

96.5

65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	50	50	µg/L	N/A	05/23/02	WGC12450	EPA 8015 MOD. (Purgeable)

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

93.0

65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Partti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-001

Client Sample ID: G-N

Sample Time: 2:15 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			111.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			111.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			111.1			65 - 135	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-002

Client Sample ID: G-S

Sample Time: 2:30 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		107.1		65 - 135			

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		107.1		65 - 135			

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate		Surrogate Recovery		Control Limits (%)			
			4-Bromofluorobenzene		112.1		65 - 135			

DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-006

Client Sample ID: P-1

Sample Time: 3:40 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 108.8 65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 108.8 65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 106.6 65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-008

Client Sample ID: P-3

Sample Time: 3:50 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	106.7	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	106.7	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	111.8	65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-009

Client Sample ID: P-4

Sample Time: 4:00 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			106.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			106.1			65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8015 MOD. (Purgeable)
			Surrogate			Surrogate Recovery			Control Limits (%)	
			4-Bromofluorobenzene			110.7			65 - 135	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-010

Client Sample ID: P-5

Sample Time: 4:05 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	106.0	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	106.0	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	105.2	65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-011

Client Sample ID: P-6

Sample Time: 4:10 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020
Xylenes, Total	ND		1	0.025	0.025	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	112.1	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	112.1	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		1	2.5	2.5	mg/kg	05/23/02	05/24/02	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	113.3	65 - 135

DF = Dilution Factor ND = Not Detected DLR = Detection Limit Reported PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-012

Client Sample ID: P-7

Sample Time: 4:15 PM

Sample Date: 05/21/02

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		20	0.025	0.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Toluene	4.7		20	0.025	0.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Ethyl Benzene	6.3		20	0.025	0.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020
Xylenes, Total	41		20	0.025	0.5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	123.4	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		20	0.25	5	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8020

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	123.4	65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	520		20	2.5	50	mg/kg	05/23/02	05/23/02	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	134.8	65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
1,1,1,2-Tetrachloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1,1-Trichloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1,2,2-Tetrachloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1,2-Trichloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1-Dichloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1-Dichloroethene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,1-Dichloropropene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2,3-Trichlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2,3-Trichloropropane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2,4-Trichlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2,4-Trimethylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2-Dibromo-3-Chloropropane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2-Dibromoethane (EDB)	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2-Dichlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2-Dichloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,2-Dichloropropane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,3,5-Trimethylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,3-Dichlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,3-Dichloropropane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
1,4-Dichlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
2,2-Dichloropropane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
2-Butanone (MEK)	ND		1	20	20	µg/L	05/23/02	WMS11559C	EPA 8260B
2-Chloroethyl-vinyl Ether	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
2-Chlorotoluene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
2-Hexanone	ND		1	20	20	µg/L	05/23/02	WMS11559C	EPA 8260B
4-Chlorotoluene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
4-Methyl-2-Pentanone(MIBK)	ND		1	20	20	µg/L	05/23/02	WMS11559C	EPA 8260B
Acetone	ND		1	100	100	µg/L	05/23/02	WMS11559C	EPA 8260B
Benzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Bromobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Bromochloromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Bromodichloromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Bromoform	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Bromomethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Carbon Disulfide	ND		1	15	15	µg/L	05/23/02	WMS11559C	EPA 8260B
Carbon Tetrachloride	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Chlorobenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Chloroethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Chloroform	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Chloromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
cis-1,2-Dichloroethene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
cis-1,3-Dichloropropene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Dibromochloromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Dibromomethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Dichlorodifluoromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Diisopropyl Ether	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Ethyl Benzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Hexachlorobutadiene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Isopropylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Methyl-t-butyl Ether	5.3		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Methylene Chloride	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
n-Butylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
n-Propylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Naphthalene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
p-Isopropyltoluene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
sec-Butylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Styrene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
tert-Amyl Methyl Ether	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
tert-Butanol	ND		1	20	20	µg/L	05/23/02	WMS11559C	EPA 8260B
tert-Butyl Ethyl Ether	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
tert-Butylbenzene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Tetrachloroethene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Toluene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
trans-1,2-Dichloroethene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
trans-1,3-Dichloropropene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Trichloroethene	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Analysis Date	QC Batch ID	Method
Trichlorofluoromethane	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Vinyl Chloride	ND		1	0.5	0.5	µg/L	05/23/02	WMS11559C	EPA 8260B
Xylenes, Total	ND		1	5	5	µg/L	05/23/02	WMS11559C	EPA 8260B
Surrogate				Surrogate Recovery		Control Limits (%)			
4-Bromofluorobenzene				85.0		73 - 151			
Dibromofluoromethane				118.0		57 - 139			
Toluene-d8				117.0		77 - 150			

DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Alpha-BHC	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Gamma-BHC (Lindane)	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Beta-BHC	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Heptachlor	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
delta-BHC	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Aldrin	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Heptachlor Epoxide	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endosulfan I	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
4,4'-DDE	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Dieldrin	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endrin	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
4,4'-DDD	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endosulfan II	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
4,4'-DDT	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endrin Aldehyde	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endosulfan Sulfate	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Methoxychlor	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Endrin Ketone	ND		1	0.04	0.04	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Chlordane (technical)	ND		1	0.2	0.2	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
Toxaphene	ND		1	0.2	0.2	µg/L	05/23/02	05/29/02	PW6068B	EPA 8081A
							Surrogate	Surrogate Recovery	Control Limits (%)	
							Decachlorobiphenyl	51.9	35 - 105	


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-005

Client Sample ID: WO-1

Sample Time: 3:15 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Naphthalene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
2-Methylnaphthalene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
2-Chloronaphthalene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Acenaphthylene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Acenaphthene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Fluorene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Phenanthrene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Anthracene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Fluoranthene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Pyrene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Benzo(a)anthracene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Chrysene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Benzo(b)fluoranthene	ND		1	10	10	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Benzo(k)fluoranthene	ND		1	10	10	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Benzo(a)pyrene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Indeno(1,2,3-cd)pyrene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Dibenz(a,h)anthracene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C
Benzo(g,h,i)perylene	ND		1	5	5	µg/L	05/23/02	05/23/02	BW5116	EPA 8270C

Surrogate	Surrogate Recovery	Control Limits (%)
2-Fluorobiphenyl	51.2	24 - 108
Nitrobenzene-d5	49.7	35 - 114
p-Terphenyl-d14	76.5	33 - 141


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)



Parti Sandrock, QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 06/06/02
Date Received: 05/22/02
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Client

Certified Analytical Report

Order ID: 30086

Lab Sample ID: 30086-003

Client Sample ID: G-1

Sample Time: 2:45 PM

Sample Date: 05/21/02

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		200	0.5	100	µg/L	N/A	05/23/02	WGC62449	EPA 8020
Toluene	ND		200	0.5	100	µg/L	N/A	05/23/02	WGC62449	EPA 8020
Ethyl Benzene	ND		200	0.5	100	µg/L	N/A	05/23/02	WGC62449	EPA 8020
Xylenes, Total	1500		200	1	200	µg/L	N/A	05/23/02	WGC62449	EPA 8020

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

99.3

65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	23000		200	5	1000	µg/L	N/A	05/15/02	WGC62449	EPA 8020

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

99.3

65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	ND		200	50	10000	µg/L	N/A	05/23/02	WGC62449	EPA 8015 MOD. (Purgeable)

Surrogate

Surrogate Recovery

Control Limits (%)

4-Bromofluorobenzene

104.2

65 - 135

DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandroek, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: DS4158A
Matrix: Solid

Units: mg/Kg
Date Analyzed: 05/28/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Diesel											
TPH as Diesel	EPA 8015 M	ND		25		21.41	LCS	85.6			54.9 - 126.0
Surrogate		Surrogate Recovery		Control Limits (%)							
o-Terphenyl		67.0		37 - 124							
Test: TPH as Diesel											
TPH as Diesel	EPA 8015 M	ND		25		27.74	LCSD	111.0	25.76	30.00	54.9 - 126.0
Surrogate		Surrogate Recovery		Control Limits (%)							
o-Terphenyl		84.0		37 - 124							

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: DW4184A
 Matrix: Liquid

Units: µg/L
 Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Diesel											
TPH as Diesel	EPA 8015 M	ND		1000		1102.27	LCS	110.2			37.6 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	o-Terphenyl			118.0		45 - 135					
Test: TPH as Diesel											
TPH as Diesel	EPA 8015 M	ND		1000		1051.2	LCSD	105.1	4.74	25.00	37.6 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	o-Terphenyl			113.0		45 - 135					

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SGC12448
Matrix: Solid

Units: mg/kg
Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.832	LCS	97.2			65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		119.4		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.332	LCS	83.0			55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.372	LCS	93.0			58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.339	LCS	84.8			56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.121	LCS	93.4			64.9 - 130.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		106.7		65 - 135							
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.787	LCSD	96.5	0.77	30.00	65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		112.7		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.359	LCSD	89.8	7.81	30.00	55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.397	LCSD	99.3	6.50	30.00	58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.37	LCSD	92.5	8.74	30.00	56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.193	LCSD	99.4	6.22	30.00	64.9 - 130.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		106.5		65 - 135							

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WGC62449
Matrix: Liquid

Units: $\mu\text{g/L}$
Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		81.2	LCS	81.2			65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		97.5		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		8		8.43	LCS	105.4			65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		8.07	LCS	100.9			65.0 - 135.0
Toluene	EPA 8020	ND		8		7.99	LCS	99.9			65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		25.65	LCS	106.9			65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		98.3		65 - 135							
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		9.02	LCS	112.8			65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		98.3		65 - 135							
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		84.6	LCSD	84.6	4.10	25.00	65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		94.8		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		8		7.24	LCSD	90.5	15.19	25.00	65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		7.24	LCSD	90.5	10.84	25.00	65.0 - 135.0
Toluene	EPA 8020	ND		8		7.26	LCSD	90.8	9.57	25.00	65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		22.39	LCSD	93.3	13.57	25.00	65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		100.8		65 - 135							
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		7.72	LCSD	96.5	15.53	25.00	65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		100.8		65 - 135							

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WGC12450
Matrix: Liquid

Units: µg/L
Date Analyzed: 05/24/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		105.3	LCS	105.3			65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			119.8		65 - 135					
Test: BTEX											
Benzene	EPA 8020	ND		8		8.002	LCS	100.0			65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		7.599	LCS	95.0			65.0 - 135.0
Toluene	EPA 8020	ND		8		7.45	LCS	93.1			65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		23.	LCS	95.8			65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			97.8		65 - 135					
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		7.291	LCS	91.1			65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			97.8		65 - 135					
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		94.2	LCSD	94.2	11.13	25.00	65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			115.2		65 - 135					
Test: BTEX											
Benzene	EPA 8020	ND		8		8.484	LCSD	106.1	5.85	25.00	65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		8.118	LCSD	101.5	6.60	25.00	65.0 - 135.0
Toluene	EPA 8020	ND		8		7.83	LCSD	97.9	4.97	25.00	65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		25.	LCSD	104.2	8.33	25.00	65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			107.0		65 - 135					
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		8.36	LCSD	104.5	13.66	25.00	65.0 - 135.0
	Surrogate			Surrogate Recovery		Control Limits (%)					
	4-Bromofluorobenzene			107.0		65 - 135					

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SMS11573B
Matrix: Solid

Units: $\mu\text{g/Kg}$
Date Analyzed: 05/24/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8260B											
1,1-Dichloroethene	EPA 8260B	ND		40		43.45	LCS	108.6			66.1 - 126.0
Benzene	EPA 8260B	ND		40		39.96	LCS	99.9			65.0 - 135.0
Chlorobenzene	EPA 8260B	ND		40		41.55	LCS	103.9			65.0 - 135.0
Methyl-t-butyl Ether	EPA 8260B	ND		40		45.79	LCS	114.5			62.4 - 124.4
Toluene	EPA 8260B	ND		40		41.66	LCS	104.1			65.0 - 135.0
Trichloroethene	EPA 8260B	ND		40		44.71	LCS	111.8			80.6 - 136.9
Surrogate				Surrogate Recovery		Control Limits (%)					
4-Bromofluorobenzene				104.0		73 - 151					
Dibromofluoromethane				135.0		57 - 156					
Toluene-d8				119.0		77 - 150					
Test: EPA 8260B											
1,1-Dichloroethene	EPA 8260B	ND		40		41.86	LCSD	104.7	3.73	30.00	66.1 - 126.0
Benzene	EPA 8260B	ND		40		38.63	LCSD	96.6	3.38	30.00	65.0 - 135.0
Chlorobenzene	EPA 8260B	ND		40		40.76	LCSD	101.9	1.92	30.00	65.0 - 135.0
Methyl-t-butyl Ether	EPA 8260B	ND		40		42.84	LCSD	107.1	6.66	30.00	62.4 - 124.4
Toluene	EPA 8260B	ND		40		40.61	LCSD	101.5	2.55	30.00	65.0 - 135.0
Trichloroethene	EPA 8260B	ND		40		43.02	LCSD	107.6	3.85	30.00	80.6 - 136.9
Surrogate				Surrogate Recovery		Control Limits (%)					
4-Bromofluorobenzene				103.0		73 - 151					
Dibromofluoromethane				135.0		57 - 156					
Toluene-d8				119.0		77 - 150					

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WMS11559C

Matrix: Liquid

Units: µg/L

Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8260B											
1,1-Dichloroethene	EPA 8260B	ND		20		22.2	LCS	111.0			57.3 - 132.4
Benzene	EPA 8260B	ND		20		19.5	LCS	97.5			65.0 - 135.0
Chlorobenzene	EPA 8260B	ND		20		21.8	LCS	109.0			65.0 - 135.0
Methyl-t-butyl Ether	EPA 8260B	ND		20		22.1	LCS	110.5			56.0 - 135.0
Toluene	EPA 8260B	ND		20		21.3	LCS	106.5			65.0 - 135.0
Trichloroethene	EPA 8260B	ND		20		23.1	LCS	115.5			69.7 - 143.5

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	102.0	73 - 151
Dibromofluoromethane	126.0	57 - 156
Toluene-d8	116.0	77 - 150

Test: EPA 8260B

1,1-Dichloroethene	EPA 8260B	ND		20		20.9	LCSD	104.5	6.03	25.00	57.3 - 132.4
Benzene	EPA 8260B	ND		20		18.2	LCSD	91.0	6.90	25.00	65.0 - 135.0
Chlorobenzene	EPA 8260B	ND		20		20.3	LCSD	101.5	7.13	25.00	65.0 - 135.0
Methyl-t-butyl Ether	EPA 8260B	ND		20		19.8	LCSD	99.0	10.98	25.00	56.0 - 135.0
Toluene	EPA 8260B	ND		20		19.9	LCSD	99.5	6.80	25.00	65.0 - 135.0
Trichloroethene	EPA 8260B	ND		20		21.8	LCSD	109.0	5.79	25.00	69.7 - 143.5

Surrogate	Surrogate Recovery	Control Limits (%)
4-Bromofluorobenzene	100.0	73 - 151
Dibromofluoromethane	123.0	57 - 156
Toluene-d8	117.0	77 - 150

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: PS6071
Matrix: Solid

Units: mg/Kg
Date Analyzed: 05/29/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8081A											
4,4-DDT	EPA 8081A	ND		0.1		0.108	LCS	108.0			47.6 - 134.9
Aldrin	EPA 8081A	ND		0.1		0.107	LCS	107.0			43.4 - 145.0
Dieldrin	EPA 8081A	ND		0.1		0.109	LCS	109.0			44.1 - 153.0
Endrin	EPA 8081A	ND		0.1		0.113	LCS	113.0			35.9 - 145.0
Gamma-BHC (Lindane)	EPA 8081A	ND		0.1		0.105	LCS	105.0			44.7 - 144.0
Heptachlor	EPA 8081A	ND		0.1		0.114	LCS	114.0			43.0 - 141.0

Surrogate	Surrogate Recovery	Control Limits (%)
Decachlorobiphenyl	87.0	43 - 156

Test: EPA 8081A											
4,4-DDT	EPA 8081A	ND		0.1		0.106	LCSD	106.0	1.87	50.00	47.6 - 134.9
Aldrin	EPA 8081A	ND		0.1		0.101	LCSD	101.0	5.77	43.00	43.4 - 145.0
Dieldrin	EPA 8081A	ND		0.1		0.104	LCSD	104.0	4.69	38.00	44.1 - 153.0
Endrin	EPA 8081A	ND		0.1		0.108	LCSD	108.0	4.52	45.00	35.9 - 145.0
Gamma-BHC (Lindane)	EPA 8081A	ND		0.1		0.101	LCSD	101.0	3.88	50.00	44.7 - 144.0
Heptachlor	EPA 8081A	ND		0.1		0.11	LCSD	110.0	3.57	31.00	43.0 - 141.0

Surrogate	Surrogate Recovery	Control Limits (%)
Decachlorobiphenyl	86.7	43 - 156

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: PW6068B
Matrix: Liquid

Units: $\mu\text{g/L}$
Date Analyzed: 05/28/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8081A											
Aldrin	EPA 8081A	ND		0.1		0.072	LCS	72.0			42.0 - 122.0
Dieldrin	EPA 8081A	ND		0.1		0.1	LCS	100.0			52.0 - 126.0
Endrin	EPA 8081A	ND		0.1		0.109	LCS	109.0			30.0 - 147.0
Gamma-BHC (Lindane)	EPA 8081A	ND		0.1		0.083	LCS	83.0			32.0 - 127.0
Heptachlor	EPA 8081A	ND		0.1		0.085	LCS	85.0			34.0 - 111.0
Surrogate		Surrogate Recovery		Control Limits (%)							
Decachlorobiphenyl		75.3		35 - 105							
Test: EPA 8081A											
Aldrin	EPA 8081A	ND		0.1		0.056	LCSD	56.0	25.00	43.00	42.0 - 122.0
Dieldrin	EPA 8081A	ND		0.1		0.087	LCSD	87.0	13.90	38.00	52.0 - 126.0
Endrin	EPA 8081A	ND		0.1		0.097	LCSD	97.0	11.65	45.00	30.0 - 147.0
Gamma-BHC (Lindane)	EPA 8081A	ND		0.1		0.07	LCSD	70.0	16.99	50.00	32.0 - 127.0
Heptachlor	EPA 8081A	ND		0.1		0.072	LCSD	72.0	16.56	31.00	34.0 - 111.0
Surrogate		Surrogate Recovery		Control Limits (%)							
Decachlorobiphenyl		76.8		35 - 105							

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: BS5117A
Matrix: Solid

Units: mg/Kg
Date Analyzed: 05/24/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8270C											
1,2,4-Trichlorobenzene	EPA 8270C	ND		1.25		0.8742	LCS	69.9			38.0 - 107.0
1,4-Dichlorobenzene	EPA 8270C	ND		1.25		0.8842	LCS	70.7			28.0 - 104.0
2,4-Dinitrotoluene	EPA 8270C	ND		1.25		0.4417	LCS	35.3			23.9 - 85.0
2-Chlorophenol	EPA 8270C	ND		1.88		1.4317	LCS	76.2			22.7 - 85.1
4-Chloro-3-methylphenol	EPA 8270C	ND		1.88		1.3493	LCS	71.8			26.0 - 103.0
4-Nitrophenol	EPA 8270C	ND		1.88		0.8505	LCS	45.2			11.0 - 114.0
Acenaphthene	EPA 8270C	ND		1.25		0.9445	LCS	75.6			20.1 - 108.0
n-Nitroso-di-n-propylamine	EPA 8270C	ND		1.25		0.9651	LCS	77.2			41.0 - 126.0
Pentachlorophenol	EPA 8270C	ND		1.88		1.0094	LCS	53.7			14.9 - 93.8
Phenol	EPA 8270C	ND		1.88		1.3357	LCS	71.0			26.0 - 90.0
Pyrene	EPA 8270C	ND		1.25		1.0869	LCS	87.0			35.0 - 142.0

Surrogate	Surrogate Recovery	Control Limits (%)
2,4,6-Tribromophenol	77.0	19 - 122
2-Fluorobiphenyl	75.2	30 - 115
2-Fluorophenol	77.8	25 - 121
Nitrobenzene-d5	88.0	20 - 91
p-Terphenyl-d14	96.0	18 - 137
Phenol-d6	81.9	23 - 91

Test: EPA 8270C											
1,2,4-Trichlorobenzene	EPA 8270C	ND		1.25		0.8762	LCSD	70.1	0.23	28.10	38.0 - 107.0
1,4-Dichlorobenzene	EPA 8270C	ND		1.25		0.819	LCSD	65.5	7.66	32.10	28.0 - 104.0
2,4-Dinitrotoluene	EPA 8270C	ND		1.25		0.4796	LCSD	38.4	8.22	21.80	23.9 - 85.0
2-Chlorophenol	EPA 8270C	ND		1.88		1.314	LCSD	69.9	8.58	28.70	22.7 - 85.1
4-Chloro-3-methylphenol	EPA 8270C	ND		1.88		1.356	LCSD	72.1	0.50	37.20	26.0 - 103.0
4-Nitrophenol	EPA 8270C	ND		1.88		0.8938	LCSD	47.5	4.97	47.20	11.0 - 114.0
Acenaphthene	EPA 8270C	ND		1.25		0.9369	LCSD	75.0	0.81	27.60	20.1 - 108.0
n-Nitroso-di-n-propylamine	EPA 8270C	ND		1.25		0.9377	LCSD	75.0	2.88	55.40	41.0 - 126.0
Pentachlorophenol	EPA 8270C	ND		1.88		1.0633	LCSD	56.6	5.20	48.90	14.9 - 93.8
Phenol	EPA 8270C	ND		1.88		1.2684	LCSD	67.5	5.17	30.00	26.0 - 90.0
Pyrene	EPA 8270C	ND		1.25		1.07	LCSD	85.6	1.57	25.20	35.0 - 142.0

Surrogate	Surrogate Recovery	Control Limits (%)
2,4,6-Tribromophenol	78.9	19 - 122
2-Fluorobiphenyl	72.3	30 - 115
2-Fluorophenol	70.4	25 - 121
Nitrobenzene-d5	81.1	20 - 91
p-Terphenyl-d14	95.3	18 - 137
Phenol-d6	75.5	23 - 91

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: BW5116
Matrix: Liquid

Units: µg/L
Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: EPA 8270C PAH											
Acenaphthene	EPA 8270C	ND		50		30.4	LCS	60.8			46.0 - 118.0
Pyrene	EPA 8270C	ND		50		37.8	LCS	75.6			26.0 - 127.0
	Surrogate			Surrogate Recovery							Control Limits (%)
	2-Fluorobiphenyl			57.8							24 - 108
	Nitrobenzene-d5			63.3							35 - 114
	p-Terphenyl-d14			81.1							33 - 141
Test: EPA 8270C PAH											
Acenaphthene	EPA 8270C	ND		50		24.6	LCSD	49.2	21.23	31.00	46.0 - 118.0
Pyrene	EPA 8270C	ND		50		37.8	LCSD	75.6	0.13	31.00	26.0 - 127.0
	Surrogate			Surrogate Recovery							Control Limits (%)
	2-Fluorobiphenyl			43.8							24 - 108
	Nitrobenzene-d5			46.3							35 - 114
	p-Terphenyl-d14			82.2							33 - 141

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SOGIR020529
Matrix: Solid

Units: mg/Kg
Date Analyzed: 05/29/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: Oil & Grease-IR Oil and Grease, Total	SM 5520 C	ND		261		272.	LCS	104.2			60.0 - 140.0
Test: Oil & Grease-IR Oil and Grease, Total	SM 5520 C	ND		261		270.	LCSD	103.4	0.74	30.00	60.0 - 140.0

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WOGIR020529
Matrix: Liquid

Units: mg/L
Date Analyzed: 05/29/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: Oil & Grease-IR Oil and Grease, Total	EPA 413.2	ND		209		240.	LCS	114.8			60.0 - 140.0
Test: Oil & Grease-IR Oil and Grease, Total	EPA 413.2	ND		209		229.	LCSD	109.6	4.69	25.00	60.0 - 140.0

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SM8182

Units: mg/Kg

Matrix: Solid

Date Analyzed: 05/23/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Cadmium	EPA 6010B	ND		50		46.9	LCS	93.8			75.6 - 108.4
Chromium	EPA 6010B	ND		50		46.4	LCS	92.8			74.1 - 127.3
Lead	EPA 6010B	ND		50		46.02	LCS	92.0			75.0 - 123.0
Nickel	EPA 6010B	ND		50		47.5	LCS	95.0			73.2 - 124.8
Zinc	EPA 6010B	ND		50		47.7	LCS	95.4			79.7 - 104.5
Cadmium	EPA 6010B	ND		50		46.4	LCSD	92.8	1.07	30.00	75.6 - 108.4
Chromium	EPA 6010B	ND		50		49.3	LCSD	98.6	6.06	30.00	74.1 - 127.3
Lead	EPA 6010B	ND		50		47.16	LCSD	94.3	2.45	30.00	75.0 - 123.0
Nickel	EPA 6010B	ND		50		47.1	LCSD	94.2	0.85	30.00	73.2 - 124.8
Zinc	EPA 6010B	ND		50		47.4	LCSD	94.8	0.63	30.00	79.7 - 104.5

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WM8230
Matrix: Liquid

Units: mg/L
Date Analyzed: 05/24/02

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Aluminum	EPA 200.7	ND		5		5.53	LCS	110.6			75.0 - 125.0
Antimony	EPA 200.7	ND		0.5		0.466	LCS	93.2			75.0 - 125.0
Arsenic	EPA 200.7	ND		0.5		0.523	LCS	104.6			75.0 - 125.0
Beryllium	EPA 200.7	ND		0.5		0.516	LCS	103.2			75.0 - 125.0
Cadmium	EPA 200.7	ND		0.5		0.536	LCS	107.2			75.0 - 125.0
Chromium	EPA 200.7	ND		0.5		0.52	LCS	104.0			75.0 - 125.0
Copper	EPA 200.7	ND		0.5		0.522	LCS	104.4			75.0 - 125.0
Iron	EPA 200.7	ND		5		5.35	LCS	107.0			75.0 - 125.0
Iron, Dissolved	EPA 200.7	ND		5		5.35	LCS	107.0			75.0 - 125.0
Lead	EPA 200.7	ND		0.5		0.503	LCS	100.6			75.0 - 125.0
Manganese	EPA 200.7	ND		0.5		0.523	LCS	104.6			75.0 - 125.0
Nickel	EPA 200.7	ND		0.5		0.568	LCS	113.6			75.0 - 125.0
Selenium	EPA 200.7	ND		0.5		0.488	LCS	97.6			75.0 - 125.0
Silver	EPA 200.7	ND		1		1.18	LCS	118.0			75.0 - 125.0
Zinc	EPA 200.7	ND		0.5		0.532	LCS	106.4			75.0 - 125.0
Aluminum	EPA 200.7	ND		5		5.54	LCSD	110.8	0.18	25.00	75.0 - 125.0
Antimony	EPA 200.7	ND		0.5		0.483	LCSD	96.6	3.58	25.00	75.0 - 125.0
Arsenic	EPA 200.7	ND		0.5		0.505	LCSD	101.0	3.50	25.00	75.0 - 125.0
Beryllium	EPA 200.7	ND		0.5		0.519	LCSD	103.8	0.58	25.00	75.0 - 125.0
Cadmium	EPA 200.7	ND		0.5		0.536	LCSD	107.2	0.00	25.00	75.0 - 125.0
Chromium	EPA 200.7	ND		0.5		0.522	LCSD	104.4	0.38	25.00	75.0 - 125.0
Copper	EPA 200.7	ND		0.5		0.522	LCSD	104.4	0.00	25.00	75.0 - 125.0
Iron	EPA 200.7	ND		5		5.35	LCSD	107.0	0.00	25.00	75.0 - 125.0
Iron, Dissolved	EPA 200.7	ND		5		5.35	LCSD	107.0	0.00	25.00	75.0 - 125.0
Lead	EPA 200.7	ND		0.5		0.501	LCSD	100.2	0.40	25.00	75.0 - 125.0
Manganese	EPA 200.7	ND		0.5		0.523	LCSD	104.6	0.00	25.00	75.0 - 125.0
Nickel	EPA 200.7	ND		0.5		0.564	LCSD	112.8	0.71	25.00	75.0 - 125.0
Selenium	EPA 200.7	ND		0.5		0.493	LCSD	98.6	1.02	25.00	75.0 - 125.0
Silver	EPA 200.7	ND		1		1.19	LCSD	119.0	0.84	25.00	75.0 - 125.0
Zinc	EPA 200.7	ND		0.5		0.532	LCSD	106.4	0.00	25.00	75.0 - 125.0

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

STANDARD LAB QUALIFIERS (FLAGS)

All Entech lab reports now reference standard lab qualifiers. These qualifiers are noted in the adjacent column to the analytical result and are adapted from the U.S. EPA CLP program. The current qualifier list is as follows:

Qualifier (Flag)	Description
U	Compound was analyzed for but not detected
J	Estimated value for tentatively identified compounds or if result is below PQL but above MDL
N	Presumptive evidence of a compound (for Tentatively Identified Compounds)
B	Analyte is found in the associated Method Blank
E	Compounds whose concentrations exceed the upper level of the calibration range
D	Multiple dilutions reported for analysis; discrepancies between analytes may be due to dilution
X	Results within quantitation range; chromatographic pattern not typical of fuel
Y	PQL is reported below MDL but verified against a standard analyzed at the client requested reporting limit of 0.5 ppb

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

May 24, 2002

Don Kubik
ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588

RECEIVED
JUN 03 2002

Order: 30084
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
Project Notes:

Date Collected: 5/22/2002
Date Received: 5/22/2002
P.O. Number: 75.75015.0002 T4

On May 22, 2002, samples were received under documented chain of custody. Results for the following analyses are attached:

<u>Matrix</u>	<u>Test</u>	<u>Method</u>
Liquid	Gas/BTEX/MTBE	EPA 8015 MOD. (Purgeable) EPA 8020
Solid	Oxygenates by EPA 8260B	EPA 8260B
	Composite Gas/BTEX/MTBE	Composite EPA 8015 MOD. (Purgeable) EPA 8020
	Lead	EPA 6010B

Chemical analysis of these samples has been completed. Summaries of the data are contained on the following pages. USEPA protocols for sample storage and preservation were followed.

Entech Analytical Labs, Inc. is certified by the State of California (#2346). If you have any questions regarding procedures or results, please call me at 408-588-0200.

Sincerely,



Patti Sandrock
QA/QC Manager

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Victoria Ellsworth

Certified Analytical Report

Order ID: 30084

Lab Sample ID: 30084-001

Client Sample ID: EW-1

Sample Time: 12:11 PM

Sample Date: 5/22/2002

Matrix: Liquid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	840		100	0.5	50	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Toluene	4200		100	0.5	50	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Ethyl Benzene	990		100	0.5	50	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Xylene, o	2000		100	0.5	50	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Xylene, m+p	4300		100	1	100	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							113.6		65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		100	5	500	µg/L	N/A	5/24/2002	WGC12450	EPA 8020
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							113.6		65 - 135	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
tert-Butanol	82		1	20	20	µg/L	N/A	5/23/2002	WMS21571A	EPA 8260B
Methyl-t-butyl Ether	56		1	5	5	µg/L	N/A	5/23/2002	WMS21571A	EPA 8260B
Diisopropyl Ether	ND		1	5	5	µg/L	N/A	5/23/2002	WMS21571A	EPA 8260B
Ethyl-t-butyl Ether	ND		1	5	5	µg/L	N/A	5/23/2002	WMS21571A	EPA 8260B
tert-Amyl Methyl Ether	ND		1	5	5	µg/L	N/A	5/23/2002	WMS21571A	EPA 8260B
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							91.0		73 - 151	
Dibromofluoromethane							104.0		57 - 156	
Toluene-d8							110.0		77 - 150	

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	30000		100	50	5000	µg/L	N/A	5/24/2002	WGC12450	EPA 8015 MOD. (Purgeable)
Surrogate							Surrogate Recovery		Control Limits (%)	
4-Bromofluorobenzene							124.3		65 - 135	

DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc (CA ELAP #2346)


Patti Sandro, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Victoria Ellsworth

Certified Analytical Report

Order ID: 30084

Lab Sample ID: 30084-006

Client Sample ID: A(1-4)Composite

Sample Time: 12:48 PM

Sample Date: 5/22/2002

Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	0.17		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	0.24		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		123.4		65 - 135		

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		123.4		65 - 135		

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	30		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)
				Surrogate		Surrogate Recovery		Control Limits (%)		
				4-Bromofluorobenzene		127.8		65 - 135		


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Victoria Ellsworth

Certified Analytical Report

Order ID: 30084 Lab Sample ID: 30084-011 Client Sample ID: B(1-4)Composite
Sample Time: 12:44 PM Sample Date: 5/22/2002 Matrix: Solid

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Toluene	0.028		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Ethyl Benzene	ND		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, o	0.049		1	0.025	0.025	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020
Xylene, m+p	0.077		1	0.05	0.05	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 108.4 65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
Methyl-t-butyl Ether	ND		1	0.25	0.25	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8020

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 108.4 65 - 135

Parameter	Result	Flag	DF	PQL	DLR	Units	Extraction Date	Analysis Date	QC Batch ID	Method
TPH as Gasoline	3.4		1	2.5	2.5	mg/kg	5/23/2002	5/23/2002	SGC12448	EPA 8015 MOD. (Purgeable)

Surrogate Surrogate Recovery Control Limits (%)
4-Bromofluorobenzene 113.4 65 - 135


DF = Dilution Factor

ND = Not Detected

DLR = Detection Limit Reported

PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA/QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

ATC Associates Inc.
6602 Owens Drive, Suite 100
Pleasanton, CA 94588
Attn: Don Kubik

Date: 5/24/02
Date Received: 5/22/2002
Project Name: Hertz Oak
Project Number: 75.75015.0002 T4
P.O. Number: 75.75015.0002 T4
Sampled By: Victoria Ellsworth


Certified Analytical Report

Order ID: 30084	Lab Sample ID: 30084-006	Client Sample ID: A(1-4)Composite							
Sample Time: 12:48 PM	Sample Date: 5/22/2002	Matrix: Solid							
Parameter	Result	DF	PQL	DLR	Units	PrepDate	Analysis Date	QC Batch ID	Method
Lead	2.5	1	1	1	mg/Kg	5/22/2002	5/23/2002	SM8182	EPA 6010B

Order ID: 30084	Lab Sample ID: 30084-011	Client Sample ID: B(1-4)Composite							
Sample Time: 12:44 PM	Sample Date: 5/22/2002	Matrix: Solid							
Parameter	Result	DF	PQL	DLR	Units	PrepDate	Analysis Date	QC Batch ID	Method
Lead	2.5	1	1	1	mg/Kg	5/22/2002	5/23/2002	SM8182	EPA 6010B

DF = Dilution Factor ND = Not Detected DLR = Detection Limit Reported PQL = Practical Quantitation Limit

Analysis performed by Entech Analytical Labs, Inc. (CA ELAP #2346)


Patti Sandrock, QA, QC Manager

Environmental Analysis Since 1983

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WGC12450
Matrix: Liquid

Units: µg/L
Date Analyzed: 5/24/2002

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		105.3	LCS	105.3			65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		119.8		65 - 135				
Test: BTEX											
Benzene	EPA 8020	ND		8		8.002	LCS	100.0			65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		7.599	LCS	95.0			65.0 - 135.0
Toluene	EPA 8020	ND		8		7.45	LCS	93.1			65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		23	LCS	95.8			65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		97.8		65 - 135				
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		7.291	LCS	91.1			65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		97.8		65 - 135				
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		100		94.2	LCSD	94.2	11.13	25.00	65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		115.2		65 - 135				
Test: BTEX											
Benzene	EPA 8020	ND		8		8.484	LCSD	106.1	5.85	25.00	65.0 - 135.0
Ethyl Benzene	EPA 8020	ND		8		8.118	LCSD	101.5	6.60	25.00	65.0 - 135.0
Toluene	EPA 8020	ND		8		7.83	LCSD	97.9	4.97	25.00	65.0 - 135.0
Xylenes, total	EPA 8020	ND		24		25	LCSD	104.2	8.33	25.00	65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		107.0		65 - 135				
Test: MTBE by EPA 8020											
Methyl-t-butyl Ether	EPA 8020	ND		8		8.36	LCSD	104.5	13.66	25.00	65.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		107.0		65 - 135				

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SM8182
Matrix: Solid

Units: mg/Kg
Date Analyzed: 5/23/2002

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Lead	EPA 6010B	ND		50		46.02	LCS	92.0			75.0 - 123.0
Lead	EPA 6010B	ND		50		47.16	LCSD	94.3	2.45	30.00	75.0 - 123.0

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: SGC12448
Matrix: Solid

Units: mg/kg
Date Analyzed: 5/23/2002

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.832	LCS	97.2			65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		119.4		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.332	LCS	83.0			55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.372	LCS	93.0			58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.339	LCS	84.8			56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.121	LCS	93.4			64.9 - 130.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		106.7		65 - 135							
Test: TPH as Gasoline											
TPH as Gasoline	EPA 8015 M	ND		6		5.787	LCSD	96.5	0.77	30.00	65.0 - 135.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		112.7		65 - 135							
Test: BTEX											
Benzene	EPA 8020	ND		0.4		0.359	LCSD	89.8	7.81	30.00	55.0 - 153.0
Ethyl Benzene	EPA 8020	ND		0.4		0.397	LCSD	99.3	6.50	30.00	58.4 - 116.0
Toluene	EPA 8020	ND		0.4		0.37	LCSD	92.5	8.74	30.00	56.1 - 127.0
Xylenes, total	EPA 8020	ND		1.2		1.193	LCSD	99.4	6.22	30.00	64.9 - 130.0
Surrogate		Surrogate Recovery		Control Limits (%)							
4-Bromofluorobenzene		106.5		65 - 135							

Entech Analytical Labs, Inc.

3334 Victor Court • Santa Clara, CA 95054 • (408) 588-0200 • Fax (408) 588-0201

Quality Control Results Summary

QC Batch #: WMS21571A
 Matrix: Liquid

Units: µg/L
 Date Analyzed: 5/23/2002

Parameter	Method	Blank Result	Spike Sample ID	Spike Amount	Sample Result	Spike Result	QC Type	% Recovery	RPD	RPD Limits	Recovery Limits
Test: Oxygenates by EPA 8260B											
Methyl-t-butyl Ether	EPA 8260B	ND		20		18.69	LCS	93.5			56.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		101.0		73 - 151				
			Dibromofluoromethane		109.0		57 - 156				
			Toluene-d8		108.0		77 - 150				
Test: Oxygenates by EPA 8260B											
Methyl-t-butyl Ether	EPA 8260B	ND		20		24.	LCSD	120.0	24.88	25.00	56.0 - 135.0
			Surrogate		Surrogate Recovery		Control Limits (%)				
			4-Bromofluorobenzene		99.1		73 - 151				
			Dibromofluoromethane		113.0		57 - 156				
			Toluene-d8		107.0		77 - 150				

McC Campbell Analytical Inc.

110 Second Avenue South, #107
Pacheco, CA 94553-5560
(925) 798-1620

CHAIN-OF-CUSTODY RECORD

WorkOrder: 0206170

Client:

ATC Associates
6602 Owens Drive, #100
Pleasanton, CA 94588

TEL: (925) 460-5300
FAX: (925) 463-2559
ProjectNo: #75.75015.0001;
PO:

11-Jun-02

Sample ID	ClientSampID	Matrix	Collection Date	Bottle	8021B/8015	Requested Tests
0206170-001	PIT	Water	6/11/02 9:00:00 AM	A		

Comments: 24hr Rush

Date/Time

Date/Time

Relinquished by:

Received by:

Relinquished by:

Received by:

Relinquished by:

Received by:

NOTE: Samples are discarded 60 days after results are reported unless other arrangements are made. Hazardous samples will be returned to client or disposed of at client expense.

Bottle Type: L-Liter V-Voa S-Soil Jar O-Orbo T-Tedlar B-Brass P-Plastic OT-Other



McC Campbell Analytical Inc.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
Telephone : 925-798-1620 Fax . 925-798-1622
<http://www.mcccampbell.com> E-mail: main@mcccampbell.com

ATC Associates 6602 Owens Drive, #100 Pleasanton, CA 94588	Client Project ID: #75.75015.0001; Hertz-Oakland-Tank Pull	Date Sampled: 06/11/02
		Date Received: 06/11/02
	Client Contact: Don Kubik	Date Reported: 06/12/02
	Client P.O.:	Date Completed: 06/12/02

June 12, 2002

Dear Don:

Enclosed are:

- 1). the results of 1 samples from your #75.75015.0001; Hertz-Oakland-Tank Pull project,
- 2). a QC report for the above samples
- 3). a copy of the chain of custody, and
- 4). a bill for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits. If you have any questions please contact me. McC Campbell Analytical Laboratories strives for excellence in quality, service and cost. Thank you for your business and I look forward to working with you again.

Yours truly,

Angela Rydelius, Lab Manager



McC Campbell Analytical Inc.

110 2nd Avenue South, #D7, Pacheco, CA 94553-3560
 Telephone : 925-798-1620 Fax 925-798-1622
 http://www.mcccampbell.com E-mail: main@mcccampbell.com

QC SUMMARY REPORT FOR SW8021B/8015Cm

BatchID: 2402

Matrix: W

WorkOrder: 0206170

EPA Method: SW8021B/8015Cm		Extraction: SW5030B		Ext. Date: 6/11/02		Spiked Sample ID: N/A				
Compound	Sample	Spiked	MS*	MSD*	MS-MSD*	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)	
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	Low	High
TPH(gas)	N/A	60	N/A	N/A	N/A	92.5	95.7	3.4	80	120
MTBE	N/A	10	N/A	N/A	N/A	105	96.3	9.1	80	120
Benzene	N/A	10	N/A	N/A	N/A	108	104	3.1	80	120
Toluene	N/A	10	N/A	N/A	N/A	112	110	1.7	80	120
Ethylbenzene	N/A	10	N/A	N/A	N/A	109	107	1.2	80	120
Xylenes	N/A	30	N/A	N/A	N/A	110	110	0	80	120
%SS	N/A	10	N/A	N/A	N/A	107	106	1.4	80	120

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions.
 NONE

MS = Matrix Spike, MSD = Matrx Spike Duplicate; LCS = Laboratory Control Sample, LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation

N/A = not enough sample to perform matrix spike, or analyte concentration in sample exceeds spike amount

% Recovery = $100 * (MS - Sample) / (Amount Spiked)$; RPD = $100 * (MS - MSD) / (MS + MSD) * 2$

* MS and / or MSD spike recoveries may not be near 100% or their RPDs near 0% if: a) the sample is inhomogeneous AND contains significant concentrations of analyte relative to the amount spiked, or b) if that specific sample matrix interferes with spike recovery

McC Campbell Analytical Inc.

110 Second Avenue South, #D7
Pacheco, CA 94553-5560
(925) 798-1620

CHAIN-OF-CUSTODY RECORD

WorkOrder: 0207189

Client:

ATC Associates
6602 Owens Drive, #100
Pleasanton, CA 94588

TEL: (925) 460-5300
FAX: (925) 463-2559
ProjectNo: #75.75015.0001;
PO:

15-Jul-02

Sample ID	ClientSampID	Matrix	Collection Date	Bottle	Requested Tests					
				8021B/8015						
0207189-001	G-EX	Water	7/15/02 12:10:00 PM	A						
0207189-002	WO-EX	Water	7/15/02 12:00:00 PM	A						

Comments: 24hr Rush.

Date/Time

Date/Time

Relinquished by:

Received by:

Relinquished by:

Received by:

Relinquished by:

Received by:

NOTE: Samples are discarded 60 days after results are reported unless other arrangements are made. Hazardous samples will be returned to client or disposed of at client expense.

Bottle Type: L-Liter V-Voa S-Soil Jar O-Orbo T-Tedlar B-Brass P-Plastic OT-Other



McC Campbell Analytical Inc.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
Telephone : 925-798-1620 Fax : 925-798-1622
<http://www.mccampbell.com> E-mail: main@mccampbell.com

ATC Associates 6602 Owens Drive, #100 Pleasanton, CA 94588	Client Project ID: #75.75015.0001; Hertz Oakland	Date Sampled: 07/15/02
		Date Received: 07/15/02
	Client Contact: Don Kubik	Date Reported: 07/16/02
	Client P.O.:	Date Completed: 07/16/02

July 16, 2002


Dear Don:

Enclosed are:

- 1). the results of 2 samples from your #75.75015.0001; Hertz Oakland project,
- 2). a QC report for the above samples
- 3). a copy of the chain of custody, and
- 4). a bill for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits. If you have any questions please contact me. McC Campbell Analytical Laboratories strives for excellence in quality, service and cost. Thank you for your business and I look forward to working with you again.

Yours truly,


Angela Rydelius, Lab Manager



QC SUMMARY REPORT FOR SW8021B/8015Cm

Matrix: W

WorkOrder: 0207189

EPA Method: SW8021B/8015Cm		Extraction: SW5030B		BatchID: 2934		Spiked Sample ID: 0207179-001A				
Compound	Sample	Spiked	MS*	MSD*	MS-MSD*	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)	
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	Low	High
TPH(gas)	ND	60	94.6	103	8.32	97.7	97.7	0.0320	80	120
MTBE	ND	10	97.5	93.9	3.73	110	96.3	13.0	80	120
Benzene	ND	10	107	109	1.67	114	106	6.74	80	120
Toluene	ND	10	109	111	2.11	114	113	1.08	80	120
Ethylbenzene	ND	10	110	111	1.37	114	109	4.40	80	120
Xylenes	ND	30	110	113	2.99	113	110	2.99	80	120
%SS:	106	100	103	106	3.10	107	108	1.17	80	120

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
 NONE

MS = Matrix Spike, MSD = Matrix Spike Duplicate, LCS = Laboratory Control Sample, LCSD = Laboratory Control Sample Duplicate, RPD = Relative Percent Deviation

N/A = not enough sample to perform matrix spike and matrix spike duplicate

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.

% Recovery = $100 * (MS - Sample) / (Amount\ Spiked)$, RPD = $100 * (MS - MSD) / (MS + MSD) * 2$

* MS and / or MSD spike recoveries may not be near 100% or the RPDs near 0% if: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) if that specific sample matrix interferes with spike recovery

ALAMEDA COUNTY
HEALTH CARE SERVICES



AGENCY
DAVID J. KEARS, Agency Director

ENVIRONMENTAL HEALTH SERVICES
ENVIRONMENTAL PROTECTION
1131 Harbor Bay Parkway, Suite 250
Alameda, CA 94502-6577
(510) 567-6700
FAX (510) 337-9335

July 11, 2002

Mr. Fred Weaver
Hertz Corporation
3838 Sheffield Circle
Danville, CA 94506

Dear Mr. Weaver:

Subject: Fuel Leak Site RO0000157, 1 Airport Drive, Oakland CA 94621

Alameda County Environmental Health, Local Oversight Program, has been informed of results from the recent underground tank removals at the referenced site. Based upon this information our office has the following technical comments and requests, which will facilitate site closure.

Technical Comments

- The treatment of the former pump island area with Fenton's reagent has apparently been successful in oxidizing residual TPH contamination in groundwater. The treatment also affected the residual absorbed contamination in soils beneath the groundwater.
- The groundwater sample from the former gasoline tank pit reported elevated MTBE concentrations. Our office, therefore, approved of the similar Fenton's reagent treatment of this groundwater.

Technical Report Request

- Please provide a copy of the underground tank removal and groundwater treatment reports to our office within 30 days after completing your groundwater treatment
- Please schedule a groundwater sampling event of all wells within 30 days after the completion of groundwater treatment. All wells are necessary since some wells were removed from sampling prior to discovering the recent MTBE release.

You may contact me at (510) 567-6765 if you have any questions.

Sincerely,

Barney M. Chan
Hazardous Materials Specialist

C: B. Chan, files

- ✓ Mr. J. Love, ATC Associates Inc., 6602 Owens Dr., Suite 100, Pleasanton, CA 94588
- Mr. D. Klettke, Port of Oakland, P.O. Box 2064, Oakland, CA 94604-2064
- Mr. K. Matthews, Oakland Fire Dept., 1605 MLK Jr Way, Oakland, CA 94612

Reprq1AirportDr