


Advanced GeoEnvironmental, Inc.

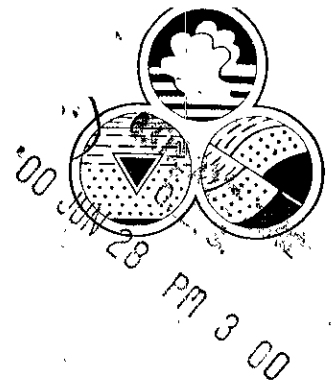

19 June 2000
AGE-NC Project No. 99-0556

Mr. Achim Ehrhardt
Continental Volvo, Inc.
4030 East 14th Street
Oakland, CA 94601

**Subject: Underground Storage Tank Removal and Soil Sample Analysis
 Former Continental Volvo
 4030 - 4122 East 14th Street, Oakland, California**

In accordance with your request, *Advanced* GeoEnvironmental, Inc. (AGE) has prepared this report in conjunction with the removal of two 1,000-gallon, steel underground storage tanks (USTs) at the referenced address (Figure 2).

BACKGROUND LOCATION

The site is located in central Oakland, California (Figure 1), at an estimated elevation of 15 feet above sea level. The site is located in a commercial area of very low topographic relief, sloping gently toward the west.

The depth to ground water at the site is uncertain. Standing water was encountered during removal of the waste oil UST and was not encountered in the heating oil UST removal. Approximately three inches of water were observed. A water sample was collected from the waste oil UST excavation from a pre-installed casing set to nine feet below surface grade.

A main compound of structures are located on the property (Figure 2). Most of the site is used auto sales and service. The remaining portions are presently occupied by auto sales and parking.

UST REMOVAL

The two USTs were excavated on 03 May 2000 and removed on 04 May 2000 (Figure 2). No dispensers or product line(s) were removed during excavation of the UST. The tanks were utilized for heating oil and waste oil storage.

All the soil removed to uncover the tanks was temporarily stockpiled on the side walks surround the USTs.

Prior to removal of the USTs, waste was removed and the tanks were triple rinsed by AGE, using a pressurized water. Approximately 500 gallons of rinseate were transported under manifest to Evergreen of Newark by Evergreen.

Inspector Hernan Gomez of the City of Oakland Fire Department was on hand to oversee the tank removal activities.

After being removed, the tanks were visually inspected with holes noted at the base of the ends of the heating oil UST. The waste oil UST was in excellent condition. The tanks were subsequently transported to ECI of Richmond for disposal.

SOIL SAMPLING

Following removal of the tank, a backhoe was used to collect a soil sample from 2 feet below the ends of the former USTs (Figure 2). A soil sample was collected from the heating oil UST soil stockpile to be analyzed. Each soil sample was collected with metric soil sampling hammer, loaded with a pre-cleaned brass sleeve. The ends of the brass sleeves were sealed with a Teflon plastic and end caps were tapped over the ends of each sample sleeve. A total of five soil samples and one water sample were collected from the UST excavations.

The samples were collected by AGE, labeled and placed in a chilled container. The samples were transported under chain-of-custody to McCampbell Analytical Inc. (MAI) of Pacheco, California, a state-certified analytical laboratory. The date and time soil samples were taken were noted on the chain-of-custody form included with the attached laboratory report and quality control data.

The samples associated with the USTs and the soil spoils pile were analyzed for:

- Total petroleum hydrocarbons quantified as gasoline, diesel and motor oil (TPH-g, d, mo) in accordance with EPA method 8015 modified,
- Purgeable volatile aromatics (benzene, toluene, ethylbenzene and total xylenes: BTE&X) in accordance with EPA method 8020,

The samples associated with the waste oil UST was also analyzed for:

- Volatile organics halocarbons (HVOC) in accordance with EPA method 8010,
- Polychlorinated Biphenyls (PCBs) in accordance with EPA method 8080, and
- Five LUFT metals in accordance with EPA method 6010.

RESULTS

TPH and BTE&X were present in each two of the samples analyzed in concentrations exceeding the method detection limits. TPH-g was detected in the soil samples has high as 360 milligrams per kilogram (mg/kg), TPH-d 1,100 mg/kg and TPH-mo 2,000 mg/kg. BTE&X compounds were detected as high as 0.7 mg/kg benzene. Total lead and other metal were detected at or above background levels. PCBs were also detected in the waste oil UST sample.

*identified as
TAME-H 400*

TPH and BTEX were not detected in the stockpile soil sample.

The grab water sample was impacted. TPH-g was detected in the soil samples has high as 180 micrograms per liter ($\mu\text{g/l}$), TPH-d 68,000 $\mu\text{g/l}$ and TPH-mo 200,000 $\mu\text{g/l}$. BTE&X compounds were detected as high as 23 $\mu\text{g/l}$ benzene. LUFT metals were detected in the grab water sample from the waste oil UST area.


water

(MAI Laboratory numbers 35567 to 35572)

If you have any questions regarding this matter, please contact our office at (209) 467-1006.



Sincerely,

Advanced GeoEnvironmental, Inc.



William Little
Staff Geologist

Enclosures cc: Mr. Hernan Gomez - Oakland Fire


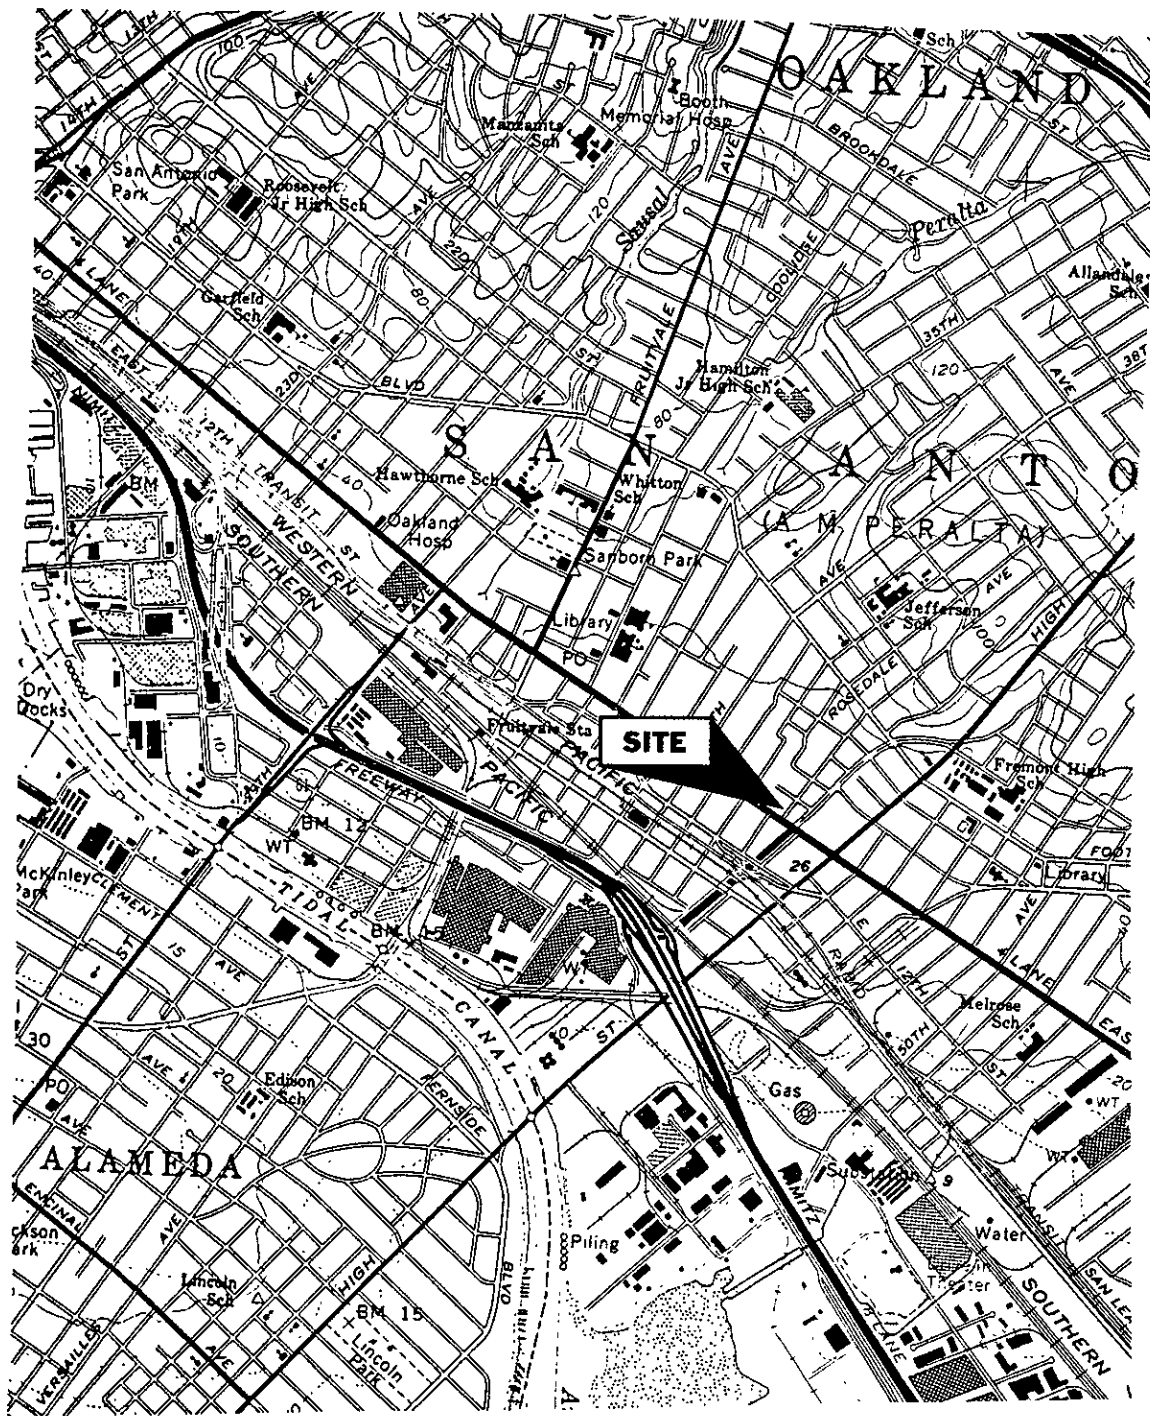


LOCATION MAP
 CONTINENTAL VOLVO
 4030-4122 EAST 14TH STREET
 OAKLAND, CALIFORNIA



Advanced
 GeoEnvironmental, Inc.
 of Northern California


PROJECT NO. AGE-NC-99-0556	FILE CON1	FIGURE
DATE 10 MARCH 1999	DRAWN BY. MAC	1

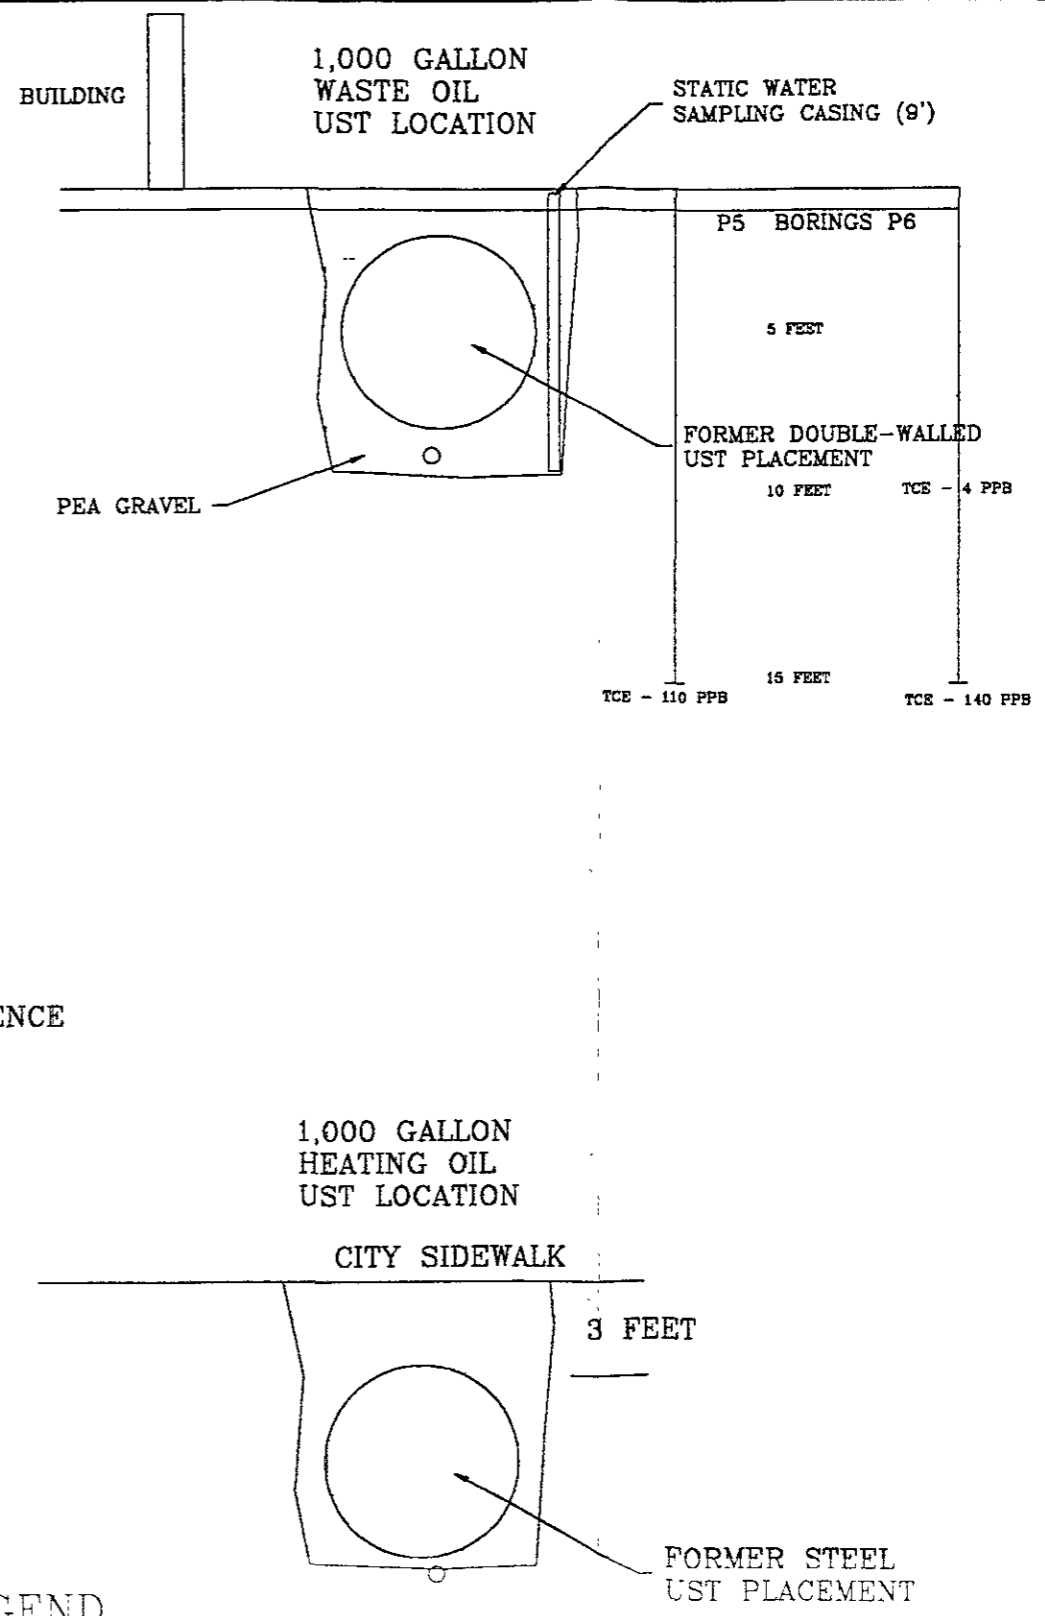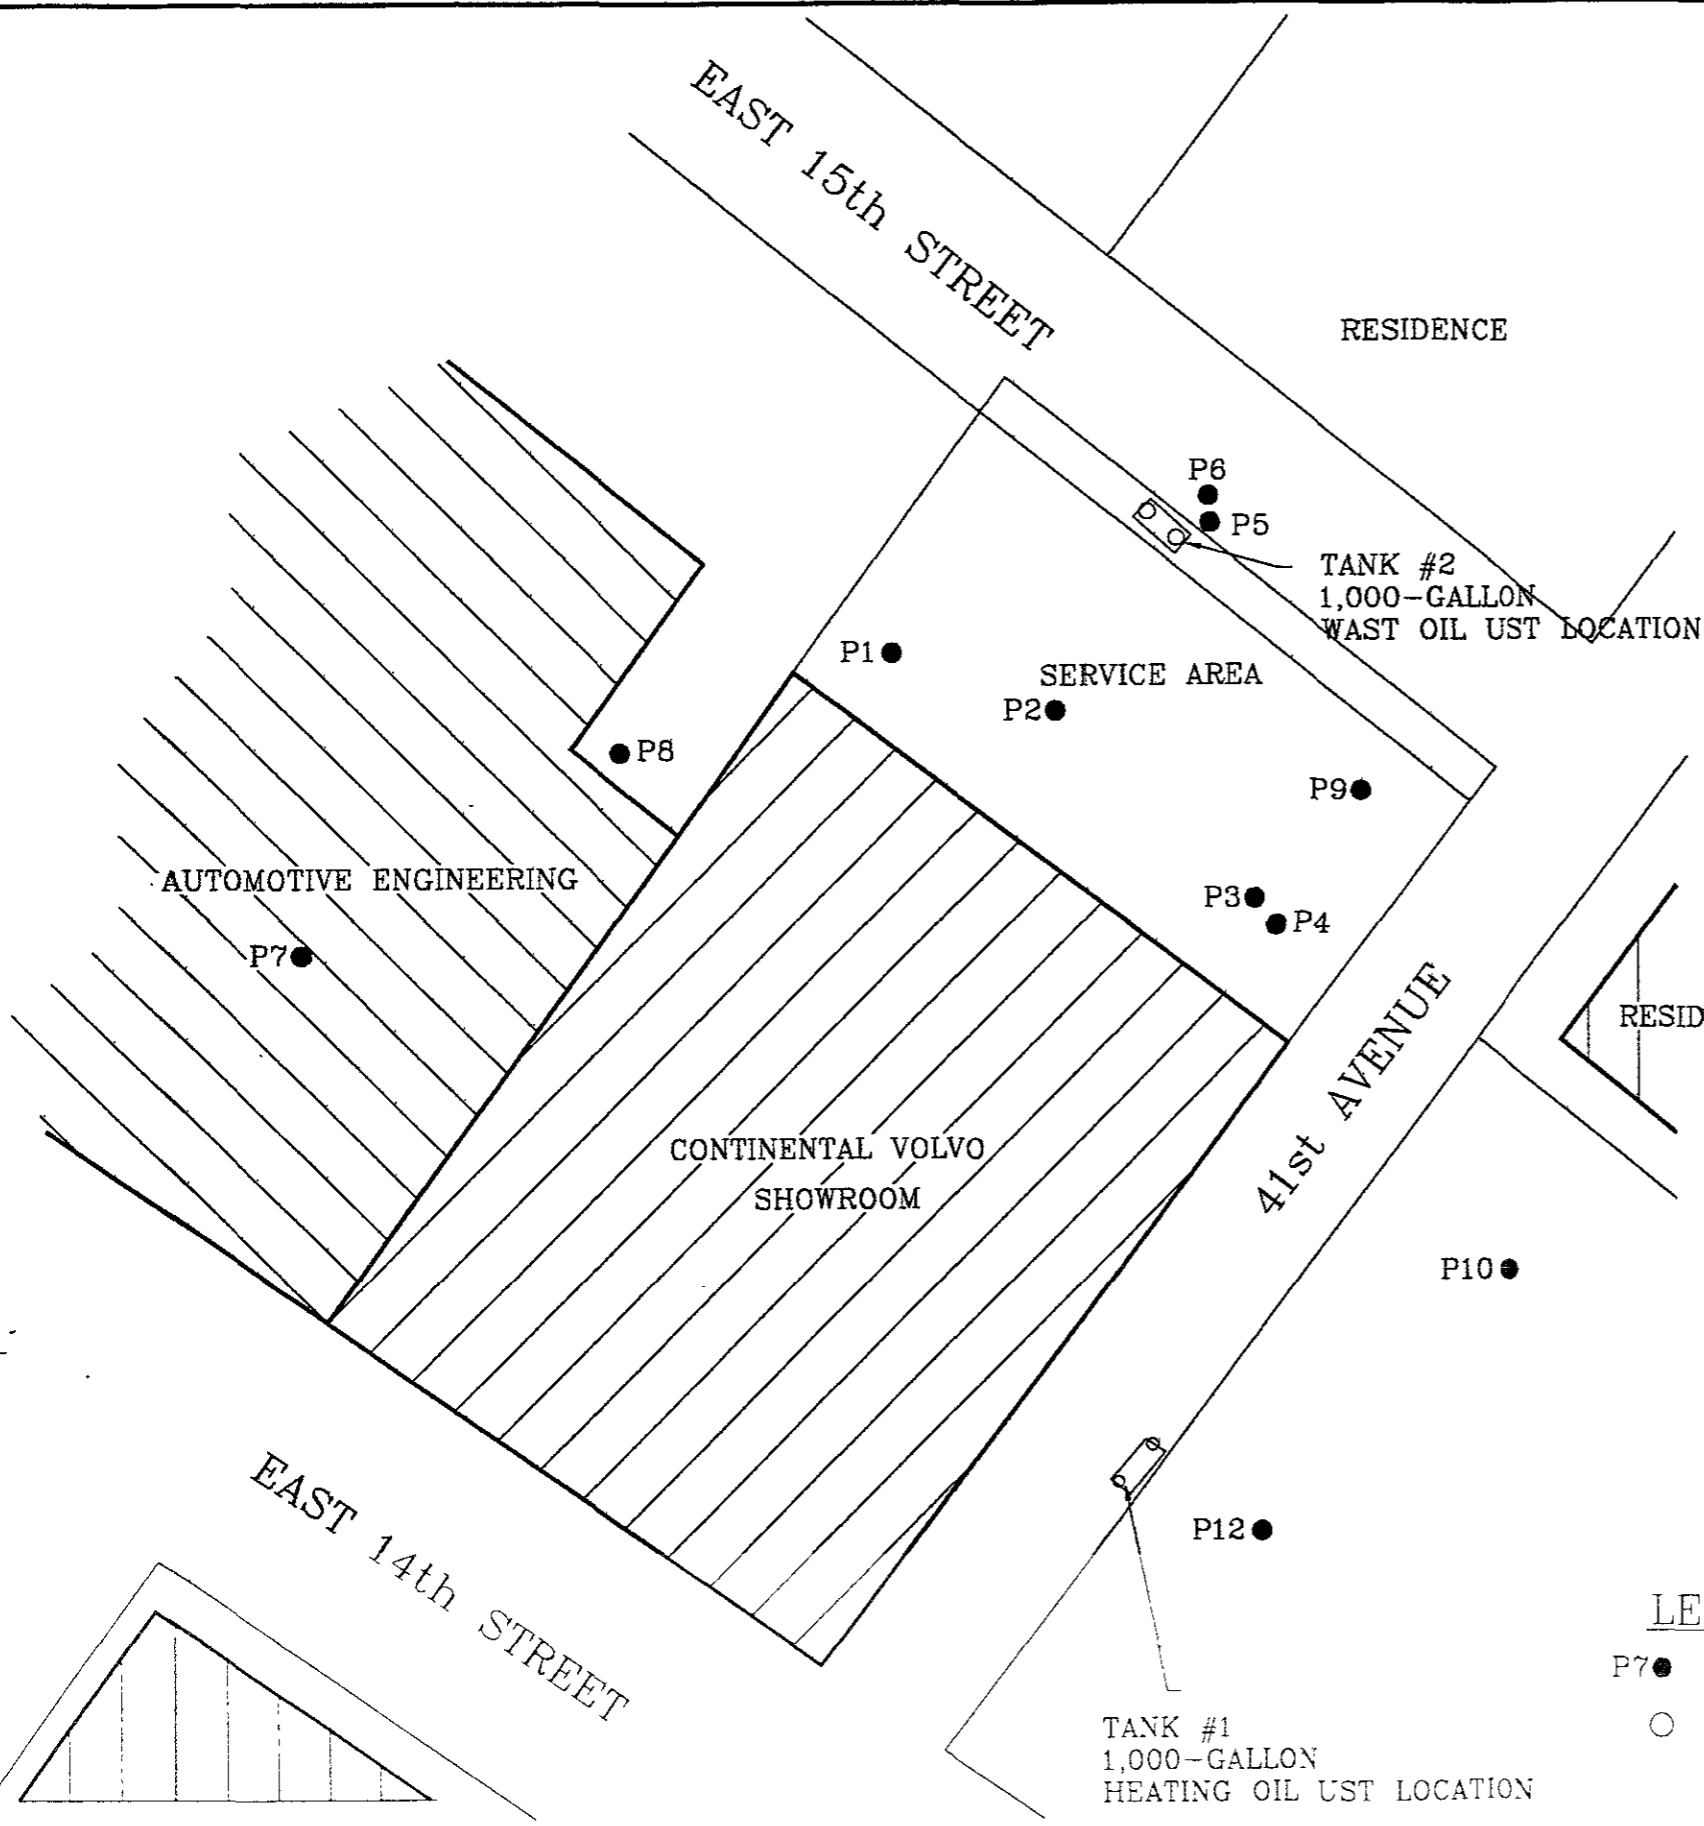

LEGEND

P7● SOIL PROBE BORING LOCATION

○ UST SOIL SAMPLING LOCATION

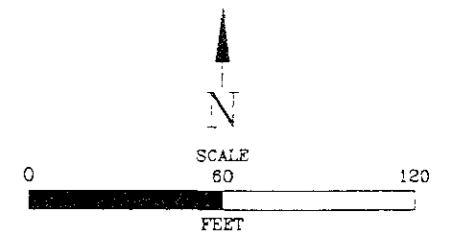

Advanced GeoEnvironmental, Inc.
of Northern California

SITE PLAN

CONTINENTAL VOLVO
4030 - 4122 EAST 14th STREET
OAKLAND, CALIFORNIA

PROJECT NO. AGE-NC-99-0556 FILE: VOLVO2
DATE: 12 FEBRUARY 1999 DRAWN BY: MAC

FIGURE: 2



McCAMPBELL ANALYTICAL INC.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
Telephone : 925-798-1620 Fax : 925-798-1622
<http://www.mccampbell.com> E-mail: main@mccampbell.com

Advanced GeoEnvironmental 4005 North Wilson Way Stockton, CA 95205	Client Project ID: Former Continental Volvo	Date Sampled: 04/04/00
		Date Received: 04/04/00
	Client Contact: Bill Little	Date Extracted: 04/04/00
	Client P.O:	Date Analyzed: 04/04/00

04/11/00


Dear Bill:

Enclosed are:

- 1). the results of 6 samples from your **Former Continental Volvo** project,
- 2). a QC report for the above samples
- 3). a copy of the chain of custody, and
- 4). a bill for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits. If you have any questions please contact me. McCampbell Analytical Laboratories strives for excellence in quality, service and cost. Thank you for your business and I look forward to working with you again.

Yours truly,



Edward Hamilton, Lab Director



McCAMPBELL ANALYTICAL INC.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
 Telephone : 925-798-1620 Fax : 925-798-1622
<http://www.mcccampbell.com> E-mail: main@mcccampbell.com

Advanced GeoEnvironmental 4005 North Wilson Way Stockton, CA 95205	Client Project ID: Former Continental Volvo	Date Sampled: 04/04/00
	Client Contact: Bill Little	Date Received: 04/04/00
	Client P.O.:	Date Extracted: 04/05-04/07/00
		Date Analyzed: 04/05-04/07/00

Volatile Halocarbons

EPA method 601 or 8010

Lab ID	35569	35570	35571
Client ID	Tank2 -N	Tank2 S	Tank2
Matrix	(S)	(S)	(W)
Compound	Concentration		
Bromodichloromethane	ND	ND	ND
Bromoform ^(b)	ND	ND	ND
Bromomethane	ND	ND	ND
Carbon Tetrachloride ^(c)	ND	ND	ND
Chlorobenzene	45	8.4	2.2
Chloroethane	ND	ND	ND
2-Chloroethyl Vinyl Ether ^(d)	ND	ND	ND
Chloroform ^(e)	ND	ND	ND
Chloromethane	ND	ND	ND
Dibromochloromethane	ND	ND	ND
1,2-Dichlorobenzene	64	12	5.5
1,3-Dichlorobenzene	8.0	ND	ND
1,4-Dichlorobenzene	26	5.6	0.87
Dichlorodifluoromethane	ND	ND	ND
1,1-Dichloroethane	ND	ND	ND
1,2-Dichloroethane	ND	ND	0.53
1,1-Dichloroethene	ND	ND	ND
cis 1,2-Dichloroethene	ND	ND	ND
trans 1,2-Dichloroethene	ND	ND	ND
1,2-Dichloropropane	ND	ND	ND
cis 1,3-Dichloropropene	ND	ND	ND
trans 1,3-Dichloropropene	ND	ND	ND
Methylene Chloride ^(f)	ND	ND	ND
1,1,2,2-Tetrachloroethane	ND	ND	ND
Tetrachloroethene	ND<25	ND<25	ND
1,1,1-Trichloroethane	ND	ND	ND
1,1,2-Trichloroethane	ND	ND	ND
Trichloroethene	ND	ND	ND
Trichlorofluoromethane	ND	ND	ND
Vinyl Chloride ^(g)	ND	ND	ND
% Recovery Surrogate	99	105	100
Comments			h

* water and vapor samples and all TCLP & SPLP extracts are reported in ug/L, soil and sludge samples in ug/kg, wipe samples in ug/wipe
 Reporting limit unless otherwise stated: water/TCLP/SPLP extracts, ND<0.5ug/L; soils and sludges, ND<5ug/kg; wipes, ND<0.2ug/wipe
 ND means not detected above the reporting limit; N/A means analyte not applicable to this analysis
 (b) tribromomethane; (c) tetrachloromethane; (d) (2-chloroethoxy) ethene; (e) trichloromethane; (f) dichloromethane; (g) chloroethene; (h) a lighter than water immiscible sheen is present; (i) liquid sample that contains greater than ~5 vol. % sediment; (j) sample diluted due to high organic content.



McCAMPBELL ANALYTICAL INC.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
Telephone : 925-798-1620 Fax : 925-798-1622
<http://www.mccampbell.com> E-mail: main@mccampbell.com

Advanced GeoEnvironmental 4005 North Wilson Way Stockton, CA 95205	Client Project ID: Former Continental Volvo	Date Sampled: 04/04/00
	Client Contact: Bill Little	Date Received: 04/04/00
	Client P.O:	Date Extracted: 04/04/00
		Date Analyzed: 04/14-04/17/00

Polychlorinated Biphenyls (PCB)

EPA method 608 and 3510 or 8080 and 3550

Lab ID	Client ID	Matrix	PCB*	% Recovery Surrogate
35569	Tank2-N	S	250,c,o <i>ppb</i>	105
35570	Tank2-S	S	ND<65,j,o <i>-2.5 ppm</i>	106
35571	Tank2	W	ND<10,j,o,h	104
Reporting Limit unless otherwise stated; ND means not detected above the reporting limit	W	0.5 ug/L		
	S	50 ug/kg		

PCB in soil

* water and vapor samples are reported in ug/L, oils in mg/L, soil and sludge samples in ug/kg, wipes in ug/wipe and all TCLP / SPLP /STLC extracts in ug/L. *ppb ppm*

ND means not detected above the reporting limit

* surrogate diluted out of range or surrogate coelutes with another peak

* PCB aroclors - the first two digits of the aroclor number convey general structural information, where 12 and 10 denote biphenyl compounds with the latter having one phenyl group that is Cl-free; the last two aroclor digits specify its Cl weight %; (a) PCB aroclor 1016; (b) PCB aroclor 1221; (c) PCB aroclor 1232; (d) PCB aroclor 1242; (e) PCB aroclor 1248; (f) PCB aroclor 1254; (g) PCB aroclor 1260; (h) a lighter than water immiscible sheen is present; (i) liquid sample that contains >~5 vol. % sediment; (j)sample diluted due to high organic content; (l) florasil (EPA 3620) cleanup; (m) silica-gel (EPA 3630) cleanup; (n) elemental sulfur (EPA 3660) cleanup; (o) sulfuric acid-permanganate (EPA 3665) cleanup.



McCAMPBELL ANALYTICAL INC.

110 2nd Avenue South, #D7, Pacheco, CA 94553-5560
Telephone : 925-798-1620 Fax : 925-798-1622
<http://www.mccampbell.com> E-mail: main@mccampbell.com

Advanced GeoEnvironmental 4005 North Wilson Way Stockton, CA 95205	Client Project ID: Former Continental Volvo	Date Sampled: 04/04/00
	Client Contact: Bill Little	Date Received: 04/04/00
	Client P.O:	Date Extracted: 04/04/00
		Date Analyzed: 04/04/00

LUFT Metals*

EPA analytical methods 6010/200.7, 239.2*

Lab ID	Client ID	Matrix	Extraction ^o	Cadmium	Chromium	Lead	Nickel	Zinc	% Recovery Surrogate
35569	Tank2-N	(S)	TTLC	ND	69	59	123	74	102
35570	Tank2-S	(S)	TTLC	ND	62	37	115	65	99
35571	Tank2	W	TTLC	0.0077	0.036	2.3	0.17	0.64	111
Reporting Limit unless otherwise stated; ND means not detected above the reporting limit	S	TTLC	0.5 mg/kg	0.5	3.0	2.0	1.0		
	W	TTLC	0.005 mg/L	0.005	0.005	0.05	0.05		
	---	STLC, TCLP	0.01 mg/L	0.05	0.2	0.05	0.05		

lead
750 ppm
FASTED

5000
2.16
2

1000

NICKEL
1000
PPM

Chromium
18

CP 380

* water samples are reported in mg/L, soil and sludge samples in mg/kg, wipes in ug/wipe and all TCLP / STLC / SPLP extracts in mg/L
^o Lead is analysed using EPA method 6010 (ICP) for soils, STLC & TCLP extracts and method 239.2 (AA Furnace) for water samples
^o EPA extraction methods 1311(TCLP), 3010/3020(water,TTLC), 3040(organic matrices,TTLC), 3050(solids,TTLC); STLC - CA Title 22
^o DISTLC extractions are performed using STLC methodology except that deionized water is substituted for citric acid buffer as the extraction fluid. DISTLC results are not applicable to STLC regulatory limits.
^o surrogate diluted out of range; N/A means surrogate not applicable to this analysis
^o reporting limit raised due to matrix interference
i) liquid sample that contains greater than ~2 vol. % sediment; this sediment is extracted with the liquid, in accordance with EPA methodologies and can significantly effect reported metal concentrations.



QC REPORT

Date: 04/04/00

Matrix: Water

Extraction: N/A

Compound	Concentration: ug/L			%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	

SampleID: 4400

Instrument: GC-7

Surrogate1	0.000	94.0	92.0	100.00	94	92	2.2
Xylenes	0.000	294.0	279.0	300.00	98	93	5.2
Ethyl Benzene	0.000	92.0	87.0	100.00	92	87	5.6
Toluene	0.000	92.0	86.0	100.00	92	86	6.7
Benzene	0.000	95.0	87.0	100.00	95	87	8.8
MTBE	0.000	93.0	84.0	100.00	93	84	10.2
GAS	0.000	1056.6	1012.0	1000.00	106	101	4.3

SampleID: 4400

Instrument: MB-1

Oil & Grease	0.000	21.7	21.6	20.00	109	108	0.5
--------------	-------	------	------	-------	-----	-----	-----

SampleID: 4400

Instrument: GC-11 A

Surrogate1	0.000	117.0	117.0	100.00	117	117	0.0
TPH (diesel)	0.000	308.0	309.0	300.00	103	103	0.3

SampleID: 4400

Instrument: IR-1

Surrogate1	0.000	89.0	90.7	100.00	89	91	1.9
TRPH	0.000	25.6	24.4	23.70	108	103	4.8

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

Date: 04/04/00

Matrix: Soil

Extraction: N/A

Compound	Concentration: mg/kg				%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	MSD	

SampleID: 28797

Instrument: GC-7

Surrogate1	0.000	98.0	98.0	100.00	98	98	0.0
Xylenes	0.000	301.0	286.0	300.00	100	95	5.1
Ethyl Benzene	0.000	94.0	91.0	100.00	94	91	3.2
Toluene	0.000	92.0	90.0	100.00	92	90	2.2
Benzene	0.000	87.0	88.0	100.00	87	88	1.1
MTBE	0.000	84.0	85.0	100.00	84	85	1.2
GAS	0.000	1036.6	992.7	1000.00	104	99	4.3

SampleID: 4400

Instrument: MB-1

Oil & Grease	0.000	22.4	22.9	20.00	112	115	2.2
--------------	-------	------	------	-------	-----	-----	-----

SampleID: 28778

Instrument: GC-11 A

Surrogate1	0.000	114.0	118.0	100.00	114	118	3.4
TPH (diesel)	0.000	304.0	307.0	300.00	101	102	1.0

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 2 \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

EPA 8010/8020/EDB

Date: 04/04/00-04/05/00 Matrix: Water

Extraction: N/A

Compound	Concentration: ug/L			%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	

SampleID: 4400

Instrument: GC-1

Surrogate1	0.000	105.0	104.0	100.00	105	104	1.0
Chlorobenzene	0.000	107.0	112.0	100.00	107	112	4.6
EDB	0.000	102.0	107.0	100.00	102	107	4.8
Trichloroethane	0.000	105.0	114.0	100.00	105	114	8.2
1,1-DCE	0.000	111.0	115.0	100.00	111	115	3.5

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{AmountSpiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 2100$$

RPD means Relative Percent Deviation



QC REPORT

EPA 8010/8020/EDB

Date: 04/04/00-04/05/00 Matrix: Soil

Extraction: N/A

Compound	Concentration: ug/kg				%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	MSD	

SampleID: 28784

Instrument: GC-1

Surrogate1	0.000	99.0	100.0	100.00	99	100	1.0
Chlorobenzene	0.000	107.0	106.0	100.00	107	106	0.9
EDB	0.000	84.0	84.0	100.00	84	84	0.0
Trichloroethane	0.000	109.0	110.0	100.00	109	110	0.9
1,1-DCE	0.000	103.0	107.0	100.00	103	107	3.8

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

LUFT

Date: 04/04/00-04/05/00 Matrix: Soil

Extraction: TTLC

Compound	Concentration: mg/kg			%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	

SampleID: 4400

Instrument: ICP-1

Copper	0.000	4.9	5.2	5.00	98	104	6.0
Zinc	0.000	5.2	5.5	5.00	104	109	4.6
Lead	0.000	5.3	5.7	5.00	106	114	7.1
Nickel	0.000	5.4	5.5	5.00	107	110	2.8
Chromium	0.000	5.2	5.3	5.00	103	105	2.1
Cadmium	0.000	5.6	5.9	5.00	112	117	5.1

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 2 \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

EPA 8080/608

Date: 04/14/00-04/15/00 Matrix: Water

Extraction: N/A

Compound	Concentration: ug/L			%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	

SampleID: 42100

Instrument: GC-5

Surrogate1	0.000	111.0	111.0	100.00	111	111	0.0
4,4'-DDT	0.000	55.0	52.0	50.00	110	104	5.6
Endrine	0.000	54.0	55.0	50.00	108	110	1.8
Dieldrin	0.000	53.0	54.0	50.00	106	108	1.9
Aldrin	0.000	21.0	21.0	20.00	105	105	0.0
Heptachlor	0.000	24.0	25.0	20.00	120	125	4.1
Lindane	0.000	20.0	21.0	20.00	100	105	4.9
PCB	0.000	150.0	156.0	150.00	100	104	3.9

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

EPA 8080/608

Date: 04/14/00-04/15/00 Matrix: Soil

Extraction: N/A

Compound	Concentration: ug/kg			%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	

SampleID: 42100

Instrument: GC-5

Surrogate1	0.000	104.0	120.0	100.00	104	120	14.3
4,4'-DDT	0.000	55.0	59.0	50.00	110	118	7.0
Endrine	0.000	56.0	57.0	50.00	112	114	1.8
Dieldrin	0.000	54.0	54.0	50.00	108	108	0.0
Aldrin	0.000	21.0	21.0	20.00	105	105	0.0
Heptachlor	0.000	23.0	24.0	20.00	115	120	4.3
Lindane	0.000	20.0	20.0	20.00	100	100	0.0
PCB	0.000	155.0	147.0	150.00	103	98	5.3

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 2 \cdot 100$$

RPD means Relative Percent Deviation



QC REPORT

CAM 17

Date: 04/04/00-04/05/00 Matrix: Water

Extraction: TTLC

Compound	Concentration: mg/L				%Recovery		RPD
	Sample	MS	MSD	Amount Spiked	MS	MSD	

SampleID: 4400

Instrument: ICP-1

Beryllium	0.000	5.3	5.2	5.00	106	103	2.1
Selenium	0.000	9.9	10.4	10.00	99	104	4.0
Molybdenum	0.000	5.1	5.0	5.00	101	100	1.1
Silver	0.000	0.5	0.5	0.50	102	100	1.9
Thallium	0.000	9.9	9.7	10.00	99	97	2.3
Barium	0.000	5.9	5.6	5.00	118	112	5.4
Nickel	0.000	5.7	5.6	5.00	113	113	0.8
Arsenic	0.000	11.6	11.7	10.00	116	117	0.9
Vanadium	0.000	5.1	5.1	5.00	102	101	0.8
Surrogate1	0.000	112.6	110.9	100.00	113	111	1.5
Zinc	0.000	5.3	5.2	5.00	106	104	2.1
Copper	0.000	5.3	4.9	5.00	107	99	7.8
Antimony	0.000	9.8	9.6	10.00	98	96	1.8
Lead	0.000	10.8	10.7	10.00	108	107	1.3
Cadmium	0.000	5.7	5.6	5.00	114	113	1.5
Cobalt	0.000	5.3	5.3	5.00	105	107	1.3
Mercury	0.000	1.0	1.0	1.00	99	96	3.0
Chromium	0.000	5.4	5.4	5.00	108	108	0.3

$$\% \text{ Recovery} = \frac{(MS - \text{Sample})}{\text{Amount Spiked}} \cdot 100$$

$$RPD = \frac{(MS - MSD)}{(MS + MSD)} \cdot 2 \cdot 100$$

RPD means Relative Percent Deviation



Advanced
GeoEnvironmental, Inc.

4005 North Wilson Way - Stockton, California - 95205 - (209) 467-1006 - Fax (209) 467-1118

CHAIN OF CUSTODY RECORD

Date 3-4-00 Page 1 of 1

19620 ZAGE257

Client <i>Achilles Ehrhardt</i>	Project Manager <i>BILL LITTE</i>	Tests Required
	Phone Number <i>ABOVE</i>	
	Samplers: (Signature) <i>William Helto</i>	
Project Name <i>Former Continental Valve</i>		Invoice: AGE <input checked="" type="checkbox"/> Client <input type="checkbox"/>

Sample Number	Location Description	Date	Time	Sample Type			Solid	No. of Conts.	Note 35567							
				Water		Air			IPH	ALL	12TEX	2010	HWOC	BORED	REB	
				Comp.	Grab.											
TANR1-E		4-4-00	1220				✓	1	X	X						35568
TANR1-W			1210						X	X						35569
TANR2-N			1245						X	X	X		X	X		35570
TANR2-S			1255				↓	↓	X	X	X		X	X		35571
+ TANR2-H2O			1235		✓			5/7	X	X	X		X	X		35572
TANR1SP1			140				X	1	X	X						Camp 2#1 For Analysis
TANR1SP2			145				X	1	X	X						

Relinquished by: (Signature) <i>William Helto</i>	Received by: (Signature) <i>Amie A Butler</i>	Normal TAT	Date/Time <i>3-4-00</i>
Relinquished by: (Signature)	Received by: (Signature)		Date/Time
Relinquished by: (Signature)	Received by Mobile Laboratory for field analysis: (Signature)		Date/Time
Dispatched by: (Signature)	Date/Time	Received for Laboratory by:	Date/Time

Method of Shipment:	Laboratory Name <i>Mc Campbell</i>
Special Instructions: ICE <input checked="" type="checkbox"/> GOOD CONDITION <input checked="" type="checkbox"/> HEAD SPACE ABSENT <input checked="" type="checkbox"/> PRESERVATION APPROPRIATE <input checked="" type="checkbox"/> CONTAINERS <input checked="" type="checkbox"/> VOAS O&G METALS OTHER	I hereby authorize the performance of the above indicated work. <i>William Helto</i>

COMMODITY Recycled Class II Aggregate Base

CARRIER [Signature]

23,860

11.93

TRUCK LIC. NO. _____ TRAILER LIC. NO. _____ TRAILER LIC. NO. _____

DRIVER _____ SHIPPER _____

ON OFF WEIGHMASTER Anthony JB

GRAND TOTAL
133.62

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

White - Trucker Yellow - File Pink - w/client invoice

99473792
 IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802; WITHIN CALIFORNIA, CALL 1-800-852-7550
 GENERATOR
 TRANSPORTER
 FACILITY

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No. CAK00147905673792		Manifest Document No. 1 of 1		2. Page 1		Information in the shaded areas is not required by Federal law. EES4	
3. Generator's Name and Mailing Address ADVANCED ECO ENVIRONMENTAL 4005 N. WILSON WY. STOCKTON, CA 95205				A. State Manifest Document Number 99473792					
4. Generator's Phone (209) 467-1006				B. State Generator's ID EXEMPT					
5. Transporter 1 Company Name EVERGREEN ENVIRONMENTAL SERVICES				C. State Transporter's ID (Reserved)					
6. US EPA ID Number CA0982413262				D. Transporter's Phone (800) 972-5284					
7. Transporter 2 Company Name				E. State Transporter's ID (Reserved)					
8. US EPA ID Number				F. Transporter's Phone					
9. Designated Facility Name and Site Address EVERGREEN OIL, INC. 6880 Smith Avenue Newark, CA 94560				G. State Facility's ID CA0980887418					
10. US EPA ID Number CA0980887418				H. Facility's Phone (510) 795-4400					
11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number) Oil Water NON-RCRA HAZARDOUS WASTE, LIQUID		12. Containers		13. Total Quantity		14. Unit Wt/Vol		I. Waste Number	
		No.	Type					State	221
b.								EPA/Other	None
c.								State	
d.								EPA/Other	
J. Additional Descriptions for Materials Listed Above				K. Handling Codes for Wastes Listed Above					
				a. 01		b.			
				c.		d.			
15. Special Handling Instructions and Additional Information 24 Hour Emergency Response Telephone No.: CHEMTREC 1-800-424-9300 Invoice # DOT ERG 171 WEAR PROTECTIVE EQUIPMENT Sales Order #									
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.									
Printed/Typed Name William Little				Signature <i>William Little</i>				Month Day Year 04/03/00	
17. Transporter 1 Acknowledgement of Receipt of Materials									
Printed/Typed Name Green Services				Signature <i>Green</i>				Month Day Year 04/03/00	
18. Transporter 2 Acknowledgement of Receipt of Materials									
Printed/Typed Name				Signature				Month Day Year	
19. Discrepancy Indication Space									
20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19.									
Printed/Typed Name M. BARRETO				Signature <i>M. Barreto</i>				Month Day Year 04/04/00	

DO NOT WRITE BELOW THIS LINE.

Yellow. TSDF SENDS THIS COPY TO GENERATOR WITHIN 30 DAYS
 (Generators who submit hazardous waste for transport out-of-state, produce completed copy of this copy and send to DTSC within 30 days.)

99476786
 IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802; WITHIN CALIFORNIA, CALL 1-800-852-7550
 GENERATOR
 TRANSPORTER
 FACILITY

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No CA941001V7905676786		Manifest Document No. 76786		2. Page 1 of 1		Information in the shaded areas is not required by Federal law. EES4					
3. Generator's Name and Mailing Address Advanced Geo. Environment 1030 International Blvd. Oakland CA 94601						A. State Manifest Document Number 99476786							
4. Generator's Phone (509) 467-1006						B. State Generator's ID							
5. Transporter 1 Company Name EVERGREEN ENVIRONMENTAL SERVICES				6. US EPA ID Number CA0982418282		C. State Transporter's ID (Reserved)							
7. Transporter 2 Company Name						D. Transporter's Phone (800) 972-5284							
8. US EPA ID Number						E. State Transporter's ID (Reserved)							
9. Designated Facility Name and Site Address EVERGREEN OIL, INC. 6880 Smith Avenue Newark, CA 94560						G. State Facility's ID CA0980887418							
10. US EPA ID Number CA0980887418						H. Facility's Phone (510) 795-4400							
11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number)						12. Containers		13. Total Quantity		14. Unit Wt/Vol		1. Waste Number	
						No. Type		Quantity		Wt/Vol		State	
a. Oil & water NON-RCRA HAZARDOUS WASTE, LIQUID						001 TT		60445 G		221		None	
b.										State		EPA/Other	
c.										State		EPA/Other	
d.										State		EPA/Other	
J. Additional Descriptions for Materials Listed Above						K. Handling Codes for Wastes Listed Above							
a.						b.							
c.						d.							
15. Special Handling Instructions and Additional Information 24 Hour Emergency Response Telephone No.: CHEMTREC 1-424-9300 Invoice # 777313 DOT ERG 171 WEAR PROTECTIVE EQUIPMENT Sales Order # 96183678													
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford													
Printed/Typed Name William Little				Signature <i>William Little</i>				Month Day Year 01/01/00					
17. Transporter 1 Acknowledgement of Receipt of Materials													
Printed/Typed Name Tom L. Power				Signature <i>Tom L. Power</i>				Month Day Year 01/01/00					
18. Transporter 2 Acknowledgement of Receipt of Materials													
Printed/Typed Name				Signature				Month Day Year					
19. Discrepancy Indication Space													
20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19													
Printed/Typed Name				Signature				Month Day Year					

DO NOT WRITE BELOW THIS LINE.

IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802; WITHIN CALIFORNIA, CALL 1-800-852-7550

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No. CAC10011479056301664		Manifest Document No. 1 of 1		2. Page 1		Information in the shaded areas is not required by Federal law.									
3. Generator's Name and Mailing Address Acchim Ehrhardt 4030 International ave. Oakland CA 94601						A. State Manifest Document Number 99630664											
4. Generator's Phone (510) 532-3778						B. State Generator's ID											
5. Transporter 1 Company Name Ecology Control Industries						6. US EPA ID Number CAD982030173											
7. Transporter 2 Company Name						8. US EPA ID Number											
9. Designated Facility Name and Site Address ECOLOGICAL CONTROL INDUSTRIES 250 PARK BLVD RICHMOND CA 94601						10. US EPA ID Number CAD009466392											
11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number)						12. Containers		13. Total Quantity		14. Unit		15. Waste Number					
a. WASTE EMPTY STORAGE TANK NOT IN HAZARDOUS WASTE CODE						No.		Type		Quantity		Wt/Vol		State			
						0102		TP		0115010		P		CA		99630664	
J. Additional Descriptions for Materials Listed Above 2 EMPTY STORAGE TANK(S) # 28077 - 28078 TANK(S) HAVE BEEN IDENTIFIED WITH CYLBS DRY TIE PER 1000 GALLON CAPACITY						K. Handling Codes for Wastes Listed Above a. 01 b. c. d.											
15. Special Handling Instructions and Additional Information Wear proper protective equipment while handling. Weights or volumes are approximate. 24 Hour emergency telephone number: (209) 467 1006 24 Hour emergency contact: Bill Little DOT # 171																	
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.																	
Printed/Typed Name William Little				Signature <i>William Little</i>				Month 04		Day 10		Year 10					
17. Transporter 1 Acknowledgement of Receipt of Materials						Printed/Typed Name Carlos Barajas		Signature <i>CS</i>		Month 04		Day 04		Year 10			
18. Transporter 2 Acknowledgement of Receipt of Materials						Printed/Typed Name		Signature		Month		Day		Year			
19. Discrepancy Indication Space																	
20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19																	
Printed/Typed Name DAVID SAP				Signature <i>DAE SAP</i>				Month 04		Day 04		Year 10					

DO NOT WRITE BELOW THIS LINE.

DAY OR NIGHT
TELEPHONE
(510) 235-1393

CERTIFICATE CERTIFIED SERVICES COMPANY

255 Parr Boulevard • Richmond, California 94801

NO. 35618

CUSTOMER
JOB NO. 5240397
ADVANCED GEO ENV.

FOR: ECOLOGY CONTROL IND. TANK NO. 28077

LOCATION: RICHMOND, CA DATE: 4/7/2000 TIME: 10:25:36

TEST METHOD VISUAL GASTECH/1314 SMPN LAST PRODUCT FO

This is to certify that I have personally determined that this tank is in accordance with the American Petroleum Institute and have found the condition to be in accordance with its assigned designation. This certificate is based on conditions existing at the time the inspection herein set forth was completed and is issued subject to compliance with all qualifications and instructions.

TANK SIZE 1,000 Gal. Tank CONDITION SAFE FOR FIRE

REMARKS: OXYGEN 20.9% LOWER EXPLOSIVE LIMIT LESS THAN 0.1% ECOLOGY CONTROL INDUSTRIES
HERBY CERTIFIES THAT THE ABOVE NUMBERED TANK HAS BEEN CUT OPEN, PROCESSED,
AND THEREFORE DESTROYED AT OUR PERMITTED HAZARDOUS WASTE FACILITY.
ECOLOGY CONTROL INDUSTRIES HAS THE APROPRIATE PERMITS FOR, AND HAS ACCEPTED
THE TANK SHIPPED TO US FOR PROCESSING.

In the event of any physical or atmospheric changes affecting the gas-free conditions of the above tanks, or if in any doubt, immediately stop all hot work and contact the undersigned. This permit is valid for 24 hours if no physical or atmospheric changes occur.

STANDARD SAFETY DESIGNATION

SAFE FOR MEN: Means that in the compartment or space so designated (a) The oxygen content of the atmosphere is at least 19.5 percent by volume; and that (b) Toxic materials in the atmosphere are within permissible concentrations; and (c) In the judgment of the Inspector, the residues are not capable of producing toxic materials under existing atmospheric conditions while maintained as directed on the Inspector's certificate.

SAFE FOR FIRE: Means that in the compartment so designated (a) The concentration of flammable materials in the atmosphere is below 10 percent of the lower explosive limit; and that (b) In the judgment of the Inspector, the residues are not capable of producing a higher concentration that permitted under existing atmospheric conditions in the presence of fire and while maintained as directed on the Inspector's certificate, and further, (c) All adjacent spaces have either been cleaned sufficiently to prevent the spread of fire, are satisfactorily inerted, or in the case of fuel tanks, have been treated as deemed necessary by the Inspector.

The undersigned representative acknowledges receipt of this certificate and understands the conditions and limitations under which it was issued.

Laura MacCree

REPRESENTATIVE

TITLE

DAVE SATO

INSPECTOR

DAY OR NIGHT
TELEPHONE
(510) 235-1393

CERTIFICATE CERTIFIED SERVICES COMPANY

255 Parr Boulevard • Richmond, California 94801

NO. 35619

CUSTOMER
JOB NO. 5240397
ADVANCED GEO ENV

FOR: ECOLOGY CONTROL IND. TANK NO. 28078

LOCATION: RICHMOND, CA DATE: 5/5/2000 TIME: 10:29:42

TEST METHOD VISUAL GASTECH/1314 SMPN LAST PRODUCT UO

This is to certify that I have personally determined that this tank is in accordance with the American Petroleum Institute and have found the condition to be in accordance with its assigned designation. This certificate is based on conditions existing at the time the inspection herein set forth was completed and is issued subject to compliance with all qualifications and instructions.

TANK SIZE 1,000 Gal. Tank CONDITION SAFE FOR FIRE

REMARKS: OXYGEN 20.9% LOWER EXPLOSIVE LIMIT LESS THAN 0.1% ECOLOGY CONTROL INDUSTRIES
HERBY CERTIFIES THAT THE ABOVE NUMBERED TANK HAS BEEN CUT OPEN, PROCESSED,
AND THEREFORE DESTROYED AT OUR PERMITTED HAZARDOUS WASTE FACILITY.
ECOLOGY CONTROL INDUSTRIES HAS THE APROPRIATE PERMITS FOR, AND HAS ACCEPTED
THE TANK SHIPPED TO US FOR PROCESSING.

In the event of any physical or atmospheric changes affecting the gas-free conditions of the above tanks, or if in any doubt, immediately stop all hot work and contact the undersigned. This permit is valid for 24 hours if no physical or atmospheric changes occur.

STANDARD SAFETY DESIGNATION

SAFE FOR MEN: Means that in the compartment or space so designated (a) The oxygen content of the atmosphere is at least 19.5 percent by volume; and that (b) Toxic materials in the atmosphere are within permissible concentrations; and (c) In the judgment of the Inspector, the residues are not capable of producing toxic materials under existing atmospheric conditions while maintained as directed on the Inspector's certificate.

SAFE FOR FIRE: Means that in the compartment so designated (a) The concentration of flammable materials in the atmosphere is below 10 percent of the lower explosive limit; and that (b) In the judgment of the Inspector, the residues are not capable of producing a higher concentration than permitted under existing atmospheric conditions in the presence of fire and while maintained as directed on the Inspector's certificate, and further, (c) All adjacent spaces have either been cleaned sufficiently to prevent the spread of fire, are satisfactorily inerted, or in the case of fuel tanks, have been treated as deemed necessary by the Inspector.

The undersigned representative acknowledges receipt of this certificate and understands the conditions and limitations under which it was issued.

Herby M. Alvarez
REPRESENTATIVE

TITLE

DAVE SATO
INSPECTOR



EXCAVATION PERMIT

TO EXCAVATE IN STREETS OR OTHER SPECIFIED WORK

CIVIL
ENGINEERING

PAGE 2 of 2

PERMIT NUMBER X0000017		SITE ADDRESS/LOCATION 4030 41ST AV
APPROX. START DATE	APPROX. END DATE	24-HOUR EMERGENCY PHONE NUMBER (Permit not valid without 24-Hour number)
CONTRACTOR'S LICENSE # AND CLASS		CITY BUSINESS TAX #

ATTENTION:

1) State law requires that the contractor/owner call *Underground Service Alert (USA)* two working days before excavating. This permit is not valid unless applicant has secured an inquiry identification number issued by USA. The USA telephone number is 1 (800) 642-2444. UNDERGROUND SERVICE ALERT (USA) #: _____

2) **48 hours prior to starting work, YOU MUST CALL (510) 238-3651 TO SCHEDULE AN INSPECTION.**

OWNER/BUILDER

I hereby affirm that I am exempt from the Contractor's License Law for the following reason (Sec. 7031.5 Business and Professions Code: Any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he is licensed pursuant to the provisions of the Contractor's License law Chapter 9 (commencing with Sec. 7000) of Division 3 of the Business and Professions Code, or that he is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than \$500):

I, as an owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business Professions Code: The Contractor's License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or through his own employees, provided that such improvements are not intended or offered for sale. If however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he did not build or improve for the purpose of sale).

I, as owner of the property, am exempt from the sale requirements of the above due to: (1) I am improving my principal place of residence or appurtenances thereto, (2) the work will be performed prior to sale, (3) I have resided in the residence for the 12 months prior to completion of the work, and (4) I have not claimed exemption on this subdivision on more than two structures more than once during any three-year period. (Sec. 7044 Business and Professions Code).

I, as owner of the property, am exclusively contracting with licensed contractors to construct the project, (Sec. 7044, Business and Professions Code: The Contractor's License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractor's License law).

I am exempt under Sec. _____, B&PC for this reason _____

WORKER'S COMPENSATION

I hereby affirm that I have a certificate of consent to self-insure, or a certificate of Worker's Compensation Insurance, or a certified copy thereof (Sec. 3700, Labor Code).

Policy # _____ Company Name _____

I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the Worker's Compensation Laws of California (not required for work valued at one hundred dollars (\$100) or less).

NOTICE TO APPLICANT: If, after making this Certificate of Exemption, you should become subject to the Worker's Compensation provisions of the Labor Code, you must forthwith comply with such provisions or this permit shall be deemed revoked. This permit is issued pursuant to all provisions of Title 12 Chapter 12.12 of the Oakland Municipal Code. It is granted upon the express condition that the permittee shall be responsible for all claims and liabilities arising out of work performed under the permit or arising out of permittee's failure to perform the obligations with respect to street maintenance. The permittee shall, and by acceptance of the permit agrees to defend, indemnify, save and hold harmless the City, its officers and employees, from and against any and all suits, claims, or actions brought by any person for or on account of any bodily injuries, disease or illness or damage to persons and/or property sustained or arising in the construction of the work performed under the permit or in consequence of permittee's failure to perform the obligations with respect to street maintenance. This permit is void 90 days from the date of issuance unless an extension is granted by the Director of the Office of Planning and Building.

I hereby affirm that I am licensed under provisions of Chapter 9 of Division 3 of the Business and Professions Code and my license is in full force and effect (if contractor), that I have read this permit and agree to its requirements, and that the above information is true and correct under penalty of law.

Signature of Permittee: *[Signature]* Date: 1-5-00

Agent for Contractor Owner

DATE STREET LAST RESURFACED	SPECIAL PAVING DETAIL REQUIRED? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	HOLIDAY RESTRICTION? (NOV 1 - JAN 1) <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	LIMITED OPERATION AREA? (7AM-9AM & 4PM-6PM) <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
ISSUED BY: <u><i>[Signature]</i></u>		DATE ISSUED: <u>1-5-00</u>	