

202448



SVLG

SILICON VALLEY LAW GROUP

A LAW CORPORATION

Jeffrey S. Lawson

jsl@svlg.com

March 1, 2004

Via Facsimile & U.S. Mail

Alameda County

MAR 04 2004

Environmental Health

Donna L. Drogos
LOP Program Manager
Environmental Health Services
Environmental Protection
1131 Harbor Bay Parkway, Ste. 250
Alameda CA 94502-6577

Re: Sunol Tree Gas Station: 3004 Andrade Road, Sunol, CA
Fuel Leak Case No.: RO0002448
Treatment System Test of February 17, 2004

Dear Ms. Drogos:

I am pleased to present the analytical sampling data of the treatment system installed at the T-Bear Ranch in accordance with paragraph 4 of your letter of October 31, 2003. Pursuant to your directive, Sunol Tree Gas Station was to collect water samples from the influent to vessel one, between the vessels, and the final discharge point every three weeks. Attached to this letter are the Sequoia Analytical results as Exhibit 1; a diagram of the system as Exhibit 2; and a photograph of the system as Exhibit 3.

The next test will take place on Tuesday, March 9, 2004 between 10 a.m. and 10:30 a.m.

Your Department's cooperation with the Sunol Tree Gas Station is appreciated.

Very truly yours,
Silicon Valley Law Group

JEFFREY S. LAWSON

JSL/lt

Enclosures: Exhibit 1 – Sequoia Analytical Results for 2/17/04
Exhibit 2 – Diagram
Exhibit 3 – Photograph

Cc: Pat Hoban
Murray Kelsoe



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

February 28 , 2004

Alameda County

MAR 04 2004

Environmental Health

Murray Kelsoe
Murray Kelsoe
PO Box 176
Alamo, CA 94507

RE: 3004 Andrade Road, Sunol
Work Order: MNB0506

Enclosed are the results of analyses for samples received by the laboratory on 02/17/04. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Leticia Reyes
Project Manager

CA ELAP Certificate Number 1210



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoc
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoc

MNB0506
Reported:
02/28/04 11:11

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
Infl	MNB0506-01	Water	02/17/04 10:58	02/17/04 15:15
Mid	MNB0506-02	Water	02/17/04 11:07	02/17/04 15:15
Eff	MNB0506-03	Water	02/17/04 11:12	02/17/04 15:15



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Gasoline\BTEX\Oxygenates by EPA method 8260B Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Infl (MNB0506-01) Water Sampled: 02/17/04 10:58 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		107 %	60-140		"	"	"	"	
Surrogate: 4-BFB		97 %	60-140		"	"	"	"	
Surrogate: 1,2-DCA-d4		100 %	60-140		"	"	"	"	
Mid (MNB0506-02) Water Sampled: 02/17/04 11:07 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	1.8	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		108 %	60-140		"	"	"	"	
Surrogate: 4-BFB		92 %	60-140		"	"	"	"	
Surrogate: 1,2-DCA-d4		110 %	60-140		"	"	"	"	

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Gasoline\BTEX\Oxygenates by EPA method 8260B

Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Eff (MNB0506-03) Water Sampled: 02/17/04 11:12 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		104 %	60-140	"	"	"	"	"	
Surrogate: 4-BFB		95 %	60-140	"	"	"	"	"	
Surrogate: 1,2-DCA-d4		101 %	60-140	"	"	"	"	"	



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Gasoline\BTEX\Oxygenates by EPA method 8260B - Quality Control Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 4020361 - EPA 5030B (P/T)

Blank (4020361-BLK1)

Prepared: 02/26/04 Analyzed: 02/27/04

Ethanol	ND	50	ug/l							
Tert-butyl alcohol	ND	5.0	"							
Methyl tert-butyl ether	ND	0.50	"							
Di-isopropyl ether	ND	0.50	"							
Ethyl tert-butyl ether	ND	0.50	"							
Tert-amyl methyl ether	ND	0.50	"							
1,2-Dichloroethane	ND	0.50	"							
1,2-Dibromooctane (EDB)	ND	0.50	"							
Benzene	ND	0.50	"							
Ethylbenzene	ND	0.50	"							
Toluene	ND	0.50	"							
Xylenes (total)	ND	0.50	"							
Gasoline Range Organics	ND	50	"							
Surrogate: Toluene-d8	26.4		"	25.0		106	60-140			
Surrogate: 4-BFB	24.0		"	25.0		96	60-140			
Surrogate: 1,2-DCA-d4	25.2		"	25.0		101	60-140			

Laboratory Control Sample (4020361-BS2)

Prepared: 02/26/04 Analyzed: 02/27/04

Methyl tert-butyl ether	5.32	0.50	ug/l	4.96		107	60-140			
Benzene	3.52	0.50	"	3.20		110	70-130			
Toluene	18.3	0.50	"	14.8		124	70-130			
Gasoline Range Organics	191	50	"	220		87	70-130			
Surrogate: Toluene-d8	26.0		"	25.0		104	60-140			
Surrogate: 4-BFB	23.5		"	25.0		94	60-140			
Surrogate: 1,2-DCA-d4	25.2		"	25.0		101	60-140			

Laboratory Control Sample Dup (4020361-BSD2)

Prepared: 02/26/04 Analyzed: 02/27/04

Methyl tert-butyl ether	4.83	0.50	ug/l	4.96		97	60-140	10	25	
Benzene	2.74	0.50	"	3.20		86	70-130	25	25	
Toluene	16.7	0.50	"	14.8		113	70-130	9	25	
Gasoline Range Organics	164	50	"	220		75	70-130	15	25	
Surrogate: Toluene-d8	25.7		"	25.0		103	60-140			
Surrogate: 4-BFB	25.1		"	25.0		100	60-140			
Surrogate: 1,2-DCA-d4	28.3		"	25.0		113	60-140			

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Gasoline\BTEX\Oxygenates by EPA method 8260B - Quality Control Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 4020361 - EPA 5030B [P/T]

Matrix Spike (4020361-MS1)	Source: MNB0506-01	Prepared: 02/26/04	Analyzed: 02/27/04	QM-09				
Methyl tert-butyl ether	22.3	0.50	ug/l	20.0	ND	112	60-140	
Benzene	22.2	0.50	"	20.0	ND	111	70-130	
Toluene	20.8	0.50	"	20.0	ND	104	70-130	
Surrogate: Toluene-d8	26.1		"	25.0		104	60-140	
Surrogate: 4-BFB	23.4		"	25.0		94	60-140	
Surrogate: 1,2-DCA-d4	23.2		"	25.0		93	60-140	



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Notes and Definitions

- QM-09 A matrix spike and/or matrix spike duplicate could not be performed due to insufficient sample amount.
- DET Analyte DETECTED
- ND Analyte NOT DETECTED at or above the reporting limit
- NR Not Reported
- dry Sample results reported on a dry weight basis
- RPD Relative Percent Difference



**SEQUOIA ANALYTICAL
CHAIN OF CUSTODY**

- 885 Jarvis Drive • Morgan Hill, CA 95037 • (408) 776-9600 • FAX (408) 782-6308
- 1455 McDowell Blvd, Suite D. • Petaluma, CA 94954 • (707) 792-1865 • FAX (707) 792-0342
- 819 Striker Ave., Suite 8 • Sacramento, CA 95834 • (916) 921-9600 • FAX (916) 921-0100
- 404 N. Wiget Lane • Walnut Creek, CA 94598 • (925) 988-9600 • FAX (925) 988-9673

NO. 923

Company Name: Murray Kelsoe Project: 3009 Andrade Rd, Sunol
 Mailing Address: 3009 Andrade Rd Billing Address (if different):
 City: Sunol State: CA Zip Code: 94586
 Telephone: 925-862-2288 Fax #:
 Report To: E-mail Address: QC Data: Level II (standard) Level III Level IV
 Sampler: Date / Time Results Required: Sequoia's Work Order # MNR0506

- Turnaround Time:
 10-15 Working Days (Standard TAT)
 7 Working Days
 5 Working Days
 72 Hours
 48 Hours
 24 Hours
 2-8 Hours

- MANDATORY:**
 SDWA (Drinking Water)
 CWA (Waste Water)
 RCRA (Hazardous Waste)
 Other

ANALYSES REQUESTED (Please provide method)


Client Sample I.D.	Date / Time Sampled	Matrix Desc.	# of Cont.	Container Type	Sequoia's Sample #	TPH-G	BTOH	BTEX	MTBE	TAME	DLX5	TBA	Comments/Temp. (if required)
1. <u>FAA</u>	<u>2/17/04 10:58</u>		<u>3</u>		<u>01</u>								<u>paid \$495</u>
2. <u>mid</u>	<u>2/17/04 11:07</u>		<u>3</u>		<u>02</u>								<u>Cash</u>
3. <u>FAA</u>	<u>2/17/04 11:12</u>		<u>3</u>		<u>03</u>								<u>Foltcher</u>
4.													
5.													
6.													
7.													
8.													
9.													
10.													

SAMPLING

Relinquished by / Co.: [Signature] Received by / Co.: Nelen Date / Time / Temp.: 2/17/04 1515
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:

Were Samples Received in Good Condition? Yes No Samples on Ice? Yes No Method of Shipment: _____ Page _____ of _____

MAR. 1. 2004 11:24AM

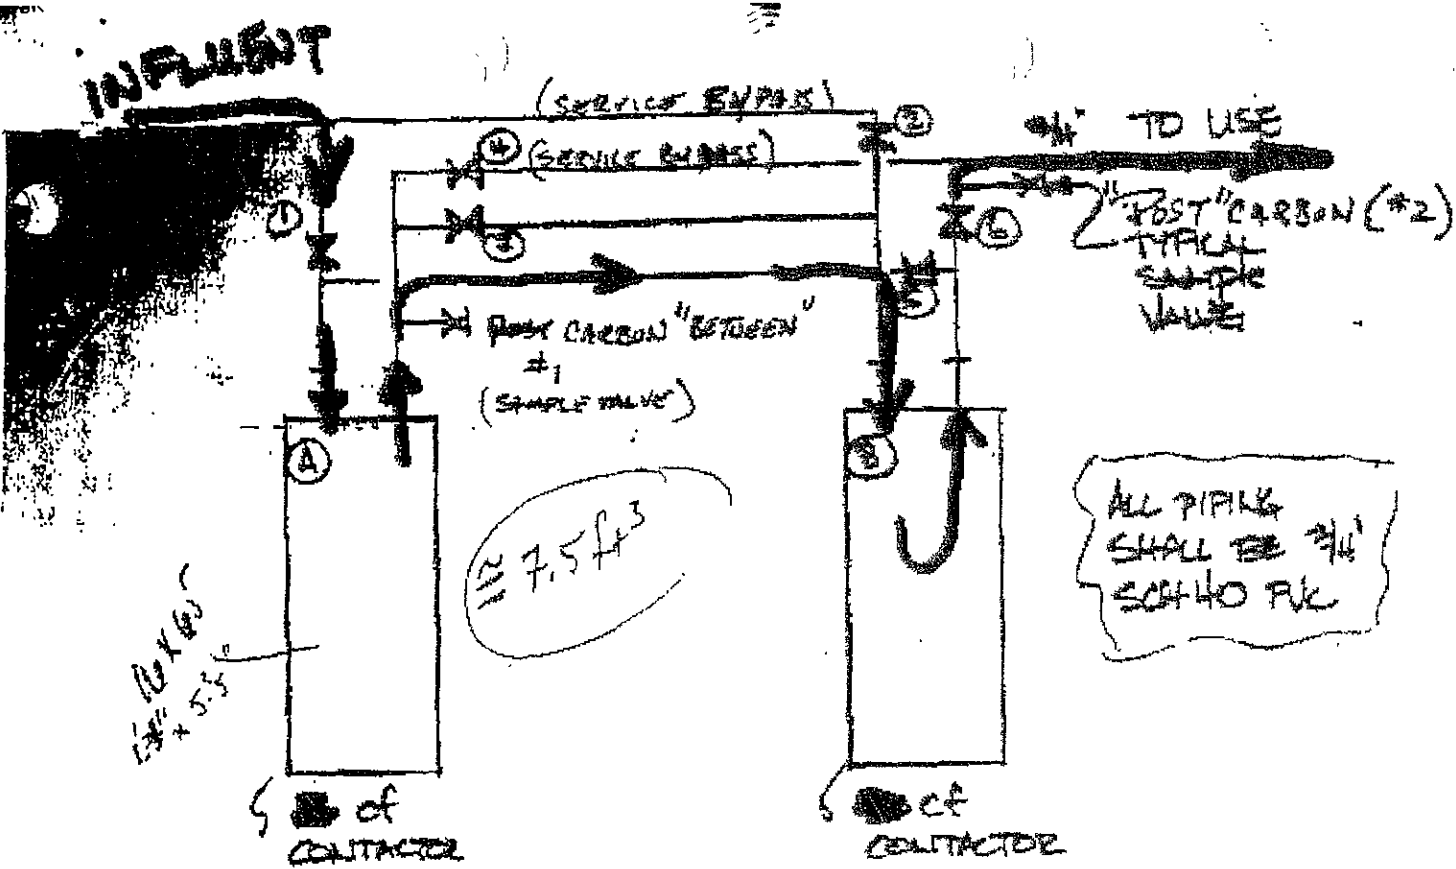


NOTES

Fill each contactor with of Hill of ~~California from the top to bottom~~

SCENARIO	VALVE POSITIONS					
	1	2	3	4	5	6
1. NORMAL, THRU (1), THEN (2)	0	X	0	X	X	0
2. SERVICE (BYPASS) (2)	X	0	X	X	X	0
3. THRU (3), THEN THRU (4)	X	0	X	0	0	X
4. SERVICE (BYPASS) (4)	0	X	X	0	X	X

	ENGR		7/10/20
	CHECK		
	Page 2 of 2		

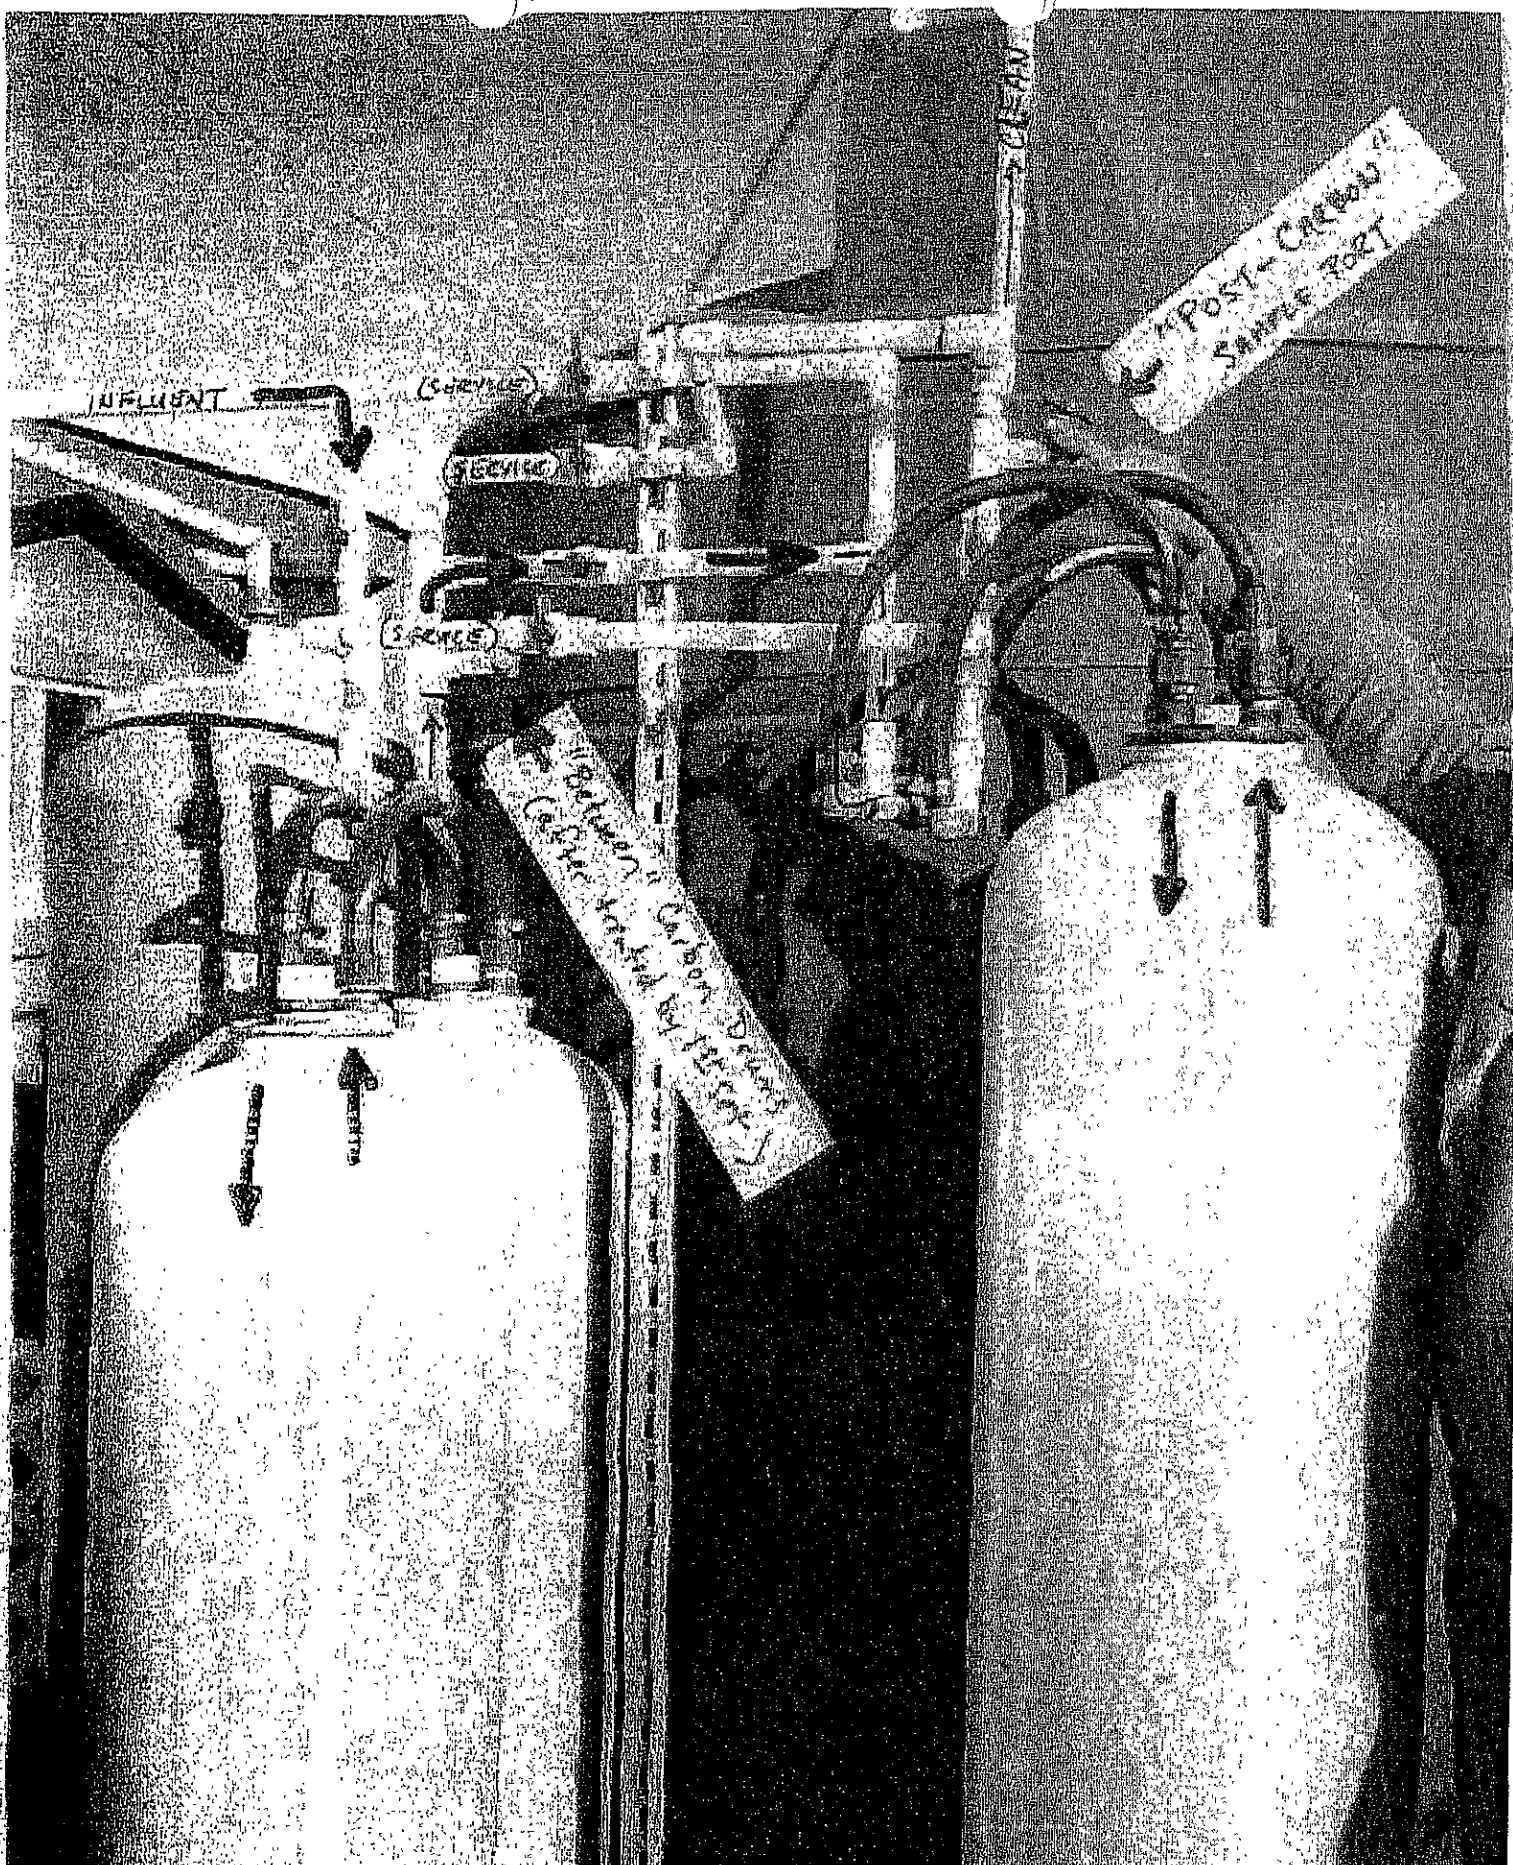

SILICON VALLEY LAW GROUP
A LAW CORPORATION

152 NORTH THIRD STREET
SUITE 900
SAN JOSE, CA 95112

TELEPHONE: (408) 288-8100
FACSIMILE: (408) 288-1400
www.svlg.com

FACSIMILE COVER SHEET

DATE: March 1, 2004
TO: Donna L. Drogos
FROM: Lisa Tornquist, Paralegal to Jeff Lawson
RE: Fuel Leak Case No. R02448/Sunol Tree Gas Station
FACSIMILE NO.: 510-337-9335 **TELEPHONE NO.:** 510-567-6700

Number of pages including Facsimile Cover Sheet: 11

COMMENTS: Please refer to the attached letter of today's date.

PRIVILEGED AND CONFIDENTIAL information intended only for the use of the addressee(s) named above. If the reader of this message is not the intended recipient or the employee or agent responsible for delivering the message to the intended recipient(s), please note that any dissemination, distribution or copying of this communication is strictly prohibited. Anyone who receives this communication in error should notify this office immediately by telephone and return the original message to this office at the above address via U.S. Mail.

**SVLG****SILICON VALLEY LAW GROUP**

A LAW CORPORATION

Jeffrey S. Lawson

jsl@svlg.com

March 1, 2004

Via Facsimile & U.S. Mail

Donna L. Drogos
LOP Program Manager
Environmental Health Services
Environmental Protection
1131 Harbor Bay Parkway, Ste. 250
Alameda CA 94502-6577

Re: Sunol Tree Gas Station: 3004 Andrade Road, Sunol, CA
Fuel Leak Case No.: RO0002448
Treatment System Test of February 17, 2004

Dear Ms. Drogos:

I am pleased to present the analytical sampling data of the treatment system installed at the T-Bear Ranch in accordance with paragraph 4 of your letter of October 31, 2003. Pursuant to your directive, Sunol Tree Gas Station was to collect water samples from the influent to vessel one, between the vessels, and the final discharge point every three weeks. Attached to this letter are the Sequoia Analytical results as Exhibit 1; a diagram of the system as Exhibit 2; and a photograph of the system as Exhibit 3.

The next test will take place on Tuesday, March 9, 2004 between 10 a.m. and 10:30 a.m.

Your Department's cooperation with the Sunol Tree Gas Station is appreciated.

Very truly yours,
Silicon Valley Law Group



JEFFREY S. LAWSON

JSL/lt

Enclosures: Exhibit 1 – Sequoia Analytical Results for 2/17/04
Exhibit 2 – Diagram
Exhibit 3 – Photograph

Cc: Pat Hoban
Murray Kelsoe



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialab.com

February 28 , 2004

Murray Kelsoe
Murray Kelsoe
PO Box 176
Alamo, CA 94507

RE: 3004 Andrade Road, Sunol
Work Order: MNB0506

Enclosed are the results of analyses for samples received by the laboratory on 02/17/04. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink, appearing to read "Leticia Reyes".

Leticia Reyes
Project Manager

CA ELAP Certificate Number 1210



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsos
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsos

MNB0506
Reported:
02/28/04 11:11

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
Infl	MNB0506-01	Water	02/17/04 10:58	02/17/04 15:15
Mid	MNB0506-02	Water	02/17/04 11:07	02/17/04 15:15
Eff	MNB0506-03	Water	02/17/04 11:12	02/17/04 15:15

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9600
FAX (408) 782-6308
www.sequoiainas.com

Murray Kelsos PO Box 176 Alamo CA, 94507	Project: 3004 Andrade Road, Sanol Project Number: - Project Manager: Murray Kelsos	MNB0506 Reported: 02/28/04 11:11
------------------------------------------------	------------------------------------------------------------------------------------------	----------------------------------------

Gasoline\BTEX\Oxygenates by EPA method 8260B Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Inf (MNB0506-01) Water Sampled: 02/17/04 10:58 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		107 %	60-140		"	"	"	"	
Surrogate: 4-BFB		97 %	60-140		"	"	"	"	
Surrogate: 1,2-DCA-d4		100 %	60-140		"	"	"	"	
Mid (MNB0506-02) Water Sampled: 02/17/04 11:07 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	1.8	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		108 %	60-140		"	"	"	"	
Surrogate: 4-BFB		92 %	60-140		"	"	"	"	
Surrogate: 1,2-DCA-d4		110 %	60-140		"	"	"	"	

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 775-9600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe PO Box 176 Alamo CA, 94507	Project: 3004 Andrade Road, Sunol Project Number: - Project Manager: Murray Kelsoe	MNB0506 Reported: 02/28/04 11:11
------------------------------------------------	------------------------------------------------------------------------------------------	----------------------------------------

Gasoline\BTEX\Oxygenates by EPA method 8260B
Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
EFF (MNB0506-03) Water Sampled: 02/17/04 11:12 Received: 02/17/04 15:15									
Ethanol	ND	50	ug/l	1	4020361	02/26/04	02/27/04	EPA 8260B	
Tert-butyl alcohol	ND	5.0	"	"	"	"	"	"	
Methyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Di-isopropyl ether	ND	0.50	"	"	"	"	"	"	
Ethyl tert-butyl ether	ND	0.50	"	"	"	"	"	"	
Tert-amyl methyl ether	ND	0.50	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.50	"	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	
Benzene	ND	0.50	"	"	"	"	"	"	
Ethylbenzene	ND	0.50	"	"	"	"	"	"	
Toluene	ND	0.50	"	"	"	"	"	"	
Xylenes (total)	ND	0.50	"	"	"	"	"	"	
Gasoline Range Organics	ND	50	"	"	"	"	"	"	
Surrogate: Toluene-d8		104 %	ug/l	60-140	"	"	"	"	
Surrogate: 4-BFB		95 %	ug/l	60-140	"	"	"	"	
Surrogate: 1,2-DCA-d4		101 %	ug/l	60-140	"	"	"	"	



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-6600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoc PO Box 176 Alamo CA, 94507	Project: 3004 Andrade Road, Sunol Project Number: - Project Manager: Murray Kelsoc	MNB0506 Reported: 02/28/04 11:11
------------------------------------------------	------------------------------------------------------------------------------------------	----------------------------------------

Gasoline\BTEX\Oxygenates by EPA method 8260B - Quality Control Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	------------	-----	-----------	-------

Batch 4020361 - EPA 5030B [P/T]

Blank (4020361-BLK1) Prepared: 02/26/04 Analyzed: 02/27/04										
Ethanol	ND	50	ug/l							
Tert-butyl alcohol	ND	5.0	"							
Methyl tert-butyl ether	ND	0.50	"							
Di-isopropyl ether	ND	0.50	"							
Ethyl tert-butyl ether	ND	0.50	"							
Tert-amyl methyl ether	ND	0.50	"							
1,2-Dichloroethane	ND	0.50	"							
1,2-Dibromoethane (EDB)	ND	0.50	"							
Benzene	ND	0.50	"							
Ethylbenzene	ND	0.50	"							
Toluene	ND	0.50	"							
Xylenes (total)	ND	0.50	"							
Gasoline Range Organics	ND	50	"							
Surrogate: Toluene-d8	26.4		"	25.0		106	60-140			
Surrogate: 4-BFB	24.0		"	25.0		96	60-140			
Surrogate: 1,2-DCA-d4	25.2		"	25.0		101	60-140			

Laboratory Control Sample (4020361-BS2) Prepared: 02/26/04 Analyzed: 02/27/04										
Methyl tert-butyl ether	5.32	0.50	ug/l	4.96		107	60-140			
Benzene	3.52	0.50	"	3.20		110	70-130			
Toluene	18.3	0.50	"	14.8		124	70-130			
Gasoline Range Organics	191	50	"	220		87	70-130			
Surrogate: Toluene-d8	26.0		"	25.0		104	60-140			
Surrogate: 4-BFB	23.5		"	25.0		94	60-140			
Surrogate: 1,2-DCA-d4	25.2		"	25.0		101	60-140			
Laboratory Control Sample Dup (4020361-BS2) Prepared: 02/26/04 Analyzed: 02/27/04										
Methyl tert-butyl ether	4.83	0.50	ug/l	4.96		97	60-140	10	25	
Benzene	2.74	0.50	"	3.20		86	70-130	25	25	
Toluene	16.7	0.50	"	14.8		113	70-130	9	25	
Gasoline Range Organics	164	50	"	220		75	70-130	15	25	
Surrogate: Toluene-d8	25.7		"	25.0		103	60-140			
Surrogate: 4-BFB	25.1		"	25.0		100	60-140			
Surrogate: 1,2-DCA-d4	28.3		"	25.0		113	60-140			

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

885 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-9500
FAX (408) 732-6908
www.sequoialabs.com

Murray Kelsoc PO Box 176 Alamo CA, 94507	Project: 3004 Andrade Road, Sumol Project Number: - Project Manager: Murray Kelsoc	MNB0506 Reported: 02/28/04 11:11
------------------------------------------------	------------------------------------------------------------------------------------------	----------------------------------------

Gasoline\BTEX\Oxygenates by EPA method 8260B - Quality Control Sequoia Analytical - Sacramento

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 4020361 - EPA 5030B [P/T]

Matrix Spike (4020361-MS1)	Source: MNB0506-01	Prepared: 02/26/04	Analyzed: 02/27/04	QM-09					
Methyl tert-butyl ether	22.3	0.50	ug/l	20.0	ND	112	60-140		
Benzene	22.2	0.50	"	20.0	ND	111	70-130		
Toluene	20.8	0.50	"	20.0	ND	104	70-130		
Surrogate: Toluene-d8	26.1		"	25.0		106	60-140		
Surrogate: 4-BFB	23.4		"	23.0		99	60-140		
Surrogate: 1,3-DCA-d4	23.2		"	23.0		99	60-140		

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



Sequoia Analytical

555 Jarvis Drive
Morgan Hill, CA 95037
(408) 776-5600
FAX (408) 782-6308
www.sequoialabs.com

Murray Kelsoe
PO Box 176
Alamo CA, 94507

Project: 3004 Andrade Road, Sunol
Project Number: -
Project Manager: Murray Kelsoe

MNB0506
Reported:
02/28/04 11:11

Notes and Definitions

QM-09 A matrix spike and/or matrix spike duplicate could not be performed due to insufficient sample amount.

DET Analyte DETECTED

ND Analyte NOT DETECTED at or above the reporting limit

NR Not Reported

dry Sample results reported on a dry weight basis

RPD Relative Percent Difference

Sequoia Analytical - Morgan Hill

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.



SEQUOIA ANALYTICAL CHAIN OF CUSTODY

- 885 Jarvis Drive • Morgan Hill, CA 95037 • (408) 776-9600 • FAX (408) 762-6308
- 1455 McDowell Blvd, Suite D • Petaluma, CA 94954 • (707) 792-1865 • FAX (707) 792-0342
- 819 Striker Ave., Suite B • Sacramento, CA 95834 • (916) 921-9600 • FAX (916) 921-0100
- 404 N. Wigal Lane • Walnut Creek, CA 94598 • (925) 988-9600 • FAX (925) 988-9673

T-725 P. 010/012 F-642

Company Name: MURRAY Kelson Project: 3009 Andrade Rd, Sunol
 Mailing Address: 3009 Andrade Rd Billing Address (if different):
 City: SUNOL State: Ca Zip Code: 94586
 Telephone: 925-862-2288 Fax #: P.O. #:
 Report To: E-mail Address: QC Data: Level II (standard) Level III Level IV
 Sampler: Date / Time Results Required: Sequoia's Work Order # MNR0506

Turnaround 10-15 Working Days 72 Hours
 Time: (Standard TAT) 48 Hours
 7 Working Days 24 Hours
 5 Working Days 2-8 Hours

- MANDATORY:**
- SDWA (Drinking Water)
 - CWA (Waste Water)
 - RCRA (Hazardous Waste)
 - Other

ANALYSES REQUESTED (Please provide method)

Client Sample I.D.	Date / Time Sampled	Matrix Desc.	# of Cont.	Container Type	Sequoia's Sample #	TPH-G	B10W	B5X MBE	TRME	D1X5	TBA	Comments/Temp. (if required)
1. <u>FAF</u>	<u>2/11/04 10:58</u>		<u>3</u>		<u>01</u>							<u>paid \$495</u>
2. <u>Mid</u>	<u>2/11/04 11:07</u>		<u>3</u>		<u>02</u>							<u>Cash</u>
3. <u>FAF</u>	<u>2/11/04 11:12</u>		<u>3</u>		<u>03</u>							<u>Folcher</u>
4.												
5.												
6.												
7.												
8.												
9.												
10.												

SAMPLING

Relinquished by / Co.: [Signature] Received by / Co.: Helen Date / Time / Temp.: 2/11/04 1515
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:
 Relinquished by / Co.: Received by / Co.: Date / Time / Temp.:


Were Samples Received in Good Condition? Yes No Samples on Ice? Yes No Method of Shipment: _____ Page ___ of ___

MAR-01-2004 02:33PM FROM-SILICON VALLEY LAW GROUP

White: Sequoia

Yellow: Sequoia

Pink: Client

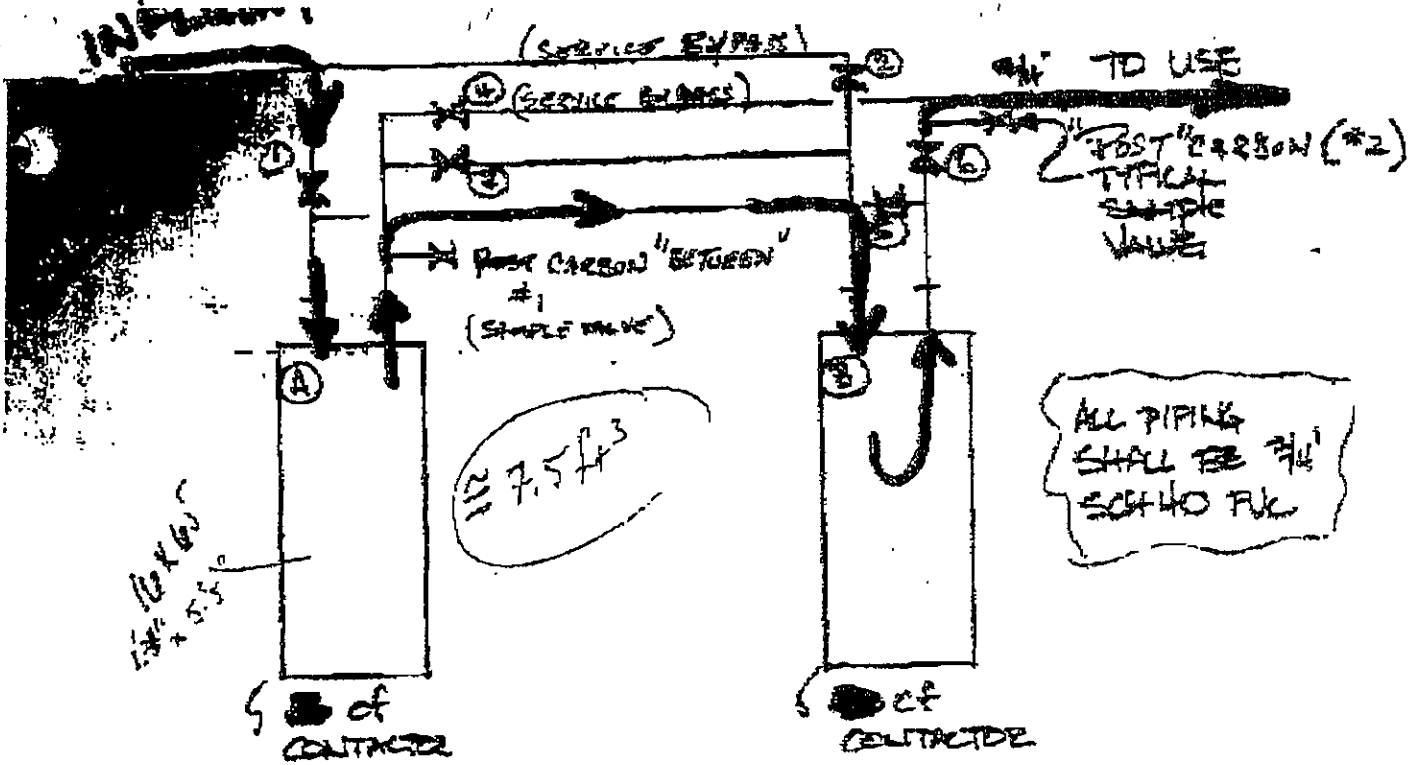


NOTES

FILL EACH CONTAINER WITH $\frac{1}{2}$ of HILL OF ~~COARSE FRACTION FOR~~

SCENARIO	VALVE POSITION					
	1	2	3	4	5	6
1. NORMAL, THEN ①, THEN ②	0	X	0	X	X	0
2. SERVICE (BYPASS) ④	X	0	X	X	X	0
3. THEN ⑤, THEN THEN ④	X	0	X	0	0	X
④ SERVICE (BYPASS) ③	0	X	X	0	X	X

[REDACTED]	ENGR	A. L. [REDACTED]	7/10/00
	CHECK		
	Page 2 of 2		

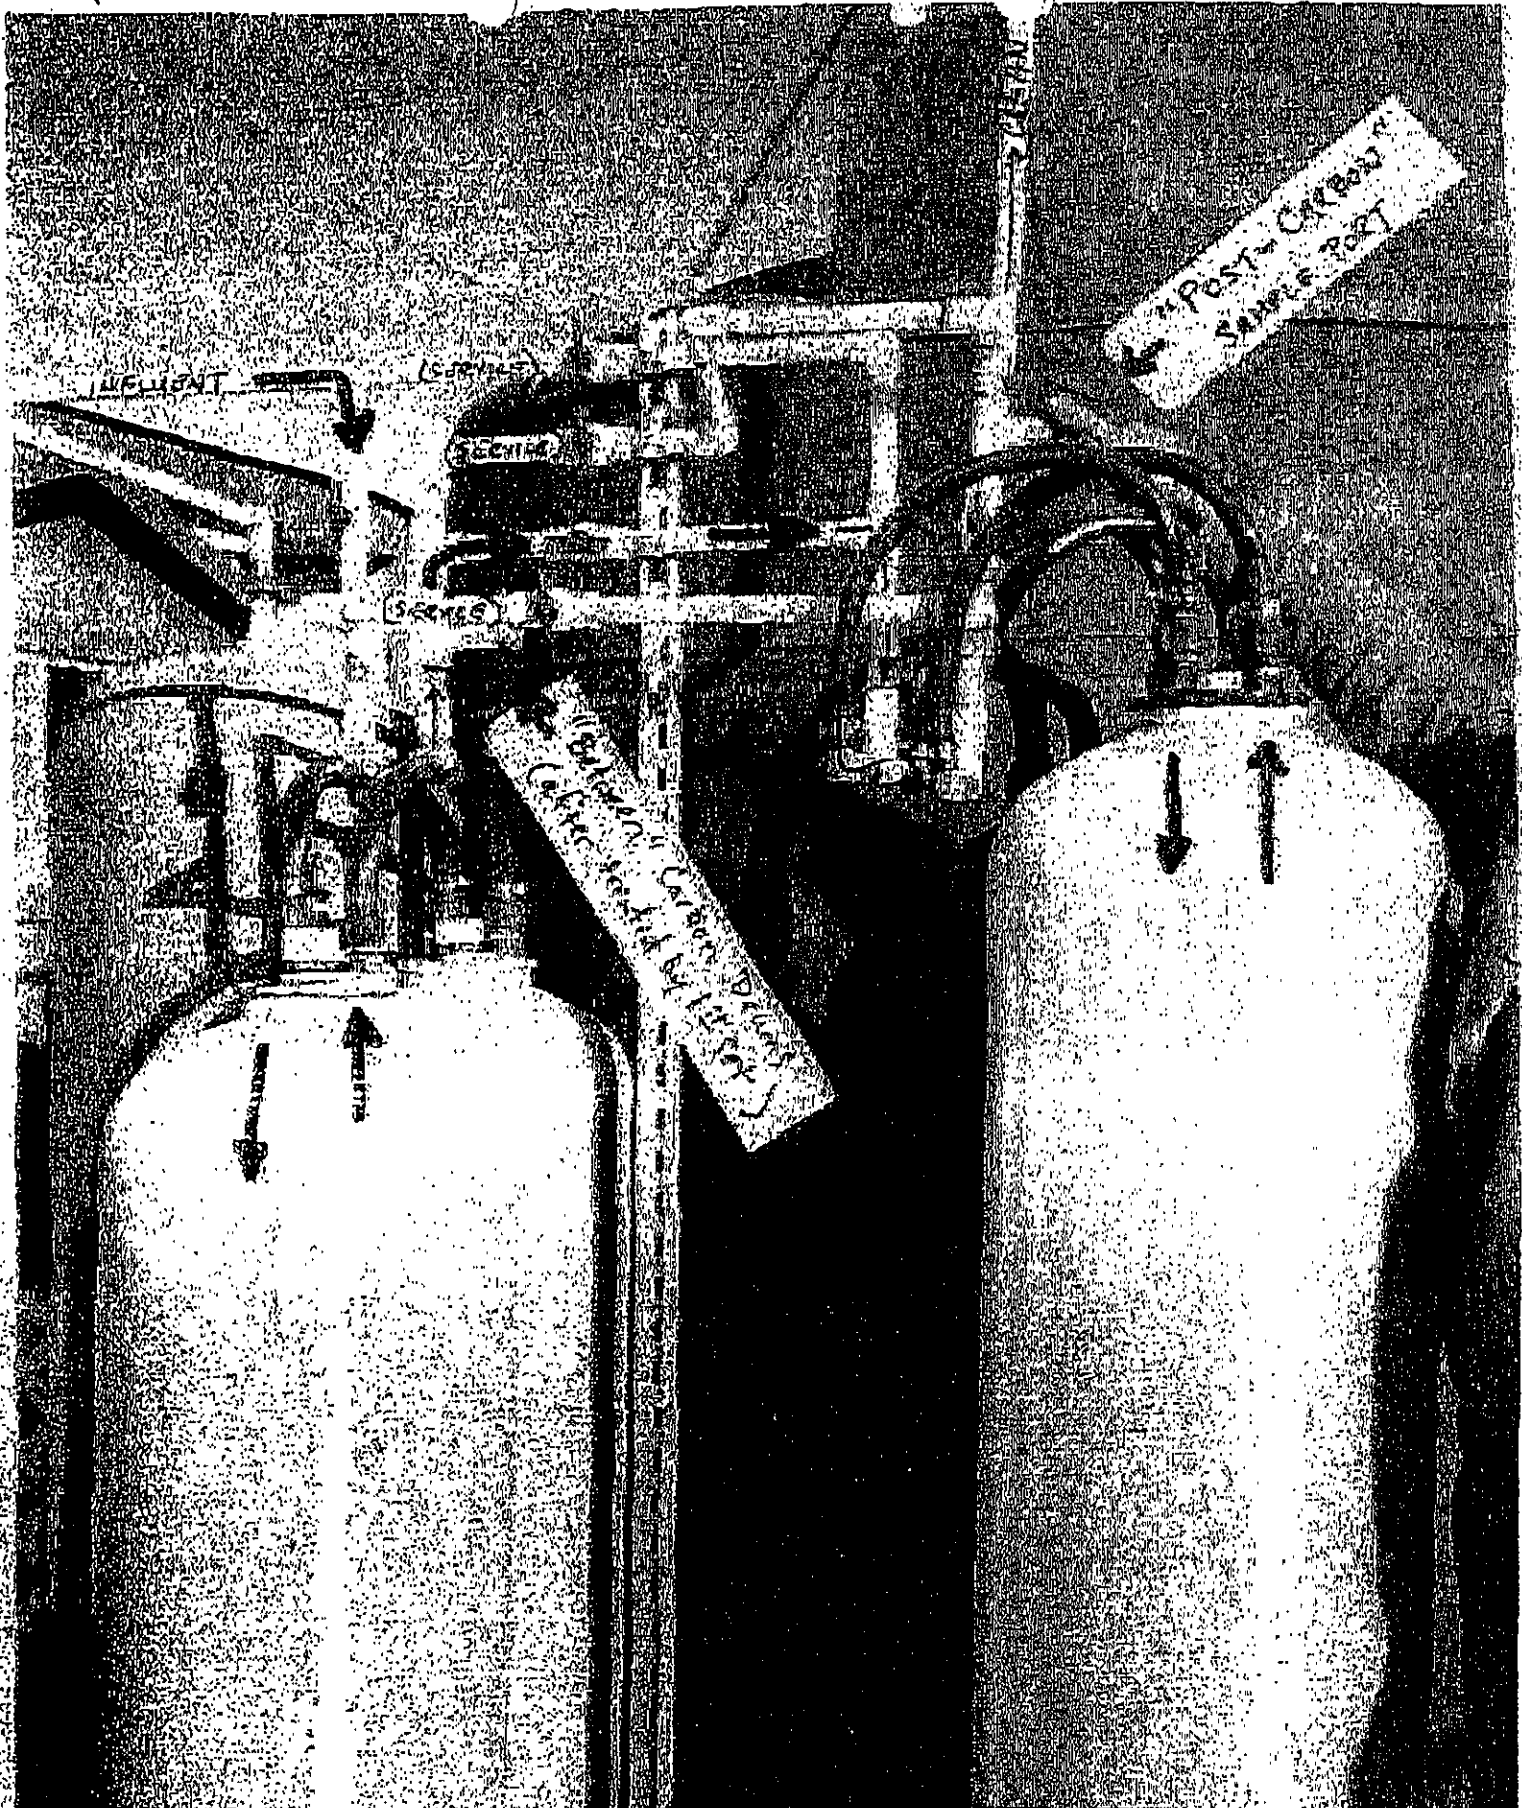

WATER PUMP - CONTROL
 SAMPLE POINT

WATER PUMP - CONTROL
 SAMPLE POINT