


Ac-4

AUG 10 RECD

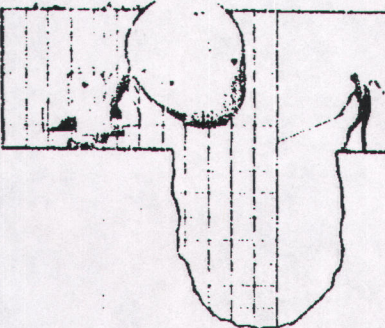

BLAINE TECH SERVICES INC.

1370 TULLY RD., SUITE 505
SAN JOSE, CA 95122
(408) 995-5535

RECEIVED
AUG 13 1987

July 28, 1987

ENVIRONMENTAL HEALTH
ADMINISTRATION

Handwritten signature/initials

Tank Excavators
P.O. Box 8402
Santa Cruz, CA 95061

Attention: Bob Smith

Re: Field sampling at

TRACT 5716
INDEPENDENCE WAY
ALAMEDA, CA

JULY 16, 1987

SAMPLING REPORT

Field sampling was undertaken in accordance with State and local enforcement agency standards and requirements for objective analytical information on the levels of residual contaminants found outside the primary containment structure. This project concerned the following:


Underground storage tank removal

Reason for removal -- discontinuation of on site storage

Type -- two 550 gallon gasoline

Condition -- good

Sampling was performed in accordance with approved methodology at the locations shown on the accompanying site diagram. Additional information is presented on the diagram including our field sampling designations and the lab identification numbers which reference the analytical results which will be found in the separate laboratory report. Sample material was collected in special containers appropriate to the type of analysis intended. Sample containers were sealed, chilled, and transported to the laboratory with standard chain of custody records maintained at each transmittal. This sampling report, the chain of custody, and the analytical report comprise the formal documentation of the sampling conducted during this phase of work at the site.

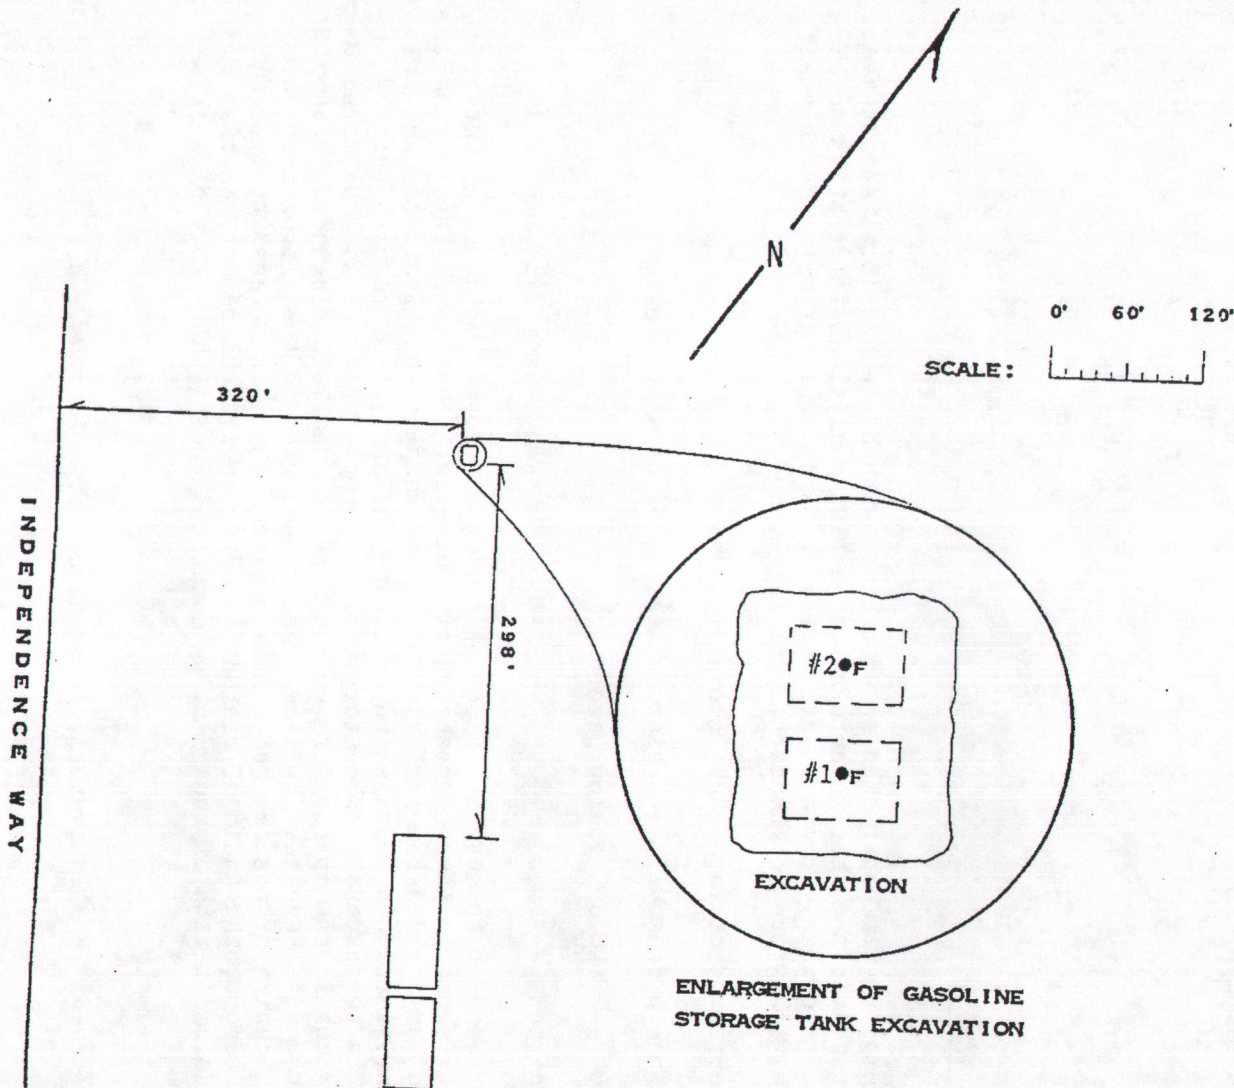

MAP REF: THOMAS BROS.
ALAMEDA COUNTY
P. 11 B-2

LEGEND: F = FILL END

- #1 SOIL FROM
ANALYSIS FOR TOTAL HYDROCARBONS
(THC) AS GASOLINE AT SEQUOIA
ANALYTICAL LABORATORY
SEQUOIA LAB NO. 7071082
- #2 SOIL FROM 6'
ANALYSIS FOR THC AS GASOLINE
SEQUOIA LAB NO. 7071083

SAMPLING PERFORMED BY
TIM BABCOCK
DIAGRAM PREPARED BY
BRENT E. ADAMS

REPORTAGE

Submission to the Regional Water Quality Control Board and the local regulatory/enforcement agency should include copies of the sampling report, the chain of custody, and the laboratory report. The property owner should attach a cover letter and submit all documents together in a package.


The following addresses have been listed here for your convenience:

Water Quality Control Board
San Francisco Bay Region
1111 Jackson Street
Room 6040
Oakland, CA 94607
ATTN: Tom Callaghan

Alameda County Health
Hazardous Materials Management
420 27th Street
Oakland, Ca 94612
ATTN: Ted Gerow

Alameda Fire Dept.
1300 Park Street
Alameda, CA 94501
ATTN: Marvin Helms

Please call if we can be of any further assistance.



Richard C. Blaine

cc: Marvin Helms

RCB/djt

BLAINE TECH SERVICES INC.

P.O. BOX 5745
SAN JOSE, CA 95150
(408) 723-3974



PROJECT NUMBER

SITE ADDRESS

87197-T1

Tank Excavator
Independence Wy.
Alameda, CA.

PLEASE INCLUDE PROJECT NUMBER AND SITE ADDRESS ON LAB REPORTS AND INVOICES

TURN-AROUND 1 week RESULTS BY _____ LAB USED SEQ

BILLING SPECIAL INSTRUCTIONS
 Bill Blaine Tech Services
 BILL _____

I.D.	TYPE	ANALYSIS TO DETECT	LAB #	LAB RESULTS
#1	soil	TPH gas		
#2	soil	TPH gas		

Field sampling completed 11:40 AM 7-16-87 performed by [Signature]

RELEASED BY [Signature] 1:39 AM 7-16-87 ACCEPTED BY [Signature] 1:10 AM 7-16-87
 : AM/PM - -87 : AM/PM - -87
 : AM/PM - -87 : AM/PM - -87