

**UNDERGROUND STORAGE TANK
CLOSURE REPORT
CALIFORNIA ARMY NATIONAL GUARD ARMORY
SAN LORENZO, CA**

Prepared for:

**Department of Defense
United States Army Engineer District, Sacramento District
Corps of Engineers
1325 J Street
Sacramento, CA 95814-2922**

Contract No. W91238-08-D-0008 Task 0006
AIS Project No. 30077

September 2010

Prepared by

 *American Integrated Services, Inc.*

1650 Palma Drive, Suite 207
Ventura, CA 93003

This page intentionally left blank.



**DEMOLITION/REMOVAL UNDERGROUND STORAGE TANK, PIPING, FUEL
ISLAND/DISPENSER
CLOSURE REPORT
CALIFORNIA ARMY NATIONAL GUARD ARMORY
SAN LORENZO, CA**

SIGNATURE SHEET

Prepared by:

Kelly Therrien
Staff Environmental Scientist
(805) 639-0884

Kelly Therrien 10/18/2010
Signature and Date

Reviewed by:

Kelly Stater
Vice President, Federal Programs
(805) 639-0884

Kelly Stater 10-18-2010
Signature and Date

Reviewed by:

Gary Runnells, P.G.
Vice President
(310) 522-1168

Gary Runnells 10-29-2010
Signature and Date



This page intentionally left blank.



TABLE OF CONTENTS

<u>ITEM</u>	<u>PAGE</u>
LIST OF ACRONYMS AND ABBREVIATIONS	iv
EXECUTIVE SUMMARY	v
1.0 INTRODUCTION	1
1.1 Facility Information.....	1
1.2 Entities Involved.....	1
1.3 UST Information	1
1.4 Site History and Characteristics	2
2.0 GEOLOGY AND HYDROGEOLOGY	3
2.1 Geology	3
2.2 Hydrogeology.....	3
3.0 FIELD ACTIVITIES	4
3.1 Permitting.....	4
3.2 Utility Clearance/Geophysical Survey	4
3.3 Tank Removal	4
3.4 Tank-Pit Sampling.....	5
3.5 Site Restoration	6
4.0 ANALYTICAL RESULTS	7
4.1 Laboratory Analysis Methods	7
4.2 Results and Interpretation of Laboratory Analysis.....	7
5.0 CONCLUSIONS AND RECOMMENDATIONS	9
6.0 LIMITATIONS.....	10

FIGURES

- Figure 1 – Site Location Map
- Figure 2 – Site Map
- Figure 3 – Confirmation Sampling Locations

TABLE

- Table 1A – Summary of Confirmation Results – TPH and VOCs
- Table 1B – Summary of Confirmation Results - Metals

APPENDICES

- Appendix A – UST Closure Permit
- Appendix B – Utility Clearance/Compaction Report
- Appendix C – Site Photographs
- Appendix D – UST Certificate of Destruction
- Appendix E – Laboratory and Quality Assurance/Quality Control (QA/QC) Reports and Chain-of-Custody Records
- Appendix F – Waste Manifests

LIST OF ACRONYMS AND ABBREVIATIONS

ACDEH	Alameda County Department of Environmental Health
AIS	American Integrated Services, Inc.
bgs	below ground surface
BTEX	benzene, toluene, ethylbenzene and total xylenes
CA ARNG	California Army National Guard
CAM/CCR	California Assessment Manual/California Code of Regulations
CUPA	Certified Unified Program Agency
1,2-DCA	1,2-dichloroethane
DIPE	di-isopropyl ether
DTSC	Department of Toxic Substances Control
1,2-EDB	1,2- ethylene dibromide
ELAP	Environmental Laboratory Accreditation Program
EPA	Environmental Protection Agency
ETBE	ethyl tertiary-butyl ether
ft	feet
IP	interphase probe
LEL	Lower Explosive Limit
mg/kg	milligrams per kilogram
µg/L	micrograms per liter
MTBE	methyl tertiary-butyl ether
OMS	Operations and Maintenance Service
QA/QC	quality assurance/quality control
SFBRWQCB	San Francisco Bay Regional Water Quality Control Board-Region 2
TAME	tertiary-amyl methyl ether
TBA	tertiary-butyl alcohol
TPHd	total petroleum hydrocarbons as diesel
TPHg	total petroleum hydrocarbons as gasoline
TPHmo	total petroleum hydrocarbons as motor oil
USA	Underground Service Alert
USACE	United States Army Corps of Engineers
UST	underground storage tank
VOC	volatile organic compound

EXECUTIVE SUMMARY

This Underground Storage Tank (UST) Closure Report details the removal activities of an underground storage tank (UST) and associated piping and fuel island/dispenser at California Army National Guard (CA ARNG) Armory, San Lorenzo, CA under contract with the United States Army Corps of Engineers (USACE).

San Lorenzo Armory (the Site) is located approximately 12 miles southeast of Oakland and approximately a ½-mile southwest of the City of Ashland. The Site is a 2-acre parcel located at the northeastern corner of the San Lorenzo High School located in San Lorenzo in Alameda County, CA. The Site was established in 1947 at the address of 16501 Ashland Avenue.

The UST stored red diesel used to fuel the armory's vehicles. The 5,000-gallon tank was installed in the late 1990s. It was a double-walled, fiberglass coated steel UST. It measured approximately 8 feet (ft) in diameter and 14 ft long. As part of this scope of work, American Integrated Services, Inc. (AIS) properly removed the UST as well as the piping and fuel island/dispenser. The details of the UST removal are reported herein.

The UST removal included the following activities:

- Geophysical survey to determine the approximate size and location of the UST as well as possible utilities on the property in the vicinity of the UST and the fuel island/dispenser;
- Removal of UST, piping, fuel island/dispenser and Total Petroleum Hydrocarbon (TPH) -impacted soil;
- Soil and groundwater confirmation sampling; and
- Backfill and compaction of UST pit using clean fill material.

Samples were collected from locations beneath the former UST and dispenser locations and analyzed for total petroleum hydrocarbons as gasoline, diesel and motor oil, volatile organic compounds, and California Assessment Manual/California Code of Regulations (CAM/CCR) 17 Metals. Based on low to non-detect results of the aforementioned contaminants of concern in the soil and water samples, and the successful restoration of the Site, AIS recommends no further action regarding this former UST.

1.0 INTRODUCTION

This report summarizes underground storage tank (UST) closure activities completed at California Army National Guard (CA ARNG) Armory located in San Lorenzo, CA. The United States Army Corps of Engineers (USACE), Sacramento District retained the services of American Integrated Services, Inc. (AIS) for permitting and removal of the UST under the oversight of the Alameda County Environmental Health Department (Contract No. W91238-08-D-0008, Task 0006). This report will summarize the UST closure work and detail the results of soil and groundwater confirmation sampling following the removal of the UST.

1.1 Facility Information

San Lorenzo Armory (the Site) is located at 16501 Ashland Avenue, San Lorenzo, Alameda County, CA. The Site is located on a 2-acre parcel in the northeastern corner of the San Lorenzo High School, 50 E. Lewelling Blvd., San Lorenzo, California. The Site is approximately 12 miles southeast of the City of Oakland and a ½-mile southwest of the City of Ashland. The Site is bounded to the north by I-238, to the south and southwest by San Lorenzo High School, to the east by Ashland Ave., and to the south by various small businesses (Figure 1). The UST is located on the west side of the Site, north of building Operations and Maintenance Service (OMS) (Figure 2).

1.2 Entities Involved

The USACE contracted AIS for UST-removal activities at the CA ARNG site. AIS subcontracted analytical work to McCampbell Analytical, Inc. The UST rinsate was transported by Evergreen Environmental, Inc. to their State-licensed facility. The UST was removed via crane by Hatton Crane and Rigging of Hayward, CA. The UST was transported by A&S Metals of Castroville, California to their licensed recycling facility for recycling. Samples were The County of Alameda provided the UST removal permit and provided on-site supervision of the UST removal and confirmation sampling activities. Details of all field procedures are provided in Section 3.

1.3 UST and Fuel Island Information

The UST was used to store red diesel fuel. The 5,000-gallon tank was installed in the late 1990s. It was a double-walled, fiberglass coated steel UST. The tank was originally believed to be approximately 7 feet (ft) in diameter and 17.5 ft long, but was measured 8 ft in diameter and 14 ft long during removal activities. No holes or tears were noted on the tank upon its removal.

The concrete fuel island structure was approximately 4 ft wide by 12 ft long by 12-inches deep and contained large amounts of rebar. The concrete pad beneath the tank was not

removed, but the tank leak detection system was salvaged and turned over to the Government on site.

Pertinent tank and piping information includes:

UST and Piping Information

Tank EPA I.D.	CA D981369085
Date Installed	Late 1990's
Tank Capacity	5,000 gallons
Tank Construction	Double-walled, fiberglass coated steel
Substances Stored in Tank	JP-8 Red Diesel fuel
Piping Construction	Double-walled fiberglass
Tank Owner/Operator	California Army National Guard
Condition of Tank	No holes visible
Type of Closure	Removal

1.4 Site History and Characteristics

San Lorenzo Armory was constructed in 1947, and the CA ARNG began leasing the facility from the San Lorenzo Unified School District. The Site is located at the northeastern corner of the San Lorenzo High School. The Site is generally level and is home to the main armory building as well as the Operations and Maintenance Shop (OMS). One 5,000 gallon UST was identified at the site by CA ARNG personnel during site assessment activities conducted at the site. An investigation was proposed to identify the possibility of contamination from the UST or other areas where fuel was being handled.

2.0 GEOLOGY AND HYDROGEOLOGY

2.1 Geology

The following regional geology was obtained from: *Phase I/Limited Phase II Environmental Site Assessment*, Kleinfelder West, Inc., September 2009 and *Geologic and Seismic Hazards Assessment Report San Lorenzo High School Campus*, Kleinfelder, Inc., September 2009.

The Site is situated on an alluvial plain that lies between the eastern shore of San Francisco Bay and the East Bay Hills of the Diablo Range. Mesozoic- and Cenozoic-aged bedrock formations underlie the nearby East Bay Hills and are composed of various types of igneous, metamorphic and sedimentary rocks. Geologic structures within the foothills trend to the northwest, and are strongly influenced by the active Hayward fault, which transects the western boundary of the hills.

Localized studies by the United States Geological Survey describing the Quaternary alluvial and Bay deposits in the vicinity of the Site show that the northeastern and northwestern portions of the nearby school campus are underlain by recent alluvial fan deposits, while recent natural levee deposits underlie the southern portion. Alluvial fan deposits are sediment deposited by streams from adjacent mountain and hillside canyons onto adjoining valley floors and plains. These sediments generally vary in composition from poorly graded sand to silt and clay and generally decrease in grain size downgradient of the top, or apex, of the fan. Natural levee deposits commonly border stream channels and are composed of fine-grained deposits of silt and clay with variable amounts of sand.

2.2 Hydrogeology

The portion of Alameda County where the Site is located falls within the California Coast Ranges Geomorphic province, which is characterized by folds, thrusts, and faults that form a series of nearly parallel northwest trending ridges, interspersed with alluvium-filled valleys.

The depth to groundwater was encountered at 7 ft bgs. General groundwater depth may be influenced by local pumping, rainfall, and irrigation patterns. Data from former on-site groundwater monitoring wells indicates depth to groundwater was 5 to 10 ft in the mid-1990s. Groundwater was encountered during tank-removal activities; therefore, the samples were collected at between 5 and 9 ft bgs.

3.0 FIELD ACTIVITIES

3.1 Permitting

The Department of Toxic Substances Control (DTSC) and the San Francisco Bay Regional Water Quality Control Board-Region 2 (SFBRWQCB) provided regulatory oversight of the Site. The Alameda County Department of Environmental Health (ACDEH); however, has jurisdiction over UST removals within County boundaries. Prior to commencement of the work, a permit for UST removal (Permit No.: SR0016792) was obtained from the ACDEH to remove the existing tank. ACDEH has acted as the Certified Unified Program Agency (CUPA). A right-of-entry agreement was not necessary. A copy of the UST Closure Permit is included in Appendix A.

3.2 Utility Clearance

Underground Service Alert (USA) was contacted, as required by State law, prior to digging. USA was notified so all utility companies with potential conflicts could locate and mark their underground utilities prior to the start of work. On April 23, 2010, a fax was received from East Bay Municipal Utility District notifying Mr. Ed Wardle of AIS that there were no facilities in conflict with the proposed excavation location. In addition, on April 28, 2010, AT&T Local Service Cable Protection Center GFI was contacted regarding excavation activities in the area. AIS was notified that the Site was clear of underground cables (Appendix B).

3.3 Tank, Piping, and Fuel Island Removal

On June 22, 2010, the field crew held their initial meetings prior to the clearing of the UST location. The waterline was shut off in preparation of UST removal. The concrete, asphalt, and soil overlying the tank were removed and stockpiled on-site. AIS excavated to the top and the sides of the UST in a manner that ensured maximum excavation safety.

The excavated soils were temporarily stockpiled prior to analytical testing and disposal. The stockpile area was lined with high-density polyethylene to prevent the excavated materials from contacting the ground surface.

On June 23, 2010, once the UST and all piping were uncovered, AIS used an interphase probe (IP) lowered into the tank to determine if any product was present. The IP was also used to detect free-phase petroleum hydrocarbons. The piping was flushed and drained back into the UST, being careful to avoid any spillage to the surrounding area. The tank interior was cleaned by pressure washing. Approximately 890 gallons of residual diesel fuel and rinse water were removed. The tank was made inert by adding approximately 200 pounds of dry ice until satisfactory levels of lower explosive limit (LEL) and total oxygen were achieved (0% LEL and 20.8% oxygen). Photographs depicting preparation of the tank removal are shown in Appendix C.

The UST atmosphere and excavation area were continuously tested for percent oxygen and combustible gas during the UST excavation and removal operations. These tests were made using a combustible gas indicator with an oxygen meter, which was properly calibrated according to the manufacturer's instructions. After witnessing the LEL and oxygen readings, an ACDEH representative approved the removal of the UST.

The cutting of piping was done with a non-sparking cutter to avoid the generation of any sparks. A 1/8-inch hole drilled through the vent tube allowed expansion and contraction of the gases contained within the UST due to temperature variations. This step was performed so the UST would not be subjected to excessive differential pressure caused by temperature changes. The UST was always positioned with this vent plug on top of the UST during transport and storage.

Hatton Crane and Rigging was subcontracted to remove the UST from the excavation and place it on a trailer using a crane. The UST was transported to A&S Metals of Castroville, California. The Certificate of Destruction shows that the tank was destroyed on June 23, 2010 by cold shearing it into salvageable parts (Appendix D).

Concrete from the UST pad and the vehicle inspection dock was removed on June 24, 2010. The above-ground clarifier was removed and set aside while the wash pad was demolished and the concrete was stockpiled on site. Additional excavation occurred to the east of the UST excavation pit due to some caving of the materials. This allowed for a more stable excavation pit that could then be backfilled safely.

Concrete removal from the inspection dock area proceeded on June 24 and 25, 2010. Once the water line was reached, it was shutoff to allow the crew to cut and cap the line. Three sump vaults were then completely removed and stockpiled on site to await disposal via truck to a recycling facility. Asphalt at the excavation locations was cut with a self-propelled saw on June 30, 2010 to create cleaner lines before placing the new asphalt (Appendix C).

3.4 Tank-Pit Sampling

On June 23, 2010, AIS personnel collected six samples, which included three grab water samples and three grab soil samples. The water samples were collected from the UST rinsate, the clarifier, and the groundwater encountered in the UST excavation. The soil samples were retrieved by utilizing the bucket of a backhoe at the desired location and at the targeted depth of between 5 and 9 ft bgs. On July 1, 2010, one soil sample was collected from the stockpiled soil (Figure 3).

The samples were collected in laboratory-grade glass jars with Teflon[®] lined plastic lids as well as Volatile Organic Analysis (VOA) vials. The samples were immediately labeled and placed in a cooler with ice pending delivery to State-certified laboratory McCampbell Analytical, Inc. (ELAP No.: 1644) under chain-of-custody protocol. Laboratory and quality assurance/quality control (QA/QC) reports and chain-of-custody documents are included in Appendix E.

3.5 Site Restoration and Disposal of Materials

Approximately 890 gallons of rinsate produced by the cleaning of the UST was removed on June 23, 2010 by Evergreen Environmental Services. The rinsate was transported via vacuum truck to their facility and disposed of as non-RCRA hazardous waste liquid (Appendix F).

Based on the laboratory results, the soil below the UST was found to be uncontaminated (below practical quantitation limits for all analyses), although total petroleum hydrocarbons as diesel (TPHd 110 mg/kg) was detected in the excavated stockpile soil. Site restoration photographs can be found in Appendix C.

On June 25, 2010 the UST excavation and clarifier excavations were prepared for backfill. Geotextile filter fabric was inserted in the excavation on top of the drain rock to bridge the groundwater that was encountered. Sand was then used to further backfill the area and compacted to 90% relative compaction. RGH Consultants performed the compaction testing and their report can be found in Appendix B.

AIS provided the appropriate drainage rock and sand backfill for the excavations. These areas were compacted with an asphalt roller and then paved with 3- to 4-inches of asphalt, sufficient for general vehicle traffic. On July 1, 2010, the ground surface was restored to its original, pre-excavation condition.

On August 20 and 21, 2010, approximately 254 tons of non-hazardous soil was removed from the Site and disposed of by Republic Services (via Millan Trucking) to Keller Canyon Landfill. Approximately 82 tons of concrete and asphalt were removed by Aman Environmental Construction and transported to their facility in Oakland for recycling (Appendix F).

4.0 ANALYTICAL RESULTS

4.1 Laboratory Analysis Methods

On June 23, 2010, six samples were collected from the Site. Three grab water samples were taken from the clarifier (Comp-Clarifier-1), the UST rinsate (Comp-Rin-1), and the groundwater encountered in the excavation (UST-GW-1). Two grab soil samples were collected from the UST excavations (Soil-West-9 and Soil-South-8) and one from the dispenser excavation (Soil-Dispenser-North-5). An additional soil sample was collected on July 1, 2010 from the stockpiled soil (Comp-Stkple). The chemical analyses were performed by McCampbell Analytical, Inc., a laboratory certified by the State of California Department of Public Health (ELAP Certification No. 1644CA) located in Pittsburg, CA.

The compounds and respective analytical methods for the collected water and soil samples are provided in Table 1. The samples were analyzed for the compounds required by the ACDEH UST Closure Permit. Analyses included the following:

- Total petroleum hydrocarbons as gasoline (TPHg) [C₆-C₁₂]; extraction performed according to EPA Method 5030B and analysis performed by EPA Method 8015B;
- TPHd [C₁₀-C₂₃] and total petroleum hydrocarbons as diesel (TPHmo) [C₁₈-C₃₆]; extraction performed according to EPA Method 3510C/3550B and analysis performed by EPA Method 8015B;
- Benzene, toluene, ethylbenzene and total xylenes (BTEX), 1,2-dichloroethane (1,2-DCA), and 1,2- ethylene dibromide (EDB); extraction performed by EPA Method 5030B and analysis performed by EPA Method 8260B;
- Fuel oxygenates, consisting of methyl tertiary-butyl ether (MTBE), di-isopropyl ether (DIPE), ethyl tertiary-butyl ether (ETBE), tertiary-amyl methyl ether (TAME) and tertiary-butyl alcohol (TBA); extraction performed by EPA Method 5030B and analysis performed by EPA Method 8260B; and
- CAM/CCR 17 Metals; extraction performed by EPA Method E200.8 and analysis performed by EPA Method E200.8.

4.2 Results and Interpretation of Laboratory Analysis

As shown on Table 1, the groundwater sample (UST-GW-1) showed a detectable concentration of TPHd (820 micrograms per Liter [$\mu\text{g/L}$]) and the composite soil stockpiled sample (Comp-Stkple) showed a detectable concentration of TPHd (110 milligrams per kilogram [mg/kg]). The UST soil samples and the stockpiled soil sample were all non-detect for volatile organic compounds (VOCs) and BTEX; Even so, clean soil was used to backfill the excavations. Based on these results, the former UST did not adversely impact the underlying soil. Because there were no

environmental concerns based on the findings, AIS received instructions from the CA ARNG to proceed and backfill the excavation.

5.0 CONCLUSIONS AND RECOMMENDATIONS

USACE Sacramento District retained the services of AIS for permitting and removal of a UST under the oversight of the ACDEH. This report was prepared to document tank closure activities.

The UST was located beneath asphalt and soil. On June 23, 2010, the soil surrounding the tank was excavated and temporarily stockpiled onsite. The tank's interior was washed and ventilated using a pressure washer and dry ice was added until satisfactory lower explosive limits and total oxygen concentrations were achieved. After the completion of cleaning the tank, AIS removed it and had it transported to A&S Metals of Castroville, California for destruction.

Three soil samples were collected from the UST excavation and dispenser excavation. The samples did not reveal any VOCs at or above laboratory practical quantitation limits. Sample Comp-Stkple did contain concentration of TPHd, which was detected at 110 mg/kg. The groundwater sample (UST-GW-1) showed a detectable concentration of TPHd (820 µg/L). AIS submitted the analytical results to the CA ARNG and received approval to restore the Site. AIS backfilled and compacted the backfill materials to 90% relative compaction and repaved the area with asphalt.

Based on the laboratory analysis and tank removal activities, AIS recommends no further action for the UST area and requests that closure be granted for the Site.


6.0 LIMITATIONS

AIS has performed the activities cited herein in conformance with the scope of work prescribed by USACE Sacramento District. AIS conducted the work in an objective and unbiased manner, and in accordance with generally accepted professional practice for this type of work. AIS believes the analysis to be accurate and relevant but cannot accept responsibility for the accuracy or completeness of available documentation or possible withholding of information by the interviewees, agencies, or other private parties. No other warranty, express or implied, is made. This report is solely for the use and information of USACE Sacramento District unless otherwise noted. Any reliance on this report by a third party is at such party's sole risk.

The findings from the soil and groundwater investigation are based primarily upon analytical results provided by an independent laboratory. Interpretations of the subsurface conditions at the Site, for the purpose of this investigation, are made from a limited number of available data points (example: soil and groundwater samples), and subsurface conditions may be different in other locations.


AIS appreciates the opportunity to provide environmental management services for USACE Sacramento District. Should you have any questions or require additional information, please feel free to call AIS at (805) 639-0884.

FIGURES

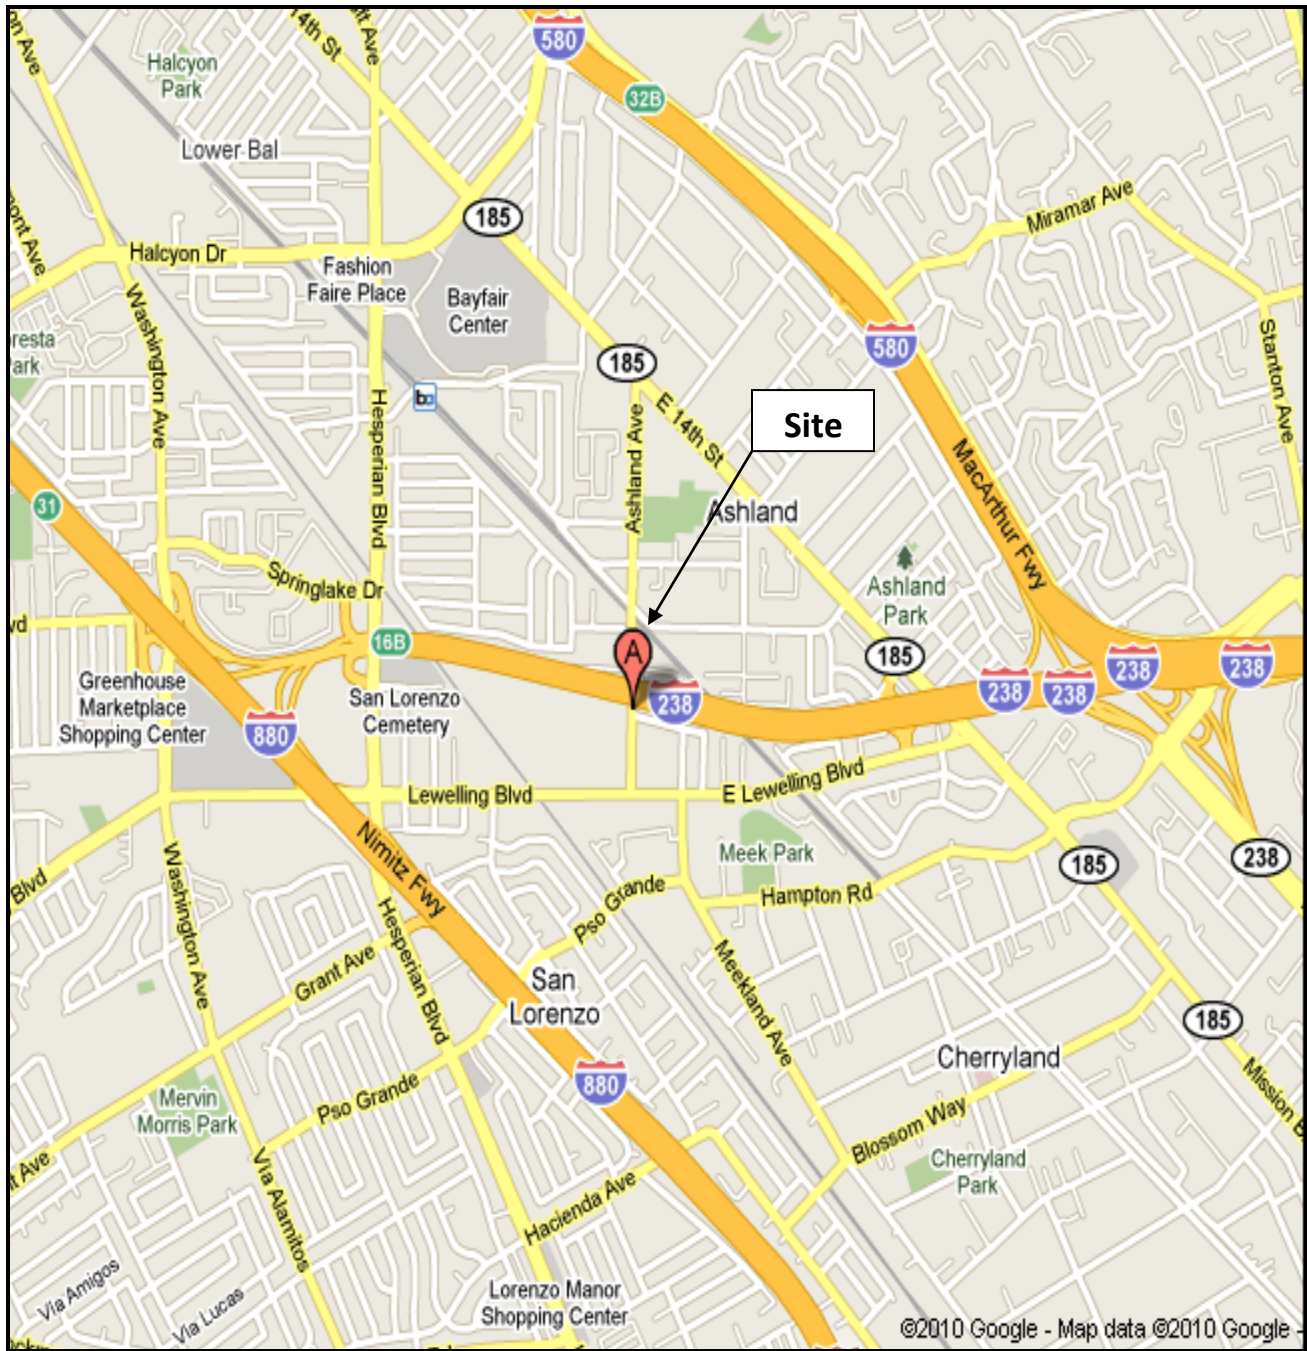


<p>FIGURE 1. SITE LOCATION MAP 16501 Ashland Ave, San Lorenzo, California</p>	<p>DRAWN BY: KT REVIEWED BY: KM DATE: 4/07/10 REV. NO. 1</p>	<p><i>American Integrated Services, Inc.</i> 1502 East Opp Street Wilmington, California 90744-3927</p>
--	---	---

FILE NAME: Z:\AIS\SAN LORENZO\SITEMAP\2011\SITEMAPS\0111\FIG 2_30077.0111.DWG

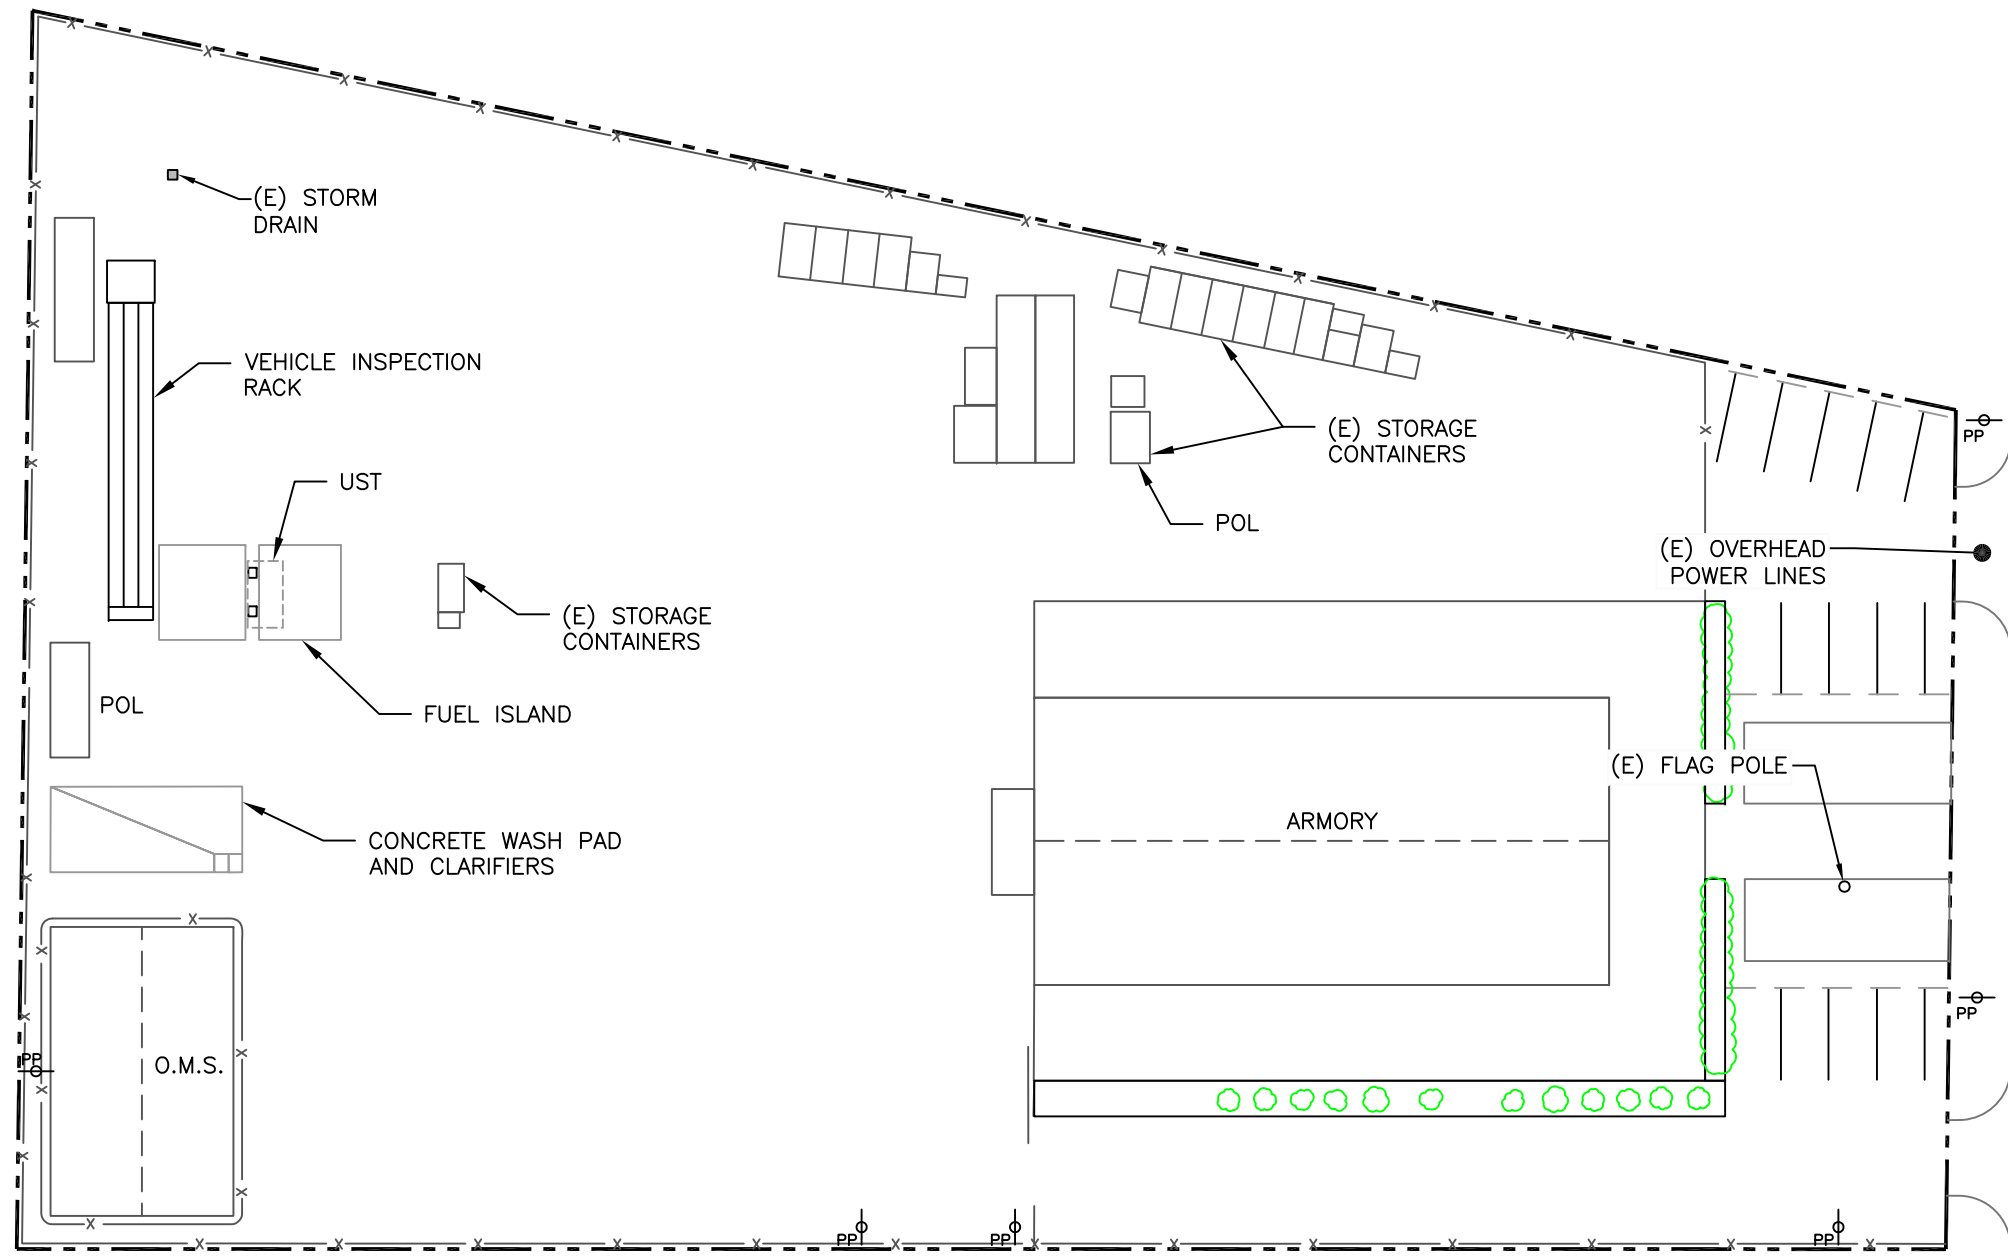


- General Site Legend:**
- Property Boundary
 - Vegetation
 - ⊙ Power Pole
 - ⊔ Former UST Location

Ashland Avenue

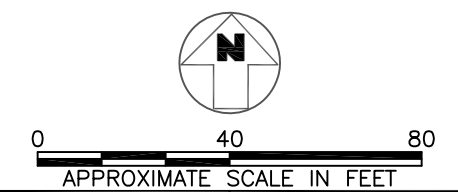

DATE:	01-11	PROJECT NO.	30077
California Army National Guard Armory San Lorenzo, CA			
Underground Storage Tank Demolition Removal, Fuel Island/Dispenser			
San Lorenzo, CA			
 1650 Palma Drive, Suite 207, Ventura, California 93003			FIGURE 2

FILE NAME: Z:\AIS\SAN LORENZO\SITEMAP\2011\SITEMAPS\0111\Fig 3_30077.0111.DWG

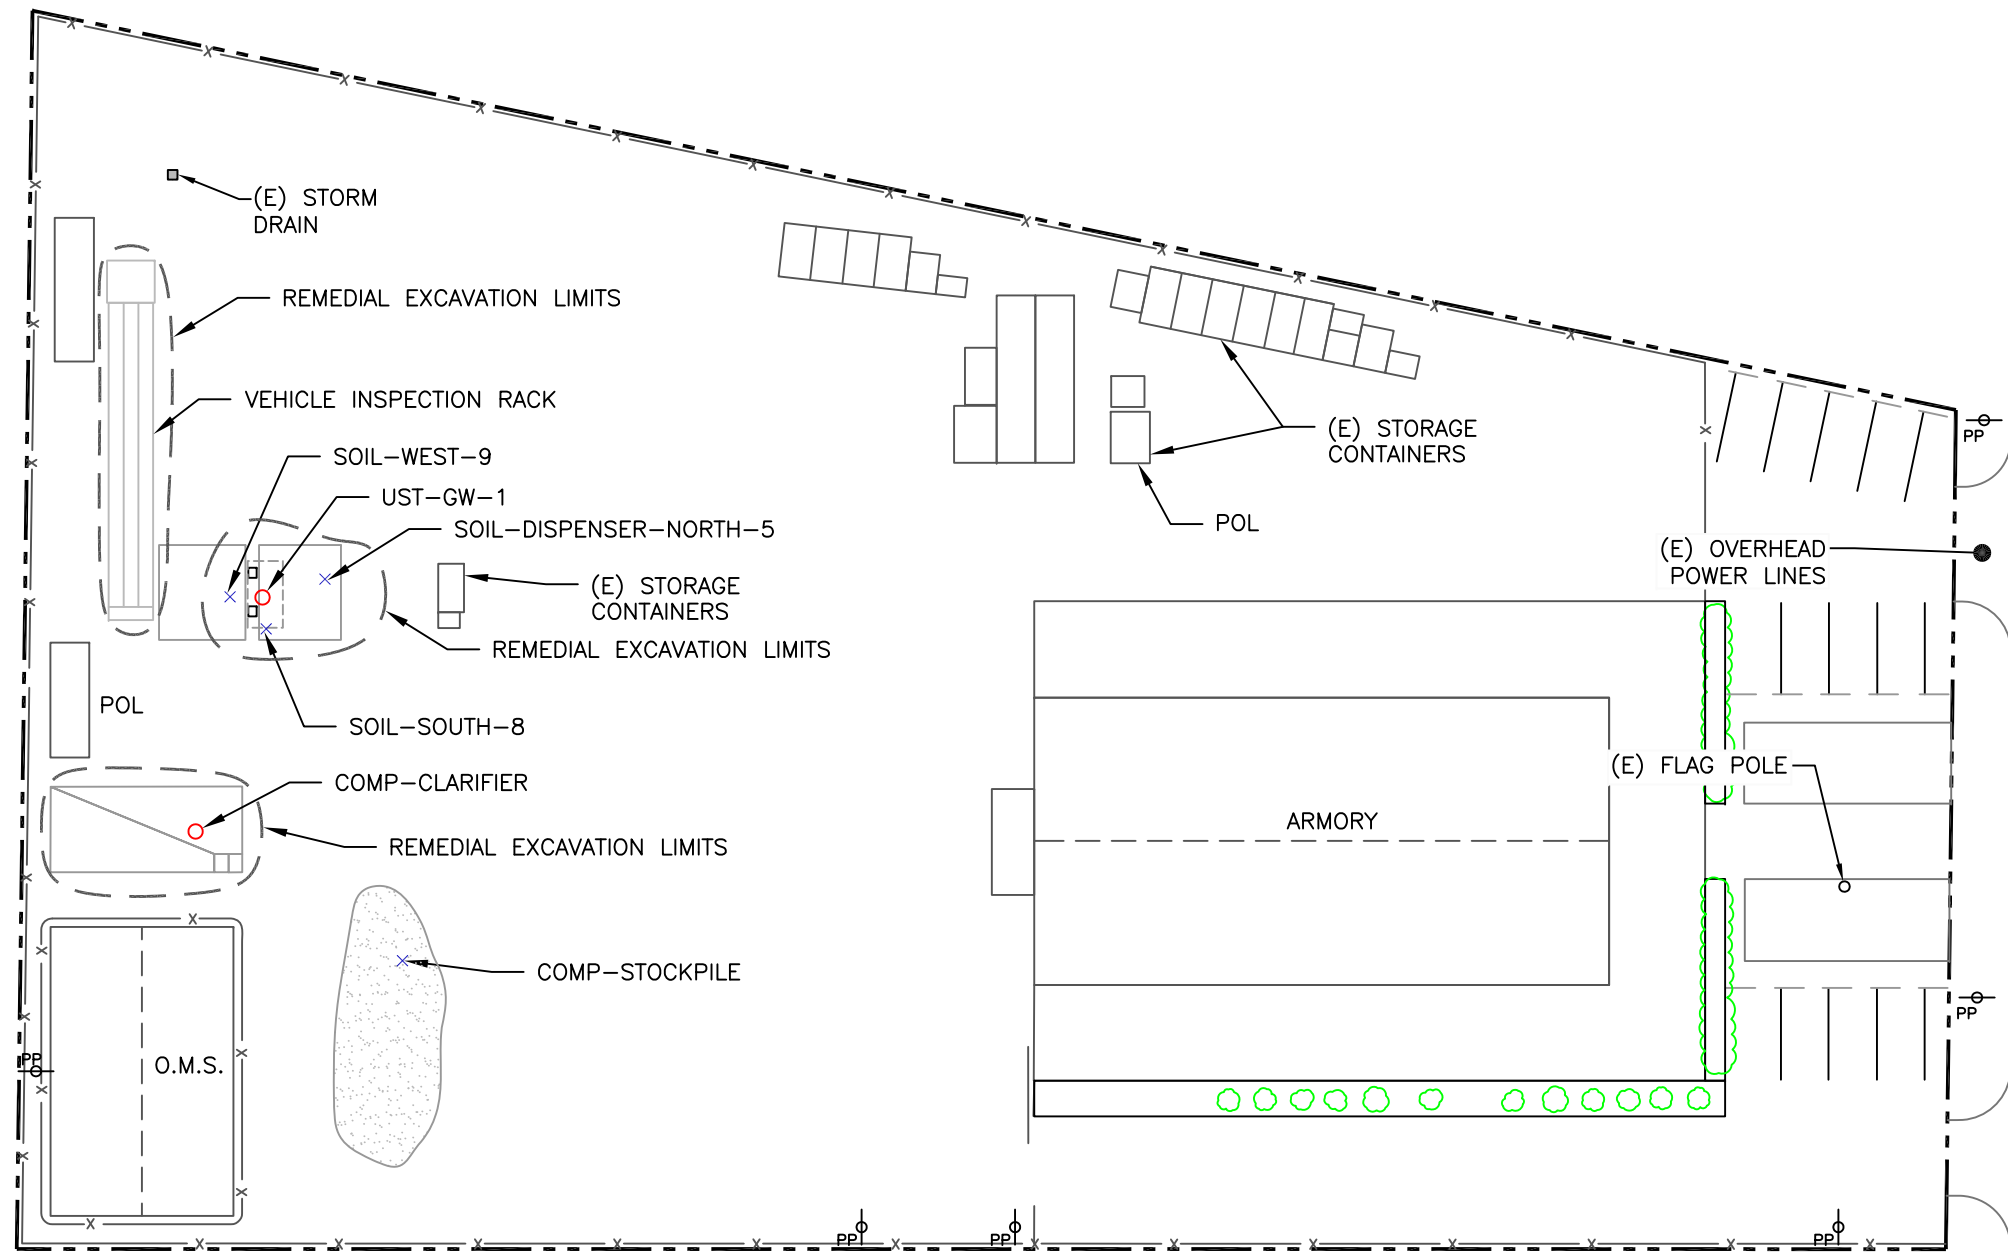


General Site Legend:

- Property Boundary
- Vegetation
- Power Pole
- Soil Pile
- Groundwater Sample Location
- Soil Sample Location
- Excavation Limits
- Former Location of 5,000 gallon UST

General Site Notes:

See Tables 1A and 1B for Analytical Results

Ashland Avenue

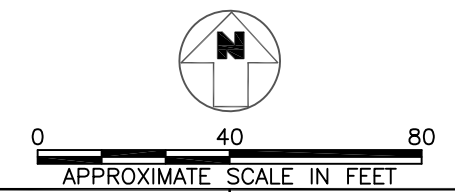

DATE:	01-11	PROJECT NO.	30077
California Army National Guard Armory San Lorenzo, CA			
Confirmation Sampling Locations			
San Lorenzo, CA			
 1650 Palma Drive, Suite 207, Ventura, California 93003			FIGURE 3

TABLES

Table 1-A: Summary of Confirmation Samples - TPH and VOCs
 California Army National Guard
 San Lorenzo Armory

Sample ID	Date	EPA 8015B			EPA 8260B								
		TPHg C6-C12 (µg/L)	TPHd C10-C23 (µg/L)	TPHmo C18-C36 (µg/L)	Benzene (µg/L)	Toluene (µg/L)	Ethyl- benzene (µg/L)	Total Xylenes (µg/L)	MTBE (µg/L)	ETBE (µg/L)	DIPE (µg/L)	TAME (µg/L)	TBA (µg/L)
Comp-Clarifier-1	6/23/2010	ND	290	800	ND	ND	ND	ND	ND	ND	ND	ND	ND
Comp-Rin-1	6/23/2010	51,000	1,400,000	350,000	ND	65	120	760	ND	ND	ND	ND	ND
UST-GW-1	6/23/2010	--	820	--	ND	ND	0.62	6.1	ND	ND	ND	ND	ND

Sample ID	Date	EPA 8015B			EPA 8260B								
		TPHg C6-C12 (mg/kg)	TPHd C10-C23 (mg/kg)	TPHo C18-C36 (mg/kg)	Benzene (mg/kg)	Toluene (mg/kg)	Ethyl- benzene (mg/kg)	Total Xylenes (mg/kg)	MTBE (mg/kg)	ETBE (mg/kg)	DIPE (mg/kg)	TAME (mg/kg)	TBA (mg/kg)
Soil-West-9	6/23/2010	--	ND	--	ND	ND	ND	ND	ND	ND	ND	ND	ND
Soil-Dispenser-North-5	6/23/2010	--	ND	--	ND	ND	ND	ND	ND	ND	ND	ND	ND
Soil-South-8	6/23/2010	--	ND	--	ND	ND	ND	ND	ND	ND	ND	ND	ND
Comp-Stkple	7/1/2010	--	110	--	ND	ND	ND	ND	ND	ND	ND	ND	ND

ND: Not detected above the reporting limit/method detection limit
 TPHg: Total Petroleum Hydrocarbons as gasoline
 TPHd: Total Petroleum Hydrocarbons as diesel
 TPHmo: Total Petroleum Hydrocarbons as motor oil
 µg/L: micrograms per Liter
 mg/kg: milligrams per kilogram
 Comp-Clarifier-1: Composite water sample collected from clarifiers
 Comp-Rin-1: Composite water sample collected from rinsate
 Comp-Stkple: Composite soil sample collected from the stockpiled soil
 UST: underground storage tank
 GW: groundwater
 MTBE: methyl-t-butyl ether
 ETBE: ethyl tert-butyl ether
 DIPE: diisopropyl ether
 TAME: tert-Amyl methyl ether
 TBA: t-Butyl alcohol

Table 1-B: Summary of Confirmation Results - Metals
 California Army National Guard
 San Lorenzo Armory

Sample ID	Date	EPA E200.8 for CAM/CCR 17 Metals (µg/L)																
		Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Copper	Lead	Mercury	Molybdenum	Nickel	Selenium	Silver	Thallium	Vanadium	Zinc
Comp-Clarifier-1	6/23/2010	1.4	1.0	120	ND	5.5	4.4	1.1	30	31	ND	3.0	15	ND	ND	ND	3.4	620
Comp-Rin-1	6/23/2010	7.7	42	77	ND	39	490	220	780	480	0.13	1.6	1100	ND	0.41	ND	26	1400

ND: Not detected above the reporting limit/method detection limit
 µg/L: micrograms per Liter
 Comp-Clarifier-1: Composite water sample collected from clarifiers
 Comp-Rin-1: Composite water sample collected from rinsate

APPENDIX A
UST CLOSURE PERMIT

ALAMEDA COUNTY
 DEPARTMENT OF ENVIRONMENTAL HEALTH
 1131 HARBOR BAY PARKWAY
 ALAMEDA, CA 94502-6577
 PHONE (510) 567-6700

ACCEPTED

Underground Storage Tank Closure Permit Application
 Alameda County Division of Hazardous Materials
 1131 Harbor Bay Parkway, Suite 250
 Alameda, CA 94502-6577

These closure/removal plans have been received and found to be acceptable and essentially meet the requirements of State and Local Health Laws. Changes to your closure plans indicated by this Department are to assure compliance with State and local laws. The project proposed herein is now released for issuance of any required building permits for construction/destruction.

One copy of the accepted plans must be on the job and available to all contractors and craftsmen involved with the removal.

Any changes or alterations of these plans and specifications must be submitted to this Department and to the Fire and Building Inspections Department to determine if such changes meet the requirements of State and local laws. Notify this Department at least 72 hours prior to the following required inspections:

- Removal of Tank(s) and Piping
- Sampling
- Final Inspection

Issuance of a permit to operate, by permanent site closure, is dependent on compliance with accepted plans and all applicable laws and regulations.

THERE IS A FINANCIAL PENALTY FOR NOT OBTAINING THESE INSPECTIONS:

Contact Operator

Robert Weston
 510 567-6781

See Table 2 enclosed for sample analysis for diesel fuel

MAY 27 2010

UNDERGROUND STORAGE TANK CLOSURE PLAN

*** Complete closure plan according to instructions ***

1. Name of Business CALIFORNIA ARMY NATIONAL GUARD ARMORY
 Business Owner or Contact Person (PRINT) FRED DELUCCHI
2. Site Address 16501 ASHLAND AVE
 City, State SAN LORENZO Zip 94580 Phone 916 854-3542
3. Mailing Address 9800 GOETHE ROAD
 City, State SACRAMENTO Zip 95827 Phone 9168543542
4. Property Owner CALIFORNIA ARMY NATIONAL GUARD
 Business Name (if applicable) SAME
 Address 9800 GOETHE ROAD
 City, State SACRAMENTO Zip 95827 Phone 918854-3542
5. Generator name under which tank will be manifested
CALIFORNIA ARMY NATIONAL GUARD
 EPA I.D. No. under which tank(s) will be manifested C A D981369085

SR0016792

6. Contractor AMERICAN INTEGRATED SERVICES INC
Address 2075 KNOWL DRIVE
City, State VENTURA Zip 93001 Phone 805 639-0884
License Type A, B, C10, C21, HAZ ID# 757133

7. Consultant (if applicable) \
Address _____
City, State _____ Zip _____ Phone _____

8. Main Contact Person for Investigation (if applicable)
Name KELLY STATER Title PROGRAM MANAGER
Company AMERICAN INTEGRATED SERVICES
Phone 805 639-0884

9. Number of underground tanks being closed with this plan ONE
Length of piping being removed under this plan 12 TO 20 FT UNKNOWN
Total number underground tanks at this facility (**confirmed with owner or operator) ONE

10. State Registered Hazardous Waste Transporters/Facilities (See Instructions).

a) Product/Residual Sludge/Rinsate Transporter
Name AMERICAN INTEGRATED SERVICES EPA I.D. No. CAR000198338
Hauler License No. 134986 License Exp. Date 9/30/2010
Address 1502 EAST OPP STREET
City, State WILMINGTON CA Zip 90744

b) Product/Residual Sludge/Rinsate Disposal Site
Name EVERGREEN OIL INC EPA I.D. No. _____
Address 6880 SMITH AVE
City, State NEWARK CA Zip 94560

W

c) Tank and Piping Transporter

Name AMERICAN INTEGRATED SERVICES EPA I.D. No. CA R000148388
Hauler License No. 134986 License Exp. Date 9/30/2010
Address 1502 EAST OPP STREET
City, State WILMINGTON Zip 90744

d) Tank and Piping Disposal Site

Name A + S METALS EPA I.D. No. _____
Address 11340 COMMERCIAL PARKWAY
City, State CASTROVILLE CA Zip 95012

11. Sample Collector

Name AMERICAN INTEGRATED SERVICES INC
Company _____
Address 1502 EAST OPP STREET
City, State WILMINGTON CA Zip 90744 Phone 310522-1168

12. Laboratory

Name Mc CAMPBELL ANALYTICAL INC
Company SAME
Address 1534 WILLOW PASS ROAD
City, State PITTSBURG CA Zip 94565
State Certification No. 1644

13. Have tank(s) or piping leaked in the past? Yes [] No [] Unknown []

If yes, describe: _____

14. Describe method(s) to be used for rendering tank(s) inert:

DRY ICE 25 LBS PER 1000 GALLONS
125 LBS OF DRY ICE FOR THE 5000 GALLON
TANK

Before tank(s) are pumped out and inerted, all associated piping must be flushed back into the tank(s). All accessible piping must then be removed. Inaccessible piping must be permanently plugged using grout.

The Bay Area Air Quality Management District, (415) 771-6000, along with local Fire and Building Departments, must also be contacted for tank removal permits. Fire departments typically require the use of a combustible gas indicator to verify tank inertness. **It is the contractor's responsibility to have a functional combustible gas indicator on-site to verify that the tank(s) is inerted.**

15. Tank History and Sampling Information ***** (See Instructions) *****

Tank		Material to be sampled (tank contents, soil, groundwater)	Location and Depth of Sample(s)
Capacity (gallons)	Use History include date last used (estimated)		
5000 GAL	UNKNOWN!	① TANK CONTENTS ② SPOILS PILES ③ AREA BELOW THE TANK ④ GROUND WATER IF PRESENT	AS REQUIRED

One soil sample must be collected for every 20 linear feet of underground piping that is removed. A groundwater sample must be collected if any groundwater is present in the excavation.

Excavated/Stockpiled Soil	
Stockpiled Soil Volume (estimated) 10-12 CUBIC YARDS	Sampling Plan PER TRI-REGIONAL BOARD PROTOCOL

Stockpiled soil must be placed on bermed plastic and must be completely covered by plastic sheeting.

Will the excavated soil be returned to the excavation immediately after tank removal? yes no unknown

If yes, explain reasoning _____

If unknown at this point in time, please be aware that **excavated soil may not be returned to the excavation without prior approval from this office.** This means that the contractor, consultant, or responsible party must communicate with the Specialist IN ADVANCE of backfilling activities.

16. Chemical methods and associated detection limits to be used for analyzing sample(s):

The Tri-Regional Board recommended minimum verification analyses and practical quantitation reporting limits shall be followed.

See Table 2, Recommended Minimum Verification Analyses for Underground Tank Leaks.

Contaminant Sought	EPA or Other Sample Preparation Method Number	EPA or Other Analysis Method Number	Method Detection Limit
/			

17. Submit Site Health and Safety Plan (See Instructions)

18. Submit Worker's Compensation Certificate copy

Name of Insurer COMMERCE AND INDUSTRY INSURANCE CO (NAIC # 19410)



19. Submit Plot Plan ***** (See Instructions) *****

20. Enclose Deposit (See Instructions)

21. **Report all leaks or contamination to this office within 5 days of discovery.**
The written report shall be made on an Underground Storage Tank Unauthorized Leak/Contamination Site Report (URL) form.

22. **Submit a closure report to this office within 60 days of the tank removal. The closure report must contain all information listed in item 22 of the instructions.**

23. Submit State (Underground Storage Tank Permit Application) Forms A and B (one-B form for each UST to be removed) (mark box 8 for "tank removed" in the upper right hand corner).

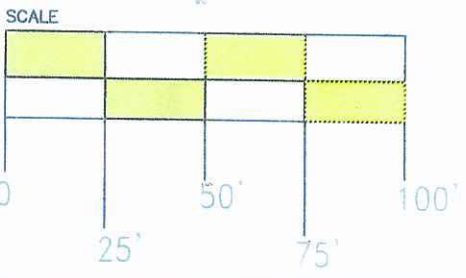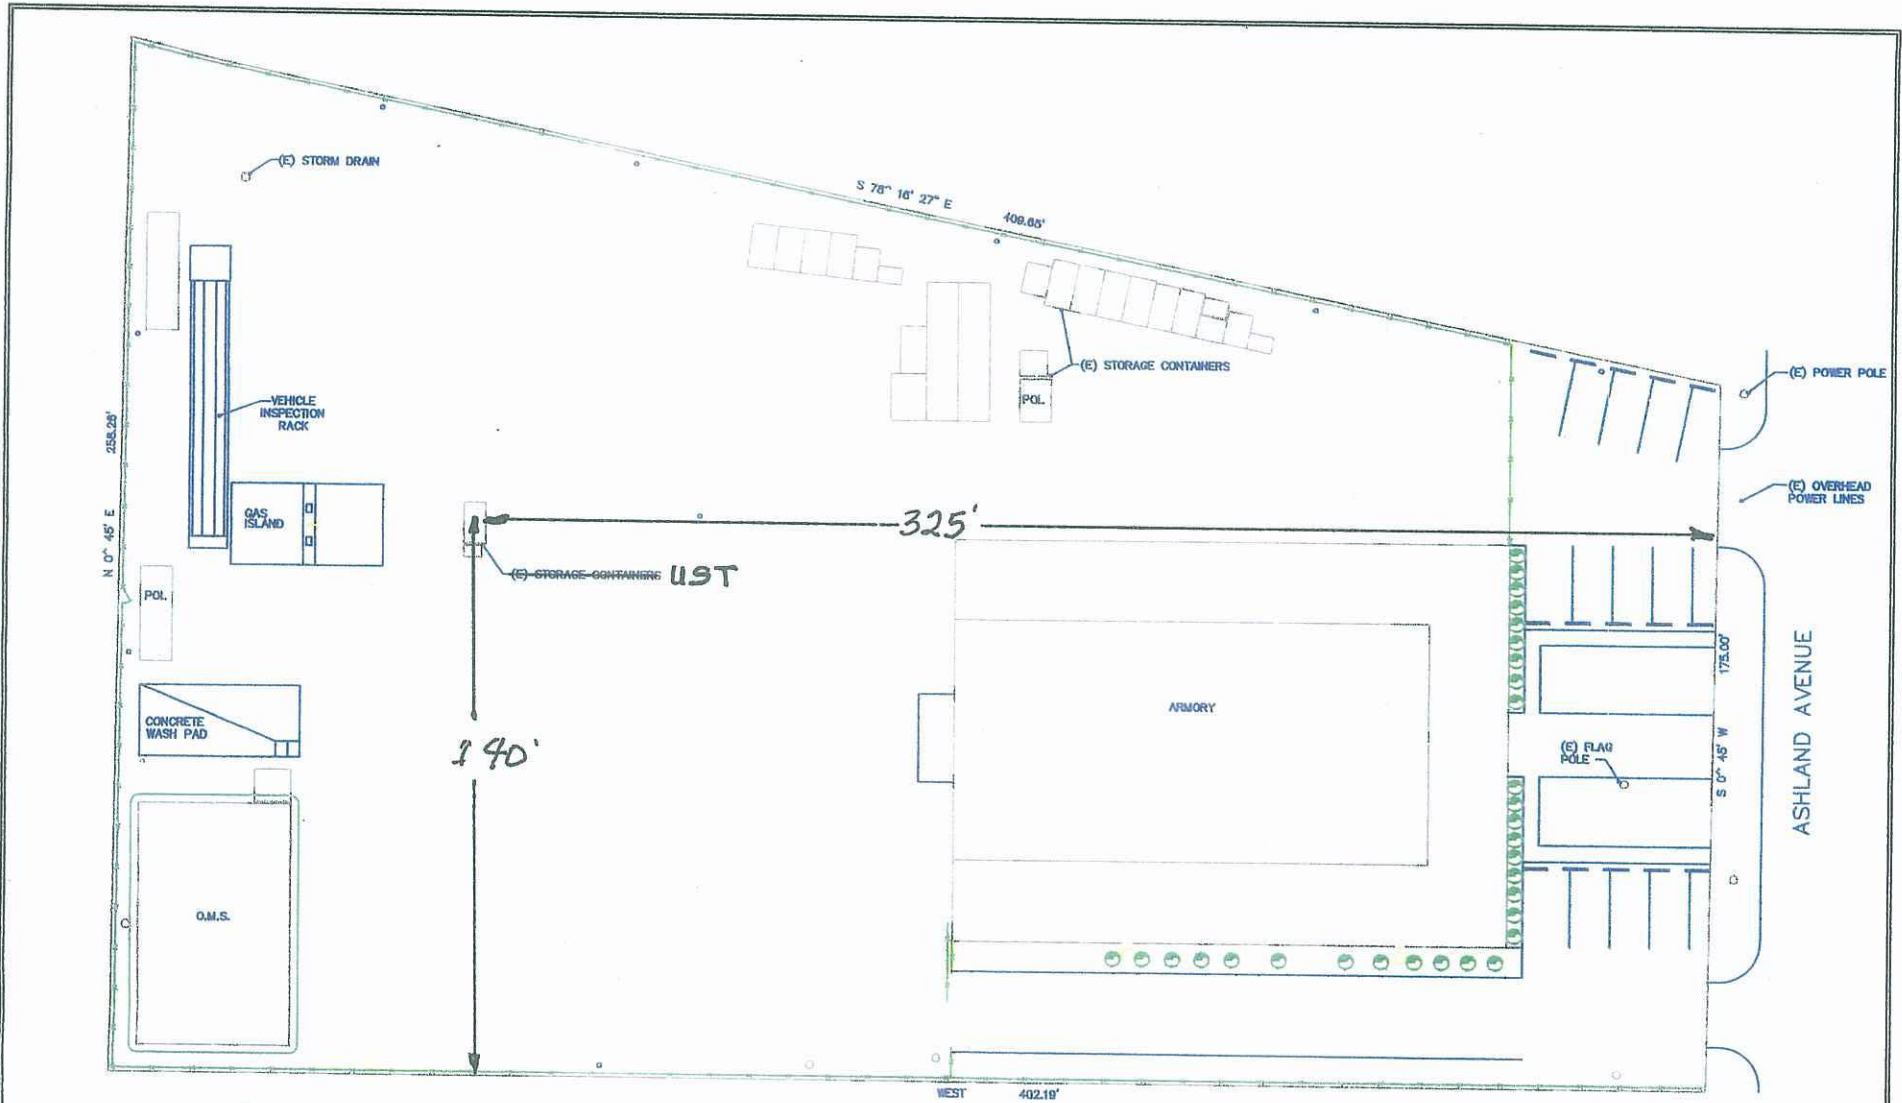

CALIFORNIA ARMY NATIONAL GUARD
 16501 ASHLAND AVE.
 SAN LORENZO, CA 94580

EPA# CA0981369085

PROJECT: Facilities Reference Data	LOCATION: San Lorenzo
DATE: 30 Oct 06	SHEET TITLE: Plot Plan

CONTRACTOR: AMERICAN INTEGRATED SERVICES

ACORD™ CERTIFICATE OF LIABILITY INSURANCE

9/1/2010

DATE (MM/DD/YYYY)
8/29/2008

PRODUCER Lockton Insurance Brokers, LLC
725 S. Figueroa Street, 35th Fl.
CA License #0F15767
Los Angeles CA 90017
(213) 689-0065

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW.

INSURED American Integrated Services, Inc.
1073047 1502 E. Opp Street
Wilmington CA 90744-3927

INSURERS AFFORDING COVERAGE	NAIC #
INSURER A: Commerce and Industry Insurance Company	19410
INSURER B:	
INSURER C:	
INSURER D:	
INSURER E:	

COVERAGES AMEIN05 C6

THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER AND THE CERTIFICATE HOLDER

THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. AGGREGATE LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	ADD'L INSRD	TYPE OF INSURANCE	POLICY NUMBER	POLICY EFFECTIVE DATE (MM/DD/YY)	POLICY EXPIRATION DATE (MM/DD/YY)	LIMITS
		GENERAL LIABILITY <input type="checkbox"/> COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS MADE <input type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC	NOT APPLICABLE			EACH OCCURRENCE \$ XXXXXXXX DAMAGE TO RENTED PREMISES (Ea occurrence) \$ XXXXXXXX MED EXP (Any one person) \$ XXXXXXXX PERSONAL & ADV INJURY \$ XXXXXXXX GENERAL AGGREGATE \$ XXXXXXXX PRODUCTS - COMP/OP AGG \$ XXXXXXXX
		AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO <input type="checkbox"/> ALL OWNED AUTOS <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> HIRED AUTOS <input type="checkbox"/> NON-OWNED AUTOS	NOT APPLICABLE			COMBINED SINGLE LIMIT (Ea accident) \$ XXXXXXXX BODILY INJURY (Per person) \$ XXXXXXXX BODILY INJURY (Per accident) \$ XXXXXXXX PROPERTY DAMAGE (Per accident) \$ XXXXXXXX
		GARAGE LIABILITY <input type="checkbox"/> ANY AUTO	NOT APPLICABLE			AUTO ONLY - EA ACCIDENT \$ XXXXXXXX OTHER THAN AUTO ONLY: EA ACC \$ XXXXXXXX AGG \$ XXXXXXXX
		EXCESS/UMBRELLA LIABILITY <input type="checkbox"/> OCCUR <input type="checkbox"/> CLAIMS MADE <input type="checkbox"/> DEDUCTIBLE <input type="checkbox"/> UMBRELLA FORM RETENTION \$	NOT APPLICABLE			EACH OCCURRENCE \$ XXXXXXXX AGGREGATE \$ XXXXXXXX \$ XXXXXXXX \$ XXXXXXXX \$ XXXXXXXX
A		WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? NO If yes, describe under SPECIAL PROVISIONS below	WC003429675	9/1/2009	9/1/2010	<input checked="" type="checkbox"/> WC STATU-TORY LIMITS <input type="checkbox"/> OTH-ER E.L. EACH ACCIDENT \$ 1,000,000 E.L. DISEASE - EA EMPLOYEE \$ 1,000,000 E.L. DISEASE - POLICY LIMIT \$ 1,000,000
		OTHER				

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES / EXCLUSIONS ADDED BY ENDORSEMENT / SPECIAL PROVISIONS

CERTIFICATE HOLDER

3405649
Contractors State License Board
9821 Business Park Drive
Sacramento CA 95827

CANCELLATION

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, THE ISSUING INSURER WILL ENDEAVOR TO MAIL 30 DAYS WRITTEN NOTICE TO THE CERTIFICATE HOLDER NAMED TO THE LEFT, BUT FAILURE TO DO SO SHALL IMPOSE NO OBLIGATION OR LIABILITY OF ANY KIND UPON THE INSURER, ITS AGENTS OR REPRESENTATIVES.

AUTHORIZED REPRESENTATIVE





State Of California
CONTRACTORS STATE LICENSE BOARD
ACTIVE LICENSE



License Number **757133**

Entity **CORP**

Business Name **AMERICAN INTEGRATED SERVICES
INC**

Classification(s) **A C57 HAZ C21 B C10 ASB C42**

Expiration Date **12/31/2010**



American Integrated Services, Inc.

January 13, 2010

RE: Authorization to obtain permits and city licenses for Contractor

To whom it may concern:

I hereby authorize Ed Wardle to act on my behalf in obtaining permits and licenses from various municipal/organizations and to sign these documents for me. I am properly licensed as required by the State of California.

I assume full responsibility under the law for permits taken by persons authorized to act on my behalf. This authorization shall continue until notified in writing that such authorization is cancelled by the contractor.

Sincerely,

American Integrated Services, Inc.

Contractors Lic.# 757133



Gary Runnells
Vice President


Ed Wardle
Operations



NOTARY

**State of California
County of Los Angeles**

Subscribed and sworn to (or affirmed) before me on this 13th day of January 2010, by Ed Wardle & Gary Runnells, proved to me on the basis of satisfactory evidence to be the person who appeared before me.

Signature  (Seal)
(Notary Public)





DEPARTMENT OF THE ARMY
SACRAMENTO DISTRICT, CORPS OF ENGINEERS
1325 J STREET
SACRAMENTO, CALIFORNIA 95814-2922
06 April 2010

REPLY TO ATTENTION OF: Contracting Division

MEMORANDUM FOR: American Integrated Services, Inc
1502 E Opp St
Wilmington, CA 95814

SUBJECT: Notice to Proceed (NTP), Contract W91238-08-D-0008-0006, Underground Storage Tank,
San Lorenzo, CA


1. This is your Notice to Proceed with work under the above-referenced contract.
2. Please acknowledge receipt of this NTP by insertion of signature and date received in the space provided below. Date of receipt must agree with the date on which this notice is received in your office via facsimile or email transmission. Return the original signed copy to:

U.S. Army Corps of Engineers, Sacramento District
Contracting Division - Charles S. Crivellaro,
1325 J Street, Room 878
Sacramento, CA 95814-2922

3. The period of performance in accordance with your contract is 60 calendar days from the Notice to Proceed date.
4. Please direct questions to Charles S. Crivellaro, 916-557-5182 or charles.s.crivellaro@usace.army.mil.


GREGORY L. TOM
Contracting Officer

ACKNOWLEDGMENT OF RECEIPT:

Received: April 6, 2010
(Date)
By:  Kelly Stater
Signature Printed Name
Title: Vice President

I declare that to the best of my knowledge and belief that the statements and information provided above are correct and true.

I understand that information, in addition to that provided above, may be needed in order to obtain approval from the Environmental Protection Division and that no work is to begin on this project until this plan has been approved.

I understand that any changes in design, materials, or equipment will void this plan if prior approval is not obtained.

I understand that all work performed during this project will be done in compliance with all applicable OSHA (Occupational Safety and Health Administration) requirements concerning personnel health and safety. I understand that site and worker safety are solely the responsibility of the property owner or his agent and that this responsibility is not shared nor assumed by the County of Alameda.

Once I have received my stamped, accepted closure plan, I will contact the project Hazardous Materials Specialist at least three working days in advance of site work to schedule the required inspections.

CONTRACTOR INFORMATION

Name of Business AMERICAN INTEGRATED SERVICES
Name of Individual KELLY STATER
Signature Kelly Stater By Ed Wardle Date 4/28/10

PROPERTY OWNER OR MOST RECENT TANK OPERATOR (Check one)

Name of Business CALIFORNIA ARMY NATIONAL GUARD
Name of Individual FRED DELUCCHI
Signature By ED WAROLE Ed Wardle Date 4/28/10

**UNIFIED PROGRAM CONSOLIDATED FORM
UNDERGROUND STORAGE TANK
OPERATING PERMIT APPLICATION – FACILITY INFORMATION**
(One form per facility)

TYPE OF ACTION (Check one item only) 1. NEW PERMIT 5. CHANGE OF INFORMATION 7. PERMANENT FACILITY CLOSURE 400.
 3. RENEWAL PERMIT 6. TEMPORARY FACILITY CLOSURE 9. TRANSFER PERMIT

I. FACILITY INFORMATION

TOTAL NUMBER OF USTs AT FACILITY 404. ONE FACILITY ID # (Agency Use Only) 1.
 BUSINESS NAME (Same as Facility Name or DBA – Doing Business As) 3. CALIFORNIA ARMY NATIONAL GUARD ARMORY
 BUSINESS SITE ADDRESS 103. 16 501 ASHLAND AVE CITY 104. SAN LORENZO
 FACILITY TYPE 1. MOTOR VEHICLE FUELING 2. FUEL DISTRIBUTION 403. Is the facility located on Indian Reservation or Trust lands? 1. Yes 2. No 405.
 3. FARM 4. PROCESSOR 6. OTHER

II. PROPERTY OWNER INFORMATION

PROPERTY OWNER NAME 407. CALIFORNIA ARMY NATIONAL GUARD PHONE 408. (918) 854-3542
 MAILING ADDRESS 409. 9800 GOETHE ROAD
 CITY 410. SACRAMENTO STATE 411. CA ZIP CODE 412. 95827

III. TANK OPERATOR INFORMATION

TANK OPERATOR NAME 428-1. CALIFORNIA ARMY NATIONAL GUARD PHONE 428-2. (918) 854-3542
 MAILING ADDRESS 428-3. 9800 GOETHE ROAD
 CITY 428-4. SACRAMENTO STATE 428-5. CA ZIP CODE 428-6. 95827

IV. TANK OWNER INFORMATION

TANK OWNER NAME 414. SAME AS TANK OPERATOR PHONE 415. ()
 MAILING ADDRESS 416. SAME AS TANK OPERATOR
 CITY 417. STATE 418. ZIP CODE 419.
 OWNER TYPE: 4. LOCAL AGENCY/DISTRICT 5. COUNTY AGENCY 6. STATE AGENCY 420.
 7. FEDERAL AGENCY 8. NON-GOVERNMENT

V. BOARD OF EQUALIZATION UST STORAGE FEE ACCOUNT NUMBER

TY (TK) HQ 44- 000389 Call the State Board of Equalization, Fuel Tax Division, if there are questions. 421.

VI. PERMIT HOLDER INFORMATION

Issue permit and send legal notifications and mailings to: TKMT OPERATIONAL MAINTENANCE
 1. FACILITY OWNER 4. TANK OPERATOR 423.
 3. TANK OWNER 5. FACILITY OPERATOR
 SUPERVISOR OF DIVISION, SECTION, OR OFFICE (Required for Public Agencies Only) 406.

VII. APPLICANT SIGNATURE

CERTIFICATION: I certify that the information provided herein is true, accurate, and in full compliance with legal requirements.
 APPLICANT SIGNATURE [Signature] DATE 424. 4/13/2010 PHONE 425. (810) 522-1168
 APPLICANT NAME (print) 426. ED WARDLE APPLICANT TITLE 427. OPERATIONS AMERICAN INTEGRATED SERVICES

**UNIFIED PROGRAM CONSOLIDATED FORM
UNDERGROUND STORAGE TANK
OPERATING PERMIT APPLICATION - TANK INFORMATION** (One form per UST)

TYPE OF ACTION (Check one item only. For a UST closure or removal, complete only this section and Sections I, II, III, IV, and IX below) 430.

1. NEW PERMIT 3. RENEWAL PERMIT 5. CHANGE OF INFORMATION

6. TEMPORARY UST CLOSURE 7. UST PERMANENT CLOSURE ON SITE 8. UST REMOVAL

DATE UST PERMANENTLY CLOSED: May 2010 ^{430a.} DATE EXISTING UST DISCOVERED: 430b.

I. FACILITY INFORMATION

FACILITY ID # (Agency Use Only) 1.

BUSINESS NAME (Same as Facility Name or DBA - Doing Business As) 3.
CALIFORNIA ARMY NATIONAL GUARD

BUSINESS SITE ADDRESS 104.
16501 ASHLAND AVE ^{103.} CITY DAN LORENZO 94580

II. TANK DESCRIPTION

TANK ID # #1 432. TANK MANUFACTURER UNKNOWN 433. TANK CONFIGURATION: THIS TANK IS 434.

1. A STAND-ALONE TANK Complete one page for each compartment in the unit.

2. ONE IN A COMPARTMENTED UNIT

DATE UST SYSTEM INSTALLED LATE 1990's 435. TANK CAPACITY IN GALLONS 5000 APPROX 436. NUMBER OF COMPARTMENTS IN THE UNIT ONE 437.

III. TANK USE AND CONTENTS

TANK USE 1a. MOTOR VEHICLE FUELING 1b. MARINA FUELING 1c. AVIATION FUELING 439.

3. CHEMICAL PRODUCT STORAGE 4. HAZARDOUS WASTE (Includes Used Oil) 5. EMERGENCY GENERATOR FUEL [HSC §25281.5(c)] 439a.

6. OTHER GENERATOR FUEL 95. UNKNOWN 99. OTHER (Specify): RED DIESEL 439a.

CONTENTS PETROLEUM: 1a. REGULAR UNLEADED 1c. MIDGRADE UNLEADED 1b. PREMIUM UNLEADED 440.

3. DIESEL RED 5. JET FUEL 6. AVIATION GAS 440.

8. PETROLEUM BLEND FUEL 9. OTHER PETROLEUM (Specify): 440a.

NON-PETROLEUM: 7. USED OIL 10. ETHANOL 440b.

11. OTHER NON-PETROLEUM (Specify): 440b.

IV. TANK CONSTRUCTION

TYPE OF TANK 1. SINGLE WALL 2. DOUBLE WALL 95. UNKNOWN 443.

PRIMARY CONTAINMENT 1. STEEL 3. FIBERGLASS 6. INTERNAL BLADDER 444.

7. STEEL + INTERNAL LINING 95. UNKNOWN 99. OTHER (Specify): 444a.

SECONDARY CONTAINMENT 1. STEEL 3. FIBERGLASS 6. EXTERIOR MEMBRANE LINER 7. JACKETED 445.

90. NONE 95. UNKNOWN 99. OTHER (Specify): 445a.

OVERFILL PREVENTION 1. AUDIBLE & VISUAL ALARMS 2. BALL FLOAT 3. FILL TUBE SHUT-OFF VALVE 452.

4. TANK MEETS REQUIREMENTS FOR EXEMPTION FROM OVERFILL PREVENTION EQUIPMENT

V. PRODUCT / WASTE PIPING CONSTRUCTION

PIPING CONSTRUCTION 1. SINGLE WALL 2. DOUBLE WALL 99. OTHER 460.

SYSTEM TYPE 1. PRESSURE 2. GRAVITY 3. CONVENTIONAL SUCTION 4. SAFE SUCTION [23 CCR §2636(a)(3)] 458.

PRIMARY CONTAINMENT 1. STEEL 4. FIBERGLASS 8. FLEXIBLE 10. RIGID PLASTIC 464.

90. NONE 95. UNKNOWN 99. OTHER (Specify): 464a.

SECONDARY CONTAINMENT 1. STEEL 4. FIBERGLASS 8. FLEXIBLE 10. RIGID PLASTIC 464b.

90. NONE 95. UNKNOWN 99. OTHER (Specify): 464c.

PIPING/TURBINE CONTAINMENT SUMP TYPE 1. SINGLE WALL 2. DOUBLE WALL 90. NONE 464d.

VI. VENT, VAPOR RECOVERY (VR) AND RISER / FILL PIPE PIPING CONSTRUCTION

VENT PRIMARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464e.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464e1.

VENT SECONDARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464f.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464f1.

VR PRIMARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464g.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464g1.

VR SECONDARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464h.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464h1.

VENT PIPING TRANSITION SUMP TYPE 1. SINGLE WALL 2. DOUBLE WALL 90. NONE 464i.

RISER PRIMARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464j.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464j1.

RISER SECONDARY CONTAINMENT 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464k.

1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 90. NONE 99. OTHER (Specify): 464k1.

FILL COMPONENTS INSTALLED 1. SPILL BUCKET 3. STRIKER PLATE/BOTTOM PROTECTOR 4. CONTAINMENT SUMP 451a-c.

VII. UNDER DISPENSER CONTAINMENT (UDC)

CONSTRUCTION TYPE 1. SINGLE WALL 2. DOUBLE WALL 3. NO DISPENSERS 90. NONE 469a.

CONSTRUCTION MATERIAL 1. STEEL 4. FIBERGLASS 10. RIGID PLASTIC 99. OTHER (Specify): UNKNOWN 469b.

469c.

VIII. CORROSION PROTECTION

STEEL COMPONENT PROTECTION 2. SACRIFICIAL ANODE(S) 4. IMPRESSED CURRENT 6. ISOLATION UNKNOWN 448.

IX. APPLICANT SIGNATURE

CERTIFICATION: I certify that this UST system is compatible with the hazardous substance stored and that the information provided herein is true, accurate, and in full compliance with legal requirements.

APPLICANT SIGNATURE 470.

DATE 470.

APPLICANT NAME (print) 471.

APPLICANT TITLE 472.

APPENDIX B

UTILITY CLEARANCE/COMPACTION REPORT

=====
To: AMERICAN INTEGRATED SERVICES Attn: ED WARDLE
Voice: 3105221168 Fax: 3105220474
Re: Response to Dig Request

This is an important message from East Bay Municipal Utility District replying to your request to locate our underground facilities in an area described on the one call center ticket.

=====
Ticket: 102680
County: ALAMEDA Place: SAN LORENZO
Address: 16501 ASHLAND AVE

EBWCMS :
Based on information that you provided to Underground Service Alert, East Bay Municipal Utility District has determined that we have no facilities in conflict with your excavation. Please call 1-866-403-2683 if you have any questions.

=====
If you have any questions please contact East Bay Municipal Utility District at 866-403-2683.
=====

TIME WARNER TELECOM

IMPROVING YOUR NETWORK

It has been determined that your excavation under the Underground Service Alert North (U.S.A.N.) Ticket referenced below has **NO CONFLICT** within the scope of the work location you have described on your U.S.A. Ticket. You are **CLEAR** of conflict with Time Warner Fiber-Optics and free to proceed with your work. Our contract locator is Golden State Utility Co. If you have any questions please call **(209) 830-0162**. Thank you for your cooperation in keeping our Fiber-Optic Network safe!!!



Golden State Utility Co. Engineering & Locating Department

Subject: USAN TWABF2 2010/04/14 #00081 0102680-000 NORM NEW

TWABF2 00081 USAN 04/14/10 14:23:02 0102680 NORMAL NOTICE

Message Number: 0102680 Received by USAN at 14:15 on 04/14/10 by RAC

Work Begins: 04/28/10 at 07:30 Notice: 093 hrs Priority: 2
Night Work: N Weekend Work: N

Expires: 05/12/10 at 17:00 Update By: 05/10/10 at 16:59

Caller: ED WARDLE
Company: AMERICAN INTEGRATED SERVICES
Address: 1502 E.OPP ST
City: WILMINGTON State: CA Zip: 90744
Business Tel: 310-522-1168 Fax: 310-522-0474
Email Address: EWARDLE@AMERICANINTEGRATEDSERVICES.COM

Nature of Work: BKHO TO REM UNG FUEL STORAGE TANK
Done for: CALIFORNIA ARMY NATIONAL G Explosives: N
Foreman: O' KELLY
Field Tel: Cell Tel: 805-636-6005

Area Premarked: Y Premark Method: WHITE PAINT
Permit Type: NO
Vac / Pwr Equip Use In The Approx Location Of Member Facilities Requested: N
Excavation Enters Into Street Or Sidewalk Area: N

Location:
Street Address: 16501 ASHLAND AVE
Cross Street: E LEWELLING BLVD

WRK ON REAR/O PROF, EXT APP 325' INTO ADDR

Place: SAN LORENZO, CO AREA County: ALAMEDA State: CA

30077

FROM: AT&T Local Service Cable Protection Center GFI

This is to notify you about status of received tickets. This does not mean that another utility other than AT&T Local Service is clear OR that future and/o different activities at the same location would be clear. This message does not include any AT&T cable formerly known as SBC, Bell South or TCG. If you have any questions about this message or if you believe you have received this notification in error, and that AT&T cable is actually in the vicinity of your excavation activity, please call 1-800-252-1133.

=====
Locate requested by AMERICAN INTEGRATED SERVICES
to the North California One Call Center
One-Call Ticket Message Number: 0102680
Closed with status: AT&T is clear. Ticket was processed by GFI AutoScreener

AT&T Reference Number: 27133322
Work Date & Time: Apr 29 2010 7:30AM
Work Location: 16501 ASHLAND AVE, SAN LORENZO CA
Near intersection: E LEWELLING BLVD

30077



Project: 6501 ASTHAMM AVE, SAN LORENZO
 Subject: Daily Field Report
 From: 7:30 To: 9:05 From: 2:00 To:
 Equipment in Use: 624 LINDER, 200c EXCAVATOR

Job No: 2815.1.11.1
 Date: 6/25/10
 Hours: 1 1/2 hours work
 Report No:

UNSATISFACTORY CONDITIONS PREVIOUSLY REPORTED (Give report date only. Circle dates of items corrected in this report and explain below.)

REMARKS

SITE PLAN 0 10'
 EXCAVATION OF UST NATIONAL GUARD ARMORY
 6501 ASTHAMM AVE, SAN LORENZO, CA

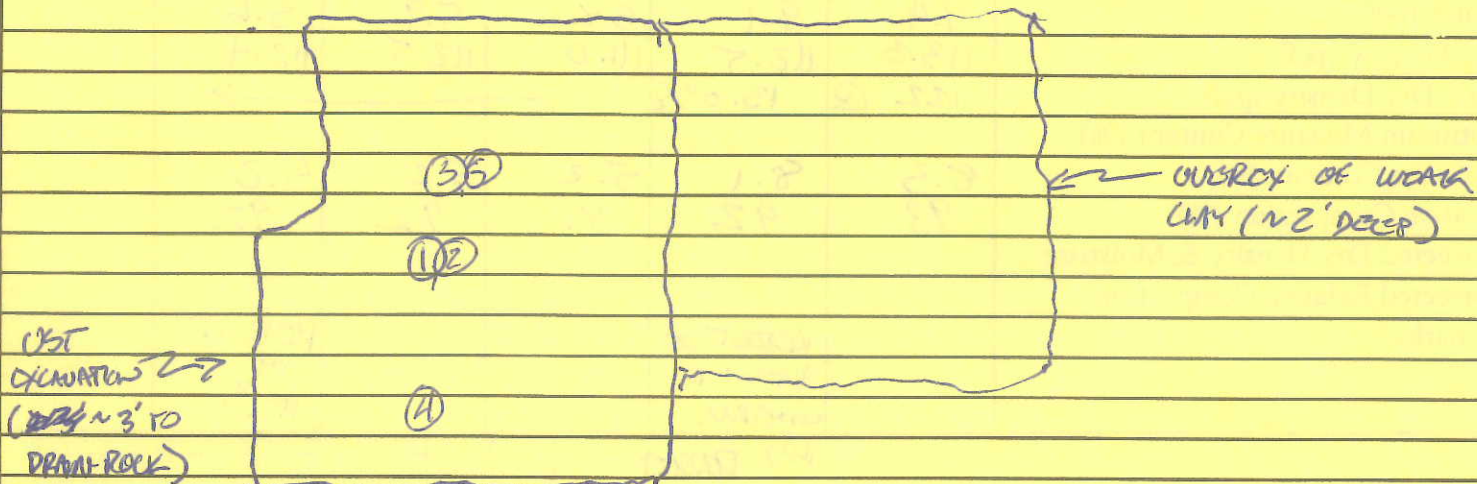

ON SITE 9:00 MET W/ O. KELLY (MURPHY FROM AMERICAN INTEGRATED WHO CONDUCTED A THURSDAY SAFETY MEETING. UPON ARRIVAL THEY HAD EXCAVATED & REMOVED A UST AND BACKFILLED TO APPX. F.G. - 3' W/ 1/2" Ø ROUND DRAIN ROCK. THEY THEN PLACED FILTER FABRIC ON SURFACE OF DRAIN ROCK AND BACKFILLED W/ SAND. I COLLECTED A BULK SAMPLE FOR ~~THE~~ MAX DENSITY CURVE. FIVE FIELD DENSITY TESTS PERFORMED, ALL TESTS ARE PENDING LAB RESULTS. I OBSERVED PUMPING W/ IN OVERLAP AREA ADJACENT TO THE EAST SIDE OF UST EXCAVATION AND NOTIFIED O. KELLY. HE STATED THAT THEY WOULD REMOVE MATERIAL & BACKFILL W/ 1" Ø DRAIN ROCK, FABRIC & SAND LIKE THE UST EXCAVATION. HE STATED THAT WE DID NOT NEED TO TEST THIS AREA.

This Report is preliminary. A preliminary report is prepared solely as evidence that field observation was performed. Observations and/or conclusions and/or recommendations conveyed in the final report may vary from and shall take precedence over those indicated in a preliminary report.

Initial: REP

Project: 16501 ASHTLAND AVE, SAN LORENZO
 Subject: Nuclear Field Density Test
 Gauge No.: 21748 User's Initials: REP
 Moisture Standard (Xi): 590
 Density Standard (Xi): 2079


Job No: 2815-1.1.1
 Date: 6/25/10
 Day: FRI
 Report No: _____
 Page _____ of _____

Test Number	1	2	3	4	5
Depth/Elevation	F6 -1.5'	F6 -1.5'	F6 -0.5'	F6 -0.5'	F6 -0.5'
Location	CENTER	CENTER	W. CENTER	S. CENTER	W. CENTER
Soil Type					
Wet Density (pcf)	122.7	121.6	116.8	118.4	118.0
Water (pcf)	9.4	9.1	5.8	5.9	5.6
Dry Density (pcf)	113.3	112.5	111.0	112.5	112.4
Max. Dry Density (pcf)	122 @	13.0%	—————>		
Optimum Moisture Content (%)					
Moisture Content (%)	8.3	8.1	5.2	5.2	5.0
Relative Compaction (%)	93	92	91	92	92
Corrected Dry Density & Moisture					
Corrected Relative Compaction					
Remarks:		RETEST OF AREA 1 TO CONFIRM			RETEST OF #3

Field Compaction Test (using gram scale):

MAX DENSITY

Mold (g)			
Mold + Wet Soil (g)			
Wet Soil (g)			
Conversion Factor	0.06614	0.06614	0.06614
Wet Density (pcf)			
Pan Number			
Pan Tare (g)			
Pan + Wet Soil (g)			
Pan + Dry Soil (g)			
Moisture Loss (g)			
Dry Soil (g)			
Moisture Content (%)			
Dry Density (pcf)			

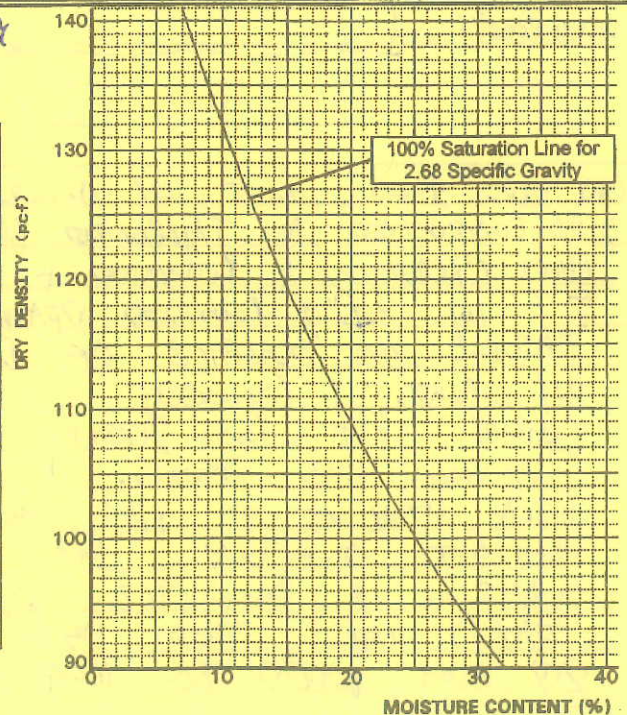


This Report is preliminary. A preliminary report is prepared solely as evidence that field observation was performed. Observations and/or conclusions and/or recommendations conveyed in the final report may vary from and shall take precedence over those indicated in a preliminary report.

PROCTOR TEST REPORT

Curve No.

A

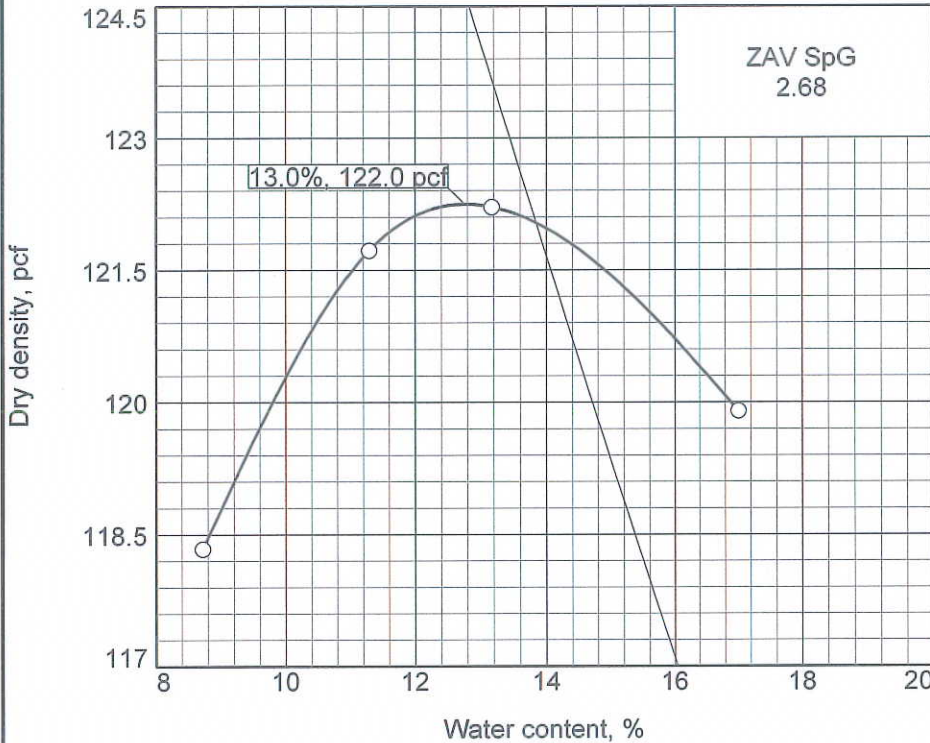

Test Specification:
ASTM D 1557 RGH Modified

Preparation Method Dry Method
 Hammer Wt. 10
 Hammer Drop 18
 Number of Layers 5
 Blows per Layer 25
 Mold Size 0.03333 cu. ft.

Test Performed on Material
 Passing 3/4 in. Sieve

NM LL PI

Sp.G. (ASTM D 854)

%>3/4 in. %<No.200

USCS SP AASHTO

Date Sampled 6-25-10

Date Tested 6-28-10

Tested By SF

TESTING DATA

	1	2	3	4	5	6
WM + WS	4142.0	3966.0	4069.0	4112.0		
WM	2021.0	2021.0	2021.0	2021.0		
WW + T #1	955.0	857.9	986.8	1009.0		
WD + T #1	832.2	797.9	897.9	904.4		
TARE #1	110.1	109.7	110.6	110.2		
WW + T #2						
WD + T #2						
TARE #2						
MOISTURE	17.0	8.7	11.3	13.2		
DRY DENSITY	119.9	118.3	121.7	122.2		

TEST RESULTS

Maximum dry density = 122.0 pcf
 Optimum moisture = 13.0 %

Project No. 2815.01.11.1 **Client:** RGH Consultants
Project: 16501 Ashland Ave. Tank Removal

○ **Source of Sample:** Bulk A **Depth:** 0.0'

R G H CONSULTANTS, INC.

Material Description

Light Brown Sand (SP)

Remarks:

Checked by: TMc
Title: Senior Advisor

Plate

APPENDIX C
SITE PHOTOGRAPHS



1. June 23, 2010 – Clearing of the UST to prepare for removal.



2. June 23, 2010 – Expansion of vent to allow the placement of dry ice.



3. June 23, 2010 – View from about a vault sump.



4. June 23, 2010 – Groundwater was reached during excavation activities.



5. June 23, 2010 – Removal of the UST and transportation via flat-bed truck.



6. June 24, 2010 – Groundwater present within the excavation.



7. June 24, 2010 – Further concrete removal around sump vaults.



8. June 24, 2010 – Demolition of the concrete prior to the removal of rebar.



9. June 24, 2010 – Concrete and exposed rebar to be removed prior to the removal of the sump vaults.



10. June 25, 2010 – The arrival of drainage rock to be placed within the excavations.



11. June 25, 2010 – The arrival of sand to be placed within the excavations.



12. June 25, 2010 – Geotextile fabric has been laid to separate the sand from the drainage rock in the UST excavation.



13. June 25, 2010 – Sand placed over drainage rock and geotextile fabric.



14. June 25, 2010 – Spreading of sand over geotextile fabric.



15. June 28, 2010 – Insertion of geotextile fabric over drainage rock.



16. June 28, 2010 – Cut and capping of piping.



17. June 30, 2010 – Preparation of excavation areas prior to asphalt application.



18. June 30, 2010 – Sawcutting clean lines in the old asphalt to prepare for the new asphalt.



19. June 30, 2010 – Excavation areas prepared for arrival of asphalt.



20. June 30, 2010 – Protection of stockpiled soil with high-density polyethylene prior to removal.



21. July 1, 2010 – Compacting the base prior to asphalt application.



22. July 1, 2010 – Start of asphalt application near maintenance building.



23. July 1, 2010 – Spreading of asphalt to match surrounding area.



24. July 1, 2010 – Finished asphalt at the San Lorenzo yard.

APPENDIX D
UST CERTIFICATE OF DESTRUCTION



August 20, 2010

American Integrated Services

1502 E. Opp Street
Wilmington, CA 90744

Attention: Mr. O. Kelly Murphy

RE: Certificate of Destruction

Dear Mr. Murphy,
This letter shall serve as a Certificate of Destruction.

On June 23, 2010 we received as UST from your project in San Lorenzo, and was shipped back to our yard via our transport. The UST was subsequently cold sheared into the smallest recyclable components possible, and reduced to scrap metal.

Please do not hesitate to call our office if you have any questions.

Respectfully,
A & S Metals and Demolition

Tom Pietras, Demolition Division Manager

- **Castroville -Corporate Office**
11340 Commercial Parkway,
PO Box 955
Castroville, California 95012
p: [831] 633-3379
f: [831] 633-2447
- **Los Banos**
2510 Technology Drive
Los Banos, California 93635
p: [209] 829-1943
f: [209] 829-1612
- **Modesto**
1616 Angelo Way
Modesto, California 95358
p: [209] 537-4766
f: [209] 537-5312
- **Salinas**
456 Brunken Avenue,
Salinas, California 93901
p: [831] 424-3367
f: [831] 424-3392
- **Watsonville**
620 Walker Street #1
Watsonville, California 95076
p: [831] 722-3597
f: [831] 722-5583
- **Butte Montana**
2100 Meadowlark Lane
Butte, Montana 59701
p: [406] 494-1661
f: [406] 494-1607

APPENDIX E

LABORATORY AND QUALITY ASSURANCE/QUALITY CONTROL (QA/QC) REPORTS & CHAIN-OF-CUSTODY RECORDS



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Reported: 06/24/10
	Client P.O.:	Date Completed: 06/24/10

WorkOrder: 1006635

June 24, 2010

Dear Kelly:

Enclosed within are:

- 1) The results of the **6** analyzed samples from your project: **#30077; San Lorenzo,**
- 2) A QC report for the above samples,
- 3) A copy of the chain of custody, and
- 4) An invoice for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits.

If you have any questions or concerns, please feel free to give me a call. Thank you for choosing

McC Campbell Analytical Laboratories for your analytical needs.

Best regards,

Angela Rydelius
Laboratory Manager
McC Campbell Analytical, Inc.

McC Campbell Analytical, Inc.



1534 Willow Pass Rd
 Pittsburg, CA 94565-1701
 (925) 252-9262

CHAIN-OF-CUSTODY RECORD

WorkOrder: 1006635

ClientCode: AIVC

WaterTrax WriteOn EDF Excel Fax Email HardCopy ThirdParty J-flag

Report to:

Kelly Stater
 American Intergrated Services
 1650 Palma Dr., Ste. 207
 Ventura, CA 93003
 (805) 639-0884 FAX (805) 639-0924

Email: kstater@americanintergrated.com
 cc:
 PO:
 ProjectNo: #30077; San Lorenzo

Bill to:

Kelly Therrien
 American Intergrated Services
 1650 Palma Dr., Ste. 207
 Ventura, CA 93003

Requested TAT: 1 day

Date Received: 06/23/2010

Date Printed: 06/23/2010

Lab ID	Client ID	Matrix	Collection Date	Hold	Requested Tests (See legend below)											
					1	2	3	4	5	6	7	8	9	10	11	12
1006635-001	Comp-Clarifier-1	Water	6/23/2010 9:30	<input type="checkbox"/>	A			A	A							
1006635-002	Comp-Rin-1	Water	6/23/2010 13:20	<input type="checkbox"/>	B			C	A							
1006635-003	UST-GW-1	Water	6/23/2010 15:20	<input type="checkbox"/>			B				A					
1006635-004	Soil-West-9	Soil	6/23/2010 15:45	<input type="checkbox"/>		A				A						
1006635-005	Soil-Dispenser-North-5	Soil	6/23/2010 15:45	<input type="checkbox"/>		A				A						
1006635-006	Soil-South-8	Soil	6/23/2010 15:45	<input type="checkbox"/>		A				A						

Test Legend:

1	8260B_W	2	8260VOC_S	3	8260VOC_W	4	CAM17(T)MS_W	5	G-MBTEX_W
6	TPH(D)_S	7	TPH(D)_W	8		9		10	
11		12							

The following SampIDs: 001A, 002A contain testgroup.

Prepared by: Ana Venegas

Comments: 24hr rush

NOTE: Soil samples are discarded 60 days after results are reported unless other arrangements are made (Water samples are 30 days).
 Hazardous samples will be returned to client or disposed of at client expense.



Sample Receipt Checklist

Client Name: **American Intergrated Services** Date and Time Received: **6/23/2010 6:19:01 PM**
 Project Name: **#30077; San Lorenzo** Checklist completed and reviewed by: **Ana Venegas**
 WorkOrder N°: **1006635** Matrix Soil/Water Carrier: Benjamin Yslas (MAI Courier)

Chain of Custody (COC) Information

Chain of custody present? Yes No
 Chain of custody signed when relinquished and received? Yes No
 Chain of custody agrees with sample labels? Yes No
 Sample IDs noted by Client on COC? Yes No
 Date and Time of collection noted by Client on COC? Yes No
 Sampler's name noted on COC? Yes No

Sample Receipt Information

Custody seals intact on shipping container/cooler? Yes No NA
 Shipping container/cooler in good condition? Yes No
 Samples in proper containers/bottles? Yes No
 Sample containers intact? Yes No
 Sufficient sample volume for indicated test? Yes No

Sample Preservation and Hold Time (HT) Information

All samples received within holding time? Yes No
 Container/Temp Blank temperature Cooler Temp: 9.4°C NA
 Water - VOA vials have zero headspace / no bubbles? Yes No No VOA vials submitted
 Sample labels checked for correct preservation? Yes No
 Metal - pH acceptable upon receipt (pH<2)? Yes No NA
 Samples Received on Ice? Yes No
 (Ice Type: WET ICE)

* NOTE: If the "No" box is checked, see comments below.

Client contacted: Date contacted: Contacted by:

Comments: Sample #1 was preserved for total metals.



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed: 06/23/10

Volatile Organics by P&T and GC/MS (Basic Target List)*

Extraction Method: SW5030B

Analytical Method: SW8260B

Work Order: 1006635

Lab ID	1006635-001A
Client ID	Comp-Clarifier-1
Matrix	Water

Compound	Concentration *	DF	Reporting Limit	Compound	Concentration *	DF	Reporting Limit
Acetone	ND	1.0	10	tert-Amyl methyl ether (TAME)	ND	1.0	0.5
Benzene	ND	1.0	0.5	Bromobenzene	ND	1.0	0.5
Bromochloromethane	ND	1.0	0.5	Bromodichloromethane	ND	1.0	0.5
Bromoform	ND	1.0	0.5	Bromomethane	ND	1.0	0.5
2-Butanone (MEK)	ND	1.0	2.0	t-Butyl alcohol (TBA)	ND	1.0	2.0
n-Butyl benzene	ND	1.0	0.5	sec-Butyl benzene	ND	1.0	0.5
tert-Butyl benzene	ND	1.0	0.5	Carbon Disulfide	ND	1.0	0.5
Carbon Tetrachloride	ND	1.0	0.5	Chlorobenzene	ND	1.0	0.5
Chloroethane	ND	1.0	0.5	Chloroform	ND	1.0	0.5
Chloromethane	ND	1.0	0.5	2-Chlorotoluene	ND	1.0	0.5
4-Chlorotoluene	ND	1.0	0.5	Dibromochloromethane	ND	1.0	0.5
1,2-Dibromo-3-chloropropane	ND	1.0	0.2	1,2-Dibromoethane (EDB)	ND	1.0	0.5
Dibromomethane	ND	1.0	0.5	1,2-Dichlorobenzene	ND	1.0	0.5
1,3-Dichlorobenzene	ND	1.0	0.5	1,4-Dichlorobenzene	ND	1.0	0.5
Dichlorodifluoromethane	ND	1.0	0.5	1,1-Dichloroethane	ND	1.0	0.5
1,2-Dichloroethane (1,2-DCA)	ND	1.0	0.5	1,1-Dichloroethene	ND	1.0	0.5
cis-1,2-Dichloroethene	ND	1.0	0.5	trans-1,2-Dichloroethene	ND	1.0	0.5
1,2-Dichloropropane	ND	1.0	0.5	1,3-Dichloropropane	ND	1.0	0.5
2,2-Dichloropropane	ND	1.0	0.5	1,1-Dichloropropene	ND	1.0	0.5
cis-1,3-Dichloropropene	ND	1.0	0.5	trans-1,3-Dichloropropene	ND	1.0	0.5
Diisopropyl ether (DIPE)	ND	1.0	0.5	Ethylbenzene	ND	1.0	0.5
Ethyl tert-butyl ether (ETBE)	ND	1.0	0.5	Freon 113	ND	1.0	10
Hexachlorobutadiene	ND	1.0	0.5	Hexachloroethane	ND	1.0	0.5
2-Hexanone	ND	1.0	0.5	Isopropylbenzene	ND	1.0	0.5
4-Isopropyl toluene	ND	1.0	0.5	Methyl-t-butyl ether (MTBE)	ND	1.0	0.5
Methylene chloride	ND	1.0	0.5	4-Methyl-2-pentanone (MIBK)	ND	1.0	0.5
Naphthalene	ND	1.0	0.5	n-Propyl benzene	ND	1.0	0.5
Styrene	ND	1.0	0.5	1,1,1,2-Tetrachloroethane	ND	1.0	0.5
1,1,1,2-Tetrachloroethane	ND	1.0	0.5	Tetrachloroethene	ND	1.0	0.5
Toluene	ND	1.0	0.5	1,2,3-Trichlorobenzene	ND	1.0	0.5
1,2,4-Trichlorobenzene	ND	1.0	0.5	1,1,1-Trichloroethane	ND	1.0	0.5
1,1,2-Trichloroethane	ND	1.0	0.5	Trichloroethene	ND	1.0	0.5
Trichlorofluoromethane	ND	1.0	0.5	1,2,3-Trichloropropane	ND	1.0	0.5
1,2,4-Trimethylbenzene	ND	1.0	0.5	1,3,5-Trimethylbenzene	ND	1.0	0.5
Vinyl Chloride	ND	1.0	0.5	Xylenes	ND	1.0	0.5

Surrogate Recoveries (%)

%SS1:	104	%SS2:	100
%SS3:	95		

Comments:

* water and vapor samples are reported in µg/L, soil/sludge/solid samples in mg/kg, product/oil/non-aqueous liquid samples and all TCLP & SPLP extracts are reported in mg/L, wipe samples in µg/wipe.

ND means not detected above the reporting limit/method detection limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or coelutes with another peak; &) low surrogate due to matrix interference.

%SS = Percent Recovery of Surrogate Standard

DF = Dilution Factor

b1) aqueous sample that contains greater than ~1 vol. % sediment

b6) lighter than water immiscible sheen/product is present



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701

Web: www.mcccampbell.com E-mail: main@mcccampbell.com

Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed: 06/23/10

Volatile Organics by P&T and GC/MS (Basic Target List)*

Extraction Method: SW5030B

Analytical Method: SW8260B

Work Order: 1006635

Lab ID	1006635-002B
Client ID	Comp-Rin-1
Matrix	Water

Compound	Concentration *	DF	Reporting Limit	Compound	Concentration *	DF	Reporting Limit
Acetone	ND<1000	100	10	tert-Amyl methyl ether (TAME)	ND<50	100	0.5
Benzene	ND<50	100	0.5	Bromobenzene	ND<50	100	0.5
Bromochloromethane	ND<50	100	0.5	Bromodichloromethane	ND<50	100	0.5
Bromoform	ND<50	100	0.5	Bromomethane	ND<50	100	0.5
2-Butanone (MEK)	ND<200	100	2.0	t-Butyl alcohol (TBA)	ND<200	100	2.0
n-Butyl benzene	540	100	0.5	sec-Butyl benzene	88	100	0.5
tert-Butyl benzene	ND<50	100	0.5	Carbon Disulfide	ND<50	100	0.5
Carbon Tetrachloride	ND<50	100	0.5	Chlorobenzene	ND<50	100	0.5
Chloroethane	ND<50	100	0.5	Chloroform	ND<50	100	0.5
Chloromethane	ND<50	100	0.5	2-Chlorotoluene	ND<50	100	0.5
4-Chlorotoluene	ND<50	100	0.5	Dibromochloromethane	ND<50	100	0.5
1,2-Dibromo-3-chloropropane	ND<20	100	0.2	1,2-Dibromoethane (EDB)	ND<50	100	0.5
Dibromomethane	ND<50	100	0.5	1,2-Dichlorobenzene	ND<50	100	0.5
1,3-Dichlorobenzene	ND<50	100	0.5	1,4-Dichlorobenzene	ND<50	100	0.5
Dichlorodifluoromethane	ND<50	100	0.5	1,1-Dichloroethane	ND<50	100	0.5
1,2-Dichloroethane (1,2-DCA)	ND<50	100	0.5	1,1-Dichloroethene	ND<50	100	0.5
cis-1,2-Dichloroethene	ND<50	100	0.5	trans-1,2-Dichloroethene	ND<50	100	0.5
1,2-Dichloropropane	ND<50	100	0.5	1,3-Dichloropropane	ND<50	100	0.5
2,2-Dichloropropane	ND<50	100	0.5	1,1-Dichloropropene	ND<50	100	0.5
cis-1,3-Dichloropropene	ND<50	100	0.5	trans-1,3-Dichloropropene	ND<50	100	0.5
Diisopropyl ether (DIPE)	ND<50	100	0.5	Ethylbenzene	120	100	0.5
Ethyl tert-butyl ether (ETBE)	ND<50	100	0.5	Freon 113	ND<1000	100	10
Hexachlorobutadiene	ND<50	100	0.5	Hexachloroethane	ND<50	100	0.5
2-Hexanone	ND<50	100	0.5	Isopropylbenzene	ND<50	100	0.5
4-Isopropyl toluene	ND<50	100	0.5	Methyl-t-butyl ether (MTBE)	ND<50	100	0.5
Methylene chloride	ND<50	100	0.5	4-Methyl-2-pentanone (MIBK)	ND<50	100	0.5
Naphthalene	ND<50	100	0.5	n-Propyl benzene	140	100	0.5
Styrene	ND<50	100	0.5	1,1,1,2-Tetrachloroethane	ND<50	100	0.5
1,1,1,2-Tetrachloroethane	ND<50	100	0.5	Tetrachloroethene	ND<50	100	0.5
Toluene	65	100	0.5	1,2,3-Trichlorobenzene	ND<50	100	0.5
1,2,4-Trichlorobenzene	ND<50	100	0.5	1,1,1-Trichloroethane	ND<50	100	0.5
1,1,2-Trichloroethane	ND<50	100	0.5	Trichloroethene	ND<50	100	0.5
Trichlorofluoromethane	ND<50	100	0.5	1,2,3-Trichloropropane	ND<50	100	0.5
1,2,4-Trimethylbenzene	1200	100	0.5	1,3,5-Trimethylbenzene	390	100	0.5
Vinyl Chloride	ND<50	100	0.5	Xylenes	760	100	0.5

Surrogate Recoveries (%)

%SS1:	101	%SS2:	98
%SS3:	86		

Comments: b6,b1

* water and vapor samples are reported in µg/L, soil/sludge/solid samples in mg/kg, product/oil/non-aqueous liquid samples and all TCLP & SPLP extracts are reported in mg/L, wipe samples in µg/wipe.

ND means not detected above the reporting limit/method detection limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or coelutes with another peak; &) low surrogate due to matrix interference.

%SS = Percent Recovery of Surrogate Standard

DF = Dilution Factor

b1) aqueous sample that contains greater than ~1 vol. % sediment

b6) lighter than water immiscible sheen/product is present



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mccampbell.com E-mail: main@mccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed: 06/23/10

Volatile Organics by P&T and GC/MS*

Extraction Method: SW5030B

Analytical Method: SW8260B

Work Order: 1006635

Lab ID	1006635-004A	1006635-005A	1006635-006A		Reporting Limit for DF =1
Client ID	Soil-West-9	Soil-Dispenser- North-5	Soil-South-8		
Matrix	S	S	S		
DF	1	1	1		

Compound	Concentration				mg/Kg	ug/L
	tert-Amyl methyl ether (TAME)	ND	ND	ND		0.005
Benzene	ND	ND	ND		0.005	NA
t-Butyl alcohol (TBA)	ND	ND	ND		0.05	NA
Diisopropyl ether (DIPE)	ND	ND	ND		0.005	NA
Ethylbenzene	ND	ND	ND		0.005	NA
Ethyl tert-butyl ether (ETBE)	ND	ND	ND		0.005	NA
Methyl-t-butyl ether (MTBE)	ND	ND	ND		0.005	NA
Toluene	ND	ND	ND		0.005	NA
Xylenes	ND	ND	ND		0.005	NA

Surrogate Recoveries (%)

%SS1:	103	103	101	
%SS2:	104	104	103	
%SS3:	102	96	99	

Comments

* water and vapor samples and all TCLP & SPLP extracts are reported in µg/L, soil/sludge/solid samples in mg/kg, wipe samples in µg/wipe, product/oil/non-aqueous liquid samples in mg/L.

ND means not detected above the reporting limit/method detection limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or surrogate coelutes with another peak.

%SS = Percent Recovery of Surrogate Standard

DF = Dilution Factor



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed: 06/23/10

Volatile Organics by P&T and GC/MS*

Extraction Method: SW5030B

Analytical Method: SW8260B

Work Order: 1006635

Lab ID	1006635-003B				Reporting Limit for DF =1	
Client ID	UST-GW-1					
Matrix	W					
DF	1					

Compound	Concentration				ug/kg	µg/L
tert-Amyl methyl ether (TAME)	ND				NA	0.5
Benzene	ND				NA	0.5
t-Butyl alcohol (TBA)	ND				NA	2.0
Diisopropyl ether (DIPE)	ND				NA	0.5
Ethylbenzene	0.62				NA	0.5
Ethyl tert-butyl ether (ETBE)	ND				NA	0.5
Methyl-t-butyl ether (MTBE)	ND				NA	0.5
Toluene	ND				NA	0.5
Xylenes	6.1				NA	0.5

Surrogate Recoveries (%)

%SS1:	116			
%SS2:	103			
%SS3:	89			

Comments	b1			
-----------------	----	--	--	--

* water and vapor samples and all TCLP & SPLP extracts are reported in µg/L, soil/sludge/solid samples in µg/kg, wipe samples in µg/wipe, product/oil/non-aqueous liquid samples in mg/L.

ND means not detected above the reporting limit/method detection limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or surrogate coelutes with another peak.

%SS = Percent Recovery of Surrogate Standard

DF = Dilution Factor

b1) aqueous sample that contains greater than ~1 vol. % sediment



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mccampbell.com E-mail: main@mccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed 06/24/10

CAM / CCR 17 Metals*

Lab ID	1006635-001A	1006635-002C			Reporting Limit for DF =1; ND means not detected above the reporting limit	
Client ID	Comp-Clarifier-1	Comp-Rin-1				
Matrix	W	W			S	W
Extraction Type	TOTAL	TOTAL			mg/kg	µg/L

ICP-MS Metals, Concentration*

Analytical Method: E200.8

Extraction Method: E200.8

Work Order: 1006635

Dilution Factor	1	1			1	1
Antimony	1.4	7.7			NA	0.5
Arsenic	1.0	42			NA	0.5
Barium	120	77			NA	5.0
Beryllium	ND	ND			NA	0.5
Cadmium	5.5	39			NA	0.25
Chromium	4.4	490			NA	0.5
Cobalt	1.1	220			NA	0.5
Copper	30	780			NA	0.5
Lead	31	480			NA	0.5
Mercury	ND	0.13			NA	0.025
Molybdenum	3.0	1.6			NA	0.5
Nickel	15	1100			NA	0.5
Selenium	ND	ND			NA	0.5
Silver	ND	0.41			NA	0.19
Thallium	ND	ND			NA	0.5
Vanadium	3.4	26			NA	0.5
Zinc	620	1400			NA	5.0
%SS:	102	111				

Comments

b1

*water samples are reported in µg/L, product/oil/non-aqueous liquid samples and all TCLP / STLC / DISTLC / SPLP extracts are reported in mg/L, soil/sludge/solid samples in mg/kg, wipe samples in µg/wipe, filter samples in µg/filter.

means surrogate diluted out of range; ND means not detected above the reporting limit/method detection limit; N/A means not applicable to this sample or instrument.

TOTAL = Hot acid digestion of a representative sample aliquot.
TRM = Total recoverable metals is the "direct analysis" of a sample aliquot taken from its acid-preserved container.
DISS = Dissolved metals by direct analysis of 0.45 µm filtered and acidified sample.

%SS = Percent Recovery of Surrogate Standard
DF = Dilution Factor

b1) aqueous sample that contains greater than ~1 vol. % sediment



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 06/23/10
		Date Received: 06/23/10
	Client Contact: Kelly Stater	Date Extracted: 06/23/10
	Client P.O.:	Date Analyzed: 06/24/10

Total Extractable Petroleum Hydrocarbons*

Extraction method: SW3510C

Analytical methods: SW8015B

Work Order: 1006635

Lab ID	Client ID	Matrix	TPH-Diesel (C10-C23)	TPH-Motor Oil (C18-C36)	DF	% SS	Comments
1006635-001A	Comp-Clarifier-1	W	290	800	1	103	e7,e2
1006635-002A	Comp-Rin-1	W	1,400,000	350,000	200	89	e1/e10,b6,b1

Reporting Limit for DF =1; ND means not detected at or above the reporting limit	W	50	250	µg/L
	S	NA	NA	mg/Kg

* water samples are reported in µg/L, wipe samples in µg/wipe, soil/solid/sludge samples in mg/kg, product/oil/non-aqueous liquid samples in mg/L, and all DISTLC / STLC / SPLP / TCLP extracts are reported in µg/L.

cluttered chromatogram resulting in coeluted surrogate and sample peaks, or; surrogate peak is on elevated baseline, or; surrogate has been diminished by dilution of original extract.

+The following descriptions of the TPH chromatogram are cursory in nature and McC Campbell Analytical is not responsible for their interpretation:

%SS = Percent Recovery of Surrogate Standard
DF = Dilution Factor

b1) aqueous sample that contains greater than ~1 vol. % sediment
b6) lighter than water immiscible sheen/product is present
e1) unmodified or weakly modified diesel is significant; and/or e10) fuel oil
e2) diesel range compounds are significant; no recognizable pattern
e7) oil range compounds are significant

R ANALYST: R. J. M...



QC SUMMARY REPORT FOR SW8021B/8015Bm

W.O. Sample Matrix: Water

QC Matrix: Water

BatchID: 51386

WorkOrder 1006635

Analyte	EPA Method SW8021B/8015Bm		Extraction SW5030B						Spiked Sample ID: 1006635-001A			
	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH(btex) [£]	ND	60	100	90.6	9.88	96	94.6	1.44	70 - 130	20	70 - 130	20
MTBE	ND	10	96.5	94.2	2.40	94.6	96.9	2.36	70 - 130	20	70 - 130	20
Benzene	ND	10	89.5	84	6.30	87.1	89.3	2.47	70 - 130	20	70 - 130	20
Toluene	ND	10	90.4	84.9	6.31	87.4	90.1	3.07	70 - 130	20	70 - 130	20
Ethylbenzene	ND	10	89.8	83.6	7.20	86.4	89.8	3.80	70 - 130	20	70 - 130	20
Xylenes	ND	30	91.7	85.2	7.33	88	91.1	3.48	70 - 130	20	70 - 130	20
%SS:	105	10	98	98	0	97	99	2.34	70 - 130	20	70 - 130	20

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51386 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-001A	06/23/10 9:30 AM	06/23/10	06/23/10 11:45 PM	1006635-002A	06/23/10 1:20 PM	06/24/10	06/24/10 12:18 AM

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

£ TPH(btex) = sum of BTEX areas from the FID.

cluttered chromatogram; sample peak coelutes with surrogate peak.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = matrix interference and/or analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content, or inconsistency in sample containers.



QC SUMMARY REPORT FOR SW8260B

W.O. Sample Matrix: Water

QC Matrix: Water

BatchID: 51388

WorkOrder 1006635

EPA Method SW8260B	Extraction SW5030B								Spiked Sample ID: 1006635-001A			
	Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)		
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
tert-Amyl methyl ether (TAME)	ND	10	90.4	87.6	3.16	85.8	88.1	2.67	70 - 130	30	70 - 130	30
Benzene	ND	10	112	111	0.832	109	109	0	70 - 130	30	70 - 130	30
t-Butyl alcohol (TBA)	ND	50	94.1	94	0.150	89.3	88	1.43	70 - 130	30	70 - 130	30
Chlorobenzene	ND	10	109	105	3.72	105	104	0.451	70 - 130	30	70 - 130	30
1,2-Dibromoethane (EDB)	ND	10	109	105	4.05	102	102	0	70 - 130	30	70 - 130	30
1,2-Dichloroethane (1,2-DCA)	ND	10	116	114	2.30	112	113	0.960	70 - 130	30	70 - 130	30
1,1-Dichloroethene	ND	10	105	103	1.83	102	100	2.03	70 - 130	30	70 - 130	30
Diisopropyl ether (DIPE)	ND	10	118	114	3.52	114	113	0.679	70 - 130	30	70 - 130	30
Ethyl tert-butyl ether (ETBE)	ND	10	111	109	2.13	108	107	0.710	70 - 130	30	70 - 130	30
Methyl-t-butyl ether (MTBE)	ND	10	117	115	1.37	111	111	0	70 - 130	30	70 - 130	30
Toluene	ND	10	95.2	92.9	2.52	91.9	91.6	0.304	70 - 130	30	70 - 130	30
Trichloroethene	ND	10	108	107	0.505	105	104	1.45	70 - 130	30	70 - 130	30
%SS1:	104	25	121	124	2.47	122	121	0.325	70 - 130	30	70 - 130	30
%SS2:	100	25	110	110	0	109	110	1.06	70 - 130	30	70 - 130	30
%SS3:	95	2.5	98	98	0	97	95	2.35	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51388 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-001A	06/23/10 9:30 AM	06/23/10	06/23/10 8:58 PM	1006635-002B	06/23/10 1:20 PM	06/23/10	06/23/10 8:16 PM
1006635-003B	06/23/10 3:20 PM	06/23/10	06/23/10 9:29 PM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.

surrogate diluted out of range or coelutes with another peak; &) low surrogate due to matrix interference.

Laboratory extraction solvents such as methylene chloride and acetone may occasionally appear in the method blank at low levels.



QC SUMMARY REPORT FOR SW8015B

W.O. Sample Matrix: Soil

QC Matrix: Soil

BatchID: 51389

WorkOrder 1006635

EPA Method SW8015B		Extraction SW3550B							Spiked Sample ID: 1006635-004A			
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	mg/Kg	mg/Kg	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH-Diesel (C10-C23)	ND	40	119	119	0	115	115	0	70 - 130	30	70 - 130	30
%SS:	117	25	118	118	0	101	102	0.101	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51389 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-004A	06/23/10 3:45 PM	06/23/10	06/24/10 12:02 AM	1006635-005A	06/23/10 3:45 PM	06/23/10	06/24/10 5:42 AM
1006635-006A	06/23/10 3:45 PM	06/23/10	06/24/10 6:50 AM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = $100 * (MS - Sample) / (Amount Spiked)$; RPD = $100 * (MS - MSD) / ((MS + MSD) / 2)$.

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.



QC SUMMARY REPORT FOR SW8260B

W.O. Sample Matrix: Soil

QC Matrix: Soil

BatchID: 51330

WorkOrder 1006635

EPA Method SW8260B	Extraction SW5030B								Spiked Sample ID: 1006531-001A			
	Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)		
	mg/Kg	mg/Kg	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
tert-Amyl methyl ether (TAME)	ND	0.050	81.1	76.1	6.38	82.1	78.5	4.57	70 - 130	30	70 - 130	30
Benzene	ND	0.050	115	111	3.16	94.9	90.1	5.17	70 - 130	30	70 - 130	30
t-Butyl alcohol (TBA)	ND	0.25	95.9	91.1	5.19	84.9	84.2	0.885	70 - 130	30	70 - 130	30
Chlorobenzene	ND	0.050	113	109	3.58	107	102	5.01	70 - 130	30	70 - 130	30
1,2-Dibromoethane (EDB)	ND	0.050	107	100	6.44	111	106	4.25	70 - 130	30	70 - 130	30
1,2-Dichloroethane (1,2-DCA)	ND	0.050	110	106	3.38	104	99.4	4.08	70 - 130	30	70 - 130	30
1,1-Dichloroethene	ND	0.050	113	113	0	91.7	87.1	5.04	70 - 130	30	70 - 130	30
Diisopropyl ether (DIPE)	ND	0.050	111	108	2.98	91.7	86.8	5.50	70 - 130	30	70 - 130	30
Ethyl tert-butyl ether (ETBE)	ND	0.050	104	99	4.57	93	88.1	5.42	70 - 130	30	70 - 130	30
Methyl-t-butyl ether (MTBE)	ND	0.050	112	106	5.39	101	96.8	3.81	70 - 130	30	70 - 130	30
Toluene	ND	0.050	110	106	3.51	108	101	6.47	70 - 130	30	70 - 130	30
Trichloroethene	ND	0.050	110	108	2.21	116	112	4.11	70 - 130	30	70 - 130	30
%SS1:	105	0.13	116	115	0.377	102	104	1.87	70 - 130	30	70 - 130	30
%SS2:	109	0.13	121	121	0	109	108	1.17	70 - 130	30	70 - 130	30
%SS3:	102	0.013	111	108	2.57	97	98	1.04	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51330 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-004A	06/23/10 3:45 PM	06/23/10	06/23/10 9:41 PM	1006635-005A	06/23/10 3:45 PM	06/23/10	06/23/10 10:23 PM
1006635-006A	06/23/10 3:45 PM	06/23/10	06/23/10 11:05 PM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

* MS and / or MSD spike recoveries may not be near 100% or the RPDs near 0% if: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) if that specific sample matrix interferes with spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.

Laboratory extraction solvents such as methylene chloride and acetone may occasionally appear in the method blank at low levels.



QC SUMMARY REPORT FOR E200.8

W.O. Sample Matrix: Water

QC Matrix: Water

BatchID: 51387

WorkOrder 1006635

Analyte	Extraction E200.8								Spiked Sample ID: 1006364-009A			
	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
Antimony	ND	10	103	104	0.483	97.2	96.9	0.319	70 - 130	20	85 - 115	20
Arsenic	3.1	10	104	105	0.741	101	98.7	2.05	70 - 130	20	85 - 115	20
Barium	43	100	99.3	99.7	0.280	94.8	95.4	0.589	70 - 130	20	85 - 115	20
Beryllium	ND	10	102	103	1.08	93.9	94.9	0.985	70 - 130	20	85 - 115	20
Cadmium	ND	10	99.6	99.2	0.392	98.7	98.4	0.244	70 - 130	20	85 - 115	20
Chromium	ND	10	100	98.8	1.19	99.3	99.1	0.222	70 - 130	20	85 - 115	20
Cobalt	ND	10	89.9	91.4	1.66	92.1	92.8	0.768	70 - 130	20	85 - 115	20
Copper	16	10	104	101	1.43	103	103	0	70 - 130	20	85 - 115	20
Lead	ND	10	98.7	98.7	0	95.3	95.6	0.241	70 - 130	20	85 - 115	20
Mercury	ND	0.25	109	106	2.23	99.5	101	1.20	70 - 130	20	85 - 115	20
Molybdenum	3.8	10	103	103	0	97.3	97.3	0	70 - 130	20	85 - 115	20
Nickel	0.58	10	101	96.7	4.30	97.4	97.7	0.338	70 - 130	20	85 - 115	20
Selenium	0.56	10	106	106	0	102	104	1.36	70 - 130	20	85 - 115	20
Silver	ND	10	94.8	94.7	0.169	95.9	96.1	0.135	70 - 130	20	85 - 115	20
Thallium	ND	10	95.4	95.2	0.168	90.1	90.6	0.487	70 - 130	20	85 - 115	20
Vanadium	3.5	10	105	102	2.11	99.5	96.9	2.62	70 - 130	20	85 - 115	20
Zinc	6.4	100	101	99.6	1.13	102	102	0	70 - 130	20	85 - 115	20
%SS:	102	750	106	105	0.291	104	105	1.06	70 - 130	20	70 - 130	20

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51387 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-001A	06/23/10 9:30 AM	06/23/10	06/24/10 1:46 PM	1006635-002C	06/23/10 1:20 PM	06/23/10	06/24/10 12:27 PM
1006635-002C	06/23/10 1:20 PM	06/23/10	06/24/10 1:02 PM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not applicable to this method.

NR = matrix interference and/or analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.



QC SUMMARY REPORT FOR SW8015B

W.O. Sample Matrix: Water

QC Matrix: Water

BatchID: 51385

WorkOrder 1006635

EPA Method SW8015B		Extraction SW3510C							Spiked Sample ID: N/A			
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH-Diesel (C10-C23)	N/A	1000	N/A	N/A	N/A	102	112	9.56	N/A	N/A	70 - 130	30
%SS:	N/A	625	N/A	N/A	N/A	91	104	13.4	N/A	N/A	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51385 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1006635-001A	06/23/10 9:30 AM	06/23/10	06/24/10 9:06 AM	1006635-002A	06/23/10 1:20 PM	06/23/10	06/24/10 11:30 AM
1006635-003A	06/23/10 3:20 PM	06/23/10	06/23/10 9:46 PM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 07/01/10
		Date Received: 07/01/10
	Client Contact: Kelly Stater	Date Reported: 07/02/10
	Client P.O.:	Date Completed: 07/02/10

WorkOrder: 1007032

July 02, 2010

Dear Kelly:

Enclosed within are:

- 1) The results of the **1** analyzed sample from your project: **#30077; San Lorenzo,**
- 2) A QC report for the above sample,
- 3) A copy of the chain of custody, and
- 4) An invoice for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits.


If you have any questions or concerns, please feel free to give me a call. Thank you for choosing

McC Campbell Analytical Laboratories for your analytical needs.

Best regards,

Angela Rydelius
Laboratory Manager
McC Campbell Analytical, Inc.

McC Campbell Analytical, Inc.


 1534 Willow Pass Rd
 Pittsburg, CA 94565-1701
 (925) 252-9262

CHAIN-OF-CUSTODY RECORD

WorkOrder: 1007032

ClientCode: AIVC

WaterTrax
 WriteOn
 EDF
 Excel
 Fax
 Email
 HardCopy
 ThirdParty
 J-flag

Report to: Kelly Stater American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003 (805) 639-0884 FAX (805) 639-0924	Email: kstater@americanintergrated.com cc: okmurphy@@americanintergrated.com PO: ProjectNo: #30077; San Lorenzo	Bill to: Kelly Therrien American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Requested TAT: 2 days Date Received: 07/01/2010 Date Printed: 07/01/2010
---	--	---	---

Lab ID	Client ID	Matrix	Collection Date	Hold	Requested Tests (See legend below)												
					1	2	3	4	5	6	7	8	9	10	11	12	
1007032-001	Comp-Stkple	Soil	7/1/2010 7:30	<input type="checkbox"/>	A	A											

Test Legend:

1	8260VOC_S	2	TPH(D)_S	3		4		5	
6		7		8		9		10	
11		12							

Prepared by: Ana Venegas

Comments: 48hr rush

NOTE: Soil samples are discarded 60 days after results are reported unless other arrangements are made (Water samples are 30 days).
 Hazardous samples will be returned to client or disposed of at client expense.



Sample Receipt Checklist

Client Name: **American Intergrated Services**

Date and Time Received: **7/1/2010 5:58:49 PM**

Project Name: **#30077; San Lorenzo**

Checklist completed and reviewed by: **Ana Venegas**

WorkOrder N°: **1007032** Matrix Soil

Carrier: Derik Cartan (MAI Courier)

Chain of Custody (COC) Information

- Chain of custody present? Yes No
- Chain of custody signed when relinquished and received? Yes No
- Chain of custody agrees with sample labels? Yes No
- Sample IDs noted by Client on COC? Yes No
- Date and Time of collection noted by Client on COC? Yes No
- Sampler's name noted on COC? Yes No

Sample Receipt Information

- Custody seals intact on shipping container/cooler? Yes No NA
- Shipping container/cooler in good condition? Yes No
- Samples in proper containers/bottles? Yes No
- Sample containers intact? Yes No
- Sufficient sample volume for indicated test? Yes No

Sample Preservation and Hold Time (HT) Information

- All samples received within holding time? Yes No
 - Container/Temp Blank temperature Cooler Temp: 5.6°C NA
 - Water - VOA vials have zero headspace / no bubbles? Yes No No VOA vials submitted
 - Sample labels checked for correct preservation? Yes No
 - Metal - pH acceptable upon receipt (pH<2)? Yes No NA
 - Samples Received on Ice? Yes No
- (Ice Type: WET ICE)

* NOTE: If the "No" box is checked, see comments below.

Client contacted:

Date contacted:

Contacted by:

Comments:



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

American Intergrated Services 1650 Palma Dr., Ste. 207 Ventura, CA 93003	Client Project ID: #30077; San Lorenzo	Date Sampled: 07/01/10
		Date Received: 07/01/10
	Client Contact: Kelly Stater	Date Extracted: 07/01/10
	Client P.O.:	Date Analyzed: 07/02/10

Volatile Organics by P&T and GC/MS*

Extraction Method: SW5030B

Analytical Method: SW8260B

Work Order: 1007032

Lab ID	1007032-001A				Reporting Limit for DF =1
Client ID	Comp-Stkple				
Matrix	S				
DF	1				

Compound	Concentration				mg/Kg	ug/L
tert-Amyl methyl ether (TAME)	ND				0.005	NA
Benzene	ND				0.005	NA
t-Butyl alcohol (TBA)	ND				0.05	NA
Diisopropyl ether (DIPE)	ND				0.005	NA
Ethylbenzene	ND				0.005	NA
Ethyl tert-butyl ether (ETBE)	ND				0.005	NA
Methyl-t-butyl ether (MTBE)	ND				0.005	NA
Toluene	ND				0.005	NA
Xylenes	ND				0.005	NA

Surrogate Recoveries (%)

%SS1:	114			
%SS2:	114			
%SS3:	99			

Comments

* water and vapor samples and all TCLP & SPLP extracts are reported in µg/L, soil/sludge/solid samples in mg/kg, wipe samples in µg/wipe, product/oil/non-aqueous liquid samples in mg/L.

ND means not detected above the reporting limit/method detection limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or surrogate coelutes with another peak.

%SS = Percent Recovery of Surrogate Standard

DF = Dilution Factor



QC SUMMARY REPORT FOR SW8260B

W.O. Sample Matrix: Soil

QC Matrix: Soil

BatchID: 51516

WorkOrder 1007032

EPA Method SW8260B	Extraction SW5030B								Spiked Sample ID: 1006792-005A			
	Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)		
	mg/Kg	mg/Kg	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
tert-Amyl methyl ether (TAME)	ND	0.050	82	85.1	3.74	86.1	87.8	2.00	70 - 130	30	70 - 130	30
Benzene	ND	0.050	112	119	6.80	110	112	1.87	70 - 130	30	70 - 130	30
t-Butyl alcohol (TBA)	ND	0.25	96.8	98	1.31	116	116	0	70 - 130	30	70 - 130	30
Chlorobenzene	ND	0.050	111	118	5.47	125	123	1.76	70 - 130	30	70 - 130	30
1,2-Dibromoethane (EDB)	ND	0.050	103	106	3.21	125	123	2.17	70 - 130	30	70 - 130	30
1,2-Dichloroethane (1,2-DCA)	ND	0.050	117	122	3.97	126	126	0	70 - 130	30	70 - 130	30
1,1-Dichloroethene	ND	0.050	110	119	8.20	76.8	81.5	5.95	70 - 130	30	70 - 130	30
Diisopropyl ether (DIPE)	ND	0.050	111	117	5.25	102	105	2.40	70 - 130	30	70 - 130	30
Ethyl tert-butyl ether (ETBE)	ND	0.050	105	110	4.21	101	103	2.22	70 - 130	30	70 - 130	30
Methyl-t-butyl ether (MTBE)	ND	0.050	114	118	3.16	108	111	2.87	70 - 130	30	70 - 130	30
Toluene	ND	0.050	105	111	5.89	118	117	0.925	70 - 130	30	70 - 130	30
Trichloroethene	ND	0.050	112	118	5.26	126	130	3.06	70 - 130	30	70 - 130	30
%SS1:	109	0.13	118	119	1.03	108	111	1.94	70 - 130	30	70 - 130	30
%SS2:	119	0.13	121	121	0	117	117	0	70 - 130	30	70 - 130	30
%SS3:	106	0.013	114	113	0.907	108	106	2.14	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51516 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1007032-001A	07/01/10 7:30 AM	07/01/10	07/02/10 12:02 AM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

* MS and / or MSD spike recoveries may not be near 100% or the RPDs near 0% if: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) if that specific sample matrix interferes with spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.

Laboratory extraction solvents such as methylene chloride and acetone may occasionally appear in the method blank at low levels.



QC SUMMARY REPORT FOR SW8015B

W.O. Sample Matrix: Soil

QC Matrix: Soil

BatchID: 51420

WorkOrder 1007032

EPA Method SW8015B		Extraction SW3550B							Spiked Sample ID: 1006669-008A			
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	mg/Kg	mg/Kg	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH-Diesel (C10-C23)	ND	40	101	101	0	112	112	0	70 - 130	30	70 - 130	30
%SS:	118	25	114	114	0	96	94	2.10	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 51420 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
1007032-001A	07/01/10 7:30 AM	07/01/10	07/02/10 10:11 AM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.

APPENDIX F
WASTE MANIFESTS

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 888-423-8760	4. Waste Tracking Number 218233	
5. Generator's Name and Mailing Address California Army National Guard 12020 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 16501 Aulard Ave San Lorenzo, CA 94580			
Generator's Phone						
6. Transporter 1 Company Name MILAN TRUCKING				U.S. EPA ID Number NA		
7. Transporter 2 Company Name				U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 901 Bailey Road Pittsburg, CA 94565 925-453-9900				U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-453-9900						
GENERATOR	9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
			No.	Type		
	1.	Non-Hazardous Waste Solid (Sol)	1	DT	18	Y
	2.					
	3.					
4.						
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. # 674754 Project #: 4212108778 Project #: 30077						
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.						
Generator's/Offor's Printed/Typed Name Frank Salcedo			Signature <i>[Signature]</i>		Month Day Year 12 30 10	
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____						
16. Transporter Acknowledgement of Receipt of Materials						
Transporter 1 Printed/Typed Name JUAN CLARA			Signature <i>[Signature]</i>		Month Day Year 8 20 10	
Transporter 2 Printed/Typed Name # MT 5431			Signature <i>[Signature]</i>		Month Day Year	
17. Discrepancy						
17a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection						
Manifest Reference Number:						
17b. Alternate Facility (or Generator) U.S. EPA ID Number						
Facility's Phone:						
17c. Signature of Alternate Facility (or Generator) Month Day Year						
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a						
Printed/Typed Name Felipe Comgu			Signature <i>[Signature]</i>		Month Day Year 12 20 10	

1051046

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE	TICKET	GRID
01	582393	
WEIGHMASTER		
FELIPE C		
DATE IN	TIME IN	
20 August 2010	8:56 am	
DATE OUT	TIME OUT	
20 August 2010	9:13 am	
VEHICLE	ROLL OFF	
MT5431		
REFERENCE	ORIGIN	
218233	SAN LORENZO	

00 Gross Weight 74,700.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,340.00 lb
 Net Weight 42,360.00 lb 21.18 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
21.18	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Signature]*

RS-F04-4pt

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 888-423-6000	4. Waste Tracking Number 218234
5. Generator's Name and Mailing Address California Army National Guard 16020 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 18501 Asland Ave San Lorenzo, CA 94580		
6. Transporter 1 Company Name MILLAN TRUCKING			U.S. EPA ID Number N/A		
7. Transporter 2 Company Name #408			U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 901 Bailey Road			U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-458-9800					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profile #: 4212109776 Project #: 30077					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L. JOHNSON		Signature <i>Tory L. Johnson</i>		Month	Day Year
FRANK SALCEDO JR		<i>Frank Salcedo Jr</i>		08	20 10
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____					
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name MILLAN		Signature <i>Millan</i>		Month	Day Year
MILLAN		<i>Millan</i>		18	20 10
Transporter 2 Printed/Typed Name		Signature		Month	Day Year
17. Discrepancy					
17a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
Manifest Reference Number: _____					
17b. Alternate Facility (or Generator)				U.S. EPA ID Number	
Facility's Phone: _____					
17c. Signature of Alternate Facility (or Generator)				Month	Day Year
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name Felipe Cornejo		Signature <i>Felipe Cornejo</i>		Month	Day Year
				08	20 10

GENERATOR

TRANSPORTER INT'L

DESIGNED FACILITY

1051127

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street
 Wilmington, CA 90744
 Contract: #4212109776

SITE 01	TICKET 582474	GRID
WEIGHMASTER		
FELIPE C		
DATE IN 20 August 2010	TIME IN 9:12 am	
DATE OUT 20 August 2010	TIME OUT 11:45 am	
VEHICLE MT408	ROLL OFF	
REFERENCE 218234	ORIGIN SAN LORENZO	

01 Gross Weight 80,800.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 30,820.00 lb
 Net Weight 49,980.00 lb 24.99 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
24.99	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Handwritten Signature]*

RS-F04-4pt

NON-HAZARDOUS WASTE MANIFEST

1. Generator ID Number
NOT REQUIRED

2. Page 1 of
1

3. Emergency Response Phone
888-423-8080

4. Waste Tracking Number
218235

5. Generator's Name and Mailing Address
California Army National Guard
16020 Mather Blvd., Mather, CA 95655

Generator's Site Address (if different than mailing address)
16501 Aeland Ave
San Lorenzo, CA 94580

Generator's Phone

6. Transporter 1 Company Name
William Trucking

U.S. EPA ID Number
N/A

7. Transporter 2 Company Name

U.S. EPA ID Number

8. Designated Facility Name and Site Address
Keller Canyon Landfill
901 Bailey Road

U.S. EPA ID Number
Not Required

Facility's Phone: **Pittsburg, CA 94565 925-458-9800**

9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					

13. Special Handling Instructions and Additional Information
Wear protective equipment while handling. Weights or volumes are approximate.

Profile #: **4212108776**
Project #: **30077**

14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Generator's/Offor's Printed/Typed Name: **Fernando Salcedo** Signature: *[Signature]* Month: **12** Day: **20** Year: **10**

15. International Shipments Import to U.S. Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____

16. Transporter Acknowledgement of Receipt of Materials
Transporter 1 Printed/Typed Name: **Octavio Alvarez** Signature: *[Signature]* Month: **8** Day: **20** Year: **10**
Transporter 2 Printed/Typed Name: **MT 409** Signature: *[Signature]* Month: _____ Day: _____ Year: _____

17. Discrepancy
17a Discrepancy Indication Space Quantity Type Residue Partial Rejection Full Rejection

17b. Alternate Facility (or Generator) Manifest Reference Number: _____ U.S. EPA ID Number: _____

Facility's Phone: _____

17c. Signature of Alternate Facility (or Generator) _____ Month: _____ Day: _____ Year: _____

18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a

Printed/Typed Name: **Felipe Cornejo** Signature: *[Signature]* Month: **8** Day: **20** Year: **10**

GENERATOR

INT'L

TRANSPORTER

DESIGNED FACILITY

1051061

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street
 Wilmington, CA 90744
 Contract: #4212109776

SITE	TICKET	GRID
01	582408	
WEIGHMASTER		
FELIPE C		
DATE IN	TIME IN	
20 August 2010	9:15 am	
DATE OUT	TIME OUT	
20 August 2010	9:36 am	
VEHICLE	ROLL OFF	
MT409		
REFERENCE	ORIGIN	
218235	SAN LORENZO	

00 Gross Weight 77,440.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,660.00 lb
 Net Weight 44,780.00 lb 22.39 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
22.39	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Handwritten Signature]*

RS-F04-4pt

NON-HAZARDOUS
WASTE MANIFEST

1. Generator ID Number
NOT REQUIRED

2. Page 1 of
1

3. Emergency Response Phone
888-423-6000

4. Waste Tracking Number
218236

5. Generator's Name and Mailing Address
California Army National Guard
18020 Matner Blvd., Matner, CA 95855

Generator's Site Address (if different than mailing address)
16501 Asland Ave
San Lorenzo, CA 94580

Generator's Phone

6. Transporter 1 Company Name
MILLAD TRUCKING

U.S. EPA ID Number
N/A

7. Transporter 2 Company Name

U.S. EPA ID Number

8. Designated Facility Name and Site Address
Keller Canyon Landfill
901 Bailey Road

U.S. EPA ID Number
Not Required

Facility's Phone: **Pittsburg, CA 94505 925-458-9800**

9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					

13. Special Handling Instructions and Additional Information

Wear protective equipment while handling. Weights or volumes are approximate.

Profile: 4212108776
Project #: 30077

14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Generator's/Officer's Printed/Typed Name: **TORY L. JOHNSON**
Signature: *Tory L. Johnson*
Month: **08** Day: **30** Year: **10**

15. International Shipments Import to U.S. Export from U.S.
Port of entry/exit: _____
Date leaving U.S.: _____

16. Transporter Acknowledgement of Receipt of Materials
Transporter 1 Printed/Typed Name: **JUAN JARA**
Signature: *Juan Jara*
Month: **8** Day: **20** Year: **10**
Transporter 2 Printed/Typed Name: **MT 3430**
Signature: *MT 3430*

17. Discrepancy
17a Discrepancy Indication Space Quantity Type Residue Partial Rejection Full Rejection

17b. Alternate Facility (or Generator) _____ U.S. EPA ID Number _____

Facility's Phone: _____
17c. Signature of Alternate Facility (or Generator) _____ Month: _____ Day: _____ Year: _____

18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a
Printed/Typed Name: **FELIPE COMGU**
Signature: *Felipe Comgu*
Month: **08** Day: **20** Year: **10**

GENERATOR

INT'L

TRANSPORTER

DESIGNED FACILITY

1051113

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674-754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE 01	TICKET 582460	GRID
WEIGHMASTER FELIPE C		
DATE IN 20 August 2010	TIME IN 11:18 am	
DATE OUT 20 August 2010	TIME OUT 11:18 am	
VEHICLE MT5430	ROLL OFF	
REFERENCE 218236	ORIGIN SAN LORENZO	

Gross Weight 73,800.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,240.00 lb
 Net Weight 41,560.00 lb 20.78 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
20.78	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Handwritten Signature]*

RS-F04-4pt

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 988-423-8060	4. Waste Tracking Number 218237
5. Generator's Name and Mailing Address California Army National Guard 16020 Mather Blvd., Mather, CA 95635			Generator's Site Address (if different than mailing address) 16501 Asland Ave San Lorenzo, CA 94530		
Generator's Phone					
6. Transporter 1 Company Name MILLER TRUCKING #408				U.S. EPA ID Number NA	
7. Transporter 2 Company Name				U.S. EPA ID Number	
8. Designated Facility Name and Site Address Keller Canyon Landfill 901 Bailey Road				U.S. EPA ID Number Not Required	
Facility's Phone: Pittsburg, CA 94565 925-458-8900					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profile #: 4212108778 Project #: 30077					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L JOHNSON			Signature <i>Tory L. Johnson</i>		Month Day Year 08 20 10
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____					
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name WESLEY MILLER			Signature <i>Wesley Miller</i>		Month Day Year 08 20 10
Transporter 2 Printed/Typed Name			Signature		Month Day Year
17. Discrepancy					
17a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
17b. Alternate Facility (or Generator) Manifest Reference Number: _____ U.S. EPA ID Number _____					
Facility's Phone: _____					
17c. Signature of Alternate Facility (or Generator) _____ Month Day Year _____					
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name Felipe Lombard			Signature <i>Felipe Lombard</i>		Month Day Year 08 20 10

1051128

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE	TICKET	GRID
01	582475	
WEIGHMASTER		
FELIPE C		
DATE IN	TIME IN	
20 August 2010	11:30 am	
DATE OUT	TIME OUT	
20 August 2010	11:47 am	
VEHICLE	ROLL OFF	
MT408		
REFERENCE	ORIGIN	
218237	SAN LORENZO	

01 Gross Weight 30,880.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 30,840.00 lb
 Net Weight 50,040.00 lb 25.02 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
25.02	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Handwritten Signature]*

RS-F04-4pt

GENERATOR
INT'L
TRANSPORTER
DESIGNED FACILITY

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 888-423-8060	4. Waste Tracking Number 218238
5. Generator's Name and Mailing Address California Army National Guard 16020 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 16501 Asland Ave San Lorenzo, CA 94580		
Generator's Phone			U.S. EPA ID Number		
6. Transporter 1 Company Name MILLAN TRUCKING			U.S. EPA ID Number		
7. Transporter 2 Company Name			U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 901 Bailey Road			U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-458-9800					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profile #: 4212108776 Project #: 30077					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L. JOHNSON		Signature <i>Tory L. Johnson</i>		Month 10	Day Year 20 10
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____					
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name <i>John A.</i>		Signature <i>John A.</i>		Month 8	Day Year 20 10
Transporter 2 Printed/Typed Name		Signature		Month	Day Year
17. Discrepancy					
17a Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
Manifest Reference Number:					
17b. Alternate Facility (or Generator)			U.S. EPA ID Number		
Facility's Phone:					
17c. Signature of Alternate Facility (or Generator)			Month Day Year		
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name Felipe Comgu		Signature <i>Felipe Comgu</i>		Month 10	Day Year 20 10

1051125

KELLER CANYON LANDFILL
901 BAILEY ROAD
PITTSBURG, CA

674754
American Integrated Services, Inc.
1502 E Opp Street

Wilmington, CA 90744
Contract: #4212109776

SITE 01	TICKET 582472	GRID
WEIGHMASTER FELIFE C		
DATE IN 20 August 2010		TIME IN 11:44 am
DATE OUT 20 August 2010		TIME OUT 11:44 am
VEHICLE MT409		ROLL OFF
REFERENCE 218238	ORIGIN SAN LORENZO	

00 Gross Weight 76,700.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,660.00 lb
 Net Weight 44,040.00 lb 22.02 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
22.02	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE

RS-F04-4pt

GENERATOR

INT'L

TRANSPORTER

DESIGNED FACILITY

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 968-423-0060	4. Waste Tracking Number 218239
5. Generator's Name and Mailing Address California Army National Guard 18020 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 16501 Asland Ave San Lorenzo, CA 94580		
6. Transporter 1 Company Name MILAN TRUCKING			U.S. EPA ID Number		
7. Transporter 2 Company Name			U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 801 Bailey Road			U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-458-9800					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profit #: 4212108776 Project #: 30077					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L. JOHNSON			Signature <i>Tory L. Johnson</i>		Month Day Year 08 20 10
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____					
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name JUAN JARA			Signature <i>Juan Jara</i>		Month Day Year 09 20 10
Transporter 2 Printed/Typed Name MT 5431			Signature		Month Day Year
17. Discrepancy					
17a Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
Manifest Reference Number: _____					
17b. Alternate Facility (or Generator)			U.S. EPA ID Number		
Facility's Phone: _____					
17c. Signature of Alternate Facility (or Generator)					Month Day Year
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name FELIPE COMISO			Signature <i>Felipe Comiso</i>		Month Day Year 18 20 10

1051173

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street
 Wilmington, CA 90744
 Contract: #4212109776

SITE 01	TICKET 582520	GRID
WEIGHMASTER FELIPE C		
DATE IN 20 August 2010	TIME IN 1:57 pm	
DATE OUT 20 August 2010	TIME OUT 1:57 pm	
VEHICLE MT5431	ROLL OFF	
REFERENCE 218239	ORIGIN SAN LORENZO	

01 Gross Weight 77,400.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,340.00 lb
 Net Weight 45,060.00 lb 22.53 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
22.53	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Signature]*

RS-F04-4pt

NON-HAZARDOUS
WASTE MANIFEST

1. Generator ID Number
NOT REQUIRED

2. Page 1 of
1

3. Emergency Response Phone
888-423-6060

4. Waste Tracking Number
218240

5. Generator's Name and Mailing Address
California Army National Guard
18020 Mather Blvd., Mather, CA 95655

Generator's Site Address (if different than mailing address)
16001 Astand Ave
San Lorenzo, CA 94580

Generator's Phone

6. Transporter 1 Company Name

MILLAN TRUCKING #1408

U.S. EPA ID Number
N/A

7. Transporter 2 Company Name

U.S. EPA ID Number

8. Designated Facility Name and Site Address

Keller Canyon Landfill
501 Bailey Road

U.S. EPA ID Number

Not Required

Facility's Phone: **Prisburg, CA 94685 925-458-9800**

9a. 9b. U.S. DOT Description (including Proper Shipping Name)

10. Containers

No. Type

11. Total Quantity

12. Unit Wt./Vol.

1. **Non-Hazardous Waste Solid (Soil)**

1

DT

18

Y

13. Special Handling Instructions and Additional Information

Wear protective equipment while handling. Weights or volumes are approximate.

Profile #: 4212109776
Project #: 30077

14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Generator's/Officer's Printed/Typed Name

TORY L. JOHNSON

Signature

Tory L. Johnson

Month Day Year

08 20 10

15. International Shipments

Import to U.S.

Export from U.S.

Port of entry/exit:
Date leaving U.S.:

16. Transporter Acknowledgement of Receipt of Materials

Transporter 1 Printed/Typed Name

Julio MILLAN

Signature

Julio Millan

Month Day Year

08 20 10

Transporter 2 Printed/Typed Name

Signature

Month Day Year

17. Discrepancy

17a Discrepancy Indication Space Quantity

Type

Residue

Partial Rejection

Full Rejection

Manifest Reference Number:

17b. Alternate Facility (or Generator)

U.S. EPA ID Number

Facility's Phone:

17c. Signature of Alternate Facility (or Generator)

Month Day Year

18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a

Printed/Typed Name

Felipe Comgo

Signature

Felipe Comgo

Month Day Year

08 20 10

GENERATOR

INT'L

TRANSPORTER

DESIGNATED FACILITY

1051180

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE	TICKET	GRID
01	582527	
WEIGHMASTER		
FELIPE C		
DATE IN	TIME IN	
20 August 2010	2:09 pm	
DATE OUT	TIME OUT	
20 August 2010	2:09 pm	
VEHICLE	ROLL OFF	
MT408		
REFERENCE	ORIGIN	
218240	SAN LORENZO	

00 Gross Weight 79,220.00 lb Inbound -- SCALE TICKET
 Stored Tare Weight 30,840.00 lb
 Net Weight 48,380.00 lb 24.19 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
24.19	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE *[Handwritten Signature]*

RS-F04-4pt

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 888-423-6060	4. Waste Tracking Number 218241
5. Generator's Name and Mailing Address California Army National Guard 13026 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 10501 Ashland Ave San Lorenzo, CA 94580		
6. Transporter 1 Company Name Willen Trucking			U.S. EPA ID Number		
7. Transporter 2 Company Name			U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 901 Bailey Road			U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-458-9800					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profile #: 4212109776 Project #: 30077					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L. JOHNSON			Signature <i>Tory L. Johnson</i>	Month 10	Day 20
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S.			Port of entry/exit: Date leaving U.S.:		
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name Octavio Alvarez			Signature <i>Octavio Alvarez</i>	Month 8	Day 20
Transporter 2 Printed/Typed Name			Signature	Month	Day
17. Discrepancy					
17a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
17b. Alternate Facility (or Generator) Manifest Reference Number: U.S. EPA ID Number					
Facility's Phone:					
17c. Signature of Alternate Facility (or Generator)			Month	Day	Year
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name Lepp (orange)			Signature <i>[Signature]</i>	Month 10	Day 20

1051183

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE 01	TICKET 582530	GRID
WEIGHMASTER		
FELIFE C		
DATE IN 20 August 2010	TIME IN 2:26 pm	
DATE OUT 20 August 2010	TIME OUT 2:26 pm	
VEHICLE MT409		ROLL OFF
REFERENCE 218241	ORIGIN SAN LORENZO	

00 Gross Weight 77,980.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,660.00 lb
 Net Weight 45,320.00 lb 22.66 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
22.66	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE

[Handwritten Signature]

RS-F04-4pt

GENERATOR

INT'L

TRANSPORTER

DESIGNED FACILITY

NON-HAZARDOUS WASTE MANIFEST 1. Generator ID Number **NOT REQUIRED** 2. Page 1 of **1** 3. Emergency Response Phone **888-423-6080** 4. Waste Tracking Number **218242**

5. Generator's Name and Mailing Address: **California Army National Guard**
 18020 Mather Blvd., Mather, CA 95655
 Generator's Site Address (if different than mailing address): **18501 Asland Ave**
San Lorenzo, CA 94580

6. Transporter 1 Company Name: **MILAN TRUCKING** U.S. EPA ID Number

7. Transporter 2 Company Name U.S. EPA ID Number

8. Designated Facility Name and Site Address: **Keller Canyon Landfill**
301 Bailey Road U.S. EPA ID Number **Not Required**
 Facility's Phone: **Pittsburg, CA 94565 925-458-8800**

9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.	
		No.	Type			
1.	Non-hazardous Waste Solid (Sol)	1	DT	18	Y	
2.						
3.						
4.						

13. Special Handling Instructions and Additional Information
 Wear protective equipment while handling. Weights or volumes are approximate.
 5431
 Project #: 4212103776
 Project #: 30077

14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.
 Generator's/Officer's Printed/Typed Name: **TORY L. JOHANSON** Signature: *Tory L. Johnson* Month Day Year: **08/20/10**

15. International Shipments Import to U.S. Export from U.S. Port of entry/exit: Date leaving U.S.:

16. Transporter Acknowledgement of Receipt of Materials
 Transporter 1 Printed/Typed Name: **JUAN WADA** Signature: *Juan Wada* Month Day Year: **08/20/10**
 Transporter 2 Printed/Typed Name: **MT 5431** Signature: *[Signature]* Month Day Year:

17. Discrepancy
 17a Discrepancy Indication Space Quantity Type Residue Partial Rejection Full Rejection
 Manifest Reference Number:

17b. Alternate Facility (or Generator) U.S. EPA ID Number
 Facility's Phone:

17c. Signature of Alternate Facility (or Generator) Month Day Year

18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a
 Printed/Typed Name: **Manue Zavala** Signature: *Manue Zavala* Month Day Year: **08/21/10**

1051201

KELLER CANYON LANDFILL
901 BAILEY ROAD
PITTSBURG, CA

674754
American Integrated Services, Inc.
1502 E Opp Street

Wilmington, CA 90744
Contract: #4212109776

SITE	TICKET	GRID
01	582546	
WEIGHMASTER		
JZ00023 MANUEL Z		
DATE IN	TIME IN	
21 August 2010	7:11 am	
DATE OUT	TIME OUT	
21 August 2010	7:11 am	
VEHICLE	ROLL OFF	
MT5431		
REFERENCE	ORIGIN	
218242	SAN LORENZO	

Gross Weight 76,700.00 lb Inbound -- SCALE TICKET
 Stored Tare Weight 32,340.00 lb
 Net Weight 44,360.00 lb 22.18 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
22.18	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE

RS-F04-4pt

674754

NON-HAZARDOUS WASTE MANIFEST		1. Generator ID Number NOT REQUIRED	2. Page 1 of 1	3. Emergency Response Phone 888-423-8080	4. Waste Tracking Number 218243
5. Generator's Name and Mailing Address California Army National Guard 16020 Mather Blvd., Mather, CA 95655			Generator's Site Address (if different than mailing address) 10601 Asland Ave San Lorenzo, CA 94580		
6. Transporter 1 Company Name Millon Trucking			U.S. EPA ID Number		
7. Transporter 2 Company Name			U.S. EPA ID Number		
8. Designated Facility Name and Site Address Keller Canyon Landfill 801 Bailey Road			U.S. EPA ID Number Not Required		
Facility's Phone: Pittsburg, CA 94565 925-459-9800					
9a.	9b. U.S. DOT Description (including Proper Shipping Name)	10. Containers		11. Total Quantity	12. Unit Wt./Vol.
		No.	Type		
1.	Non-Hazardous Waste Solid (Soil)	1	DT	18	Y
2.					
3.					
4.					
13. Special Handling Instructions and Additional Information Wear protective equipment while handling. Weights or volumes are approximate. Profile: 4212109776 Project #: 30077 409					
14. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.					
Generator's/Officer's Printed/Typed Name TORY L. JOHNSON			Signature <i>Tory L. Johnson</i>		Month Day Year 08 20 10
15. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____					
16. Transporter Acknowledgement of Receipt of Materials					
Transporter 1 Printed/Typed Name Octavio Aza			Signature <i>Octavio Aza</i>		Month Day Year 8 20 10
Transporter 2 Printed/Typed Name			Signature		Month Day Year
17. Discrepancy					
17a Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection					
Manifest Reference Number:					
17b. Alternate Facility (or Generator)			U.S. EPA ID Number		
Facility's Phone:					
17c. Signature of Alternate Facility (or Generator)			Month Day Year		
18. Designated Facility Owner or Operator: Certification of receipt of materials covered by the manifest except as noted in Item 17a					
Printed/Typed Name Manuel Zavala			Signature <i>Manuel Zavala</i>		Month Day Year 8 21 10

GENERATOR

INT'L

TRANSPORTER

DESIGNED FACILITY

1051194

KELLER CANYON LANDFILL
 901 BAILEY ROAD
 PITTSBURG, CA

674754
 American Integrated Services, Inc.
 1502 E Opp Street

Wilmington, CA 90744
 Contract: #4212109776

SITE	TICKET	GRID
01	582539	
WEIGHMASTER		
JZ00023 MANUEL Z		
DATE IN	TIME IN	
21 August 2010	7:02 am	
DATE OUT	TIME OUT	
21 August 2010	7:02 am	
VEHICLE	ROLL OFF	
MT409		
REFERENCE	ORIGIN	
218243	SAN LORENZO	

Gross Weight 84,300.00 lb Inbound - SCALE TICKET
 Stored Tare Weight 32,660.00 lb
 Net Weight 51,640.00 lb 25.82 TN

QTY.	UNIT	DESCRIPTION	RATE	EXTENSION	TAX	TOTAL
25.82	TN	SW-CONT SOIL				
1.00	LD	ENVIRONMENTAL FEE				
1.00	LD	FUEL RECOVERY FEE				

NET AMOUNT
TENDERED
CHANGE
CHECK NO.



REV 11/09

SIGNATURE

[Handwritten Signature]

RS-F04-4pt



Evergreen Environmental Services

dedicated to the protection of the environment

WORK ORDER/SERVICE AGREEMENT

No 559791

To schedule a pickup, call
800-596-9455

Send payment to:

Sales Order # WOC 23863

6880 Smith Ave., Newark, CA EPA# CAD982413262
16540 S. San Pedro St., Carson, CA EPA# CAD982413262

Evergreen Oil, Inc.
Dept. LA 23234
Pasadena, CA 91185-3234

Date: 6-23-10

GENERATOR/JOB LOCATION

BILLING INFORMATION

NAME <u>CALIFORNIA army national guard</u>				NAME <u>AMERICAN Integrated SUC</u>				CASH <input type="checkbox"/> CHECK <input type="checkbox"/>	
ADDRESS <u>16501 Ashland Ave</u>				ADDRESS <u>PO BOX 92316</u>				CUSTOMER CODE NO. <u>CA106101</u>	
CITY <u>San Lorenzo CA</u>		STATE <u>CA</u>		CITY <u>LONG BEACH CA</u>		STATE <u>CA</u>		PO #	
ZIP <u>94580</u>		CO.		ZIP <u>90809-2316</u>		CO.		CUSTOMER EPA ID NO. <u>CAD981369085</u>	
PHONE NO. <u>(916) 854 3542</u>				PHONE NO. ()		PROFILE NO.			

PRODUCT	WASTE CODE	MANIFEST NUMBER	QUANTITY	UNITS	PRICE	AMOUNT
Used oil, Non-RCRA Hazardous Lubricating	CA221			Gal.		
Waste, Liquid Industrial	CA221			Gal.		
Used Automotive Antifreeze, Non-RCRA Hazardous Waste Liquid	CA134			Gal.		
RQ Waste Combustible Liquid, N.O.S. NA 1993 III (Oil contaminated with halogens)	CA221 F001/F002			Gal.		
<u>Di esol</u> <u>Water</u> , Non-RCRA Hazardous Waste Liquid	CA221	<u>007016232</u>	<u>890</u>	Gal.		<u>C</u>
Non Hazardous Water				Gal.		
Waste Solids and Sludges				Gal.		
Wash Out				Each		
Pressure Washer/Steam Cleaner				Day		
Transportation			<u>7</u>	Hrs.		<u>C</u>
Fuel Surcharge				%		
Glycol Bulk 50/50/Specify Product				Gal.		
Glycol Bulk Conc./Specify Product				Gal.		

TEST: Clor D Tech 4000 _____ ppm Clor D Tech 1000 Pass Fail

Retain sample # Required

Field Service Work Description:

Other: _____

Other: _____

Total Charges

Contract

TSDF Consolidated Manifest

Evergreen Oil, Inc. 6880 Smith Ave. Newark, CA 94560 CAD980887418

Evergreen Oil, Inc. - Davis Road 30B Davis, CA 95616 CAD982446874

Evergreen Oil, Inc. - Fresno 4139 N. Valentine Fresno, CA 93722 CAD982446882

Evergreen Env. Svc. 16604 S. San Pedro Carson, CA 90746 CAD981696420

Evergreen Oil, Inc. - Santa Maria 745 A West Betteravia Santa Maria, CA 93454 CAD982446858

DRIVER CHECKLIST

Time In _____ Time Out _____

Tank/Drum Properly Labeled

Accumulation Start Date Marked

House Keeping - Tank/Drum Clean

Other Services Checked: Oil, Filters/Drums, Antifreeze

Called in other services needed Oil, Filters/Drums, Antifreeze

Source: Collection Station Government Marine Agricultural Industrial

Generator certifies that it has established a program to reduce the volume or quantity & toxicity of the hazardous waste to the degree determined by generator to be economically practicable.

I hereby certify that I have read and have the authority to bind the above listed generator to the terms on the reverse side of this form.

IMPORTANT NOTICE REGARDING THE DISPOSITION OF YOUR OIL.

Per California Health and Safety Code Section 25250.9, Evergreen hereby advises customer that customer's shipment of used oil may be transported to a facility that is required to comply with federal regulations applicable to management of used oil, but that is not required to comply with the more stringent requirements applicable to hazardous waste management facilities. California facilities that handle or process used oil are required to meet those more stringent requirements, and some out-of-state facilities that process used oil also meet those requirements. These include more stringent leak detection and prevention requirements, engineering certifications of tank integrity, and financial assurances for closure and accidental releases. It is lawful to send used oil to out-of-state facilities that comply only with federal used oil management standards and not these more stringent requirements. This notification is for information purposes only.

JL Jesse FALIONE 2204 6-23-10

Driver Signature Print Name Route # Date

[Signature] [Signature] 6-23-10

Generator's Signature Print Name Date

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator ID Number CAD981368085	2. Page 1 of	3. Emergency Response Phone 888-423-6080	4. Manifest Tracking Number 007016232 JJK			
5. Generator's Name and Mailing Address California Army National Guard 10620 Mather Blvd. Mather, CA 95655				Generator's Site Address (if different than mailing address) 16501 Ashland Ave. San Lorenzo, CA 94580				
6. Transporter 1 Company Name Evergreen Environmental Services				U.S. EPA ID Number CAD982413262				
7. Transporter 2 Company Name				U.S. EPA ID Number				
8. Designated Facility Name and Site Address Evergreen Oil, Inc. 6880 Smith Ave. Newark, CA 94560				U.S. EPA ID Number CAD880887418				
Facility's Phone: 510-785-4400								
9a. HM	9b. U.S. DOT Description (including Proper Shipping Name, Hazard Class, ID Number, and Packing Group (if any))	10. Containers		11. Total Quantity	12. Unit Wt./Vol.	13. Waste Codes		
		No.	Type					
1.	Non-RCRA Hazardous Waste Liquid (Diesel and Water)	1	TT	890	G	221		
2.								
3.								
4.								
14. Special Handling Instructions and Additional Information Wear appropriate PPE while handling. Weights or volumes are approximate. Diesel and Water Job#: 30077 Profile#: 53511								
15. GENERATOR'S/OFFEROR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by the proper shipping name, and are classified, packaged, marked and labeled/placarded, and are in all respects in proper condition for transport according to applicable international and national governmental regulations. If export shipment and I am the Primary Exporter, I certify that the contents of this consignment conform to the terms of the attached EPA Acknowledgment of Consent. I certify that the waste minimization statement identified in 40 CFR 262.27(a) (if I am a large quantity generator) or (b) (if I am a small quantity generator) is true.								
Generator's/Offorer's Printed/Typed Name				Signature		Month	Day	Year
						00	23	10
16. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Transporter signature (for exports only): _____ Date leaving U.S.: _____								
17. Transporter Acknowledgment of Receipt of Materials								
Transporter 1 Printed/Typed Name				Signature		Month	Day	Year
Joseph Alvarez						06	23	10
Transporter 2 Printed/Typed Name				Signature		Month	Day	Year
18. Discrepancy								
18a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection								
Manifest Reference Number: _____								
18b. Alternate Facility (or Generator)					U.S. EPA ID Number			
Facility's Phone: _____								
18c. Signature of Alternate Facility (or Generator)						Month	Day	Year
19. Hazardous Waste Report Management Method Codes (i.e., codes for hazardous waste treatment, disposal, and recycling systems)								
1.	2.	3.	4.					
20. Designated Facility Owner or Operator: Certification of receipt of hazardous materials covered by the manifest except as noted in Item 18a								
Printed/Typed Name				Signature		Month	Day	Year



Fax from :

TOTN 1693.58

07-09-10 10:43a Pg: 2

Weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/29/10
TICKET NO. 2010478392
TRIP: 530 SCALE: 4 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name LUIS SERGIO CHAVEZ
CARSON, CA 94025

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

CDU RECEIPT
LIC# Vehicle-NP
Driver -NL
Trailer-

Deputy Weighmaster Ruben Alvarado

Signature

Date and Time - In: 06/29/10 10:47 Out: 06/29/10 10:56

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	1240.0 LB	\$96.10
			TOTAL:	\$96.10
Total Wt- Gross: 10920.0 lbs Tare: 9680.0 lbs Net: 1240.0 lbs				382143



Weighmaster: **SCHNITZER STEEL PRODUCTS OF CALIF.**
Weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/30/10
TICKET NO. 2010478704
TRIP: 555 SCALE: 4 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name LUIS SERGIO CHAVEZ
CARSON, CA

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

CDU RECP: VOID CHK 264574
LIC# Vehicle-NP
Driver -NL
Trailer-

Deputy Weighmaster Ruben Alvarado

Signature

Date and Time - In: 06/30/10 12:54 Out: 06/30/10 13:03

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
103-00	Unp. HMS	\$130.00 /NT	2220.0 LB	\$144.30
			TOTAL:	\$144.30
Total Wt- Gross: 11780.0 lbs Tare: 9560.0 lbs Net: 2220.0 lbs				384194



Fax from : weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/24/10
TICKET NO. 2010477558
TRIP: 453 SCALE: 4 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name: LUIS CHAVEZ
923 E RENTON ST
CARSON CITY, CA 90745

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

4745989468
GDV RECEIPT
LIC# Vehicle-8V09052
Driver -A5888112
Trailer-

Deputy Weighmaster Ruben Alvarado
Signature

Date and Time - In: 06/24/10 10:31 Out: 06/24/10 10:39

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Non Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	3080.0 LB	\$238.70
13-01	Yellow Brs-HONEY	\$1.8100/LB	12.0 LB	\$21.72
42-08	85% U/Cast-TENSE	\$0.3000/LB	12.0 LB	\$3.60
2-01	Tu/Wire/SI-BIRCH/CLI	\$2.4500/LB	19.0 LB	\$46.55
50-03	Irony S.St-SABOT	\$0.3500/LB	28.0 LB	\$9.80
			TOTAL:	\$320.37
Commodity Wt:			Net: 3151.0 lbs	379133



Weighmaster: **SCHNITZER STEEL PRODUCTS OF CALIF.**
Weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/25/10
TICKET NO. 2010477896
TRIP: 492 SCALE: 4 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name: LUIS SERGIO CHAVEZ
CARSON, CA 90745

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

4748069478
GDV RECEIPT
LIC# Vehicle-NP
Driver -A5888112
Trailer-

Deputy Weighmaster Ruben Alvarado
Signature

Date and Time - In: 06/25/10 14:29 Out: 06/25/10 14:30

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	2260.0 LB	\$175.15
			TOTAL:	\$175.15
Total Wt- Gross: 12000.0 lbs Tare: 9740.0 lbs			Net: 2260.0 lbs	380234



Fax from :
 Weighed at : 1101 EMBARCADERO WEST
 OAKLAND, CA 94607
 800-449-3919

TICKET DATE: 06/25/10
 TICKET NO. 2010477823
 TRIP: 481 SCALE: 4 (TRUCK/DOCK SCALE)
 Vendor Number 999
 Vendor Name: LUIS SERGIO CHAVEZ
 923 E RENTON ST
 CARSON, CA 90745

X *Sergio Chavez*
 I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

49176947
GDU RECEIPT
 LIC# Vehicle-NP
 Driver -A5888112
 Trailer-

Deputy Weighmaster Ruben Alvarado
 Signature

Date and Time - In: 06/25/10 11:07 Out: 06/25/10 11:25

WEIGHMASTER CERTIFICATE - THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	4540.0 LB	\$351.85
			TOTAL:	\$351.85

Total Wt- Gross: 14300.0 lbs Tare: 9760.0 lbs Net: 4540.0 lbs 380152



Weighmaster: **SCHNITZER STEEL PRODUCTS OF CALIF.**
 Weighed at : 1101 EMBARCADERO WEST
 OAKLAND, CA 94607
 800-449-3919

TICKET DATE: 06/25/10
 TICKET NO. 2010477776
 TRIP: 475 SCALE: 4 (TRUCK/DOCK SCALE)
 Vendor Number 999
 Vendor Name: LUIS SERGIO CHAVEZ
 CARSON, CA 90745

X *Sergio Chavez*
 I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

49176947
GDU RECEIPT
 LIC# Vehicle-NP
 Driver -A5888112
 Trailer-

Deputy Weighmaster Ruben Alvarado
 Signature

Date and Time - In: 06/25/10 09:23 Out: 06/25/10 09:31

WEIGHMASTER CERTIFICATE - THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	4540.0 LB	\$351.85
			TOTAL:	\$351.85

Total Wt- Gross: 14340.0 lbs Tare: 9800.0 lbs Net: 4540.0 lbs 380101



Fax from :

Weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/29/10
TICKET NO. 2010478399
TRIP: 839 SCALE: 6 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name LUIS SERGIO CHAVEZ
CARSON, CA 94025

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

4783999704
GDU RECEIPT
LIC# Vehicle-NP
Driver -NL
Trailer-

Deputy Weighmaster Ruben Alvarado
Signature _____

Date and Time - In: 06/29/10 11:06 Out: 06/29/10 11:06

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Non Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	26.6 LB	\$2.06
40-01	Sheet Alum-TAINT/TAB	\$0.4300/LB	10.0 LB	\$4.30
2-01	Tu/Wire/Sl-BIRCH/CLI	\$2.4500/LB	13.0 LB	\$31.85
			TOTAL:	\$38.21
Commodity Wt:			Net: 49.6 lbs	382151



Weighmaster: **SCHNITZER STEEL PRODUCTS OF CALIF.**
Weighed at : 1101 EMBARCADERO WEST
OAKLAND, CA 94607
800-449-3919

TICKET DATE: 06/29/10
TICKET NO. 2010478334
TRIP: 522 SCALE: 4 (TRUCK/DOCK SCALE)
Vendor Number 999
Vendor Name LUIS SERGIO CHAVEZ
CARSON, CA 90745

X *Sergio Chavez*
I affirm under penalty of law that the property I am selling in this transaction is not, to the best of my knowledge, stolen property and I am the lawful owner and can convey legal title to Purchaser/Payor. I warrant that this material does not contain any hazardous substances as defined by the federal or state law, and I agree to indemnify Purchaser/Payor if this is untrue.

4783949765
GDU RECEIPT
LIC# Vehicle-NP
Driver -A5888112
Trailer-

Deputy Weighmaster Ruben Alvarado
Signature _____

Date and Time - In: 06/29/10 08:20 Out: 06/29/10 08:23

WEIGHMASTER CERTIFICATE : THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

Commodity	Description - Ferrous	Price/UOM	Net Weight	AMOUNT
101-00	HMS Prepar	\$155.00 /NT	2900.0 LB	\$224.75
			TOTAL:	\$224.75
Total Wt- Gross: 12520.0 lbs			Tare: 9620.0 lbs	Net: 2900.0 lbs
				382084



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103756
8300 BALDWIN STREET Date Time Scale
OAKLAND, CA 94621 In: 0
PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 01:10 PM 3

Vehicle ID: 9E04958
Account: CREDIT CARD CUSTOMER
Material: 3/4" CLASS II AB \$5.50
Job No. ID: 16501 ASHLAND AVE
Destination: OAKLAND

Charge by Weight

Gross: 71620 lb (K)
Tare: 30400 lb (K)
Net: 41220 lb
Total Tons: 20.61 tn
Price:\$ 5.500 /tn
Net:\$ 113.35
Tax:\$ 11.05
Total:\$ 124.40

Driver Signature: J.S. EHANDI

Deputy Weighmaster: _____

Weighmaster Certificate

Jose Martin

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103753
8300 BALDWIN STREET Date Time Scale
OAKLAND, CA 94621 In: 0
PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 01:01 PM 3

Vehicle ID: 9E04958
Account: CREDIT CARD CUSTOMER
Material: CONCRETE CLEAN END DUMP
Job No. ID: 16501 ASHLAND AVE
Destination: OAKLAND

Charge by Load
Gross: 0 lb (K)
Tare: 0 lb (K)
Net: 0 lb
Total Tons: 0.00 tn
Price:\$ 35.00
Net:\$ 35.00
Tax:\$ 1
Total:\$ 35.00

Driver Signature: J.S. CHANDI

Deputy Weighmaster: [Signature]

Jose Martin Weighmaster Certificate

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103726
 8300 BALDWIN STREET Date Time Scale
 OAKLAND, CA 94621 In: 0
 PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 11:46 AM 3

Vehicle ID: 9E04958
 Account: CREDIT CARD CUSTOMER
 Material: CONCRETE CLEAN END DUMP
 Job No. ID: 16501 ASHLAND AVE
 Destination: OAKLAND

Charge by Load
 Gross: 0 lb (K)
 Tare: 0 lb (K)
 Net: 0 lb
 Total Tons: 0.00 tn
 Price:\$ 35.00
 Net:\$ 35.00
 Tax:\$ 1
 Total:\$ 35.00

Driver Signature: JS-CHANDI

Deputy Weighmaster: [Signature]

Jose Martin

Weighmaster Certificate

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103729
 8300 BALDWIN STREET Date Time Scale
 OAKLAND, CA 94621 In: 0
 PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 11:56 AM 3

Vehicle ID: 9E04958
 Account: CREDIT CARD CUSTOMER
 Material: 3/4" CLASS II AB \$5.50
 Job No. ID: 16501 ASHLAND AVE
 Destination: OAKLAND

Charge by Weight

Gross:	71020 lb (K)	
Tare:	30400 lb (K)	
Net:	40620 lb	
Total Tons:	20.31 tn	
Price:\$		5.500 /tn
Net:\$	111.71	
Tax:\$		10.89
Total:\$		122.60

Driver Signature: _____

J. S. Chapman

Deputy Weighmaster: _____

Jose Martin

Jose Martin
Weighmaster Certificate

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility


CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103777
 8300 BALDWIN STREET Date Time Scale
 OAKLAND, CA 94621 In: 0
 PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 02:07 PM 3

Vehicle ID: 9B88666
 Account: CREDIT CARD CUSTOMER
 Material: CONCRETE CLEAN END DUMP
 Job No. ID: 16501 ASHLAND AVE
 Destination: SAN LEANDRO

Charge by Load

Gross:	0 lb (K)	
Tare:	0 lb (K)	
Net:	0 lb	
Total Tons:	0.00 tn	
Price:\$	35.00	
Net:\$	35.00	
Tax:\$	1	
Total:\$		35.00

Driver Signature: 

Deputy Weighmaster: 

Jose Martin *Weighmaster Certificate*

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE

Deputy Weighmaster

AMAN

Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

Jose Martin

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103755
8300 BALDWIN STREET Date Time Scale
OAKLAND, CA 94621 In: 0
PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 01:04 PM 3

Vehicle ID: 9B88666
Account: CREDIT CARD CUSTOMER
Material: 3/4" CLASS II AB \$5.50
Job No. ID: 16501 ASHLAND AVE
Destination: SAN LEANDRO

Charge by Weight

Gross: 73960 lb (K)
Tare: 32280 lb (K)
Net: 41680 lb
Total Tons: 20.84 tn
Price:\$ 5.500 /tn
Net:\$ 114.62
Tax:\$ 11.18

Total: \$125.80

Jose Martin

Deputy Weighmaster:

Driver Signature:

Weighmaster Certificate

THIS IS TO CERTIFY that the following ~~described~~ commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103750
 8300 BALDWIN STREET Date Time Scale
 OAKLAND, CA 94621 In: 0
 PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 12:51 PM 3

Vehicle ID: 9B88666
 Account: CREDIT CARD CUSTOMER
 Material: CONCRETE CLEAN END DUMP
 Job No. ID: 16501 ASHLAND AVE
 Destination: SAN LEANDRO

Charge by Load

Gross:	0 lb (K)
Tare:	0 lb (K)
Net:	0 lb
Total Tons:	0.00 tn
Price:\$	35.00
Net:\$	35.00
Tax:\$	1
Total:\$	35.00


Driver Signature: _____

Weighmaster Certificate

Jose Martin

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103727
8300 BALDWIN STREET Date Time Scale
OAKLAND, CA 94621 In: 0
PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 11:48 AM 3

Vehicle ID: 9B88666
Account: CREDIT CARD CUSTOMER
Material: 3/4" CLASS II AB \$5.50
Job No. ID: 16501 ASHLAND AVE
Destination: SAN LEANDRO

Charge by Weight

Gross: 72040 lb (K)
Tare: 32280 lb (K)
Net: 39760 lb
Total Tons: 19.88 tn
Price:\$ 5.500 /tn
Net:\$ 109.34
Tax:\$ 10.66
Total:\$ 120.00

Driver Signature: _____

Deputy Weighmaster: _____

Weighmaster Certificate

Jose Martin

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.

ADDITIONAL TERMS AND CONDITIONS ON REVERSE SIDE



AMAN Environmental Construction, Inc.
Concrete/Asphalt Recycling Facility

CONCRETE/ASPHALT RECYCLING TRANSACTION NO.: 103722
 8300 BALDWIN STREET Date Time Scale
 OAKLAND, CA 94621 In: 0
 PH: 510-553-0110 FAX: 510-5530 Out: 06/29/2010 11:33 AM 3

Vehicle ID: 9B88666
 Account: CREDIT CARD CUSTOMER
 Material: CONCRETE CLEAN END DUMP
 Job No. ID: 16501 ASHLAND AVE
 Destination: SAN LEANDRO

Charge by Load
 Gross: 0 lb (K)
 Tare: 0 lb (K)
 Net: 0 lb
 Total Tons: 0.00 tn
 Price:\$ 35.00
 Net:\$ 35.00
 Tax:\$ 1
 Total:\$ 35.00

Driver Signature: 

Deputy Weighmaster: 

Weighmaster Certificate

Jose Martin

THIS IS TO CERTIFY that the following described commodity was weighed, measured, or counted by a weighmaster, whose signature is on this certificate, who is a recognized authority of accuracy, as prescribed by Chapter 7 (commencing with Section 12700) of Division 5 of the California Business and Professions Code, administered by the Division of Measurement Standards of the California Department of Food and Agriculture.