



76 Broadway
Sacramento, California 95818

March 1, 2011

RECEIVED

10:28 am, Apr 15, 2011

Alameda County
Environmental Health

Mr. Paresh Khatri
Alameda County Environmental Health
1131 Harbor Bay Parkway
Alameda, CA 94502

Re: **Semi-Annual Summary Report Transmittal
Fourth Quarter 2010 through First Quarter 2011
76 Service Station #7176
7850 Amador Valley Boulevard
Dublin, California**

Fuel leak Case No. RO0000482

Dear Mr. Khatri:

I declare under penalty of perjury that the information and/or recommendations contained in the attached document or report is true and correct to the best of my knowledge.

If you have any questions or need additional information, please call:

Ted Moise (Contractor)
ConocoPhillips
Risk Management & Remediation
76 Broadway
Sacramento, CA 95818

Phone: (510) 245-5162
Fax: (918) 662-4480
Ted.Moise@contractor.conocophillips.com

Sincerely,

Eric G. Hetrick
Site Manager
Risk Management & Remediation

Attachment

March 1, 2011

Mr. Paresh Khatri
Hazardous Materials Specialist
Alameda County Health Care Services Agency
1131 Harbor Bay Parkway, Suite 250
Alameda, California 94502

Re: **Semi-Annual Summary Report – Fourth Quarter 2010 through First Quarter 2011**
Fuel leak Case No. RO0000482

Dear Mr. Khatri:

Due to global rebranding, as of January 5, 2011 Delta Consultants has become Antea™Group. Any reports submitted prior to this date will remain under title reference of Delta Consultants (Delta).


On behalf of ConocoPhillips Company (COP), Antea Group is submitting the Semi-Annual Summary Report – Fourth Quarter 2010 through First Quarter 2011 and forwarding a copy of TRC Solutions, Inc. (TRC's) Groundwater Monitoring Report, January through March 2011, dated February 2, 2011, for the following location:

Service Station	Location
76 Service Station No. 7176	7850 Amador Valley Boulevard Dublin, California

Sincerely,
Antea Group



Jan Wagoner
Senior Project Manager



James B. Barnard, P.G.
California Registered Professional Geologist No. 7478



cc: Mr. Ted Moise, ConocoPhillips (electronic copy)

SEMI-ANNUAL SUMMARY REPORT
Fourth Quarter 2010 through First Quarter 2011
76 Service Station No. 7176
7850 Amador Valley Road
Dublin, California

PREVIOUS ASSESSMENT

November 1994 Unocal Corporation (Unocal) replaced the fuel underground storage tanks (USTs), removed the used-oil UST and associated product piping, and removed the oil/water separator. No holes or signs of leakage were observed in the fuel USTs, however, eight holes up to 0.5-inches in diameter were observed in the used oil UST.

October 1995 Six soil borings (B1 through B6) and three on-site monitor wells (U1 through U3) were installed.

March 1998 Tosco Marketing Company (Tosco, now ConocoPhillips) conducted an off-site soil and groundwater investigation that included the installation of two off-site groundwater monitoring wells (MW4 and MW5).

August 2000 A *Request and Work Plan for Case Closure* was submitted that presented results of a groundwater receptor survey, risk-based corrective action Tier II analysis and requested environmental closure. No active groundwater production wells were positively identified within the survey radius during the agency and field groundwater receptor surveys.

June 2001 The *Addendum to Request and Work Plan for Case Closure* was completed.

November 2004 Four soil borings (SB-1 through SB-4) were advanced. The site data is documented in the December 10, 2004 *Limited Phase II Environmental Site Assessment* report. Based on the report of findings, residual concentrations of total petroleum hydrocarbons as diesel (TPHd) (7.1 mg/kg) were reported in the vicinity of SB-3. Dissolved hydrocarbon concentrations were reported in each soil boring with the exception of SB-4. Maximum concentrations were reported as follows: TPHd [1,100 micrograms per liter ($\mu\text{g}/\text{L}$) in SB-1], total petroleum hydrocarbons as gasoline (TPHg) (9,700 $\mu\text{g}/\text{L}$ in SB-3) and methyl tertiary butyl ether (MTBE) (3.0 $\mu\text{g}/\text{L}$ in SB-1). Benzene was not reported above the laboratories indicated reporting limit of 2.5 $\mu\text{g}/\text{L}$.

January 2005 ATC became the new site lead consultant.

September 2005 Site environmental consulting responsibilities were transferred to Delta Consultants.

January 2010 Delta advanced an on-site cone penetrometer (CPT) boring to perform a vertical assessment of groundwater at the site. With the exception of TPHd, petroleum hydrocarbon concentrations in samples collected during this investigation were below the laboratory's reporting limits. The reported concentrations of TPHd were below the Bay Area Regional Water Quality Control Board Primary Environmental Screening Levels (ESLs) of 100 $\mu\text{g}/\text{L}$ (Table 5)

SENSITIVE RECEPTORS

July 2007 Delta conducted a sensitive receptor survey to identify all water supply wells within a one-mile radius of the site and sensitive receptors within 1,000 feet from the site. Using the DWR well logs, a total of 28 water supply wells were identified as being within a one-mile radius of the subject site. The closest down-gradient well is a cathodic protection well located approximately 0.8 miles southeast of the site. The closest water supply well is a domestic well located approximately 0.4 miles southwest of the site. No water bodies, schools, daycare centers, hospitals, or churches acting as a potential school or daycare facilities were identified within the survey area. Site Locator Sensitive Receptor Map is included as Attachment A.

GROUNDWATER MONITORING AND SAMPLING

This site is monitored and sampled on a semi-annual basis during the first and third quarters. The monitoring and sampling network consists of 3 on-site and 2 off-site wells. Samples collected from the monitoring wells are analyzed for TPHd and TPHg by Environmental Protection Agency (EPA) Method 8015M, TPHg (GC/MS), benzene, toluene, ethyl-benzene, and total xylenes (BTEX), MTBE, di-isopropyl ether (DIPE), tertiary butyl alcohol (TBA), tertiary amyl methyl ether (TAME), ethyl tertiary butyl ether (ETBE), ethylene dichloride (EDC), ethylene dibromide (EDB) and ethanol (eight oxygenates) as well as a full Volatile Organic Compound (VOC) scan by EPA Method 8260B. TRC has been retained to perform the monitoring and sampling. A copy of TRC's *Groundwater Monitoring Report January through March 2011*, dated February 2, 2010 has been provided with this report.

During the most recent groundwater monitoring and sampling event, conducted on January 17, 2011, depth to groundwater ranged from 14.35 feet (MW-5) to 16.70 feet (U-3) below top of casing (TOC). The groundwater flow direction was interpreted to be southeast with a gradient of 0.003 foot per foot (ft/ft). Groundwater flow direction and gradient during the previous event was also interpreted to be southeast with a flow gradient of 0.004 ft/ft. Historically, groundwater flow direction has been predominantly southeast. Historical groundwater flow directions are shown in a rose diagram presented as Attachment B.

All monitoring and sampling activities during the first quarter 2011 were performed by TRC and reviewed and certified by a TRC California Professional Geologist. The groundwater sampling data package which includes the groundwater monitoring field data sheets are provided as Attachment C.

CONSTITUENTS OF CONCERN

TPHg (GC/MS) was above the laboratory's indicated reporting limit in groundwater samples collected from three of the five wells sampled with a maximum concentration of 2,100 µg/L in U-1 during the current sampling event. This is an increase from a maximum concentration of 2,000 µg/L in U-1 during the previous sampling event (8/13/10). Wells U-2 and MW-4 reported TPHg (GC/MS) concentrations of 1,100 µg/L and 120 µg/L, respectively, during the current event. TPHg (GC/MS) concentrations reported during the first quarter 2011 sampling event are consistent with historical concentrations at the site.

TPHd was above the laboratory's indicated reporting limit in groundwater samples collected from two of the five wells sampled with a maximum concentration of 670 µg/L in U-1 during the current sampling event. This is an increase from a maximum concentration of 540 µg/L in this well during the previous sampling event (8/13/10). Well U-2 reported a TPHd concentration of 360 µg/L during the current event. TPHd concentrations reported during the first quarter 2011 sampling event are consistent with historical concentrations at the site.

Benzene was below the laboratory's indicated reporting limits in groundwater samples collected from all five monitoring wells during the current event. This is consistent with the previous sampling event.

Toluene was below the laboratory's indicated reporting limits in groundwater samples collected from all five wells sampled during the current sampling event. This is consistent with the previous sampling event.

Ethyl-benzene was above the laboratory's indicated reported limit in the groundwater sample collected from well U-2 only, with a maximum concentration of 0.59 µg/L during the current sampling

event. This is a decrease from the maximum concentration of 0.77 µg/L reported in the same well during the previous sampling event (8/13/10).

Total Xylenes were below the laboratory's indicated reporting limits in groundwater samples collected from all five of the wells sampled during the current sampling event. During the previous sampling event, total xylenes were reported in one well, U-2, at a concentration of 1.2 µg/L.

MTBE was above the laboratory's indicated reporting limit in one well, U-2 at a concentration of 0.63 µg/L. This is decrease from the maximum reported concentration of 0.69 µg/L reported in the same well during the previous sampling event (8/13/10).

Concentrations of the eight oxygenates were below the laboratory's indicated reported limits in all five of the wells sampled during the current sampling event. Concentrations of n-Butyl-benzene, tert-Butyl-benzene, isopropyl-benzene and n-Propyl-benzene were reported above the laboratory's indicated reporting limits in wells U-1 and U-2 during the current sampling event.

REMEDIATION STATUS

Approximately 5,000 gallons of groundwater were removed from the fuel UST excavation during the 1994 UST replacement activities. A total of 15,511 gallons of groundwater have been removed historically from the site through periodic groundwater purging of the UST cavity. Approximately 1,863 tons of hydrocarbon-impacted soil were excavated and removed from the site during the 1994 UST replacement activities.

Active remediation is currently not being conducted at the site.

CHARACTERIZATION STATUS

Petroleum hydrocarbon concentrations in the groundwater are limited to an area surrounding the UST cavity and dispenser islands.

Contaminants of concern benzene and MTBE are not present above State of California drinking water standards. Analytical data collected during the most recent groundwater monitoring and sampling event indicate that MTBE and benzene concentrations in the groundwater are below laboratory indicated reporting limits.

Based on the data collected during groundwater monitoring and sampling activities at the site it appears that TPHg and TPHd concentrations in the groundwater are generally stable or decreasing.

In addition, with the exception of the January, 2010 gauging event, historically the average groundwater gradient at the site is 0.005 ft/ft. This is relatively flat and indicates that the off-site potential for petroleum hydrocarbon plume migration is minimized.

RECENT CORRESPONDENCE

February 25, 2011 – Email from Antea Group to ACEH requesting the due date for summary reports to be established as 45 days after sampling and not the 30 days as outlined in ACEH's July 29, 2010 letter to ConocoPhillips.

WASTE DISPOSAL SUMMARY

Purge water generated during the first quarter 2011 monitoring and sampling activities was accumulated at TRC's groundwater monitoring field office in Concord, California for transportation by a licensed carrier to an authorized disposal facility. Currently, non-hazardous purge water is

transported under a bulk non-hazardous waste manifest to Crosby and Overton, Inc. in Long Beach, California.

FOURTH QUARTER 2010 THROUGH FIRST QUARTER 2011 ACTIVITIES

1. TRC conducted the semi-annual monitoring and sampling activities at the site on January 17, 2011, and prepared a *Groundwater Monitoring Report – January through March 2011*, dated February 2, 2011.

SECOND QUARTER 2011 THROUGH THIRD QUARTER 2011 ACTIVITES


1. A second semi-annual monitoring and sampling event will be performed during the third quarter of 2011. Antea Group recommends discontinuing the full VOC scan by EPA Method 8260 and the TPHg analysis by EPA Method 8015.
2. A semi-annual summary report will be prepared.

CONSULTANT: AnteaTMGroup

ATTACHMENTS

Attachment A – Site Locator Sensitive Receptor Map
Attachment B – Historic Groundwater Flow Directions (Rose Diagram)
Attachment C – Groundwater Monitoring Report - October 2010 through March 2011

ATTACHMENT A
Site Locator Sensitive Receptor Map

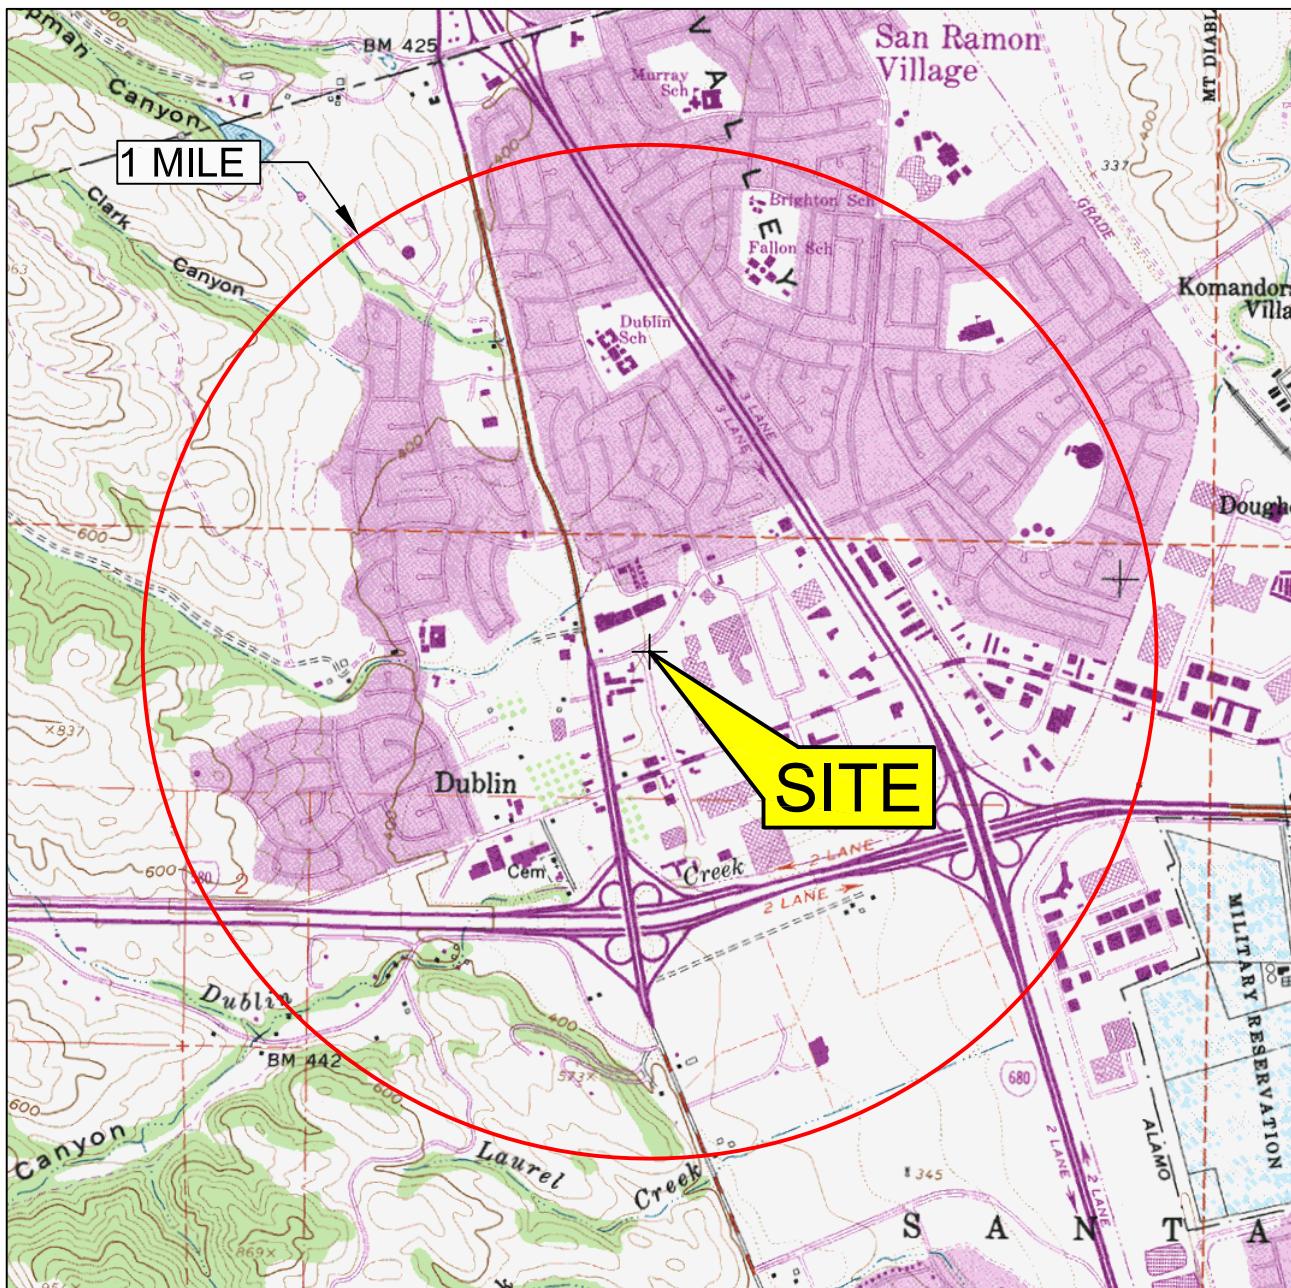

0 1000 FT 2000 FT

SCALE: 1 : 24,000



North

FIGURE 1

SITE LOCATOR SENSITIVE RECEPTOR
MAP

76 STATION NO. 7176
7850 AMADOR VALLEY BOULEVARD
DUBLIN, CALIFORNIA

PROJECT NO. C107-176 DRAWN BY MC 10/12/06

FILE NO. Site Locator 7176 PREPARED BY MC

REVISION NO. REVIEWED BY




ATTACHMENT B
Historic Groundwater Flow Directions

Historic Groundwater Flow Directions

ConocoPhillips Site No. 7176

7850 Amador Valley Boulevard

Dublin, California

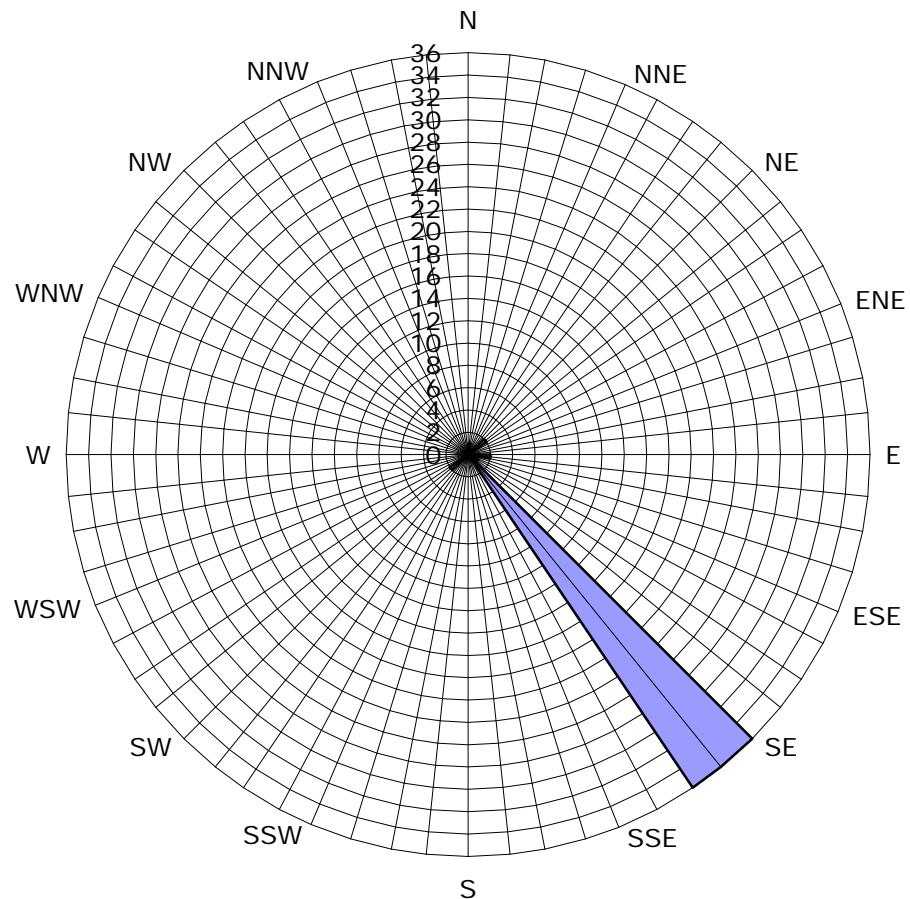


■ Groundwater Flow Direction

LEGEND

Concentric circles represent quarterly monitoring events.
Fourth Quarter 1995 through Fourth Quarter 2010.

ATTACHMENT C

Groundwater Monitoring Report, TRC, February 2, 2011

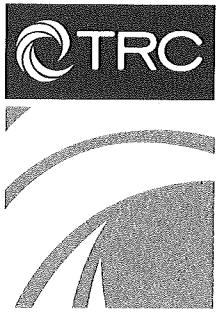

**123 Technology Drive West
Irvine, CA 92618**

949.727.9336 PHONE
949.727.7399 FAX

www.TRCsolutions.com

DATE: February 2, 2011

TO: ConocoPhillips Company
76 Broadway
Sacramento, CA 95818

ATTN: MR. TED MOISE


SITE: 76 STATION 7176
7850 AMADOR VALLEY BLVD.
DUBLIN, CALIFORNIA

RE: GROUNDWATER MONITORING REPORT
JANUARY THROUGH MARCH 2011

Dear Mr. Moise,

Please find enclosed our Groundwater Monitoring Report for 76 Station 7176, located at 7850 Amador Valley Blvd., Dublin, California. If you have any questions regarding this report, please call us at (949) 727-9336.

Sincerely,


Anju Farfan

Groundwater Program Operations Manager

CC: Mr. Jan Wagoner, Delta Consultants (2 copies)

Enclosures
20-0400/7176R15.QMS

**GROUNDWATER MONITORING REPORT
JANUARY THROUGH MARCH 2011**

76 STATION 7176
7850 Amador Valley Blvd.
Dublin, California

Prepared For:

Mr. Ted Moise
CONOCOPHILLIPS COMPANY
76 Broadway
Sacramento, California 95818

By:



Senior Project Geologist, Irvine Operations

Date: 2/2/11

LIST OF ATTACHMENTS	
Summary Sheet	Summary of Gauging and Sampling Activities
Tables	Table Key Contents of Tables Table 1: Current Fluid Levels and Selected Analytical Results Table 1a: Additional Current Analytical Results Table 1b: Additional Current Analytical Results Table 1c: Additional Current Analytical Results Table 1d: Additional Current Analytical Results Table 1e: Additional Current Analytical Results Table 2: Historic Fluid Levels and Selected Analytical Results Table 2a: Additional Historic Analytical Results Table 2b: Additional Historic Analytical Results Table 2c: Additional Historic Analytical Results Table 2d: Additional Historic Analytical Results Table 2e: Additional Historic Analytical Results Table 2f: Additional Historic Analytical Results
Figures	Figure 1: Vicinity Map Figure 2: Groundwater Elevation Contour Map Figure 3: Dissolved-Phase TPH-G Concentration Map Figure 4: Dissolved-Phase Benzene Concentration Map Figure 5: Dissolved-Phase MTBE Concentration Map Figure 6: Dissolved-Phase TPH-D Concentration Map
Graphs	Groundwater Elevations vs. Time Benzene Concentrations vs. Time MTBE Concentrations vs. Time
Field Activities	General Field Procedures Field Monitoring Data Sheet – 1/17/11 Groundwater Sampling Field Notes – 1/17/11
Laboratory Reports	Official Laboratory Reports Quality Control Reports Chain of Custody Records
Statements	Purge Water Disposal Limitations

Summary of Gauging and Sampling Activities
January through March 2011
76 Station 7176
7850 Amador Valley Boulevard
Dublin, CA

Project Coordinator: **Ted Moise** Water Sampling Contractor: **TRC**
Telephone: **510-245-5162** Compiled by: **Daniel Lee**

Date(s) of Gauging/Sampling Event: **1/17/2011**

Sample Points

Groundwater wells: **3** onsite, **2** offsite Points gauged: **5** Points sampled: **5**
Purging method: **Submersible pump/bailer**
Purge water disposal: **Crosby and Overton treatment facility**
Other Sample Points: **0** Type: **--**

Liquid Phase Hydrocarbons (LPH)

Sample Points with LPH: **0** Maximum thickness (feet): **--**
LPH removal frequency: **--** Method: **--**
Treatment or disposal of water/LPH: **--**

Hydrogeologic Parameters

Depth to groundwater (below TOC): Minimum: **14.35 feet** Maximum: **16.7 feet**
Average groundwater elevation (relative to available local datum): **343.86 feet**
Average change in groundwater elevation since previous event: **0.65 feet**
Interpreted groundwater gradient and flow direction:
Current event: **0.003 ft/ft, southeast**
Previous event: **0.004 ft/ft, southeast (8/13/2010)**

Selected Laboratory Results

Sample Points with detected **Benzene**: **0** Sample Points above MCL (1.0 µg/l): **--**
Maximum reported benzene concentration: **--**
Sample Points with **TPH-G by GC/MS** **3** Maximum: **2,100 µg/l (U-1)**
Sample Points with **MTBE 8260B** **1** Maximum: **0.63 µg/l (U-2)**

Notes:

TABLES

TABLE KEY

STANDARD ABBREVIATIONS

--	= not analyzed, measured, or collected
LPH	= liquid-phase hydrocarbons
$\mu\text{g/l}$	= micrograms per liter (approx. equivalent to parts per billion, ppb)
mg/l	= milligrams per liter (approx. equivalent to parts per million, ppm)
ND<	= not detected at or above laboratory detection limit
TOC	= top of casing (surveyed reference elevation)
D	= duplicate
P	= no-purge sample

ANALYTES

DIPE	= di-isopropyl ether
ETBE	= ethyl tertiary butyl ether
MTBE	= methyl tertiary butyl ether
PCB	= polychlorinated biphenyls
PCE	= tetrachloroethene
TBA	= tertiary butyl alcohol
TCA	= trichloroethane
TCE	= trichloroethylene
TPH-G	= total petroleum hydrocarbons with gasoline distinction
TPH-G (GC/MS)	= total petroleum hydrocarbons with gasoline distinction utilizing EPA Method 8260B
TPH-D	= total petroleum hydrocarbons with diesel distinction
TRPH	= total recoverable petroleum hydrocarbons
TAME	= tertiary amyl methyl ether
1,2-DCA	= 1,2-dichloroethane (same as EDC, ethylene dichloride)

NOTES

1. Elevations are in feet above mean sea level. Depths are in feet below surveyed top-of-casing.
2. Groundwater elevations for wells with LPH are calculated as: Surface Elevation – Measured Depth to Water + (Dp x LPH Thickness), where Dp is the density of the LPH, if known. A value of 0.75 is used for gasoline and when the density is not known. A value of 0.83 is used for diesel.
3. Wells with LPH are generally not sampled for laboratory analysis (see General Field Procedures).
4. Comments shown on tables are general. Additional explanations may be included in field notes and laboratory reports, both of which are included as part of this report.
5. A “J” flag indicates that a reported analytical result is an estimated concentration value between the method detection limit (MDL) and the practical quantification limit (PQL) specified by the laboratory.
6. Other laboratory flags (qualifiers) may have been reported. See the official laboratory report (attached) for a complete list of laboratory flags.
7. Concentration graphs based on tables (presented following Figures) show non-detect results prior to the Second Quarter 2000 plotted at fixed values for graphical display. Non-detect results reported since that time are plotted at reporting limits stated in the official laboratory report.
8. Prior to the 1st quarter 2010, the word “monitor” was used in table comments interchangeably with the word “gauge”. Starting in the 1st quarter 2010, the word “monitor” is used to include both “gauge” and “sample”.

REFERENCE

TRC began groundwater monitoring and sampling for site 76 Station 7176 in October 2003. Historical data compiled prior to that time were provided by Gettler-Ryan Inc.

Contents of Tables 1 and 2

Site: 76 Station 7176

Current Event

Table 1	Well/ Date	Depth to Water	LPH Thickness	Ground- water Elevation	Change in Elevation	TPH-D	TPH-G 8015	TPH-G (GC/MS)	Benzene	Toluene	Ethyl- benzene	Total Xylenes	MTBE (8021B)	MTBE (8260B)
Table 1a	Well/ Date	TBA	Ethanol (8260B)	Ethylene- dibromide (EDB)	1,2-DCA (EDC)	DIPE	ETBE	TAME	Bromo- benzene	Bromo- chloro- methane	Bromo- dichloro- methane	Bromo- form	Bromo- methane	Bromo- methane
Table 1b	Well/ Date	n-Butyl- benzene	sec-Butyl- benzene	tert-Butyl benzene	Carbon Tetra- chloride	Chloro- benzene	Chloro- ethane	Chloroform	Chloro- methane	2- Chloro- toluene	4-Chloro- toluene	1,2Dibrom- 3-chloro- propane	Dibromo- chloro- methane	Dibromo- chloro- methane
Table 1c	Well/ Date	Dibromo- methane	1,2- Dichloro- benzene	1,3- Dichloro- benzene	1,4- Dichloro- benzene	Dichloro- difluoro- methane	1,1-DCA	1,1-DCE	cis- 1,2-DCE	trans- 1,2-DCE	1,2- Dichloro- propane	1,3- Dichloro- propane	2,2- Dichloro- propane	2,2- Dichloro- propane
Table 1d	Well/ Date	1,1- Dichloro- propene	cis-1,3- Dichloro- propene	trans-1,3- Dichloro- propene	Hexa- chloro- butadiene	Isopropyl- benzene	p- Isopropyl- toluene	Methylene chloride	Naph- thalene	n-Propyl- benzene	Styrene	1,1,1,2- Tetrachloro- ethane	1,1,2,2- Tetrachloro- ethane	1,1,2,2- Tetrachloro- ethane
Table 1e	Well/ Date	Tetrachloro- ethene (PCE)	Trichloro- trifluoro- ethane	1,2,4- Trichloro- benzene	1,2,3- Trichloro- benzene	1,1,1- Trichloro- ethane	1,1,2- Trichloro- ethane	Trichloro- ethene (TCE)	Trichloro- fluoro- methane	1,2,3- Trichloro- propane	1,2,4- Trimethyl- benzene	1,3,5- Trimethyl- benzene	Vinyl chloride	Vinyl chloride

Historic Data

Table 2	Well/ Date	Depth to Water	LPH Thickness	Ground- water Elevation	Change in Elevation	TPH-D	TPH-G 8015	TPH-G (GC/MS)	Benzene	Toluene	Ethyl- benzene	Total Xylenes	MTBE (8021B)	MTBE (8260B)	
Table 2a	Well/ Date	TBA	Ethanol (8260B)	Ethylene- dibromide (EDB)	EDB (504)	1,2-DCA (EDC)	DIPE	ETBE	TAME	Bromo- benzene	Bromo- chloro- methane	Bromo- dichloro- methane	Bromo- form	Bromo- methane	Bromo- methane
Table 2b	Well/ Date	Bromo- methane	n-Butyl- benzene	sec-Butyl- benzene	tert-Butyl benzene	Carbon Tetra- chloride	Chloro- benzene	Chloro- ethane	Chloroform	Chloro- methane	2- Chloro- toluene	4-Chloro- toluene	1,2Dibrom- 3-chloro- propane	1,2Dibrom- 3-chloro- propane	1,2Dibrom- 3-chloro- propane
Table 2c	Well/ Date	Dibromo- chloro- methane	Dibromo- methane	1,2- Dichloro- benzene	1,3- Dichloro- benzene	1,4- Dichloro- benzene	Dichloro- difluoro- methane	1,1-DCA	1,1-DCE	cis- 1,2-DCE	trans- 1,2-DCE	1,2- Dichloro- propane	1,3- Dichloro- propane	1,3- Dichloro- propane	1,3- Dichloro- propane
Table 2d	Well/ Date	2,2- Dichloro- propane	1,1- Dichloro- propene	cis-1,3- Dichloro- propene	trans-1,3- Dichloro- propene	Hexa- chloro- butadiene	Isopropyl- benzene	p- Isopropyl- toluene	Methylene chloride	Naph- thalene	n-Propyl- benzene	Styrene	1,1,1,2- Tetrachloro- ethane	1,1,2,2- Tetrachloro- ethane	1,1,2,2- Tetrachloro- ethane

Contents of Tables 1 and 2

Site: 76 Station 7176

Table 2e	Well/ Date	1,1,2,2- Tetrachloro- ethane	Tetrachloro- ethene (PCE)	Trichloro- trifluoro- ethane	1,2,4- Trichloro- benzene	1,2,3- Trichloro- benzene	1,1,1- Trichloro- ethane	1,1,2- Trichloro- ethane	Trichloro- ethene (TCE)	Trichloro- fluoro- methane	1,2,3- Trichloro- propane	1,2,4- Trimethyl- benzene	1,3,5- Trimethyl- benzene
-----------------	---------------	------------------------------------	---------------------------------	------------------------------------	---------------------------------	---------------------------------	--------------------------------	--------------------------------	-------------------------------	----------------------------------	---------------------------------	---------------------------------	---------------------------------

Table 2f	Well/ Date	Vinyl chloride
-----------------	---------------	-------------------

Table 1
CURRENT FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
January 17, 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (GC/MS) (µg/l)	TPH-G Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-4 (Screen Interval in feet: 10.0-25.0)														
1/17/2011	359.16	15.37	0.00	343.79	0.70	ND<50	55	120	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50
MW-5 (Screen Interval in feet: 10.0-25.0)														
1/17/2011	357.80	14.35	0.00	343.45	0.66	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50
U-1 (Screen Interval in feet: 10.0-30.0)														
1/17/2011	358.36	14.50	0.00	343.86	0.65	670	1200	2100	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50
U-2 (Screen Interval in feet: 10.0-30.0)														
1/17/2011	359.32	15.27	0.00	344.05	0.57	360	560	1100	ND<0.50	ND<0.50	0.59	ND<1.0	--	0.63
U-3 (Screen Interval in feet: 10.0-30.0)														
1/17/2011	360.87	16.70	0.00	344.17	0.68	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50

Table 1 a
ADDITIONAL CURRENT ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA (µg/l)	Ethanol (8260B) (µg/l)	Ethylene-dibromide (EDB) (µg/l)	1,2-DCA (EDC) (µg/l)	DIPE (µg/l)	ETBE (µg/l)	TAME (µg/l)	Bromo-benzene (µg/l)	Bromo-chloro-methane (µg/l)	Bromo-dichloro-methane (µg/l)	Bromo-form (µg/l)	Bromo-methane (µg/l)
MW-4												
1/17/2011	ND<10	ND<250	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
MW-5												
1/17/2011	ND<10	ND<250	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-1												
1/17/2011	ND<10	ND<250	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-2												
1/17/2011	ND<10	ND<250	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-3												
1/17/2011	ND<10	ND<250	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0

Table 1 b
ADDITIONAL CURRENT ANALYTICAL RESULTS
76 Station 7176

Date Sampled	n-Butyl-benzene (µg/l)	sec-Butyl-benzene (µg/l)	tert-Butyl benzene (µg/l)	Carbon Tetra-chloride (µg/l)	Chloro-benzene (µg/l)	Chloro-ethane (µg/l)	Chloroform (µg/l)	Chloro-methane (µg/l)	2-Chloro-toluene (µg/l)	4-Chloro-toluene (µg/l)	1,2Dibrom-3-chloro-propane (µg/l)	Dibromo-chloro-methane (µg/l)
MW-4 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50
MW-5 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50
U-1 1/17/2011	39	ND<0.50	2.6	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50
U-2 1/17/2011	4.4	ND<0.50	4.7	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50
U-3 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50

Table 1 c
ADDITIONAL CURRENT ANALYTICAL RESULTS
76 Station 7176

Date Sampled	Dibromo-methane (µg/l)	1,2-Dichloro-benzene (µg/l)	1,3-Dichloro-benzene (µg/l)	1,4-Dichloro-benzene (µg/l)	Dichloro-difluoro-methane (µg/l)	1,1-DCA (µg/l)	1,1-DCE (µg/l)	cis-1,2-DCE (µg/l)	trans-1,2-DCE (µg/l)	1,2-Dichloro-propane (µg/l)	1,3-Dichloro-propane (µg/l)	2,2-Dichloro-propane (µg/l)
MW-4												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
MW-5												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-1												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-2												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-3												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50

Table 1 d
ADDITIONAL CURRENT ANALYTICAL RESULTS
76 Station 7176

Date Sampled	1,1-Dichloro-propene (µg/l)	cis-1,3-Dichloro-propene (µg/l)	trans-1,3-Dichloro-propene (µg/l)	Hexa-chloro-butadiene (µg/l)	Isopropyl-benzene (µg/l)	p-Isopropyl-toluene (µg/l)	Methylene chloride (µg/l)	Naphthalene (µg/l)	n-Propyl-benzene (µg/l)	Styrene (µg/l)	1,1,1,2-Tetrachloro-ethane (µg/l)	1,1,2,2-Tetrachloro-ethane (µg/l)
MW-4 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
MW-5 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-1 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	17	ND<0.50	ND<1.0	ND<0.50	67	ND<0.50	ND<0.50	ND<0.50
U-2 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	15	ND<0.50	ND<1.0	ND<0.50	25	ND<0.50	ND<0.50	ND<0.50
U-3 1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50

Table 1 e
ADDITIONAL CURRENT ANALYTICAL RESULTS
76 Station 7176

Date Sampled	Tetrachloro-ethene (PCE) (µg/l)	Trichloro-trifluoro-ethane (µg/l)	1,2,4-Trichloro-benzene (µg/l)	1,2,3-Trichloro-benzene (µg/l)	1,1,1-Trichloro-ethane (µg/l)	1,1,2-Trichloro-ethane (µg/l)	Trichloro-ethene (TCE) (µg/l)	Trichloro-fluoro-methane (µg/l)	1,2,3-Trichloro-propane (µg/l)	1,2,4-Trimethyl-benzene (µg/l)	1,3,5-Trimethyl-benzene (µg/l)	Vinyl chloride (µg/l)
MW-4												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50
MW-5												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50
U-1												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50
U-2												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50
U-3												
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-4 (Screen Interval in feet: 10.0-25.0)															
4/23/1998	356.41	12.11	0.00	344.30	--	--	2500	--	5.9	6.4	16	31	ND	--	
7/8/1998	356.41	13.70	0.00	342.71	-1.59	1400	1000	--	ND	ND	ND	ND	ND	--	
10/5/1998	356.41	15.18	0.00	341.23	-1.48	--	890	--	ND	ND	ND	14	ND	--	
1/4/1999	356.41	16.39	0.00	340.02	-1.21	71	230	--	0.56	1.3	1.4	1.8	10	--	
D 1/4/1999	356.41	16.39	0.00	340.02	-1.21	71	--	--	--	--	--	--	--	--	
4/5/1999	356.41	14.61	0.00	341.80	1.78	340	620	--	ND	1.8	2.1	ND	6	9.3	
D 4/5/1999	356.41	14.61	0.00	341.80	1.78	210	--	--	--	--	--	--	--	--	
7/1/1999	356.41	15.43	0.00	340.98	-0.82	260	700	--	2.1	ND	1.9	2.4	ND	21	
D 7/1/1999	356.41	15.43	0.00	340.98	-0.82	310	--	--	--	--	--	--	--	--	
9/30/1999	356.41	16.27	0.00	340.14	-0.84	420	582	--	2.6	1.30	1.98	ND	23.1	22.5	
D 9/30/1999	356.41	16.27	0.00	340.14	-0.84	220	--	--	--	--	--	--	--	--	
1/3/2000	356.41	17.50	0.00	338.91	-1.23	250	800	--	4.2	4.6	3.3	11	31	17	
D 1/3/2000	356.41	17.50	0.00	338.91	-1.23	260	--	--	--	--	--	--	--	--	
4/4/2000	356.41	13.91	0.00	342.50	3.59	460	710	--	2	1.3	4.4	2.0	21	22	
D 4/4/2000	356.41	13.91	0.00	342.50	3.59	340	--	--	--	--	--	--	--	--	
7/14/2000	356.41	15.58	0.00	340.83	-1.67	220	490	--	0.89	1.3	0.85	1.8	21	12	
D 7/14/2000	356.41	15.58	0.00	340.83	-1.67	76	--	--	--	--	--	--	--	--	
10/27/2000	356.41	16.96	0.00	339.45	-1.38	160	598	--	ND	1.56	4.65	ND	15.4	14	
D 10/27/2000	356.41	16.96	0.00	339.45	-1.38	120	--	--	--	--	--	--	--	--	
1/8/2001	356.41	16.64	0.00	339.77	0.32	--	522	--	4.09	1.69	2.53	1.26	17.2	14.3	
4/3/2001	356.41	15.46	0.00	340.95	1.18	180	575	--	ND	ND	ND	ND	14.0	11.6	
D 4/3/2001	356.41	15.46	0.00	340.95	1.18	ND	--	--	--	--	--	--	--	--	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-4 continued															
7/6/2001	356.41	16.63	0.00	339.78	-1.17	230	720	--	4.7	1.5	2.5	0.74	10	7.1	
D 7/6/2001	356.41	16.63	0.00	339.78	-1.17	200	--	--	--	--	--	--	--	--	
10/5/2001	356.41	17.38	0.00	339.03	-0.75	180	650	--	4.3	1.2	1.1	1.8	5.9	5.4	
D 10/5/2001	356.41	17.38	0.00	339.03	-0.75	140	--	--	--	--	--	--	--	--	
1/3/2002	356.41	15.10	0.00	341.31	2.28	390	340	--	2.9	1.4	1.7	ND<1.0	ND<10/	3.1	
D 1/3/2002	356.41	15.10	0.00	341.31	2.28	360	--	--	--	--	--	--	--	--	
4/1/2002	356.41	14.85	0.00	341.56	0.25	160	340	--	ND<0.50	2.7	ND<0.50	0.66	ND<5.0	2.2	
D 4/1/2002	356.41	14.85	0.00	341.56	0.25	100	--	--	--	--	--	--	--	--	
7/1/2002	356.41	15.53	0.00	340.88	-0.68	130	--	280	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	0.58	
D 7/1/2002	356.41	15.53	0.00	340.88	-0.68	97	--	--	--	--	--	--	--	--	
1/24/2003	356.41	14.52	0.00	341.89	1.01	52	--	170	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<2.0	
D 1/24/2003	356.41	14.52	0.00	341.89	1.01	ND<50	--	--	--	--	--	--	--	--	
7/28/2003	356.41	15.47	0.00	340.94	-0.95	110	--	380	ND<0.50	ND<0.50	ND<0.50	ND<1	ND<2	ND<2	
D 7/28/2003	356.41	15.47	0.00	340.94	-0.95	130	--	--	--	--	--	--	--	--	
2/4/2004	356.41	15.55	0.00	340.86	-0.08	94	--	270	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<2.0	
7/2/2004	356.41	16.52	0.00	339.89	-0.97	ND<200	--	170	ND<0.5	ND<0.5	ND<0.5	ND<1	--	0.83	
1/11/2005	356.41	14.83	0.00	341.58	1.69	110	--	460	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	0.87	
D 1/11/2005	356.41	14.83	0.00	341.58	1.69	85	--	--	--	--	--	--	--	--	
7/8/2005	356.41	14.33	0.00	342.08	0.50	67	--	120	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	0.60	
D 7/8/2005	356.41	14.33	0.00	342.08	0.50	67	--	--	--	--	--	--	--	--	
1/6/2006	356.41	15.59	0.00	340.82	-1.26	ND<200	--	130	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	1.3	
9/11/2006	356.41	16.16	0.00	340.25	-0.57	ND<50	--	110	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	1.0	
2/16/2007	356.41	16.39	0.00	340.02	-0.23	66	--	210	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	1.0	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-4 continued															
7/3/2007	356.41	16.60	0.00	339.81	-0.21	ND<56	--	160	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	0.71	
2/1/2008	356.41	15.26	0.00	341.15	1.34	66	--	91	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
9/2/2008	356.41	17.97	0.00	338.44	-2.71	51	--	380	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	0.70	
3/6/2009	356.41	15.89	0.00	340.52	2.08	ND<50	--	90	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/21/2009	356.41	17.80	0.00	338.61	-1.91	ND<50	--	260	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/14/2010	356.41	18.12	0.00	338.29	-0.32	66	--	220	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/13/2010	359.16	16.07	0.00	343.09	4.80	87	55	110	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/17/2011	359.16	15.37	0.00	343.79	0.70	ND<50	55	120	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
MW-5															
(Screen Interval in feet: 10.0-25.0)															
4/23/1998	355.03	11.15	0.00	343.88	--	--	120	--	0.53	0.90	1.0	3.8	13	--	
7/8/1998	355.03	12.63	0.00	342.40	-1.48	170	ND	--	ND	ND	ND	ND	12	--	
10/5/1998	355.03	14.00	0.00	341.03	-1.37	--	ND	--	ND	ND	ND	ND	12	--	
1/4/1999	355.03	15.21	0.00	339.82	-1.21	ND	ND	--	ND	ND	ND	ND	ND	--	
4/5/1999	355.03	13.76	0.00	341.27	1.45	ND	ND	--	ND	ND	ND	ND	ND	ND	
7/1/1999	355.03	14.48	0.00	340.55	-0.72	ND	ND	--	ND	ND	ND	ND	ND	2.3	
9/30/1999	355.03	15.15	0.00	339.88	-0.67	60.4	50.8	--	ND	ND	ND	ND	ND	ND	
D 9/30/1999	355.03	15.15	0.00	339.88	-0.67	ND	--	--	--	--	--	--	--	--	
1/3/2000	355.03	16.34	0.00	338.69	-1.19	ND	ND	--	ND	ND	ND	ND	ND	ND	
4/4/2000	355.03	12.90	0.00	342.13	3.44	69	ND	--	ND	ND	ND	ND	ND	ND	
D 4/4/2000	355.03	12.90	0.00	342.13	3.44	ND	--	--	--	--	--	--	--	--	
7/14/2000	355.03	14.48	0.00	340.55	-1.58	ND	ND	--	ND	ND	ND	ND	ND	ND	
10/27/2000	355.03	15.75	0.00	339.28	-1.27	ND	ND	--	ND	ND	ND	ND	ND	ND	
1/8/2001	355.03	15.25	0.00	339.78	0.50	--	ND	--	ND	ND	ND	ND	ND	ND	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-5 continued															
4/3/2001	355.03	14.41	0.00	340.62	0.84	ND	ND	--	ND	ND	ND	ND	ND	ND	
7/6/2001	355.03	15.52	0.00	339.51	-1.11	ND	ND	--	ND	ND	ND	ND	ND	ND	
10/5/2001	355.03	16.28	0.00	338.75	-0.76	ND<50	ND<50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<5.0	ND<2.0	
1/3/2002	355.03	14.01	0.00	341.02	2.27	ND<51	ND<50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<5.0	1.6	
4/1/2002	355.03	13.64	0.00	341.39	0.37	ND<50	ND<50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<5.0	3.5	
7/1/2002	355.03	14.51	0.00	340.52	-0.87	ND<60	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	2.3	
1/24/2003	355.03	13.53	0.00	341.50	0.98	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	4.3	
7/28/2003	355.03	14.40	0.00	340.63	-0.87	ND<50	--	ND<50	ND<0.50	ND<0.50	ND0.50	ND<1.0	--	3.4	
2/4/2004	355.03	14.41	0.00	340.62	-0.01	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	2.6	
7/2/2004	355.03	15.41	0.00	339.62	-1.00	ND<200	--	80	ND<0.5	ND<0.5	ND<0.5	ND<1	--	2.0	
1/11/2005	355.03	13.74	0.00	341.29	1.67	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	0.64	
7/8/2005	355.03	13.24	0.00	341.79	0.50	220	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
D 7/8/2005	355.03	13.24	0.00	341.79	0.50	ND<50	--	--	--	--	--	--	--	--	
1/6/2006	355.03	14.33	0.00	340.70	-1.09	ND<200	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
9/11/2006	355.03	14.91	0.00	340.12	-0.58	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	ND<0.50	
2/16/2007	355.03	15.13	0.00	339.90	-0.22	ND<56	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	ND<0.50	
7/3/2007	355.03	--	--	--	--	--	--	--	--	--	--	--	--	Paved over	
2/1/2008	355.03	--	--	--	--	--	--	--	--	--	--	--	--	Paved over	
9/2/2008	355.03	--	--	--	--	--	--	--	--	--	--	--	--	Paved over	
3/6/2009	355.03	14.56	0.00	340.47	--	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/21/2009	355.03	16.69	0.00	338.34	-2.13	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/14/2010	355.03	16.94	0.00	338.09	-0.25	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/13/2010	357.80	15.01	0.00	342.79	4.70	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
MW-5 continued															
1/17/2011	357.80	14.35	0.00	343.45	0.66	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
U-1															
(Screen Interval in feet: 10.0-30.0)															
7/8/1995	355.62	12.59	0.00	343.03	--	9400	39000	--	1500	19	1600	5200	--	--	
10/12/1995	355.62	15.38	0.00	340.24	-2.79	4200	33000	--	1400	ND	1400	3100	--	--	
1/11/1996	355.62	16.33	0.00	339.29	-0.95	8200	8300	--	690	11	680	1500	--	--	
4/11/1996	355.62	12.20	0.00	343.42	4.13	5630	3200	--	110	ND	180	290	790	--	
7/10/1996	355.62	13.84	0.00	341.78	-1.64	2200	2600	--	81	4.4	210	230	510	--	
10/30/1996	355.62	15.85	0.00	339.77	-2.01	560	2200	--	67	19	140	150	360	--	
1/27/1997	355.62	12.20	0.00	343.42	3.65	2300	4600	--	98	ND	360	290	150	--	
4/8/1997	355.62	13.46	0.00	342.16	-1.26	1300	2800	--	50	ND	220	140	ND	--	
7/17/1997	355.62	15.30	0.00	340.32	-1.84	460	2300	--	30	4.5	140	94	190	--	
10/17/1997	355.62	16.33	0.00	339.29	-1.03	510	1500	--	31	6.7	110	88	220	--	
1/19/1998	355.62	14.34	0.00	341.28	1.99	1900	3100	--	46	3.4	310	200	170	--	
D 1/19/1998	355.62	14.34	0.00	341.28	1.99	1300	--	--	--	--	--	--	--	--	
4/23/1998	355.59	11.16	0.00	344.43	3.15	--	3400	--	72	3.8	470	350	280	--	
7/8/1998	355.59	12.67	0.00	342.92	-1.51	2000	4500	--	51	ND	590	430	190	--	
10/5/1998	355.59	14.57	0.00	341.02	-1.90	--	7500	--	53	ND	680	350	190	180	
1/4/1999	355.59	15.35	0.00	340.24	-0.78	2700	10000	--	ND	ND	1200	540	--	ND	
D 1/4/1999	355.59	15.35	0.00	340.24	-0.78	2500	--	--	--	--	--	--	--	--	
4/5/1999	355.59	13.64	0.00	341.95	1.71	920	4900	--	34	ND	350	150	150	55	
D 4/5/1999	355.59	13.64	0.00	341.95	1.71	570	--	--	--	--	--	--	--	--	
7/1/1999	355.59	14.39	0.00	341.20	-0.75	2700	10000	--	45	ND	850	420	260	110	
D 7/1/1999	355.59	14.39	0.00	341.20	-0.75	3600	--	--	--	--	--	--	--	--	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
U-1 continued															
9/30/1999	355.59	15.32	0.00	340.27	-0.93	2360	7150	--	ND	ND	415	84.4	ND	195	
D 9/30/1999	355.59	15.32	0.00	340.27	-0.93	1680	--	--	--	--	--	--	--	--	
1/3/2000	355.59	16.51	0.00	339.08	-1.19	2000	5400	--	28	8.4	180	33	160	120	
D 1/3/2000	355.59	16.51	0.00	339.08	-1.19	1700	--	--	--	--	--	--	--	--	
4/4/2000	355.59	12.89	0.00	342.70	3.62	990	4800	--	30	ND	210	93	170	160	
D 4/4/2000	355.59	12.89	0.00	342.70	3.62	1400	--	--	--	--	--	--	--	--	
7/14/2000	355.59	14.56	0.00	341.03	-1.67	2800	6200	--	41	16	170	32	170	120	
D 7/14/2000	355.59	14.56	0.00	341.03	-1.67	1200	--	--	--	--	--	--	--	--	
10/27/2000	355.59	15.96	0.00	339.63	-1.40	1400	3830	--	16.8	ND	68.6	7.99	55.2	38	
D 10/27/2000	355.59	15.96	0.00	339.63	-1.40	1300	--	--	--	--	--	--	--	--	
1/8/2001	355.59	15.72	0.00	339.87	0.24	--	2410	--	14.7	4.30	30.5	5.04	34.5	9.33	
4/3/2001	355.59	14.46	0.00	341.13	1.26	1500	3330	--	15.8	5.96	74.8	7.06	ND	13.3	
D 4/3/2001	355.59	14.46	0.00	341.13	1.26	830	--	--	--	--	--	--	--	--	
7/6/2001	355.59	15.65	0.00	339.94	-1.19	1600	4300	--	23	6.4	57	6.8	58	36	
D 7/6/2001	355.59	15.65	0.00	339.94	-1.19	1200	--	--	--	--	--	--	--	--	
10/5/2001	355.59	16.45	0.00	339.14	-0.80	2500	3800	--	19	ND<5.0	19	ND<5.0	64	36	
D 10/5/2001	355.59	16.45	0.00	339.14	-0.80	2300	--	--	--	--	--	--	--	--	
1/3/2002	355.59	14.18	0.00	341.41	2.27	2200	4500	--	25	ND<10	24	ND<10	ND<100	23	
D 1/3/2002	355.59	14.18	0.00	341.41	2.27	2200	--	--	--	--	--	--	--	--	
4/1/2002	355.59	13.72	0.00	341.87	0.46	1800	5300	--	36	6.7	48	12	93	59	
D 4/1/2002	355.59	13.72	0.00	341.87	0.46	1200	--	--	--	--	--	--	--	--	
7/1/2002	355.59	14.61	0.00	340.98	-0.89	2100	--	3900	ND<0.50	ND<0.50	ND<0.50	3.9	--	23	
D 7/1/2002	355.59	14.61	0.00	340.98	-0.89	2100	--	--	--	--	--	--	--	--	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
U-1 continued															
1/24/2003	355.59	13.82	0.00	341.77	0.79	2100	--	3400	ND<2.5	ND<2.5	37	ND<5.0	--	21	
D 1/24/2003	355.59	13.82	0.00	341.77	0.79	1700	--	--	--	--	--	--	--	--	
7/28/2003	355.59	14.51	0.00	341.08	-0.69	2100	--	7100	ND<2.5	ND<2.5	12	ND<5	13	13	
D 7/28/2003	355.59	14.51	0.00	341.08	-0.69	1200	--	--	--	--	--	--	--	--	
2/4/2004	355.59	14.66	0.00	340.93	-0.15	1300	--	4000	ND<0.50	ND<0.50	13	ND<1.0	--	9.6	
7/2/2004	355.59	16.57	0.00	339.02	-1.91	400	--	2600	0.56	ND<0.5	5.3	ND<1	--	5.4	
1/11/2005	355.59	13.91	0.00	341.68	2.66	2000	--	5000	0.59	ND<0.50	7.8	ND<1.0	--	4.2	
D 1/11/2005	355.59	13.91	0.00	341.68	2.66	1500	--	--	--	--	--	--	--	--	
7/8/2005	355.59	13.26	0.00	342.33	0.65	1300	--	3100	ND<0.50	ND<0.50	4.3	ND<1.0	--	2.2	
1/6/2006	355.59	14.64	0.00	340.95	-1.38	1200	--	2200	ND<0.50	ND<0.50	3.1	ND<1.0	--	2.8	
9/11/2006	355.59	15.11	0.00	340.48	-0.47	1200	--	2700	ND<0.50	ND<0.50	2.0	0.79	--	1.6	
2/16/2007	355.59	15.38	0.00	340.21	-0.27	2000	--	3700	ND<0.50	ND<0.50	3.1	0.81	--	2.4	
7/3/2007	355.59	15.60	0.00	339.99	-0.22	950	--	2300	ND<0.50	ND<0.50	1.6	0.74	--	0.89	
D 7/3/2007	355.59	15.60	0.00	339.99	-0.22	890	--	--	--	--	--	--	--	--	
2/1/2008	355.59	14.28	0.00	341.31	1.32	1100	--	3100	0.88	ND<0.50	1.6	ND<1.0	--	ND<0.50	
9/2/2008	355.59	16.97	0.00	338.62	-2.69	960	--	3300	ND<1.0	ND<1.0	1.4	ND<2.0	--	ND<1.0	
3/6/2009	355.59	14.95	0.00	340.64	2.02	670	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	5.7	
8/21/2009	355.59	16.90	0.00	338.69	-1.95	620	--	1600	ND<0.50	ND<0.50	0.66	ND<1.0	--	ND<0.50	
1/14/2010	355.59	17.19	0.00	338.40	-0.29	800	--	1700	ND<1.0	ND<1.0	ND<1.0	ND<2.0	--	ND<1.0	
8/13/2010	358.36	15.15	0.00	343.21	4.81	540	1000	2000	ND<0.50	ND<0.50	0.68	ND<1.0	--	ND<0.50	
1/17/2011	358.36	14.50	0.00	343.86	0.65	670	1200	2100	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
U-2															
(Screen Interval in feet: 10.0-30.0)															
7/8/1995	356.59	12.68	0.00	343.91	--	4700	17000	--	430	ND	2200	590	--	--	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
U-2 continued															
10/12/1995	356.59	16.01	0.00	340.58	-3.33	3600	24000	--	310	60	1900	190	--	--	
1/11/1996	356.59	17.06	0.00	339.53	-1.05	8600	10000	--	210	55	1400	240	--	--	
4/11/1996	356.59	12.75	0.00	343.84	4.31	1900	7700	--	130	27	1100	110	340	--	
7/10/1996	356.59	14.42	0.00	342.17	-1.67	2300	5600	--	59	15	610	42	250	--	
10/30/1996	356.59	16.82	0.00	339.77	-2.40	1800	7700	--	67	35	1000	54	260	--	
1/27/1997	356.59	12.91	0.00	343.68	3.91	660	1600	--	14	ND	130	7.0	100	--	
4/8/1997	356.59	14.07	0.00	342.52	-1.16	2000	4300	--	35	ND	400	16	ND	--	
7/17/1997	356.59	15.96	0.00	340.63	-1.89	1300	6200	--	17	22	410	ND	130	--	
10/17/1997	356.59	17.03	0.00	339.56	-1.07	1400	7100	--	71	26	520	50	ND	--	
1/19/1998	356.59	15.10	0.00	341.49	1.93	2100	5300	--	46	11	350	16	110	--	
D 1/19/1998	356.59	15.10	0.00	341.49	1.93	1500	--	--	--	--	--	--	--	--	
4/23/1998	356.55	11.74	0.00	344.81	3.32	--	3200	--	23	11	210	38	160	--	
7/8/1998	356.55	13.27	0.00	343.28	-1.53	1100	1600	--	34	8.5	100	7.4	190	--	
10/5/1998	356.55	14.90	0.00	341.65	-1.63	--	2900	--	37	8.4	110	7.3	78	--	
1/4/1999	356.55	15.94	0.00	340.61	-1.04	670	2200	--	35	ND	17	ND	86	--	
D 1/4/1999	356.55	15.94	0.00	340.61	-1.04	250	--	--	--	--	--	--	--	--	
4/5/1999	356.55	14.19	0.00	342.36	1.75	660	4900	--	21	77	130	310	100	6.9	
D 4/5/1999	356.55	14.19	0.00	342.36	1.75	490	--	--	--	--	--	--	--	--	
7/1/1999	356.55	14.98	0.00	341.57	-0.79	210	1500	--	7.6	ND	ND	ND	ND	35	
D 7/1/1999	356.55	14.98	0.00	341.57	-0.79	440	--	--	--	--	--	--	--	--	
9/30/1999	356.55	16.00	0.00	340.55	-1.02	483	256	--	1.85	ND	2.42	ND	26.3	29.8	
D 9/30/1999	356.55	16.00	0.00	340.55	-1.02	340	--	--	--	--	--	--	--	--	
1/3/2000	356.55	17.20	0.00	339.35	-1.20	2400	3400	--	23	13	ND	44	46	14	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
D U-2 continued															
D 1/3/2000	356.55	17.20	0.00	339.35	-1.20	1900	--	--	--	--	--	--	--	--	
	4/4/2000	356.55	13.50	0.00	343.05	3.70	1000	3600	--	34	17	56	ND	59	25
D 4/4/2000	356.55	13.50	0.00	343.05	3.70	1000	--	--	--	--	--	--	--	--	
	7/14/2000	356.55	15.23	0.00	341.32	-1.73	1000	3100	--	16	13	15	10	100	19
D 7/14/2000	356.55	15.23	0.00	341.32	-1.73	350	--	--	--	--	--	--	--	--	
	10/27/2000	356.55	16.74	0.00	339.81	-1.51	2000	4180	--	30.4	10.2	14.6	ND	55.5	15
D 10/27/2000	356.55	16.74	0.00	339.81	-1.51	1900	--	--	--	--	--	--	--	--	
	1/8/2001	356.55	16.68	0.00	339.87	0.06	--	3300	--	33.5	7.32	3.49	ND	66.7	7.49
D 4/3/2001	356.55	15.12	0.00	341.43	1.56	1500	4290	--	32.4	9.91	20.1	ND	66.6	18.1	
D 4/3/2001	356.55	15.12	0.00	341.43	1.56	830	--	--	--	--	--	--	--	--	
	7/6/2001	356.55	16.32	0.00	340.23	-1.20	1400	4700	--	35	11	12	5.3	62	19
D 7/6/2001	356.55	16.32	0.00	340.23	-1.20	1100	--	--	--	--	--	--	--	--	
	10/5/2001	356.55	17.15	0.00	339.40	-0.83	3200	3600	--	31	9.6	8.7	6.9	62	13
D 10/5/2001	356.55	17.15	0.00	339.40	-0.83	1900	--	--	--	--	--	--	--	--	
	1/3/2002	356.55	14.90	0.00	341.65	2.25	2300	4600	--	34	11	15	5.8	62	7.5
D 1/3/2002	356.55	14.90	0.00	341.65	2.25	2100	--	--	--	--	--	--	--	--	
	4/1/2002	356.55	14.38	0.00	342.17	0.52	1400	3500	--	38	9.3	10	6.5	87	18
D 4/1/2002	356.55	14.38	0.00	342.17	0.52	470	--	--	--	--	--	--	--	--	
	7/1/2002	356.55	15.24	0.00	341.31	-0.86	ND<50	--	4500	ND<0.50	ND<0.50	5.0	1.7	--	ND<0.50
D 1/24/2003	356.55	14.31	0.00	342.24	0.93	860	--	2300	1.1	1.5	6.9	2.4	--	5.9	
D 1/24/2003	356.55	14.31	0.00	342.24	0.93	570	--	--	--	--	--	--	--	--	
	7/28/2003	356.55	15.18	0.00	341.37	-0.87	1300	--	5600	ND<2.5	ND<2.5	3.4	ND<5	ND<10	ND<10
D 7/28/2003	356.55	15.18	0.00	341.37	-0.87	710	--	--	--	--	--	--	--	--	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	Comments								
						TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)
U-2 continued														
2/4/2004	356.55	15.36	0.00	341.19	-0.18	1300	--	4400	ND<5.0	ND<5.0	7.0	ND<10	--	ND<20
7/2/2004	356.55	16.28	0.00	340.27	-0.92	380	--	5700	1.4	2.8	6.6	5.5	--	6.6
1/11/2005	356.55	14.59	0.00	341.96	1.69	1800	--	5800	0.99	2.5	5.4	5.1	--	ND<5.0
D 1/11/2005	356.55	14.59	0.00	341.96	1.69	1100	--	--	--	--	--	--	--	--
D 7/8/2005	356.55	13.97	0.00	342.58	0.62	1100	--	3000	0.56	1.9	3.0	3.2	--	5.0
D 7/8/2005	356.55	13.97	0.00	342.58	0.62	960	--	--	--	--	--	--	--	--
1/6/2006	356.55	15.30	0.00	341.25	-1.33	1100	--	1600	ND<0.50	ND<0.50	0.97	ND<1.0	--	2.1
9/11/2006	356.55	15.62	0.00	340.93	-0.32	790	--	2300	ND<0.50	ND<0.50	1.0	1.0	--	2.7
2/16/2007	356.55	16.01	0.00	340.54	-0.39	200	--	1500	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	1.2
D 7/3/2007	356.55	16.27	0.00	340.28	-0.26	540	--	1400	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	1.5
D 7/3/2007	356.55	16.27	0.00	340.28	-0.26	530	--	--	--	--	--	--	--	--
2/1/2008	356.55	15.02	0.00	341.53	1.25	340	--	830	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	1.1
9/2/2008	356.55	17.71	0.00	338.84	-2.69	300	--	1500	ND<0.50	ND<0.50	0.73	ND<1.0	--	0.80
3/6/2009	356.55	15.60	0.00	340.95	2.11	77	--	630	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	1.0
8/21/2009	356.55	17.60	0.00	338.95	-2.00	350	--	1600	ND<0.50	0.67	0.72	1.1	--	0.66
1/14/2010	356.55	18.94	0.00	337.61	-1.34	440	--	1300	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50
8/13/2010	359.32	15.84	0.00	343.48	5.87	310	930	1500	ND<0.50	0.53	0.77	1.2	--	0.69
1/17/2011	359.32	15.27	0.00	344.05	0.57	360	560	1100	ND<0.50	ND<0.50	0.59	ND<1.0	--	0.63
U-3 (Screen Interval in feet: 10.0-30.0)														
7/8/1995	358.13	14.58	0.00	343.55	--	710	1100	--	0.57	2.1	1.7	2.4	--	--
10/12/1995	358.13	17.60	0.00	340.53	-3.02	470	560	--	ND	0.87	0.7	1.1	--	--
1/11/1996	358.13	18.65	0.00	339.48	-1.05	260	230	--	0.62	0.91	0.97	1.9	--	--
4/11/1996	358.13	13.20	0.00	344.93	5.45	ND	68	--	ND	ND	ND	ND	--	--

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
U-3 continued															
7/10/1996	358.13	15.98	0.00	342.15	-2.78	ND	ND	--	ND	ND	ND	ND	ND	--	
10/30/1996	358.13	18.24	0.00	339.89	-2.26	ND	70	--	ND	ND	ND	ND	ND	--	
1/27/1997	358.13	14.41	0.00	343.72	3.83	ND	ND	--	ND	ND	ND	ND	ND	--	
4/8/1997	358.13	15.73	0.00	342.40	-1.32	ND	ND	--	ND	ND	ND	ND	ND	--	
7/17/1997	358.13	17.54	0.00	340.59	-1.81	ND	ND	--	ND	ND	ND	ND	ND	--	
10/17/1997	358.13	18.64	0.00	339.49	-1.10	63	ND	--	ND	ND	ND	ND	ND	--	
1/19/1998	358.13	16.67	0.00	341.46	1.97	68	ND	--	ND	ND	ND	ND	ND	--	
D 1/19/1998	358.13	16.67	0.00	341.46	1.97	ND	--	--	--	--	--	--	--	--	
4/23/1998	358.09	13.28	0.00	344.81	3.35	--	ND	--	ND	ND	ND	ND	ND	--	
7/8/1998	358.09	14.90	0.00	343.19	-1.62	80	ND	--	ND	ND	ND	ND	ND	--	
10/5/1998	358.09	16.50	0.00	341.59	-1.60	--	ND	--	ND	ND	ND	ND	ND	--	
1/4/1999	358.09	17.70	0.00	340.39	-1.20	ND	ND	--	ND	ND	ND	ND	ND	--	
4/5/1999	358.09	15.67	0.00	342.42	2.03	ND	ND	--	ND	ND	ND	ND	ND	ND	
7/1/1999	358.09	16.79	0.00	341.30	-1.12	ND	ND	--	ND	ND	ND	ND	ND	ND	
9/30/1999	358.09	17.60	0.00	340.49	-0.81	ND	ND	--	ND	ND	ND	ND	ND	ND	
1/3/2000	358.09	18.86	0.00	339.23	-1.26	ND	ND	--	ND	ND	ND	ND	ND	ND	
4/4/2000	358.09	15.10	0.00	342.99	3.76	ND	ND	--	ND	ND	ND	ND	ND	ND	
7/14/2000	358.09	16.85	0.00	341.24	-1.75	ND	ND	--	ND	ND	ND	ND	ND	ND	
10/27/2000	358.09	18.35	0.00	339.74	-1.50	ND	ND	--	ND	ND	ND	ND	ND	ND	
1/8/2001	358.09	18.31	0.00	339.78	0.04	--	ND	--	ND	ND	ND	ND	ND	ND	
4/3/2001	358.09	16.70	0.00	341.39	1.61	ND	ND	--	ND	ND	ND	ND	ND	ND	
7/6/2001	358.09	17.90	0.00	340.19	-1.20	ND	ND	--	ND	ND	ND	ND	ND	ND	
10/5/2001	358.09	18.71	0.00	339.38	-0.81	ND<50	ND<50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<5.0	ND<2.0	

Table 2
HISTORIC FLUID LEVELS AND SELECTED ANALYTICAL RESULTS
July 1995 Through January 2011
76 Station 7176

Date Sampled	TOC Elevation	Depth to Water (feet)	LPH Thickness (feet)	Ground-water Elevation (feet)	Change in Elevation (feet)	TPH-D (µg/l)	TPH-G 8015 (µg/l)	TPH-G (GC/MS) (µg/l)	Benzene (µg/l)	Toluene (µg/l)	Ethyl-benzene (µg/l)	Total Xylenes (µg/l)	MTBE (8021B) (µg/l)	MTBE (8260B) (µg/l)	Comments
U-3 continued															
1/3/2002	358.09	16.41	0.00	341.68	2.30	ND<52	ND<50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<5.0	ND<1.0	
4/1/2002	358.09	15.87	0.00	342.22	0.54	ND<50	ND<50	--	ND<0.50	1.1	ND<0.50	1.2	ND<5.0	ND<2.0	
7/1/2002	358.09	16.77	0.00	341.32	-0.90	1500	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/24/2003	358.09	15.75	0.00	342.34	1.02	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<5.0	ND<2.019	
7/28/2003	358.09	16.74	0.00	341.35	-0.99	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1	ND<2	ND<2	
2/4/2004	358.09	16.87	0.00	341.22	-0.13	90	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<2.0	
7/2/2004	358.09	17.87	0.00	340.22	-1.00	ND<200	--	ND<50	ND<0.5	ND<0.5	ND<0.5	ND<1	--	ND<0.5	
1/11/2005	358.09	16.10	0.00	341.99	1.77	ND<50	--	52	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
7/8/2005	358.09	15.57	0.00	342.52	0.53	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/6/2006	358.09	16.94	0.00	341.15	-1.37	ND<200	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
9/11/2006	358.09	17.49	0.00	340.60	-0.55	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	ND<0.50	
2/16/2007	358.09	17.71	0.00	340.38	-0.22	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	ND<0.50	
7/3/2007	358.09	17.91	0.00	340.18	-0.20	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	ND<0.50	
2/1/2008	358.09	16.52	0.00	341.57	1.39	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
9/2/2008	358.09	19.32	0.00	338.77	-2.80	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
3/6/2009	358.09	17.24	0.00	340.85	2.08	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/21/2009	358.09	19.13	0.00	338.96	-1.89	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/14/2010	358.09	19.54	0.00	338.55	-0.41	ND<50	--	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
8/13/2010	360.87	17.38	0.00	343.49	4.94	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	
1/17/2011	360.87	16.70	0.00	344.17	0.68	ND<50	ND<50	ND<50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	--	ND<0.50	

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA (µg/l)	Ethanol (8260B) (µg/l)	Ethylene-dibromide (EDB) (µg/l)	EDB (504) (µg/l)	1,2-DCA (EDC) (µg/l)	DIPE (µg/l)	ETBE (µg/l)	TAME (µg/l)	Bromo-benzene (µg/l)	Bromo-chloro-methane (µg/l)	Bromo-dichloro-methane (µg/l)	Bromo-form (µg/l)
MW-4												
4/5/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/1/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
9/30/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/3/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/4/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/14/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/27/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/8/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/3/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/6/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/5/2001	ND<100	ND<1000	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
1/3/2002	ND<20	ND<500	ND<1.0	--	ND<1.0	ND<1.0	ND<1.0	ND<1.0	--	--	--	--
4/1/2002	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/1/2002	ND<5.0	ND<25	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
1/24/2003	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/28/2003	ND<100	ND<500	ND<2	--	ND<2	ND<2	ND<2	ND<2	--	--	--	--
2/4/2004	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/2/2004	ND<12	ND<800	ND<0.5	--	ND<0.5	ND<1	ND<1	ND<1	--	--	--	--
1/11/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
7/8/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/6/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/11/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/16/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
7/3/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/1/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA ($\mu\text{g/l}$)	Ethanol (8260B) ($\mu\text{g/l}$)	Ethylene-dibromide (EDB) ($\mu\text{g/l}$)	EDB (504) ($\mu\text{g/l}$)	1,2-DCA (EDC) ($\mu\text{g/l}$)	DIPE ($\mu\text{g/l}$)	ETBE ($\mu\text{g/l}$)	TAME ($\mu\text{g/l}$)	Bromo-benzene ($\mu\text{g/l}$)	Bromo-chloro-methane ($\mu\text{g/l}$)	Bromo-dichloro-methane ($\mu\text{g/l}$)	Bromo-form ($\mu\text{g/l}$)
MW-4 continued												
9/2/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
3/6/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/21/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/14/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/13/2010	ND<10	ND<250	ND<0.50	ND<0.010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
MW-5												
4/5/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/1/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
9/30/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/3/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/4/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/14/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/27/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/8/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/3/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/6/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/5/2001	ND<100	ND<1000	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
1/3/2002	ND<20	ND<500	ND<1.0	--	ND<1.0	ND<1.0	ND<1.0	ND<1.0	--	--	--	--
4/1/2002	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/1/2002	ND<5.0	ND<25	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
1/24/2003	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/28/2003	ND<100	ND<500	ND<2	--	ND<2	ND<2	ND<2	ND<2	--	--	--	--
2/4/2004	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/2/2004	ND<12	ND<800	ND<0.5	--	ND<0.5	ND<1	ND<1	ND<1	--	--	--	--

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA (µg/l)	Ethanol (8260B) (µg/l)	Ethylene-dibromide (EDB) (µg/l)	EDB (504) (µg/l)	1,2-DCA (EDC) (µg/l)	DIPE (µg/l)	ETBE (µg/l)	TAME (µg/l)	Bromo-benzene (µg/l)	Bromo-chloro-methane (µg/l)	Bromo-dichloro-methane (µg/l)	Bromo-form (µg/l)
MW-5 continued												
1/11/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
7/8/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/6/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/11/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/16/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
3/6/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/21/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/14/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/13/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-1												
4/5/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/1/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
9/30/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/3/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/4/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/14/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/27/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/8/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/3/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/6/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/5/2001	ND<100	ND<1000	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
1/3/2002	ND<100	ND<2500	ND<5.0	--	ND<5.0	ND<5.0	ND<5.0	ND<5.0	--	--	--	--
4/1/2002	ND<500	ND<2500	ND<10	--	ND<10	ND<10	ND<10	ND<10	--	--	--	--
7/1/2002	ND<5.0	ND<25	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA (µg/l)	Ethanol (8260B) (µg/l)	Ethylene-dibromide (EDB) (µg/l)	EDB (504) (µg/l)	1,2-DCA (EDC) (µg/l)	DIPE (µg/l)	ETBE (µg/l)	TAME (µg/l)	Bromo-benzene (µg/l)	Bromo-chloro-methane (µg/l)	Bromo-dichloro-methane (µg/l)	Bromo-form (µg/l)
U-1 continued												
1/24/2003	ND<500	ND<2500	ND<10	--	ND<10	ND<10	ND<10	ND<10	--	--	--	--
7/28/2003	ND<500	ND<2500	ND<10	--	ND<10	ND<10	ND<10	ND<10	--	--	--	--
2/4/2004	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/2/2004	ND<12	ND<800	ND<0.5	--	ND<0.5	ND<1	ND<1	ND<1	--	--	--	--
1/11/2005	5.2	ND<50	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
7/8/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/6/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/11/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/16/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
7/3/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/1/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/2/2008	ND<20	ND<500	ND<1.0	--	ND<1.0	ND<1.0	ND<1.0	ND<1.0	--	--	--	--
3/6/2009	16	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/21/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/14/2010	ND<20	ND<500	ND<1.0	--	ND<1.0	ND<1.0	ND<1.0	ND<1.0	--	--	--	--
8/13/2010	ND<10	ND<250	ND<0.50	ND<0.010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-2												
4/5/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/1/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
9/30/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/3/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/4/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/14/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/27/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA ($\mu\text{g/l}$)	Ethanol (8260B) ($\mu\text{g/l}$)	Ethylene-dibromide (EDB) ($\mu\text{g/l}$)	EDB (504) ($\mu\text{g/l}$)	1,2-DCA (EDC) ($\mu\text{g/l}$)	DIPE ($\mu\text{g/l}$)	ETBE ($\mu\text{g/l}$)	TAME ($\mu\text{g/l}$)	Bromo-benzene ($\mu\text{g/l}$)	Bromo-chloro-methane ($\mu\text{g/l}$)	Bromo-dichloro-methane ($\mu\text{g/l}$)	Bromo-form ($\mu\text{g/l}$)
U-2 continued												
1/8/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/3/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/6/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/5/2001	ND<100	ND<1000	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
1/3/2002	ND<100	ND<2500	ND<5.0	--	ND<5.0	ND<5.0	ND<5.0	ND<5.0	--	--	--	--
4/1/2002	ND<200	ND<1000	ND<4.0	--	ND<4.0	ND<4.0	ND<4.0	ND<4.0	--	--	--	--
7/1/2002	ND<5.0	ND<25	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
1/24/2003	ND<200	ND<1000	ND<4.0	--	ND<4.0	ND<4.0	ND<4.0	ND<4.0	--	--	--	--
7/28/2003	ND<500	ND<2500	ND<10	--	ND<10	ND<10	ND<10	ND<10	--	--	--	--
2/4/2004	ND<1000	ND<5000	ND<20	--	ND<20	ND<20	ND<20	ND<20	--	--	--	--
7/2/2004	ND<12	ND<800	ND<0.5	--	ND<0.5	ND<1	ND<1	ND<1	--	--	--	--
1/11/2005	ND<50	ND<500	ND<5.0	--	ND<5.0	ND<10	ND<5.0	ND<5.0	--	--	--	--
7/8/2005	ND<50	ND<500	ND<5.0	--	ND<5.0	ND<5.0	ND<5.0	ND<5.0	--	--	--	--
1/6/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/11/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/16/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
7/3/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/1/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/2/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
3/6/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/21/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/14/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/13/2010	ND<10	ND<250	ND<0.50	ND<0.010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50

U-3

7176

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA ($\mu\text{g/l}$)	Ethanol (8260B) ($\mu\text{g/l}$)	Ethylene-dibromide (EDB) ($\mu\text{g/l}$)	EDB (504) ($\mu\text{g/l}$)	1,2-DCA (EDC) ($\mu\text{g/l}$)	DIPE ($\mu\text{g/l}$)	ETBE ($\mu\text{g/l}$)	TAME ($\mu\text{g/l}$)	Bromo-benzene ($\mu\text{g/l}$)	Bromo-chloro-methane ($\mu\text{g/l}$)	Bromo-dichloro-methane ($\mu\text{g/l}$)	Bromo-form ($\mu\text{g/l}$)
U-3 continued												
4/5/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/1/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
9/30/1999	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/3/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/4/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/14/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/27/2000	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
1/8/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
4/3/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
7/6/2001	ND	ND	ND	--	ND	ND	ND	ND	--	--	--	--
10/5/2001	ND<100	ND<1000	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
1/3/2002	ND<20	ND<500	ND<1.0	--	ND<1.0	ND<1.0	ND<1.0	ND<1.0	--	--	--	--
4/1/2002	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/1/2002	ND<5.0	ND<25	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
1/24/2003	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/28/2003	ND<100	ND<500	ND<2	--	ND<2	ND<2	ND<2	ND<2	--	--	--	--
2/4/2004	ND<100	ND<500	ND<2.0	--	ND<2.0	ND<2.0	ND<2.0	ND<2.0	--	--	--	--
7/2/2004	ND<12	ND<800	ND<0.5	--	ND<0.5	ND<1	ND<1	ND<1	--	--	--	--
1/11/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<1.0	ND<0.50	ND<0.50	--	--	--	--
7/8/2005	ND<5.0	ND<50	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/6/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
9/11/2006	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/16/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
7/3/2007	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
2/1/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--

Table 2 a
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	TBA ($\mu\text{g/l}$)	Ethanol (8260B) ($\mu\text{g/l}$)	Ethylene-dibromide (EDB) ($\mu\text{g/l}$)	EDB (504) ($\mu\text{g/l}$)	1,2-DCA (EDC) ($\mu\text{g/l}$)	DIPE ($\mu\text{g/l}$)	ETBE ($\mu\text{g/l}$)	TAME ($\mu\text{g/l}$)	Bromo-benzene ($\mu\text{g/l}$)	Bromo-chloro-methane ($\mu\text{g/l}$)	Bromo-dichloro-methane ($\mu\text{g/l}$)	Bromo-form ($\mu\text{g/l}$)
U-3 continued												
9/2/2008	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
3/6/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/21/2009	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
1/14/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	--	--	--	--
8/13/2010	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<10	ND<250	ND<0.50	--	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50

Table 2 b
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	Carbon								2-Chloro-toluene (µg/l)	4-Chloro-toluene (µg/l)	1,2Dibrom-3-chloro-propane (µg/l)
	Bromo-methane (µg/l)	n-Butyl-benzene (µg/l)	sec-Butyl-benzene (µg/l)	tert-Butyl benzene (µg/l)	Tetra-chloride (µg/l)	Chloro-benzene (µg/l)	Chloro-ethane (µg/l)	Chloroform (µg/l)			
MW-4											
8/13/2010	ND<1.0	1.2	0.54	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
1/17/2011	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
MW-5											
8/13/2010	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
1/17/2011	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-1											
8/13/2010	ND<1.0	36	21	2.4	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
1/17/2011	ND<1.0	39	ND<0.50	2.6	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-2											
8/13/2010	ND<1.0	8.1	11	5.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
1/17/2011	ND<1.0	4.4	ND<0.50	4.7	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
U-3											
8/13/2010	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0
1/17/2011	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0

Table 2 c
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	Dibromo-chloro-methane (µg/l)	Dibromo-methane (µg/l)	1,2-Dichloro-benzene (µg/l)	1,3-Dichloro-benzene (µg/l)	1,4-Dichloro-benzene (µg/l)	Dichloro-difluoro-methane (µg/l)	1,1-DCA (µg/l)	1,1-DCE (µg/l)	cis-1,2-DCE (µg/l)	trans-1,2-DCE (µg/l)	1,2-Dichloro-propane (µg/l)	1,3-Dichloro-propane (µg/l)
MW-4												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
MW-5												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-1												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-2												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-3												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50

Table 2 d
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	2,2-Dichloropropane (µg/l)	1,1-Dichloropropene (µg/l)	cis-1,3-Dichloropropene (µg/l)	trans-1,3-Dichloropropene (µg/l)	Hexachlorobutadiene (µg/l)	Isopropylbenzene (µg/l)	p-Isopropyltoluene (µg/l)	Methylene chloride (µg/l)	Naphthalene (µg/l)	n-Propylbenzene (µg/l)	Styrene (µg/l)	1,1,1,2-Tetrachloroethane (µg/l)
MW-4												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50
MW-5												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50
U-1												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	19	0.80	ND<1.0	ND<0.50	76	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	17	ND<0.50	ND<1.0	ND<0.50	67	ND<0.50	ND<0.50
U-2												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	21	ND<0.50	ND<1.0	ND<0.50	43	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	15	ND<0.50	ND<1.0	ND<0.50	25	ND<0.50	ND<0.50
U-3												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50	ND<0.50	ND<0.50


Table 2 e
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	1,1,2,2-Tetrachloroethane (µg/l)	Tetrachloroethene (PCE) (µg/l)	Trichloro-trifluoroethane (µg/l)	1,2,4-Trichlorobenzene (µg/l)	1,2,3-Trichlorobenzene (µg/l)	1,1,1-Trichloroethane (µg/l)	1,1,2-Trichloroethane (µg/l)	Trichloroethene (TCE) (µg/l)	Trichlorofluoromethane (µg/l)	1,2,3-Trichloropropane (µg/l)	1,2,4-Trimethylbenzene (µg/l)	1,3,5-Trimethylbenzene (µg/l)
MW-4												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
MW-5												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
U-1												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	31	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
U-2												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
U-3												
8/13/2010	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50
1/17/2011	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<0.50	ND<1.0	ND<0.50	ND<0.50

Table 2 f
ADDITIONAL HISTORIC ANALYTICAL RESULTS
76 Station 7176

Date Sampled	Vinyl chloride ($\mu\text{g/l}$)
MW-4	
8/13/2010	ND<0.50
1/17/2011	ND<0.50
MW-5	
8/13/2010	ND<0.50
1/17/2011	ND<0.50
U-1	
8/13/2010	ND<0.50
1/17/2011	ND<0.50
U-2	
8/13/2010	ND<0.50
1/17/2011	ND<0.50
U-3	
8/13/2010	ND<0.50
1/17/2011	ND<0.50

FIGURES

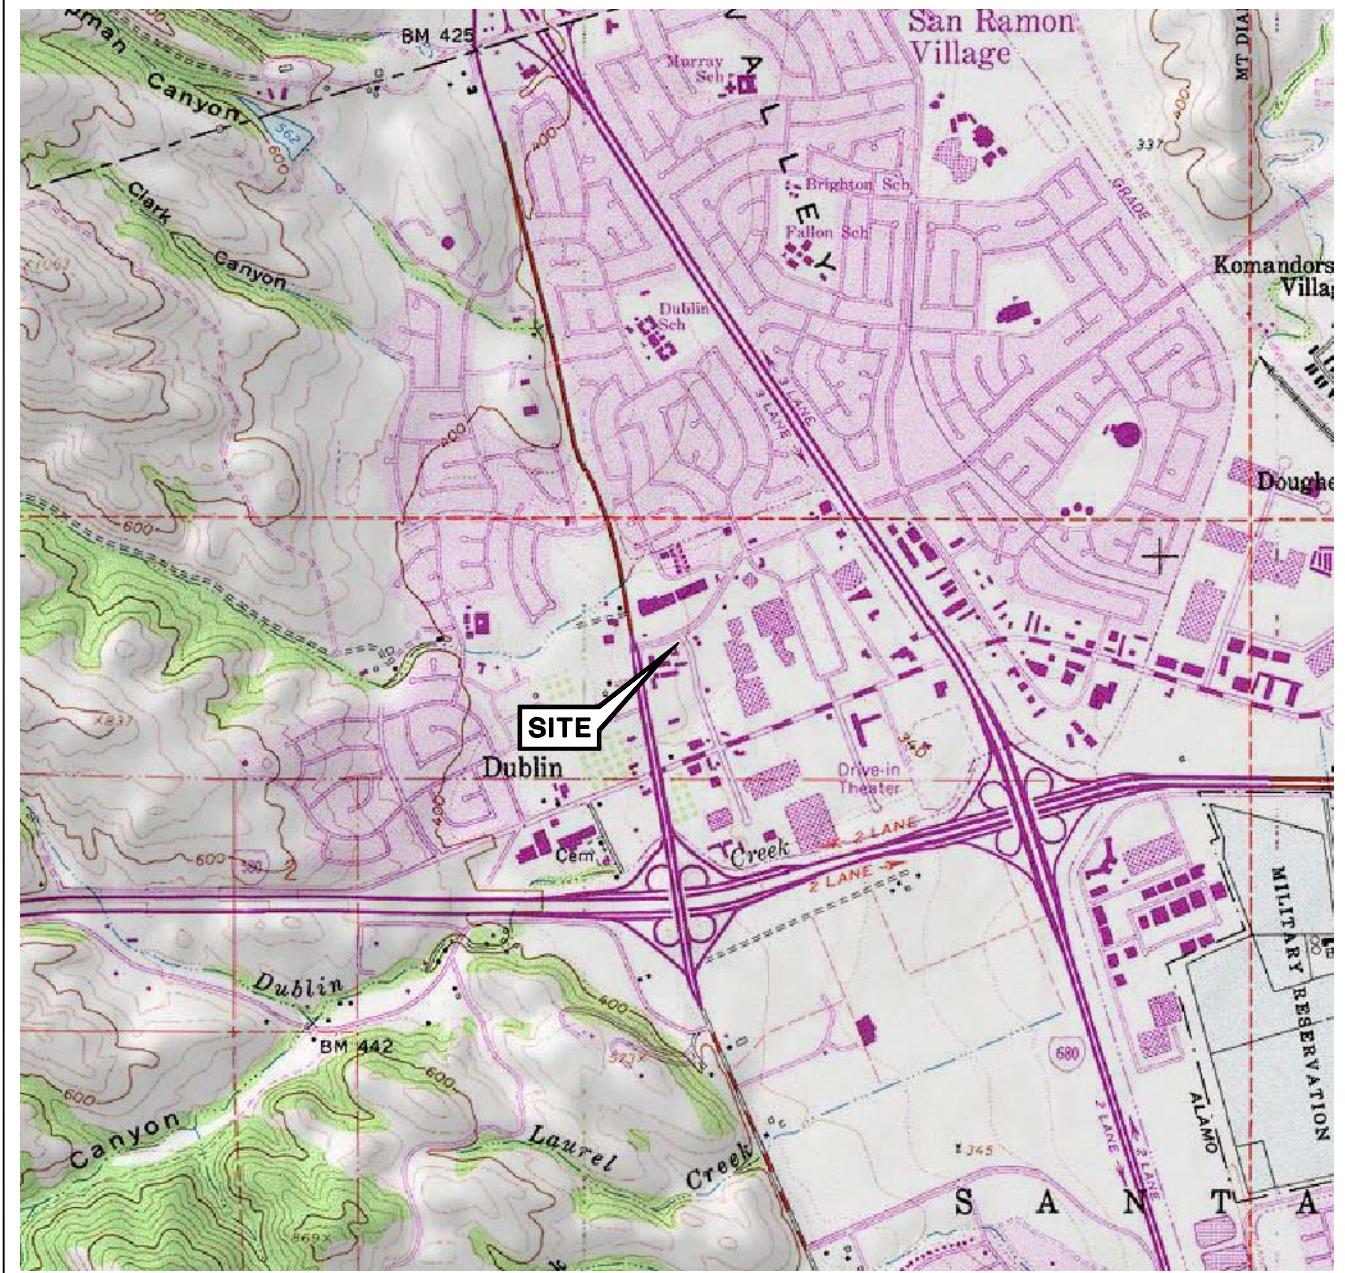

0 1/4 1/2 3/4 1 MILE

SCALE 1:24,000



SOURCE:

United States Geological Survey
7.5 Minute Topographic Map:
Dublin Quadrangle



76 STATION 7176
7850 AMADOR VALLEY BOULEVARD
DUBLIN, CALIFORNIA

VICINITY MAP

FIGURE 1

LEGEND

MW-5 Monitoring Well with
Groundwater Elevation (feet)


CC-2 Conductor Casing

344.00 — Groundwater Elevation Contour

→ General Direction of
Groundwater Flow



AMADOR VALLEY BOULEVARD

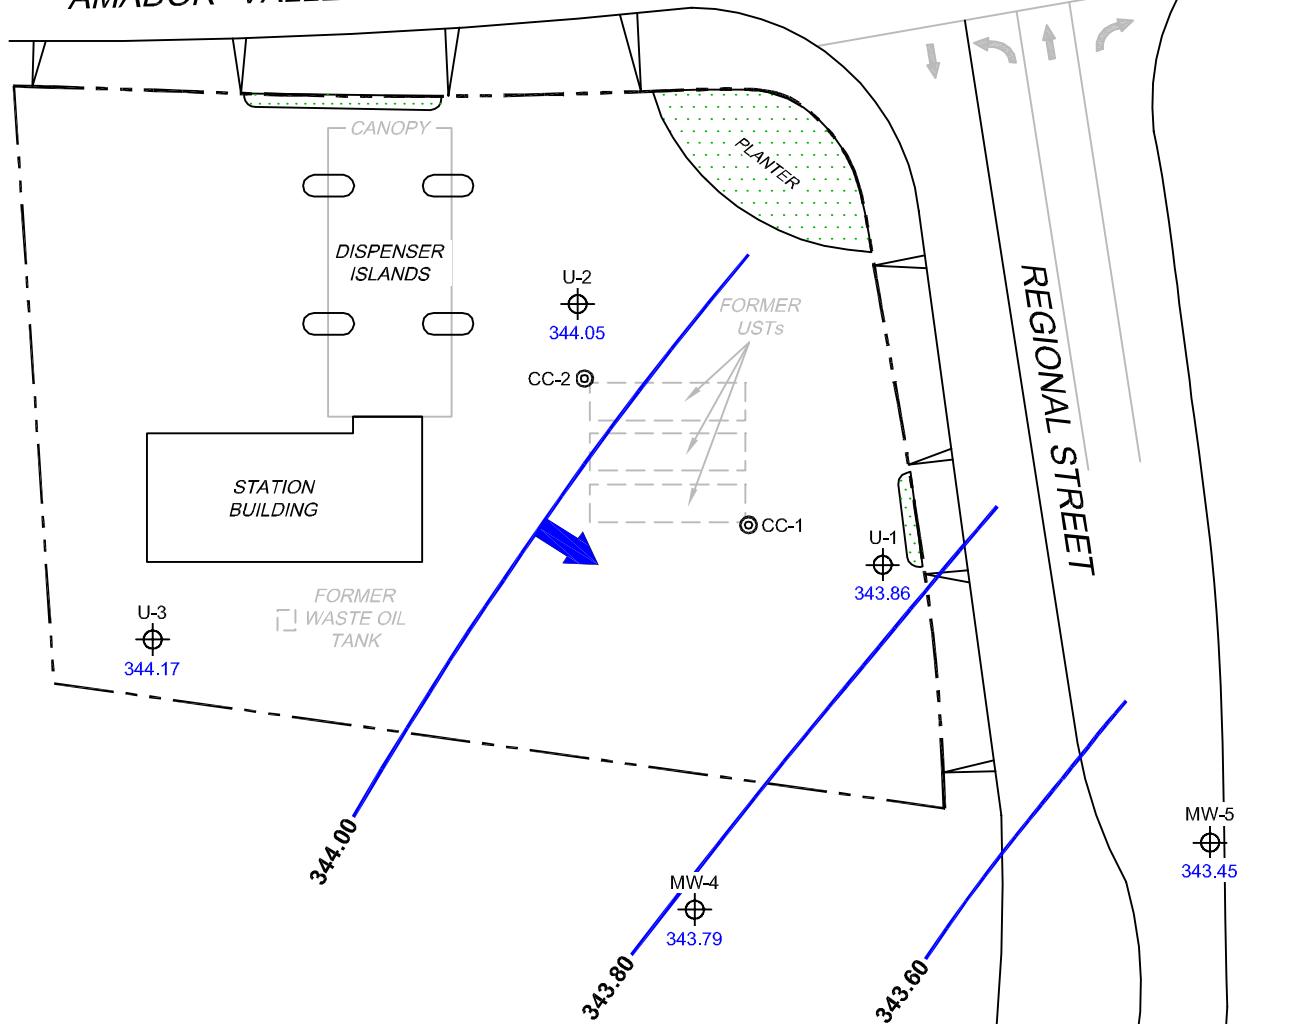

NOTES:

Contour lines are interpretive and based on fluid levels measured in monitoring wells.
Elevations are in feet above mean sea level. UST = underground storage tank.

SCALE (FEET)



LEGEND


MW-5 Monitoring Well with Dissolved-Phase TPH-G (GC/MS) Concentration ($\mu\text{g/l}$)

CC-2 Conductor Casing

1,000 Dissolved-Phase TPH-G Contour ($\mu\text{g/l}$)



AMADOR VALLEY BOULEVARD

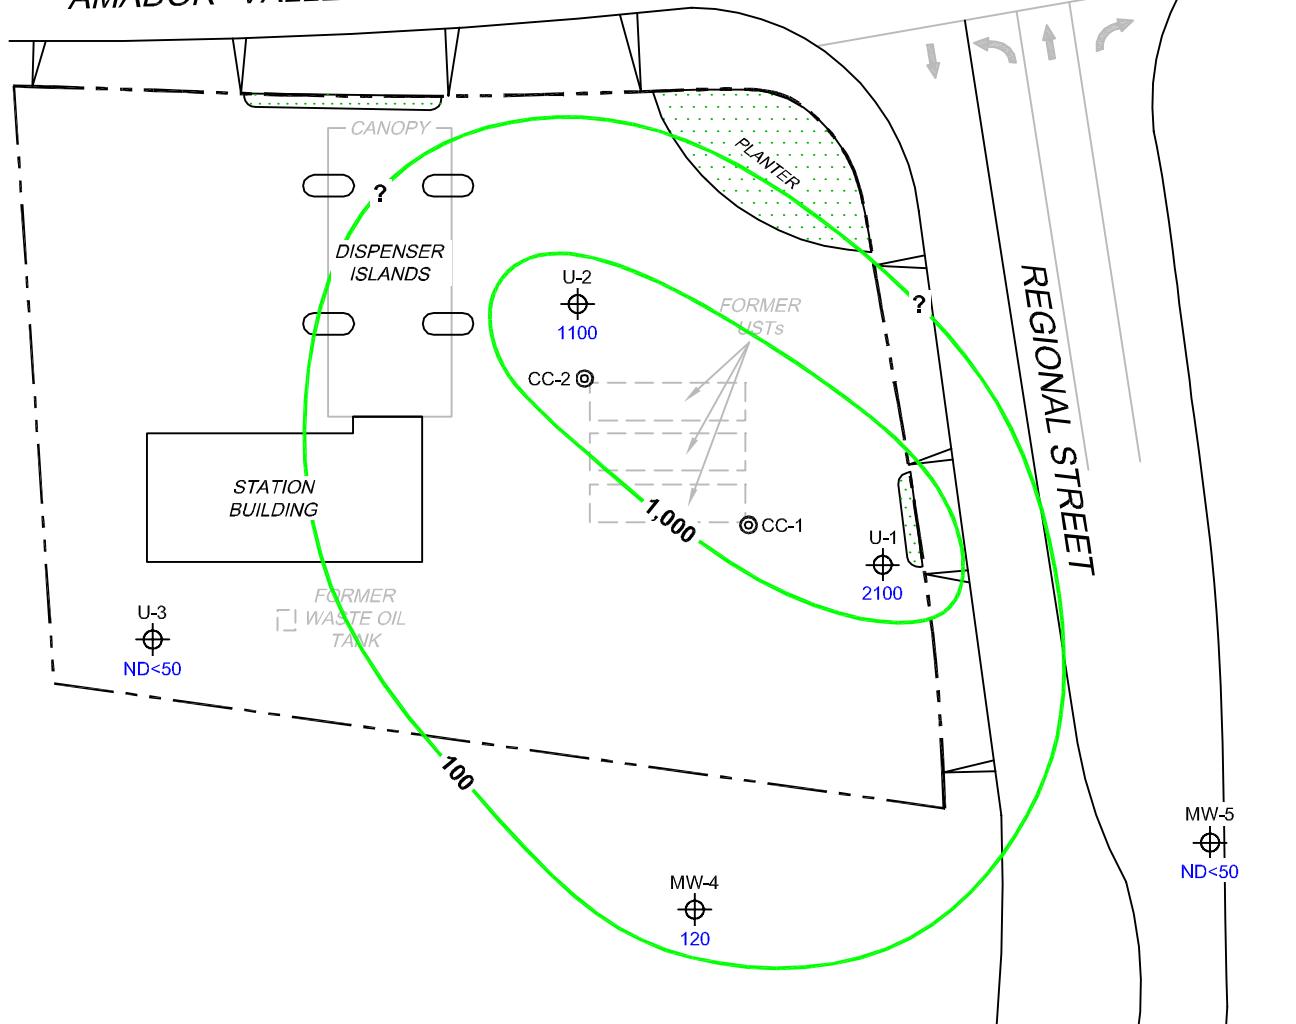

NOTES:

Contour lines are interpretive and based on laboratory analysis results of groundwater samples.
TPH-G (GC/MS) = total petroleum hydrocarbons with gasoline distinction utilizing EPA Method 8260B. $\mu\text{g/l}$ = micrograms per liter. ND = not detected at limit indicated on official laboratory report. UST = underground storage tank.

SCALE (FEET)




DISSOLVED-PHASE TPH-G CONCENTRATION MAP
January 17, 2011

FIGURE 3

LEGEND

MW-5 Monitoring Well with Dissolved-Phase Benzene Concentration ($\mu\text{g/l}$)

CC-2 Conductor Casing

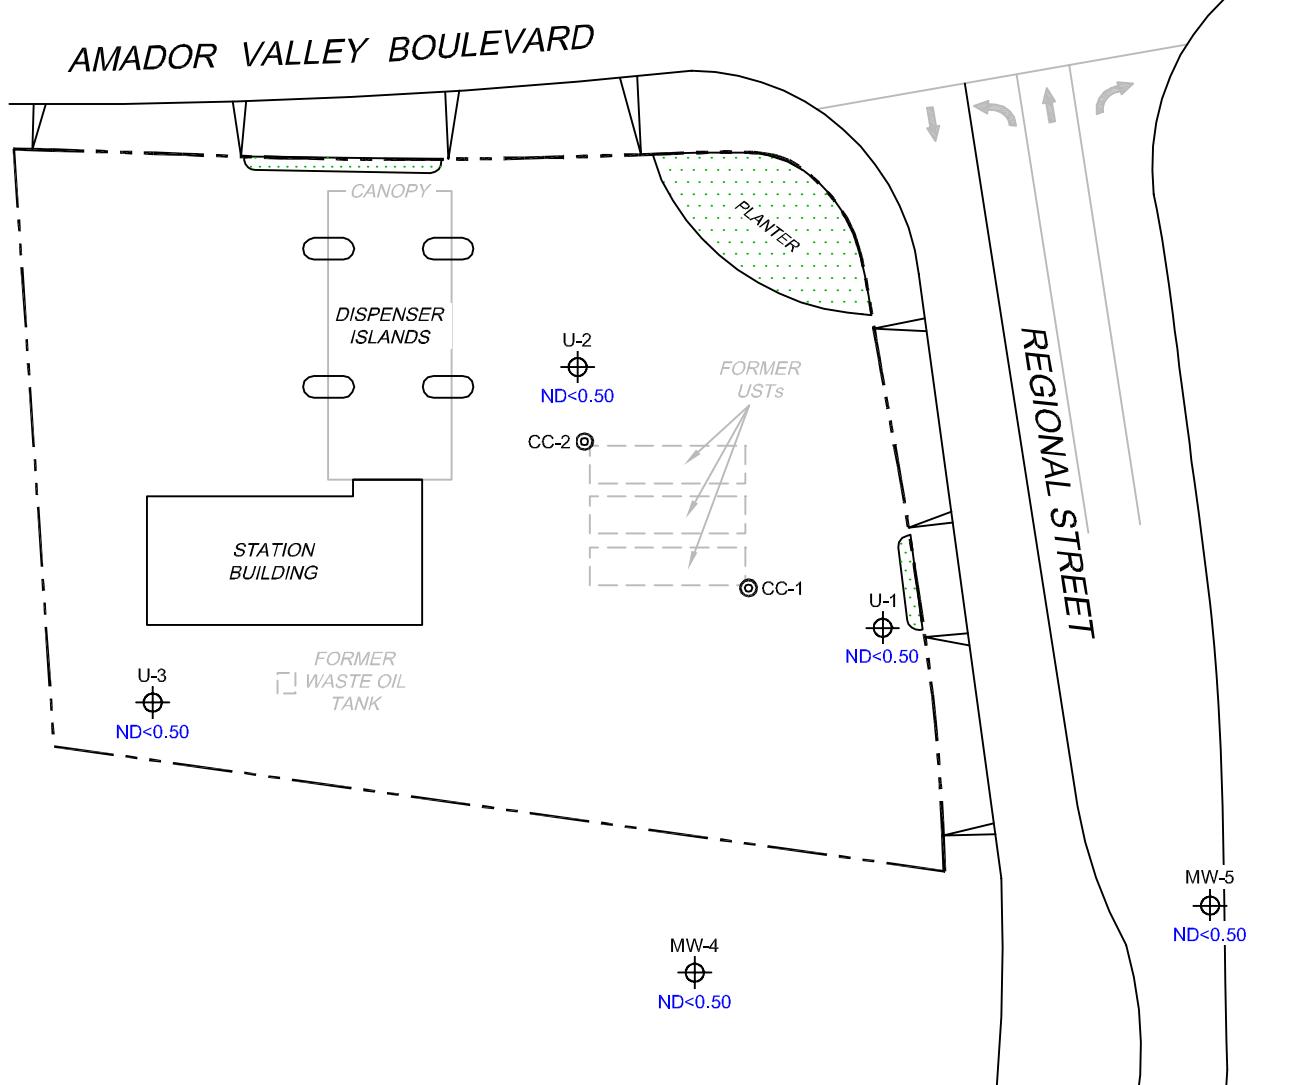

NOTES:


$\mu\text{g/l}$ = micrograms per liter. ND = not detected at limit indicated on official laboratory report.
UST = underground storage tank.



LEGEND

MW-5 Monitoring Well with
Dissolved-Phase MTBE
Concentration ($\mu\text{g/l}$)

CC-2 Conductor Casing

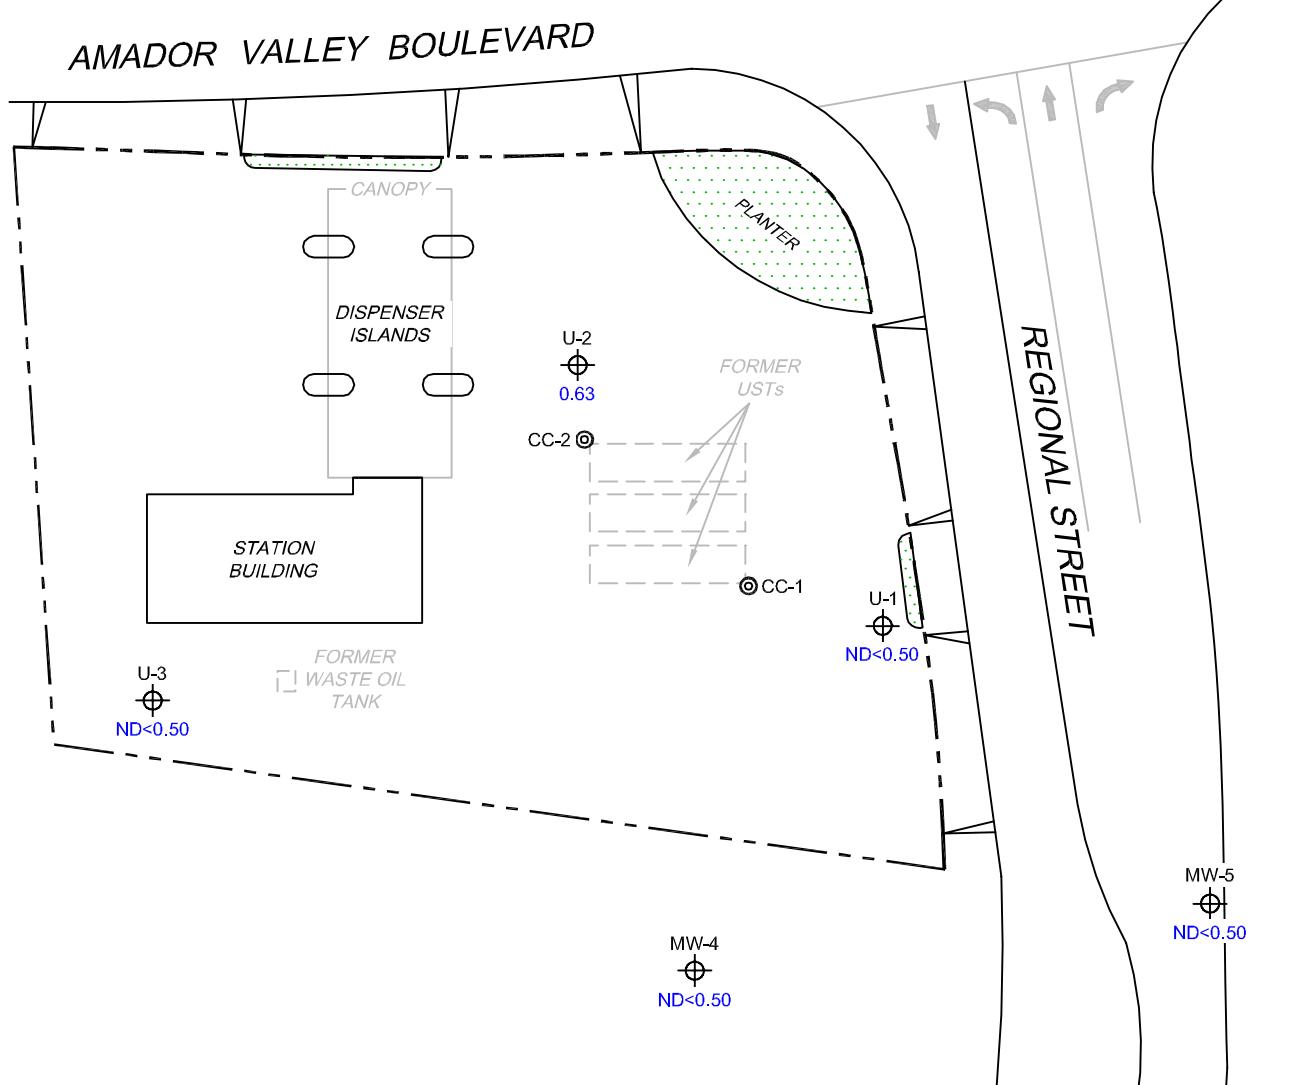

NOTES:

MTBE = methyl tertiary butyl ether. $\mu\text{g/l}$ = micrograms per liter. ND = not detected at limit indicated on official laboratory report. UST = underground storage tank. Results obtained using EPA Method 8260B.

SCALE (FEET)



LEGEND


MW-5 Monitoring Well with
Dissolved-Phase TPH-D
Concentration ($\mu\text{g/l}$)

CC-2 Conductor Casing

100 Dissolved-Phase TPH-D
Contour ($\mu\text{g/l}$)



AMADOR VALLEY BOULEVARD

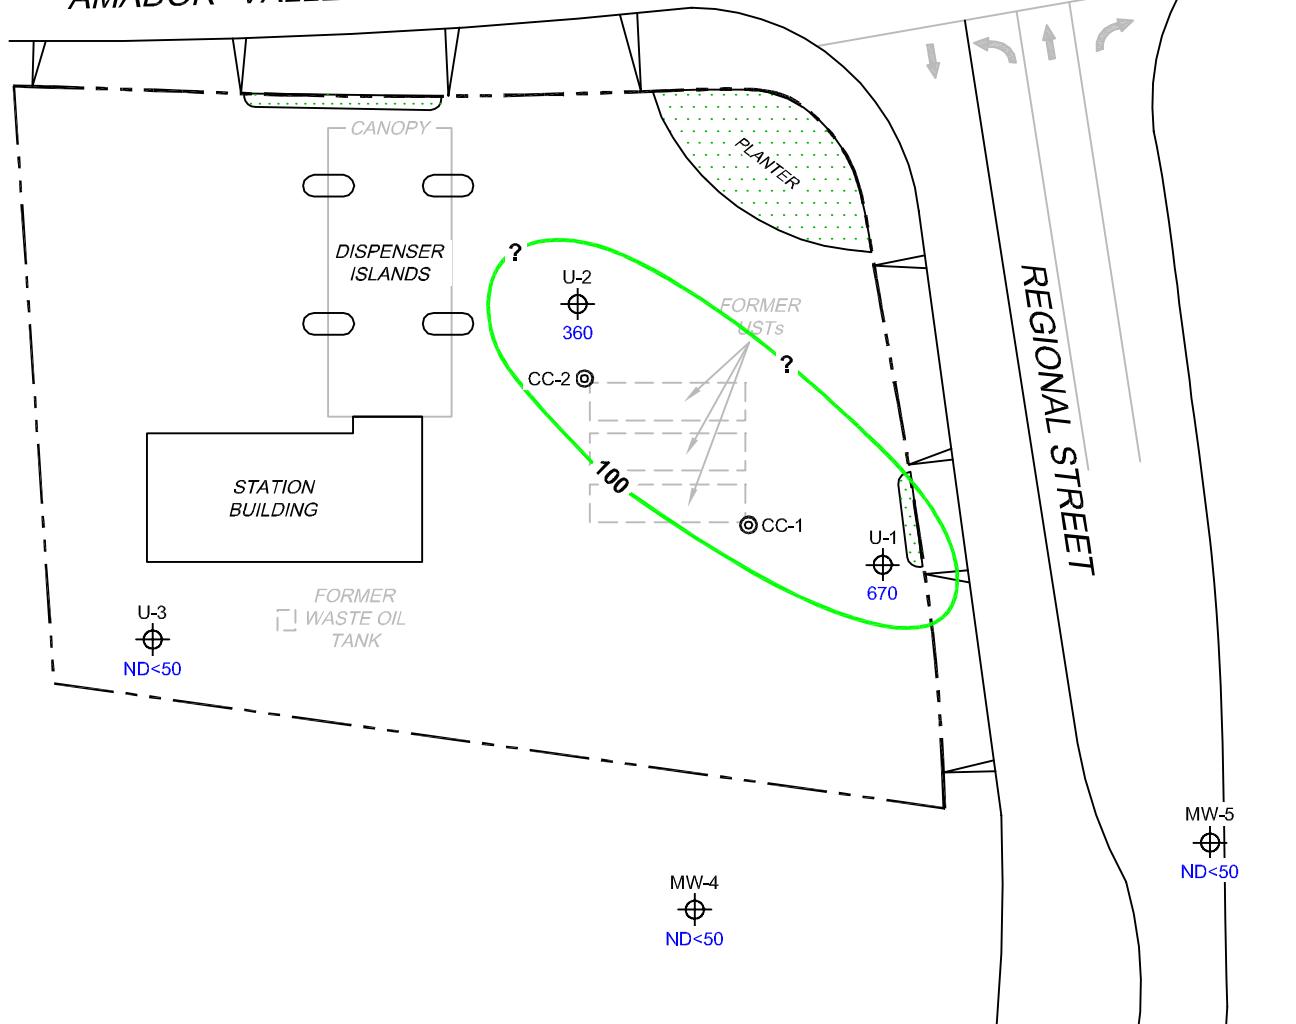

NOTES:


Contour lines are interpretive and based on laboratory analysis results of groundwater samples.
TPH-D = total petroleum hydrocarbons as diesel. $\mu\text{g/l}$ = micrograms per liter. ND = not detected at limit indicated on official laboratory report. UST = underground storage tank. Results obtained using EPA Method 8015M.

SCALE (FEET)




GRAPHS

Groundwater Elevations vs. Time
76 Station 7176

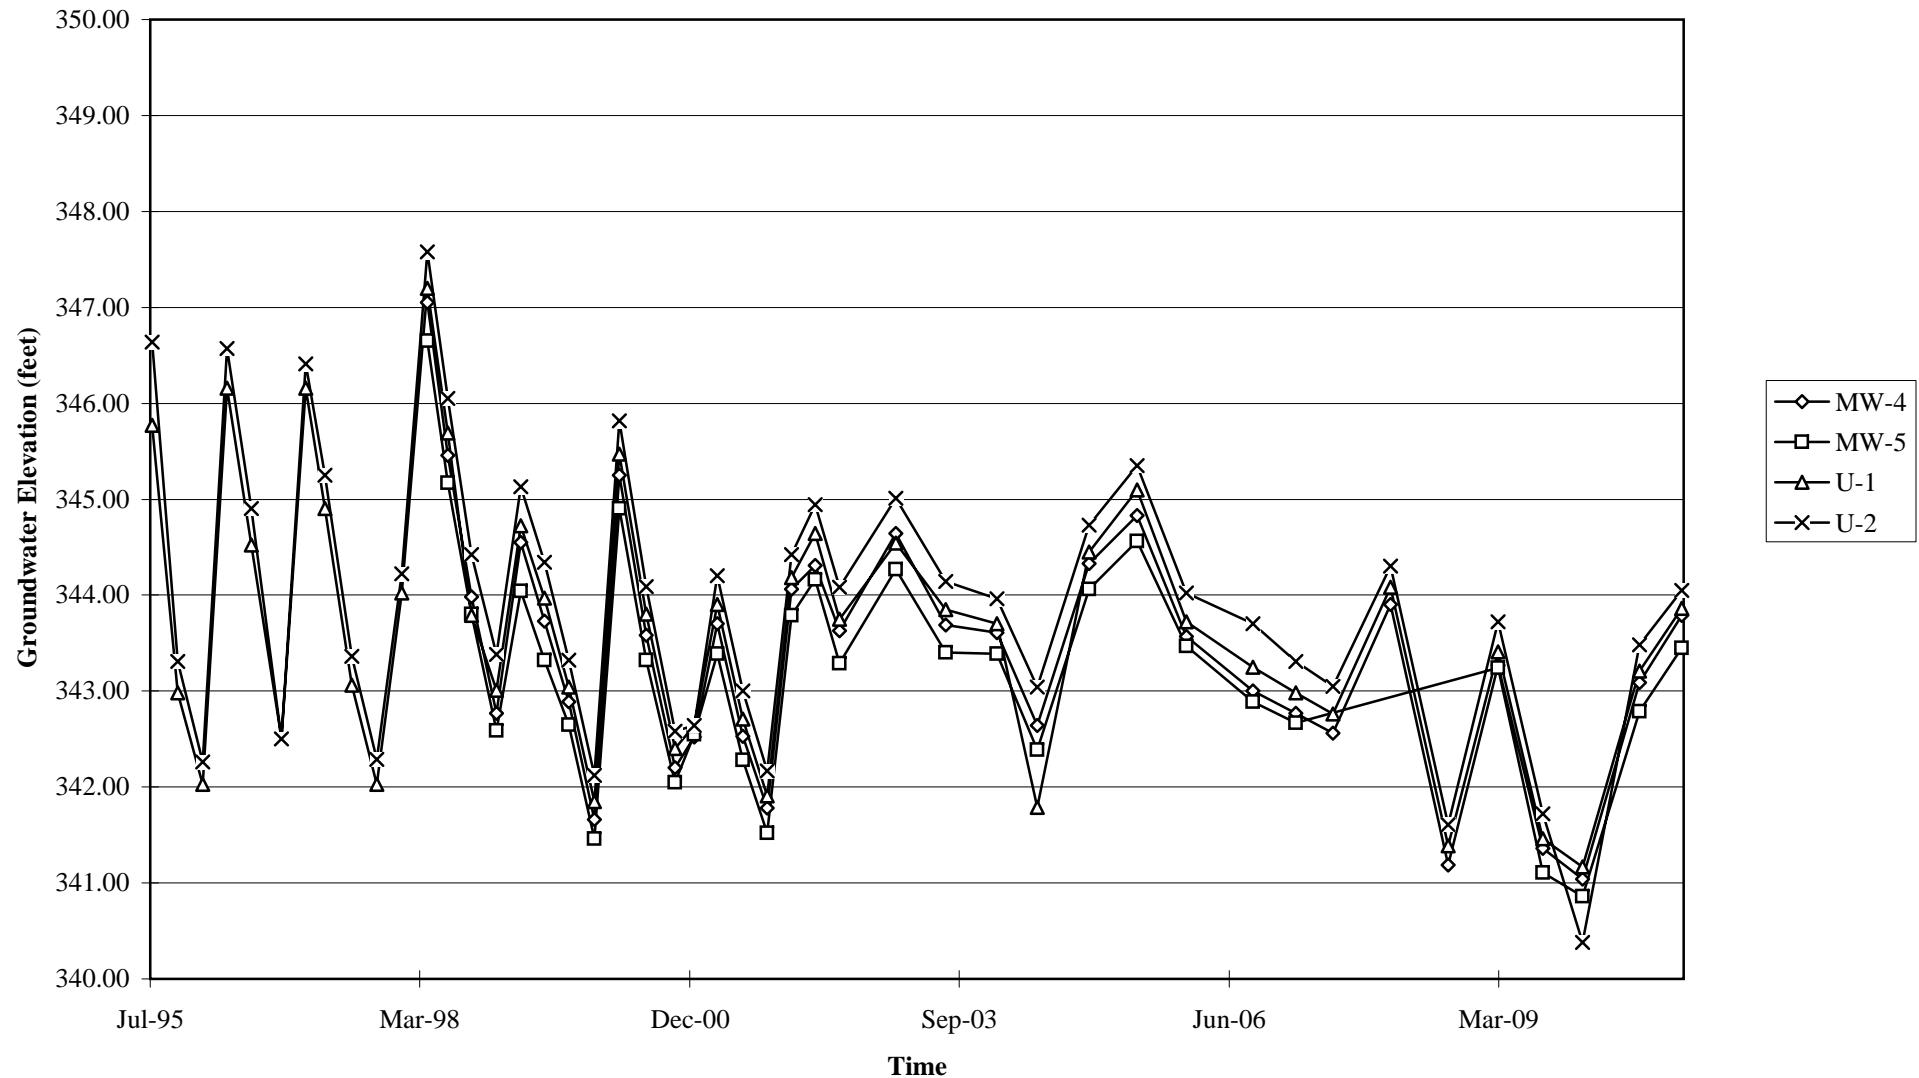


Elevations may have been corrected for apparent changes due to resurvey


Groundwater Elevations vs. Time
76 Station 7176

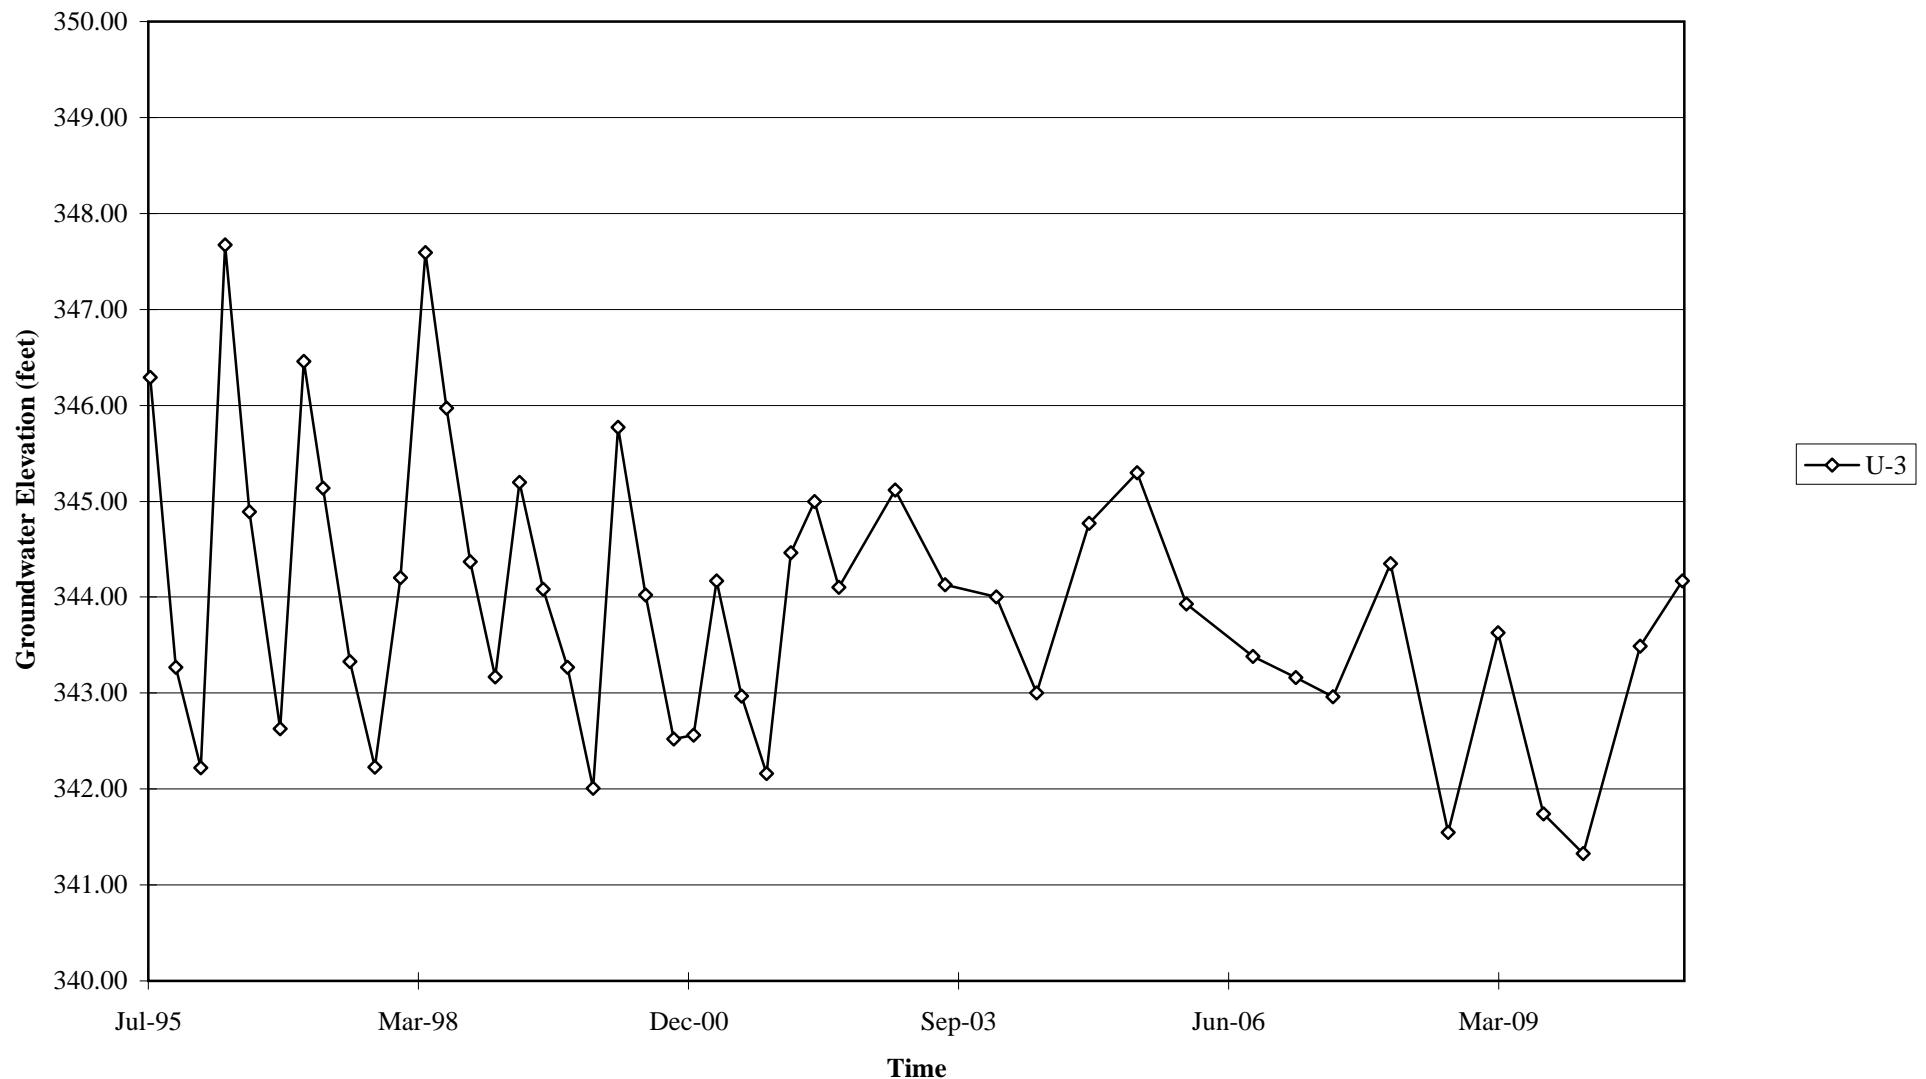

Benzene Concentrations vs Time
76 Station 7176

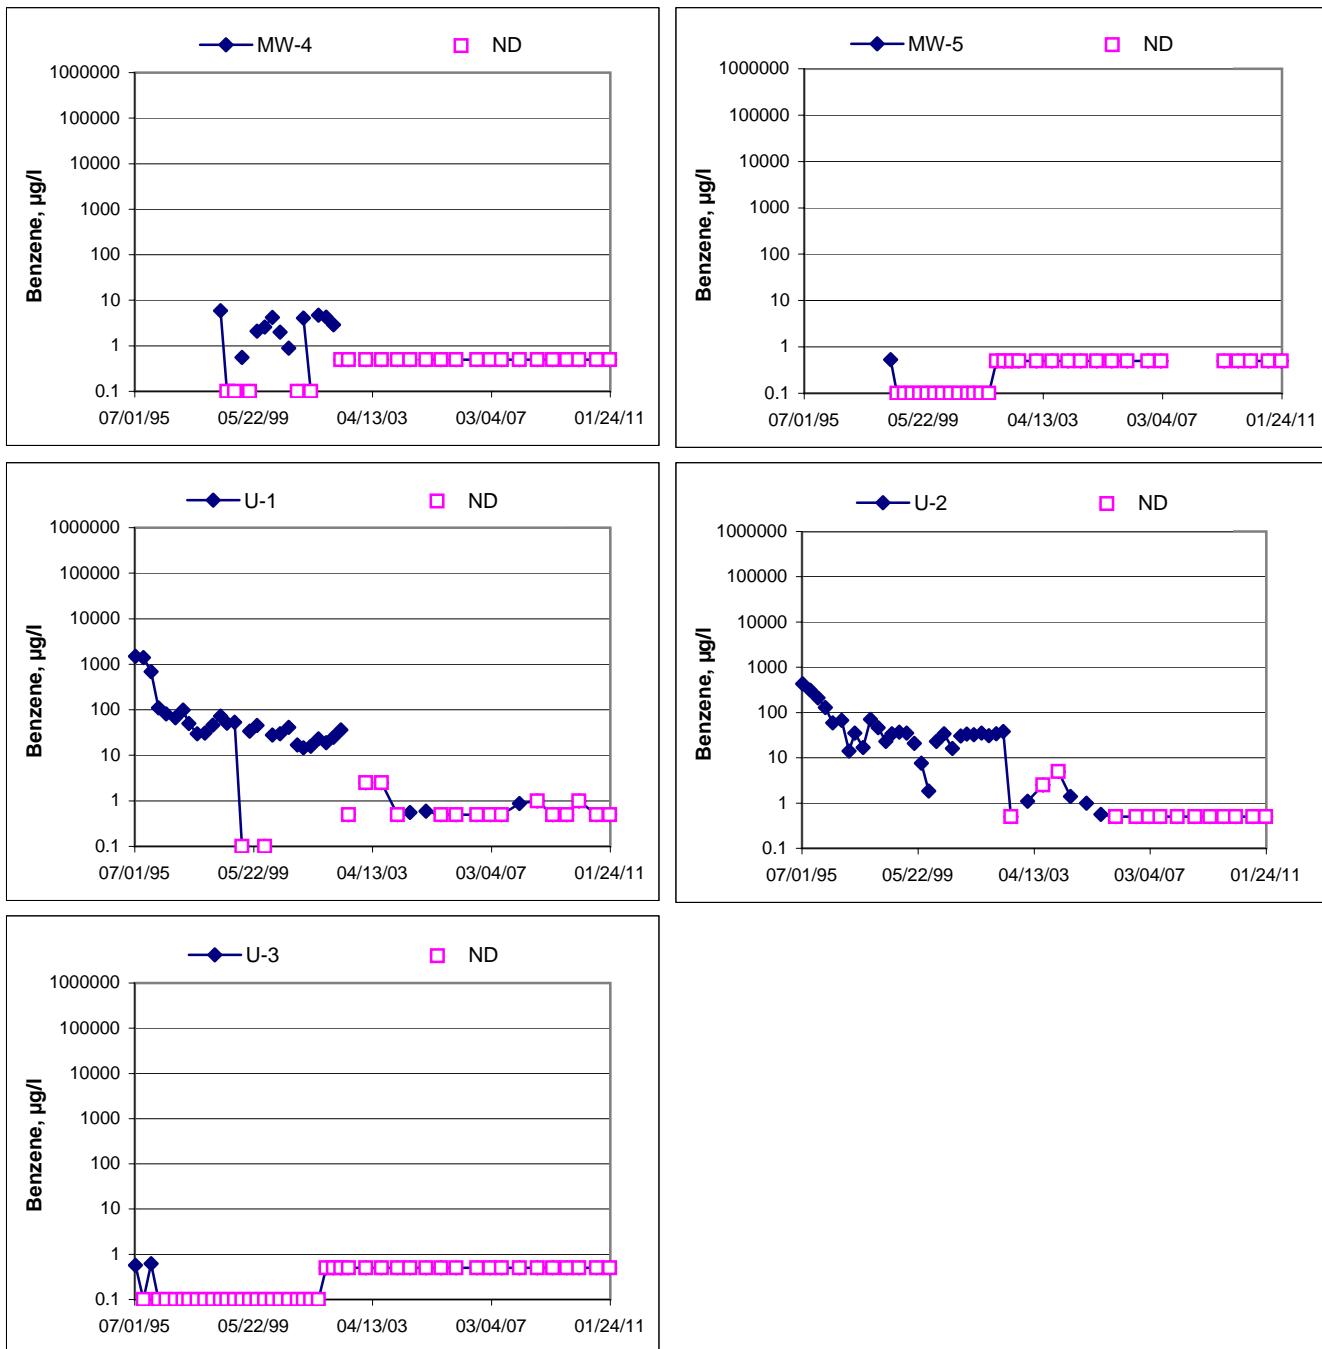

MTBE Concentrations vs Time
76 Station 7176

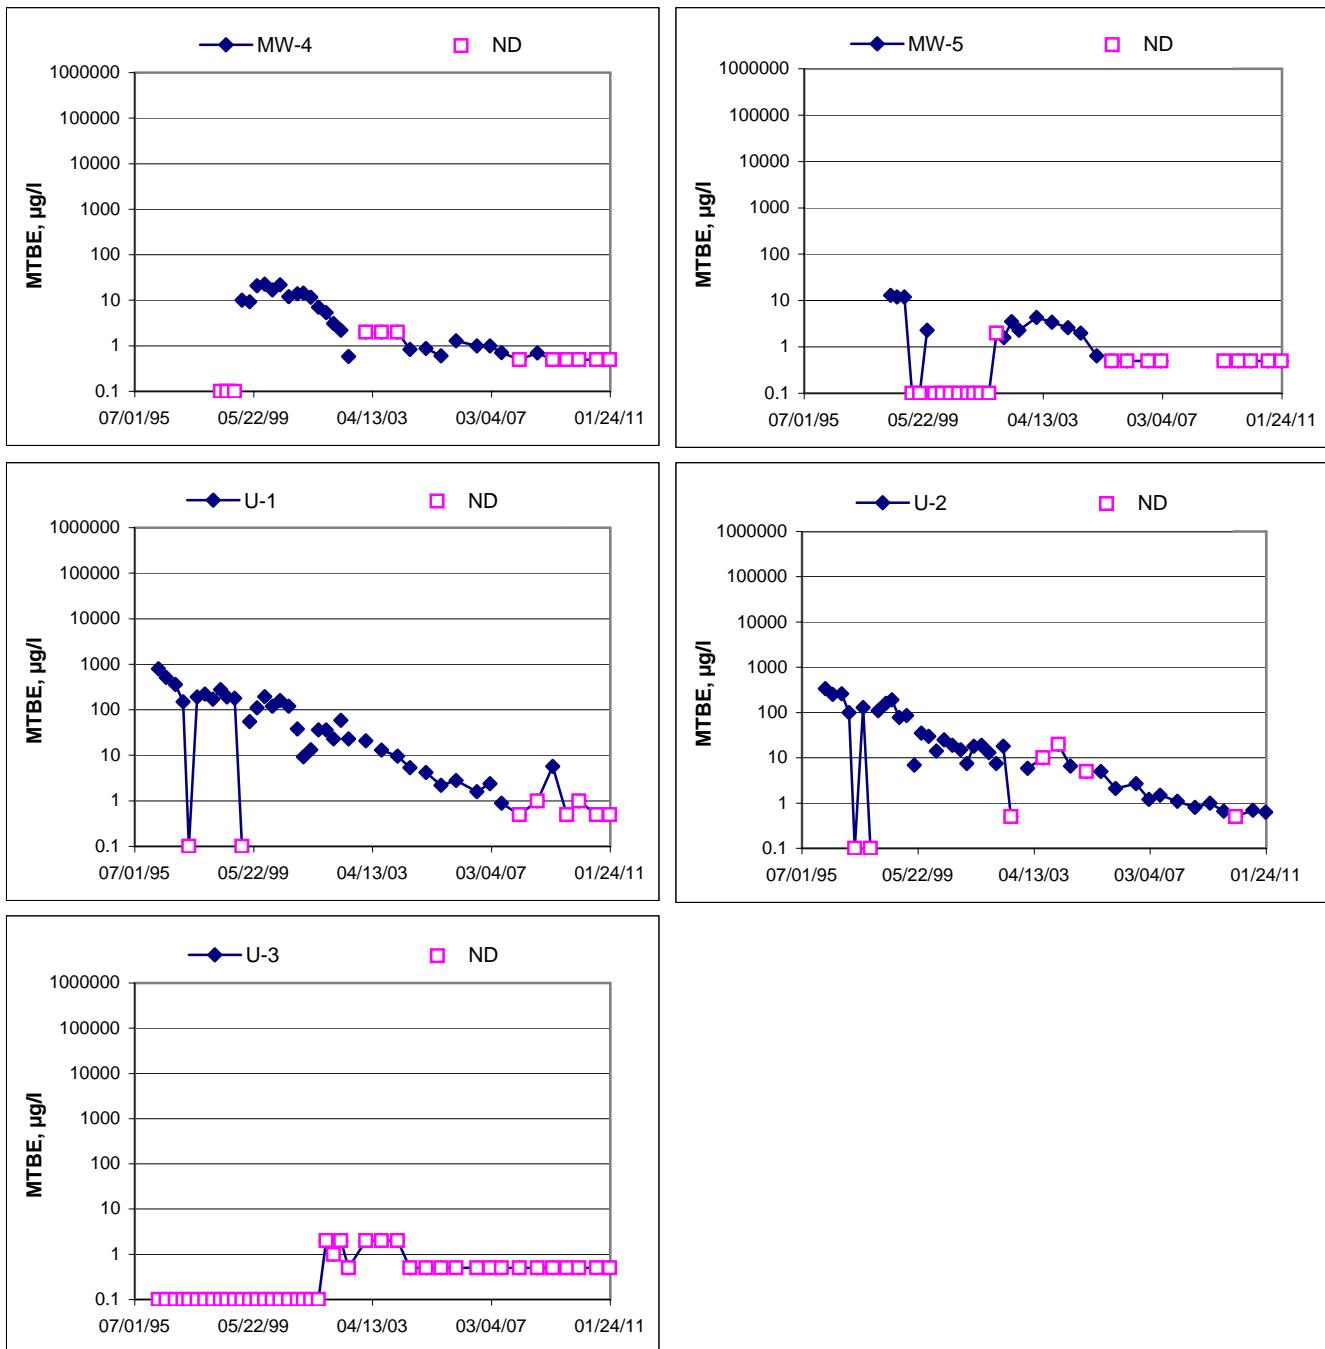

GENERAL FIELD PROCEDURES

Groundwater Monitoring and Sampling Assignments

For each site, TRC technicians are provided with a Technical Service Request (TSR) that specifies activities required to complete the groundwater monitoring and sampling assignment for the site. TSRs are based on client directives, instructions from the primary environmental consultant for the site, regulatory requirements, and TRC's previous experience with the site.

Fluid Level Measurements

Initial site activities include determination of well locations based on a site map provided with the TSR. Well boxes are opened and caps are removed. Indications of well or well box damage or of pressure buildup in the well are noted.

Fluid levels in each well are measured using a coated cloth tape equipped with an electronic interface probe, which distinguishes between liquid phase hydrocarbon (LPH) and water. The depth to LPH (if it is present), to water, and to the bottom of the well are measured from the top of the well casing (surveyors mark or notch if present) to the nearest 0.01 foot. Unless otherwise instructed, a well with less than 0.67 foot between the measured top of water and the measured bottom of the well casing is considered dry, and is not sampled. If the well contains 0.67 foot or more of water, an attempt is made to bail and/or sample as specified on the TSR.

Wells that are found to contain LPH are not purged or sampled. Instead, one casing volume of fluid is bailed from the well and the well is re-sealed. Bailed fluids are placed in a container separate from normal purge water, and properly disposed.

Purging and Groundwater Parameter Measurement

TSR instructions may specify that a well not be purged (no-purge sampling), be purged using low-flow methods, or be purged using conventional pump and/or bail methods. Conventional purging generally consists of pumping or bailing until a minimum of three casing volumes of water have been removed or until the well has been pumped dry. Pumping is generally accomplished using submersible electric or pneumatic diaphragm pumps.

During conventional purging, three groundwater parameters (temperature, pH, and conductivity) are measured after removal of each casing volume. Stabilization of these parameters, to within 10 percent, confirm that sufficient purging has been completed. In some cases, the TSR indicates that other parameters are also to be measured during purging. TRC commonly measures dissolved oxygen (DO), oxidation-reduction potential (ORP), and/or turbidity. Instruments used for groundwater parameter measurements are calibrated daily according to manufacturer's instructions.

Low-flow purging utilizes a bladder or peristaltic pump to remove water from the well at a low rate. Groundwater parameters specified by the TSR are measured continuously until they become stable in general accordance with EPA guidelines.

Purge water is generally collected in labeled drums for disposal. Drums may be left on site for disposal by others, or transported to a collection location for eventual transfer to a licensed treatment or recycling facility. In some cases, purge water may be collected directly from the site by a licensed vacuum truck company, or may be treated on site by an active remediation system, if so directed.

Groundwater Sample Collection

After wells are purged, or not purged, according to TSR instructions, samples are collected for laboratory analysis. For wells that have been purged using conventional pump or bail methods, sampling is conducted after the well has recovered to 80 percent of its original volume or after two hours if the well does not recover to at least 80 percent. If there is insufficient recharge of water in the well after two hours, the well is not sampled.

Samples are collected by lowering a new, disposable, ½-inch to 4-inch polyethylene bottom-fill bailer to just below the water level in the well. The bailer is retrieved and the water sample is carefully transferred to containers specified for the laboratory analytical methods indicated by the TSR. Particular care is given to containers for volatile organic analysis (VOAs) which require filling to zero headspace and fitting with Teflon-sealed caps.

After filling, all containers are labeled with project number (or site number), well designation, sample date, sample time, and the sampler's initials, and placed in an insulated chest with ice. Samples remain chilled prior to and during transport to a state-certified laboratory for analysis. Sample container descriptions and requested analyses are entered onto a chain-of-custody form in order to provide instructions to the laboratory. The chain-of-custody form accompanies the samples during transportation to provide a continuous record of possession from the field to the laboratory. If a freight or overnight carrier transports the samples, the carrier is noted on the form.

For wells that have been purged using low-flow methods, sample containers are filled from the effluent stream of the bladder or peristaltic pump. In some cases, if so specified by the TSR, samples are taken from the sample ports of actively pumping remediation wells.

Sequence of Gauging, Purging and Sampling

The sequence in which monitoring activities are conducted is specified on the TSR. In general, wells are gauged beginning with the least affected well and ending with the well that has the highest concentration based on previous analytic results. After all gauging for the site is completed, wells are purged and/or sampled from the least-affected to the most-affected well.

Decontamination

In order to reduce the possibility of cross contamination between wells, strict isolation and decontamination procedures are observed. Portable pumps are not used in wells with LPH. Technicians wear nitrile gloves during all gauging, purging, and sampling activities. Gloves are changed between wells and more often if warranted. Any equipment that could come in contact with fluids are either dedicated a particular well, decontaminated prior to each use, or discarded after a single use. Decontamination consists of washing in a solution of Liqui-nox and water and rinsing twice. The final rinse is in deionized water.

Exceptions

Additional tasks or non-standard procedures, if any, that may be requested or required for a particular site, and noted on the site TSR, are documented in field notes on the following pages.

FIELD MONITORING DATA SHEET

Technician: Danw

Job #/Task #: 181816

Date: J-17-11

Site # 7176

Project Manager A. Collins

Page 1 of 1

GROUNDWATER SAMPLING FIELD NOTES

Technician: Banli

Site: 7176

Project No.: 181816

Date: 1-17-11

Well No. MW-5

Depth to Water (feet): 14.35

Total Depth (feet) 25.55

Water Column (feet): 11.20

80% Recharge Depth(feet): 16.59

Purge Method: 3 min H2

Depth to Product (feet): -

LPH & Water Recovered (gallons): -

Casing Diameter (Inches): 2

1 Well Volume (gallons): 2

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity	
Pre-Purge										
<u>0952</u>			<u>2</u>	<u>1262</u>	<u>19.2</u>	<u>7.96</u>				
			<u>4</u>	<u>1237</u>	<u>20.3</u>	<u>7.24</u>				
<u>1002</u>			<u>6</u>	<u>1221</u>	<u>20.9</u>	<u>6.97</u>				
Static at Time Sampled			Total Gallons Purged			Sample Time				
<u>14.47</u>			<u>6</u>			<u>1010</u>				
Comments:										

Well No. MW-4

Depth to Water (feet): 15.37

Total Depth (feet) 25.15

Water Column (feet): 9.78

80% Recharge Depth(feet): 17.32

Purge Method: S_n

Depth to Product (feet): -

LPH & Water Recovered (gallons): -

Casing Diameter (Inches): 2

1 Well Volume (gallons): 2

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity	
Pre-Purge										
<u>1017</u>			<u>2</u>	<u>1178</u>	<u>14.2</u>	<u>7.02</u>				
			<u>4</u>	<u>1196</u>	<u>16.9</u>	<u>6.86</u>				
<u>1021</u>			<u>6</u>	<u>1206</u>	<u>18.3</u>	<u>6.72</u>				
Static at Time Sampled			Total Gallons Purged			Sample Time				
<u>15.49</u>			<u>6</u>			<u>1025</u>				
Comments:										

GROUNDWATER SAMPLING FIELD NOTES

Technician: Bonita

Site: 7176

Project No.: 181816

Date: 1-17-11

Well No. U-1

Depth to Water (feet): 14.50

Total Depth (feet) 28.57

Water Column (feet): 14.07

80% Recharge Depth(feet): 17.31

Purge Method: Sub

Depth to Product (feet): -

LPH & Water Recovered (gallons): -

Casing Diameter (Inches): 2

1 Well Volume (gallons): 3

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity
Pre-Purge									
<u>1036</u>			<u>3</u>	<u>1134</u>	<u>17.9</u>	<u>6.66</u>			
			<u>6</u>	<u>1110</u>	<u>19.3</u>	<u>6.57</u>			
	<u>1041</u>		<u>9</u>	<u>1117</u>	<u>20.7</u>	<u>6.52</u>			
Static at Time Sampled			Total Gallons Purged			Sample Time			
<u>15.67</u>			<u>9</u>			<u>1045</u>			
Comments:									

Well No. U-3

Depth to Water (feet): 16.70

Total Depth (feet) 28.40

Water Column (feet): 11.70

80% Recharge Depth(feet): 19.04

Purge Method: Sub

Depth to Product (feet): -

LPH & Water Recovered (gallons): -

Casing Diameter (Inches): 2

1 Well Volume (gallons): 2

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity
Pre-Purge									
<u>1053</u>			<u>2</u>	<u>1230</u>	<u>18.1</u>	<u>6.65</u>			
			<u>4</u>	<u>1247</u>	<u>19.4</u>	<u>6.59</u>			
	<u>1059</u>		<u>6</u>	<u>1250</u>	<u>19.9</u>	<u>6.55</u>			
Static at Time Sampled			Total Gallons Purged			Sample Time			
<u>16.82</u>			<u>6</u>			<u>1103</u>			
Comments:									

GROUNDWATER SAMPLING FIELD NOTES

Technician: Bailie

Site: 7176 Project No.: 181816 Date: 1-17-11
 Well No. U-2 Purge Method: 5L
 Depth to Water (feet): 15.27 Depth to Product (feet): —
 Total Depth (feet) 26.30 LPH & Water Recovered (gallons): —
 Water Column (feet): 11.03 Casing Diameter (Inches): 2
 80% Recharge Depth(feet): 17.47 1 Well Volume (gallons): 2

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity
Pre-Purge									
1112			3	1342	18.3	6.94			
			4	1350	19.6	6.75			
1117			6	1352	20.1	6.63			
Static at Time Sampled			Total Gallons Purged			Sample Time			
<u>15.53</u>			<u>6</u>			<u>1130</u>			
Comments:									

Well No. _____ Purge Method: _____
 Depth to Water (feet): _____
 Total Depth (feet) _____ Depth to Product (feet): _____
 Water Column (feet): _____ LPH & Water Recovered (gallons): _____
 80% Recharge Depth(feet): _____ Casing Diameter (Inches): 2
 1 Well Volume (gallons): _____

Time Start	Time Stop	Depth to Water (feet)	Volume Purged (gallons)	Conductivity ($\mu\text{S}/\text{cm}$)	Temperature (F, C)	pH	D.O. (mg/L)	ORP	Turbidity
Pre-Purge									
Static at Time Sampled			Total Gallons Purged			Sample Time			
Comments:									



Laboratories, Inc.

Environmental Testing Laboratory Since 1949

Date of Report: 02/01/2011

Anju Farfan

TRC

123 Technology Drive
Irvine, CA 92618


RE: 7176
BC Work Order: 1101076
Invoice ID: B094358

Enclosed are the results of analyses for samples received by the laboratory on 1/18/2011. If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Contact Person: Molly Meyers
Client Service Rep



Authorized Signature

Certifications: CA ELAP #1186; NV #CA00014

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.
All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.

4100 Atlas Court Bakersfield, CA 93308 (661) 327-4911 FAX (661) 327-1918 www.bclabs.com



Table of Contents

Sample Information

Chain of Custody and Cooler Receipt form.....	3
Laboratory / Client Sample Cross Reference.....	5

Sample Results

1101076-01 - MW-5	
Volatile Organic Analysis (EPA Method 8260).....	7
Purgeable Aromatics and Total Petroleum Hydrocarbons.....	10
Total Petroleum Hydrocarbons.....	11
1101076-02 - MW-4	
Volatile Organic Analysis (EPA Method 8260).....	12
Purgeable Aromatics and Total Petroleum Hydrocarbons.....	15
Total Petroleum Hydrocarbons.....	16
1101076-03 - U-1	
Volatile Organic Analysis (EPA Method 8260).....	17
Purgeable Aromatics and Total Petroleum Hydrocarbons.....	20
Total Petroleum Hydrocarbons.....	21
1101076-04 - U-3	
Volatile Organic Analysis (EPA Method 8260).....	22
Purgeable Aromatics and Total Petroleum Hydrocarbons.....	25
Total Petroleum Hydrocarbons.....	26
1101076-05 - U-2	
Volatile Organic Analysis (EPA Method 8260).....	27
Purgeable Aromatics and Total Petroleum Hydrocarbons.....	30
Total Petroleum Hydrocarbons.....	31

Quality Control Reports

Volatile Organic Analysis (EPA Method 8260)	
Method Blank Analysis.....	32
Laboratory Control Sample.....	35
Precision and Accuracy.....	36
Purgeable Aromatics and Total Petroleum Hydrocarbons	
Method Blank Analysis.....	37
Laboratory Control Sample.....	38
Precision and Accuracy.....	39
Total Petroleum Hydrocarbons	
Method Blank Analysis.....	40
Laboratory Control Sample.....	41
Precision and Accuracy.....	42

Notes

Notes and Definitions.....	43
----------------------------	----

BC

Laboratories, Inc.

Environmental Testing Laboratory Since 1949

Chain of Custody and Courier Receipt Form for 1101076 Page 1 of 2

BC LABORATORIES, INC.

4100 Atlas Court Bakersfield, CA 93308
(661) 327-4911 FAX (661) 327-1918

11-01076

Bill to: Conoco Phillips/ TRC		Consultant Firm: TRC		MATRIX		Analysis Requested		Turnaround Time Requested								
Address: 7850 Amador Valley Blvd.		21 Technology Drive Irvine, CA 92618-2302 Attn: Anju Farfan		(GW)	Ground-water (S)	TPH-G by GC/MS	BTExMTBE/Oxy's BY 8260B									
City: Dublin		4-digit site#: 7176		Soil (WW)	Waste-water (SL)	TPH DIESEL by 8015M	TPH GAS by 8015M									
State: CA Zip:		Workorder # 01635-4514546263		Sludge	BTEXMTBE by 8021B, Gass by 8015S	8260 full list w/oxygenates										
Conoco Phillips Mgr: Ted Moise		Sampler Name: Banlio														
Lab#	Sample Description	Field Point Name	Date & Time Sampled													
-1	MW-5	1-17-11	1010	8												
-2	MW-4		1025													
-3	U-1		1045													
-4	U-3		1103													
-5	U-2		1130	✓												
<table border="1"> <tr> <td><input type="checkbox"/> CHK BY</td> <td colspan="2">DISTRIBUTION</td> </tr> <tr> <td><i>Ross Dickey</i></td> <td colspan="2"><i>Ross Dickey</i></td> </tr> <tr> <td colspan="3">SUB OUT TO</td> </tr> </table>								<input type="checkbox"/> CHK BY	DISTRIBUTION		<i>Ross Dickey</i>	<i>Ross Dickey</i>		SUB OUT TO		
<input type="checkbox"/> CHK BY	DISTRIBUTION															
<i>Ross Dickey</i>	<i>Ross Dickey</i>															
SUB OUT TO																
Comments: Analyse 8260's on an instrument that is able to report a full scan. Run TPH-G w/silica gel clean-up on hits. GLOBAL IDE-Mail copy Lab results to To 600101883 awgover@deltaenv.com R (Reynd) 1-18-11 2140		Relinquished by: (Signature) <i>Ross Dickey</i>		Received by: (Signature) <i>Ross Dickey</i>		Date & Time 1-18-11 1555										
		Relinquished by: (Signature) <i>Ross Dickey</i> 1-18-11		Received by: (Signature) <i>R Reynd</i>		Date & Time 1-18-11 1835										
		Relinquished by: (Signature) <i>R Reynd</i>		Received by: (Signature) <i>R Reynd</i>		Date & Time 1-18-11 2140										



Chain of Custody and Cooler Receipt Form for 1101076 Page 2 of 2

LABORATORIES INC.		SAMPLE RECEIPT FORM		Rev. No. 12	06/24/08	Page 1 Of 1					
Submission #: 11-01076											
SHIPPING INFORMATION				SHIPPING CONTAINER							
Federal Express <input type="checkbox"/> UPS <input type="checkbox"/> Hand Delivery <input type="checkbox"/> C Lab Field Service <input checked="" type="checkbox"/> Other <input type="checkbox"/> (Specify) _____				Ice Chest <input checked="" type="checkbox"/>	None <input type="checkbox"/>	Box <input type="checkbox"/> Other <input type="checkbox"/> (Specify) _____					
Comments:											
Refrigerant: Ice <input type="checkbox"/> Blue Ice <input type="checkbox"/> None <input type="checkbox"/> Other <input type="checkbox"/>		Comments:									
Custody Seals: Ice Chest <input type="checkbox"/> Containers <input type="checkbox"/> None <input type="checkbox"/>		Comments:									
Intact? Yes <input type="checkbox"/> No <input type="checkbox"/>		Intact? Yes <input type="checkbox"/> No <input type="checkbox"/>		All samples containers intact? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>							
COC Received <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		Emissivity: 0.98 Container: VOA Thermometer ID: 103		Description(s) match COC? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>							
		Temperature: A 1.1 °C / C 1.1 °C		DateTime 1-18-11 2144 Analyst Init. JMW							
SAMPLE CONTAINERS		SAMPLE NUMBERS									
		1	2	3	4	5	6	7	8	9	10
QT GENERAL MINERAL/GENERAL PHYSICAL											
PT PE UNPRESERVED											
QT INORGANIC CHEMICAL METALS											
PT INORGANIC CHEMICAL METALS											
PT CYANIDE											
PT NITROGEN FORMS											
PT TOTAL SULFIDE											
100 mL NITRATE / NITRITE											
PT TOTAL ORGANIC CARBON											
PT TOX											
PT CHEMICAL OXYGEN DEMAND											
Psa PHENOLICS											
40mL VOA VIAL TRAVEL BLANK		A	D	A	D	A	D				
40mL VOA VIAL											
QT EPA 413.1, 413.2, 413.3											
PT ODOR											
RADIOLOGICAL											
BACTERIOLOGICAL											
40 mL VOA VIAL-504											
QT EPA 508/608/8080											
QT EPA 515 LBE50											
QT EPA 515											
QT EPA 515 TRAVEL BLANK											
1000mL EPA 531.1											
QT EPA 518											
QT EPA 549											
QT EPA 631											
QT EPA 8015M		BC	BC	BC	BC	BC					
QT AMBER											
8 OZ. JAR											
11 OZ. JAR											
SOIL SLEEVE											
PCB VIAL											
PLASTIC BAG											
FERROUS IRON											
ENCLOSURE											
Comments: _____		Sample Numbering Completed By: 8		DateTime: 1/19/11 1753		(H:\DOCS\SWP\BCLAB\DOCS\FORMS\SamREC1.VPD)					
A = Actual / C = Corrected											



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Laboratory / Client Sample Cross Reference

Laboratory	Client Sample Information			
1101076-01	COC Number: --- Project Number: 7176 Sampling Location: --- Sampling Point: MW-5 Sampled By: TRCI	Receive Date: 01/18/2011 21:40 Sampling Date: 01/17/2011 10:10 Sample Depth: --- Lab Matrix: Water Sample Type: Water Delivery Work Order: Global ID: T0600101883 Location ID (FieldPoint): MW-5 Matrix: W Sample QC Type (SACode): CS Cooler ID:		
1101076-02	COC Number: --- Project Number: 7176 Sampling Location: --- Sampling Point: MW-4 Sampled By: TRCI	Receive Date: 01/18/2011 21:40 Sampling Date: 01/17/2011 10:25 Sample Depth: --- Lab Matrix: Water Sample Type: Water Delivery Work Order: Global ID: T0600101883 Location ID (FieldPoint): MW-4 Matrix: W Sample QC Type (SACode): CS Cooler ID:		
1101076-03	COC Number: --- Project Number: 7176 Sampling Location: --- Sampling Point: U-1 Sampled By: TRCI	Receive Date: 01/18/2011 21:40 Sampling Date: 01/17/2011 10:45 Sample Depth: --- Lab Matrix: Water Sample Type: Water Delivery Work Order: Global ID: T0600101883 Location ID (FieldPoint): U-1 Matrix: W Sample QC Type (SACode): CS Cooler ID:		



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Laboratory / Client Sample Cross Reference

Laboratory	Client Sample Information	
1101076-04	COC Number: --- Project Number: 7176 Sampling Location: --- Sampling Point: U-3 Sampled By: TRCI	Receive Date: 01/18/2011 21:40 Sampling Date: 01/17/2011 11:03 Sample Depth: --- Lab Matrix: Water Sample Type: Water Delivery Work Order: Global ID: T0600101883 Location ID (FieldPoint): U-3 Matrix: W Sample QC Type (SACode): CS Cooler ID:
1101076-05	COC Number: --- Project Number: 7176 Sampling Location: --- Sampling Point: U-2 Sampled By: TRCI	Receive Date: 01/18/2011 21:40 Sampling Date: 01/17/2011 11:30 Sample Depth: --- Lab Matrix: Water Sample Type: Water Delivery Work Order: Global ID: T0600101883 Location ID (FieldPoint): U-2 Matrix: W Sample QC Type (SACode): CS Cooler ID:



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-01	Client Sample Name:	7176, MW-5, 1/17/2011 10:10:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Benzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromodichloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromoform	ND	ug/L	0.50	EPA-8260	ND		1
Bromomethane	ND	ug/L	1.0	EPA-8260	ND		1
n-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
sec-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
tert-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Carbon tetrachloride	ND	ug/L	0.50	EPA-8260	ND		1
Chlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Chloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Chloroform	ND	ug/L	0.50	EPA-8260	ND		1
Chloromethane	ND	ug/L	0.50	EPA-8260	ND		1
2-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
4-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
Dibromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dibromo-3-chloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dibromoethane	ND	ug/L	0.50	EPA-8260	ND		1
Dibromomethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,4-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Dichlorodifluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,2-Dichloroethene	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
2,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-01	Client Sample Name:	7176, MW-5, 1/17/2011 10:10:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
1,1-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,3-Dichloropropene	ND	ug/L	1.0	EPA-8260	ND		1
Ethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Hexachlorobutadiene	ND	ug/L	0.50	EPA-8260	ND		1
Isopropylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
p-Isopropyltoluene	ND	ug/L	0.50	EPA-8260	ND		1
Methylene chloride	ND	ug/L	1.0	EPA-8260	ND		1
Methyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Naphthalene	ND	ug/L	0.50	EPA-8260	ND		1
n-Propylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Styrene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Tetrachloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Toluene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Trichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Trichlorofluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3,5-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Vinyl chloride	ND	ug/L	0.50	EPA-8260	ND		1
Total Xylenes	ND	ug/L	1.0	EPA-8260	ND		1
t-Amyl Methyl ether	ND	ug/L	0.50	EPA-8260	ND		1
t-Butyl alcohol	ND	ug/L	10	EPA-8260	ND		1
Diisopropyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Ethanol	ND	ug/L	250	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-01	Client Sample Name: 7176, MW-5, 1/17/2011 10:10:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Ethyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Total Purgeable Petroleum Hydrocarbons	ND	ug/L	50	Luft-GC/MS	ND		1
1,2-Dichloroethane-d4 (Surrogate)	108	%	76 - 114 (LCL - UCL)	EPA-8260			1
Toluene-d8 (Surrogate)	99.2	%	88 - 110 (LCL - UCL)	EPA-8260			1
4-Bromofluorobenzene (Surrogate)	102	%	86 - 115 (LCL - UCL)	EPA-8260			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	EPA-8260	01/20/11	01/21/11 01:16	JSK	HPCHEM	1	BUA1112



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-01	Client Sample Name:	7176, MW-5, 1/17/2011 10:10:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Gasoline Range Organics (C4 - C12)	ND	ug/L	50	Luft	ND		1
a,a,a-Trifluorotoluene (FID Surrogate)	93.3	%	70 - 130 (LCL - UCL)	Luft			1

Run #	Method	Prep Date	Run	Analyst	Instrument	Dilution	QC Batch ID
			Date/Time				
1	Luft	01/25/11	01/25/11 16:47	jjh	GC-V4	1	BUA1436



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-01	Client Sample Name:	7176, MW-5, 1/17/2011 10:10:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Diesel Range Organics (C12 - C24)	ND	ug/L	50	Luft/TPHd	ND		1
Tetracosane (Surrogate)	111	%	28 - 139 (LCL - UCL)	Luft/TPHd			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft/TPHd	01/24/11	02/01/11 13:43	MWB	GC-5	1	BUB0070



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-02	Client Sample Name:	7176, MW-4, 1/17/2011 10:25:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Benzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromodichloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromoform	ND	ug/L	0.50	EPA-8260	ND		1
Bromomethane	ND	ug/L	1.0	EPA-8260	ND		1
n-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
sec-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
tert-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Carbon tetrachloride	ND	ug/L	0.50	EPA-8260	ND		1
Chlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Chloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Chloroform	ND	ug/L	0.50	EPA-8260	ND		1
Chloromethane	ND	ug/L	0.50	EPA-8260	ND		1
2-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
4-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
Dibromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dibromo-3-chloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dibromoethane	ND	ug/L	0.50	EPA-8260	ND		1
Dibromomethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,4-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Dichlorodifluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,2-Dichloroethene	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
2,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.

4100 Atlas Court Bakersfield, CA 93308 (661) 327-4911 FAX (661) 327-1918 www.bclabs.com

Page 12 of 43



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-02	Client Sample Name:	7176, MW-4, 1/17/2011 10:25:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
1,1-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,3-Dichloropropene	ND	ug/L	1.0	EPA-8260	ND		1
Ethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Hexachlorobutadiene	ND	ug/L	0.50	EPA-8260	ND		1
Isopropylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
p-Isopropyltoluene	ND	ug/L	0.50	EPA-8260	ND		1
Methylene chloride	ND	ug/L	1.0	EPA-8260	ND		1
Methyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Naphthalene	ND	ug/L	0.50	EPA-8260	ND		1
n-Propylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Styrene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Tetrachloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Toluene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Trichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Trichlorofluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3,5-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Vinyl chloride	ND	ug/L	0.50	EPA-8260	ND		1
Total Xylenes	ND	ug/L	1.0	EPA-8260	ND		1
t-Amyl Methyl ether	ND	ug/L	0.50	EPA-8260	ND		1
t-Butyl alcohol	ND	ug/L	10	EPA-8260	ND		1
Diisopropyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Ethanol	ND	ug/L	250	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-02	Client Sample Name: 7176, MW-4, 1/17/2011 10:25:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Ethyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Total Purgeable Petroleum Hydrocarbons	120	ug/L	50	Luft-GC/MS	ND		1
1,2-Dichloroethane-d4 (Surrogate)	99.1	%	76 - 114 (LCL - UCL)	EPA-8260			1
Toluene-d8 (Surrogate)	99.1	%	88 - 110 (LCL - UCL)	EPA-8260			1
4-Bromofluorobenzene (Surrogate)	102	%	86 - 115 (LCL - UCL)	EPA-8260			1

Run #	Method	Prep Date	Run		Instrument	Dilution	QC Batch ID
			Date/Time	Analyst			
1	EPA-8260	01/21/11	01/21/11 18:03	JSK	HPCHEM	1	BUA1112



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-02	Client Sample Name: 7176, MW-4, 1/17/2011 10:25:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Gasoline Range Organics (C4 - C12)	55	ug/L	50	Luft	ND		1
a,a,a-Trifluorotoluene (FID Surrogate)	94.4	%	70 - 130 (LCL - UCL)	Luft			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft	01/25/11	01/25/11 17:09	jjh	GC-V4	1	BUA1436



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-02	Client Sample Name:	7176, MW-4, 1/17/2011 10:25:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Diesel Range Organics (C12 - C24)	ND	ug/L	50	Luft/TPHd	ND		1
Tetracosane (Surrogate)	110	%	28 - 139 (LCL - UCL)	Luft/TPHd			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft/TPHd	01/24/11	02/01/11 13:58	MWB	GC-5	1	BUB0070



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-03	Client Sample Name:	7176, U-1, 1/17/2011 10:45:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Benzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromodichloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromoform	ND	ug/L	0.50	EPA-8260	ND		1
Bromomethane	ND	ug/L	1.0	EPA-8260	ND		1
n-Butylbenzene	39	ug/L	0.50	EPA-8260	ND		1
sec-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
tert-Butylbenzene	2.6	ug/L	0.50	EPA-8260	ND		1
Carbon tetrachloride	ND	ug/L	0.50	EPA-8260	ND		1
Chlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Chloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Chloroform	ND	ug/L	0.50	EPA-8260	ND		1
Chloromethane	ND	ug/L	0.50	EPA-8260	ND		1
2-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
4-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
Dibromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dibromo-3-chloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dibromoethane	ND	ug/L	0.50	EPA-8260	ND		1
Dibromomethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,4-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Dichlorodifluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,2-Dichloroethene	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
2,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-03	Client Sample Name: 7176, U-1, 1/17/2011 10:45:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
1,1-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,3-Dichloropropene	ND	ug/L	1.0	EPA-8260	ND		1
Ethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Hexachlorobutadiene	ND	ug/L	0.50	EPA-8260	ND		1
Isopropylbenzene	17	ug/L	0.50	EPA-8260	ND		1
p-Isopropyltoluene	ND	ug/L	0.50	EPA-8260	ND		1
Methylene chloride	ND	ug/L	1.0	EPA-8260	ND		1
Methyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Naphthalene	ND	ug/L	0.50	EPA-8260	ND		1
n-Propylbenzene	67	ug/L	0.50	EPA-8260	ND		1
Styrene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Tetrachloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Toluene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Trichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Trichlorofluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3,5-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Vinyl chloride	ND	ug/L	0.50	EPA-8260	ND		1
Total Xylenes	ND	ug/L	1.0	EPA-8260	ND		1
t-Amyl Methyl ether	ND	ug/L	0.50	EPA-8260	ND		1
t-Butyl alcohol	ND	ug/L	10	EPA-8260	ND		1
Diisopropyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Ethanol	ND	ug/L	250	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.

4100 Atlas Court Bakersfield, CA 93308 (661) 327-4911 FAX (661) 327-1918 www.bclabs.com



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-03	Client Sample Name:	7176, U-1, 1/17/2011 10:45:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Ethyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Total Purgeable Petroleum Hydrocarbons	2100	ug/L	250	Luft-GC/MS	ND	A01	2
1,2-Dichloroethane-d4 (Surrogate)	100	%	76 - 114 (LCL - UCL)	EPA-8260			1
1,2-Dichloroethane-d4 (Surrogate)	91.6	%	76 - 114 (LCL - UCL)	EPA-8260			2
Toluene-d8 (Surrogate)	103	%	88 - 110 (LCL - UCL)	EPA-8260			1
Toluene-d8 (Surrogate)	97.7	%	88 - 110 (LCL - UCL)	EPA-8260			2
4-Bromofluorobenzene (Surrogate)	124	%	86 - 115 (LCL - UCL)	EPA-8260		S09	1
4-Bromofluorobenzene (Surrogate)	105	%	86 - 115 (LCL - UCL)	EPA-8260			2

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	EPA-8260	01/21/11	01/21/11 18:25	JSK	HPCHEM	1	BUA1112
2	EPA-8260	01/24/11	01/24/11 17:36	JSK	HPCHEM	5	BUA1112



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-03	Client Sample Name: 7176, U-1, 1/17/2011 10:45:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Gasoline Range Organics (C4 - C12)	1200	ug/L	50	Luft	ND		1
a,a,a-Trifluorotoluene (FID Surrogate)	123	%	70 - 130 (LCL - UCL)	Luft			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft	01/25/11	01/25/11 17:32	jjh	GC-V4	1	BUA1436



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-03	Client Sample Name: 7176, U-1, 1/17/2011 10:45:00AM						
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #	
Diesel Range Organics (C12 - C24)	670	ug/L	50	Luft/TPHd	ND	A52	1	
Tetracosane (Surrogate)	114	%	28 - 139 (LCL - UCL)	Luft/TPHd			1	

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft/TPHd	01/24/11	02/01/11 14:12	MWB	GC-5	0.960	BUB0070



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-04	Client Sample Name:	7176, U-3, 1/17/2011 11:03:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Benzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromodichloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromoform	ND	ug/L	0.50	EPA-8260	ND		1
Bromomethane	ND	ug/L	1.0	EPA-8260	ND		1
n-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
sec-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
tert-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Carbon tetrachloride	ND	ug/L	0.50	EPA-8260	ND		1
Chlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Chloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Chloroform	ND	ug/L	0.50	EPA-8260	ND		1
Chloromethane	ND	ug/L	0.50	EPA-8260	ND		1
2-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
4-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
Dibromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dibromo-3-chloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dibromoethane	ND	ug/L	0.50	EPA-8260	ND		1
Dibromomethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,4-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Dichlorodifluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,2-Dichloroethene	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
2,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-04	Client Sample Name:	7176, U-3, 1/17/2011 11:03:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
1,1-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,3-Dichloropropene	ND	ug/L	1.0	EPA-8260	ND		1
Ethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Hexachlorobutadiene	ND	ug/L	0.50	EPA-8260	ND		1
Isopropylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
p-Isopropyltoluene	ND	ug/L	0.50	EPA-8260	ND		1
Methylene chloride	ND	ug/L	1.0	EPA-8260	ND		1
Methyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Naphthalene	ND	ug/L	0.50	EPA-8260	ND		1
n-Propylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Styrene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Tetrachloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Toluene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Trichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Trichlorofluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3,5-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Vinyl chloride	ND	ug/L	0.50	EPA-8260	ND		1
Total Xylenes	ND	ug/L	1.0	EPA-8260	ND		1
t-Amyl Methyl ether	ND	ug/L	0.50	EPA-8260	ND		1
t-Butyl alcohol	ND	ug/L	10	EPA-8260	ND		1
Diisopropyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Ethanol	ND	ug/L	250	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-04	Client Sample Name: 7176, U-3, 1/17/2011 11:03:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Ethyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Total Purgeable Petroleum Hydrocarbons	ND	ug/L	50	Luft-GC/MS	ND		1
1,2-Dichloroethane-d4 (Surrogate)	98.1	%	76 - 114 (LCL - UCL)	EPA-8260			1
Toluene-d8 (Surrogate)	100	%	88 - 110 (LCL - UCL)	EPA-8260			1
4-Bromofluorobenzene (Surrogate)	99.0	%	86 - 115 (LCL - UCL)	EPA-8260			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	EPA-8260	01/21/11	01/21/11 19:06	JSK	HPCHEM	1	BUA1112



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-04	Client Sample Name:	7176, U-3, 1/17/2011 11:03:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Gasoline Range Organics (C4 - C12)	ND	ug/L	50	Luft	ND		1
a,a,a-Trifluorotoluene (FID Surrogate)	102	%	70 - 130 (LCL - UCL)	Luft			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft	01/25/11	01/25/11 17:55	jjh	GC-V4	1	BUA1436



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-04	Client Sample Name: 7176, U-3, 1/17/2011 11:03:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Diesel Range Organics (C12 - C24)	ND	ug/L	50	Luft/TPHd	ND		1
Tetracosane (Surrogate)	116	%	28 - 139 (LCL - UCL)	Luft/TPHd			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft/TPHd	01/24/11	02/01/11 14:27	MWB	GC-5	1	BUB0070



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-05	Client Sample Name: 7176, U-2, 1/17/2011 11:30:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Benzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Bromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromodichloromethane	ND	ug/L	0.50	EPA-8260	ND		1
Bromoform	ND	ug/L	0.50	EPA-8260	ND		1
Bromomethane	ND	ug/L	1.0	EPA-8260	ND		1
n-Butylbenzene	4.4	ug/L	0.50	EPA-8260	ND		1
sec-Butylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
tert-Butylbenzene	4.7	ug/L	0.50	EPA-8260	ND		1
Carbon tetrachloride	ND	ug/L	0.50	EPA-8260	ND		1
Chlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Chloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Chloroform	ND	ug/L	0.50	EPA-8260	ND		1
Chloromethane	ND	ug/L	0.50	EPA-8260	ND		1
2-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
4-Chlorotoluene	ND	ug/L	0.50	EPA-8260	ND		1
Dibromochloromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dibromo-3-chloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dibromoethane	ND	ug/L	0.50	EPA-8260	ND		1
Dibromomethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,4-Dichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
Dichlorodifluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2-Dichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,2-Dichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,2-Dichloroethene	ND	ug/L	1.0	EPA-8260	ND		1
1,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
1,3-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1
2,2-Dichloropropane	ND	ug/L	0.50	EPA-8260	ND		1



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-05	Client Sample Name:	7176, U-2, 1/17/2011 11:30:00AM				
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
1,1-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
cis-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
trans-1,3-Dichloropropene	ND	ug/L	0.50	EPA-8260	ND		1
Total 1,3-Dichloropropene	ND	ug/L	1.0	EPA-8260	ND		1
Ethylbenzene	0.59	ug/L	0.50	EPA-8260	ND		1
Hexachlorobutadiene	ND	ug/L	0.50	EPA-8260	ND		1
Isopropylbenzene	15	ug/L	0.50	EPA-8260	ND		1
p-Isopropyltoluene	ND	ug/L	0.50	EPA-8260	ND		1
Methylene chloride	ND	ug/L	1.0	EPA-8260	ND		1
Methyl t-butyl ether	0.63	ug/L	0.50	EPA-8260	ND		1
Naphthalene	ND	ug/L	0.50	EPA-8260	ND		1
n-Propylbenzene	25	ug/L	0.50	EPA-8260	ND		1
Styrene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2,2-Tetrachloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Tetrachloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Toluene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trichlorobenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,1,1-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,1,2-Trichloroethane	ND	ug/L	0.50	EPA-8260	ND		1
Trichloroethene	ND	ug/L	0.50	EPA-8260	ND		1
Trichlorofluoromethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,3-Trichloropropane	ND	ug/L	1.0	EPA-8260	ND		1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	ug/L	0.50	EPA-8260	ND		1
1,2,4-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
1,3,5-Trimethylbenzene	ND	ug/L	0.50	EPA-8260	ND		1
Vinyl chloride	ND	ug/L	0.50	EPA-8260	ND		1
Total Xylenes	ND	ug/L	1.0	EPA-8260	ND		1
t-Amyl Methyl ether	ND	ug/L	0.50	EPA-8260	ND		1
t-Butyl alcohol	ND	ug/L	10	EPA-8260	ND		1
Diisopropyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Ethanol	ND	ug/L	250	EPA-8260	ND		1

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

BCL Sample ID:	1101076-05	Client Sample Name: 7176, U-2, 1/17/2011 11:30:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Ethyl t-butyl ether	ND	ug/L	0.50	EPA-8260	ND		1
Total Purgeable Petroleum Hydrocarbons	1100	ug/L	50	Luft-GC/MS	ND		1
1,2-Dichloroethane-d4 (Surrogate)	101	%	76 - 114 (LCL - UCL)	EPA-8260			1
Toluene-d8 (Surrogate)	99.3	%	88 - 110 (LCL - UCL)	EPA-8260			1
4-Bromofluorobenzene (Surrogate)	113	%	86 - 115 (LCL - UCL)	EPA-8260			1

Run #	Method	Prep Date	Run		Instrument	Dilution	QC Batch ID
			Date/Time	Analyst			
1	EPA-8260	01/21/11	01/21/11 19:27	JSK	HPCHEM	1	BUA1112



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-05	Client Sample Name: 7176, U-2, 1/17/2011 11:30:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Gasoline Range Organics (C4 - C12)	560	ug/L	50	Luft	ND		1
a,a,a-Trifluorotoluene (FID Surrogate)	120	%	70 - 130 (LCL - UCL)	Luft			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft	01/25/11	01/25/11 20:26	jjh	GC-V4	1	BUA1436



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

BCL Sample ID:	1101076-05	Client Sample Name: 7176, U-2, 1/17/2011 11:30:00AM					
Constituent	Result	Units	PQL	Method	MB Bias	Lab Quals	Run #
Diesel Range Organics (C12 - C24)	360	ug/L	50	Luft/TPHd	ND	A52	1
Tetracosane (Surrogate)	115	%	28 - 139 (LCL - UCL)	Luft/TPHd			1

Run #	Method	Prep Date	Run Date/Time	Analyst	Instrument	Dilution	QC Batch ID
1	Luft/TPHd	01/24/11	02/01/11 14:42	MWB	GC-5	1	BUB0070



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

Quality Control Report - Method Blank Analysis

Constituent	QC Sample ID	MB Result	Units	PQL	MDL	Lab Quals
QC Batch ID: BUA1112						
Benzene	BUA1112-BLK1	ND	ug/L	0.50		
Bromobenzene	BUA1112-BLK1	ND	ug/L	0.50		
Bromochloromethane	BUA1112-BLK1	ND	ug/L	0.50		
Bromodichloromethane	BUA1112-BLK1	ND	ug/L	0.50		
Bromoform	BUA1112-BLK1	ND	ug/L	0.50		
Bromomethane	BUA1112-BLK1	ND	ug/L	1.0		
n-Butylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
sec-Butylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
tert-Butylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
Carbon tetrachloride	BUA1112-BLK1	ND	ug/L	0.50		
Chlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
Chloroethane	BUA1112-BLK1	ND	ug/L	0.50		
Chloroform	BUA1112-BLK1	ND	ug/L	0.50		
Chloromethane	BUA1112-BLK1	ND	ug/L	0.50		
2-Chlorotoluene	BUA1112-BLK1	ND	ug/L	0.50		
4-Chlorotoluene	BUA1112-BLK1	ND	ug/L	0.50		
Dibromochloromethane	BUA1112-BLK1	ND	ug/L	0.50		
1,2-Dibromo-3-chloropropane	BUA1112-BLK1	ND	ug/L	1.0		
1,2-Dibromoethane	BUA1112-BLK1	ND	ug/L	0.50		
Dibromomethane	BUA1112-BLK1	ND	ug/L	0.50		
1,2-Dichlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
1,3-Dichlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
1,4-Dichlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
Dichlorodifluoromethane	BUA1112-BLK1	ND	ug/L	0.50		
1,1-Dichloroethane	BUA1112-BLK1	ND	ug/L	0.50		
1,2-Dichloroethane	BUA1112-BLK1	ND	ug/L	0.50		
1,1-Dichloroethene	BUA1112-BLK1	ND	ug/L	0.50		
cis-1,2-Dichloroethene	BUA1112-BLK1	ND	ug/L	0.50		
trans-1,2-Dichloroethene	BUA1112-BLK1	ND	ug/L	0.50		
Total 1,2-Dichloroethene	BUA1112-BLK1	ND	ug/L	1.0		
1,2-Dichloropropane	BUA1112-BLK1	ND	ug/L	0.50		
1,3-Dichloropropane	BUA1112-BLK1	ND	ug/L	0.50		
2,2-Dichloropropane	BUA1112-BLK1	ND	ug/L	0.50		
1,1-Dichloropropene	BUA1112-BLK1	ND	ug/L	0.50		

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

Quality Control Report - Method Blank Analysis

Constituent	QC Sample ID	MB Result	Units	PQL	MDL	Lab Quals
QC Batch ID: BUA1112						
cis-1,3-Dichloropropene	BUA1112-BLK1	ND	ug/L	0.50		
trans-1,3-Dichloropropene	BUA1112-BLK1	ND	ug/L	0.50		
Total 1,3-Dichloropropene	BUA1112-BLK1	ND	ug/L	1.0		
Ethylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
Hexachlorobutadiene	BUA1112-BLK1	ND	ug/L	0.50		
Isopropylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
p-Isopropyltoluene	BUA1112-BLK1	ND	ug/L	0.50		
Methylene chloride	BUA1112-BLK1	ND	ug/L	1.0		
Methyl t-butyl ether	BUA1112-BLK1	ND	ug/L	0.50		
Naphthalene	BUA1112-BLK1	ND	ug/L	0.50		
n-Propylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
Styrene	BUA1112-BLK1	ND	ug/L	0.50		
1,1,1,2-Tetrachloroethane	BUA1112-BLK1	ND	ug/L	0.50		
1,1,2,2-Tetrachloroethane	BUA1112-BLK1	ND	ug/L	0.50		
Tetrachloroethene	BUA1112-BLK1	ND	ug/L	0.50		
Toluene	BUA1112-BLK1	ND	ug/L	0.50		
1,2,3-Trichlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
1,2,4-Trichlorobenzene	BUA1112-BLK1	ND	ug/L	0.50		
1,1,1-Trichloroethane	BUA1112-BLK1	ND	ug/L	0.50		
1,1,2-Trichloroethane	BUA1112-BLK1	ND	ug/L	0.50		
Trichloroethene	BUA1112-BLK1	ND	ug/L	0.50		
Trichlorofluoromethane	BUA1112-BLK1	ND	ug/L	0.50		
1,2,3-Trichloropropane	BUA1112-BLK1	ND	ug/L	1.0		
1,1,2-Trichloro-1,2,2-trifluoroethane	BUA1112-BLK1	ND	ug/L	0.50		
1,2,4-Trimethylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
1,3,5-Trimethylbenzene	BUA1112-BLK1	ND	ug/L	0.50		
Vinyl chloride	BUA1112-BLK1	ND	ug/L	0.50		
Total Xylenes	BUA1112-BLK1	ND	ug/L	1.0		
t-Amyl Methyl ether	BUA1112-BLK1	ND	ug/L	0.50		
t-Butyl alcohol	BUA1112-BLK1	ND	ug/L	10		
Diisopropyl ether	BUA1112-BLK1	ND	ug/L	0.50		
Ethanol	BUA1112-BLK1	ND	ug/L	250		
Ethyl t-butyl ether	BUA1112-BLK1	ND	ug/L	0.50		
Total Purgeable Petroleum Hydrocarbons	BUA1112-BLK1	ND	ug/L	50		

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

All results listed in this report are for the exclusive use of the submitting party. BC Laboratories, Inc. assumes no responsibility for report alteration, separation, detachment or third party interpretation.



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

Quality Control Report - Method Blank Analysis

Constituent	QC Sample ID	MB Result	Units	PQL	MDL	Lab Quals
QC Batch ID: BUA1112						
1,2-Dichloroethane-d4 (Surrogate)	BUA1112-BLK1	108	%	76 - 114 (LCL - UCL)		
Toluene-d8 (Surrogate)	BUA1112-BLK1	100	%	88 - 110 (LCL - UCL)		
4-Bromofluorobenzene (Surrogate)	BUA1112-BLK1	105	%	86 - 115 (LCL - UCL)		



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

Quality Control Report - Laboratory Control Sample

Constituent	QC Sample ID	Type	Result	Spike Level	Units	Percent Recovery	Control Limits		Lab Quals
							RPD	Percent Recovery	
QC Batch ID: BUA1112									
Benzene	BUA1112-BS1	LCS	24.980	25.000	ug/L	99.9	70 - 130		
Bromodichloromethane	BUA1112-BS1	LCS	28.130	25.000	ug/L	113	70 - 130		
Chlorobenzene	BUA1112-BS1	LCS	26.430	25.000	ug/L	106	70 - 130		
Chloroethane	BUA1112-BS1	LCS	24.930	25.000	ug/L	99.7	70 - 130		
1,4-Dichlorobenzene	BUA1112-BS1	LCS	26.190	25.000	ug/L	105	70 - 130		
1,1-Dichloroethane	BUA1112-BS1	LCS	25.580	25.000	ug/L	102	70 - 130		
1,1-Dichloroethene	BUA1112-BS1	LCS	26.440	25.000	ug/L	106	70 - 130		
Toluene	BUA1112-BS1	LCS	27.170	25.000	ug/L	109	70 - 130		
Trichloroethene	BUA1112-BS1	LCS	27.520	25.000	ug/L	110	70 - 130		
1,2-Dichloroethane-d4 (Surrogate)	BUA1112-BS1	LCS	9.8800	10.000	ug/L	98.8	76 - 114		
Toluene-d8 (Surrogate)	BUA1112-BS1	LCS	10.050	10.000	ug/L	100	88 - 110		
4-Bromofluorobenzene (Surrogate)	BUA1112-BS1	LCS	10.550	10.000	ug/L	106	86 - 115		



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Volatile Organic Analysis (EPA Method 8260)

Quality Control Report - Precision & Accuracy

Constituent	Type	Source Sample ID	Source Result	Result	Spike Added	Units	RPD	Percent Recovery	Control Limits		
									RPD	Percent Recovery	Lab Quals
QC Batch ID: BUA1112		Used client sample: Y - Description: MW-5, 01/17/2011 10:10									
Benzene	MS	1101076-01	ND	24.970	25.000	ug/L		99.9		70 - 130	
	MSD	1101076-01	ND	24.760	25.000	ug/L	0.8	99.0	20	70 - 130	
Bromodichloromethane	MS	1101076-01	ND	27.820	25.000	ug/L		111		70 - 130	
	MSD	1101076-01	ND	26.730	25.000	ug/L	4.0	107	20	70 - 130	
Chlorobenzene	MS	1101076-01	ND	26.310	25.000	ug/L		105		70 - 130	
	MSD	1101076-01	ND	25.620	25.000	ug/L	2.7	102	20	70 - 130	
Chloroethane	MS	1101076-01	ND	25.910	25.000	ug/L		104		70 - 130	
	MSD	1101076-01	ND	25.710	25.000	ug/L	0.8	103	20	70 - 130	
1,4-Dichlorobenzene	MS	1101076-01	ND	24.310	25.000	ug/L		97.2		70 - 130	
	MSD	1101076-01	ND	25.440	25.000	ug/L	4.5	102	20	70 - 130	
1,1-Dichloroethane	MS	1101076-01	ND	25.830	25.000	ug/L		103		70 - 130	
	MSD	1101076-01	ND	25.990	25.000	ug/L	0.6	104	20	70 - 130	
1,1-Dichloroethene	MS	1101076-01	ND	26.500	25.000	ug/L		106		70 - 130	
	MSD	1101076-01	ND	27.830	25.000	ug/L	4.9	111	20	70 - 130	
Toluene	MS	1101076-01	ND	26.390	25.000	ug/L		106		70 - 130	
	MSD	1101076-01	ND	27.210	25.000	ug/L	3.1	109	20	70 - 130	
Trichloroethene	MS	1101076-01	ND	26.690	25.000	ug/L		107		70 - 130	
	MSD	1101076-01	ND	26.910	25.000	ug/L	0.8	108	20	70 - 130	
1,2-Dichloroethane-d4 (Surrogate)	MS	1101076-01	ND	11.170	10.000	ug/L		112		76 - 114	
	MSD	1101076-01	ND	9.4800	10.000	ug/L	16.4	94.8		76 - 114	
Toluene-d8 (Surrogate)	MS	1101076-01	ND	10.100	10.000	ug/L		101		88 - 110	
	MSD	1101076-01	ND	9.9700	10.000	ug/L	1.3	99.7		88 - 110	
4-Bromofluorobenzene (Surrogate)	MS	1101076-01	ND	9.9200	10.000	ug/L		99.2		86 - 115	
	MSD	1101076-01	ND	9.9200	10.000	ug/L	0	99.2		86 - 115	



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

Quality Control Report - Method Blank Analysis

Constituent	QC Sample ID	MB Result	Units	PQL	MDL	Lab Quals
QC Batch ID: BUA1436						
Gasoline Range Organics (C4 - C12)	BUA1436-BLK1	ND	ug/L	50		
a,a,a-Trifluorotoluene (FID Surrogate)	BUA1436-BLK1	104	%	70 - 130 (LCL - UCL)		



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

Quality Control Report - Laboratory Control Sample

Constituent	QC Sample ID	Type	Result	Spike Level	Units	Percent Recovery	Control Limits		Lab Quals
							RPD	Percent Recovery	
QC Batch ID: BUA1436									
Gasoline Range Organics (C4 - C12)	BUA1436-BS1	LCS	891.33	1000.0	ug/L	89.1		85 - 115	
a,a,a-Trifluorotoluene (FID Surrogate)	BUA1436-BS1	LCS	43.714	40.000	ug/L	109		70 - 130	



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Purgeable Aromatics and Total Petroleum Hydrocarbons

Quality Control Report - Precision & Accuracy

Constituent	Type	Source Sample ID	Source Result	Result	Spike Added	Units	RPD	Control Limits			
								Percent Recovery	RPD	Percent Recovery	Lab Quals
QC Batch ID: BUA1436		Used client sample: N									
Gasoline Range Organics (C4 - C12)	MS	1100204-23	ND	877.02	1000.0	ug/L		87.7		70 - 130	
	MSD	1100204-23	ND	897.87	1000.0	ug/L	2.3	89.8	20	70 - 130	
a,a,a-Trifluorotoluene (FID Surrogate)	MS	1100204-23	ND	42.098	40.000	ug/L		105		70 - 130	
	MSD	1100204-23	ND	44.924	40.000	ug/L	6.5	112		70 - 130	



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

Quality Control Report - Method Blank Analysis

Constituent	QC Sample ID	MB Result	Units	PQL	MDL	Lab Quals
QC Batch ID: BUB0070						
Diesel Range Organics (C12 - C24)	BUB0070-BLK1	ND	ug/L	50		
Tetracosane (Surrogate)	BUB0070-BLK1	91.4	%	28 - 139 (LCL - UCL)		



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

Quality Control Report - Laboratory Control Sample

Constituent	QC Sample ID	Type	Result	Spike Level	Units	Percent Recovery	Control Limits		Lab Quals
							Percent Recovery	RPD	
QC Batch ID: BUB0070									
Diesel Range Organics (C12 - C24)	BUB0070-BS1	LCS	469.35	500.00	ug/L	93.9		48 - 125	
Tetracosane (Surrogate)	BUB0070-BS1	LCS	22.363	20.000	ug/L	112		28 - 139	



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22
Project: 7176
Project Number: 4514546263
Project Manager: Anju Farfan

Total Petroleum Hydrocarbons

Quality Control Report - Precision & Accuracy

Constituent	Type	Source Sample ID	Source Result	Result	Spike Added	Units	RPD	Control Limits			
								Percent Recovery	RPD	Percent Recovery	Lab Quals
QC Batch ID: BUB0070		Used client sample: N									
Diesel Range Organics (C12 - C24)	MS	1016633-67	ND	456.38	500.00	ug/L		91.3		36 - 130	
	MSD	1016633-67	ND	441.42	500.00	ug/L	3.3	88.3	30	36 - 130	
Tetracosane (Surrogate)	MS	1016633-67	ND	21.324	20.000	ug/L		107		28 - 139	
	MSD	1016633-67	ND	20.834	20.000	ug/L	2.3	104		28 - 139	



TRC
123 Technology Drive
Irvine, CA 92618

Reported: 02/01/2011 17:22

Project: 7176

Project Number: 4514546263

Project Manager: Anju Farfan

Notes And Definitions

MDL	Method Detection Limit
ND	Analyte Not Detected at or above the reporting limit
PQL	Practical Quantitation Limit
RPD	Relative Percent Difference
A01	PQL's and MDL's are raised due to sample dilution.
A52	Chromatogram not typical of diesel.
S09	The surrogate recovery on the sample for this compound was not within the control limits.

STATEMENTS

Purge Water Disposal

Non-hazardous groundwater produced during purging and sampling of monitoring wells is accumulated at TRC's groundwater monitoring field office at Concord, California, for transportation by a licensed carrier to an authorized disposal facility. Currently, non-hazardous purge water is transported under a bulk non-hazardous waste manifest to Crosby and Overton, Inc. in Long Beach, California.

Limitations

The fluid level monitoring and groundwater sampling activities summarized in this report have been performed under the responsible charge of a California Registered Geologist or Registered Civil Engineer and have been conducted in accordance with current practice and the standard of care exercised by geologists and engineers performing similar tasks in this area. No warranty, express or implied, is made regarding the conclusions and professional opinions presented in this report. The conclusions are based solely upon an analysis of the observed conditions. If actual conditions differ from those described in this report, our office should be notified.