

7/29/00

# CERTIFICATE OF UNDERGROUND STORAGE TANK SYSTEM TESTING

**RECEIVED**

11:45 am, Apr 30, 2009

Alameda County  
Environmental Health



8900 SHOAL CREEK, BUILDING 200  
AUSTIN, TEXAS 78757  
(512) 451-6334  
FAX (512) 459-1459

## TEST RESULT SITE SUMMARY REPORT

TEST TYPE **PTK-88**

PURPOSE **REQUEST**

TEST DATE **04/28/00**

CUSTOMER PO

WORK ORDER NUMBER **2211899**

CLIENT **TOSCO MARKETING COMPANY**

**P.O. BOX 52189**

**PHOENIX, AZ 85072**

SITE **TOSCO 2705191**

**449 HEGENBERGER RD**

**OAKLAND, CA 94621**

**KIM REINHARDT**

**(602) 728-6613**

**JOHN**

**(510) 430-9360**

The following test(s) were conducted at the site above in accordance with all applicable portions of Federal, NFPA and local regulations

### Line and Leak Detector Tests

TANK NUMBER	PRODUCT	VOLUME CHANGE				LINE RESULTS				LEAK DETECTOR		IMPACT VALVES OPERATIONAL	
		A	B	C	D	A	B	C	D	#1	#2		

Tanknology appreciates the opportunity to serve you, and looks forward to working with you in the future. Please call any time, day or night when you need us.

Tanknology representative

**MARK SHAW**

Services conducted by

**ANEIL CHAND**

**RECEIVED**

**MAY 09 2000**

**PHX. SERVICE DEPT**

Reviewed

Technician Certification Number **1262**

# SITE DIAGRAM




8900 SHOAL CREEK, BUILDING 200  
AUSTIN, TEXAS 78757  
(512) 451-6334  
FAX (512) 459-1459

TEST DATE 04/28/00

CLIENT TOSCO MARKETING COMPANY

WORK ORDER NUMBER 2211899

SITE TOSCO 2705191

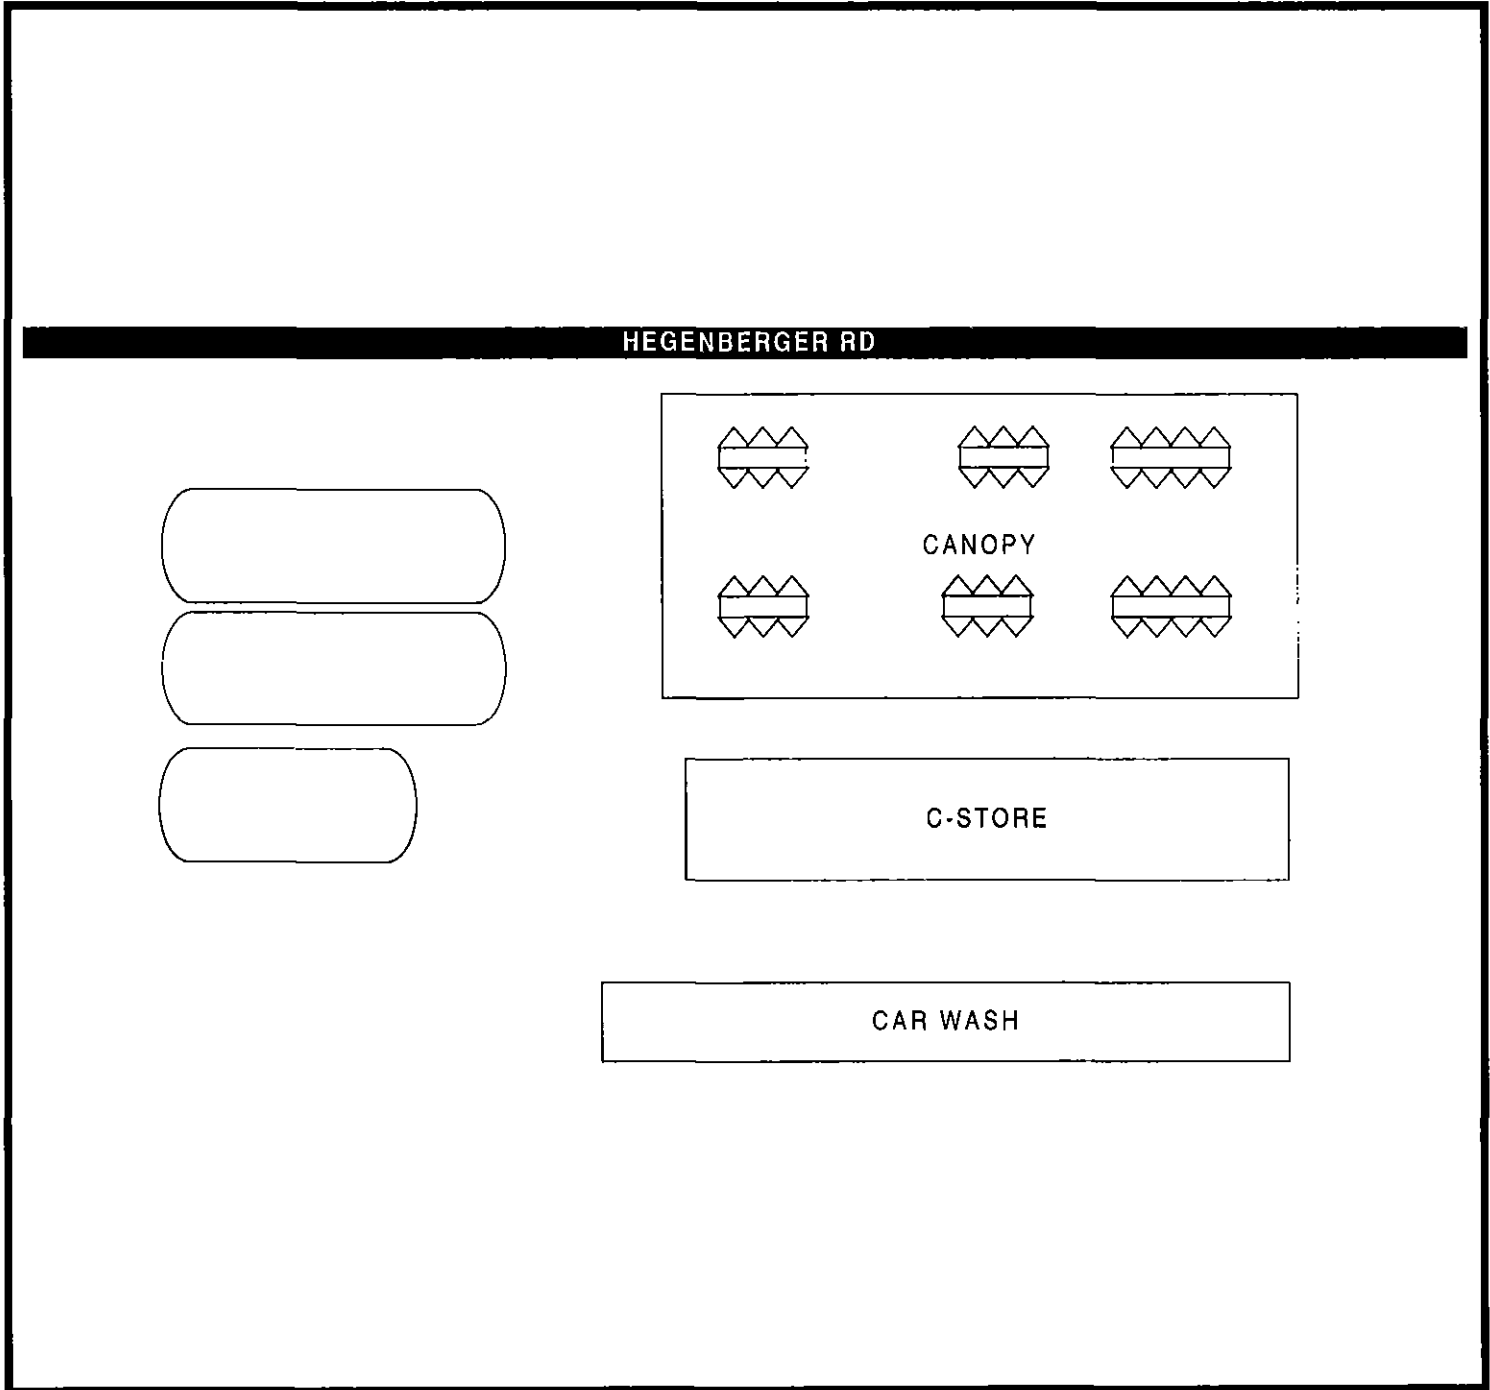

# MONITOR CERTIFICATION FORM

CUSTOMER TOSCO MARKETING COMPANY      SITE ID TOSCO 2705191      DATE 04/28/2000

ADDRESS 449 HEGENBERGER RD  
OAKLAND, CA 94621

WORK ORDER 2211899

**1) IN TANK PROBES**

MANUFACTURER VEEDER ROOT      MODEL NUMBER TLS350

SERIAL NUMBER \_\_\_\_\_      NUMBER OF TANKS MONITORED 3

SET UP FOR MONTHLY TEST (Y/N) NO      LAST TEST DATE 11      PASSED/FAILED \_\_\_\_\_

DOES THE SYSTEM DISPLAY OR PRINT  
 OUT MONTHLY TEST RESULTS ( Y/N ) NO      TYPE (DISPLAY OR PRINT OUT) \_\_\_\_\_

OPERATIONAL ( Y/N ) YES

**COMMENTS**

**NO MECH LEAK DETECTORS TESTED MONITOR CERTIFICATION REQUESTED ONLY**

**2) OTHER PROBES**      MANUFACTURER VEEDER ROOT      MODEL TLS350

PROBE LOCATION	NUMBER OF PROBES	LIQUID, FLOAT SW, OR VAPOR SENSOR	POSITIVE SHUT DOWN (Y/N)	FAIL SAFE ( Y/N )	OPERATIONAL (Y/N)
ANNULAR PROBE	3	FLOAT	NO	NO	YES
TURBINE SUMP	3	FLOAT	NO	NO	YES
FILL SUMP	0				
FIBERTRENCH	0				
MONITORING WELL	0				
DISPENSER PAN	0				
OTHER	0				

ANNULAR SPACE FILLED WITH MONITORING FLUID? DRY

**COMMENTS**

# MONITOR CERTIFICATION FORM (CONT.)

## 3 ) PRODUCT LINE PRESSURE MONITOR

MANUFACTURER \_\_\_\_\_

MODEL \_\_\_\_\_

NUMBER OF SENSORS \_\_\_\_\_

MECH LEAK DETECTOR ( Y/N ) \_\_\_\_\_

MECH LEAK DETECTOR  
OPERATIONAL ( Y/N ) \_\_\_\_\_

DOES THE SYSTEM DISPLAY OR PRINT  
OUT MONTHLY TEST RESULTS ( Y/N ) \_\_\_\_\_

TYPE (DISPLAY OR PRINT OUT) \_\_\_\_\_

DOES THE SYSTEM GO INTO ALARM WITH  
THE SIMULATED LEAK TEST ( Y/N ) \_\_\_\_\_

POSITIVE SHUT DOWN (Y/N) \_\_\_\_\_

OPERATIONAL ( Y/N ) \_\_\_\_\_

## 4 ) OVERALL SYSTEM PERFORMANCE

DOES THE FUEL SYSTEM SHUT DOWN  
WHEN POWER IS SHUT OFF TO  
THE MONITORING PANEL ( Y/N ) YES  
( FAIL SAFE )

DO ALL ALARMS INCLUDE BOTH  
AUDIBLE AND VISUAL ALARMS YES  
( Y/N )

THE MONITORING SYSTEM IS CERTIFIED OPERATIONAL ( Y/N ) YES

ANEIL CHAND  
TECHNICIAN ( PRINT )

  
TECHNICIAN ( SIGNATURE )

COMMENTS

# Summary of Site Data

Critical Data Survey done by ANEIL CHAND

Site Name & ID # TOSCO 2705191

Address 449 HEGENBERGER RD

City, State, Zip OAKLAND, CA 94621

Phone # (510) 430-9360

I verify that the information and diagram are correct

Yes  No

## Site Information

WO#

2211899

	Tank# 1	Tank# 2	Tank# 3	Tank# 4	Tank# 5	Tank# 6	Tank# 7	Tank# 8
Product								
Tank Size								
Tank Diameter								
Tank Material								
Manifolded (Tk #)								
Overfill (Type)								
Overspill (Type)								
Line Material								
Line Secondary Containment								
Mechanical Leak Detection								
Stage I (Type)								
Stage II (Type)								
ATG								
CP								

## Site Diagram

