



**CONESTOGA-ROVERS
& ASSOCIATES**

RECEIVED

2:36 pm, Jun 11, 2008

Alameda County
Environmental Health

5900 Hollis Street, Suite A, Emeryville, California 94608
Telephone: 510-420-0700 Facsimile: 510-420-9170
www.CRAworld.com

June 4, 2008

Mr. Jerry Wickham
Alameda County Environmental Health
1131 Harbor Bay Parkway, Suite 250
Alameda, California 94502

Re: **Groundwater Monitoring Report - First Quarter 2008**
Allright Parking
1432 Harrison Street, Oakland, California
Fuel Leak Case No. RO0000266
CRA Project No. 540188


Dear Mr. Wickham:

On behalf of the Sydney & Barbara Borsuk Trust and Shiela Siegel Trust, Conestoga-Rovers & Associates, Inc. (CRA) is submitting the *Groundwater Monitoring Report - First Quarter 2008*. Presented in this report are a summary of the field activities and a presentation of the results from the first quarter 2008 groundwater monitoring event.

If you have any questions or comments regarding this report, please call me at (510) 420-3307.

Sincerely,

Conestoga-Rovers & Associates, Inc.

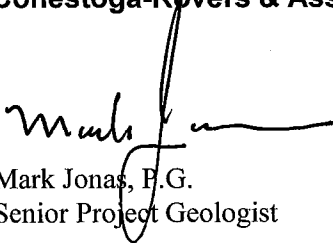

Mark Jonas, P.G.
Senior Project Geologist

Attachments: *Groundwater Monitoring Report - First Quarter 2008*

cc: Sydney and Barbara Borsuk Trust & Sheila Siegel Trust
c/o Mr. Mark Borsuk, 1626 Vallejo Street, San Francisco, CA 94123-5116

Equal
Employment
Opportunity Employer



**CONESTOGA-ROVERS
& ASSOCIATES**

GROUNDWATER MONITORING REPORT – FIRST QUARTER 2008

**Allright Parking
1432 Harrison Street
Oakland, California
Fuel Leak Case No. RO0000266
CRA Project No. 540188**

June 4, 2008

Prepared for:

Sydney & Barbara Borsuk Trust
Sheila Siegel Trust
c/o Mr. Mark Borsuk
1626 Vallejo Street
San Francisco, California 94123-5116


Prepared by:

Conestoga-Rovers & Associates, Inc.
5900 Hollis Street, Suite A
Emeryville, California 94608

Conestoga-Rovers & Associates (CRA) prepared this document for use by our client and appropriate regulatory agencies. It is based partially on information available to CRA from outside sources and/or in the public domain, and partially on information supplied by CRA and its subcontractors. CRA makes no warranty or guarantee, expressed or implied, included or intended in this document, with respect to the accuracy of information obtained from these outside sources or the public domain, or any conclusions or recommendations based on information that was not independently verified by CRA. This document represents the best professional judgment of CRA. None of the work performed hereunder constitutes or shall be represented as a legal opinion of any kind or nature.

Written by:

Christina McClelland
Staff Geologist



Reviewed By:

Mark Jonas, P.G.
Senior Project Geologist



**CONESTOGA-ROVERS
& ASSOCIATES**

GROUNDWATER MONITORING REPORT – FIRST QUARTER 2008

**Allright Parking
1432 Harrison Street, Oakland, California
Fuel Leak Case No. RO000266
CRA Project No. 540188**

June 4, 2008

INTRODUCTION

On behalf of the Sydney & Barbara Borsuk Trust and Shiela Siegal Trust, Conestoga-Rovers & Associates, Inc. (CRA) has prepared this *Groundwater Monitoring Report – First Quarter 2008* for the above-referenced site (see Figure 1). Presented in this report are the first quarter 2008 groundwater monitoring activities and results, and the anticipated second quarter 2008 activities.

Figure 1 is a vicinity map. Figure 2 presents groundwater elevation contours and hydrocarbon concentrations for this monitoring event. Table 1 provides well construction details. Table 2 presents recent and historic well water depth measurements and hydrochemical data, and separate phase hydrocarbon (SPH) measurements and observations. Appendix A contains the field data sheets for the first quarter 2008 monitoring events. Appendix B is the analytical laboratory report for the groundwater sampling event. Appendix C contains benzene concentrations and depth to water time-series graphs.

FIRST QUARTER 2008 ACTIVITIES AND RESULTS

Monitoring Activities

Field Activities: On March 3, 2008, CRA coordinated with Muskan Environmental Sampling (MES) to conduct quarterly monitoring activities. MES gauged groundwater levels and inspected for SPH in all monitoring wells. Groundwater samples were collected from wells MW-1 through MW-6. Groundwater monitoring field data sheets are provided in Appendix A. The groundwater monitoring data has been submitted to the GeoTracker database.

Field activities associated with well sampling included well purging, water quality measurements, sample collection, and equipment decontamination. Prior to sampling, the monitoring wells were purged by repeated bailing using a new, disposable bailer for each well. Field measurements of pH, specific conductance, and temperature of the purged groundwater were measured after extraction of each successive casing volume or at regular volume intervals. Purging of groundwater from each monitoring well continued until at least three casing volumes of water were extracted and consecutive pH,



conductivity, and temperature measurements appeared to stabilize. Field water quality measurements, purge volumes, and sample collection data were recorded on field sampling data forms (Appendix A).

Groundwater samples were collected using disposable bailers. The samples were decanted from the bailers into 40-milliliter (mL) glass volatile organic analysis (VOA) vials supplied by McCampbell Analytical, Inc. (McCampbell) of Pittsburg, California. Immediately after collection, the sample containers were labeled and placed on water-based ice in a cooler. Chain-of-custody procedures were followed from sample collection to transfer to the laboratory (Appendix B).

To minimize the potential for cross-contamination, groundwater monitoring equipment was decontaminated prior to being deployed in the first monitoring well and between successive wells. The probe of the electric well sounder used for water level measurements was rinsed thoroughly with distilled water and Alconox™ detergent prior to first use and between subsequent water level measurements. The disposable bailers were discarded after use at each well.

Sample Analyses: Groundwater samples were analyzed for total petroleum hydrocarbons as gasoline (TPHg) by modified EPA Method 8015; and benzene, toluene, ethylbenzene, and xylenes (BTEX) by EPA Method 8021; and methyl tertiary-butyl ether (MTBE) by EPA Method 8260. All analyses were performed by McCampbell. The laboratory analytical report is included as Appendix B. Hydrocarbon concentrations are summarized on Figure 2 and presented in Table 2. The analytical data were submitted to the GeoTracker database.

Monitoring Results

Groundwater Flow Direction: Based on depth-to-water measurements collected during the March 3, 2008 site visit, groundwater beneath the site apparently flows toward the north-northeast, at a gradient of 0.003 feet/foot. Groundwater flow conditions observed during the first quarter 2008 are consistent with conditions observed during previous monitoring events. Groundwater elevation data is summarized on Figure 2 and presented in Table 2.

Separate Phase Hydrocarbon: No measurable SPH was detected in any of the monitored wells. A sheen was observed by the laboratory in a groundwater sample from monitoring well MW-1. This well has periodically had SPH, both measurable and as a sheen. Groundwater from other wells did not exhibit a sheen.

Hydrocarbon Distribution in Groundwater: Hydrocarbon concentrations were detected in four of the six sampled wells. TPHg concentrations ranged from 63 micrograms per liter ($\mu\text{g/L}$) to 40,000 $\mu\text{g/L}$.



**CONESTOGA-ROVERS
& ASSOCIATES**

Groundwater Monitoring Report - First Quarter 2008
1432 Harrison Street, Oakland, California
June 4, 2008

Benzene concentrations ranged from 0.78 µg/L to 7,700 µg/L. Toluene concentrations ranged from 28 µg/L to 490 µg/L. Ethylbenzene concentrations ranged from 900 µg/L to 1,400 µg/L. Xylenes concentrations ranged from 1,400 µg/L to 4,400 µg/L. All these concentrations were highest in groundwater from monitoring well MW-2. No MTBE was detected in any of the sampled wells. Refer to Table 2 for dissolved hydrocarbon concentrations, and Appendix C for benzene concentration trend graphs for wells MW-1 through MW-6. The unshaded symbols on the graphs represent results below laboratory detection limits.

ANTICIPATED SECOND QUARTER 2008 ACTIVITIES

Monitoring Activities

CRA will coordinate with MES to perform quarterly monitoring activities. MES will gauge all monitoring wells; check wells for SPH; and collect groundwater samples from wells not containing SPH. As per the sampling schedule, wells MW-1, MW-2, MW-4, and MW-5 will be sampled during the second quarter event. Groundwater samples will be analyzed for TPHg by modified EPA Method 8015, BTEX by EPA Method 8021 and MTBE by EPA Method 8260B. Groundwater monitoring and sampling results will be submitted to the State's GeoTracker database. CRA will summarize groundwater monitoring activities and results in the Groundwater Monitoring Report - Second Quarter 2008.

Work Plan

A Work Plan will be submitted for consideration by the regulatory agency for additional characterization of the Site and Alice Street property.



**CONESTOGA-ROVERS
& ASSOCIATES**

Groundwater Monitoring Report - First Quarter 2008
1432 Harrison Street, Oakland, California
June 4, 2008

ATTACHMENTS

Figure 1 – Vicinity Map

Figure 2 – Groundwater Elevation and Hydrocarbon Concentration Map

Table 1 – Well Construction Details

Table 2 – Groundwater Elevations and Analytical Data

Appendix A – Groundwater Monitoring Field Data Sheets

Appendix B – Analytical Results for Groundwater Sampling

Appendix C – Benzene Concentration and Depth to Water Time-Series Graphs

C:\DOCUMENTS AND SETTINGS\MJONAS\MY DOCUMENTS\X TEMP\QMR IQ08 BORSUK, OAKLAND 540188.DOC

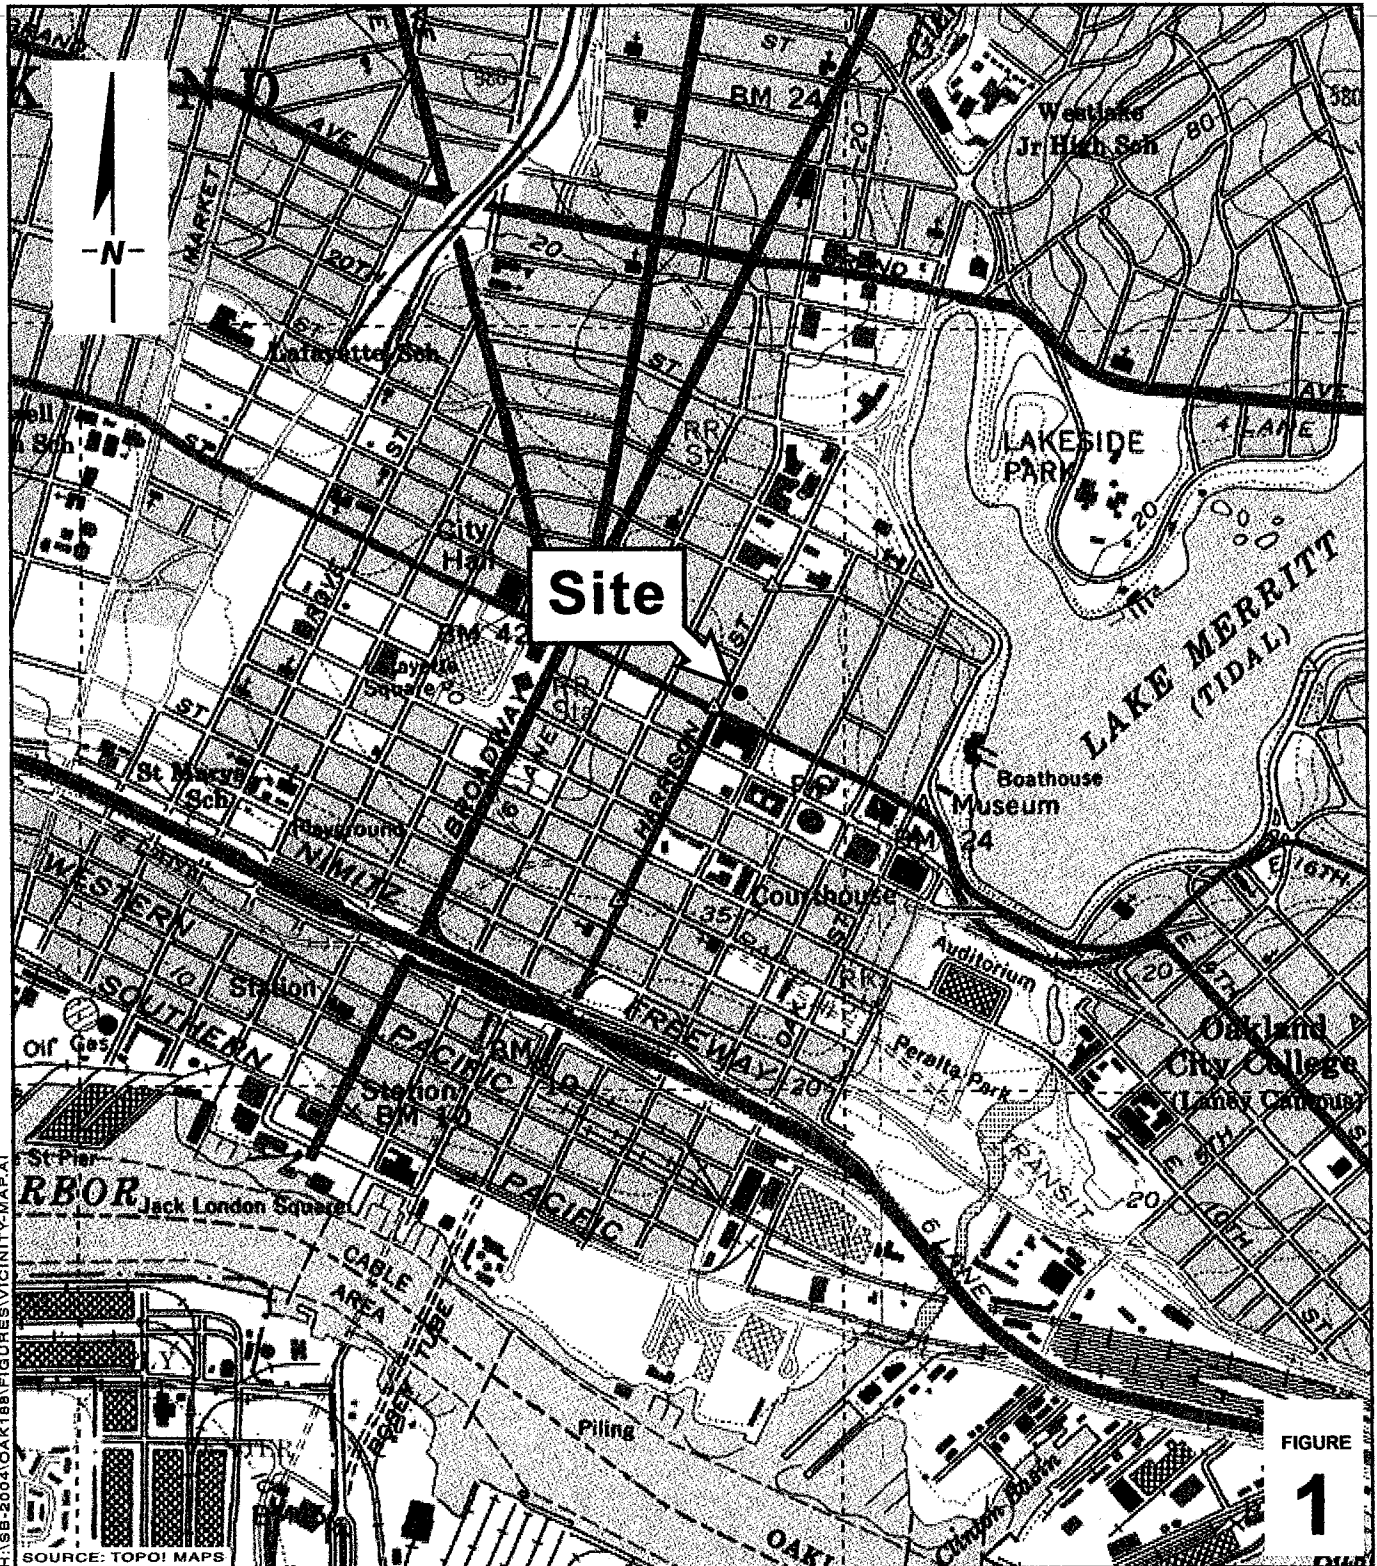


FIGURE 1


0 1/8 1/4 1/2 1 MILE
SCALE 1:1/4

Allright Parking
1432 Harrison Street
Oakland, California



CONESTOGA-ROVERS & ASSOCIATES

Vicinity Map

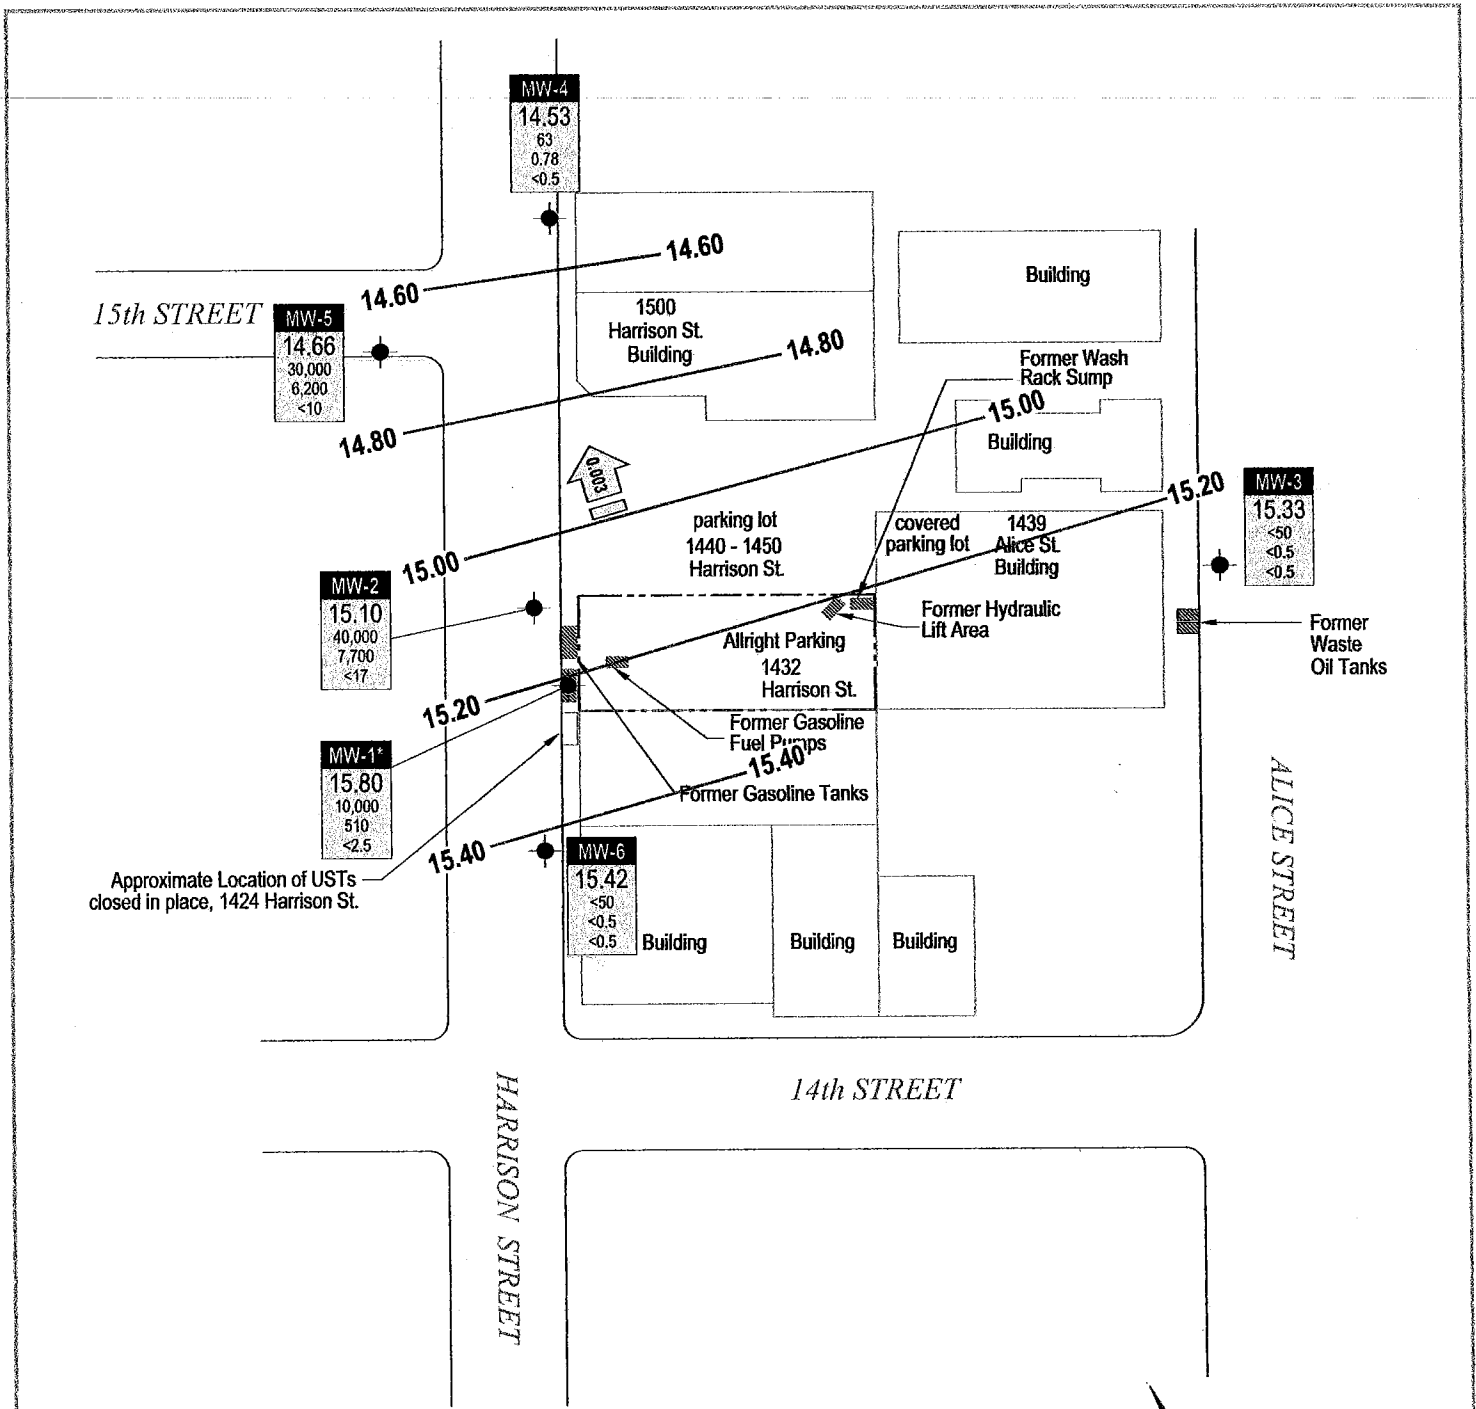

Approximate Location of USTs closed in place, 1424 Harrison St.

EXPLANATION

- Groundwater monitoring well
 - Groundwater elevation contour, in feet above mean sea level (dashed where inferred)
 - Groundwater flow direction and gradient
 - Well designation
 - Groundwater elevation, in feet above mean sea level
 - Hydrocarbons and MTBE in groundwater, in micrograms per liter
- * MW-1 is possibly anomalous

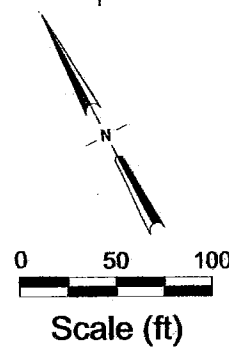


FIGURE **2**

Allright Parking
1432 Harrison Street
Oakland, California



Groundwater Elevation and Hydrocarbon Concentration Map

March 3, 2008

H:\BORSUK\FIGURES\2008\1\CD08.DWG

Conestoga-Rovers & Associates

Table 1. Well Construction Details - Allright Parking, 1432 Harrison Street, Oakland, California

Well No.	Installation Date	Total Depth (ft-bgs)	Boring Diameter (inch)	Well Diameter (inch)	Screen Size (inch)	Screened Interval (ft-bgs)	Sand Pack Interval (ft-bgs)	Surface Seal (ft-bgs)	TOC Elevation (ft-msl)
MW-1	1/12/1994	27	12	4	0.020	16-26.5	14.5-27	0-14.5	35.37*
MW-2	7/30/1994	26		2	0.010	11-26	9-26	0-9	35.21
MW-3	7/30/1994	25		2	0.010	15-25	13-25	0-13	34.01
MW-4	10/2/1996	25	8	2	0.010	15-25	13-25	0-13	33.75
MW-5	10/2/1996	30	8	2	0.010	14-29	12-30	0-12	34.63
MW-6	10/2/1996	30.5	8	2	0.010	14-29	30-Dec	0-12	35.89
VES-1 (VE)	7/23/1999	30	8	3	0.020	5-20	4.5-20	0-5	-
VES-1 (AS)				1	0.020	28-30	27.5-30	0-27.5	-
VES-2 (VE)	7/22/1999	29.5	8	3	0.020	5-20	4-20	0-4	-
VES-2 (AS)				1	0.020	27.5-29.5	27-29.5	0-27	-
VES-3 (VE)	7/23/1999	30	8	3	0.020	5-20	4-20	0-4	-
VES-3 (AS)				1	0.020	28-30	25-30	0-25	-
VES-4 (VE)	7/23/1999	29	8	3	0.020	5-20	4-20	0-4	-
VES-4 (AS)				1	0.020	27-29	26.5-28.5	0-26.5	-

ft-bgs feet below ground surface
 ft-msl feet above mean sea level

Conestoga-Rovers & Associates

Table 2. Groundwater Elevations and Analytical Data - Allright Parking, 1432 Harrison Street, Oakland, California

Well ID Sample ID TOC (ft amsl)	Date	Depth to Groundwater (ft below TOC)	SPH Thickness (feet)	Groundwater Elevation (ft amsl)	TOC (μg/L)					MTBE	Notes
					TPHg	Benzene	Toluene	Ethylbenzene	Xylenes		
MW-2 (cont.) 35.21	12/23/1998	19.67	--	15.51	180,000	16,000	22,000	2,200	8,300	--	--
	3/29/1999	18.97	--	16.21	16,600	1,380	1,920	373	1,840	--	--
	6/23/1999	18.25	--	16.93	41,000	10,000	9,400	1,100	5,000	--	--
	9/24/1999	19.60	--	15.58	40,600	4,880	3,490	1,090	4,560	--	--
	12/23/1999	20.21	--	14.97	61,900	6,710	9,320	1,150	5,360	--	--
	3/21/2000	18.93	--	16.25	98,000	14,000	21,000	1,600	6,900	<1600	a
	7/3/2000	19.38	--	15.80	140,000	18,000	33,000	2,600	11,000	<200*	a
	9/7/2000	19.83	--	15.35	110,000	17,000	21,000	2,200	9,700	<100***	a,l
	12/5/2000	20.30	--	14.88	130,000	19,000	28,000	2,500	11,000	<200	a
	3/6/2001	19.57	--	15.61	32,000	3,400	3,400	580	2,500	<200	a
	6/8/2001	20.59	--	14.59	72,000	9,400	9,200	1,300	5,800	<200	a
	8/27/2001	21.79	--	13.39	110,000	17,000	28,000	2,600	11,000	<950	a
	10/25/2001	22.05	--	13.13	110,000	15,000	18,000	2,000	8,700	<350	a
	3/1/2002	21.80	--	13.38	3,100	370	180	62	330	<5.0*	a
	6/10/2002	22.83	--	12.35	7,800	2,000	1,100	76	570	<100*	a
	9/3/2002	22.03	--	13.18	21,000	2,400	2,900	320	1,400	<500	a
	12/22/2002	22.70	--	12.51	630	48	56	19	82	<5.0	a
	1/23/2003	20.49	--	14.72	1,100	27	32	19	150	<25	a
	6/12/2003	21.03	--	14.18	10,000	2,100	1,600	150	660	<250	a
	7/23/2003	21.40	--	13.81	28,000	4,800	4,800	380	1,700	<500	a
	12/22/2003	19.33	--	15.88	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
	3/10/2004	19.33	--	15.88	3,100	460	290	38	240	<50	a
	6/16/2004	19.90	--	15.31	9,100	1,600	1,200	220	830	<400	a
	9/27/2004	22.08	--	13.13	14,000	2,800	490	340	1,600	<350	a
	12/22/2004	21.74	--	13.47	1,100	300	28	22	71	<15	a
	3/3/2005	19.60	--	15.61	340	12	4.4	9.1	28	<10	a
	6/9/2005	18.65	--	16.56	240	22	2.7	6.4	27	<10	a
	9/9/2005	19.27	--	15.94	7,800	1,100	170	380	690	<160	a
	12/20/2005	19.70	--	15.51	150	10	1.9	2.8	10	<5.0	a
	3/26/2006	18.51	--	16.70	2,200	93	19	66	130	<50	a
	6/23/2006	18.47	--	16.74	8,800	1,600	110	500	480	<500	a,m
9/7/2006	18.97	--	16.24	29,000	4,800	280	940	1,000	<500	a	
12/29/2006	19.76	--	15.45	4,500	720	54	250	480	75+1/<0.5***	a	
3/21/2007	19.59	--	15.62	34,000	9,100	500	890	2,500	<1,100*	a	
6/7/2007	19.74	Sheen ^{lab}	15.47	46,000	7,100	410	870	2,400	<800*	a,b	
9/28/2007	20.23	--	14.98	44,000	9,400	630	1,400	3,600	<0.5***	a	
12/9/2007	20.68	--	14.53	37,000	8,400	550	1,400	4,500	<17***	a,l	
3/3/2008	20.11	--	15.10	40,000	7,700	490	1,400	4,400	<17***	a,l	
MW-3 33.97	8/1/1994	--	--	--	<50	<0.5	<0.5	<0.5	<2.0	--	--
	12/21/1994	18.82	--	15.15	<50	<0.5	<0.5	<0.5	<0.5	--	--
	3/13/1995	17.86	--	16.11	<50	<0.5	<0.5	<0.5	<0.5	--	e
	7/7/1995	18.25	--	15.72	--	--	--	--	--	--	f,g
	9/28/1995	18.00	--	15.97	--	--	--	--	--	--	h
	12/20/1995	18.74	--	15.23	--	--	--	--	--	--	--
	3/26/1996	18.25	--	15.72	--	--	--	--	--	--	--
	6/20/1996	18.35	--	15.62	--	--	--	--	--	--	--
	9/26/1996	19.12	--	14.85	--	--	--	--	--	--	--
	10/28/1996	19.11	--	14.86	--	--	--	--	--	--	--
	12/12/1996	18.61	--	15.36	--	--	--	--	--	--	--
	3/31/1997	18.35	--	15.62	--	--	--	--	--	--	--
	6/27/1997	18.81	--	15.16	--	--	--	--	--	--	--
	9/9/1997	19.18	--	14.79	--	--	--	--	--	--	--
	12/18/1997	18.64	--	15.33	--	--	--	--	--	--	--
	3/12/1998	17.56	--	16.41	--	--	--	--	--	--	--
	6/22/1998	18.64	--	15.33	--	--	--	--	--	--	--
	9/18/1998	18.33	--	15.64	--	--	--	--	--	--	--
	12/23/1998	18.60	--	15.37	--	--	--	--	--	--	--
	3/29/1999	17.85	--	16.12	--	--	--	--	--	--	--
	6/23/1999	18.67	--	15.30	--	--	--	--	--	--	--
	9/24/1999	18.64	--	15.33	--	--	--	--	--	--	--
	12/23/1999	19.32	--	14.65	--	--	--	--	--	--	--
	3/21/2000	17.89	--	16.08	--	--	--	--	--	--	--
	7/3/2000	18.40	--	15.57	--	--	--	--	--	--	--
	9/7/2000	18.75	--	15.22	--	--	--	--	--	--	--
	34.01	12/5/2000	19.03	--	14.94	<50	<0.5	<0.5	<0.5	<0.5	<5.0
3/6/2001		18.12	--	15.85	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
6/8/2001		20.02	--	13.95	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
8/27/2001		21.09	--	12.88	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
10/25/2001		21.29	--	12.68	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
3/1/2002		21.14	--	12.83	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	--
6/10/2002		21.99	--	11.98	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	--
9/3/2002		21.17	--	12.84	--	--	--	--	--	--	--
12/22/2002		21.94	--	12.07	--	--	--	--	--	--	--
1/23/2003		20.08	--	13.93	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
6/12/2003		20.95	--	13.06	--	--	--	--	--	--	--
7/23/2003		21.28	--	12.73	--	--	--	--	--	--	--
12/22/2003	19.05	--	14.96	--	--	--	--	--	--	--	

Conestoga-Rovers & Associates

Table 2. Groundwater Elevations and Analytical Data - Allright Parking, 1432 Harrison Street, Oakland, California

Well ID Sample ID TOC (ft amsl)	Date	Depth to Groundwater (ft below TOC)	SPH Thickness (feet)	TOC Groundwater Elevation (ft amsl)	TPHg	Benzene	Toluene	Ethylbenzene	Xylenes	MTBE	Notes
MW-3 (cont.)	3/10/2004	18.22	--	15.79	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
	6/16/2004	18.82	--	15.19	--	--	--	--	--	--	--
	9/27/2004	21.03	--	12.98	--	--	--	--	--	--	--
	12/22/2004	20.69	--	13.32	--	--	--	--	--	--	--
	3/3/2005	17.94	--	16.07	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
	6/9/2005	18.00	--	16.01	--	--	--	--	--	--	--
	9/9/2005	18.43	--	15.58	--	--	--	--	--	--	--
	12/20/2005	18.18	--	15.83	--	--	--	--	--	--	--
	3/26/2006	17.42	--	16.59	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
	6/23/2006	17.77	--	16.24	--	--	--	--	--	--	--
	9/7/2006	18.20	--	15.81	--	--	--	--	--	--	--
	12/29/2006	18.49	--	15.52	--	--	--	--	--	--	--
	3/21/2007	18.44	--	15.57	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	--
	6/7/2007	18.68	--	15.33	--	--	--	--	--	--	--
	9/28/2007	19.19	--	14.82	--	--	--	--	--	--	--
	12/9/2007	19.31	--	14.70	--	--	--	--	--	--	--
3/3/2008	18.68	--	15.33	<50	<0.5	<0.5	<0.5	<0.5	<0.5***	--	
MW-4 33.75	10/28/1996	19.32	--	14.43	10,000	3,900	420	400	360	<200*	n
	12/12/1996	19.42	--	14.33	11,000	4,200	410	420	260	32*	--
	3/31/1997	18.67	--	15.08	ND	ND	ND	ND	ND	ND*	--
	6/27/1997	19.08	--	14.67	160	49	1.2	ND	5.9	ND*	--
	9/9/1997	19.33	--	14.42	7,400	5,000	410	230	470	33*	--
	12/18/1997	19.17	--	14.58	710	170	8.0	ND	39	ND***	--
	3/12/1998	17.68	--	16.07	1,300	410	21	ND	57	ND***	--
	6/22/1998	17.63	--	16.12	ND	ND	ND	ND	ND	--	--
	9/18/1998	18.58	--	15.17	ND	42	1.6	ND	4.8	--	--
	12/23/1998	19.01	--	14.74	1,900	1,000	76	50	120	--	--
	3/29/1999	18.35	--	15.40	ND	ND	ND	ND	ND	--	--
	6/23/1999	17.58	--	16.17	ND	ND	ND	ND	ND	--	--
	9/24/1999	19.05	--	14.70	9,150	3,270	131	34	537	--	--
	12/23/1999	19.41	--	14.34	12,200	5,360	275	424	592	--	--
	3/21/2000	18.42	--	15.33	45,000	16,000	1,100	1,400	1,900	1400*/<35***	a,l
	7/3/2000	18.82	--	14.93	33,000	10,000	720	840	1,800	<200*	a
	9/7/2000	19.21	--	14.54	26,000	8,800	800	740	1,500	<50***	a,c,l
	12/5/2000	19.60	--	14.15	41,000	11,000	840	930	1,900	<200	a
	3/6/2001	18.24	--	15.51	1,100	400	5.7	<0.5	20	<5.0	a
	6/8/2001	20.91	--	12.84	92	19	<0.5	<0.5	1	<5.0	a
	8/27/2001	21.63	--	12.12	49,000	17,000	1700	1,700	3,200	<260	a
	10/25/2001	21.70	--	12.05	57,000	16,000	1,500	1,600	2,600	<300	a
	3/1/2002	21.53	--	12.22	400	140	2.3	<0.5	12	<5.0*	a
	6/10/2002	22.23	--	11.52	<50	2.5	<0.5	<0.5	<0.5	<5.0*	--
	9/3/2002	21.85	--	11.90	31,000	9,700	300	650	1,100	<1,000	a
	12/22/2002	22.39	--	11.36	35,000	13,000	310	1,100	1,800	<1,500	a
	1/23/2003	20.61	--	13.14	51,000	18,000	430	1,500	2,200	<5.0***	a,l
	6/12/2003	21.20	--	12.55	80	12	<0.5	<0.5	1.0	<10	a
	7/23/2003	21.51	--	12.24	20,000	7,600	100	65	660	<250	a
	12/22/2003	19.60	--	14.15	26,000	9,500	200	380	1,100	<150	a
3/10/2004	18.81	--	14.94	14,000	4,800	150	320	530	<400	a	
6/16/2004	19.32	--	14.43	2,800	1,100	24	17	100	<50	a	
9/27/2004	21.45	--	12.30	45,000	16,000	260	1,700	2,000	<25***	a	
12/22/2004	21.15	--	12.60	29,000	10,000	160	890	1,200	<5.0***	aj	
3/3/2005	18.60	--	15.15	18,000	6,400	98	500	610	<600	a	
6/9/2005	18.11	--	15.64	20,000	6,100	110	460	580	<500	a	
9/9/2005	18.65	--	15.10	17,000	6,400	100	470	730	<250	a	
12/20/2005	19.01	--	14.74	26,000	8,500	160	640	800	<120	a	
3/26/2006	17.84	--	15.91	1,900	700	22	49	85	<50	a	
6/23/2006	17.96	--	15.79	12,000	3,400	130	370	510	260	a	
9/7/2006	18.29	--	15.46	8,600	1,800	100	170	220	<210	a,i	
12/29/2006	18.93	--	14.82	4,200	1,100	120	150	280	<150*/<0.5***	a	
3/21/2007	18.76	--	14.99	550	30	2.0	4.5	5.1	<30*	a	
6/7/2007	18.92	--	14.83	85	4.4	<0.5	0.77	0.82	<5.0*	a	
9/28/2007	19.41	--	14.34	140	7.0	<0.5	1.2	<0.5	<0.5***	a	
12/9/2007	19.86	--	13.89	120	4.5	<0.5	0.62	<0.5	<0.5	a	
3/3/2008	19.22	--	14.53	63	0.78	<0.5	<0.5	<0.5	<0.5***	i	
MW-5 34.63	10/28/1996	19.88	--	14.75	90	4.0	0.6	<0.50	<0.50	16*	--
	12/12/1996	20.09	--	14.54	230	5.6	0.9	ND	0.9	3.6*	n
	3/31/1997	19.24	--	15.39	90	3.1	ND	ND	ND	ND*	--
	6/27/1997	19.16	--	15.47	ND	ND	ND	ND	ND	ND*	--
	9/9/1997	19.93	--	14.70	ND	ND	ND	ND	ND	ND*	--
	12/18/1997	19.77	--	14.86	ND	ND	ND	ND	ND	ND***	--
	3/12/1998	19.77	--	14.86	79	2.3	ND	0.8	ND	ND*	--
	6/22/1998	18.08	--	16.55	ND	ND	ND	ND	ND	--	--
	9/18/1998	19.12	--	15.51	ND	ND	ND	ND	ND	--	--
	12/23/1998	19.60	--	15.03	ND	0.8	0.9	ND	ND	--	--
	3/29/1999	18.88	--	15.75	ND	ND	ND	ND	ND	--	--
6/23/1999	18.05	--	16.58	ND	ND	ND	ND	ND	--	--	

Conestoga-Rovers & Associates

Table 2. Groundwater Elevations and Analytical Data - Allright Parking, 1432 Harrison Street, Oakland, California

Well ID Sample ID TOC (ft amsl)	Date	Depth to Groundwater (ft below TOC)	SPH Thickness (feet)	TOC	TPHg	Benzene	Toluene (µg/L)	Ethylbenzene	Xylenes	MTBE	Notes	
				Groundwater Elevation (ft amsl)								
MW-5 (cont.)	9/24/1999	19.61	--	15.02	ND	ND	ND	ND	ND	--	--	
	12/23/1999	20.01	--	14.62	ND	ND	ND	ND	ND	--	--	
	3/21/2000	19.05	--	15.58	140	<0.5	<0.5	<0.5	<0.5	<5.0	--	
	7/3/2000	19.40	--	15.23	85	8.1	3.1	1.6	7.8	<5.0*	k	
	9/7/2000	19.62	--	15.01	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	a	
	12/5/2000	20.25	--	14.38	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
	3/6/2001	19.07	--	15.56	91	5.5	<0.5	<0.5	<0.5	<5.0	--	
	6/8/2001	20.77	--	13.86	290	22.0	0.8	<0.5	<0.5	<5.0	--	
	8/27/2001	21.33	--	13.30	660	24.0	2.2	1.3	4.0	<25	a	
	10/25/2001	21.62	--	13.01	55	3.5	<0.5	<0.5	<0.5	<5.0	a	
	3/1/2002	21.49	--	13.14	200	1.9	0.69	<0.5	<0.5	<5.0*	a	
	6/10/2002	22.15	--	12.48	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	a	
	9/3/2002	21.50	--	13.13	60	1.9	<0.5	<0.5	0.77	<5.0	--	
	12/22/2002	22.19	--	12.44	82	0.57	<0.5	0.68	<0.5	<5.0	a	
	1/23/2003	20.27	--	14.36	<50	2.1	<0.5	<0.5	<0.5	<5.0	a	
	6/12/2003	21.10	--	13.53	<50	0.88	<0.5	<0.5	<0.5	<5.0	--	
	7/23/2003	21.47	--	13.16	<50	4.0	<0.5	<0.5	<0.5	<5.0	--	
	12/22/2003	19.57	--	15.06	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
	3/10/2004	19.61	--	15.02	990	200	2.9	4.0	20	<70	--	
	6/16/2004	20.15	--	14.48	250	42	<0.5	0.88	<0.5	<35	a	
	9/27/2004	22.14	--	12.49	1,600	140	4.8	45	18	<110	a	
	12/22/2004	21.81	--	12.82	<50	5.3	<0.5	<0.5	0.66	<5.0	--	
	3/3/2005	19.35	--	15.28	2,000	330	4.4	63	39	<150	a	
	6/9/2005	18.73	--	15.90	250	42	1.4	14	3.2	<5.0	a	
	9/9/2005	19.30	--	15.33	2,000	390	5.0	71	38	<400	a	
	12/20/2005	19.65	--	14.98	4,300	760	18	170	150	<35	a	
	3/26/2006	18.58	--	16.05	1,600	460	3.3	35	32	<50	a	
	6/23/2006	18.57	--	16.06	1,900	500	3.9	81	56	<17	a	
	9/7/2006	18.98	--	15.65	8,800	1,900	12	350	220	<260	a,i	
	12/29/2006	19.70	--	14.93	15,000	3,400	69	610	700	<450*/<0.5***	a	
	3/21/2007	19.57	--	15.06	9,900	2,300	24	360	410	<240*	a	
	6/7/2007	19.70	--	14.93	14,000	3,800	40	790	720	<550*	a	
	9/28/2007	20.16	--	14.47	26,000	7,200	84	1,100	1,600	<25***	a,l	
	12/9/2007	20.56	--	14.07	25,000	7,000	59	1,100	2,900	<17	a,l	
	3/3/2008	19.97	--	14.66	30,000	6,200	31	900	1,400	<10***	a,l	
	MW-6 35.89 (annual sampling)	10/28/1996	20.02	--	15.87	<50	<0.50	<0.50	<0.50	<0.50	<2.0*	
		12/12/1996	20.18	--	15.71	ND	ND	ND	ND	ND	ND*	n
		3/31/1997	19.81	--	16.08	--	--	--	--	--	--	--
		6/27/1997	19.76	--	16.13	--	--	--	--	--	--	--
		9/9/1997	20.06	--	15.83	ND	ND	ND	ND	ND	ND*	--
		12/18/1997	19.90	--	15.99	ND	ND	ND	ND	ND	ND	--
		3/12/1998	18.00	--	17.89	ND	ND	ND	ND	ND	ND*	--
		6/22/1998	18.43	--	17.46	ND	ND	ND	ND	ND	ND	--
		9/18/1998	19.10	--	16.79	ND	ND	ND	ND	ND	ND	--
		12/23/1998	19.61	--	16.28	ND	ND	ND	ND	ND	ND	--
		3/29/1999	18.92	--	16.97	ND	ND	ND	ND	ND	ND	--
		6/23/1999	18.41	--	17.48	ND	ND	ND	ND	ND	ND	--
		9/24/1999	19.61	--	16.28	ND	ND	ND	ND	ND	ND	--
		12/23/1999	20.30	--	15.59	ND	ND	ND	ND	ND	ND	--
		3/21/2000	18.97	--	16.92	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--
7/3/2000		19.46	--	16.43	59	5.1	2.3	1.1	5.3	<5.0*	--	
9/7/2000		19.95	--	15.94	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	a	
12/5/2000		20.50	--	15.39	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
3/6/2001		19.54	--	16.35	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
6/8/2001		20.92	--	14.97	<50	<0.5	<0.5	<0.5	<0.5	<5.1	--	
8/27/2001		21.37	--	14.52	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
10/25/2001		21.59	--	14.30	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
3/1/2002		21.33	--	14.56	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	--	
6/10/2002		21.97	--	13.92	<50	<0.5	<0.5	<0.5	<0.5	<5.0*	--	
9/3/2002		21.55	--	14.34	--	--	--	--	--	--	--	
12/22/2002		22.25	--	13.64	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
1/23/2003		20.47	--	15.42	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
6/12/2003		21.09	--	14.80	--	--	--	--	--	--	--	
7/23/2003		21.42	--	14.47	--	--	--	--	--	--	--	
12/22/2003		19.49	--	16.40	--	--	--	--	--	--	--	
3/10/2004		20.20	--	15.69	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--	
6/16/2004		20.73	--	15.16	--	--	--	--	--	--	--	
9/27/2004	22.88	--	13.01	--	--	--	--	--	--	--		
12/22/2004	22.53	--	13.36	--	--	--	--	--	--	--		
3/3/2005	19.87	--	16.02	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--		
6/9/2005	18.95	--	16.94	--	--	--	--	--	--	--		
9/9/2005	19.45	--	16.44	--	--	--	--	--	--	--		
12/20/2005	19.90	--	15.99	--	--	--	--	--	--	--		
3/26/2006	18.85	--	17.04	<50	<0.5	<0.5	<0.5	<0.5	<5.0	--		
6/23/2006	18.57	--	17.32	--	--	--	--	--	--	--		
9/7/2006	19.13	--	16.76	--	--	--	--	--	--	--		
12/29/2006	19.96	--	15.93	--	--	--	--	--	--	--		

Conestoga-Rovers & Associates

Table 2. Groundwater Elevations and Analytical Data - Allright Parking, 1432 Harrison Street, Oakland, California

Well ID Sample ID TOC (ft amsl)	Date	Depth to Groundwater (ft below TOC)	SPH Thickness (feet)	TOC Groundwater Elevation (ft amsl)	TPHg	Benzene Toluene Ethylbenzene Xylenes					MTBE	Notes
						(µg/L)						
MW-6	3/21/2007	19.87	--	16.02	<50	<0.5	<0.5	<0.5	<0.5	<0.5	<5.0*	m
(cont.)	6/7/2007	20.05	--	15.84	--	--	--	--	--	--	--	--
	9/28/2007	20.51	--	15.38	--	--	--	--	--	--	--	--
	12/9/2007	20.90	--	14.99	--	--	--	--	--	--	--	--
	3/3/2008	20.47	--	15.42	<50	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5***	--
Trip Blank	3/21/2000	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<0.5	<5.0	--
	9/7/2000	--	--	--	<50	<0.5	<0.5	<0.5	<0.5	<0.5	<5.0	--
Grab Groundwater Sample Results:												
SB-A	7/6/1995	~20	--	--	330	16	3.6	1.3	4.9	--	--	ij
SB-B	7/7/1995	~20	--	--	450	55	3.1	5.1	5.0	--	--	a
SB-C	7/6/1995	~20	--	--	44,000	6,600	5,900	980	4,400	--	--	a
SB-D	7/6/1995	~20	--	--	70,000	7,400	10,000	1,600	7,200	--	--	a
SB-E	7/6/1995	~20	--	--	25,000	1,000	3,000	610	2,700	--	--	a
SB-G	7/7/1995	~20	--	--	84,000	9,400	16,000	2,200	9,900	--	--	a,b
SB-I	7/7/1995	~20	--	--	24,000	6,100	1,400	680	1,600	--	--	a
SB-J	7/7/1995	~20	--	--	960	110	66	8.7	71	--	--	a
SB-K	7/7/1995	~20	--	--	72,000	9,600	9,600	1,800	7,000	--	--	a
CB-1-W	7/22/1999	--	--	--	110,000	1,300	16,000	2,700	12,000	<3000*	--	a,b,c
CB-2-W	7/22/1999	--	--	--	4,700	21	13	170	76	<50*	--	a,c

Abbreviations, Methods, & Notes

TOC = Top of casing elevation

ft amsl = feet above mean sea level

SPH = Separate-phase hydrocarbons

TPHg = Total petroleum hydrocarbons as gasoline by modified EPA Method SW8015C

Benzene, toluene, ethylbenzene, and xylenes by EPA Method SW8021B

MTBE = Methyl tert-butyl ether

* = MTBE by EPA Method SW8021B

** = MTBE by EPA Method SW8240

*** = MTBE by EPA Method SW8260

l = Not confirmed with EPA method 8260B.

µg/L = micrograms per liter, equivalent to parts per billion

-- = Not sampled, not analyzed, not applicable, or no SPH was measured or observed

<n = Not detected in sample above n µg/L

ND = Not detected above laboratory detection limit

x = Groundwater elevation adjusted for SPH by the relation:

Groundwater Elevation = TOC Elevation - Depth to Groundwater + (0.7 x SPH thickness)

= The wellhead elevation was raised by 0.41 feet when well MW-1 was connected to

the SVE system on October 31, 2003.

= The wellhead elevation was lowered by 0.41 feet when well MW-1 was disconnected from the SVE system on April

30, 2005.

+ = Well de-watered during purging, no measurable water to sample.

Sheen = A sheen was observed on the water's surface

Field = Observed in the field

Lab = Observed in analytical laboratory

a = Unmodified or weakly modified gasoline is significant.

b = Lighter than water immiscible sheen is present.

c = Liquid sample that contains greater than ~2 vol. % sediment.

d = MTBE result confirmed by secondary column or GC/MS analysis.

e = Sample analyzed for purgeable hydrocarbons by EPA Method SW8010,

no purgeable hydrocarbons were detected.

f = Sample analyzed for VOCs by EPA Method SW8240, no non-BTEX compounds were detected.

g = Sample analyzed for Total Petroleum Hydrocarbons as motor oil (TPHmo) by

Modified EPA Method SW8015, no TPHmo was detected.

h = Analytic sampling discontinued. Approved by Alameda County Department of

Environmental Health.

i = Lighter gasoline range compounds are significant.

j = Gasoline range compounds having broad chromatographic peaks are significant.

k = No recognizable pattern.

l = Sample diluted due to high organic content.

m = Liquid sample that contains greater than ~1 vol. % sediment.

n = TOC well elevation was increased by 3 ft based on a benchmark discrepancy discovered

during a well survey performed on September 11, 2002



CONESTOGA-ROVERS
& ASSOCIATES

APPENDIX A
Field Data Sheet

WELL GAUGING SHEET

Client: Conestoga-Rovers and Associates

Site Address: 1432 Harrison Street, Oakland, CA

Date: 3/3/2008 **Signature:**

Well ID	Time	Depth to SPH	Depth to Water	SPH Thickness	Depth to Bottom	Comments
MW-1	9:45		19.16		20.46	
MW-2	9:40		20.11		25.57	
MW-3	9:20		18.68		23.95	
MW-4	9:30		19.22		24.48	
MW-5	9:35		19.97		27.90	
MW-6	9:25		20.47		28.25	

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-1				
Well Diameter:		4"				
Purging Device:		NO PURGE				
Sampling Method:		Disposable Bailer				
Total Well Depth:		20.46	Fe= mg/L			
Depth to Water:		19.16	ORP= mV			
Water Column Height:		1.30	DO= mg/L			
Gallons/ft:		0.65				
1 Casing Volume (gal):		0.85	COMMENTS: NO PURGE SAMPLE, very turbid, very silty			
3 Casing Volumes (gal):		2.54				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-1	3/3/2008	11:40	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
Signature:						

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-2				
Well Diameter:		2"				
Purging Device:		Disposable Bailer				
Sampling Method:		Disposable Bailer				
Total Well Depth:		25.57	Fe= mg/L			
Depth to Water:		20.11	ORP= mV			
Water Column Height:		5.46	DO= mg/L			
Gallons/ft:		0.16				
1 Casing Volume (gal):		0.87	COMMENTS: very turbid, very silty			
3 Casing Volumes (gal):		2.62				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
11:20	0.9	21.0	7.09	1125		
11:22	1.7	21.2	7.07	1161		
11:25	2.6	21.2	7.06	1147		
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-2	3/3/2008	11:30	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
				Signature:		

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-3				
Well Diameter:		2"				
Purging Device:		Disposable Bailer				
Sampling Method:		Disposable Bailer				
Total Well Depth:		23.95	Fe= mg/L			
Depth to Water:		18.68	ORP= mV			
Water Column Height:		5.27	DO= mg/L			
Gallons/ft:		0.16				
1 Casing Volume (gal):		0.84	COMMENTS: very turbid, silty			
3 Casing Volumes (gal):		2.53				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
10:05	0.8	18.8			7.40	1170
10:07	1.7	18.0	7.41	1204		
10:10	2.5	18.8	7.48	1218		
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-3	3/3/2008	10:15	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
Signature:						

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-4				
Well Diameter:		2"				
Purging Device:		Disposable Bailer				
Sampling Method:		Disposable Bailer				
Total Well Depth:		24.48	Fe= mg/L			
Depth to Water:		19.22	ORP= mV			
Water Column Height:		5.26	DO= mg/L			
Gallons/ft:		0.16				
1 Casing Volume (gal):		0.84	COMMENTS: very turbid, silty			
3 Casing Volumes (gal):		2.52				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
10:45	0.8	19.4	6.93	1189		
10:47	1.7	20.1	6.95	1188		
10:50	2.5	20.2	6.88	1195		
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-4	3/3/2008	10:55	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
Signature:						

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-5				
Well Diameter:		2"				
Purging Device:		Disposable Bailer				
Sampling Method:		Disposable Bailer				
Total Well Depth:		27.90	Fe= mg/L			
Depth to Water:		19.97	ORP= mV			
Water Column Height:		7.93	DO= mg/L			
Gallons/ft:		0.16				
1 Casing Volume (gal):		1.27	COMMENTS: very turbid, silty			
3 Casing Volumes (gal):		3.81				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
11:00	1.3	19.6			7.12	1154
11:03	2.5	19.5			7.15	1189
11:05	3.8	19.2	7.17	1160		
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-5	3/3/2008	11:10	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
Signature:						

WELL SAMPLING FORM

Date:		3/3/2008				
Client:		Conestoga-Rovers and Associates				
Site Address:		1432 Harrison Street, Oakland, CA				
Well ID:		MW-6				
Well Diameter:		4"				
Purging Device:		Disposable Bailer				
Sampling Method:		Disposable Bailer				
Total Well Depth:		28.25	Fe= mg/L			
Depth to Water:		20.47	ORP= mV			
Water Column Height:		7.78	DO= mg/L			
Gallons/ft:		0.16				
1 Casing Volume (gal):		1.24	COMMENTS: very turbid, silty			
3 Casing Volumes (gal):		3.73				
TIME:	CASING VOLUME (gal)	TEMP (Celsius)			pH	COND. (µS)
10:25	1.2	19.2			6.87	1187
10:27	2.5	19.4			6.92	1208
10:30	3.7	19.4	6.90	1201		
Sample ID:	Sample Date:	Sample Time:	Container Type	Preservative	Analytes	Method
MW-6	3/3/2008	10:35	40 ml VOA	HCl, ICE	TPHg BTEX MTBE	8015, 8021, 8260
Signature:						



**CONESTOGA-ROVERS
& ASSOCIATES**

APPENDIX B
Laboratory Analytical Report

**McC Campbell Analytical, Inc.**

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

Conestoga-Rovers & Associates 5900 Hollis St, Suite A Emeryville, CA 94608	Client Project ID: #540188; Borsuk	Date Sampled: 03/03/08
		Date Received: 03/03/08
	Client Contact: Mark Jonas	Date Reported: 03/07/08
	Client P.O.:	Date Completed: 03/10/08

WorkOrder: 0803008

March 10, 2008

Dear Mark:

Enclosed within are:

- 1) The results of the 6 analyzed samples from your project: **#540188; Borsuk,**
- 2) A QC report for the above samples,
- 3) A copy of the chain of custody, and
- 4) An invoice for analytical services.

All analyses were completed satisfactorily and all QC samples were found to be within our control limits.

If you have any questions or concerns, please feel free to give me a call. Thank you for choosing

McC Campbell Analytical Laboratories for your analytical needs.

Best regards,

Angela Rydelius
Laboratory Manager
McC Campbell Analytical, Inc.

0803008



McCAMPBELL ANALYTICAL, INC.
 1534 WILLOW PASS ROAD
 PITTSBURG, CA 94565-1701
 Website: www.mccampbell.com Email: main@mccampbell.com
 Telephone: (877) 252-9262 Fax: (925) 252-9269

CHAIN OF CUSTODY RECORD
 TURN AROUND TIME
 RUSH 24 HR 48 HR 72 HR 5 DAY
 GeoTracker EDF PDF Excel Write On (DW)
 Check if sample is effluent and "J" flag is required

Report To: MacK Jones Bill To: Ceres Terra-Rovers & Associates
 Company: Ceres Terra-Rovers & Associates
500 Morris Street, Ste A
Emeryville, CA E-Mail: mjones@ceresworld.com
 Tele: (510) 420-3307 Fax: (510) 420-9170
 Project #: 540188 Project Name: Biosuk
 Project Location: 1432 Harrison Street, Oakland, CA
 Sampler Signature: Muskan Environmental Sampling

SAMPLE ID	LOCATION/ Field Point Name	SAMPLING		# Containers	Type Containers	MATRIX					METHOD PRESERVED	Analysis Request	Other	Comments	
		Date	Time			Water	Soil	Air	Sludge	Other	ICE				HCL
+ MW-1		3/30/07	11:40	4	Voon	X						X			
+ MW-2			11:30												
+ MW-3			10:15												
+ MW-4			10:55												
+ MW-5			11:10												
+ MW-6		X	10:35	X	X	X						X			

Relinquished By: [Signature] Date: 3/3/07 Time: 14:17 Received By: [Signature]
 Relinquished By: _____ Date: _____ Time: _____ Received By: _____
 Relinquished By: _____ Date: _____ Time: _____ Received By: _____

ICE/P 5.3
 GOOD CONDITION /
 HEAD SPACE ABSENT /
 DECHLORINATED IN LAB /
 APPROPRIATE CONTAINERS /
 PRESERVED IN LAB /

COMMENTS:
 Filter Samples for Metals analysis: Yes / No
 MTBE by 2260

VOAS O&G METALS OTHER
 PRESERVATION / pH<2

McC Campbell Analytical, Inc.



1534 Willow Pass Rd
Pittsburg, CA 94565-1701
(925) 252-9262

CHAIN-OF-CUSTODY RECORD

WorkOrder: 0803008

ClientCode: CETE

- WriteOn
 EDF
 Excel
 Fax
 Email
 HardCopy
 ThirdParty
 J-flag

Report to:

Mark Jonas
Conestoga-Rovers & Associates
5900 Hollis St, Suite A
Emeryville, CA 94608

Email: mjonas@CRAworld.com
TEL: (510) 420-0700 FAX: (510) 420-9170
PO:
ProjectNo: #540188; Borsuk

Bill to:

Accounts Payable
Conestoga-Rovers & Associates
5900 Hollis St, Ste. A
Emeryville, CA 94608

Requested TAT: 5 days

Date Received: 03/03/2008

Date Printed: 03/03/2008

Lab ID	Client ID	Matrix	Collection Date	Hold	Requested Tests (See legend below)												
					1	2	3	4	5	6	7	8	9	10	11	12	
0803008-001	MW-1	Water	3/3/2008 11:40	<input type="checkbox"/>	A	B											
0803008-002	MW-2	Water	3/3/2008 11:30	<input type="checkbox"/>	A	B											
0803008-003	MW-3	Water	3/3/2008 10:15	<input type="checkbox"/>	A	B											
0803008-004	MW-4	Water	3/3/2008 10:55	<input type="checkbox"/>	A	B											
0803008-005	MW-5	Water	3/3/2008 11:10	<input type="checkbox"/>	A	B											
0803008-006	MW-6	Water	3/3/2008 10:35	<input type="checkbox"/>	A	B											

Test Legend:

1 G-MBTEX_W
6
11

2 MTBE_W
7
12

3
8

4
9

5
10

Prepared by: Maria Venegas

Comments:

NOTE: Samples are discarded 60 days after results are reported unless other arrangements are made. Hazardous samples will be returned to client or disposed of at client expense.



Sample Receipt Checklist

Client Name: **Conestoga-Rovers & Associates**

Date and Time Received: **03/03/08 2:35:23 PM**

Project Name: **#540188; Borsuk**

Checklist completed and reviewed by: **Maria Venegas**

WorkOrder N°: **0803008** Matrix Water

Carrier: Client Drop-In

Chain of Custody (COC) Information


- Chain of custody present? Yes No
- Chain of custody signed when relinquished and received? Yes No
- Chain of custody agrees with sample labels? Yes No
- Sample IDs noted by Client on COC? Yes No
- Date and Time of collection noted by Client on COC? Yes No
- Sampler's name noted on COC? Yes No

Sample Receipt Information

- Custody seals intact on shipping container/cooler? Yes No NA
- Shipping container/cooler in good condition? Yes No
- Samples in proper containers/bottles? Yes No
- Sample containers intact? Yes No
- Sufficient sample volume for indicated test? Yes No

Sample Preservation and Hold Time (HT) Information

- All samples received within holding time? Yes No
- Container/Temp Blank temperature Cooler Temp: 5.3°C NA
- Water - VOA vials have zero headspace / no bubbles? Yes No No VOA vials submitted
- Sample labels checked for correct preservation? Yes No
- TTLC Metal - pH acceptable upon receipt (pH<2)? Yes No NA



Client contacted:

Date contacted:

Contacted by:

Comments:



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mcccampbell.com E-mail: main@mcccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

Conestoga-Rovers & Associates 5900 Hollis St, Suite A Emeryville, CA 94608	Client Project ID: #540188; Borsuk	Date Sampled: 03/03/08
		Date Received: 03/03/08
	Client Contact: Mark Jonas	Date Extracted: 03/04/08-03/06/08
	Client P.O.:	Date Analyzed 03/04/08-03/06/08

Gasoline Range (C6-C12) Volatile Hydrocarbons as Gasoline with BTEX and MTBE*

Extraction method SW5030B

Analytical methods SW8021B/8015Cm

Work Order: 0803008

Lab ID	Client ID	Matrix	TPH(g)	MTBE	Benzene	Toluene	Ethylbenzene	Xylenes	DF	% SS
001A	MW-1	W	10,000,a,h,i	---	510	28	ND<10	1700	20	75
002A	MW-2	W	40,000,a	---	7700	490	1400	4400	20	107
003A	MW-3	W	ND	---	ND	ND	ND	ND	1	93
004A	MW-4	W	63,c	---	0.78	ND	ND	ND	1	92
005A	MW-5	W	30,000,a	---	6200	31	900	1400	50	110
006A	MW-6	W	ND	---	ND	ND	ND	ND	1	103

Reporting Limit for DF =1; ND means not detected at or above the reporting limit	W	50	5.0	0.5	0.5	0.5	0.5	0.5	1	µg/L
	S	NA	NA	NA	NA	NA	NA	NA	1	mg/Kg

* water and vapor samples and all TCLP & SPLP extracts are reported in ug/L, soil/sludge/solid samples in mg/kg, wipe samples in µg/wipe, product/oil/non-aqueous liquid samples in mg/L.

cluttered chromatogram; sample peak coelutes with surrogate peak.

+The following descriptions of the TPH chromatogram are cursory in nature and McC Campbell Analytical is not responsible for their interpretation: a) unmodified or weakly modified gasoline is significant; b) heavier gasoline range compounds are significant(aged gasoline?); c) lighter gasoline range compounds (the most mobile fraction) are significant; d) gasoline range compounds having broad chromatographic peaks are significant; biologically altered gasoline?; e) TPH pattern that does not appear to be derived from gasoline (stoddard solvent / mineral spirit?); f) one to a few isolated non-target peaks present; g) strongly aged gasoline or diesel range compounds are significant; h) lighter than water immiscible sheen/product is present; i) liquid sample that contains greater than ~1 vol. % sediment; j) reporting limit raised due to high MTBE content; k) TPH pattern that does not appear to be derived from gasoline (aviation gas). m) no recognizable pattern; n) TPH(g) range non-target isolated peaks subtracted out of the TPH(g) concentration at the client's request; p) see attached narrative.



McC Campbell Analytical, Inc.

"When Quality Counts"

1534 Willow Pass Road, Pittsburg, CA 94565-1701
Web: www.mccampbell.com E-mail: main@mccampbell.com
Telephone: 877-252-9262 Fax: 925-252-9269

Conestoga-Rovers & Associates 5900 Hollis St, Suite A Emeryville, CA 94608	Client Project ID: #540188; Borsuk	Date Sampled: 03/03/08
		Date Received: 03/03/08
	Client Contact: Mark Jonas	Date Extracted: 03/07/08
	Client P.O.:	Date Analyzed 03/07/08

Methyl tert-Butyl Ether*

Extraction method SW5030B

Analytical methods SW8260B

Work Order: 0803008

Lab ID	Client ID	Matrix	Methyl-t-butyl ether (MTBE)	DF	% SS
001B	MW-1	W	ND<2.5,j,h,i	5	103
002B	MW-2	W	ND<17,j	33	100
003B	MW-3	W	ND	1	102
004B	MW-4	W	ND	1	104
005B	MW-5	W	ND<10,j	20	101
006B	MW-6	W	ND	1	103


Reporting Limit for DF =1; ND means not detected at or above the reporting limit	W	0.5	µg/L
	S	NA	NA

* water and vapor samples are reported in µg/L, soil/sludge/solid samples in mg/kg, product/oil/non-aqueous liquid samples and all TCLP & SPLP extracts are reported in mg/L, wipe samples in µg/wipe.

ND means not detected above the reporting limit; N/A means analyte not applicable to this analysis.

surrogate diluted out of range or surrogate coelutes with another peak.

h) lighter than water immiscible sheen/product is present; i) liquid sample that contains greater than ~1 vol. % sediment; j) sample diluted due to high organic content/matrix interference; k) reporting limit near, but not identical to our standard reporting limit due to variable Encore sample weight; m) reporting limit raised due to insufficient sample amount; n) results are reported on a dry weight basis; p) see attached narrative.

 Angela Rydelius, Lab Manager



QC SUMMARY REPORT FOR SW8021B/8015Cm

W.O. Sample Matrix: Water

QC Matrix: Water

WorkOrder: 0803008

EPA Method SW8021B/8015Cm		Extraction SW5030B				BatchID: 34101			Spiked Sample ID: 0802733-001A			
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH(btex) ^f	ND	60	NR	NR	NR	94.3	91	3.50	70 - 130	20	70 - 130	20
MTBE	10	10	91.5	84.9	3.44	101	95.6	5.02	70 - 130	20	70 - 130	20
Benzene	ND	10	103	103	0	95.3	92.8	2.65	70 - 130	20	70 - 130	20
Toluene	ND	10	115	114	1.43	91.9	89.8	2.36	70 - 130	20	70 - 130	20
Ethylbenzene	ND	10	117	113	3.70	91.9	90.6	1.40	70 - 130	20	70 - 130	20
Xylenes	ND	30	126	123	2.80	85.4	83.5	2.15	70 - 130	20	70 - 130	20
%SS:	92	10	98	102	3.39	108	106	1.56	70 - 130	20	70 - 130	20

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 34101 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
0803008-001A	03/03/08 11:40 AM	03/06/08	03/06/08 12:10 AM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

£ TPH(btex) = sum of BTEX areas from the FID.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content, or inconsistency in sample containers.



QC SUMMARY REPORT FOR SW8021B/8015Cm

W.O. Sample Matrix: Water

QC Matrix: Water

WorkOrder: 0803008

EPA Method SW8021B/8015Cm		Extraction SW5030B			BatchID: 34118			Spiked Sample ID: 0803008-006A				
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
TPH(btex) ^f	ND	60	82.1	84	2.27	89.5	77.6	14.3	70 - 130	20	70 - 130	20
MTBE	ND	10	96.4	107	10.6	90.9	90.9	0	70 - 130	20	70 - 130	20
Benzene	ND	10	96.5	97.9	1.45	92.9	95.7	2.96	70 - 130	20	70 - 130	20
Toluene	ND	10	94.1	96	2.05	91.7	93.8	2.33	70 - 130	20	70 - 130	20
Ethylbenzene	ND	10	94.9	96.6	1.70	92.3	94.1	1.95	70 - 130	20	70 - 130	20
Xylenes	ND	30	86.8	89.1	2.55	85.6	86.2	0.654	70 - 130	20	70 - 130	20
%SS:	103	10	106	106	0	106	110	3.61	70 - 130	20	70 - 130	20

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:

NONE

BATCH 34118 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
0803008-002A	03/03/08 11:30 AM	03/04/08	03/04/08 8:56 AM	0803008-003A	03/03/08 10:15 AM	03/04/08	03/04/08 9:30 AM
0803008-004A	03/03/08 10:55 AM	03/04/08	03/04/08 10:04 AM	0803008-005A	03/03/08 11:10 AM	03/04/08	03/04/08 5:08 AM
0803008-006A	03/03/08 10:35 AM	03/04/08	03/04/08 6:38 AM				

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked, or b) the spiked sample's matrix interferes with the spike recovery.

£ TPH(btex) = sum of BTEX areas from the FID.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content, or inconsistency in sample containers.



QC SUMMARY REPORT FOR SW8260B

W.O. Sample Matrix: Water

QC Matrix: Water

WorkOrder: 0803008

EPA Method SW8260B		Extraction SW5030B			BatchID: 34116			Spiked Sample ID: 0803007-008B				
Analyte	Sample	Spiked	MS	MSD	MS-MSD	LCS	LCSD	LCS-LCSD	Acceptance Criteria (%)			
	µg/L	µg/L	% Rec.	% Rec.	% RPD	% Rec.	% Rec.	% RPD	MS / MSD	RPD	LCS/LCSD	RPD
Methyl-t-butyl ether (MTBE)	ND	10	92.3	91.7	0.637	97.2	108	10.6	70 - 130	30	70 - 130	30
%SS1:	100	10	122	120	1.32	102	91	10.9	70 - 130	30	70 - 130	30

All target compounds in the Method Blank of this extraction batch were ND less than the method RL with the following exceptions:
NONE

BATCH 34116 SUMMARY

Lab ID	Date Sampled	Date Extracted	Date Analyzed	Lab ID	Date Sampled	Date Extracted	Date Analyzed
0803008-001B	03/03/08 11:40 AM	03/07/08	03/07/08 7:38 PM	0803008-002B	03/03/08 11:30 AM	03/07/08	03/07/08 8:27 PM
0803008-003B	03/03/08 10:15 AM	03/07/08	03/07/08 9:10 PM	0803008-004B	03/03/08 10:55 AM	03/07/08	03/07/08 9:53 PM
0803008-005B	03/03/08 11:10 AM	03/07/08	03/07/08 10:39 PM	0803008-006B	03/03/08 10:35 AM	03/07/08	03/07/08 11:22 PM

MS = Matrix Spike; MSD = Matrix Spike Duplicate; LCS = Laboratory Control Sample; LCSD = Laboratory Control Sample Duplicate; RPD = Relative Percent Deviation.

% Recovery = 100 * (MS-Sample) / (Amount Spiked); RPD = 100 * (MS - MSD) / ((MS + MSD) / 2).

MS / MSD spike recoveries and / or %RPD may fall outside of laboratory acceptance criteria due to one or more of the following reasons: a) the sample is inhomogenous AND contains significant concentrations of analyte relative to the amount spiked; or b) the spiked sample's matrix interferes with the spike recovery.

N/A = not enough sample to perform matrix spike and matrix spike duplicate.

NR = analyte concentration in sample exceeds spike amount for soil matrix or exceeds 2x spike amount for water matrix or sample diluted due to high matrix or analyte content.




**CONESTOGA-ROVERS
& ASSOCIATES**

APPENDIX C
Benzene Concentration and Depth to Water
Time-Series Graphs


MW-1: Benzene Concentration and Depth to Water vs. Time

Allright Parking, 1432 Harrison Street, Oakland, California

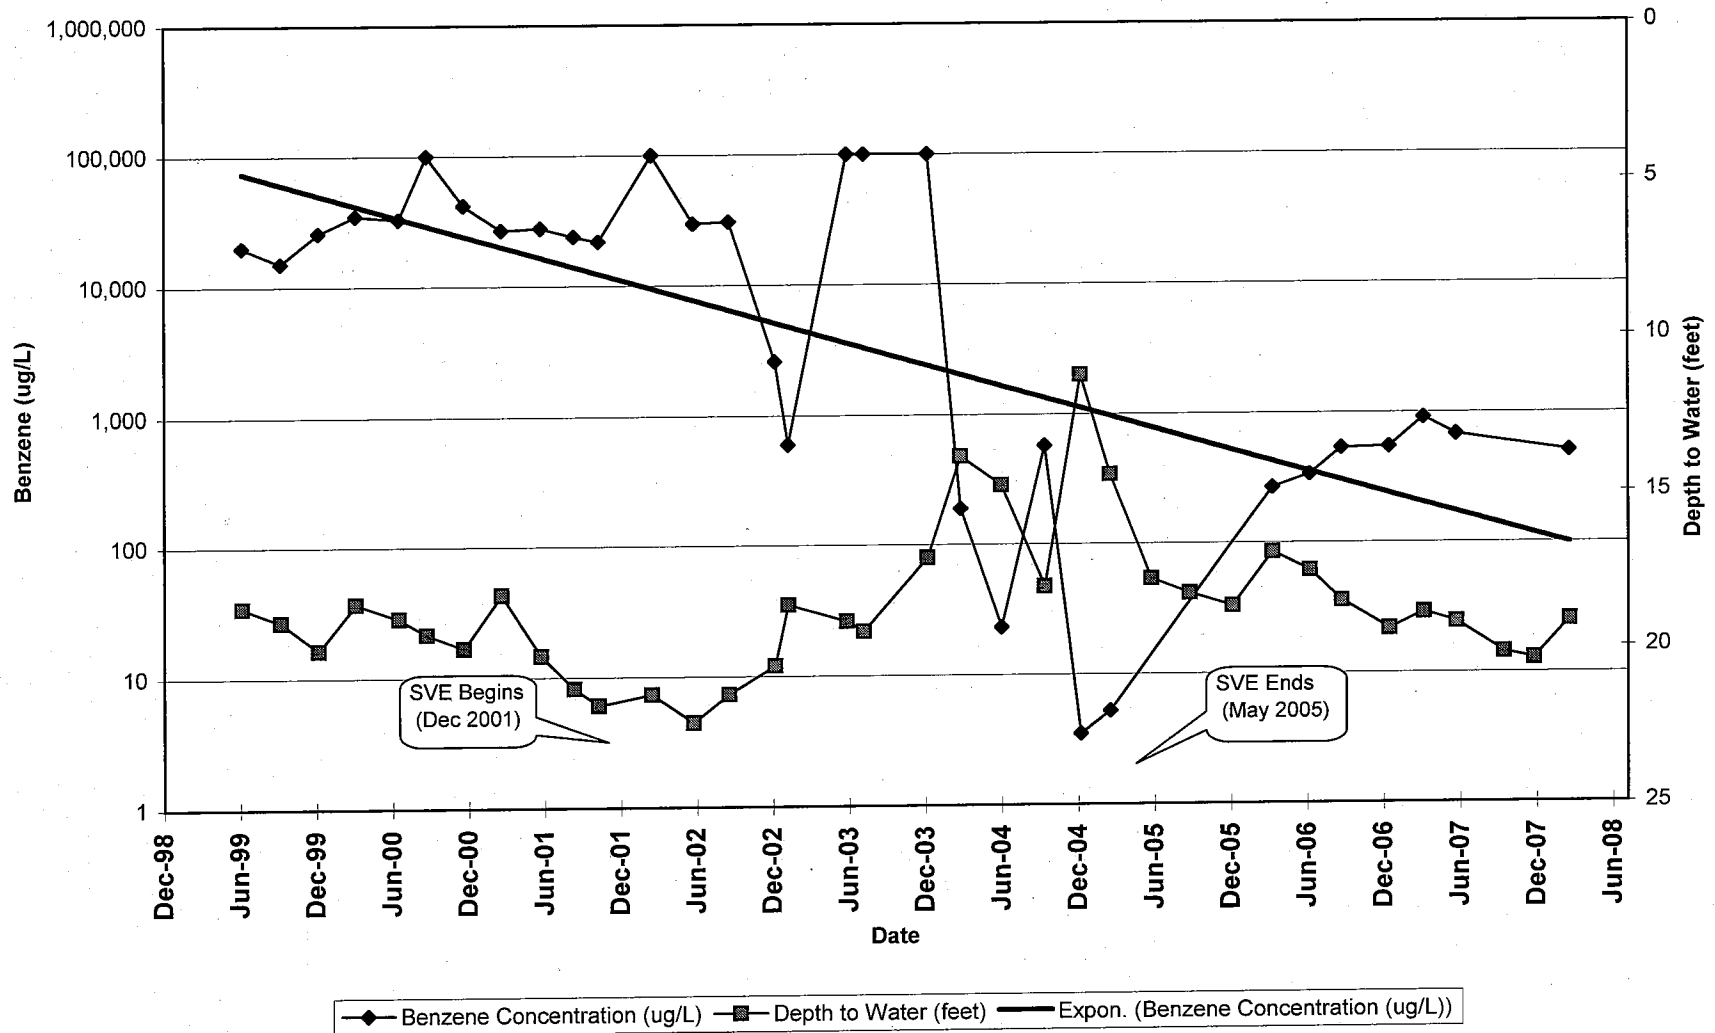


MW-2: Benzene Concentration and Depth to Water vs. Time

Allright Parking, 1432 Harrison Street, Oakland, California

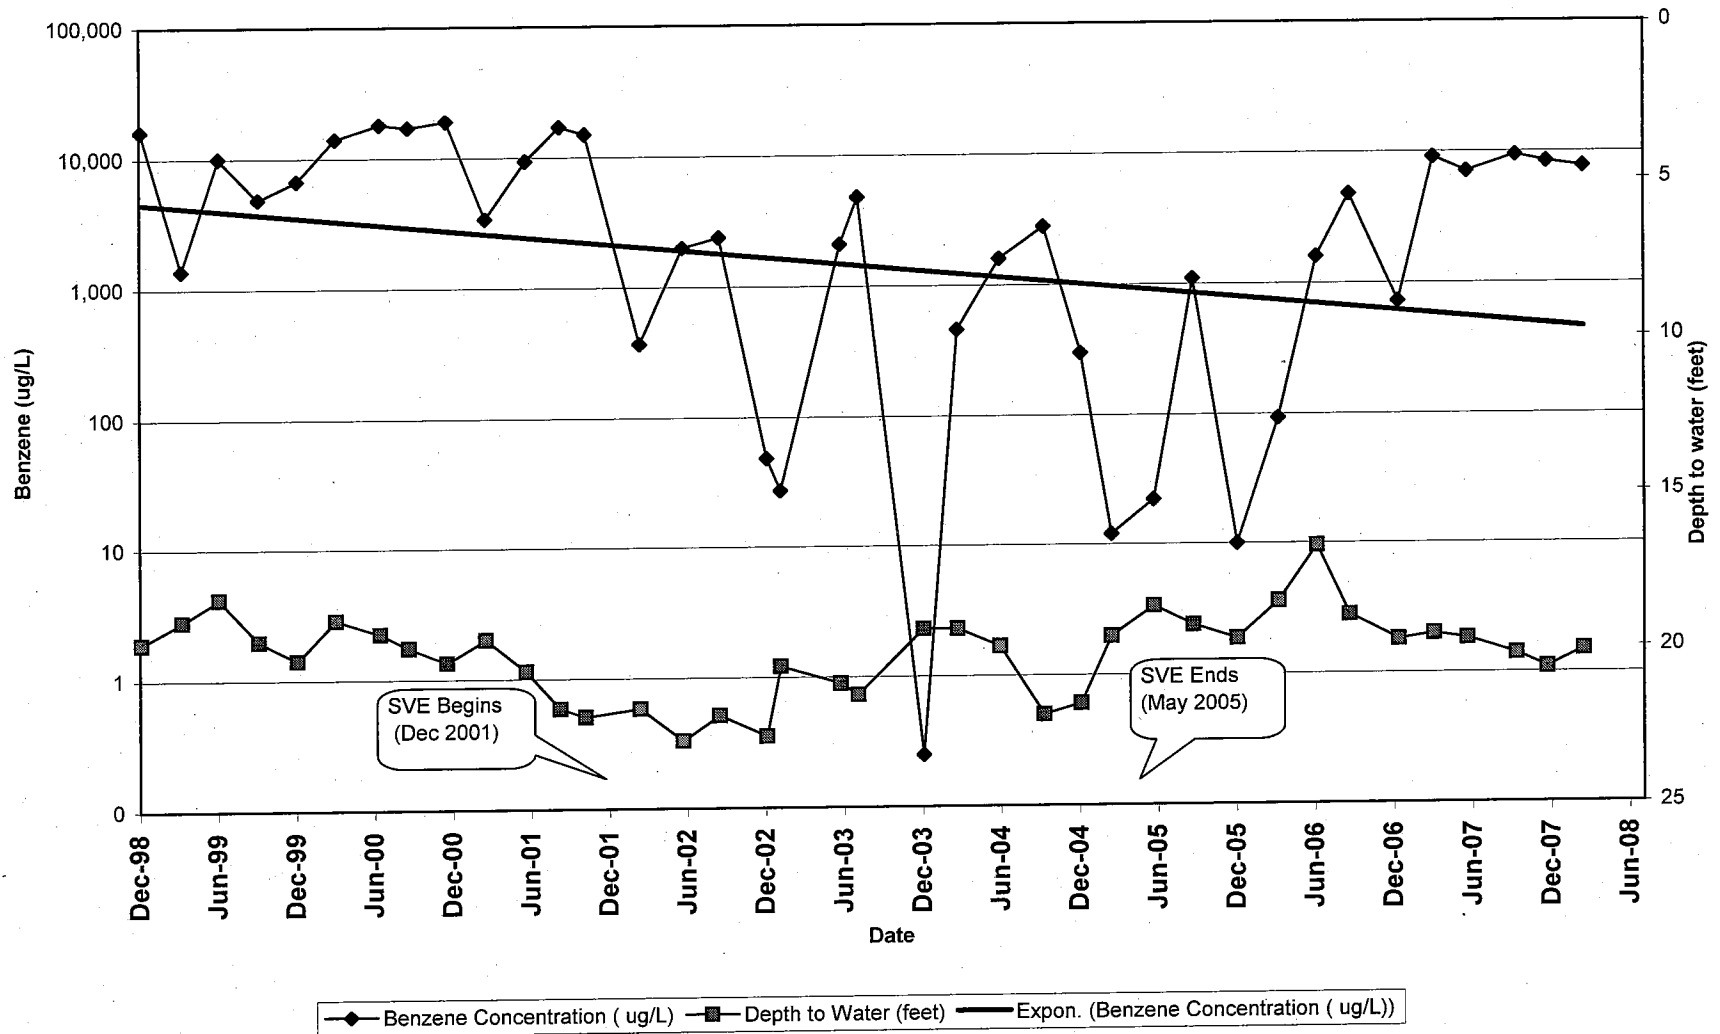


MW-3: Benzene Concentration and Depth to Water vs. Time

Allright Parking, 1432 Harrison Street, Oakland, California

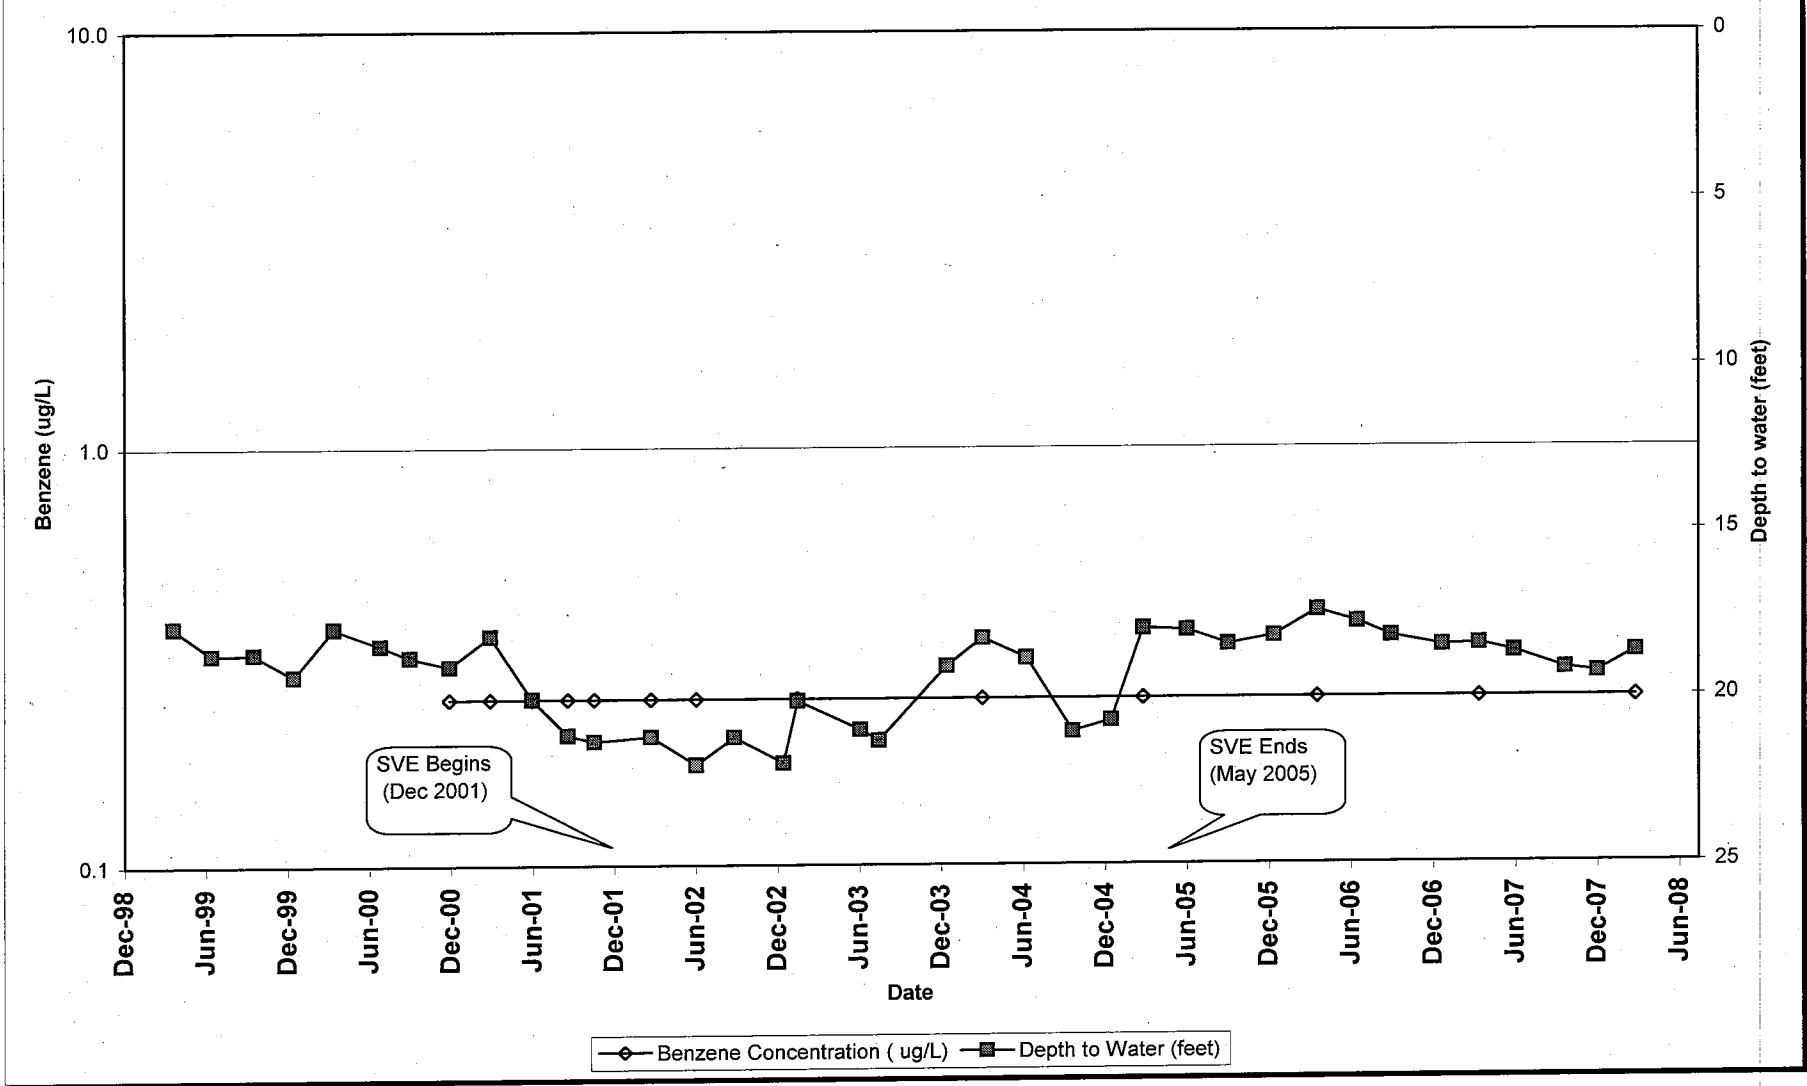


MW-4: Benzene Concentration and Depth to Water vs. Time

Allright Parking, 1432 Harrison Street, Oakland, California

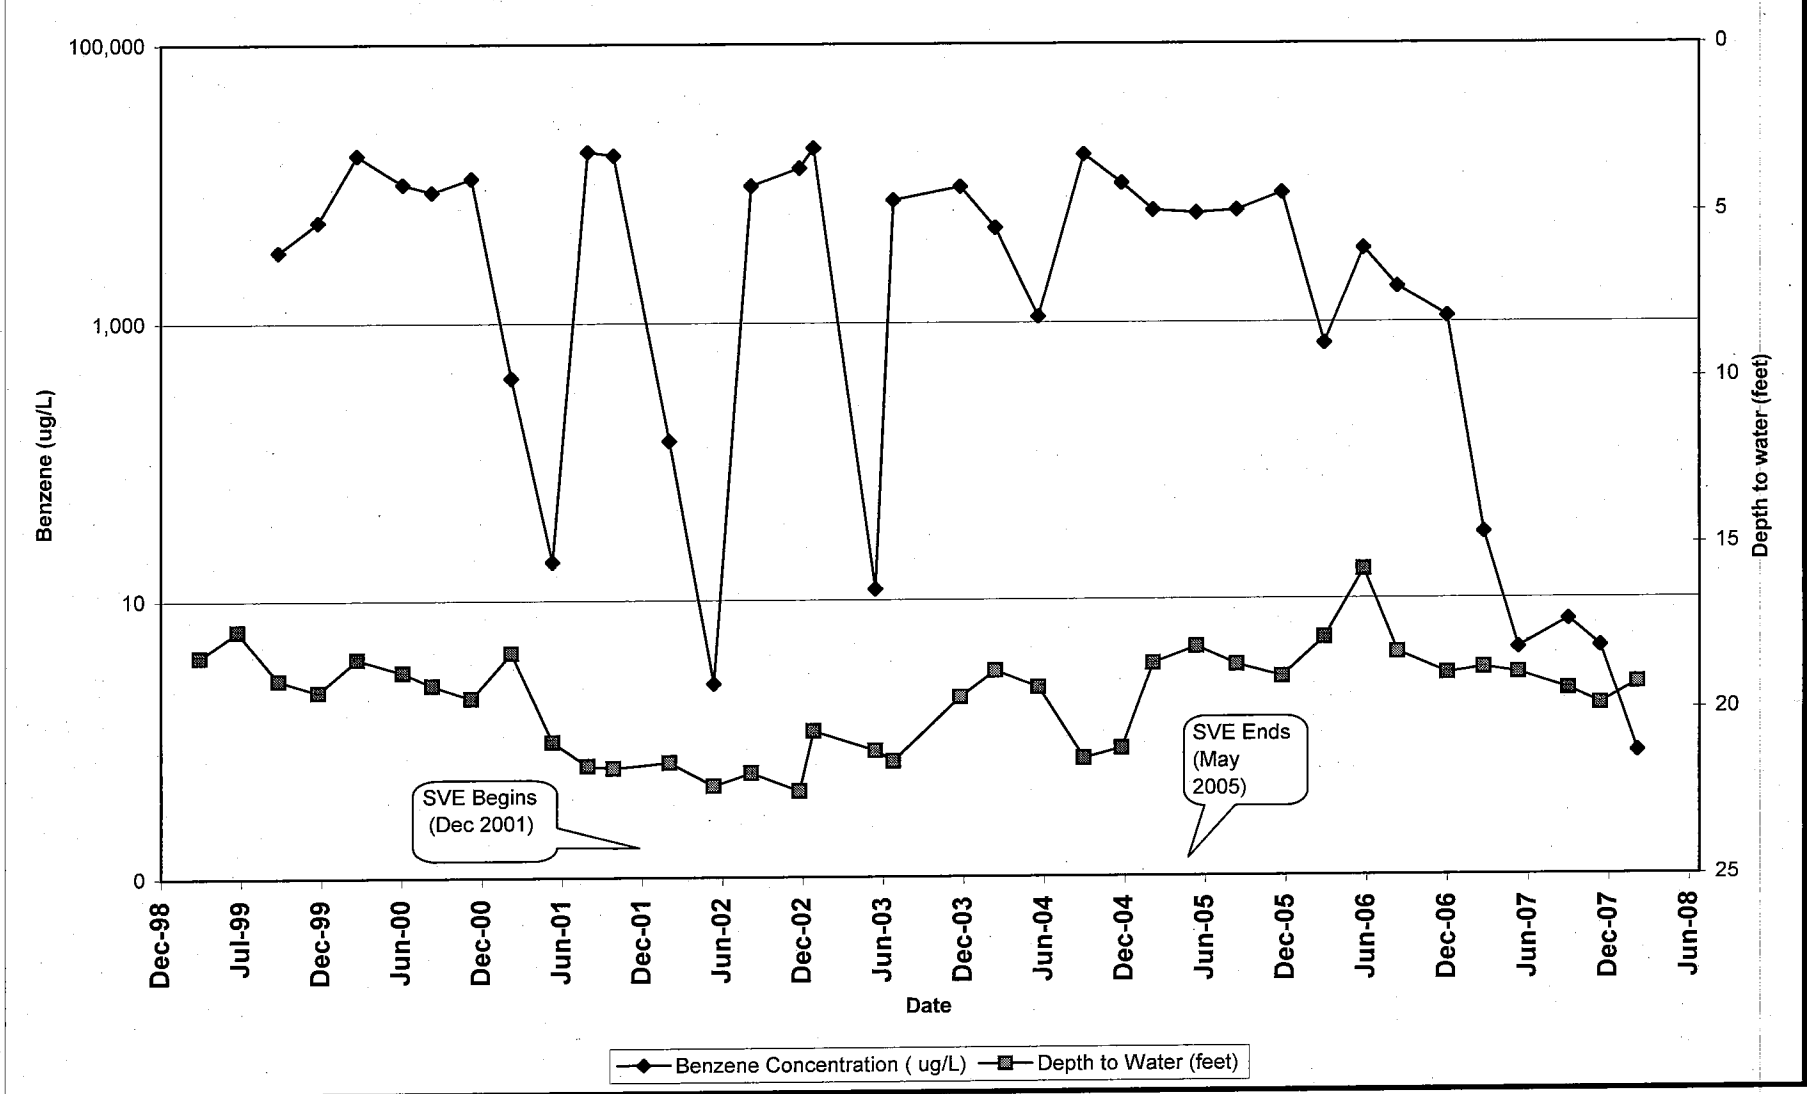

MW-5: Benzene Concentration and Depth to Water vs. Time

Allright Parking, 1432 Harrison Street, Oakland, California

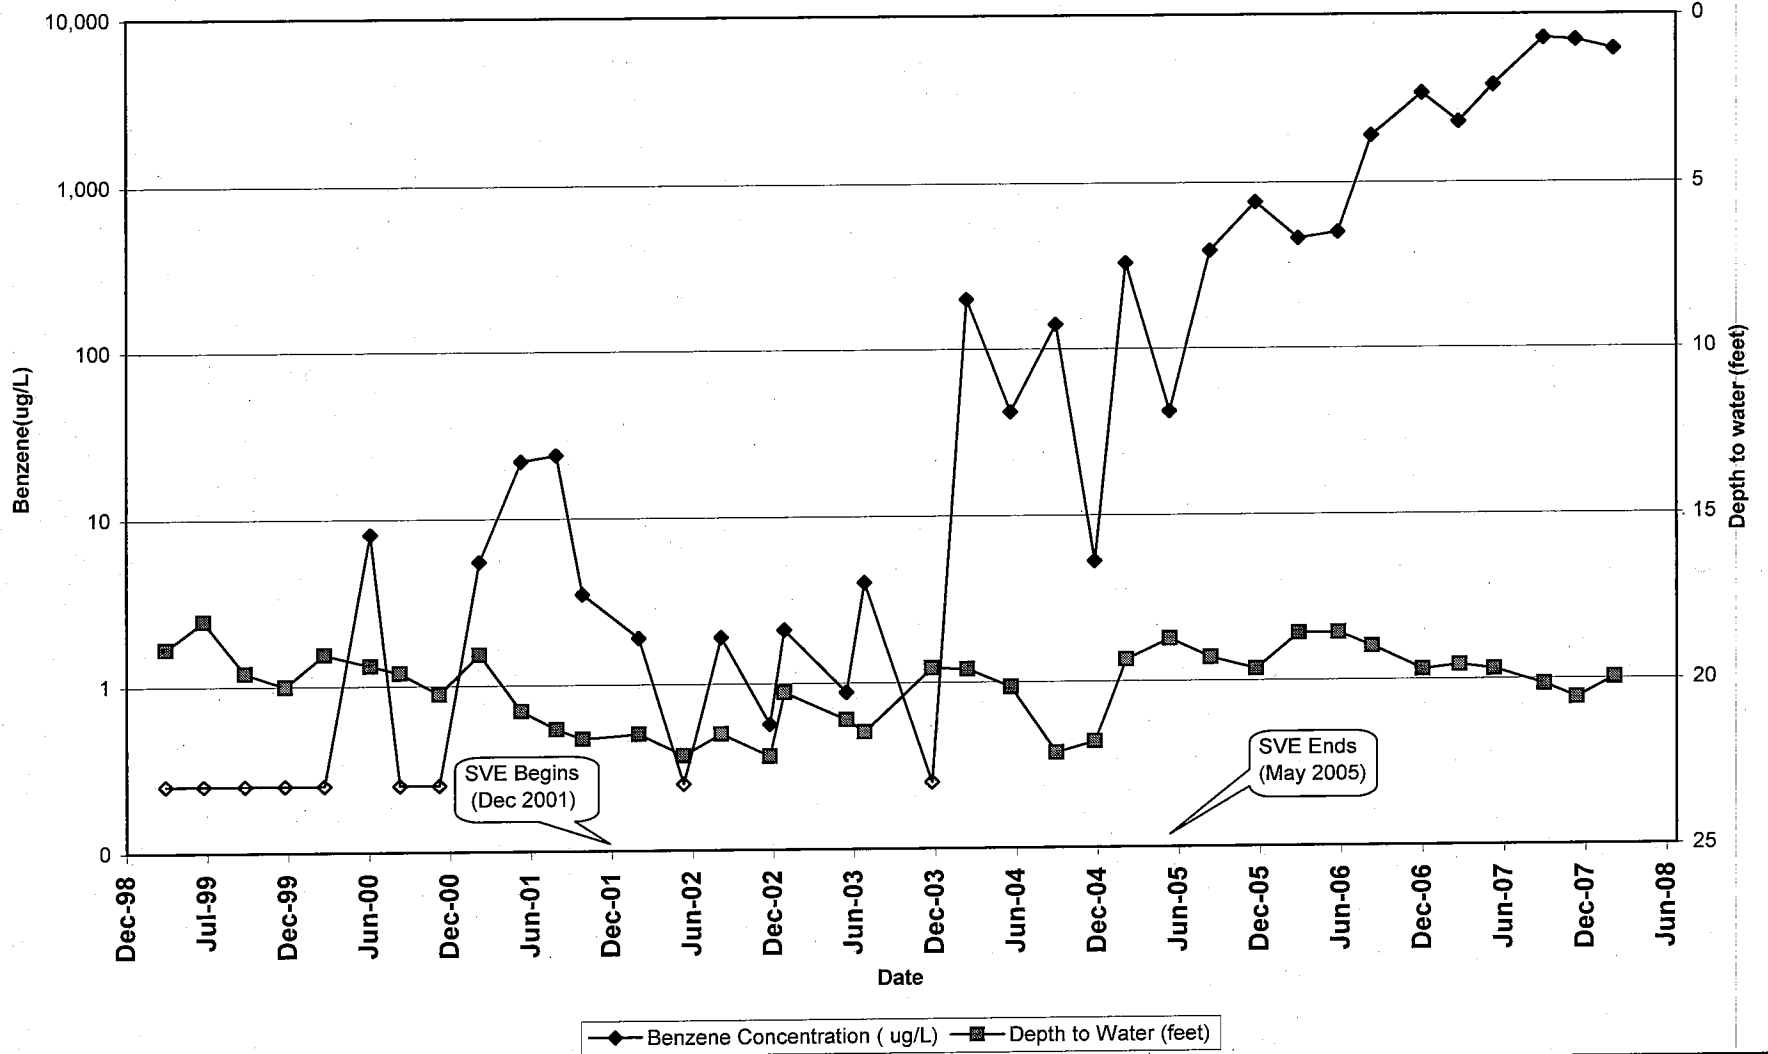

MW-6: Benzene Concentration and Depth to Water vs. Time
 Allright Parking, 1432 Harrison Street, Oakland, California

