



**CONESTOGA-ROVERS
& ASSOCIATES**

5900 Hollis Street, Suite A, Emeryville, California 94608
Telephone: 510-420-0700 Facsimile: 510-420-9170
www.CRAworld.com

RO363

May 3, 2007

Mr. Paul Smith
Livermore-Pleasanton Fire Department
3560 Nevada Street
Pleasanton, California 94566

Re: **Underground Storage Tank Removal Report**
Shell-branded Service Station
3790 Hopyard Road
Pleasanton, California
SAP Code 135784
CRA Project No. 200497-001

Dear Mr. Smith:

Conestoga-Rovers & Associates (CRA) prepared this report on behalf of Equilon Enterprises LLC dba Shell Oil Products US (Shell) to document the recent underground storage tank (UST) removal activities at the referenced site. Under Livermore-Pleasanton Fire Department (LPPD) direction, Cambria Environmental Technology, Inc. (Cambria) performed soil sampling following the removal of one waste oil UST. Cambria performed the work in accordance with Alameda County Health Care Services Agency (ACHCSA) and San Francisco Bay Regional Water Quality Control Board (RWQCB) guidelines.

SITE DESCRIPTION

The subject site is an active Shell-branded service station located on the southwest corner of the Hopyard Road and Las Positas Road intersection in Pleasanton, California (Figure 1). Prior to the waste oil UST removal, the site layout included a station building, three gasoline USTs, one waste oil UST, and two dispenser islands. (Figure 2).

Equal
Employment
Opportunity Employer



SAMPLING ACTIVITIES AND SAMPLE ANALYSES

On February 14, 2007, Wayne Perry, Inc. (Wayne Perry) of Sacramento, California removed one 550-gallon single-wall fiberglass waste oil UST. Attachment A presents CRA's standard tank removal sampling procedures.

Personnel Present:

- Paul Smith, Hazardous Materials Inspector, LPFD
- Chris Steadman, Construction Foreman, Wayne Perry
- Celina Hernandez, Senior Staff Geologist, CRA (formerly Cambria)

Sampling Date: February 14, 2007

UST Removal Observations: Cambria observed no cracks, holes, or corrosion in the UST upon removal.

UST Excavation Soil Sampling: Cambria collected one soil sample (WO-1-9) from the bottom of the UST excavation at a depth of 9 feet below grade using an excavator. Figure 2 shows the sampling location. The soil was removed from the excavator bucket and packed into a clean brass sample tube; the tube ends were covered with Teflon[®] tape and plastic end caps. The soil sample was labeled, placed into a cooler with ice, entered onto a chain-of-custody record, and transported to a California-certified analytical laboratory.

UST Excavation Grab Water Sampling: Cambria collected one grab water sample (WO-W) from the excavation using a disposable bailer. The sample was placed into appropriate glass and plastic containers, labeled, placed into a cooler with ice, entered onto a chain-of-custody record, and transported to a California-certified analytical laboratory.

Chemical Analyses: State-certified laboratory TestAmerica Analytical Testing Corporation (TestAmerica) of Sacramento, California analyzed all samples for:

- Oil and grease by EPA Method 413.1 (Modified);
- Total petroleum hydrocarbons as diesel (TPHd) by EPA Method 8015 (Modified);
- Total petroleum hydrocarbons as gasoline (TPHg), benzene, toluene, ethylbenzene, and total xylenes (BTEX), methyl tertiary-butyl ether (MTBE), ethyl tertiary-butyl ether (ETBE), di-isopropyl ether (DIPE), tertiary-amyl methyl ether (TAME), tertiary-butanol (TBA), 1,2-dichloroethane (1,2-DCA), 1,2-dibromoethane (EDB), and chlorinated hydrocarbons by EPA Method 8260B;
- Cadmium, chromium, lead, nickel, and zinc by EPA Method 6010B;



- Polychlorinated biphenyls (PCBs) by EPA Method 3545/8082; and
- Polynuclear aromatics (PNAs) and pentachlorophenol (PCP) EPA Method 8270C.

Attachment B includes the laboratory report.

Soil Disposal: No soil or pea gravel was removed from the site during the waste oil UST removal activities. Cambria collected one four-point composite sample from the pea gravel removed from the UST excavation during soil sampling activities. State-certified laboratory TestAmerica analyzed the composite sample for:

- Total recoverable petroleum hydrocarbons by EPA Method 418.1 (Modified);
- TPHd by EPA Method 8015B with silica gel clean-up;
- TPHg, BTEX, and toxicity characteristic leaching procedure (TCLP) volatile organic compounds by EPA Method 8260B;
- Antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, copper, lead, molybdenum, nickel, selenium, silver, thallium, vanadium, and zinc by EPA Method 6010B;
- Mercury by EPA Method 7471A;
- TCLP semi-volatile organic compounds by EPA Method 8270C;
- PCBs by EPA Method 3545/8082;
- Total cyanide EPA Method 9014; and
- Sulfide by EPA Method 9034.

With approval from ACHCSA, the pea gravel was placed back into the excavation. Attachment B includes the laboratory report.

ANALYTICAL RESULTS

Table 1 summarizes soil analytical results, Table 2 summarizes grab groundwater analytical results, and Attachment B presents the laboratory analytical reports. A summary of these data is presented below.

The soil sample (WO-1-9) collected from the UST excavation contained 0.88 milligrams per kilogram (mg/kg) TPHg, 0.0017 mg/kg toluene, 0.010 mg/kg ethylbenzene, 0.057 mg/kg total xylenes, 52 mg/kg chromium, 8.0 mg/kg lead, 53 mg/kg nickel, and 56 mg/kg zinc.



**CONESTOGA-ROVERS
& ASSOCIATES**

Mr. Paul Smith
May 3, 2007

The grab water sample (WO-W) collected from the UST excavation contained 0.67 micrograms per liter (ug/L) benzene, 0.75 ug/L toluene, 0.73 ug/L ethylbenzene, 1.6 ug/L MTBE, 47 ug/L chromium, 9.4 ug/L lead, 130 ug/L nickel, 500 ug/L zinc, and 32 ug/L benzoic acid.

Based on these concentrations, Shell submitted an Underground Storage Tank Unauthorized Release (Leak)/Site Contamination Report (Unauthorized Release Report) on March 7, 2007. Attachment C presents this report.


CONCLUSIONS

All the detections except lead, nickel, and zinc in groundwater are below SFBRWQCB environmental screening levels (ESLs) for shallow soil (fewer than 3 meters below grade) and groundwater where groundwater is a current or potential drinking water source for residential land use areas.

CLOSING

If you have any questions regarding the contents of this report, please call Aubrey Cool at (510) 420-3336.

Sincerely,
Conestoga-Rovers & Associates


Aubrey K. Cool, PG
Professional Geologist



Figures: 1 – Vicinity Map
2 – Site Plan

Tables: 1 – Soil Analytical Data
2 – Grab Water Analytical Data

Attachments: A – Tank Removal Sampling Procedures
B – Laboratory Analytical Reports
C – Unauthorized Release Report




**CONESTOGA-ROVERS
& ASSOCIATES**

Mr. Paul Smith
May 3, 2007

cc: Bill Merchant, Shell Oil Products US, 4801 Laguna Boulevard, Suite 105-290, Elk Grove,
CA 95758
Denis Brown, Shell Oil Products US, 20945 S. Wilmington Avenue, Carson, CA 90810
Jerry Wickham, Alameda County Health Care Services Agency, 1131 Harbor Bay
Parkway, Suite 250, Alameda, CA 94502-6577
Joe Rounds, Delta Environmental Consultants, Inc., 175 Bernal Road, Suite 200, San
Jose, CA 95119

J:\Shell\Pleasanton 3790 Hopyard\2007 waste oil tank removal\Report\WOT Pull Report 2007.doc

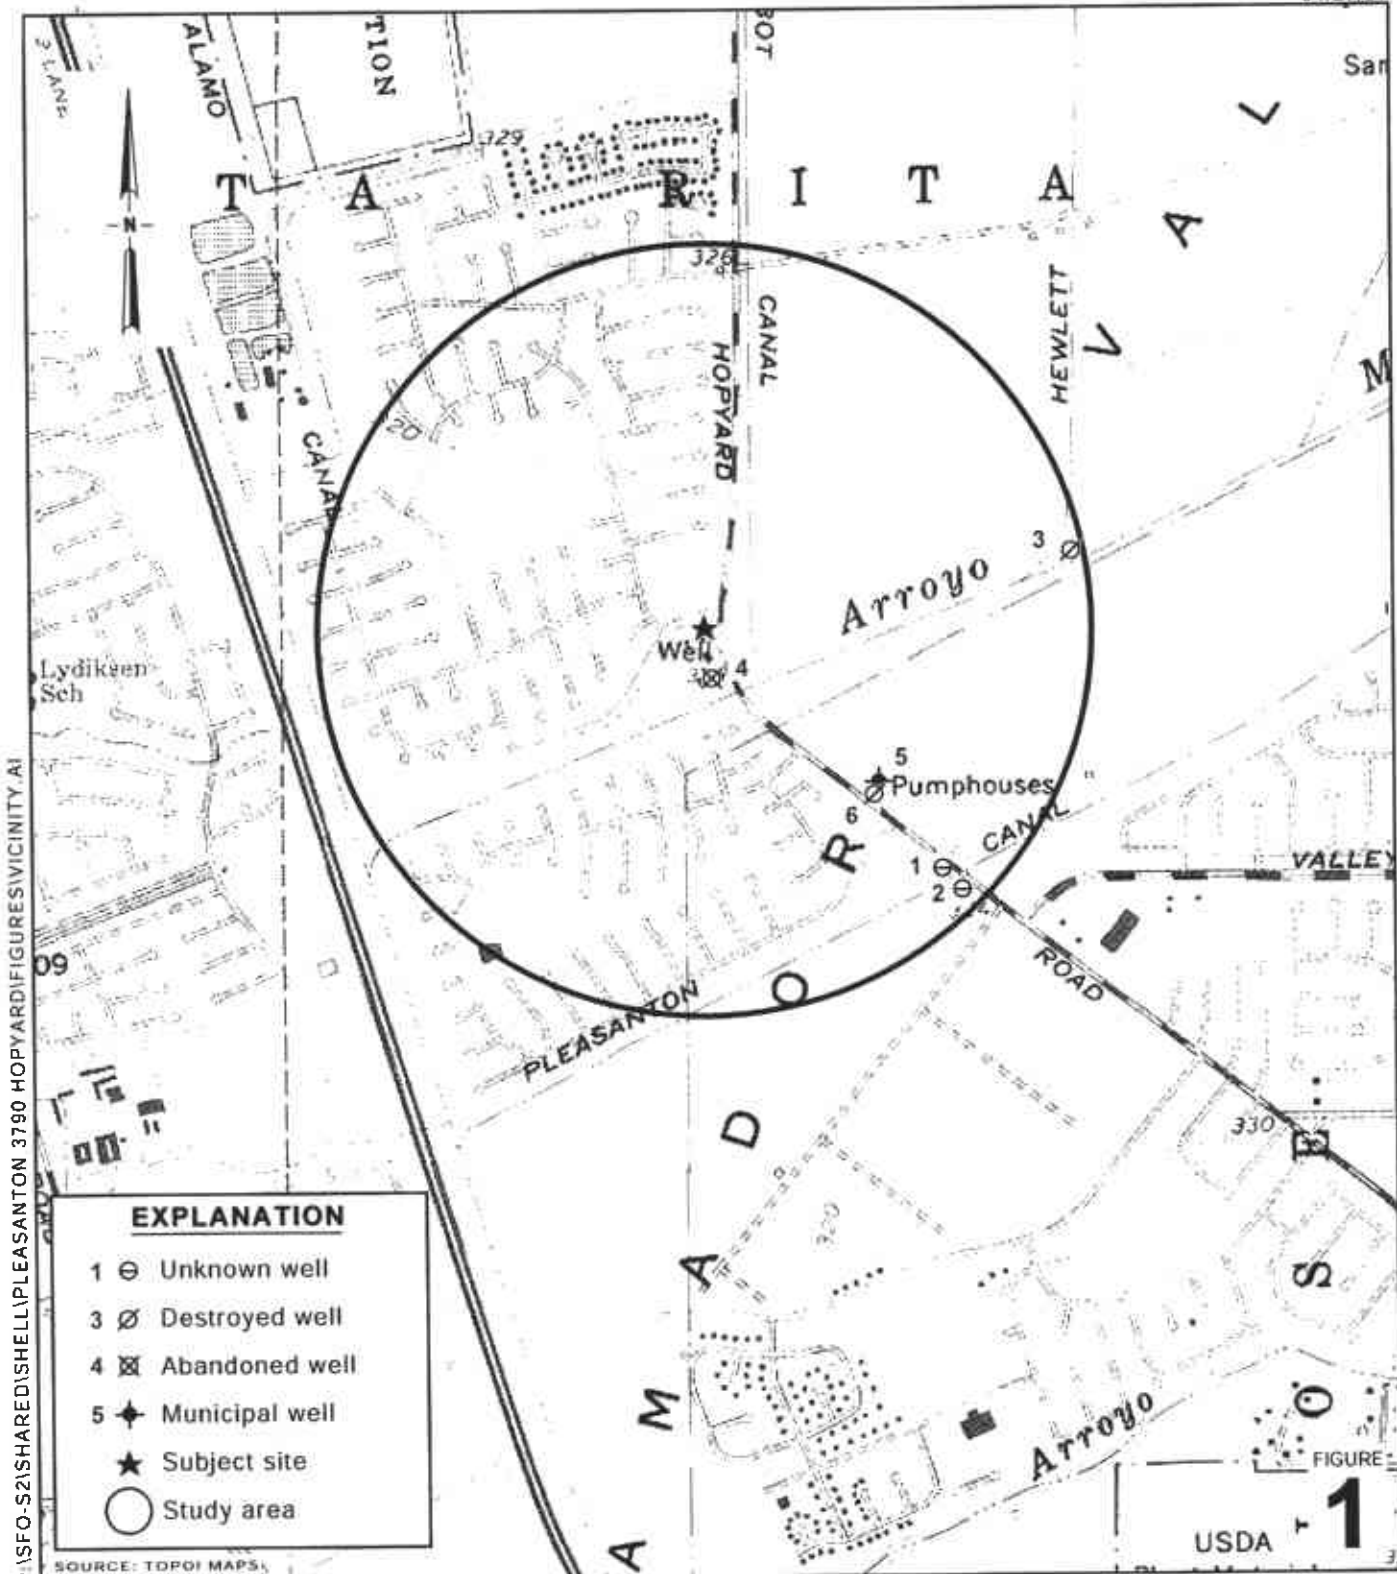

J:\SFO-S2\SHARED\SHELL\PLEASANTON 3790 HOPYARD\FIGURES\VICINITY.A1




Shell-branded Service Station
 3790 Hopyard Road
 Pleasanton, California



**CONESTOGA-ROVERS
 & ASSOCIATES**

Vicinity Map

EXPLANATION	
WO-1	• Soil sample location (2/14/07)
WO-W	▲ Grab groundwater sample location (2/14/07)
MW-1	◆ Monitoring well location
SR-1	⊕ Groundwater extraction well location
T-1	⊕ Existing tank backfill well location

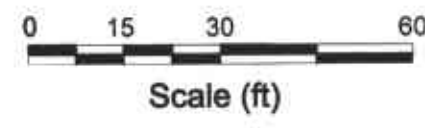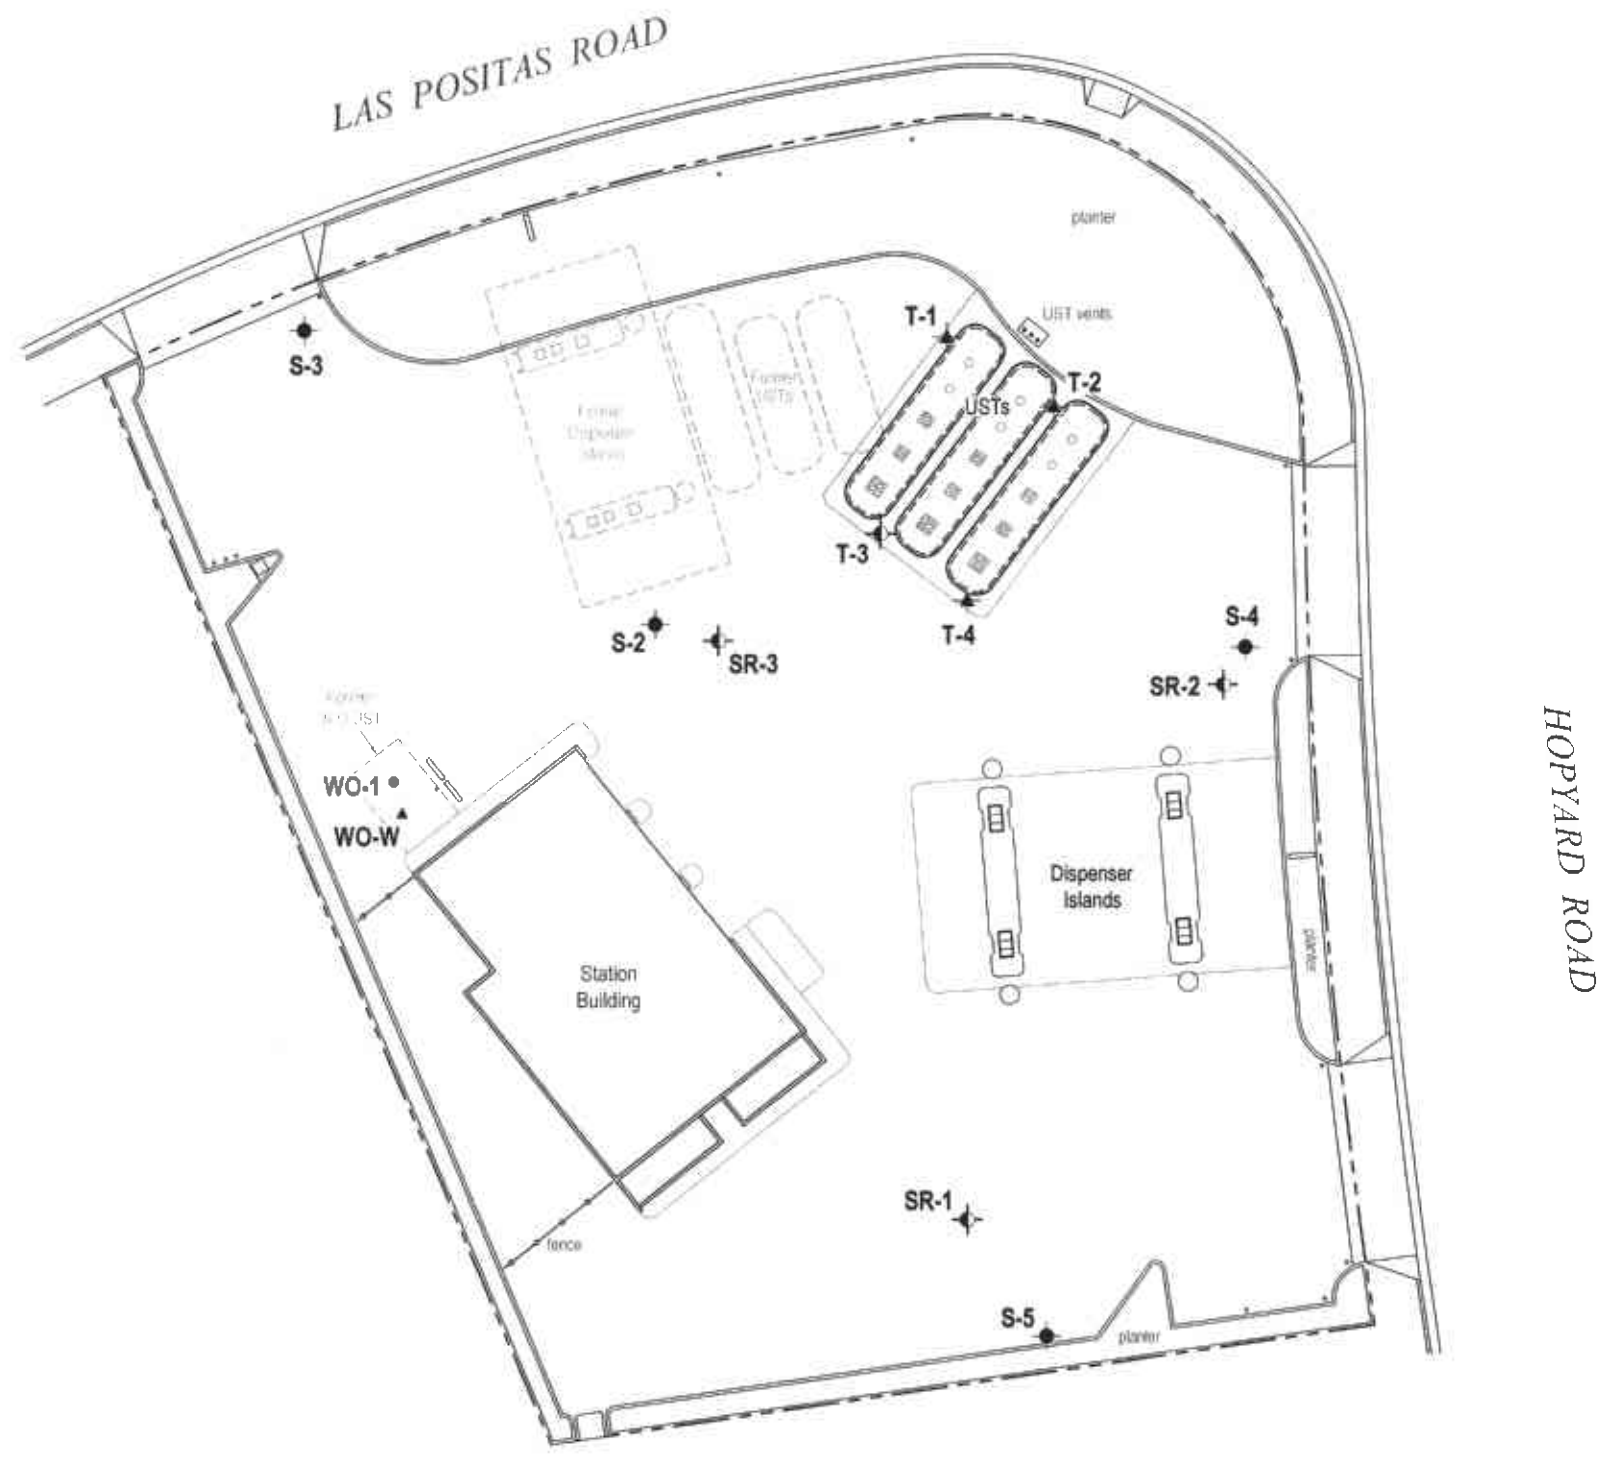

J:\SFO-SCS\HARD\HELL\PLAN\ANTON 3790 HOPYARD\FIGURE\SITE PLAN.DWG



FIGURE 2

Shell-branded Service Station
 3790 Hopyard Road
 Pleasanton, California

Table 1. Soil Analytical Data - Shell-branded Service Station, 3790 Hopyard Road, Pleasanton, California

Sample ID	Date Sampled	Depth (fbg)	O&G	TPHd	TPHg	B	T	E	X	Chlorinated Hydrocarbons	(mg/kg)										
											OXYs	1,2-DCA	EDB	Cd	Cr	Pb	Ni	Zn	PNAs	PCP	PCBs
WO-1-9	14-Feb-07	9	<1,500	<5.0	0.88	<0.00099	0.0017	0.010	0.057	ND	ND	<0.0020	<0.0020	<0.50	52	8.0	53	56	ND	<0.83	<0.096

SFBRWQCB ESLs for shallow soil where groundwater is a current or potential drinking water source (Residential Land Use)

--	100	100	0.044	2.3	3.3	2.3	Varies	Varies	0.0045	0.00033	1.7	58	150	150	600	Varies	4.4	0.22
----	------------	------------	--------------	------------	------------	------------	---------------	---------------	---------------	----------------	------------	-----------	------------	------------	------------	---------------	------------	-------------

Abbreviations and Notes:

- O&G = Oil and grease as hexane extractable material by EPA Method 1664 A (Modified)
- TPHd = Total petroleum hydrocarbons as diesel by EPA Method 8015 (Modified)
- TPHg = Total petroleum hydrocarbons as gasoline by EPA Method 8260B
- BTEX = Benzene, toluene, ethylbenzene, and total xylenes by EPA Method 8260B
- Chlorinated hydrocarbons by EPA Method 8260B; see laboratory analytical report for a complete list of specific constituents
- OXYs = Di-isopropyl ether, ethyl tertiary-butyl ether, tertiary-amyl methyl ether, and tertiary-butanol by EPA Method 8260B
- 1,2-DCA = 1,2-Dichloroethane by EPA Method 8260B
- EDB = 1,2-Dibromoethane by EPA Method 8260B
- Cd = Cadmium by EPA Method 6010B
- Cr = Chromium by EPA Method 6010B
- Pb = Lead by EPA Method 6010B
- Ni = Nickel by EPA Method 6010B
- Zn = Zinc by EPA Method 6010B
- PNAs = Polynuclear aromatics by EPA Method 8270C; see laboratory analytical report for a complete list of specific constituents
- PCP = Pentachlorophenol by EPA Method 8270C
- PCBs = Polychlorinated biphenyls by EPA Method 8082; see laboratory analytical report for a complete list of specific constituents
- fbg = Feet below grade
- mg/kg = Milligrams per kilogram (parts per million)
- <x = Not detected at reporting limit x
- ND = Not detected; see laboratory analytical report for constituent-specific reporting limits
- = No applicable environmental screening level

All detected constituents tabulated. See laboratory report for complete results.

Data in **BOLD** equals or exceeds applicable San Francisco Bay Regional Water Quality Control Board (SFBRWQCB) environmental screening level (ESL) value

Table 2. Grab Water Analytical Data - Shell-branded Service Station, 3790 Hopyard Road, Pleasanton, California

Sample ID	Date Sampled	O&G	TPHd	TPHg	B	T	E	X	Chlorinated		1,2-DCA	EDB	Cd	Cr	Pb	Ni	Zn	Benzoic Acid	PCP	PCBs	
									Hydrocarbons	MTBE											
(ug/L)																					
WO-W	14-Feb-07	<4,700	<480	<50	0.67	0.75	0.73	<1.0	ND	1.6	ND	<2.0	<0.50	<5.0	47	9.4	130	500	32	<20	<0.94
SFBRWQCB ESLs for groundwater which is a current or potential drinking water source (Residential Land Use)																					
		--	100	100	1.0	40	30	20	Varies	5.0	Varies	0.50	0.050	1.1	50	2.5	8.2	81	--	1.0	0.014

Abbreviations and Notes:

O&G = Oil and grease as hexane extractable material by EPA Method 1664 A (Modified)

TPHd = Total petroleum hydrocarbons as diesel by EPA Method 8015 (Modified)

TPHg = Total petroleum hydrocarbons as gasoline by EPA Method 8260B

BTEX = Benzene, toluene, ethylbenzene, and total xylenes by EPA Method 8260B

Chlorinated hydrocarbons by EPA Method 8260B; see laboratory analytical report for a complete list of specific constituents

MTBE = Methyl tertiary-butyl ether by EPA Method 8260B.

OXYs = Di-isopropyl ether, ethyl tertiary-butyl ether, tertiary-amyl methyl ether, and tertiary-butanol by EPA Method 8260B

1,2-DCA = 1,2-Dichloroethane by EPA Method 8260B

EDB = 1,2-Dibromoethane by EPA Method 8260B

Cd = Cadmium by EPA Method 6010B

Cr = Chromium by EPA Method 6010B

Pb = Lead by EPA Method 6010B

Ni = Nickel by EPA Method 6010B

Zn = Zinc by EPA Method 6010B

Benzoic Acid by EPA Method 8270C. No other polynuclear aromatics detected; see laboratory analytical report for a complete list of specific constituents

PCP = Pentachlorophenol by EPA Method 8270C

PCBs = Polychlorinated biphenyls by EPA Method 8082; see laboratory analytical report for a complete list of specific constituents

ug/L = Micrograms per liter (parts per billion)

<x = Not detected at reporting limit x

ND = Not detected; see laboratory analytical report for constituent-specific reporting limits

-- = No applicable environmental screening level

All detected constituents tabulated. See laboratory report for complete results.

Data in **BOLD** equals or exceeds applicable San Francisco Bay Regional Water Quality Control Board (SFBRWQCB) environmental screening level (ESL) value

ATTACHMENT A

Tank Removal Sampling Procedures

TANK REMOVAL SAMPLING PROCEDURES

This document describes Conestoga-Rovers and Associates (CRA) standard operating procedures for collecting soil and ground water samples during underground storage tank removal. These procedures ensure that the samples are collected, handled, and documented in compliance with California Administration Code Title 23: Waters; Chapter 3: Water Resources Control Board; Subchapter 16: Underground Storage Tank Regulations (Title 23). CRA's sampling procedures are based on guidelines contained in the California State Regional Water Quality Control Board Tri-Regional Staff Recommendations for Preliminary Evaluation and Investigation of Underground Tank Sites dated August 10, 1990.

Tank Removal Sampling

The objective of sample collection during routine underground storage tank removals is to determine whether hydrocarbons or other stored chemicals have leaked to the subsurface. If no ground water is encountered within the tank excavation, CRA will sample native soil 1 to 2 ft beneath the removed tank. Additional soil samples may also be collected at locations of obvious spillage to determine maximum concentrations in the surrounding soils. For underground storage tanks with a capacity of less than 1,000 gallons, one soil sample is collected beneath the fill end of the tank. For tanks with a capacity of between 1,000 and 10,000 gallons, one soil sample is collected beneath each end of the tank. For tanks larger than 10,000 gallons, 3 or more soil samples are collected beneath the removed tank. We also collect one soil sample for every 20 ft of product piping.

In cases where ground water is encountered within underground storage tank excavations, CRA will collect confirmatory soil samples from the excavation sidewalls just above the soil/ground water interface and a representative ground water sample from the excavation. The excavation is typically purged and allowed to recover prior to collecting the water sample. For tanks with capacities of 10,000 gallons or less, one soil sample is collected from the wall at each end of the tank excavation. For tanks with capacities greater than 10,000 gallons, or tank clusters, at least four soil samples are collected from the excavation walls next to the tank ends. Piping samples are collected in native soil 1 to 2 ft beneath the removed piping. One sample is typically collected for every 20 linear ft of piping unless regulatory agencies approve of different sampling requirements.

The soil samples are collected in steam cleaned brass or steel tubes from either a driven split-spoon type sampler or the bucket of a backhoe. When a backhoe is used, approximately three inches of soil are scraped from the surface and the tube is driven into the exposed soil.

Upon removal from the split-spoon sampler or the backhoe, the samples are trimmed flush, capped with Teflon sheets and plastic end caps, labeled, logged and refrigerated for delivery under chain of custody to a State certified analytic laboratory.

The ground water sample is collected using steam cleaned Teflon or PVC bailers, decanted into a volatile organic analysis (VOA) bottle or other appropriate clean sample container, refrigerated and transported under chain of custody to a State certified analytic laboratory.

ATTACHMENT B

Laboratory Analytical Reports


5 March, 2007

Aubrey Cool
Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville, CA 94608

RE: 3790 Hopyard Rd, Pleasanton
Work Order: SQB0322

Enclosed are the results of analyses for samples received by the laboratory on 02/15/07 16:00. If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Linda C. Laver
Project Manager

CA ELAP Certificate # 2630

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
WO-1-9	SQB0322-01	Soil	02/14/07 11:10	02/15/07 16:00
WO-W	SQB0322-02	Water	02/14/07 11:30	02/15/07 16:00

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

EXTRACTABLE FUEL HYDROCARBONS (CADHS/8015 Modified)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
DRO (C10-C28)	ND	5.0	mg/kg	1	7B19077	02/19/07	02/20/07	EPA 8015 MOD.	
Surrogate: n-Octacosane		78 %	40-125		"	"	"	"	
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
DRO (C10-C28)	ND	0.48	mg/l	1	7B20082	02/20/07	02/20/07	EPA 8015B	
Surrogate: n-Octacosane		65 %	40-125		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE FUEL HYDROCARBONS BY GC/MS (CA LUFT)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
Volatile Fuel Hydrocarbons (C4-C12)	0.88	0.20	mg/kg	1	7B17005	02/17/07	02/17/07	TPH by GC/MS	
Surrogate: Dibromofluoromethane		99 %	80-125		"	"	"	"	
Surrogate: Toluene-d8		104 %	80-120		"	"	"	"	
Surrogate: 4-Bromofluorobenzene		91 %	80-120		"	"	"	"	
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Volatile Fuel Hydrocarbons (C4-C12)	ND	50	ug/l	1	7B17003	02/17/07	02/17/07	TPH by GC/MS	
Surrogate: Dibromofluoromethane		103 %	80-120		"	"	"	"	
Surrogate: Toluene-d8		108 %	80-120		"	"	"	"	
Surrogate: 4-Bromofluorobenzene		104 %	80-120		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
Bromodichloromethane	ND	0.0020	mg/kg	1	7B17005	02/17/07	02/17/07 18:07	EPA 8260B	
Bromoform	ND	0.0049	"	"	"	"	"	"	
Bromomethane	ND	0.0049	"	"	"	"	"	"	
Carbon tetrachloride	ND	0.0049	"	"	"	"	"	"	
Chlorobenzene	ND	0.0020	"	"	"	"	"	"	
Chloroethane	ND	0.0049	"	"	"	"	"	"	
Chloroform	ND	0.0020	"	"	"	"	"	"	
Chloromethane	ND	0.0049	"	"	"	"	"	"	
Dibromochloromethane	ND	0.0020	"	"	"	"	"	"	
1,2-Dichlorobenzene	ND	0.0020	"	"	"	"	"	"	
1,3-Dichlorobenzene	ND	0.0020	"	"	"	"	"	"	
1,4-Dichlorobenzene	ND	0.0020	"	"	"	"	"	"	
Dichlorodifluoromethane	ND	0.0049	"	"	"	"	"	"	
1,1-Dichloroethane	ND	0.0020	"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.0020	"	"	"	"	"	"	
1,1-Dichloroethene	ND	0.0049	"	"	"	"	"	"	
cis-1,2-Dichloroethene	ND	0.0020	"	"	"	"	"	"	
trans-1,2-Dichloroethene	ND	0.0020	"	"	"	"	"	"	
1,2-Dichloropropane	ND	0.0020	"	"	"	"	"	"	
cis-1,3-Dichloropropene	ND	0.0020	"	"	"	"	"	"	
trans-1,3-Dichloropropene	ND	0.0020	"	"	"	"	"	"	
Methylene chloride	ND	0.020	"	"	"	"	"	"	
1,1,1,2-Tetrachloroethane	ND	0.0049	"	"	"	"	"	"	
1,1,2,2-Tetrachloroethane	ND	0.0020	"	"	"	"	"	"	
Tetrachloroethene	ND	0.0020	"	"	"	"	"	"	
1,1,1-Trichloroethane	ND	0.0020	"	"	"	"	"	"	
1,1,2-Trichloroethane	ND	0.0020	"	"	"	"	"	"	
Trichloroethene	ND	0.0020	"	"	"	"	"	"	
Trichlorofluoromethane	ND	0.0049	"	"	"	"	"	"	
Vinyl chloride	ND	0.0049	"	"	"	"	"	"	
Surrogate: Dibromofluoromethane		99 %	80-125	"	"	"	"	"	
Surrogate: Toluene-d8		104 %	80-120	"	"	"	"	"	
Surrogate: 4-Bromofluorobenzene		91 %	80-120	"	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.0020	"	"	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Bromodichloromethane	ND	2.0	ug/l	1	7B17003	02/17/07	02/17/07 14:47	EPA 8260B	
Bromoform	ND	5.0	"	"	"	"	"	"	
Bromomethane	ND	5.0	"	"	"	"	"	"	
Carbon tetrachloride	ND	5.0	"	"	"	"	"	"	
Chlorobenzene	ND	2.0	"	"	"	"	"	"	
Chloroethane	ND	5.0	"	"	"	"	"	"	
Chloroform	ND	2.0	"	"	"	"	"	"	
Chloromethane	ND	5.0	"	"	"	"	"	"	
Dibromochloromethane	ND	2.0	"	"	"	"	"	"	
1,2-Dichlorobenzene	ND	2.0	"	"	"	"	"	"	
1,3-Dichlorobenzene	ND	2.0	"	"	"	"	"	"	
1,4-Dichlorobenzene	ND	2.0	"	"	"	"	"	"	
Dichlorodifluoromethane	ND	5.0	"	"	"	"	"	"	
1,1-Dichloroethane	ND	2.0	"	"	"	"	"	"	
1,2-Dichloroethane	ND	2.0	"	"	"	"	"	"	
1,1-Dichloroethene	ND	5.0	"	"	"	"	"	"	
cis-1,2-Dichloroethene	ND	2.0	"	"	"	"	"	"	
trans-1,2-Dichloroethene	ND	2.0	"	"	"	"	"	"	
1,2-Dichloropropane	ND	2.0	"	"	"	"	"	"	
cis-1,3-Dichloropropene	ND	2.0	"	"	"	"	"	"	
trans-1,3-Dichloropropene	ND	2.0	"	"	"	"	"	"	
Methylene chloride	ND	5.0	"	"	"	"	"	"	
1,1,1,2-Tetrachloroethane	ND	5.0	"	"	"	"	"	"	
1,1,2,2-Tetrachloroethane	ND	2.0	"	"	"	"	"	"	
Tetrachloroethene	ND	2.0	"	"	"	"	"	"	
1,1,1-Trichloroethane	ND	2.0	"	"	"	"	"	"	
1,1,2-Trichloroethane	ND	2.0	"	"	"	"	"	"	
Trichloroethene	ND	2.0	"	"	"	"	"	"	
Trichlorofluoromethane	ND	5.0	"	"	"	"	"	"	
Vinyl chloride	ND	5.0	"	"	"	"	"	"	
Surrogate: Dibromofluoromethane		103 %		80-120	"	"	"	"	
Surrogate: Toluene-d8		108 %		80-120	"	"	"	"	
Surrogate: 4-Bromofluorobenzene		104 %		80-120	"	"	"	"	
1,2-Dibromoethane (EDB)	ND	0.50	"	"	"	"	"	"	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

BTEX/OXYGENATES by GC/MS (EPA 8260B)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
Benzene	ND	0.00099	mg/kg	1	7B17005	02/17/07	02/17/07	EPA 8260B	
Ethylbenzene	0.010	0.00099	"	"	"	"	"	"	
Toluene	0.0017	0.00099	"	"	"	"	"	"	
m,p-Xylenes	0.048	0.0020	"	"	"	"	"	"	
o-Xylene	0.0097	0.00099	"	"	"	"	"	"	
Xylenes, Total	0.057	0.0020	"	"	"	"	"	"	
Methyl-tert-butyl Ether (MTBE)	ND	0.0020	"	"	"	"	"	"	
Di-isopropyl Ether (DIPE)	ND	0.0020	"	"	"	"	"	"	
Ethyl tert-Butyl Ether (ETBE)	ND	0.0020	"	"	"	"	"	"	
tert-Amyl Methyl Ether (TAME)	ND	0.0020	"	"	"	"	"	"	
tert-Butanol (TBA)	ND	0.020	"	"	"	"	"	"	
Surrogate: Dibromofluoromethane		99 %	80-125	"	"	"	"	"	
Surrogate: Toluene-d8		104 %	80-120	"	"	"	"	"	
Surrogate: 4-Bromofluorobenzene		91 %	80-120	"	"	"	"	"	
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Benzene	0.67	0.50	ug/l	1	7B17003	02/17/07	02/17/07	EPA 8260B	
Ethylbenzene	0.73	0.50	"	"	"	"	"	"	
Toluene	0.75	0.50	"	"	"	"	"	"	
o-Xylene	ND	0.50	"	"	"	"	"	"	
m,p-Xylenes	ND	1.0	"	"	"	"	"	"	
Xylenes, Total	ND	1.0	"	"	"	"	"	"	
Methyl-tert-butyl Ether (MTBE)	1.6	1.0	"	"	"	"	"	"	
Di-isopropyl Ether (DIPE)	ND	1.0	"	"	"	"	"	"	
Ethyl tert-Butyl Ether (ETBE)	ND	1.0	"	"	"	"	"	"	
tert-Amyl Methyl Ether (TAME)	ND	1.0	"	"	"	"	"	"	
tert-Butanol (TBA)	ND	10	"	"	"	"	"	"	
Surrogate: Dibromofluoromethane		103 %	80-120	"	"	"	"	"	
Surrogate: Toluene-d8		108 %	80-120	"	"	"	"	"	
Surrogate: 4-Bromofluorobenzene		104 %	80-120	"	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00										
1,2,4-Trichlorobenzene	ND	9.8		ug/l	1	7B19095	02/19/07	02/23/07	EPA 8270C	
1,2-Dichlorobenzene	ND	9.8		"	"	"	"	"	"	
1,2-Diphenylhydrazine/Azobenzene	ND	20		"	"	"	"	"	"	
1,3-Dichlorobenzene	ND	9.8		"	"	"	"	"	"	
1,4-Dichlorobenzene	ND	9.8		"	"	"	"	"	"	
2,4,5-Trichlorophenol	ND	20		"	"	"	"	"	"	
2,4,6-Trichlorophenol	ND	20		"	"	"	"	"	"	
2,4-Dichlorophenol	ND	9.8		"	"	"	"	"	"	
2,4-Dimethylphenol	ND	20		"	"	"	"	"	"	
2,4-Dinitrophenol	ND	20		"	"	"	"	"	"	
2,4-Dinitrotoluene	ND	9.8		"	"	"	"	"	"	
2,6-Dinitrotoluene	ND	9.8		"	"	"	"	"	"	
2-Chloronaphthalene	ND	9.8		"	"	"	"	"	"	
2-Chlorophenol	ND	9.8		"	"	"	"	"	"	
2-Methylnaphthalene	ND	9.8		"	"	"	"	"	"	
2-Methylphenol	ND	9.8		"	"	"	"	"	"	
2-Nitroaniline	ND	20		"	"	"	"	"	"	
2-Nitrophenol	ND	9.8		"	"	"	"	"	"	
3,3-Dichlorobenzidine	ND	20		"	"	"	"	"	"	
3-Nitroaniline	ND	20		"	"	"	"	"	"	
4,6-Dinitro-2-methylphenol	ND	20		"	"	"	"	"	"	
4-Bromophenyl phenyl ether	ND	9.8		"	"	"	"	"	"	
4-Chloro-3-methylphenol	ND	20		"	"	"	"	"	"	
4-Chloroaniline	ND	9.8		"	"	"	"	"	"	
4-Chlorophenyl phenyl ether	ND	9.8		"	"	"	"	"	"	
4-Methylphenol	ND	9.8		"	"	"	"	"	"	
4-Nitroaniline	ND	20		"	"	"	"	"	"	
4-Nitrophenol	ND	20		"	"	"	"	"	"	
Acenaphthene	ND	9.8		"	"	"	"	"	"	
Acenaphthylene	ND	9.8		"	"	"	"	"	"	
Aniline	ND	9.8		"	"	"	"	"	"	
Anthracene	ND	9.8		"	"	"	"	"	"	
Benzidine	ND	20		"	"	"	"	"	"	L6
Benzo(a)anthracene	ND	9.8		"	"	"	"	"	"	
Benzo(a)pyrene	ND	9.8		"	"	"	"	"	"	L
Benzo(b)fluoranthene	ND	9.8		"	"	"	"	"	"	L
Benzo(g,h,i)perylene	ND	9.8		"	"	"	"	"	"	
Benzo(k)fluoranthene	ND	9.8		"	"	"	"	"	"	L
Benzoic acid	32	20		"	"	"	"	"	"	
Benzyl alcohol	ND	20		"	"	"	"	"	"	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
---------	--------	-----------------	-------	----------	-------	----------	----------	--------	-------

WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00

Bis(2-chloroethoxy)methane	ND	9.8	ug/l	1	7B19095	02/19/07	02/23/07	EPA 8270C	
Bis(2-chloroethyl)ether	ND	9.8	"	"	"	"	"	"	
Bis(2-chloroisopropyl)ether	ND	9.8	"	"	"	"	"	"	
Bis(2-ethylhexyl)phthalate	ND	49	"	"	"	"	"	"	
Butyl benzyl phthalate	ND	20	"	"	"	"	"	"	
Carbazole	ND	20	"	"	"	"	"	"	
Chrysene	ND	9.8	"	"	"	"	"	"	
Dibenz(a,h)anthracene	ND	20	"	"	"	"	"	"	
Dibenzofuran	ND	9.8	"	"	"	"	"	"	
Diethyl phthalate	ND	9.8	"	"	"	"	"	"	
Dimethyl phthalate	ND	9.8	"	"	"	"	"	"	
Di-n-butyl phthalate	ND	20	"	"	"	"	"	"	
Di-n-octyl phthalate	ND	20	"	"	"	"	"	"	
Fluoranthene	ND	9.8	"	"	"	"	"	"	
Fluorene	ND	9.8	"	"	"	"	"	"	
Hexachlorobenzene	ND	9.8	"	"	"	"	"	"	
Hexachlorobutadiene	ND	9.8	"	"	"	"	"	"	
Hexachlorocyclopentadiene	ND	20	"	"	"	"	"	"	
Hexachloroethane	ND	9.8	"	"	"	"	"	"	
Indeno(1,2,3-cd)pyrene	ND	20	"	"	"	"	"	"	
Isophorone	ND	9.8	"	"	"	"	"	"	
Naphthalene	ND	9.8	"	"	"	"	"	"	
Nitrobenzene	ND	20	"	"	"	"	"	"	
N-Nitrosodimethylamine	ND	20	"	"	"	"	"	"	
N-Nitroso-di-n-propylamine	ND	9.8	"	"	"	"	"	"	
N-Nitrosodiphenylamine	ND	9.8	"	"	"	"	"	"	
Pentachlorophenol	ND	20	"	"	"	"	"	"	
Phenanthrene	ND	9.8	"	"	"	"	"	"	
Phenol	ND	9.8	"	"	"	"	"	"	
Pyrene	ND	9.8	"	"	"	"	"	"	
Pyridine	ND	20	"	"	"	"	"	"	

Surrogate: 2,4,6-Tribromophenol	72 %	40-120	"	"	"	"	"	"	
Surrogate: 2-Fluorobiphenyl	83 %	45-120	"	"	"	"	"	"	
Surrogate: 2-Fluorophenol	69 %	30-120	"	"	"	"	"	"	
Surrogate: Nitrobenzene-d5	83 %	40-120	"	"	"	"	"	"	
Surrogate: Phenol-d6	72 %	35-120	"	"	"	"	"	"	
Surrogate: Terphenyl-d14	69 %	45-120	"	"	"	"	"	"	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
1,2,4-Trichlorobenzene	ND	0.33	mg/kg	1	7B19075	02/19/07	02/20/07	EPA 8270C	
1,2-Dichlorobenzene	ND	0.33	"	"	"	"	"	"	
1,2-Diphenylhydrazine/Azobenzene	ND	0.33	"	"	"	"	"	"	
1,3-Dichlorobenzene	ND	0.33	"	"	"	"	"	"	
1,4-Dichlorobenzene	ND	0.33	"	"	"	"	"	"	
2,4,5-Trichlorophenol	ND	0.33	"	"	"	"	"	"	
2,4,6-Trichlorophenol	ND	0.33	"	"	"	"	"	"	
2,4-Dichlorophenol	ND	0.33	"	"	"	"	"	"	
2,4-Dimethylphenol	ND	0.33	"	"	"	"	"	"	
2,4-Dinitrophenol	ND	0.66	"	"	"	"	"	"	
2,4-Dinitrotoluene	ND	0.33	"	"	"	"	"	"	
2,6-Dinitrotoluene	ND	0.33	"	"	"	"	"	"	
2-Chloronaphthalene	ND	0.33	"	"	"	"	"	"	
2-Chlorophenol	ND	0.33	"	"	"	"	"	"	
2-Methylnaphthalene	ND	0.33	"	"	"	"	"	"	
2-Methylphenol	ND	0.33	"	"	"	"	"	"	
2-Nitroaniline	ND	0.33	"	"	"	"	"	"	
2-Nitrophenol	ND	0.33	"	"	"	"	"	"	
3,3-Dichlorobenzidine	ND	0.83	"	"	"	"	"	"	
3-Nitroaniline	ND	0.33	"	"	"	"	"	"	
4,6-Dinitro-2-methylphenol	ND	0.42	"	"	"	"	"	"	
4-Bromophenyl phenyl ether	ND	0.33	"	"	"	"	"	"	
4-Chloro-3-methylphenol	ND	0.33	"	"	"	"	"	"	
4-Chloroaniline	ND	0.33	"	"	"	"	"	"	
4-Chlorophenyl phenyl ether	ND	0.33	"	"	"	"	"	"	
4-Methylphenol	ND	0.33	"	"	"	"	"	"	
4-Nitroaniline	ND	0.83	"	"	"	"	"	"	
4-Nitrophenol	ND	0.83	"	"	"	"	"	"	
Acenaphthene	ND	0.33	"	"	"	"	"	"	
Acenaphthylene	ND	0.33	"	"	"	"	"	"	
Aniline	ND	0.42	"	"	"	"	"	"	
Anthracene	ND	0.33	"	"	"	"	"	"	
Benzidine	ND	0.66	"	"	"	"	"	"	
Benzo(a)anthracene	ND	0.33	"	"	"	"	"	"	
Benzo(a)pyrene	ND	0.33	"	"	"	"	"	"	L
Benzo(b)fluoranthene	ND	0.33	"	"	"	"	"	"	L
Benzo(g,h,i)perylene	ND	0.33	"	"	"	"	"	"	L
Benzo(k)fluoranthene	ND	0.33	"	"	"	"	"	"	L
Benzyl alcohol	ND	0.33	"	"	"	"	"	"	
Bis(2-chloroethoxy)methane	ND	0.33	"	"	"	"	"	"	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00										
Bis(2-chloroethyl)ether	ND	0.17		mg/kg	1	7B19075	02/19/07	02/20/07	EPA 8270C	
Bis(2-chloroisopropyl)ether	ND	0.33		"	"	"	"	"	"	
Bis(2-ethylhexyl)phthalate	ND	0.33		"	"	"	"	"	"	
Butyl benzyl phthalate	ND	0.33		"	"	"	"	"	"	
Carbazole	ND	0.33		"	"	"	"	"	"	
Chrysene	ND	0.33		"	"	"	"	"	"	
Dibenz(a,h)anthracene	ND	0.42		"	"	"	"	"	"	L
Dibenzofuran	ND	0.33		"	"	"	"	"	"	
Diethyl phthalate	ND	0.33		"	"	"	"	"	"	
Dimethyl phthalate	ND	0.33		"	"	"	"	"	"	
Di-n-butyl phthalate	ND	0.33		"	"	"	"	"	"	
Di-n-octyl phthalate	ND	0.33		"	"	"	"	"	"	
Fluoranthene	ND	0.33		"	"	"	"	"	"	
Fluorene	ND	0.33		"	"	"	"	"	"	
Hexachlorobenzene	ND	0.33		"	"	"	"	"	"	
Hexachlorobutadiene	ND	0.33		"	"	"	"	"	"	
Hexachlorocyclopentadiene	ND	0.83		"	"	"	"	"	"	
Hexachloroethane	ND	0.33		"	"	"	"	"	"	
Indeno(1,2,3-cd)pyrene	ND	0.33		"	"	"	"	"	"	L
Isophorone	ND	0.33		"	"	"	"	"	"	
Naphthalene	ND	0.33		"	"	"	"	"	"	
Nitrobenzene	ND	0.33		"	"	"	"	"	"	
N-Nitrosodimethylamine	ND	0.33		"	"	"	"	"	"	
N-Nitroso-di-n-propylamine	ND	0.25		"	"	"	"	"	"	
N-Nitrosodiphenylamine	ND	0.33		"	"	"	"	"	"	
Pentachlorophenol	ND	0.83		"	"	"	"	"	"	
Phenanthrene	ND	0.33		"	"	"	"	"	"	
Phenol	ND	0.33		"	"	"	"	"	"	
Pyrene	ND	0.33		"	"	"	"	"	"	
Pyridine	ND	0.20		"	"	"	"	"	"	
Surrogate: 2,4,6-Tribromophenol		97 %		35-125		"	"	"	"	
Surrogate: 2-Fluorobiphenyl		94 %		35-120		"	"	"	"	
Surrogate: 2-Fluorophenol		76 %		25-120		"	"	"	"	
Surrogate: Nitrobenzene-d5		81 %		30-120		"	"	"	"	
Surrogate: Phenol-d6		79 %		35-120		"	"	"	"	
Surrogate: Terphenyl-d14		94 %		40-135		"	"	"	"	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
---------	--------	-----------------	-------	----------	-------	----------	----------	--------	-------

WO-1-9 (SQB0322-01RE2) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00

RL1

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Benzoic acid	ND	1.6	mg/kg	1	7B23065	02/23/07	02/24/07	EPA 8270C	
Surrogate: 2,4,6-Tribromophenol	109 %	35-125			"	"	"	"	
Surrogate: 2-Fluorobiphenyl	87 %	35-120			"	"	"	"	
Surrogate: 2-Fluorophenol	78 %	25-120			"	"	"	"	
Surrogate: Nitrobenzene-d5	83 %	30-120			"	"	"	"	
Surrogate: Phenol-d6	80 %	35-120			"	"	"	"	
Surrogate: Terphenyl-d14	116 %	40-135			"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

POLYCHLORINATED BIPHENYLS (EPA 3510C/8082)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Aroclor 1016	ND	0.94	ug/l	1	7B19088	02/19/07	02/20/07	EPA 8082	
Aroclor 1221	ND	0.94	"	"	"	"	"	"	
Aroclor 1232	ND	0.94	"	"	"	"	"	"	
Aroclor 1242	ND	0.94	"	"	"	"	"	"	
Aroclor 1248	ND	0.94	"	"	"	"	"	"	
Aroclor 1254	ND	0.94	"	"	"	"	"	"	
Aroclor 1260	ND	0.94	"	"	"	"	"	"	
<i>Surrogate: Decachlorobiphenyl</i>		82 %	45-120		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

POLYCHLORINATED BIPHENYLS (EPA 3545/8082)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00 RL1									
Aroclor 1016	ND	0.096	mg/kg	1	7B19093	02/19/07	02/21/07	EPA 8082	
Aroclor 1221	ND	0.096	"	"	"	"	"	"	
Aroclor 1232	ND	0.096	"	"	"	"	"	"	
Aroclor 1242	ND	0.096	"	"	"	"	"	"	
Aroclor 1248	ND	0.096	"	"	"	"	"	"	
Aroclor 1254	ND	0.096	"	"	"	"	"	"	
Aroclor 1260	ND	0.096	"	"	"	"	"	"	
<i>Surrogate: Decachlorobiphenyl</i>		114 %	45-120		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

METALS

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
Cadmium	ND	0.50	mg/kg	1	7B17042	02/17/07	02/19/07 12:03	EPA 6010B	
Chromium	52	1.0	"	"	"	"	"	"	
Lead	8.0	2.0	"	"	"	"	"	"	
Nickel	53	2.0	"	"	"	"	02/19/07 12:02	"	
Zinc	56	5.0	"	"	"	"	"	"	
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Cadmium	ND	0.0050	mg/l	1	7B16139	02/16/07	02/19/07 11:43	EPA 6010B	
Chromium	0.047	0.0050	"	"	"	"	"	"	
Lead	0.0094	0.0050	"	"	"	"	"	"	
Nickel	0.13	0.010	"	"	"	"	"	"	
Zinc	0.50	0.020	"	"	"	"	02/19/07 11:42	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

INORGANICS
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
WO-1-9 (SQB0322-01) Soil Sampled: 02/14/07 11:10 Received: 02/15/07 16:00									
Oil & Grease	ND	1500	mg/kg	1	7B20085	02/20/07	02/20/07	EPA 413.1 MOD.	
WO-W (SQB0322-02) Water Sampled: 02/14/07 11:30 Received: 02/15/07 16:00									
Oil & Grease	ND	4.7	mg/l	1	7B21095	02/21/07	02/21/07	EPA 413.1	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

EXTRACTABLE FUEL HYDROCARBONS (CADHS/8015 Modified) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19077 - CADHS LUFT / EPA 8015 MOD.

Blank (7B19077-BLK1)		Prepared: 02/19/07 Analyzed: 02/20/07								
EFH (C8 - C28)	ND	5.0	mg/kg							
Surrogate: n-Octacosane	6.40		"	6.67		96	40-125			
Laboratory Control Sample (7B19077-BS1)		Prepared: 02/19/07 Analyzed: 02/20/07								
EFH (C8 - C28)	26.2	5.0	mg/kg	33.3		79	40-115			
Surrogate: n-Octacosane	6.12		"	6.67		92	40-125			
Matrix Spike (7B19077-MS1)		Source: IQB1737-12		Prepared: 02/19/07 Analyzed: 02/20/07						
EFH (C8 - C28)	80.7	5.0	mg/kg	33.3	36	134	40-120			M1
Surrogate: n-Octacosane	6.27		"	6.67		94	40-125			
Matrix Spike Dup (7B19077-MSD1)		Source: IQB1737-12		Prepared: 02/19/07 Analyzed: 02/20/07						
EFH (C8 - C28)	85.9	5.0	mg/kg	33.3	36	150	40-120	6	30	M1
Surrogate: n-Octacosane	6.16		"	6.67		92	40-125			

Batch 7B20082 - EPA 3510C / EPA 8015B

Blank (7B20082-BLK1)		Prepared & Analyzed: 02/20/07								
EFH (C8 - C28)	ND	0.50	mg/l							
Surrogate: n-Octacosane	0.126		"	0.200		63	40-125			
Laboratory Control Sample (7B20082-BS1)		Prepared & Analyzed: 02/20/07								
EFH (C8 - C28)	0.751	0.50	mg/l	1.00		75	40-115			MNR1
Surrogate: n-Octacosane	0.136		"	0.200		68	40-125			
Laboratory Control Sample Dup (7B20082-BSD1)		Prepared & Analyzed: 02/20/07								
EFH (C8 - C28)	0.775	0.50	mg/l	1.00		78	40-115	3	25	
Surrogate: n-Octacosane	0.145		"	0.200		72	40-125			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE FUEL HYDROCARBONS BY GC/MS (CA LUFT) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / TPH by GC/MS

Blank (7B17003-BLK1)

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	ND	50	ug/l							
Surrogate: Dibromofluoromethane	24.8		"	25.0		99	80-120			
Surrogate: Toluene-d8	26.6		"	25.0		106	80-120			
Surrogate: 4-Bromofluorobenzene	26.8		"	25.0		107	80-120			

Laboratory Control Sample (7B17003-BS2)

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	338	50	ug/l	500		68	55-130			
Surrogate: Dibromofluoromethane	23.6		"	25.0		94	80-120			
Surrogate: Toluene-d8	27.0		"	25.0		108	80-120			
Surrogate: 4-Bromofluorobenzene	26.8		"	25.0		107	80-120			

Matrix Spike (7B17003-MS1)

Source: IQB1831-01

Prepared & Analyzed: 02/17/07

P1

Volatile Fuel Hydrocarbons (C4-C12)	1170	50	ug/l	1720	ND	68	50-145			
Surrogate: Dibromofluoromethane	26.6		"	25.0		106	80-120			
Surrogate: Toluene-d8	27.3		"	25.0		109	80-120			
Surrogate: 4-Bromofluorobenzene	27.2		"	25.0		109	80-120			

Matrix Spike Dup (7B17003-MSD1)

Source: IQB1831-01

Prepared & Analyzed: 02/17/07

P1

Volatile Fuel Hydrocarbons (C4-C12)	1290	50	ug/l	1720	ND	75	50-145	10	20	
Surrogate: Dibromofluoromethane	26.9		"	25.0		108	80-120			
Surrogate: Toluene-d8	27.1		"	25.0		108	80-120			
Surrogate: 4-Bromofluorobenzene	27.0		"	25.0		108	80-120			

Batch 7B17005 - EPA 5030B GCMS / TPH by GC/MS

Blank (7B17005-BLK1)

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	ND	0.20	mg/kg							
Surrogate: Dibromofluoromethane	0.0514		"	0.0500		103	80-125			
Surrogate: Toluene-d8	0.0518		"	0.0500		104	80-120			
Surrogate: 4-Bromofluorobenzene	0.0536		"	0.0500		107	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE FUEL HYDROCARBONS BY GC/MS (CA LUFT) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / TPH by GC/MS

Laboratory Control Sample (7B17005-BS2)

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	0.842	0.20	mg/kg	1.00		84	60-130			
Surrogate: Dibromofluoromethane	0.0539		"	0.0500		108	80-125			
Surrogate: Toluene-d8	0.0534		"	0.0500		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0550		"	0.0500		110	80-120			

Matrix Spike (7B17005-MS1)

Source: IQB1465-01

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	2.15	0.20	mg/kg	3.44	ND	62	60-135			
Surrogate: Dibromofluoromethane	0.0519		"	0.0498		104	80-125			
Surrogate: Toluene-d8	0.0531		"	0.0498		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0535		"	0.0498		107	80-120			

Matrix Spike Dup (7B17005-MSD1)

Source: IQB1465-01

Prepared & Analyzed: 02/17/07

Volatile Fuel Hydrocarbons (C4-C12)	2.15	0.20	mg/kg	3.42	ND	63	60-135	0	25	
Surrogate: Dibromofluoromethane	0.0518		"	0.0496		104	80-125			
Surrogate: Toluene-d8	0.0530		"	0.0496		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0516		"	0.0496		104	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Blank (7B17003-BLK1)

Prepared & Analyzed: 02/17/07

Bromodichloromethane	ND	2.0	ug/l							
Bromoform	ND	5.0	"							
Bromomethane	ND	5.0	"							
Carbon tetrachloride	ND	5.0	"							
Chlorobenzene	ND	2.0	"							
Chloroethane	ND	5.0	"							
Chloroform	ND	2.0	"							
Chloromethane	ND	5.0	"							
Dibromochloromethane	ND	2.0	"							
1,2-Dibromoethane (EDB)	ND	0.50	"							
1,2-Dichlorobenzene	ND	2.0	"							
1,3-Dichlorobenzene	ND	2.0	"							
1,4-Dichlorobenzene	ND	2.0	"							
Dichlorodifluoromethane	ND	5.0	"							
1,1-Dichloroethane	ND	2.0	"							
1,2-Dichloroethane	ND	2.0	"							
1,2-Dichloroethane	ND	0.50	"							
1,1-Dichloroethene	ND	5.0	"							
cis-1,2-Dichloroethene	ND	2.0	"							
trans-1,2-Dichloroethene	ND	2.0	"							
1,2-Dichloropropane	ND	2.0	"							
cis-1,3-Dichloropropene	ND	2.0	"							
trans-1,3-Dichloropropene	ND	2.0	"							
Methylene chloride	ND	5.0	"							
1,1,1,2-Tetrachloroethane	ND	5.0	"							
1,1,2,2-Tetrachloroethane	ND	2.0	"							
Tetrachloroethene	ND	2.0	"							
1,1,1-Trichloroethane	ND	2.0	"							
1,1,2-Trichloroethane	ND	2.0	"							
Trichloroethene	ND	2.0	"							
Trichlorofluoromethane	ND	5.0	"							
Vinyl chloride	ND	5.0	"							
Surrogate: Dibromofluoromethane	24.8		"	25.0		99	80-120			
Surrogate: Dibromofluoromethane	24.8		"	25.0		99	80-120			
Surrogate: Toluene-d8	26.6		"	25.0		106	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Blank (7B17003-BLK1)

Prepared & Analyzed: 02/17/07

Surrogate: Toluene-d8	26.6		ug/l	25.0		106	80-120			
Surrogate: 4-Bromofluorobenzene	26.8		"	25.0		107	80-120			
Surrogate: 4-Bromofluorobenzene	26.8		"	25.0		107	80-120			

Laboratory Control Sample (7B17003-BS1)

Prepared & Analyzed: 02/17/07

Bromodichloromethane	25.0	2.0	ug/l	25.0		100	70-135			
Bromoform	21.0	5.0	"	25.0		84	55-130			
Bromomethane	26.9	5.0	"	25.0		108	65-140			
Carbon tetrachloride	23.4	5.0	"	25.0		94	65-140			
Chlorobenzene	25.4	2.0	"	25.0		102	75-120			
Chloroethane	25.6	5.0	"	25.0		102	60-140			
Chloroform	24.4	2.0	"	25.0		98	70-130			
Chloromethane	27.7	5.0	"	25.0		111	50-140			
Dibromochloromethane	22.6	2.0	"	25.0		90	70-140			
1,2-Dibromoethane (EDB)	25.7	0.50	"	25.0		103	75-125			
1,2-Dichlorobenzene	25.7	2.0	"	25.0		103	75-120			
1,3-Dichlorobenzene	25.9	2.0	"	25.0		104	75-120			
1,4-Dichlorobenzene	25.6	2.0	"	25.0		102	75-120			
Dichlorodifluoromethane	28.7	5.0	"	25.0		115	35-155			
1,1-Dichloroethane	24.8	2.0	"	25.0		99	70-125			
1,2-Dichloroethane	24.0	2.0	"	25.0		96	60-140			
1,2-Dichloroethane	24.0	0.50	"	25.0		96	60-140			
1,1-Dichloroethene	23.2	5.0	"	25.0		93	70-125			
cis-1,2-Dichloroethene	25.7	2.0	"	25.0		103	70-125			
trans-1,2-Dichloroethene	25.9	2.0	"	25.0		104	70-125			
1,2-Dichloropropane	26.7	2.0	"	25.0		107	70-125			
cis-1,3-Dichloropropene	24.4	2.0	"	25.0		98	75-125			
trans-1,3-Dichloropropene	24.0	2.0	"	25.0		96	70-125			
Methylene chloride	23.5	5.0	"	25.0		94	55-130			
1,1,1,2-Tetrachloroethane	24.4	5.0	"	25.0		98	70-130			
1,1,2,2-Tetrachloroethane	26.2	2.0	"	25.0		105	55-130			
Tetrachloroethene	25.7	2.0	"	25.0		103	70-125			
1,1,1-Trichloroethane	23.2	2.0	"	25.0		93	65-135			
1,1,2-Trichloroethane	27.0	2.0	"	25.0		108	70-125			
Trichloroethene	25.4	2.0	"	25.0		102	70-125			
Trichlorofluoromethane	23.8	5.0	"	25.0		95	65-145			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Laboratory Control Sample (7B17003-BS1)

Prepared & Analyzed: 02/17/07

Vinyl chloride	27.2	5.0	ug/l	25.0		109	55-135			
Surrogate: Dibromofluoromethane	24.2		"	25.0		97	80-120			
Surrogate: Dibromofluoromethane	24.2		"	25.0		97	80-120			
Surrogate: Toluene-d8	27.0		"	25.0		108	80-120			
Surrogate: Toluene-d8	27.0		"	25.0		108	80-120			
Surrogate: 4-Bromofluorobenzene	26.3		"	25.0		105	80-120			
Surrogate: 4-Bromofluorobenzene	26.3		"	25.0		105	80-120			

Matrix Spike (7B17003-MS1)

Source: IQB1831-01

Prepared & Analyzed: 02/17/07

P1

Bromodichloromethane	26.0	2.0	ug/l	25.0	ND	104	70-135			
Bromofom	21.7	5.0	"	25.0	ND	87	55-135			
Bromomethane	26.4	5.0	"	25.0	ND	106	55-145			
Carbon tetrachloride	22.3	5.0	"	25.0	ND	89	65-140			
Chlorobenzene	25.2	2.0	"	25.0	ND	101	75-125			
Chloroethane	26.6	5.0	"	25.0	ND	106	55-140			
Chloroform	25.8	2.0	"	25.0	ND	103	65-135			
Chloromethane	26.0	5.0	"	25.0	ND	104	45-145			
Dibromochloromethane	23.5	2.0	"	25.0	ND	94	65-140			
1,2-Dibromoethane (EDB)	26.1	0.50	"	25.0	ND	104	70-130			
1,2-Dichlorobenzene	25.8	2.0	"	25.0	ND	103	75-125			
1,3-Dichlorobenzene	25.5	2.0	"	25.0	ND	102	75-125			
1,4-Dichlorobenzene	24.8	2.0	"	25.0	ND	99	75-125			
Dichlorodifluoromethane	26.6	5.0	"	25.0	ND	106	25-155			
1,1-Dichloroethane	25.9	2.0	"	25.0	ND	104	65-130			
1,2-Dichloroethane	24.9	2.0	"	25.0	ND	100	60-140			
1,2-Dichloroethane	24.9	0.50	"	25.0	ND	100	60-140			
1,1-Dichloroethene	22.8	5.0	"	25.0	ND	91	60-130			
cis-1,2-Dichloroethene	26.4	2.0	"	25.0	ND	106	65-130			
trans-1,2-Dichloroethene	26.0	2.0	"	25.0	ND	104	65-130			
1,2-Dichloropropane	27.6	2.0	"	25.0	ND	110	65-130			
cis-1,3-Dichloropropene	25.4	2.0	"	25.0	ND	102	70-130			
trans-1,3-Dichloropropene	25.7	2.0	"	25.0	ND	103	65-135			
Methylene chloride	24.7	5.0	"	25.0	ND	99	50-135			
1,1,1,2-Tetrachloroethane	25.1	5.0	"	25.0	ND	100	65-140			
1,1,2,2-Tetrachloroethane	26.9	2.0	"	25.0	ND	108	55-135			
Tetrachloroethene	24.0	2.0	"	25.0	ND	96	65-130			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Matrix Spike (7B17003-MS1)	Source: IQB1831-01			Prepared & Analyzed: 02/17/07				P1		
1,1,1-Trichloroethane	23.6	2.0	ug/l	25.0	ND	94	65-140			
1,1,2-Trichloroethane	27.9	2.0	"	25.0	ND	112	65-130			
Trichloroethene	24.1	2.0	"	25.0	ND	96	65-125			
Trichlorofluoromethane	23.6	5.0	"	25.0	ND	94	60-145			
Vinyl chloride	27.0	5.0	"	25.0	ND	108	45-140			
<i>Surrogate: Dibromofluoromethane</i>	26.6		"	25.0		106	80-120			
<i>Surrogate: Dibromofluoromethane</i>	26.6		"	25.0		106	80-120			
<i>Surrogate: Toluene-d8</i>	27.3		"	25.0		109	80-120			
<i>Surrogate: Toluene-d8</i>	27.3		"	25.0		109	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	27.2		"	25.0		109	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	27.2		"	25.0		109	80-120			

Matrix Spike Dup (7B17003-MSD1)	Source: IQB1831-01			Prepared & Analyzed: 02/17/07				P1		
Bromodichloromethane	29.5	2.0	ug/l	25.0	ND	118	70-135	13	20	
Bromoform	24.6	5.0	"	25.0	ND	98	55-135	13	25	
Bromomethane	29.8	5.0	"	25.0	ND	119	55-145	12	25	
Carbon tetrachloride	24.5	5.0	"	25.0	ND	98	65-140	9	25	
Chlorobenzene	28.7	2.0	"	25.0	ND	115	75-125	13	20	
Chloroethane	29.3	5.0	"	25.0	ND	117	55-140	10	25	
Chloroform	29.4	2.0	"	25.0	ND	118	65-135	13	20	
Chloromethane	28.4	5.0	"	25.0	ND	114	45-145	9	25	
Dibromochloromethane	27.3	2.0	"	25.0	ND	109	65-140	15	25	
1,2-Dibromoethane (EDB)	29.7	0.50	"	25.0	ND	119	70-130	13	25	
1,2-Dichlorobenzene	29.2	2.0	"	25.0	ND	117	75-125	12	20	
1,3-Dichlorobenzene	29.0	2.0	"	25.0	ND	116	75-125	13	20	
1,4-Dichlorobenzene	28.5	2.0	"	25.0	ND	114	75-125	14	20	
Dichlorodifluoromethane	29.0	5.0	"	25.0	ND	116	25-155	9	30	
1,1-Dichloroethane	29.4	2.0	"	25.0	ND	118	65-130	13	20	
1,2-Dichloroethane	28.4	0.50	"	25.0	ND	114	60-140	13	20	
1,2-Dichloroethane	28.4	2.0	"	25.0	ND	114	60-140	13	20	
1,1-Dichloroethene	25.4	5.0	"	25.0	ND	102	60-130	11	20	
cis-1,2-Dichloroethene	30.2	2.0	"	25.0	ND	121	65-130	13	20	
trans-1,2-Dichloroethene	29.7	2.0	"	25.0	ND	119	65-130	13	20	
1,2-Dichloropropane	31.7	2.0	"	25.0	ND	127	65-130	14	20	
cis-1,3-Dichloropropene	28.7	2.0	"	25.0	ND	115	70-130	12	20	
trans-1,3-Dichloropropene	28.9	2.0	"	25.0	ND	116	65-135	12	25	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Matrix Spike Dup (7B17003-MSD1)	Source: IQB1831-01	Prepared & Analyzed: 02/17/07									P1
Methylene chloride	28.4	5.0	ug/l	25.0	ND	114	50-135	14	20		
1,1,1,2-Tetrachloroethane	29.0	5.0	"	25.0	ND	116	65-140	14	20		
1,1,2,2-Tetrachloroethane	31.6	2.0	"	25.0	ND	126	55-135	16	30		
Tetrachloroethene	26.8	2.0	"	25.0	ND	107	65-130	11	20		
1,1,1-Trichloroethane	26.4	2.0	"	25.0	ND	106	65-140	11	20		
1,1,2-Trichloroethane	31.7	2.0	"	25.0	ND	127	65-130	13	25		
Trichloroethene	27.1	2.0	"	25.0	ND	108	65-125	12	20		
Trichlorofluoromethane	25.9	5.0	"	25.0	ND	104	60-145	9	25		
Vinyl chloride	29.7	5.0	"	25.0	ND	119	45-140	10	30		
Surrogate: Dibromofluoromethane	26.9		"	25.0		108	80-120				
Surrogate: Dibromofluoromethane	26.9		"	25.0		108	80-120				
Surrogate: Toluene-d8	27.1		"	25.0		108	80-120				
Surrogate: Toluene-d8	27.1		"	25.0		108	80-120				
Surrogate: 4-Bromofluorobenzene	27.0		"	25.0		108	80-120				
Surrogate: 4-Bromofluorobenzene	27.0		"	25.0		108	80-120				

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Blank (7B17005-BLK1)	Prepared & Analyzed: 02/17/07									
Bromodichloromethane	ND	0.0020	mg/kg							
Bromoform	ND	0.0050	"							
Bromomethane	ND	0.0050	"							
Carbon tetrachloride	ND	0.0050	"							
Chlorobenzene	ND	0.0020	"							
Chloroethane	ND	0.0050	"							
Chloroform	ND	0.0020	"							
Chloromethane	ND	0.0050	"							
Dibromochloromethane	ND	0.0020	"							
1,2-Dibromoethane (EDB)	ND	0.0020	"							
1,2-Dichlorobenzene	ND	0.0020	"							
1,3-Dichlorobenzene	ND	0.0020	"							
1,4-Dichlorobenzene	ND	0.0020	"							
Dichlorodifluoromethane	ND	0.0050	"							
1,1-Dichloroethane	ND	0.0020	"							
1,2-Dichloroethane	ND	0.0020	"							
1,2-Dichloroethane	ND	0.0020	"							

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Blank (7B17005-BLK1)

Prepared & Analyzed: 02/17/07

1,1-Dichloroethene	ND	0.0050	mg/kg							
cis-1,2-Dichloroethene	ND	0.0020	"							
trans-1,2-Dichloroethene	ND	0.0020	"							
1,2-Dichloropropane	ND	0.0020	"							
cis-1,3-Dichloropropene	ND	0.0020	"							
trans-1,3-Dichloropropene	ND	0.0020	"							
Methylene chloride	ND	0.020	"							
1,1,1,2-Tetrachloroethane	ND	0.0050	"							
1,1,2,2-Tetrachloroethane	ND	0.0020	"							
Tetrachloroethene	ND	0.0020	"							
1,1,1-Trichloroethane	ND	0.0020	"							
1,1,2-Trichloroethane	ND	0.0020	"							
Trichloroethene	ND	0.0020	"							
Trichlorofluoromethane	ND	0.0050	"							
Vinyl chloride	ND	0.0050	"							
<i>Surrogate: Dibromofluoromethane</i>	<i>0.0514</i>		"	<i>0.0500</i>		<i>103</i>	<i>80-125</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>0.0514</i>		"	<i>0.0500</i>		<i>103</i>	<i>80-125</i>			
<i>Surrogate: Toluene-d8</i>	<i>0.0518</i>		"	<i>0.0500</i>		<i>104</i>	<i>80-120</i>			
<i>Surrogate: Toluene-d8</i>	<i>0.0518</i>		"	<i>0.0500</i>		<i>104</i>	<i>80-120</i>			
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>0.0536</i>		"	<i>0.0500</i>		<i>107</i>	<i>80-120</i>			
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>0.0536</i>		"	<i>0.0500</i>		<i>107</i>	<i>80-120</i>			

Laboratory Control Sample (7B17005-BS1)

Prepared & Analyzed: 02/17/07

Bromodichloromethane	0.0519	0.0020	mg/kg	0.0500		104	70-135			
Bromoform	0.0558	0.0050	"	0.0500		112	55-135			
Bromomethane	0.0506	0.0050	"	0.0500		101	60-145			
Carbon tetrachloride	0.0475	0.0050	"	0.0500		95	65-140			
Chlorobenzene	0.0507	0.0020	"	0.0500		101	75-120			
Chloroethane	0.0458	0.0050	"	0.0500		92	60-140			
Chloroform	0.0480	0.0020	"	0.0500		96	70-130			
Chloromethane	0.0476	0.0050	"	0.0500		95	45-145			
Dibromochloromethane	0.0549	0.0020	"	0.0500		110	65-140			
1,2-Dibromoethane (EDB)	0.0519	0.0020	"	0.0500		104	70-130			
1,2-Dichlorobenzene	0.0515	0.0020	"	0.0500		103	75-120			
1,3-Dichlorobenzene	0.0503	0.0020	"	0.0500		101	75-125			
1,4-Dichlorobenzene	0.0510	0.0020	"	0.0500		102	75-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Laboratory Control Sample (7B17005-BS1)

Prepared & Analyzed: 02/17/07

Dichlorodifluoromethane	0.0514	0.0050	mg/kg	0.0500		103	35-160			
1,1-Dichloroethane	0.0459	0.0020	"	0.0500		92	70-130			
1,2-Dichloroethane	0.0514	0.0020	"	0.0500		103	60-140			
1,2-Dichloroethane	0.0514	0.0020	"	0.0500		103	60-140			
1,1-Dichloroethene	0.0422	0.0050	"	0.0500		84	70-125			
cis-1,2-Dichloroethene	0.0493	0.0020	"	0.0500		99	70-125			
trans-1,2-Dichloroethene	0.0480	0.0020	"	0.0500		96	70-125			
1,2-Dichloropropane	0.0517	0.0020	"	0.0500		103	70-130			
cis-1,3-Dichloropropene	0.0497	0.0020	"	0.0500		99	75-125			
trans-1,3-Dichloropropene	0.0509	0.0020	"	0.0500		102	70-135			
Methylene chloride	0.0441	0.020	"	0.0500		88	55-135			
1,1,1,2-Tetrachloroethane	0.0517	0.0050	"	0.0500		103	70-130			
1,1,2,2-Tetrachloroethane	0.0477	0.0020	"	0.0500		95	55-140			
Tetrachloroethene	0.0500	0.0020	"	0.0500		100	70-125			
1,1,1-Trichloroethane	0.0454	0.0020	"	0.0500		91	65-135			
1,1,2-Trichloroethane	0.0546	0.0020	"	0.0500		109	65-135			
Trichloroethene	0.0518	0.0020	"	0.0500		104	70-125			
Trichlorofluoromethane	0.0467	0.0050	"	0.0500		93	60-145			
Vinyl chloride	0.0478	0.0050	"	0.0500		96	55-135			
Surrogate: Dibromofluoromethane	0.0515		"	0.0500		103	80-125			
Surrogate: Dibromofluoromethane	0.0515		"	0.0500		103	80-125			
Surrogate: Toluene-d8	0.0537		"	0.0500		107	80-120			
Surrogate: Toluene-d8	0.0537		"	0.0500		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0529		"	0.0500		106	80-120			
Surrogate: 4-Bromofluorobenzene	0.0529		"	0.0500		106	80-120			

Matrix Spike (7B17005-MS1)

Source: IQB1465-01

Prepared & Analyzed: 02/17/07

Bromodichloromethane	0.0532	0.0020	mg/kg	0.0498	ND	107	65-145			
Bromoform	0.0602	0.0050	"	0.0498	ND	121	50-145			
Bromomethane	0.0526	0.0050	"	0.0498	ND	106	60-155			
Carbon tetrachloride	0.0481	0.0050	"	0.0498	ND	97	60-145			
Chlorobenzene	0.0530	0.0020	"	0.0498	ND	106	70-130			
Chloroethane	0.0488	0.0050	"	0.0498	ND	98	60-150			
Chloroform	0.0502	0.0020	"	0.0498	ND	101	65-135			
Chloromethane	0.0486	0.0050	"	0.0498	ND	98	40-145			
Dibromochloromethane	0.0584	0.0020	"	0.0498	ND	117	60-145			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Matrix Spike (7B17005-MS1)	Source: IQB1465-01	Prepared & Analyzed: 02/17/07								
1,2-Dibromoethane (EDB)	0.0560	0.0020	mg/kg	0.0498	ND	112	65-140			
1,2-Dichlorobenzene	0.0552	0.0020	"	0.0498	ND	111	70-130			
1,3-Dichlorobenzene	0.0534	0.0020	"	0.0498	ND	107	70-130			
1,4-Dichlorobenzene	0.0539	0.0020	"	0.0498	ND	108	70-130			
Dichlorodifluoromethane	0.0508	0.0050	"	0.0498	ND	102	30-160			
1,1-Dichloroethane	0.0479	0.0020	"	0.0498	ND	96	65-135			
1,2-Dichloroethane	0.0530	0.0020	"	0.0498	ND	106	60-150			
1,2-Dichloroethane	0.0530	0.0020	"	0.0498	ND	106	60-150			
1,1-Dichloroethene	0.0436	0.0050	"	0.0498	ND	88	65-135			
cis-1,2-Dichloroethene	0.0510	0.0020	"	0.0498	ND	102	65-135			
trans-1,2-Dichloroethene	0.0501	0.0020	"	0.0498	ND	101	70-135			
1,2-Dichloropropane	0.0533	0.0020	"	0.0498	ND	107	65-130			
cis-1,3-Dichloropropene	0.0514	0.0020	"	0.0498	ND	103	70-135			
trans-1,3-Dichloropropene	0.0526	0.0020	"	0.0498	ND	106	60-145			
Methylene chloride	0.0465	0.020	"	0.0498	ND	93	55-145			
1,1,1,2-Tetrachloroethane	0.0543	0.0050	"	0.0498	ND	109	65-145			
1,1,2,2-Tetrachloroethane	0.0562	0.0020	"	0.0498	ND	113	40-160			
Tetrachloroethene	0.0513	0.0020	"	0.0498	ND	103	65-135			
1,1,1-Trichloroethane	0.0475	0.0020	"	0.0498	ND	95	65-145			
1,1,2-Trichloroethane	0.0568	0.0020	"	0.0498	ND	114	65-140			
Trichloroethene	0.0527	0.0020	"	0.0498	ND	106	65-140			
Trichlorofluoromethane	0.0487	0.0050	"	0.0498	ND	98	55-155			
Vinyl chloride	0.0486	0.0050	"	0.0498	ND	98	55-140			
Surrogate: Dibromofluoromethane	0.0519		"	0.0498		104	80-125			
Surrogate: Dibromofluoromethane	0.0519		"	0.0498		104	80-125			
Surrogate: Toluene-d8	0.0531		"	0.0498		107	80-120			
Surrogate: Toluene-d8	0.0531		"	0.0498		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0535		"	0.0498		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0535		"	0.0498		107	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Matrix Spike Dup (7B17005-MSD1)	Source: IQB1465-01	Prepared & Analyzed: 02/17/07								
Bromodichloromethane	0.0525	0.0020	mg/kg	0.0496	ND	106	65-145	1	20	
Bromoform	0.0552	0.0050	"	0.0496	ND	111	50-145	9	30	
Bromomethane	0.0541	0.0050	"	0.0496	ND	109	60-155	3	25	
Carbon tetrachloride	0.0496	0.0050	"	0.0496	ND	100	60-145	3	25	
Chlorobenzene	0.0527	0.0020	"	0.0496	ND	106	70-130	0.6	25	
Chloroethane	0.0506	0.0050	"	0.0496	ND	102	60-150	4	25	
Chloroform	0.0512	0.0020	"	0.0496	ND	103	65-135	2	20	
Chloromethane	0.0508	0.0050	"	0.0496	ND	102	40-145	4	25	
Dibromochloromethane	0.0550	0.0020	"	0.0496	ND	111	60-145	6	25	
1,2-Dibromoethane (EDB)	0.0512	0.0020	"	0.0496	ND	103	65-140	9	25	
1,2-Dichlorobenzene	0.0540	0.0020	"	0.0496	ND	109	70-130	2	25	
1,3-Dichlorobenzene	0.0538	0.0020	"	0.0496	ND	108	70-130	0.7	25	
1,4-Dichlorobenzene	0.0539	0.0020	"	0.0496	ND	109	70-130	0	25	
Dichlorodifluoromethane	0.0544	0.0050	"	0.0496	ND	110	30-160	7	35	
1,1-Dichloroethane	0.0494	0.0020	"	0.0496	ND	100	65-135	3	25	
1,2-Dichloroethane	0.0509	0.0020	"	0.0496	ND	103	60-150	4	25	
1,2-Dichloroethane	0.0509	0.0020	"	0.0496	ND	103	60-150	4	25	
1,1-Dichloroethene	0.0457	0.0050	"	0.0496	ND	92	65-135	5	25	
cis-1,2-Dichloroethene	0.0520	0.0020	"	0.0496	ND	105	65-135	2	25	
trans-1,2-Dichloroethene	0.0522	0.0020	"	0.0496	ND	105	70-135	4	25	
1,2-Dichloropropane	0.0529	0.0020	"	0.0496	ND	107	65-130	0.8	20	
cis-1,3-Dichloropropene	0.0501	0.0020	"	0.0496	ND	101	70-135	3	25	
trans-1,3-Dichloropropene	0.0504	0.0020	"	0.0496	ND	102	60-145	4	25	
Methylene chloride	0.0468	0.020	"	0.0496	ND	94	55-145	0.6	25	
1,1,1,2-Tetrachloroethane	0.0537	0.0050	"	0.0496	ND	108	65-145	1	20	
1,1,2,2-Tetrachloroethane	0.0517	0.0020	"	0.0496	ND	104	40-160	8	30	
Tetrachloroethene	0.0524	0.0020	"	0.0496	ND	106	65-135	2	25	
1,1,1-Trichloroethane	0.0494	0.0020	"	0.0496	ND	100	65-145	4	20	
1,1,2-Trichloroethane	0.0534	0.0020	"	0.0496	ND	108	65-140	6	30	
Trichloroethene	0.0538	0.0020	"	0.0496	ND	108	65-140	2	25	
Trichlorofluoromethane	0.0514	0.0050	"	0.0496	ND	104	55-155	5	25	
Vinyl chloride	0.0545	0.0050	"	0.0496	ND	110	55-140	11	30	
Surrogate: Dibromofluoromethane	0.0518		"	0.0496		104	80-125			
Surrogate: Dibromofluoromethane	0.0518		"	0.0496		104	80-125			
Surrogate: Toluene-d8	0.0530		"	0.0496		107	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

VOLATILE ORGANICS by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Matrix Spike Dup (7B17005-MSD1)

Source: IQB1465-01

Prepared & Analyzed: 02/17/07

Surrogate: Toluene-d8	0.0530		mg/kg	0.0496		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0516		"	0.0496		104	80-120			
Surrogate: 4-Bromofluorobenzene	0.0516		"	0.0496		104	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

BTEX/OXYGENATES by GC/MS (EPA 8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Blank (7B17003-BLK1)

Prepared & Analyzed: 02/17/07

Benzene	ND	0.50	ug/l							
Ethylbenzene	ND	0.50	"							
Toluene	ND	0.50	"							
o-Xylene	ND	0.50	"							
m,p-Xylenes	ND	1.0	"							
Xylenes, Total	ND	1.0	"							
Methyl-tert-butyl Ether (MTBE)	ND	1.0	"							
Di-isopropyl Ether (DIPE)	ND	1.0	"							
Ethyl tert-Butyl Ether (ETBE)	ND	1.0	"							
tert-Amyl Methyl Ether (TAME)	ND	1.0	"							
tert-Butanol (TBA)	ND	10	"							
<i>Surrogate: Dibromofluoromethane</i>	24.8		"	25.0		99	80-120			
<i>Surrogate: Toluene-d8</i>	26.6		"	25.0		106	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	26.8		"	25.0		107	80-120			

Laboratory Control Sample (7B17003-BS1)

Prepared & Analyzed: 02/17/07

Benzene	26.0	0.50	ug/l	25.0		104	70-120			
Ethylbenzene	27.0	0.50	"	25.0		108	75-125			
Toluene	26.1	0.50	"	25.0		104	70-120			
o-Xylene	25.9	0.50	"	25.0		104	75-125			
m,p-Xylenes	53.6	1.0	"	50.0		107	75-125			
Xylenes, Total	79.5	1.0	"	75.0		106	70-125			
Methyl-tert-butyl Ether (MTBE)	24.1	1.0	"	25.0		96	60-135			
Di-isopropyl Ether (DIPE)	26.7	1.0	"	25.0		107	60-135			
Ethyl tert-Butyl Ether (ETBE)	24.7	1.0	"	25.0		99	65-135			
tert-Amyl Methyl Ether (TAME)	25.2	1.0	"	25.0		101	60-135			
tert-Butanol (TBA)	121	10	"	125		97	70-135			
<i>Surrogate: Dibromofluoromethane</i>	24.2		"	25.0		97	80-120			
<i>Surrogate: Toluene-d8</i>	27.0		"	25.0		108	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	26.3		"	25.0		105	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

BTEX/OXYGENATES by GC/MS (EPA 8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17003 - EPA 5030B GCMS / EPA 8260B

Matrix Spike (7B17003-MS1)	Source: IQB1831-01			Prepared & Analyzed: 02/17/07						P1
Benzene	25.7	0.50	ug/l	25.0	0.29	102	65-125			
Ethylbenzene	26.4	0.50	"	25.0	0.28	104	65-130			
Toluene	26.0	0.50	"	25.0	0.52	102	70-125			
o-Xylene	26.0	0.50	"	25.0	ND	104	65-125			
m,p-Xylenes	52.2	1.0	"	50.0	ND	104	65-130			
Xylenes, Total	78.2	1.0	"	75.0	ND	104	60-130			
Methyl-tert-butyl Ether (MTBE)	27.3	1.0	"	25.0	ND	109	55-145			
Di-isopropyl Ether (DIPE)	29.5	1.0	"	25.0	ND	118	60-140			
Ethyl tert-Butyl Ether (ETBE)	28.1	1.0	"	25.0	ND	112	60-135			
tert-Amyl Methyl Ether (TAME)	28.3	1.0	"	25.0	ND	113	60-140			
tert-Butanol (TBA)	120	10	"	125	ND	96	65-140			
<i>Surrogate: Dibromofluoromethane</i>	26.6		"	25.0		106	80-120			
<i>Surrogate: Toluene-d8</i>	27.3		"	25.0		109	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	27.2		"	25.0		109	80-120			

Matrix Spike Dup (7B17003-MSD1)	Source: IQB1831-01			Prepared & Analyzed: 02/17/07						P1
Benzene	28.9	0.50	ug/l	25.0	0.29	114	65-125	12	20	
Ethylbenzene	29.9	0.50	"	25.0	0.28	118	65-130	12	20	
Toluene	29.3	0.50	"	25.0	0.52	115	70-125	12	20	
o-Xylene	29.1	0.50	"	25.0	ND	116	65-125	11	20	
m,p-Xylenes	58.7	1.0	"	50.0	ND	117	65-130	12	25	
Xylenes, Total	87.8	1.0	"	75.0	ND	117	60-130	12	20	
Methyl-tert-butyl Ether (MTBE)	31.7	1.0	"	25.0	ND	127	55-145	15	25	
Di-isopropyl Ether (DIPE)	34.3	1.0	"	25.0	ND	137	60-140	15	25	
Ethyl tert-Butyl Ether (ETBE)	32.7	1.0	"	25.0	ND	131	60-135	15	25	
tert-Amyl Methyl Ether (TAME)	33.7	1.0	"	25.0	ND	135	60-140	17	30	
tert-Butanol (TBA)	134	10	"	125	ND	107	65-140	11	25	
<i>Surrogate: Dibromofluoromethane</i>	26.9		"	25.0		108	80-120			
<i>Surrogate: Toluene-d8</i>	27.1		"	25.0		108	80-120			
<i>Surrogate: 4-Bromofluorobenzene</i>	27.0		"	25.0		108	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

BTEX/OXYGENATES by GC/MS (EPA 8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Blank (7B17005-BLK1)

Prepared & Analyzed: 02/17/07

Benzene	ND	0.0010	mg/kg							
Ethylbenzene	ND	0.0010	"							
Toluene	ND	0.0010	"							
m,p-Xylenes	ND	0.0020	"							
o-Xylene	ND	0.0010	"							
Xylenes, Total	ND	0.0020	"							
Methyl-tert-butyl Ether (MTBE)	ND	0.0020	"							
Di-isopropyl Ether (DIPE)	ND	0.0020	"							
Ethyl tert-Butyl Ether (ETBE)	ND	0.0020	"							
tert-Amyl Methyl Ether (TAME)	ND	0.0020	"							
tert-Butanol (TBA)	ND	0.020	"							
Surrogate: Dibromofluoromethane	0.0514		"	0.0500		103	80-125			
Surrogate: Toluene-d8	0.0518		"	0.0500		104	80-120			
Surrogate: 4-Bromofluorobenzene	0.0536		"	0.0500		107	80-120			

Laboratory Control Sample (7B17005-BS1)

Prepared & Analyzed: 02/17/07

Benzene	0.0504	0.0010	mg/kg	0.0500		101	65-120			
Ethylbenzene	0.0504	0.0010	"	0.0500		101	70-125			
Toluene	0.0511	0.0010	"	0.0500		102	70-125			
m,p-Xylenes	0.102	0.0020	"	0.100		102	70-125			
o-Xylene	0.0511	0.0010	"	0.0500		102	70-125			
Xylenes, Total	0.153	0.0020	"	0.150		102	70-125			
Methyl-tert-butyl Ether (MTBE)	0.0529	0.0020	"	0.0500		106	60-140			
Di-isopropyl Ether (DIPE)	0.0502	0.0020	"	0.0500		100	60-140			
Ethyl tert-Butyl Ether (ETBE)	0.0529	0.0020	"	0.0500		106	60-140			
tert-Amyl Methyl Ether (TAME)	0.0546	0.0020	"	0.0500		109	60-145			
tert-Butanol (TBA)	0.231	0.020	"	0.250		92	70-135			
Surrogate: Dibromofluoromethane	0.0515		"	0.0500		103	80-125			
Surrogate: Toluene-d8	0.0537		"	0.0500		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0529		"	0.0500		106	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0322 Reported: 03/05/07 09:03
--	---	--

BTEX/OXYGENATES by GC/MS (EPA 8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17005 - EPA 5030B GCMS / EPA 8260B

Matrix Spike (7B17005-MS1)	Source: IQB1465-01			Prepared & Analyzed: 02/17/07						
Benzene	0.0516	0.0010	mg/kg	0.0498	ND	104	65-130			
Ethylbenzene	0.0524	0.0010	"	0.0498	ND	105	70-135			
Toluene	0.0520	0.0010	"	0.0498	ND	104	70-130			
m,p-Xylenes	0.106	0.0020	"	0.0996	ND	106	70-130			
o-Xylene	0.0533	0.0010	"	0.0498	ND	107	65-130			
Xylenes, Total	0.160	0.0020	"	0.149	ND	107	70-125			
Methyl-tert-butyl Ether (MTBE)	0.0572	0.0020	"	0.0498	ND	115	55-155			
Di-isopropyl Ether (DIPE)	0.0531	0.0020	"	0.0498	ND	107	60-150			
Ethyl tert-Butyl Ether (ETBE)	0.0562	0.0020	"	0.0498	ND	113	60-145			
tert-Amyl Methyl Ether (TAME)	0.0583	0.0020	"	0.0498	ND	117	60-150			
tert-Butanol (TBA)	0.249	0.020	"	0.249	ND	100	65-145			
Surrogate: Dibromofluoromethane	0.0519		"	0.0498		104	80-125			
Surrogate: Toluene-d8	0.0531		"	0.0498		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0535		"	0.0498		107	80-120			

Matrix Spike Dup (7B17005-MSD1)	Source: IQB1465-01			Prepared & Analyzed: 02/17/07						
Benzene	0.0521	0.00099	mg/kg	0.0496	ND	105	65-130	1	20	
Ethylbenzene	0.0526	0.00099	"	0.0496	ND	106	70-135	0.4	25	
Toluene	0.0523	0.00099	"	0.0496	ND	105	70-130	0.6	20	
m,p-Xylenes	0.107	0.0020	"	0.0992	ND	108	70-130	0.9	25	
o-Xylene	0.0537	0.00099	"	0.0496	ND	108	65-130	0.7	25	
Xylenes, Total	0.160	0.0020	"	0.149	ND	107	70-125	0	25	
Methyl-tert-butyl Ether (MTBE)	0.0538	0.0020	"	0.0496	ND	108	55-155	6	35	
Di-isopropyl Ether (DIPE)	0.0527	0.0020	"	0.0496	ND	106	60-150	0.8	25	
Ethyl tert-Butyl Ether (ETBE)	0.0550	0.0020	"	0.0496	ND	111	60-145	2	30	
tert-Amyl Methyl Ether (TAME)	0.0557	0.0020	"	0.0496	ND	112	60-150	5	25	
tert-Butanol (TBA)	0.247	0.020	"	0.248	ND	100	65-145	0.8	30	
Surrogate: Dibromofluoromethane	0.0518		"	0.0496		104	80-125			
Surrogate: Toluene-d8	0.0530		"	0.0496		107	80-120			
Surrogate: 4-Bromofluorobenzene	0.0516		"	0.0496		104	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Blank (7B19095-BLK1)

Prepared: 02/19/07 Analyzed: 02/22/07

1,2,4-Trichlorobenzene	ND	10	ug/l							
1,2-Dichlorobenzene	ND	10	"							
1,2-Diphenylhydrazine/Azobenzene	ND	20	"							
1,3-Dichlorobenzene	ND	10	"							
1,4-Dichlorobenzene	ND	10	"							
2,4,5-Trichlorophenol	ND	20	"							
2,4,6-Trichlorophenol	ND	20	"							
2,4-Dichlorophenol	ND	10	"							
2,4-Dimethylphenol	ND	20	"							
2,4-Dinitrophenol	ND	20	"							
2,4-Dinitrotoluene	ND	10	"							
2,6-Dinitrotoluene	ND	10	"							
2-Chloronaphthalene	ND	10	"							
2-Chlorophenol	ND	10	"							
2-Methylnaphthalene	ND	10	"							
2-Methylphenol	ND	10	"							
2-Nitroaniline	ND	20	"							
2-Nitrophenol	ND	10	"							
3,3-Dichlorobenzidine	ND	20	"							
3-Nitroaniline	ND	20	"							
4,6-Dinitro-2-methylphenol	ND	20	"							
4-Bromophenyl phenyl ether	ND	10	"							
4-Chloro-3-methylphenol	ND	20	"							
4-Chloroaniline	ND	10	"							
4-Chlorophenyl phenyl ether	ND	10	"							
4-Methylphenol	ND	10	"							
4-Nitroaniline	ND	20	"							
4-Nitrophenol	ND	20	"							
Acenaphthene	ND	10	"							
Acenaphthylene	ND	10	"							
Aniline	ND	10	"							
Anthracene	ND	10	"							
Benzidine	ND	20	"							
Benzo(a)anthracene	ND	10	"							
Benzo(a)pyrene	ND	10	"							
Benzo(b)fluoranthene	ND	10	"							

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Blank (7B19095-BLK1)

Prepared: 02/19/07 Analyzed: 02/22/07

Benzo(g,h,i)perylene	ND	10	ug/l
Benzo(k)fluoranthene	ND	10	"
Benzoic acid	ND	20	"
Benzyl alcohol	ND	20	"
Bis(2-chloroethoxy)methane	ND	10	"
Bis(2-chloroethyl)ether	ND	10	"
Bis(2-chloroisopropyl)ether	ND	10	"
Bis(2-ethylhexyl)phthalate	ND	50	"
Butyl benzyl phthalate	ND	20	"
Carbazole	ND	20	"
Chrysene	ND	10	"
Dibenz(a,h)anthracene	ND	20	"
Dibenzofuran	ND	10	"
Diethyl phthalate	ND	10	"
Dimethyl phthalate	ND	10	"
Di-n-butyl phthalate	ND	20	"
Di-n-octyl phthalate	ND	20	"
Fluoranthene	ND	10	"
Fluorene	ND	10	"
Hexachlorobenzene	ND	10	"
Hexachlorobutadiene	ND	10	"
Hexachlorocyclopentadiene	ND	20	"
Hexachloroethane	ND	10	"
Indeno(1,2,3-cd)pyrene	ND	20	"
Isophorone	ND	10	"
Naphthalene	ND	10	"
Nitrobenzene	ND	20	"
N-Nitrosodimethylamine	ND	20	"
N-Nitroso-di-n-propylamine	ND	10	"
N-Nitrosodiphenylamine	ND	10	"
Pentachlorophenol	ND	20	"
Phenanthrene	ND	10	"
Phenol	ND	10	"
Pyrene	ND	10	"
Pyridine	ND	20	"

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Blank (7B19095-BLK1)

Prepared: 02/19/07 Analyzed: 02/22/07

Surrogate: 2,4,6-Tribromophenol	185		ug/l	200		92	40-120			
Surrogate: 2-Fluorobiphenyl	91.1		"	100		91	45-120			
Surrogate: 2-Fluorophenol	149		"	200		74	30-120			
Surrogate: Nitrobenzene-d5	87.8		"	100		88	40-120			
Surrogate: Phenol-d6	157		"	200		78	35-120			
Surrogate: Terphenyl-d14	89.7		"	100		90	45-120			

Laboratory Control Sample (7B19095 BS1)

Prepared: 02/19/07 Analyzed: 02/22/07

MNRI

1,2,4-Trichlorobenzene	76.4	10	ug/l	100		76	45-120			
1,2-Dichlorobenzene	73.9	10	"	100		74	40-120			
1,2-Diphenylhydrazine/Azobenzene	90.5	20	"	100		90	55-120			
1,3-Dichlorobenzene	70.3	10	"	100		70	35-120			
1,4-Dichlorobenzene	72.0	10	"	100		72	35-120			
2,4,5-Trichlorophenol	94.6	20	"	100		95	50-120			
2,4,6-Trichlorophenol	89.5	20	"	100		90	50-120			
2,4-Dichlorophenol	84.0	10	"	100		84	50-120			
2,4-Dimethylphenol	79.6	20	"	100		80	35-120			
2,4-Dinitrophenol	90.9	20	"	100		91	35-120			
2,4-Dinitrotoluene	97.4	10	"	100		97	60-120			
2,6-Dinitrotoluene	94.1	10	"	100		94	60-120			
2-Chloronaphthalene	90.4	10	"	100		90	55-120			
2-Chlorophenol	86.0	10	"	100		86	45-120			
2-Methylnaphthalene	86.2	10	"	100		86	50-120			
2-Methylphenol	89.4	10	"	100		89	50-120			
2-Nitroaniline	99.5	20	"	100		100	60-120			
2-Nitrophenol	90.0	10	"	100		90	45-120			
3,3-Dichlorobenzidine	94.7	20	"	100		95	50-135			
3-Nitroaniline	107	20	"	100		107	55-120			
4,6-Dinitro-2-methylphenol	106	20	"	100		106	40-120			
4-Bromophenyl phenyl ether	90.0	10	"	100		90	55-120			
4-Chloro-3-methylphenol	97.8	20	"	100		98	55-120			
4-Chloroaniline	91.1	10	"	100		91	50-120			
4-Chlorophenyl phenyl ether	89.9	10	"	100		90	60-120			
4-Methylphenol	83.1	10	"	100		83	45-120			
4-Nitroaniline	104	20	"	100		104	50-125			
4-Nitrophenol	106	20	"	100		106	40-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Laboratory Control Sample (7B19095-BS1)				Prepared: 02/19/07 Analyzed: 02/22/07				MNR1	
Acenaphthene	92.8	10	ug/l	100	93	55-120			
Acenaphthylene	92.8	10	"	100	93	60-120			
Aniline	71.2	10	"	100	71	40-120			
Anthracene	93.5	10	"	100	94	60-120			
Benmidine	109	20	"	100	109	25-160			
Benzo(a)anthracene	94.9	10	"	100	95	60-120			
Benzo(a)pyrene	129	10	"	100	129	55-125			L
Benzo(b)fluoranthene	127	10	"	100	127	55-125			L
Benzo(g,h,i)perylene	107	10	"	100	107	45-130			
Benzo(k)fluoranthene	131	10	"	100	131	50-125			L
Benzoic acid	50.7	20	"	100	51	25-120			
Benzyl alcohol	83.2	20	"	100	83	50-120			
Bis(2-chloroethoxy)methane	95.5	10	"	100	96	55-120			
Bis(2-chloroethyl)ether	80.1	10	"	100	80	50-120			
Bis(2-chloroisopropyl)ether	79.7	10	"	100	80	45-120			
Bis(2-ethylhexyl)phthalate	85.8	50	"	100	86	60-125			
Butyl benzyl phthalate	83.7	20	"	100	84	50-125			
Carbazole	97.8	20	"	100	98	55-125			
Chrysene	94.8	10	"	100	95	60-120			
Dibenz(a,h)anthracene	120	20	"	100	120	50-135			
Dibenzofuran	92.1	10	"	100	92	60-120			
Diethyl phthalate	87.2	10	"	100	87	50-120			
Dimethyl phthalate	85.1	10	"	100	85	25-120			
Di-n-butyl phthalate	90.3	20	"	100	90	55-125			
Di-n-octyl phthalate	88.3	20	"	100	88	60-130			
Fluoranthene	97.5	10	"	100	98	55-120			
Fluorene	92.6	10	"	100	93	60-120			
Hexachlorobenzene	93.9	10	"	100	94	55-120			
Hexachlorobutadiene	73.6	10	"	100	74	40-120			
Hexachlorocyclopentadiene	81.9	20	"	100	82	20-120			
Hexachloroethane	68.2	10	"	100	68	35-120			
Indeno(1,2,3-cd)pyrene	114	20	"	100	114	45-135			
Isophorone	76.2	10	"	100	76	50-120			
Naphthalene	93.6	10	"	100	94	50-120			
Nitrobenzene	80.5	20	"	100	80	50-120			
N-Nitrosodimethylamine	69.1	20	"	100	69	40-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Laboratory Control Sample (7B19095-BS1)		Prepared: 02/19/07		Analyzed: 02/22/07		MNR1	
N-Nitroso-di-n-propylamine	81.4	10	ug/l	100	81	45-120	
N-Nitrosodiphenylamine	85.7	10	"	100	86	55-120	
Pentachlorophenol	102	20	"	100	102	45-125	
Phenanthrene	93.7	10	"	100	94	60-120	
Phenol	81.4	10	"	100	81	45-120	
Pyrene	87.2	10	"	100	87	50-125	
Pyridine	53.2	20	"	100	53	30-120	
Surrogate: 2,4,6-Tribromophenol	193		"	200	96	40-120	
Surrogate: 2-Fluorobiphenyl	87.7		"	100	88	45-120	
Surrogate: 2-Fluorophenol	150		"	200	75	30-120	
Surrogate: Nitrobenzene-d5	85.8		"	100	86	40-120	
Surrogate: Phenol-d6	156		"	200	78	35-120	
Surrogate: Terphenyl-d14	86.2		"	100	86	45-120	

Laboratory Control Sample Dup (7B19095-BSD1)		Prepared: 02/19/07		Analyzed: 02/22/07			
1,2,4-Trichlorobenzene	62.7	10	ug/l	100	63	45-120	20
1,2-Dichlorobenzene	59.9	10	"	100	60	40-120	21
1,2-Diphenylhydrazine/Azobenzene	81.5	20	"	100	82	55-120	10
1,3-Dichlorobenzene	56.1	10	"	100	56	35-120	22
1,4-Dichlorobenzene	59.1	10	"	100	59	35-120	20
2,4,5-Trichlorophenol	83.1	20	"	100	83	50-120	13
2,4,6-Trichlorophenol	79.4	20	"	100	79	50-120	12
2,4-Dichlorophenol	71.2	10	"	100	71	50-120	16
2,4-Dimethylphenol	68.0	20	"	100	68	35-120	16
2,4-Dinitrophenol	64.7	20	"	100	65	35-120	34
2,4-Dinitrotoluene	79.9	10	"	100	80	60-120	20
2,6-Dinitrotoluene	85.1	10	"	100	85	60-120	10
2-Chloronaphthalene	81.1	10	"	100	81	55-120	11
2-Chlorophenol	70.8	10	"	100	71	45-120	19
2-Methylnaphthalene	72.0	10	"	100	72	50-120	18
2-Methylphenol	76.1	10	"	100	76	50-120	16
2-Nitroaniline	83.0	20	"	100	83	60-120	18
2-Nitrophenol	72.5	10	"	100	72	45-120	22
3,3-Dichlorobenzidine	62.0	20	"	100	62	50-135	42
3-Nitroaniline	81.2	20	"	100	81	55-120	27
4,6-Dinitro-2-methylphenol	86.0	20	"	100	86	40-120	21

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B19095 - EPA 3520C / EPA 8270C										
Laboratory Control Sample Dup (7B19095-bsd1)					Prepared: 02/19/07 Analyzed: 02/22/07					
4-Bromophenyl phenyl ether	90.3	10	ug/l	100	90	90	55-120	0.3	25	
4-Chloro-3-methylphenol	80.9	20	"	100	81	81	55-120	19	25	
4-Chloroaniline	69.7	10	"	100	70	70	50-120	27	25	R-7
4-Chlorophenyl phenyl ether	83.0	10	"	100	83	83	60-120	8	20	
4-Methylphenol	71.1	10	"	100	71	71	45-120	16	20	
4-Nitroaniline	67.5	20	"	100	68	68	50-125	43	20	R-7
4-Nitrophenol	70.2	20	"	100	70	70	40-120	41	30	R-7
Acenaphthene	84.2	10	"	100	84	84	55-120	10	20	
Acenaphthylene	84.7	10	"	100	85	85	60-120	9	20	
Aniline	39.5	10	"	100	40	40	40-120	57	30	R-7
Anthracene	84.5	10	"	100	84	84	60-120	10	20	
Benzidine	ND	20	"	100			25-160		35	L6
Benzo(a)anthracene	90.8	10	"	100	91	91	60-120	4	20	
Benzo(a)pyrene	119	10	"	100	119	119	55-125	8	25	
Benzo(b)fluoranthene	118	10	"	100	118	118	55-125	7	25	
Benzo(g,h,i)perylene	113	10	"	100	113	113	45-130	5	25	
Benzo(k)fluoranthene	129	10	"	100	129	129	50-125	2	20	L
Benzoic acid	43.6	20	"	100	44	44	25-120	15	30	
Benzyl alcohol	68.3	20	"	100	68	68	50-120	20	20	
Bis(2-chloroethoxy)methane	81.9	10	"	100	82	82	55-120	15	20	
Bis(2-chloroethyl)ether	69.8	10	"	100	70	70	50-120	14	20	
Bis(2-chloroisopropyl)ether	66.4	10	"	100	66	66	45-120	18	20	
Bis(2-ethylhexyl)phthalate	94.0	50	"	100	94	94	60-125	9	20	
Butyl benzyl phthalate	94.6	20	"	100	95	95	50-125	12	20	
Carbazole	76.6	20	"	100	77	77	55-125	24	20	R-7
Chrysene	91.8	10	"	100	92	92	60-120	3	20	
Dibenz(a,h)anthracene	119	20	"	100	119	119	50-135	0.8	25	
Dibenzofuran	80.9	10	"	100	81	81	60-120	13	20	
Diethyl phthalate	86.4	10	"	100	86	86	50-120	0.9	30	
Dimethyl phthalate	82.7	10	"	100	83	83	25-120	3	30	
Di-n-butyl phthalate	93.7	20	"	100	94	94	55-125	4	20	
Di-n-octyl phthalate	78.6	20	"	100	79	79	60-130	12	20	
Fluoranthene	81.9	10	"	100	82	82	55-120	17	20	
Fluorene	83.9	10	"	100	84	84	60-120	10	20	
Hexachlorobenzene	98.1	10	"	100	98	98	55-120	4	20	
Hexachlorobutadiene	61.5	10	"	100	62	62	40-120	18	25	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 3520C/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19095 - EPA 3520C / EPA 8270C

Laboratory Control Sample Dup (7B19095-bsd1)

Prepared: 02/19/07 Analyzed: 02/22/07

Hexachlorocyclopentadiene	56.9	20	ug/l	100	57	20-120	36	30	R-7
Hexachloroethane	56.2	10	"	100	56	35-120	19	25	
Indeno(1,2,3-cd)pyrene	116	20	"	100	116	45-135	2	25	
Isophorone	70.4	10	"	100	70	50-120	8	20	
Naphthalene	80.1	10	"	100	80	50-120	16	20	
Nitrobenzene	70.9	20	"	100	71	50-120	13	25	
N-Nitrosodimethylamine	57.6	20	"	100	58	40-120	18	20	
N-Nitroso-di-n-propylamine	66.4	10	"	100	66	45-120	20	20	
N-Nitrosodiphenylamine	85.1	10	"	100	85	55-120	0.7	20	
Pentachlorophenol	88.4	20	"	100	88	45-125	14	25	
Phenanthrene	88.5	10	"	100	88	60-120	6	20	
Phenol	68.2	10	"	100	68	45-120	18	25	
Pyrene	105	10	"	100	105	50-125	19	25	
Pyridine	29.5	20	"	100	30	30-120	57	30	R-7
Surrogate: 2,4,6-Tribromophenol	178		"	200	89	40-120			
Surrogate: 2-Fluorobiphenyl	81.9		"	100	82	45-120			
Surrogate: 2-Fluorophenol	131		"	200	66	30-120			
Surrogate: Nitrobenzene-d5	73.7		"	100	74	40-120			
Surrogate: Phenol-d6	137		"	200	68	35-120			
Surrogate: Terphenyl-d14	101		"	100	101	45-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Blank (7B19075-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

1,2,4-Trichlorobenzene	ND	0.33	mg/kg
1,2-Dichlorobenzene	ND	0.33	"
1,2-Diphenylhydrazine/Azobenzene	ND	0.33	"
1,3-Dichlorobenzene	ND	0.33	"
1,4-Dichlorobenzene	ND	0.33	"
2,4,5-Trichlorophenol	ND	0.33	"
2,4,6-Trichlorophenol	ND	0.33	"
2,4-Dichlorophenol	ND	0.33	"
2,4-Dimethylphenol	ND	0.33	"
2,4-Dinitrophenol	ND	0.66	"
2,4-Dinitrotoluene	ND	0.33	"
2,6-Dinitrotoluene	ND	0.33	"
2-Chloronaphthalene	ND	0.33	"
2-Chlorophenol	ND	0.33	"
2-Methylnaphthalene	ND	0.33	"
2-Methylphenol	ND	0.33	"
2-Nitroaniline	ND	0.33	"
2-Nitrophenol	ND	0.33	"
3,3-Dichlorobenzidine	ND	0.83	"
3-Nitroaniline	ND	0.33	"
4,6-Dinitro-2-methylphenol	ND	0.42	"
4-Bromophenyl phenyl ether	ND	0.33	"
4-Chloro-3-methylphenol	ND	0.33	"
4-Chloroaniline	ND	0.33	"
4-Chlorophenyl phenyl ether	ND	0.33	"
4-Methylphenol	ND	0.33	"
4-Nitroaniline	ND	0.83	"
4-Nitrophenol	ND	0.83	"
Acenaphthene	ND	0.33	"
Acenaphthylene	ND	0.33	"
Aniline	ND	0.42	"
Anthracene	ND	0.33	"
Benzidine	ND	0.66	"
Benzo(a)anthracene	ND	0.33	"
Benzo(a)pyrene	ND	0.33	"
Benzo(b)fluoranthene	ND	0.33	"

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Blank (7B19075-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

Benzo(g,h,i)perylene	ND	0.33	mg/kg							
Benzo(k)fluoranthene	ND	0.33	"							
Benzoic acid	ND	0.83	"							
Benzyl alcohol	ND	0.33	"							
Bis(2-chloroethoxy)methane	ND	0.33	"							
Bis(2-chloroethyl)ether	ND	0.17	"							
Bis(2-chloroisopropyl)ether	ND	0.33	"							
Bis(2-ethylhexyl)phthalate	ND	0.33	"							
Butyl benzyl phthalate	ND	0.33	"							
Carbazole	ND	0.33	"							
Chrysene	ND	0.33	"							
Dibenz(a,h)anthracene	ND	0.42	"							
Dibenzofuran	ND	0.33	"							
Diethyl phthalate	ND	0.33	"							
Dimethyl phthalate	ND	0.33	"							
Di-n-butyl phthalate	ND	0.33	"							
Di-n-octyl phthalate	ND	0.33	"							
Fluoranthene	ND	0.33	"							
Fluorene	ND	0.33	"							
Hexachlorobenzene	ND	0.33	"							
Hexachlorobutadiene	ND	0.33	"							
Hexachlorocyclopentadiene	ND	0.83	"							
Hexachloroethane	ND	0.33	"							
Indeno(1,2,3-cd)pyrene	ND	0.33	"							
Isophorone	ND	0.33	"							
Naphthalene	ND	0.33	"							
Nitrobenzene	ND	0.33	"							
N-Nitrosodimethylamine	ND	0.33	"							
N-Nitroso-di-n-propylamine	ND	0.25	"							
N-Nitrosodiphenylamine	ND	0.33	"							
Pentachlorophenol	ND	0.83	"							
Phenanthrene	ND	0.33	"							
Phenol	ND	0.33	"							
Pyrene	ND	0.33	"							
Pyridine	ND	0.20	"							

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B19075 - EPA 3545 / EPA 8270C										
Blank (7B19075-BLK1)										
Prepared: 02/19/07 Analyzed: 02/20/07										
Surrogate: 2,4,6-Tribromophenol	5.67		mg/kg	6.67		85	35-125			
Surrogate: 2-Fluorobiphenyl	2.94		"	3.33		88	35-120			
Surrogate: 2-Fluorophenol	4.75		"	6.67		71	25-120			
Surrogate: Nitrobenzene-d5	2.63		"	3.33		79	30-120			
Surrogate: Phenol-d6	5.03		"	6.67		75	35-120			
Surrogate: Terphenyl-d14	2.89		"	3.33		87	40-135			
Laboratory Control Sample (7B19075-BS1)										
Prepared: 02/19/07 Analyzed: 02/20/07										
1,2,4-Trichlorobenzene	2.75	0.33	mg/kg	3.33		83	40-120			
1,2-Dichlorobenzene	2.70	0.33	"	3.33		81	40-120			
1,2-Diphenylhydrazine/Azobenzene	3.27	0.33	"	3.33		98	60-120			
1,3-Dichlorobenzene	2.59	0.33	"	3.33		78	35-120			
1,4-Dichlorobenzene	2.73	0.33	"	3.33		82	35-120			
2,4,5-Trichlorophenol	3.48	0.33	"	3.33		105	55-120			
2,4,6-Trichlorophenol	3.35	0.33	"	3.33		101	50-120			
2,4-Dichlorophenol	3.01	0.33	"	3.33		90	50-120			
2,4-Dimethylphenol	2.98	0.33	"	3.33		89	40-120			
2,4-Dinitrophenol	2.40	0.66	"	3.33		72	25-120			
2,4-Dinitrotoluene	3.56	0.33	"	3.33		107	60-120			
2,6-Dinitrotoluene	3.48	0.33	"	3.33		105	60-120			
2-Chloronaphthalene	3.26	0.33	"	3.33		98	50-120			
2-Chlorophenol	3.16	0.33	"	3.33		95	45-120			
2-Methylnaphthalene	3.00	0.33	"	3.33		90	50-120			
2-Methylphenol	3.20	0.33	"	3.33		96	45-120			
2-Nitroaniline	3.61	0.33	"	3.33		108	55-120			
2-Nitrophenol	3.05	0.33	"	3.33		92	50-120			
3,3-Dichlorobenzidine	3.45	0.83	"	3.33		104	20-135			
3-Nitroaniline	3.70	0.33	"	3.33		111	35-120			
4,6-Dinitro-2-methylphenol	3.69	0.42	"	3.33		111	45-120			
4-Bromophenyl phenyl ether	3.47	0.33	"	3.33		104	50-120			
4-Chloro-3-methylphenol	3.37	0.33	"	3.33		101	55-120			
4-Chloroaniline	2.99	0.33	"	3.33		90	20-120			
4-Chlorophenyl phenyl ether	3.31	0.33	"	3.33		99	60-120			
4-Methylphenol	3.00	0.33	"	3.33		90	50-120			
4-Nitroaniline	3.59	0.83	"	3.33		108	50-120			
4-Nitrophenol	3.74	0.83	"	3.33		112	45-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Laboratory Control Sample (7B19075-BS1)

Prepared: 02/19/07 Analyzed: 02/20/07

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Acenaphthene	3.40	0.33	mg/kg	3.33		102	55-120			
Acenaphthylene	3.43	0.33	"	3.33		103	55-120			
Aniline	2.90	0.42	"	3.33		87	25-120			
Anthracene	3.38	0.33	"	3.33		102	60-120			
Benzidine	3.78	0.66	"	3.33		114	10-160			
Benzo(a)anthracene	3.51	0.33	"	3.33		105	60-120			
Benzo(a)pyrene	4.82	0.33	"	3.33		145	60-120			L
Benzo(b)fluoranthene	4.62	0.33	"	3.33		139	55-125			L
Benzo(g,h,i)perylene	4.76	0.33	"	3.33		143	40-130			L
Benzo(k)fluoranthene	4.55	0.33	"	3.33		137	50-125			L
Benzoic acid	0.648	0.83	"	3.33		19	25-120			L2
Benzyl alcohol	3.26	0.33	"	3.33		98	35-120			
Bis(2-chloroethoxy)methane	3.25	0.33	"	3.33		98	50-120			
Bis(2-chloroethyl)ether	2.95	0.17	"	3.33		89	40-120			
Bis(2-chloroisopropyl)ether	2.80	0.33	"	3.33		84	40-120			
Bis(2-ethylhexyl)phthalate	3.30	0.33	"	3.33		99	55-125			
Butyl benzyl phthalate	3.30	0.33	"	3.33		99	50-120			
Carbazole	3.67	0.33	"	3.33		110	55-125			
Chrysene	3.56	0.33	"	3.33		107	55-120			
Dibenz(a,h)anthracene	5.23	0.42	"	3.33		157	45-135			L
Dibenzofuran	3.47	0.33	"	3.33		104	60-120			
Diethyl phthalate	3.24	0.33	"	3.33		97	55-120			
Dimethyl phthalate	3.20	0.33	"	3.33		96	55-120			
Di-n-butyl phthalate	3.39	0.33	"	3.33		102	55-120			
Di-n-octyl phthalate	3.29	0.33	"	3.33		99	50-130			
Fluoranthene	3.54	0.33	"	3.33		106	60-120			
Fluorene	3.45	0.33	"	3.33		104	60-120			
Hexachlorobenzene	3.55	0.33	"	3.33		107	55-120			
Hexachlorobutadiene	2.68	0.33	"	3.33		80	40-120			
Hexachlorocyclopentadiene	3.11	0.83	"	3.33		93	30-120			
Hexachloroethane	2.52	0.33	"	3.33		76	40-120			
Indeno(1,2,3-cd)pyrene	4.97	0.33	"	3.33		149	35-135			L
Isophorone	2.73	0.33	"	3.33		82	45-120			
Naphthalene	3.20	0.33	"	3.33		96	50-120			
Nitrobenzene	2.80	0.33	"	3.33		84	45-120			
N-Nitrosodimethylamine	2.54	0.33	"	3.33		76	25-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Laboratory Control Sample (7B19075-BS1)

Prepared: 02/19/07 Analyzed: 02/20/07

N-Nitroso-di-n-propylamine	2.84	0.25	mg/kg	3.33		85	45-120			
N-Nitrosodiphenylamine	3.29	0.33	"	3.33		99	50-120			
Pentachlorophenol	3.66	0.83	"	3.33		110	45-125			
Phenanthrene	3.58	0.33	"	3.33		108	55-120			
Phenol	2.99	0.33	"	3.33		90	40-120			
Pyrene	3.41	0.33	"	3.33		102	45-125			
Pyridine	2.33	0.20	"	3.33		70	25-130			
Surrogate: 2,4,6-Tribromophenol	6.58		"	6.67		99	35-125			
Surrogate: 2-Fluorobiphenyl	2.93		"	3.33		88	35-120			
Surrogate: 2-Fluorophenol	5.04		"	6.67		76	25-120			
Surrogate: Nitrobenzene-d5	2.59		"	3.33		78	30-120			
Surrogate: Phenol-d6	5.11		"	6.67		77	35-120			
Surrogate: Terphenyl-d14	2.99		"	3.33		90	40-135			

Matrix Spike (7B19075-MS1)

Source: IQB1093-04

Prepared: 02/19/07 Analyzed: 02/20/07

1,2,4-Trichlorobenzene	2.59	0.33	mg/kg	3.33	ND	78	40-120			
1,2-Dichlorobenzene	2.57	0.33	"	3.33	ND	77	40-120			
1,2-Diphenylhydrazine/Azobenzene	3.12	0.33	"	3.33	ND	94	55-125			
1,3-Dichlorobenzene	2.49	0.33	"	3.33	ND	75	35-120			
1,4-Dichlorobenzene	2.51	0.33	"	3.33	ND	75	35-120			
2,4,5-Trichlorophenol	3.14	0.33	"	3.33	ND	94	50-120			
2,4,6-Trichlorophenol	3.01	0.33	"	3.33	ND	90	50-120			
2,4-Dichlorophenol	2.85	0.33	"	3.33	ND	86	50-120			
2,4-Dimethylphenol	1.72	0.33	"	3.33	ND	52	35-120			
2,4-Dinitrophenol	0.488	0.66	"	3.33	ND	15	35-120			M2
2,4-Dinitrotoluene	3.38	0.33	"	3.33	ND	102	50-120			
2,6-Dinitrotoluene	3.37	0.33	"	3.33	ND	101	55-120			
2-Chloronaphthalene	3.16	0.33	"	3.33	ND	95	45-120			
2-Chlorophenol	2.88	0.33	"	3.33	ND	86	40-120			
2-Methylnaphthalene	2.93	0.33	"	3.33	ND	88	45-120			
2-Methylphenol	2.49	0.33	"	3.33	ND	75	50-120			
2-Nitroaniline	3.51	0.33	"	3.33	ND	105	50-120			
2-Nitrophenol	2.94	0.33	"	3.33	ND	88	45-120			
3,3-Dichlorobenzidine	2.90	0.83	"	3.33	ND	87	15-120			
3-Nitroaniline	3.29	0.33	"	3.33	ND	99	30-120			
4,6-Dinitro-2-methylphenol	2.45	0.42	"	3.33	ND	74	40-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Matrix Spike (7B19075-MS1)	Source: IQB1093-04		Prepared: 02/19/07		Analyzed: 02/20/07					
4-Bromophenyl phenyl ether	3.26	0.33	mg/kg	3.33	ND	98	45-120			
4-Chloro-3-methylphenol	3.04	0.33	"	3.33	ND	91	55-120			
4-Chloroaniline	2.56	0.33	"	3.33	ND	77	10-120			
4-Chlorophenyl phenyl ether	3.19	0.33	"	3.33	ND	96	50-120			
4-Methylphenol	2.42	0.33	"	3.33	ND	73	50-120			
4-Nitroaniline	3.49	0.83	"	3.33	ND	105	40-120			
4-Nitrophenol	3.34	0.83	"	3.33	ND	100	40-120			
Acenaphthene	3.26	0.33	"	3.33	ND	98	45-120			
Acenaphthylene	3.34	0.33	"	3.33	ND	100	60-120			
Aniline	2.16	0.42	"	3.33	ND	65	40-110			
Anthracene	3.32	0.33	"	3.33	ND	100	60-120			
Benzidine	ND	0.66	"	3.33	ND		25-120			M2
Benzo(a)anthracene	3.34	0.33	"	3.33	ND	100	50-120			
Benzo(a)pyrene	4.46	0.33	"	3.33	ND	134	55-120			M7
Benzo(b)fluoranthene	4.31	0.33	"	3.33	ND	129	55-125			M7
Benzo(g,h,i)perylene	4.26	0.33	"	3.33	ND	128	30-120			M7
Benzo(k)fluoranthene	4.30	0.33	"	3.33	ND	129	55-120			M7
Benzoic acid	ND	0.83	"	3.33	ND		25-120			M8
Benzyl alcohol	3.02	0.33	"	3.33	ND	91	40-120			
Bis(2-chloroethoxy)methane	3.11	0.33	"	3.33	ND	93	50-120			
Bis(2-chloroethyl)ether	2.69	0.17	"	3.33	ND	81	35-110			
Bis(2-chloroisopropyl)ether	2.57	0.33	"	3.33	ND	77	40-120			
Bis(2-ethylhexyl)phthalate	3.13	0.33	"	3.33	ND	94	50-125			
Butyl benzyl phthalate	3.13	0.33	"	3.33	ND	94	50-120			
Carbazole	3.49	0.33	"	3.33	ND	105	55-125			
Chrysene	3.41	0.33	"	3.33	ND	102	55-120			
Dibenz(a,h)anthracene	4.75	0.42	"	3.33	ND	143	25-135			M7
Dibenzofuran	3.26	0.33	"	3.33	ND	98	55-120			
Diethyl phthalate	3.11	0.33	"	3.33	ND	93	50-120			
Dimethyl phthalate	3.04	0.33	"	3.33	ND	91	25-120			
Di-n-butyl phthalate	3.11	0.33	"	3.33	0.13	89	50-120			
Di-n-octyl phthalate	3.08	0.33	"	3.33	ND	92	55-120			
Fluoranthene	3.24	0.33	"	3.33	ND	97	45-120			
Fluorene	3.33	0.33	"	3.33	ND	100	50-120			
Hexachlorobenzene	3.39	0.33	"	3.33	ND	102	50-120			
Hexachlorobutadiene	2.50	0.33	"	3.33	ND	75	40-110			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Matrix Spike (7B19075-MS1)	Source: IQB1093-04	Prepared: 02/19/07	Analyzed: 02/20/07							
Hexachlorocyclopentadiene	2.82	0.83	mg/kg	3.33	ND	85	20-120			
Hexachloroethane	2.32	0.33	"	3.33	ND	70	35-120			
Indeno(1,2,3-cd)pyrene	4.52	0.33	"	3.33	ND	136	20-135			M7
Isophorone	2.54	0.33	"	3.33	ND	76	40-120			
Naphthalene	3.06	0.33	"	3.33	ND	92	40-120			
Nitrobenzene	2.63	0.33	"	3.33	ND	79	40-120			
N-Nitrosodimethylamine	2.24	0.33	"	3.33	ND	67	25-125			
N-Nitroso-di-n-propylamine	2.58	0.25	"	3.33	ND	77	35-120			
N-Nitrosodiphenylamine	3.27	0.33	"	3.33	ND	98	50-120			
Pentachlorophenol	2.18	0.83	"	3.33	ND	65	30-125			
Phenanthrene	3.28	0.33	"	3.33	ND	98	50-120			
Phenol	2.66	0.33	"	3.33	ND	80	45-120			
Pyrene	3.19	0.33	"	3.33	ND	96	45-120			
Pyridine	1.63	0.20	"	3.33	ND	49	25-130			
Surrogate: 2,4,6-Tribromophenol	5.11		"	6.67		77	35-125			
Surrogate: 2-Fluorobiphenyl	2.67		"	3.33		80	35-120			
Surrogate: 2-Fluorophenol	4.19		"	6.67		63	25-120			
Surrogate: Nitrobenzene-d5	2.34		"	3.33		70	30-120			
Surrogate: Phenol-d6	4.42		"	6.67		66	35-120			
Surrogate: Terphenyl-d14	2.68		"	3.33		80	40-135			

Matrix Spike Dup (7B19075-MSD1)	Source: IQB1093-04	Prepared: 02/19/07	Analyzed: 02/20/07							
1,2,4-Trichlorobenzene	2.88	0.33	mg/kg	3.33	ND	86	40-120	11	25	
1,2-Dichlorobenzene	2.74	0.33	"	3.33	ND	82	40-120	6	25	
1,2-Diphenylhydrazine/Azobenzene	3.32	0.33	"	3.33	ND	100	55-125	6	25	
1,3-Dichlorobenzene	2.77	0.33	"	3.33	ND	83	35-120	11	25	
1,4-Dichlorobenzene	2.78	0.33	"	3.33	ND	83	35-120	10	25	
2,4,5-Trichlorophenol	3.52	0.33	"	3.33	ND	106	50-120	11	20	
2,4,6-Trichlorophenol	3.30	0.33	"	3.33	ND	99	50-120	9	25	
2,4-Dichlorophenol	3.22	0.33	"	3.33	ND	97	50-120	12	25	
2,4-Dimethylphenol	2.06	0.33	"	3.33	ND	62	35-120	18	25	
2,4-Dinitrophenol	0.850	0.66	"	3.33	ND	26	35-120	54	25	M2
2,4-Dinitrotoluene	3.69	0.33	"	3.33	ND	111	50-120	9	25	
2,6-Dinitrotoluene	3.56	0.33	"	3.33	ND	107	55-120	5	20	
2-Chloronaphthalene	3.50	0.33	"	3.33	ND	105	45-120	10	20	
2-Chlorophenol	3.20	0.33	"	3.33	ND	96	40-120	11	20	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Matrix Spike Dup (7B19075-MSD1)	Source: IQB1093-04	Prepared: 02/19/07	Analyzed: 02/20/07							
2-Methylnaphthalene	3.19	0.33	mg/kg	3.33	ND	96	45-120	8	20	
2-Methylphenol	2.80	0.33	"	3.33	ND	84	50-120	12	25	
2-Nitroaniline	3.68	0.33	"	3.33	ND	111	50-120	5	25	
2-Nitrophenol	3.28	0.33	"	3.33	ND	98	45-120	11	25	
3,3-Dichlorobenzidine	3.04	0.83	"	3.33	ND	91	15-120	5	25	
3-Nitroaniline	3.49	0.33	"	3.33	ND	105	30-120	6	25	
4,6-Dinitro-2-methylphenol	3.08	0.42	"	3.33	ND	92	40-120	23	25	
4-Bromophenyl phenyl ether	3.52	0.33	"	3.33	ND	106	45-120	8	20	
4-Chloro-3-methylphenol	3.30	0.33	"	3.33	ND	99	55-120	8	25	
4-Chloroaniline	2.89	0.33	"	3.33	ND	87	10-120	12	30	
4-Chlorophenyl phenyl ether	3.46	0.33	"	3.33	ND	104	50-120	8	25	
4-Methylphenol	2.68	0.33	"	3.33	ND	80	50-120	10	25	
4-Nitroaniline	3.65	0.83	"	3.33	ND	110	40-120	4	30	
4-Nitrophenol	3.67	0.83	"	3.33	ND	110	40-120	9	30	
Acenaphthene	3.45	0.33	"	3.33	ND	104	45-120	6	25	
Acenaphthylene	3.55	0.33	"	3.33	ND	107	60-120	6	20	
Aniline	2.44	0.42	"	3.33	ND	73	40-110	12	30	
Anthracene	3.62	0.33	"	3.33	ND	109	60-120	9	25	
Benzidine	ND	0.66	"	3.33	ND		25-120		30	M2
Benzo(a)anthracene	3.60	0.33	"	3.33	ND	108	50-120	7	25	
Benzo(a)pyrene	4.62	0.33	"	3.33	ND	139	55-120	4	25	M7
Benzo(b)fluoranthene	4.54	0.33	"	3.33	ND	136	55-125	5	30	M7
Benzo(g,h,i)perylene	4.13	0.33	"	3.33	ND	124	30-120	3	30	M7
Benzo(k)fluoranthene	4.48	0.33	"	3.33	ND	135	55-120	4	30	M7
Benzoic acid	ND	0.83	"	3.33	ND		25-120		30	M8
Benzyl alcohol	3.32	0.33	"	3.33	ND	100	40-120	9	30	
Bis(2-chloroethoxy)methane	3.49	0.33	"	3.33	ND	105	50-120	12	25	
Bis(2-chloroethyl)ether	2.99	0.17	"	3.33	ND	90	35-110	11	25	
Bis(2-chloroisopropyl)ether	2.82	0.33	"	3.33	ND	85	40-120	9	25	
Bis(2-ethylhexyl)phthalate	3.27	0.33	"	3.33	ND	98	50-125	4	25	
Butyl benzyl phthalate	3.30	0.33	"	3.33	ND	99	50-120	5	25	
Carbazole	3.69	0.33	"	3.33	ND	111	55-125	6	20	
Chrysene	3.70	0.33	"	3.33	ND	111	55-120	8	25	
Dibenz(a,h)anthracene	4.78	0.42	"	3.33	ND	144	25-135	0.6	30	M7
Dibenzofuran	3.48	0.33	"	3.33	ND	105	55-120	7	25	
Diethyl phthalate	3.34	0.33	"	3.33	ND	100	50-120	7	25	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19075 - EPA 3545 / EPA 8270C

Matrix Spike Dup (7B19075-MSD1)	Source: IQB1093-04	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
				Prepared: 02/19/07		Analyzed: 02/20/07				
Dimethyl phthalate	3.26	0.33	mg/kg	3.33	ND	98	25-120	7	25	
Di-n-butyl phthalate	3.43	0.33	"	3.33	0.13	99	50-120	10	25	
Di-n-octyl phthalate	3.29	0.33	"	3.33	ND	99	55-120	7	25	
Fluoranthene	3.58	0.33	"	3.33	ND	108	45-120	10	25	
Fluorene	3.50	0.33	"	3.33	ND	105	50-120	5	25	
Hexachlorobenzene	3.59	0.33	"	3.33	ND	108	50-120	6	25	
Hexachlorobutadiene	2.86	0.33	"	3.33	ND	86	40-110	13	25	
Hexachlorocyclopentadiene	3.22	0.83	"	3.33	ND	97	20-120	13	30	
Hexachloroethane	2.57	0.33	"	3.33	ND	77	35-120	10	30	
Indeno(1,2,3-cd)pyrene	4.60	0.33	"	3.33	ND	138	20-135	2	30	M7
Isophorone	2.77	0.33	"	3.33	ND	83	40-120	9	25	
Naphthalene	3.35	0.33	"	3.33	ND	101	40-120	9	25	
Nitrobenzene	2.92	0.33	"	3.33	ND	88	40-120	10	25	
N-Nitrosodimethylamine	2.48	0.33	"	3.33	ND	74	25-125	10	25	
N-Nitroso-di-n-propylamine	2.79	0.25	"	3.33	ND	84	35-120	8	25	
N-Nitrosodiphenylamine	3.36	0.33	"	3.33	ND	101	50-120	3	25	
Pentachlorophenol	2.70	0.83	"	3.33	ND	81	30-125	21	25	
Phenanthrene	3.60	0.33	"	3.33	ND	108	50-120	9	25	
Phenol	2.80	0.33	"	3.33	ND	84	45-120	5	25	
Pyrene	3.49	0.33	"	3.33	ND	105	45-120	9	30	
Pyridine	2.00	0.20	"	3.33	ND	60	25-130	20	30	
Surrogate: 2,4,6-Tribromophenol	5.74		"	6.66		86	35-125			
Surrogate: 2-Fluorobiphenyl	3.00		"	3.33		90	35-120			
Surrogate: 2-Fluorophenol	4.75		"	6.66		71	25-120			
Surrogate: Nitrobenzene-d5	2.68		"	3.33		80	30-120			
Surrogate: Phenol-d6	5.05		"	6.66		76	35-120			
Surrogate: Terphenyl-d14	2.90		"	3.33		87	40-135			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Blank (7B23065-BLK1)

Prepared & Analyzed: 02/23/07

1,2,4-Trichlorobenzene	ND	0.33	mg/kg
1,2-Dichlorobenzene	ND	0.33	"
1,2-Diphenylhydrazine/Azobenzene	ND	0.33	"
1,3-Dichlorobenzene	ND	0.33	"
1,4-Dichlorobenzene	ND	0.33	"
2,4,5-Trichlorophenol	ND	0.33	"
2,4,6-Trichlorophenol	ND	0.33	"
2,4-Dichlorophenol	ND	0.33	"
2,4-Dimethylphenol	ND	0.33	"
2,4-Dinitrophenol	ND	0.66	"
2,4-Dinitrotoluene	ND	0.33	"
2,6-Dinitrotoluene	ND	0.33	"
2-Chloronaphthalene	ND	0.33	"
2-Chlorophenol	ND	0.33	"
2-Methylnaphthalene	ND	0.33	"
2-Methylphenol	ND	0.33	"
2-Nitroaniline	ND	0.33	"
2-Nitrophenol	ND	0.33	"
3,3-Dichlorobenzidine	ND	0.83	"
3-Nitroaniline	ND	0.33	"
4,6-Dinitro-2-methylphenol	ND	0.42	"
4-Bromophenyl phenyl ether	ND	0.33	"
4-Chloro-3-methylphenol	ND	0.33	"
4-Chloroaniline	ND	0.33	"
4-Chlorophenyl phenyl ether	ND	0.33	"
4-Methylphenol	ND	0.33	"
4-Nitroaniline	ND	0.83	"
4-Nitrophenol	ND	0.83	"
Acenaphthene	ND	0.33	"
Acenaphthylene	ND	0.33	"
Aniline	ND	0.42	"
Anthracene	ND	0.33	"
Benzidine	ND	0.66	"
Benzo(a)anthracene	ND	0.33	"
Benzo(a)pyrene	ND	0.33	"
Benzo(b)fluoranthene	ND	0.33	"

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Blank (7B23065-BLK1)

Prepared & Analyzed: 02/23/07

Benzo(g,h,i)perylene	ND	0.33	mg/kg							
Benzo(k)fluoranthene	ND	0.33	"							
Benzoic acid	ND	0.83	"							
Benzyl alcohol	ND	0.33	"							
Bis(2-chloroethoxy)methane	ND	0.33	"							
Bis(2-chloroethyl)ether	ND	0.17	"							
Bis(2-chloroisopropyl)ether	ND	0.33	"							
Bis(2-ethylhexyl)phthalate	ND	0.33	"							
Butyl benzyl phthalate	ND	0.33	"							
Carbazole	ND	0.33	"							
Chrysene	ND	0.33	"							
Dibenz(a,h)anthracene	ND	0.42	"							
Dibenzofuran	ND	0.33	"							
Diethyl phthalate	ND	0.33	"							
Dimethyl phthalate	ND	0.33	"							
Di-n-butyl phthalate	ND	0.33	"							
Di-n-octyl phthalate	ND	0.33	"							
Fluoranthene	ND	0.33	"							
Fluorene	ND	0.33	"							
Hexachlorobenzene	ND	0.33	"							
Hexachlorobutadiene	ND	0.33	"							
Hexachlorocyclopentadiene	ND	0.83	"							
Hexachloroethane	ND	0.33	"							
Indeno(1,2,3-cd)pyrene	ND	0.33	"							
Isophorone	ND	0.33	"							
Naphthalene	ND	0.33	"							
Nitrobenzene	ND	0.33	"							
N-Nitrosodimethylamine	ND	0.33	"							
N-Nitroso-di-n-propylamine	ND	0.25	"							
N-Nitrosodiphenylamine	ND	0.33	"							
Pentachlorophenol	ND	0.83	"							
Phenanthrene	ND	0.33	"							
Phenol	ND	0.33	"							
Pyrene	ND	0.33	"							
Pyridine	ND	0.20	"							

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Blank (7B23065-BLK1)

Prepared & Analyzed: 02/23/07

Surrogate: 2,4,6-Tribromophenol	5.94		mg/kg	6.67		89	35-125			
Surrogate: 2-Fluorobiphenyl	2.76		"	3.33		83	35-120			
Surrogate: 2-Fluorophenol	4.48		"	6.67		67	25-120			
Surrogate: Nitrobenzene-d5	2.54		"	3.33		76	30-120			
Surrogate: Phenol-d6	4.62		"	6.67		69	35-120			
Surrogate: Terphenyl-d14	3.03		"	3.33		91	40-135			

Laboratory Control Sample (7B23065-BS1)

Prepared & Analyzed: 02/23/07

1,2,4-Trichlorobenzene	2.14	0.33	mg/kg	3.33		64	40-120			
1,2-Dichlorobenzene	1.89	0.33	"	3.33		57	40-120			
1,2-Diphenylhydrazine/Azobenzene	2.22	0.33	"	3.33		67	60-120			
1,3-Dichlorobenzene	1.84	0.33	"	3.33		55	35-120			
1,4-Dichlorobenzene	1.86	0.33	"	3.33		56	35-120			
2,4,5-Trichlorophenol	2.45	0.33	"	3.33		74	55-120			
2,4,6-Trichlorophenol	2.58	0.33	"	3.33		77	50-120			
2,4-Dichlorophenol	2.38	0.33	"	3.33		71	50-120			
2,4-Dimethylphenol	1.99	0.33	"	3.33		60	40-120			
2,4-Dinitrophenol	1.82	0.66	"	3.33		55	25-120			
2,4-Dinitrotoluene	2.36	0.33	"	3.33		71	60-120			
2,6-Dinitrotoluene	2.28	0.33	"	3.33		68	60-120			
2-Chloronaphthalene	2.49	0.33	"	3.33		75	50-120			
2-Chlorophenol	1.99	0.33	"	3.33		60	45-120			
2-Methylnaphthalene	2.30	0.33	"	3.33		69	50-120			
2-Methylphenol	2.06	0.33	"	3.33		62	45-120			
2-Nitroaniline	2.51	0.33	"	3.33		75	55-120			
2-Nitrophenol	1.93	0.33	"	3.33		58	50-120			
3,3-Dichlorobenzidine	1.89	0.83	"	3.33		57	20-135			
3-Nitroaniline	1.74	0.33	"	3.33		52	35-120			
4,6-Dinitro-2-methylphenol	2.16	0.42	"	3.33		65	45-120			
4-Bromophenyl phenyl ether	2.56	0.33	"	3.33		77	50-120			
4-Chloro-3-methylphenol	2.45	0.33	"	3.33		74	55-120			
4-Chloroaniline	1.10	0.33	"	3.33		33	20-120			
4-Chlorophenyl phenyl ether	2.49	0.33	"	3.33		75	60-120			
4-Methylphenol	2.05	0.33	"	3.33		62	50-120			
4-Nitroaniline	2.28	0.83	"	3.33		68	50-120			
4-Nitrophenol	2.44	0.83	"	3.33		73	45-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B23065 - EPA 3545 / EPA 8270C										
Laboratory Control Sample (7B23065-BS1)					Prepared & Analyzed: 02/23/07					
Acenaphthene	2.46	0.33	mg/kg	3.33		74	55-120			
Acenaphthylene	2.60	0.33	"	3.33		78	55-120			
Aniline	1.60	0.42	"	3.33		48	25-120			
Anthracene	2.60	0.33	"	3.33		78	60-120			
Benzidine	1.16	0.66	"	3.33		35	10-160			
Benzo(a)anthracene	2.62	0.33	"	3.33		79	60-120			
Benzo(a)pyrene	3.44	0.33	"	3.33		103	60-120			
Benzo(b)fluoranthene	3.32	0.33	"	3.33		100	55-125			
Benzo(g,h,i)perylene	3.70	0.33	"	3.33		111	40-130			
Benzo(k)fluoranthene	3.36	0.33	"	3.33		101	50-125			
Benzoic acid	1.23	0.83	"	3.33		37	25-120			
Benzyl alcohol	2.12	0.33	"	3.33		64	35-120			
Bis(2-chloroethoxy)methane	2.42	0.33	"	3.33		73	50-120			
Bis(2-chloroethyl)ether	1.97	0.17	"	3.33		59	40-120			
Bis(2-chloroisopropyl)ether	1.95	0.33	"	3.33		59	40-120			
Bis(2-ethylhexyl)phthalate	2.44	0.33	"	3.33		73	55-125			
Butyl benzyl phthalate	2.40	0.33	"	3.33		72	50-120			
Carbazole	2.69	0.33	"	3.33		81	55-125			
Chrysene	2.70	0.33	"	3.33		81	55-120			
Dibenz(a,h)anthracene	3.73	0.42	"	3.33		112	45-135			
Dibenzofuran	2.54	0.33	"	3.33		76	60-120			
Diethyl phthalate	2.30	0.33	"	3.33		69	55-120			
Dimethyl phthalate	2.39	0.33	"	3.33		72	55-120			
Di-n-butyl phthalate	2.38	0.33	"	3.33		71	55-120			
Di-n-octyl phthalate	2.46	0.33	"	3.33		74	50-130			
Fluoranthene	2.71	0.33	"	3.33		81	60-120			
Fluorene	2.55	0.33	"	3.33		77	60-120			
Hexachlorobenzene	2.60	0.33	"	3.33		78	55-120			
Hexachlorobutadiene	2.20	0.33	"	3.33		66	40-120			
Hexachlorocyclopentadiene	2.32	0.83	"	3.33		70	30-120			
Hexachloroethane	1.87	0.33	"	3.33		56	40-120			
Indeno(1,2,3-cd)pyrene	3.46	0.33	"	3.33		104	35-135			
Isophorone	2.03	0.33	"	3.33		61	45-120			
Naphthalene	2.22	0.33	"	3.33		67	50-120			
Nitrobenzene	2.00	0.33	"	3.33		60	45-120			
N-Nitrosodimethylamine	1.78	0.33	"	3.33		53	25-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Laboratory Control Sample (7B23065-BS1)

Prepared & Analyzed: 02/23/07

N-Nitroso-di-n-propylamine	1.98	0.25	mg/kg	3.33		59	45-120			
N-Nitrosodiphenylamine	2.38	0.33	"	3.33		71	50-120			
Pentachlorophenol	2.74	0.83	"	3.33		82	45-125			
Phenanthrene	2.62	0.33	"	3.33		79	55-120			
Phenol	2.03	0.33	"	3.33		61	40-120			
Pyrene	2.61	0.33	"	3.33		78	45-125			
Pyridine	1.45	0.20	"	3.33		44	25-130			
Surrogate: 2,4,6-Tribromophenol	5.34		"	6.67		80	35-125			
Surrogate: 2-Fluorobiphenyl	2.39		"	3.33		72	35-120			
Surrogate: 2-Fluorophenol	3.94		"	6.67		59	25-120			
Surrogate: Nitrobenzene-d5	2.04		"	3.33		61	30-120			
Surrogate: Phenol-d6	4.01		"	6.67		60	35-120			
Surrogate: Terphenyl-d14	2.63		"	3.33		79	40-135			

Matrix Spike (7B23065-MS1)

Source: IQB1703-02

Prepared & Analyzed: 02/23/07

1,2,4-Trichlorobenzene	2.11	0.33	mg/kg	3.33	ND	63	40-120			
1,2-Dichlorobenzene	1.83	0.33	"	3.33	ND	55	40-120			
1,2-Diphenylhydrazine/Azobenzene	2.30	0.33	"	3.33	ND	69	55-125			
1,3-Dichlorobenzene	1.79	0.33	"	3.33	ND	54	35-120			
1,4-Dichlorobenzene	1.78	0.33	"	3.33	ND	53	35-120			
2,4,5-Trichlorophenol	2.63	0.33	"	3.33	ND	79	50-120			
2,4,6-Trichlorophenol	2.67	0.33	"	3.33	ND	80	50-120			
2,4-Dichlorophenol	2.40	0.33	"	3.33	ND	72	50-120			
2,4-Dimethylphenol	1.81	0.33	"	3.33	ND	54	35-120			
2,4-Dinitrophenol	1.85	0.66	"	3.33	ND	56	35-120			
2,4-Dinitrotoluene	2.56	0.33	"	3.33	ND	77	50-120			
2,6-Dinitrotoluene	2.50	0.33	"	3.33	ND	75	55-120			
2-Chloronaphthalene	2.53	0.33	"	3.33	ND	76	45-120			
2-Chlorophenol	1.93	0.33	"	3.33	ND	58	40-120			
2-Methylnaphthalene	2.28	0.33	"	3.33	ND	68	45-120			
2-Methylphenol	1.92	0.33	"	3.33	ND	58	50-120			
2-Nitroaniline	2.70	0.33	"	3.33	ND	81	50-120			
2-Nitrophenol	2.40	0.33	"	3.33	ND	72	45-120			
3,3-Dichlorobenzidine	1.36	0.83	"	3.33	ND	41	15-120			
3-Nitroaniline	1.53	0.33	"	3.33	ND	46	30-120			
4,6-Dinitro-2-methylphenol	2.51	0.42	"	3.33	ND	75	40-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Matrix Spike (7B23065-MS1)	Source: IQB1703-02			Prepared & Analyzed: 02/23/07						
4-Bromophenyl phenyl ether	2.67	0.33	mg/kg	3.33	ND	80	45-120			
4-Chloro-3-methylphenol	2.44	0.33	"	3.33	ND	73	55-120			
4-Chloroaniline	0.753	0.33	"	3.33	ND	23	10-120			
4-Chlorophenyl phenyl ether	2.59	0.33	"	3.33	ND	78	50-120			
4-Methylphenol	2.04	0.33	"	3.33	ND	61	50-120			
4-Nitroaniline	2.32	0.83	"	3.33	ND	70	40-120			
4-Nitrophenol	2.60	0.83	"	3.33	ND	78	40-120			
Acenaphthene	2.49	0.33	"	3.33	ND	75	45-120			
Acenaphthylene	2.65	0.33	"	3.33	ND	80	60-120			
Aniline	0.954	0.42	"	3.33	ND	29	40-110			M2
Anthracene	2.65	0.33	"	3.33	ND	80	60-120			
Benzidine	ND	0.66	"	3.33	ND		25-120			M2
Benzo(a)anthracene	2.64	0.33	"	3.33	ND	79	50-120			
Benzo(a)pyrene	3.52	0.33	"	3.33	ND	106	55-120			
Benzo(b)fluoranthene	3.47	0.33	"	3.33	ND	104	55-125			
Benzo(g,h,i)perylene	3.87	0.33	"	3.33	ND	116	30-120			
Benzo(k)fluoranthene	3.47	0.33	"	3.33	ND	104	55-120			
Benzoic acid	1.32	0.83	"	3.33	ND	40	25-120			
Benzyl alcohol	1.99	0.33	"	3.33	ND	60	40-120			
Bis(2-chloroethoxy)methane	2.48	0.33	"	3.33	ND	74	50-120			
Bis(2-chloroethyl)ether	1.93	0.17	"	3.33	ND	58	35-110			
Bis(2-chloroisopropyl)ether	1.91	0.33	"	3.33	ND	57	40-120			
Bis(2-ethylhexyl)phthalate	2.46	0.33	"	3.33	ND	74	50-125			
Butyl benzyl phthalate	2.43	0.33	"	3.33	ND	73	50-120			
Carbazole	2.80	0.33	"	3.33	ND	84	55-125			
Chrysene	2.71	0.33	"	3.33	ND	81	55-120			
Dibenz(a,h)anthracene	3.89	0.42	"	3.33	ND	117	25-135			
Dibenzofuran	2.63	0.33	"	3.33	ND	79	55-120			
Diethyl phthalate	2.41	0.33	"	3.33	ND	72	50-120			
Dimethyl phthalate	2.48	0.33	"	3.33	ND	74	25-120			
Di-n-butyl phthalate	2.57	0.33	"	3.33	ND	77	50-120			
Di-n-octyl phthalate	2.46	0.33	"	3.33	ND	74	55-120			
Fluoranthene	2.69	0.33	"	3.33	ND	81	45-120			
Fluorene	2.69	0.33	"	3.33	ND	81	50-120			
Hexachlorobenzene	2.72	0.33	"	3.33	ND	82	50-120			
Hexachlorobutadiene	2.18	0.33	"	3.33	ND	65	40-110			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Matrix Spike (7B23065-MS1)	Source: IQB1703-02			Prepared & Analyzed: 02/23/07						
Hexachlorocyclopentadiene	2.33	0.83	mg/kg	3.33	ND	70	20-120			
Hexachloroethane	1.77	0.33	"	3.33	ND	53	35-120			
Indeno(1,2,3-cd)pyrene	3.56	0.33	"	3.33	ND	107	20-135			
Isophorone	1.99	0.33	"	3.33	ND	60	40-120			
Naphthalene	2.12	0.33	"	3.33	ND	64	40-120			
Nitrobenzene	2.02	0.33	"	3.33	ND	61	40-120			
N-Nitrosodimethylamine	1.59	0.33	"	3.33	ND	48	25-125			
N-Nitroso-di-n-propylamine	1.92	0.25	"	3.33	ND	58	35-120			
N-Nitrosodiphenylamine	2.46	0.33	"	3.33	ND	74	50-120			
Pentachlorophenol	2.91	0.83	"	3.33	ND	87	30-125			
Phenanthrene	2.73	0.33	"	3.33	ND	82	50-120			
Phenol	1.96	0.33	"	3.33	ND	59	45-120			
Pyrene	2.75	0.33	"	3.33	ND	83	45-120			
Pyridine	1.31	0.20	"	3.33	ND	39	25-130			
<i>Surrogate: 2,4,6-Tribromophenol</i>	5.44		"	6.66		82	35-125			
<i>Surrogate: 2-Fluorobiphenyl</i>	2.48		"	3.33		74	35-120			
<i>Surrogate: 2-Fluorophenol</i>	3.67		"	6.66		55	25-120			
<i>Surrogate: Nitrobenzene-d5</i>	2.11		"	3.33		63	30-120			
<i>Surrogate: Phenol-d6</i>	3.87		"	6.66		58	35-120			
<i>Surrogate: Terphenyl-d14</i>	2.61		"	3.33		78	40-135			

Matrix Spike Dup (7B23065-MSD1)	Source: IQB1703-02			Prepared & Analyzed: 02/23/07						
1,2,4-Trichlorobenzene	2.22	0.33	mg/kg	3.33	ND	67	40-120	5	25	
1,2-Dichlorobenzene	1.90	0.33	"	3.33	ND	57	40-120	4	25	
1,2-Diphenylhydrazine/Azobenzene	2.55	0.33	"	3.33	ND	77	55-125	10	25	
1,3-Dichlorobenzene	1.87	0.33	"	3.33	ND	56	35-120	4	25	
1,4-Dichlorobenzene	1.84	0.33	"	3.33	ND	55	35-120	3	25	
2,4,5-Trichlorophenol	2.81	0.33	"	3.33	ND	84	50-120	7	20	
2,4,6-Trichlorophenol	2.77	0.33	"	3.33	ND	83	50-120	4	25	
2,4-Dichlorophenol	2.72	0.33	"	3.33	ND	82	50-120	12	25	
2,4-Dimethylphenol	1.74	0.33	"	3.33	ND	52	35-120	4	25	
2,4-Dinitrophenol	2.37	0.66	"	3.33	ND	71	35-120	25	25	
2,4-Dinitrotoluene	2.81	0.33	"	3.33	ND	84	50-120	9	25	
2,6-Dinitrotoluene	2.67	0.33	"	3.33	ND	80	55-120	7	20	
2-Chloronaphthalene	2.53	0.33	"	3.33	ND	76	45-120	0	20	
2-Chlorophenol	2.13	0.33	"	3.33	ND	64	40-120	10	20	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Matrix Spike Dup (7B23065-MSD1)	Source: IQB1703-02	Prepared & Analyzed: 02/23/07								
2-Methylnaphthalene	2.46	0.33	mg/kg	3.33	ND	74	45-120	8	20	
2-Methylphenol	2.07	0.33	"	3.33	ND	62	50-120	8	25	
2-Nitroaniline	2.98	0.33	"	3.33	ND	89	50-120	10	25	
2-Nitrophenol	2.74	0.33	"	3.33	ND	82	45-120	13	25	
3,3-Dichlorobenzidine	1.38	0.83	"	3.33	ND	41	15-120	1	25	
3-Nitroaniline	1.79	0.33	"	3.33	ND	54	30-120	16	25	
4,6-Dinitro-2-methylphenol	3.10	0.42	"	3.33	ND	93	40-120	21	25	
4-Bromophenyl phenyl ether	2.56	0.33	"	3.33	ND	77	45-120	4	20	
4-Chloro-3-methylphenol	2.72	0.33	"	3.33	ND	82	55-120	11	25	
4-Chloroaniline	0.884	0.33	"	3.33	ND	27	10-120	16	30	
4-Chlorophenyl phenyl ether	2.68	0.33	"	3.33	ND	80	50-120	3	25	
4-Methylphenol	2.29	0.33	"	3.33	ND	69	50-120	12	25	
4-Nitroaniline	2.62	0.83	"	3.33	ND	79	40-120	12	30	
4-Nitrophenol	2.85	0.83	"	3.33	ND	86	40-120	9	30	
Acenaphthene	2.53	0.33	"	3.33	ND	76	45-120	2	25	
Acenaphthylene	2.71	0.33	"	3.33	ND	81	60-120	2	20	
Aniline	1.15	0.42	"	3.33	ND	35	40-110	19	30	M2
Anthracene	2.74	0.33	"	3.33	ND	82	60-120	3	25	
Benzidine	ND	0.66	"	3.33	ND		25-120		30	M2
Benzo(a)anthracene	2.65	0.33	"	3.33	ND	80	50-120	0.4	25	
Benzo(a)pyrene	3.50	0.33	"	3.33	ND	105	55-120	0.6	25	
Benzo(b)fluoranthene	3.45	0.33	"	3.33	ND	104	55-125	0.6	30	
Benzo(g,h,i)perylene	3.85	0.33	"	3.33	ND	116	30-120	0.5	30	
Benzo(k)fluoranthene	3.33	0.33	"	3.33	ND	100	55-120	4	30	
Benzoic acid	1.25	0.83	"	3.33	ND	38	25-120	5	30	
Benzyl alcohol	2.28	0.33	"	3.33	ND	68	40-120	14	30	
Bis(2-chloroethoxy)methane	2.58	0.33	"	3.33	ND	77	50-120	4	25	
Bis(2-chloroethyl)ether	2.01	0.17	"	3.33	ND	60	35-110	4	25	
Bis(2-chloroisopropyl)ether	1.99	0.33	"	3.33	ND	60	40-120	4	25	
Bis(2-ethylhexyl)phthalate	2.45	0.33	"	3.33	ND	74	50-125	0.4	25	
Butyl benzyl phthalate	2.45	0.33	"	3.33	ND	74	50-120	0.8	25	
Carbazole	2.89	0.33	"	3.33	ND	87	55-125	3	20	
Chrysene	2.76	0.33	"	3.33	ND	83	55-120	2	25	
Dibenz(a,h)anthracene	3.84	0.42	"	3.33	ND	115	25-135	1	30	
Dibenzofuran	2.69	0.33	"	3.33	ND	81	55-120	2	25	
Diethyl phthalate	2.48	0.33	"	3.33	ND	74	50-120	3	25	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

SEMI-VOLATILE ORGANICS BY GC/MS (EPA 8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B23065 - EPA 3545 / EPA 8270C

Matrix Spike Dup (7B23065-MSD1)	Source: IQB1703-02		Prepared & Analyzed: 02/23/07							
Dimethyl phthalate	2.51	0.33	mg/kg	3.33	ND	75	25-120	1	25	
Di-n-butyl phthalate	2.47	0.33	"	3.33	ND	74	50-120	4	25	
Di-n-octyl phthalate	2.54	0.33	"	3.33	ND	76	55-120	3	25	
Fluoranthene	2.81	0.33	"	3.33	ND	84	45-120	4	25	
Fluorene	2.77	0.33	"	3.33	ND	83	50-120	3	25	
Hexachlorobenzene	2.71	0.33	"	3.33	ND	81	50-120	0.4	25	
Hexachlorobutadiene	2.16	0.33	"	3.33	ND	65	40-110	0.9	25	
Hexachlorocyclopentadiene	2.30	0.83	"	3.33	ND	69	20-120	1	30	
Hexachloroethane	1.86	0.33	"	3.33	ND	56	35-120	5	30	
Indeno(1,2,3-cd)pyrene	3.64	0.33	"	3.33	ND	109	20-135	2	30	
Isophorone	2.09	0.33	"	3.33	ND	63	40-120	5	25	
Naphthalene	2.22	0.33	"	3.33	ND	67	40-120	5	25	
Nitrobenzene	2.17	0.33	"	3.33	ND	65	40-120	7	25	
N-Nitrosodimethylamine	1.84	0.33	"	3.33	ND	55	25-125	15	25	
N-Nitroso-di-n-propylamine	2.08	0.25	"	3.33	ND	62	35-120	8	25	
N-Nitrosodiphenylamine	2.45	0.33	"	3.33	ND	74	50-120	0.4	25	
Pentachlorophenol	3.28	0.83	"	3.33	ND	98	30-125	12	25	
Phenanthrene	2.69	0.33	"	3.33	ND	81	50-120	1	25	
Phenol	2.18	0.33	"	3.33	ND	65	45-120	11	25	
Pyrene	2.60	0.33	"	3.33	ND	78	45-120	6	30	
Pyridine	1.34	0.20	"	3.33	ND	40	25-130	2	30	
Surrogate: 2,4,6-Tribromophenol	5.80		"	6.67		87	35-125			
Surrogate: 2-Fluorobiphenyl	2.49		"	3.33		75	35-120			
Surrogate: 2-Fluorophenol	3.99		"	6.67		60	25-120			
Surrogate: Nitrobenzene-d5	2.34		"	3.33		70	30-120			
Surrogate: Phenol-d6	4.38		"	6.67		66	35-120			
Surrogate: Terphenyl-d14	2.52		"	3.33		76	40-135			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

POLYCHLORINATED BIPHENYLS (EPA 3510C/8082) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19088 - EPA 3510C / EPA 8082

Blank (7B19088-BLK1)

Prepared & Analyzed: 02/19/07

Aroclor 1016	ND	1.0	ug/l							
Aroclor 1221	ND	1.0	"							
Aroclor 1232	ND	1.0	"							
Aroclor 1242	ND	1.0	"							
Aroclor 1248	ND	1.0	"							
Aroclor 1254	ND	1.0	"							
Aroclor 1260	ND	1.0	"							
<i>Surrogate: Decachlorobiphenyl</i>	0.487		"	0.500		97	45-120			

Laboratory Control Sample (7B19088-BS2)

Prepared & Analyzed: 02/19/07

MNR1

Aroclor 1016	3.18	1.0	ug/l	4.00		80	45-115			
Aroclor 1260	3.34	1.0	"	4.00		84	55-115			
<i>Surrogate: Decachlorobiphenyl</i>	0.435		"	0.500		87	45-120			

Laboratory Control Sample Dup (7B19088-BSD2)

Prepared & Analyzed: 02/19/07

Aroclor 1016	3.07	1.0	ug/l	4.00		77	45-115	4	30	
Aroclor 1260	3.21	1.0	"	4.00		80	55-115	4	25	
<i>Surrogate: Decachlorobiphenyl</i>	0.436		"	0.500		87	45-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

POLYCHLORINATED BIPHENYLS (EPA 3545/8082) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19093 - EPA 3545 / EPA 8082

Blank (7B19093-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	ND	0.050	mg/kg							
Aroclor 1221	ND	0.050	"							
Aroclor 1232	ND	0.050	"							
Aroclor 1242	ND	0.050	"							
Aroclor 1248	ND	0.050	"							
Aroclor 1254	ND	0.050	"							
Aroclor 1260	ND	0.050	"							

Surrogate: Decachlorobiphenyl 0.0391 " 0.0333 117 45-120

Laboratory Control Sample (7B19093-BS2)

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	0.240	0.050	mg/kg	0.267	90	60-115				
Aroclor 1260	0.256	0.050	"	0.267	96	60-115				

Surrogate: Decachlorobiphenyl 0.0391 " 0.0333 117 45-120

Matrix Spike (7B19093-MS2)

Source: IQB1140-15

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	0.344	0.050	mg/kg	0.266	ND	129	45-120			M1
Aroclor 1260	0.219	0.050	"	0.266	ND	82	45-120			

Surrogate: Decachlorobiphenyl 0.0174 " 0.0332 52 45-120

Matrix Spike Dup (7B19093-MSD2)

Source: IQB1140-15

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	0.290	0.050	mg/kg	0.266	ND	109	45-120	17	30	
Aroclor 1260	0.211	0.050	"	0.266	ND	79	45-120	4	30	

Surrogate: Decachlorobiphenyl 0.0195 " 0.0332 59 45-120

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

METALS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B16139 - EPA 3005A ICP / EPA 6010B

Blank (7B16139-BLK1)

Prepared: 02/16/07 Analyzed: 02/19/07

Cadmium	ND	0.0050	mg/l							
Chromium	ND	0.0050	"							
Lead	ND	0.0050	"							
Nickel	ND	0.010	"							
Zinc	ND	0.020	"							

Laboratory Control Sample (7B16139-BS1)

Prepared: 02/16/07 Analyzed: 02/19/07

Cadmium	1.02	0.0050	mg/l	1.00		102	80-120			
Chromium	1.02	0.0050	"	1.00		102	80-120			
Lead	1.02	0.0050	"	1.00		102	80-120			
Nickel	1.04	0.010	"	1.00		104	80-120			
Zinc	1.01	0.020	"	1.00		101	80-120			

Matrix Spike (7B16139-MS1)

Source: IQB1510-22

Prepared: 02/16/07 Analyzed: 02/19/07

Cadmium	0.999	0.0050	mg/l	1.00	ND	100	75-125			
Chromium	1.02	0.0050	"	1.00	ND	102	75-125			
Lead	1.02	0.0050	"	1.00	ND	102	75-125			
Nickel	1.01	0.010	"	1.00	0.0028	101	75-125			
Zinc	1.00	0.020	"	1.00	0.0043	100	75-125			

Matrix Spike Dup (7B16139-MSD1)

Source: IQB1510-22

Prepared: 02/16/07 Analyzed: 02/19/07

Cadmium	1.02	0.0050	mg/l	1.00	ND	102	75-125	2	20	
Chromium	1.01	0.0050	"	1.00	ND	101	75-125	1	20	
Lead	1.01	0.0050	"	1.00	ND	101	75-125	1	20	
Nickel	1.03	0.010	"	1.00	0.0028	103	75-125	2	20	
Zinc	1.02	0.020	"	1.00	0.0043	102	75-125	2	20	

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0322
 Reported:
 03/05/07 09:03

METALS - Quality Control

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17042 - EPA 3050B ICP / EPA 6010B

Blank (7B17042-BLK1)

Prepared: 02/17/07 Analyzed: 02/19/07

Cadmium	ND	0.50	mg/kg							
Chromium	ND	1.0	"							
Lead	ND	2.0	"							
Nickel	ND	2.0	"							
Zinc	ND	5.0	"							

Laboratory Control Sample (7B17042-BS1)

Prepared: 02/17/07 Analyzed: 02/19/07

Cadmium	47.2	0.50	mg/kg	50.0		94	80-120			
Chromium	48.5	1.0	"	50.0		97	80-120			
Lead	49.5	2.0	"	50.0		99	80-120			
Nickel	47.3	2.0	"	50.0		95	80-120			
Zinc	46.8	5.0	"	50.0		94	80-120			

Matrix Spike (7B17042-MS1)

Source: IQB1858-01

Prepared: 02/17/07 Analyzed: 02/19/07

Cadmium	43.7	0.50	mg/kg	50.0	ND	87	75-125			
Chromium	69.0	1.0	"	50.0	25	88	75-125			
Lead	46.1	2.0	"	50.0	1.6	89	75-125			
Nickel	53.6	2.0	"	50.0	9.4	88	75-125			
Zinc	100	5.0	"	50.0	56	88	75-125			

Matrix Spike Dup (7B17042-MSD1)

Source: IQB1858-01

Prepared: 02/17/07 Analyzed: 02/19/07

Cadmium	44.2	0.50	mg/kg	50.0	ND	88	75-125	1	20	
Chromium	71.0	1.0	"	50.0	25	92	75-125	3	20	
Lead	47.2	2.0	"	50.0	1.6	91	75-125	2	20	
Nickel	54.8	2.0	"	50.0	9.4	91	75-125	2	20	
Zinc	101	5.0	"	50.0	56	90	75-125	1	20	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0322 Reported: 03/05/07 09:03
--	---	--

INORGANICS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B21095 - 413.1 / EPA 413.1										
Blank (7B21095-BLK1) Prepared & Analyzed: 02/21/07										
Oil & Grease	ND	5.0	mg/l							
Laboratory Control Sample (7B21095-BS1) Prepared & Analyzed: 02/21/07 MNR1										
Oil & Grease	19.8	5.0	mg/l	20.0		99	65-120			
Laboratory Control Sample Dup (7B21095-BSD1) Prepared & Analyzed: 02/21/07										
Oil & Grease	20.7	5.0	mg/l	20.0		104	65-120	4	20	
Batch 7B20085 - 413.1 / EPA 413.1 MOD.										
Blank (7B20085-BLK1) Prepared & Analyzed: 02/20/07										
Oil & Grease	ND	500	mg/kg							
Laboratory Control Sample (7B20085-BS1) Prepared & Analyzed: 02/20/07										
Oil & Grease	673	500	mg/kg	667		101	55-130			
Matrix Spike (7B20085-MS1) Source: IQB1799-01 Prepared & Analyzed: 02/20/07										
Oil & Grease	680	500	mg/kg	667	ND	102	35-130			
Matrix Spike Dup (7B20085-MSD1) Source: IQB1799-01 Prepared & Analyzed: 02/20/07										
Oil & Grease	650	500	mg/kg	667	ND	97	35-130	5	25	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0322
Reported:
03/05/07 09:03

Notes and Definitions

- RL1 Reporting limit raised due to sample matrix effects.
- R-7 LFB/LFBD RPD exceeded the acceptance limit. Recovery met acceptance criteria.
- P1 Sample received and analyzed without chemical preservation.
- MNR1 There was no MS/MSD analyzed with this batch due to insufficient sample volume. See Blank Spike/Blank Spike Duplicate.
- M8 The MS and/or MSD were below the acceptance limits. See Blank Spike (LCS).
- M7 The MS and/or MSD were above the acceptance limits. See Blank Spike (LCS).
- M2 The MS and/or MSD were below the acceptance limits due to sample matrix interference. See Blank Spike (LCS).
- M1 The MS and/or MSD were above the acceptance limits due to sample matrix interference. See Blank Spike (LCS).
- L6 Per the EPA methods, benzidine is known to be subject to oxidative losses during solvent concentration.
- L2 Laboratory Control Sample and/or Laboratory Control Sample Duplicate recovery was below acceptance limits.
- L Laboratory Control Sample and/or Laboratory Control Sample Duplicate recovery was above the acceptance limits. Analyte not detected, data not impacted.
- DET Analyte DETECTED
- ND Analyte NOT DETECTED at or above the reporting limit or MDL, if MDL is specified
- NR Not Reported
- dry Sample results reported on a dry weight basis
- RPD Relative Percent Difference

LAB:

- TA - Irvine, California
- TA - Morgan Hill, California
- TA - Sacramento, California
- TA - Nashville, Tennessee
- Calscience
- Other _____



SHELL Chain Of Custody Record

NAME OF PERSON TO BILL: Bill Merchant

ENVIRONMENTAL SERVICES
 NETWORK DEV/FE
 COMPLIANCE
 BILL CONSULTANT
 RMT/CRMT

CHECK BOX TO VERIFY IF NO INCIDENT # APPLIES

INCIDENT # (ES ONLY)

DATE: 2/14/07

PAGE: 1 of 1

SAMPLING COMPANY: Cambria Environmental Technology, Inc.		LOG CODE: CETO	SITE ADDRESS: Street and City 3790 Hopyard Rd., Pleasanton		State CA	GLOBAL ID NO.: T0600101257
ADDRESS: 5900 Hollis Street, Suite A, Emeryville, CA 94608			EDF DELIVERABLE TO (Name, Company, Office Location): Brenda Carter		PHONE NO.: (510) 420-0700	CONTRACT PROJECT NO.: 207-1232-001
PROJECT CONTACT (Hardcopy or PDF Report to): Aubray Cool			E-MAIL: shell.em.edf@cambria-env.com		LAB USE ONLY: SOB0322	
TELEPHONE: 510-420-3336	FAX: 510-420-9170	E-MAIL: acool@cambria-env.com				

TAT (STD IS 10 BUSINESS DAYS / RUSH IS CALENDAR DAYS):
 STD 5 DAY 3 DAY 2 DAY 24 HOURS
 RESULTS NEEDED ON WEEKEND

REQUESTED ANALYSIS

LA - RWQCB REPORT FORMAT LIST AGENCY:

SPECIAL INSTRUCTIONS OR NOTES:
 EDD NOT NEEDED
 SHELL CONTRACT RATE APPLIES
 STATE REIMB RATE APPLIES
 RECEIPT VERIFICATION REQUESTED

FIELD NOTES:
Container/Preservative or PID Readings or Laboratory Notes

No partial lab reports, send final PDF report only.

LAB USE ONLY	Field Sample Identification				REQUESTED ANALYSIS																	TEMPERATURE ON RECEIPT °C		
	DATE	TIME	MATRIX	NO. OF CONT.	TPH gas- Pungeable (8260B)	TPH diesel - Extractable (8015M)	BTEX (8260B)	5 Oxygenates (8260B)	MTBE (8260B)	TEA (8260B)	DIPE (8260B)	TAME (8260B)	ETBE (8260B)	1,2 DCA (8260B)	EDB (8260B)	PNA5 (8270)	PCP (8270)	Chlorinated Hydrocarbons (8260)	Oil & grease	Cam 5 Metals Cd, Cr, Pb, Zn, Ni	PCBs		Creosote (8270)	
01	2/14/07	1110	Soil	2	X	X	X	X						X	X	X	X	X	X	X	X	X	X	
	2/14/07	1110	soil	1	X	X	X	X																C.H.
02	2/14/07	1130	water	14	X	X	Y	Y						Y	Y	Y	Y	X	X	Y	Y	Y		

Relinquished by (Signature): <i>Celine</i>	Received by (Signature): <i>Secured location</i>	Date: 2/14/07	Time: 1430
Relinquished by (Signature): <i>[Signature]</i>	Received by (Signature): <i>[Signature]</i>	Date: 2-15-07	Time: 08:45
Relinquished by (Signature): <i>[Signature]</i>	Received by (Signature): <i>[Signature]</i>	Date: 2-15-07	Time: 1600

2/15/07 1900


9 March, 2007

Aubrey Cool
Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville, CA 94608

RE: 3790 Hopyard Rd, Pleasanton
Work Order: SQB0321

Enclosed are the results of analyses for samples received by the laboratory on 02/15/07 16:10. If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Linda C. Laver
Project Manager

CA ELAP Certificate # 2630

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0321 Reported: 03/09/07 14:32
--	---	--

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
PG-1	SQB0321-01	Soil	02/14/07 11:15	02/15/07 16:10

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TOTAL RECOVERABLE PETROLEUM HYDROCARBONS (EPA 418.1)
TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Total Recoverable Hydrocarbons	29	5.0	mg/kg	1	7B20086	02/20/07	02/20/07	EPA 418.1	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

EXTRACTABLE FUEL HYDROCARBONS (EPA 8015B w/ Silica Gel Clean-up)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10										
DRO (C10-C28)	20	5.0		mg/kg	1	7B19098	02/19/07	02/20/07	EPA 8015 MOD.	
<i>Surrogate: n-Octacosane</i>		<i>91 %</i>		<i>40-125</i>		<i>"</i>	<i>"</i>	<i>"</i>	<i>"</i>	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

VOLATILE FUEL HYDROCARBONS BY GC/MS (CA LUFT)

TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								

PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10

Analyte	Result	Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
Volatile Fuel Hydrocarbons (C4-C12)	ND	0.20	mg/kg	1	7B16027	02/16/07	02/17/07	TPH by GC/MS	
Surrogate: Dibromofluoromethane		101 %	80-125		"	"	"	"	
Surrogate: Toluene-d8		104 %	80-120		"	"	"	"	
Surrogate: 4-Bromofluorobenzene		102 %	80-120		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

BTEX by GC/MS (EPA 5030B/8260B)
TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Benzene	ND	0.0020	mg/kg	1	7B16027	02/16/07	02/17/07 05:00	EPA 8260B	
Ethylbenzene	ND	0.0020	"	"	"	"	"	"	
Toluene	ND	0.0020	"	"	"	"	"	"	
o-Xylene	ND	0.0020	"	"	"	"	"	"	
m,p-Xylenes	ND	0.0020	"	"	"	"	"	"	
<i>Surrogate: Dibromofluoromethane</i>		101 %		80-125	"	"	"	"	
<i>Surrogate: Toluene-d8</i>		104 %		80-120	"	"	"	"	
<i>Surrogate: 4-Bromofluorobenzene</i>		102 %		80-120	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP SEMI-VOLATILE ORGANIC COMPOUNDS BY GC/MS (EPA 1311/3520/8270C)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Cresol	ND	0.10	mg/l	1	7B20127	02/20/07	02/22/07	EPA 8270C	
1,4-Dichlorobenzene	ND	0.050	"	"	"	"	"	"	
2,4-Dinitrotoluene	ND	0.050	"	"	"	"	"	"	
Hexachlorobenzene	ND	0.050	"	"	"	"	"	"	
Hexachlorobutadiene	ND	0.050	"	"	"	"	"	"	
Hexachloroethane	ND	0.050	"	"	"	"	"	"	
Nitrobenzene	ND	0.20	"	"	"	"	"	"	
Pentachlorophenol	ND	0.20	"	"	"	"	"	"	L
Pyridine	ND	0.050	"	"	"	"	"	"	
2,4,5-Trichlorophenol	ND	0.10	"	"	"	"	"	"	
2,4,6-Trichlorophenol	ND	0.10	"	"	"	"	"	"	
<i>Surrogate: 2-Fluorophenol</i>		81 %		35-120	"	"	"	"	
<i>Surrogate: Phenol-d6</i>		89 %		45-120	"	"	"	"	
<i>Surrogate: 2,4,6-Tribromophenol</i>		109 %		40-125	"	"	"	"	
<i>Surrogate: Nitrobenzene-d5</i>		95 %		40-120	"	"	"	"	
<i>Surrogate: 2-Fluorobiphenyl</i>		89 %		45-120	"	"	"	"	
<i>Surrogate: Terphenyl-d14</i>		101 %		45-135	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

POLYCHLORINATED BIPHENYLS (EPA 3545/8082)

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Aroclor 1016	ND	50	ug/kg	1	7B19093	02/19/07	02/21/07	EPA 8082	
Aroclor 1221	ND	50	"	"	"	"	"	"	
Aroclor 1232	ND	50	"	"	"	"	"	"	
Aroclor 1242	ND	50	"	"	"	"	"	"	
Aroclor 1248	ND	50	"	"	"	"	"	"	
Aroclor 1254	ND	50	"	"	"	"	"	"	
Aroclor 1260	ND	50	"	"	"	"	"	"	
Surrogate: Decachlorobiphenyl		104 %	45-120	"	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP VOLATILE ORGANIC COMPOUNDS (EPA 1311/8260B)
TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10										
Benzene	ND	0.020		mg/l	1	7B20019	02/19/07	02/21/07	8260B-TCLP	
2-Butanone (MEK)	ND	0.10		"	"	"	"	"	"	
Carbon tetrachloride	ND	0.050		"	"	"	"	"	"	
Chlorobenzene	ND	0.020		"	"	"	"	"	"	
Chloroform	ND	0.020		"	"	"	"	"	"	
1,4-Dichlorobenzene	ND	0.020		"	"	"	"	"	"	
1,2-Dichloroethane	ND	0.020		"	"	"	"	"	"	
1,1-Dichloroethene	ND	0.050		"	"	"	"	"	"	
Hexachlorobutadiene	ND	0.050		"	"	"	"	"	"	
Tetrachloroethene	ND	0.020		"	"	"	"	"	"	
Trichloroethene	ND	0.020		"	"	"	"	"	"	
Vinyl chloride	ND	0.050		"	"	"	"	"	"	
Surrogate: Dibromofluoromethane		105 %		80-120		"	"	"	"	
Surrogate: Toluene-d8		103 %		80-120		"	"	"	"	
Surrogate: 4-Bromofluorobenzene		102 %		80-120		"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

METALS

TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Antimony	ND	10	mg/kg	1	7B17042	02/17/07	02/19/07 11:52	EPA 6010B	
Arsenic	4.0	2.0	"	"	"	"	"	"	
Barium	66	1.0	"	"	"	"	"	"	
Beryllium	ND	0.50	"	"	"	"	"	"	
Cadmium	ND	0.50	"	"	"	"	"	"	
Chromium	26	1.0	"	"	"	"	"	"	
Cobalt	6.2	1.0	"	"	"	"	"	"	
Copper	19	2.0	"	"	"	"	"	"	
Lead	3.6	2.0	"	"	"	"	"	"	
Mercury	0.13	0.020	"	"	7B19065	02/19/07	02/19/07 13:26	EPA 7471A	
Molybdenum	ND	2.0	"	"	7B17042	02/17/07	02/19/07 11:52	EPA 6010B	
Nickel	60	2.0	"	"	"	"	"	"	
Selenium	ND	2.0	"	"	"	"	"	"	
Silver	ND	1.0	"	"	"	"	"	"	
Thallium	ND	10	"	"	"	"	"	"	
Vanadium	17	1.0	"	"	"	"	"	"	
Zinc	43	5.0	"	"	"	"	"	"	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

INORGANICS
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10									
Total Cyanide	ND	0.50	mg/kg	1	7B19101	02/19/07	02/19/07 20:38	EPA 9014	
Sulfide	ND	10	"	"	7B21125	02/21/07	02/21/07 20:22	EPA 9034	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP EXTRACTION - Zero Headspace (ZHE)
TestAmerica - Irvine, CA

Analyte	Result	Reporting		Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit	Units						

PG-1 (SQB0321-01) Soil **Sampled: 02/14/07 11:15** **Received: 02/15/07 16:10**

Extraction	DET	1.0	N/A	1	7B19113	02/19/07	02/20/07	EPA 1311-ZHE	
------------	-----	-----	-----	---	---------	----------	----------	--------------	--

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP EXTRACTION - Semi Volatiles
TestAmerica - Irvine, CA

Analyte	Result	Reporting		Units	Dilution	Batch	Prepared	Analyzed	Method	Notes
		Limit								
PG-1 (SQB0321-01) Soil Sampled: 02/14/07 11:15 Received: 02/15/07 16:10										
Extraction	DET	1.0		N/A	1	7B19114	02/19/07	02/20/07	EPA 1311-SV	

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0321 Reported: 03/09/07 14:32
--	---	--

TOTAL RECOVERABLE PETROLEUM HYDROCARBONS (EPA 418.1) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B20086 - 413.2/418.1 / EPA 418.1										
Blank (7B20086-BLK1)										
Total Recoverable Hydrocarbons	ND	5.0	mg/kg							Prepared & Analyzed: 02/20/07
Laboratory Control Sample (7B20086-BS1)										
Total Recoverable Hydrocarbons	16.6	5.0	mg/kg	20.0		83	55-130			Prepared & Analyzed: 02/20/07
Matrix Spike (7B20086-MS1)										
Total Recoverable Hydrocarbons	107	5.0	mg/kg	20.0	92	75	35-130			Source: IQB1788-01 Prepared & Analyzed: 02/20/07 MHA
Matrix Spike Dup (7B20086-MSD1)										
Total Recoverable Hydrocarbons	109	5.0	mg/kg	20.0	92	85	35-130	2	25	Source: IQB1788-01 Prepared & Analyzed: 02/20/07 MHA

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

EXTRACTABLE FUEL HYDROCARBONS (EPA 8015B w/ Silica Gel Clean-up) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19098 - CADHS LUFT+SilicaGel / EPA 8015 MOD.

Blank (7B19098-BLK1)		Prepared & Analyzed: 02/19/07								
EFH (C8 - C28)	ND	5.0	mg/kg							
Surrogate: n-Octacosane	6.07		"	6.67		91	40-125			
Laboratory Control Sample (7B19098-BS1)		Prepared & Analyzed: 02/19/07								
EFH (C8 - C28)	29.4	5.0	mg/kg	33.3		88	40-115			
Surrogate: n-Octacosane	6.20		"	6.67		93	40-125			
Matrix Spike (7B19098-MS1)		Source: IQB1788-01		Prepared & Analyzed: 02/19/07						
EFH (C8 - C28)	57.6	5.0	mg/kg	33.3	30	83	40-120			
Surrogate: n-Octacosane	6.55		"	6.67		98	40-125			
Matrix Spike Dup (7B19098-MSD1)		Source: IQB1788-01		Prepared & Analyzed: 02/19/07						
EFH (C8 - C28)	59.7	5.0	mg/kg	33.3	30	89	40-120	4	30	
Surrogate: n-Octacosane	6.55		"	6.67		98	40-125			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

VOLATILE FUEL HYDROCARBONS BY GC/MS (CA LUFT) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7B16027 - EPA 5030B GCMS / TPH by GC/MS										
Blank (7B16027-BLK1)					Prepared & Analyzed: 02/16/07					
Volatile Fuel Hydrocarbons (C4-C12)	ND	0.20	mg/kg							
Surrogate: Dibromofluoromethane	0.0504		"	0.0500		101	80-125			
Surrogate: Toluene-d8	0.0525		"	0.0500		105	80-120			
Surrogate: 4-Bromofluorobenzene	0.0524		"	0.0500		105	80-120			
Laboratory Control Sample (7B16027-BS2)					Prepared & Analyzed: 02/16/07					
Volatile Fuel Hydrocarbons (C4-C12)	0.774	0.20	mg/kg	1.00		77	60-135			
Surrogate: Dibromofluoromethane	0.0507		"	0.0500		101	80-125			
Surrogate: Toluene-d8	0.0527		"	0.0500		105	80-120			
Surrogate: 4-Bromofluorobenzene	0.0532		"	0.0500		106	80-120			
Matrix Spike (7B16027-MS1)					Source: IQB1237-01 Prepared: 02/16/07 Analyzed: 02/17/07					
Volatile Fuel Hydrocarbons (C4-C12)	1.79	0.20	mg/kg	3.45	ND	52	55-140			M2
Surrogate: Dibromofluoromethane	0.0512		"	0.0500		102	80-125			
Surrogate: Toluene-d8	0.0530		"	0.0500		106	80-120			
Surrogate: 4-Bromofluorobenzene	0.0511		"	0.0500		102	80-120			
Matrix Spike Dup (7B16027-MSD1)					Source: IQB1237-01 Prepared: 02/16/07 Analyzed: 02/17/07					
Volatile Fuel Hydrocarbons (C4-C12)	1.65	0.20	mg/kg	3.45	ND	48	55-140	8	25	M2
Surrogate: Dibromofluoromethane	0.0517		"	0.0500		103	80-125			
Surrogate: Toluene-d8	0.0528		"	0.0500		106	80-120			
Surrogate: 4-Bromofluorobenzene	0.0501		"	0.0500		100	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

BTEX by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B16027 - EPA 5030B GCMS / EPA 8260B

Blank (7B16027-BLK1)

Prepared & Analyzed: 02/16/07

Benzene	ND	0.0020	mg/kg							
Ethylbenzene	ND	0.0020	"							
Toluene	ND	0.0020	"							
o-Xylene	ND	0.0020	"							
m,p-Xylenes	ND	0.0020	"							
Surrogate: Dibromofluoromethane	0.0504		"	0.0500		101	80-125			
Surrogate: Toluene-d8	0.0525		"	0.0500		105	80-120			
Surrogate: 4-Bromofluorobenzene	0.0524		"	0.0500		105	80-120			

Laboratory Control Sample (7B16027-BS1)

Prepared & Analyzed: 02/16/07

Benzene	0.0480	0.0020	mg/kg	0.0500		96	65-120			
Ethylbenzene	0.0477	0.0020	"	0.0500		95	70-125			
Toluene	0.0487	0.0020	"	0.0500		97	70-125			
o-Xylene	0.0500	0.0020	"	0.0500		100	70-125			
m,p-Xylenes	0.0982	0.0020	"	0.100		98	70-125			
Surrogate: Dibromofluoromethane	0.0509		"	0.0500		102	80-125			
Surrogate: Toluene-d8	0.0531		"	0.0500		106	80-120			
Surrogate: 4-Bromofluorobenzene	0.0529		"	0.0500		106	80-120			

Matrix Spike (7B16027-MS1)

Source: IQB1237-01

Prepared: 02/16/07 Analyzed: 02/17/07

Benzene	0.0474	0.0020	mg/kg	0.0500	ND	95	65-130			
Ethylbenzene	0.0471	0.0020	"	0.0500	ND	94	70-135			
Toluene	0.0474	0.0020	"	0.0500	ND	95	70-130			
o-Xylene	0.0483	0.0020	"	0.0500	ND	97	65-130			
m,p-Xylenes	0.0971	0.0020	"	0.100	ND	97	70-130			
Surrogate: Dibromofluoromethane	0.0512		"	0.0500		102	80-125			
Surrogate: Toluene-d8	0.0530		"	0.0500		106	80-120			
Surrogate: 4-Bromofluorobenzene	0.0511		"	0.0500		102	80-120			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

BTEX by GC/MS (EPA 5030B/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B16027 - EPA 5030B GCMS / EPA 8260B

Matrix Spike Dup (7B16027-MSD1)	Source: IQB1237-01	Prepared: 02/16/07	Analyzed: 02/17/07						
Benzene	0.0477	0.0020	mg/kg	0.0500	ND	95	65-130	0.6	20
Ethylbenzene	0.0447	0.0020	"	0.0500	ND	89	70-135	5	25
Toluene	0.0465	0.0020	"	0.0500	ND	93	70-130	2	20
o-Xylene	0.0465	0.0020	"	0.0500	ND	93	65-130	4	25
m,p-Xylenes	0.0887	0.0020	"	0.100	ND	89	70-130	9	25
Surrogate: Dibromofluoromethane	0.0517		"	0.0500		103	80-125		
Surrogate: Toluene-d8	0.0528		"	0.0500		106	80-120		
Surrogate: 4-Bromofluorobenzene	0.0501		"	0.0500		100	80-120		

Cambria Env - 5900 Hollis, Emeryville (Shell)
 5900 Hollis St., Ste. A
 Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
 Project Number: SAP# 135784
 Project Manager: Aubrey Cool

SQB0321
 Reported:
 03/09/07 14:32

TCLP SEMI-VOLATILE ORGANIC COMPOUNDS BY GC/MS (EPA 1311/3520/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B20127 - EPA 1311/3520C / EPA 8270C

Blank (7B20127-BLK1)

Prepared: 02/20/07 Analyzed: 02/22/07

Cresol	ND	0.10	mg/l							
1,4-Dichlorobenzene	ND	0.050	"							
2,4-Dinitrotoluene	ND	0.050	"							
Hexachlorobenzene	ND	0.050	"							
Hexachlorobutadiene	ND	0.050	"							
Hexachloroethane	ND	0.050	"							
Nitrobenzene	ND	0.20	"							
Pentachlorophenol	ND	0.20	"							
Pyridine	ND	0.050	"							
2,4,5-Trichlorophenol	ND	0.10	"							
2,4,6-Trichlorophenol	ND	0.10	"							
Surrogate: 2-Fluorophenol	0.962		"	1.00		96	35-120			
Surrogate: Phenol-d6	0.994		"	1.00		99	45-120			
Surrogate: 2,4,6-Tribromophenol	1.12		"	1.00		112	40-125			
Surrogate: Nitrobenzene-d5	0.516		"	0.500		103	40-120			
Surrogate: 2-Fluorobiphenyl	0.495		"	0.500		99	45-120			
Surrogate: Terphenyl-d14	0.561		"	0.500		112	45-135			

Laboratory Control Sample (7B20127-BS1)

Prepared: 02/20/07 Analyzed: 02/22/07

1,4-Dichlorobenzene	0.361	0.050	mg/l	0.500		72	35-120			
2,4-Dinitrotoluene	0.514	0.050	"	0.500		103	60-120			
Hexachlorobenzene	0.561	0.050	"	0.500		112	55-120			
Hexachlorobutadiene	0.439	0.050	"	0.500		88	40-120			
Hexachloroethane	0.357	0.050	"	0.500		71	35-120			
Nitrobenzene	0.472	0.20	"	0.500		94	50-120			
Pentachlorophenol	0.649	0.20	"	0.500		130	45-125			L
Pyridine	0.326	0.050	"	0.500		65	30-120			
2,4,5-Trichlorophenol	0.537	0.10	"	0.500		107	50-120			
2,4,6-Trichlorophenol	0.556	0.10	"	0.500		111	50-120			
Surrogate: 2-Fluorophenol	0.838		"	1.00		84	35-120			
Surrogate: Phenol-d6	0.924		"	1.00		92	45-120			
Surrogate: 2,4,6-Tribromophenol	1.20		"	1.00		120	40-125			
Surrogate: Nitrobenzene-d5	0.497		"	0.500		99	40-120			
Surrogate: 2-Fluorobiphenyl	0.507		"	0.500		101	45-120			
Surrogate: Terphenyl-d14	0.533		"	0.500		107	45-135			

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP SEMI-VOLATILE ORGANIC COMPOUNDS BY GC/MS (EPA 1311/3520/8270C) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B20127 - EPA 1311/3520C / EPA 8270C

Matrix Spike (7B20127-MS1)	Source: SQB0321-01			Prepared: 02/20/07		Analyzed: 02/22/07	
1,4-Dichlorobenzene	0.295	0.050	mg/l	0.500	ND	59	35-120
2,4-Dinitrotoluene	0.469	0.050	"	0.500	ND	94	60-120
Hexachlorobenzene	0.499	0.050	"	0.500	ND	100	50-120
Hexachlorobutadiene	0.384	0.050	"	0.500	ND	77	40-120
Hexachloroethane	0.271	0.050	"	0.500	ND	54	35-120
Nitrobenzene	0.449	0.20	"	0.500	ND	90	50-120
Pentachlorophenol	0.570	0.20	"	0.500	ND	114	45-125
Pyridine	0.330	0.050	"	0.500	ND	66	30-120
2,4,5-Trichlorophenol	0.506	0.10	"	0.500	ND	101	50-120
2,4,6-Trichlorophenol	0.508	0.10	"	0.500	ND	102	50-120
Surrogate: 2-Fluorophenol	0.820		"	1.00		82	35-120
Surrogate: Phenol-d6	0.860		"	1.00		86	45-120
Surrogate: 2,4,6-Tribromophenol	1.08		"	1.00		108	40-125
Surrogate: Nitrobenzene-d5	0.467		"	0.500		93	40-120
Surrogate: 2-Fluorobiphenyl	0.464		"	0.500		93	45-120
Surrogate: Terphenyl-d14	0.524		"	0.500		105	45-135

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

POLYCHLORINATED BIPHENYLS (EPA 3545/8082) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19093 - EPA 3545 / EPA 8082

Blank (7B19093-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	ND	50	ug/kg							
Aroclor 1221	ND	50	"							
Aroclor 1232	ND	50	"							
Aroclor 1242	ND	50	"							
Aroclor 1248	ND	50	"							
Aroclor 1254	ND	50	"							
Aroclor 1260	ND	50	"							

Surrogate: Decachlorobiphenyl 39.1 " 33.3 117 45-120

Laboratory Control Sample (7B19093-BS2)

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	240	50	ug/kg	267		90	60-115			
Aroclor 1260	256	50	"	267		96	60-115			

Surrogate: Decachlorobiphenyl 39.1 " 33.3 117 45-120

Matrix Spike (7B19093-MS2)

Source: IQB1140-15

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	344	50	ug/kg	266	ND	129	45-120			M1
Aroclor 1260	219	50	"	266	ND	82	45-120			

Surrogate: Decachlorobiphenyl 17.4 " 33.2 52 45-120

Matrix Spike Dup (7B19093-MSD2)

Source: IQB1140-15

Prepared: 02/19/07 Analyzed: 02/20/07

Aroclor 1016	290	50	ug/kg	266	ND	109	45-120	17	30	
Aroclor 1260	211	50	"	266	ND	79	45-120	4	30	

Surrogate: Decachlorobiphenyl 19.5 " 33.2 59 45-120

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP VOLATILE ORGANIC COMPOUNDS (EPA 1311/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B20019 - EPA 1311/5030B-MSV / 8260B-TCLP

Blank (7B20019-BLK1)

Prepared: 02/19/07 Analyzed: 02/21/07

Benzene	ND	0.020	mg/l							
2-Butanone (MEK)	ND	0.10	"							
Carbon tetrachloride	ND	0.050	"							
Chlorobenzene	ND	0.020	"							
Chloroform	ND	0.020	"							
1,4-Dichlorobenzene	ND	0.020	"							
1,2-Dichloroethane	ND	0.020	"							
1,1-Dichloroethene	ND	0.050	"							
Hexachlorobutadiene	ND	0.050	"							
Tetrachloroethene	ND	0.020	"							
Trichloroethene	ND	0.020	"							
Vinyl chloride	ND	0.050	"							
Surrogate: Dibromofluoromethane	0.281		"	0.250		112	80-120			
Surrogate: Toluene-d8	0.261		"	0.250		104	80-120			
Surrogate: 4-Bromofluorobenzene	0.247		"	0.250		99	80-120			

Laboratory Control Sample (7B20019-BS1)

Prepared: 02/19/07 Analyzed: 02/21/07

Benzene	0.249	0.020	mg/l	0.250		100	70-120			
2-Butanone (MEK)	0.219	0.10	"	0.250		88	40-140			
Carbon tetrachloride	0.217	0.050	"	0.250		87	65-140			
Chlorobenzene	0.246	0.020	"	0.250		98	75-120			
Chloroform	0.242	0.020	"	0.250		97	70-130			
1,4-Dichlorobenzene	0.238	0.020	"	0.250		95	75-120			
1,2-Dichloroethane	0.219	0.020	"	0.250		88	60-140			
1,1-Dichloroethene	0.206	0.050	"	0.250		82	70-125			
Hexachlorobutadiene	0.196	0.050	"	0.250		78	65-135			
Tetrachloroethene	0.225	0.020	"	0.250		90	70-125			
Trichloroethene	0.225	0.020	"	0.250		90	70-125			
Vinyl chloride	0.301	0.050	"	0.250		120	55-135			
Surrogate: Dibromofluoromethane	0.275		"	0.250		110	80-120			
Surrogate: Toluene-d8	0.262		"	0.250		105	80-120			
Surrogate: 4-Bromofluorobenzene	0.278		"	0.250		111	80-120			

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP VOLATILE ORGANIC COMPOUNDS (EPA 1311/8260B) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B20019 - EPA 1311/5030B-MSV / 8260B-TCLP

Matrix Spike (7B20019-MS1)	Source: IQA2566-02	Prepared: 02/19/07	Analyzed: 02/21/07				
Benzene	0.248	0.020	mg/l	0.250	0.0089	96	65-125
2-Butanone (MEK)	0.245	0.10	"	0.250	ND	98	30-145
Carbon tetrachloride	0.211	0.050	"	0.250	ND	84	65-140
Chlorobenzene	0.254	0.020	"	0.250	ND	102	75-125
Chloroform	0.232	0.020	"	0.250	ND	93	65-135
1,4-Dichlorobenzene	0.257	0.020	"	0.250	ND	103	75-125
1,2-Dichloroethane	0.252	0.020	"	0.250	ND	101	60-140
1,1-Dichloroethene	0.217	0.050	"	0.250	ND	87	60-130
Hexachlorobutadiene	0.265	0.050	"	0.250	ND	106	60-135
Tetrachloroethene	0.254	0.020	"	0.250	ND	102	65-130
Trichloroethene	0.241	0.020	"	0.250	ND	96	65-125
Vinyl chloride	0.286	0.050	"	0.250	ND	114	45-140
Surrogate: Dibromofluoromethane	0.248		"	0.250		99	80-120
Surrogate: Toluene-d8	0.275		"	0.250		110	80-120
Surrogate: 4-Bromofluorobenzene	0.255		"	0.250		102	80-120

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

METALS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17042 - EPA 3050B ICP / EPA 6010B

Blank (7B17042-BLK1)

Prepared: 02/17/07 Analyzed: 02/19/07

Antimony	ND	10	mg/kg							
Arsenic	ND	2.0	"							
Barium	ND	1.0	"							
Beryllium	ND	0.50	"							
Cadmium	ND	0.50	"							
Chromium	ND	1.0	"							
Cobalt	ND	1.0	"							
Copper	ND	2.0	"							
Lead	ND	2.0	"							
Molybdenum	ND	2.0	"							
Nickel	ND	2.0	"							
Selenium	ND	2.0	"							
Silver	ND	1.0	"							
Thallium	ND	10	"							
Vanadium	ND	1.0	"							
Zinc	ND	5.0	"							

Laboratory Control Sample (7B17042-BS1)

Prepared: 02/17/07 Analyzed: 02/19/07

Antimony	52.7	10	mg/kg	50.0	105	80-120
Arsenic	48.4	2.0	"	50.0	97	80-120
Barium	46.8	1.0	"	50.0	94	80-120
Beryllium	48.0	0.50	"	50.0	96	80-120
Cadmium	47.2	0.50	"	50.0	94	80-120
Chromium	48.5	1.0	"	50.0	97	80-120
Cobalt	47.4	1.0	"	50.0	95	80-120
Copper	46.5	2.0	"	50.0	93	80-120
Lead	49.5	2.0	"	50.0	99	80-120
Molybdenum	46.9	2.0	"	50.0	94	80-120
Nickel	47.3	2.0	"	50.0	95	80-120
Selenium	46.3	2.0	"	50.0	93	80-120
Silver	24.9	1.0	"	25.0	100	80-120
Thallium	48.1	10	"	50.0	96	80-120
Vanadium	48.1	1.0	"	50.0	96	80-120
Zinc	46.8	5.0	"	50.0	94	80-120

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

METALS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B17042 - EPA 3050B ICP / EPA 6010B

Matrix Spike (7B17042-MS1)	Source: IQB1858-01			Prepared: 02/17/07		Analyzed: 02/19/07				
Antimony	14.9	10	mg/kg	50.0	ND	30	75-125			M2
Arsenic	46.3	2.0	"	50.0	2.1	88	75-125			
Barium	203	1.0	"	50.0	160	86	75-125			
Beryllium	45.2	0.50	"	50.0	0.25	90	75-125			
Cadmium	43.7	0.50	"	50.0	ND	87	75-125			
Chromium	69.0	1.0	"	50.0	25	88	75-125			
Cobalt	49.6	1.0	"	50.0	6.1	87	75-125			
Copper	61.4	2.0	"	50.0	16	91	75-125			
Lead	46.1	2.0	"	50.0	1.6	89	75-125			
Molybdenum	42.7	2.0	"	50.0	0.86	84	75-125			
Nickel	53.6	2.0	"	50.0	9.4	88	75-125			
Selenium	44.2	2.0	"	50.0	1.8	85	75-125			
Silver	24.5	1.0	"	25.0	ND	98	75-125			
Thallium	46.2	10	"	50.0	2.0	88	75-125			
Vanadium	110	1.0	"	50.0	65	90	75-125			
Zinc	100	5.0	"	50.0	56	88	75-125			

Matrix Spike Dup (7B17042-MSD1)	Source: IQB1858-01			Prepared: 02/17/07		Analyzed: 02/19/07				
Antimony	14.8	10	mg/kg	50.0	ND	30	75-125	0.7	20	M2
Arsenic	47.7	2.0	"	50.0	2.1	91	75-125	3	20	
Barium	205	1.0	"	50.0	160	90	75-125	1	20	
Beryllium	46.2	0.50	"	50.0	0.25	92	75-125	2	20	
Cadmium	44.2	0.50	"	50.0	ND	88	75-125	1	20	
Chromium	71.0	1.0	"	50.0	25	92	75-125	3	20	
Cobalt	51.3	1.0	"	50.0	6.1	90	75-125	3	20	
Copper	62.0	2.0	"	50.0	16	92	75-125	1	20	
Lead	47.2	2.0	"	50.0	1.6	91	75-125	2	20	
Molybdenum	43.9	2.0	"	50.0	0.86	86	75-125	3	20	
Nickel	54.8	2.0	"	50.0	9.4	91	75-125	2	20	
Selenium	45.6	2.0	"	50.0	1.8	88	75-125	3	20	
Silver	24.8	1.0	"	25.0	ND	99	75-125	1	20	
Thallium	47.0	10	"	50.0	2.0	90	75-125	2	20	
Vanadium	111	1.0	"	50.0	65	92	75-125	0.9	20	
Zinc	101	5.0	"	50.0	56	90	75-125	1	20	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0321 Reported: 03/09/07 14:32
--	---	--

METALS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19065 - EPA 7471A Hg / EPA 7471A

Blank (7B19065-BLK1)				Prepared & Analyzed: 02/19/07						
Mercury	ND	0.020	mg/kg							
Laboratory Control Sample (7B19065-BS1)				Prepared & Analyzed: 02/19/07						
Mercury	0.792	0.020	mg/kg	0.800		99	85-120			
Matrix Spike (7B19065-MS1)				Prepared & Analyzed: 02/19/07						
Mercury	0.818	0.020	mg/kg	0.800	0.049	96	65-135			
Matrix Spike Dup (7B19065-MSD1)				Prepared & Analyzed: 02/19/07						
Mercury	0.823	0.020	mg/kg	0.800	0.049	97	65-135	0.6	20	

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

INORGANICS - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19101 - General Prep / EPA 9014

Blank (7B19101-BLK1)				Prepared & Analyzed: 02/19/07						
Total Cyanide	ND	0.50	mg/kg							
Laboratory Control Sample (7B19101-BS1)				Prepared & Analyzed: 02/19/07						
Total Cyanide	4.97	0.50	mg/kg	5.00		99	90-110			
Matrix Spike (7B19101-MS1)				Source: IQB1423-01 Prepared & Analyzed: 02/19/07						
Total Cyanide	6.31	0.50	mg/kg	5.00	5.6	14	70-115			M2
Matrix Spike Dup (7B19101-MSD1)				Source: IQB1423-01 Prepared & Analyzed: 02/19/07						
Total Cyanide	6.36	0.50	mg/kg	5.00	5.6	15	70-115	0.8	15	M2

Batch 7B21125 - General Prep / EPA 9034

Blank (7B21125-BLK1)				Prepared & Analyzed: 02/21/07						
Sulfide	ND	1.0	mg/kg							
Laboratory Control Sample (7B21125-BS1)				Prepared & Analyzed: 02/21/07						
Sulfide	10.8	1.0	mg/kg	11.2		96	80-120			
Matrix Spike (7B21125-MS1)				Source: IQB1809-01 Prepared & Analyzed: 02/21/07						
Sulfide	96.0	10	mg/kg	112	ND	86	70-130			
Matrix Spike Dup (7B21125-MSD1)				Source: IQB1809-01 Prepared & Analyzed: 02/21/07						
Sulfide	88.0	10	mg/kg	112	ND	79	70-130	9	30	

TestAmerica - Sacramento, CA

The results in this report apply to the samples analyzed in accordance with the chain of custody document. Unless otherwise stated, results are reported on a wet weight basis. This analytical report must be reproduced in its entirety.

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP EXTRACTION - Zero Headspace (ZHE) - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7B19113 - EPA 1311 - ZHE / EPA 1311-ZHE

Blank (7B19113-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

Extraction	ND	1.0	N/A							
------------	----	-----	-----	--	--	--	--	--	--	--

Cambria Env - 5900 Hollis, Emeryville (Shell)
5900 Hollis St., Ste. A
Emeryville CA, 94608

Project: 3790 Hopyard Rd, Pleasanton
Project Number: SAP# 135784
Project Manager: Aubrey Cool

SQB0321
Reported:
03/09/07 14:32

TCLP EXTRACTION - Semi Volatiles - Quality Control
TestAmerica - Irvine, CA

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	-------

Batch 7B19114 - EPA 1311 - SV / EPA 1311-SV

Blank (7B19114-BLK1)

Prepared: 02/19/07 Analyzed: 02/20/07

Extraction	ND	1.0	N/A							
------------	----	-----	-----	--	--	--	--	--	--	--

Cambria Env - 5900 Hollis, Emeryville (Shell) 5900 Hollis St., Ste. A Emeryville CA, 94608	Project: 3790 Hopyard Rd, Pleasanton Project Number: SAP# 135784 Project Manager: Aubrey Cool	SQB0321 Reported: 03/09/07 14:32
--	---	--

Notes and Definitions

- MHA Due to high levels of analyte in the sample, the MS/MSD calculation does not provide useful spike recovery information. See Blank Spike (LCS).
- M2 The MS and/or MSD were below the acceptance limits due to sample matrix interference. See Blank Spike (LCS).
- M1 The MS and/or MSD were above the acceptance limits due to sample matrix interference. See Blank Spike (LCS).
- L Laboratory Control Sample and/or Laboratory Control Sample Duplicate recovery was above the acceptance limits. Analyte not detected, data not impacted.
- DET Analyte DETECTED
- ND Analyte NOT DETECTED at or above the reporting limit or MDL, if MDL is specified
- NR Not Reported
- dry Sample results reported on a dry weight basis
- RPD Relative Percent Difference

LAB:

- TA - Irvine, California
- TA - Morgan Hill, California
- TA - Sacramento, California
- TA - Nashville, Tennessee
- Calscience
- Other



SHELL Chain Of Custody Record

NAME OF PERSON TO BILL: Bill Merchant

INCIDENT # (ES ONLY)

ENVIRONMENTAL SERVICES

NETWORK DEV / PE

COMPLIANCE

BILL CONSULTANT

RMT/GRMT

CHECK BOX TO VERIFY IF NO INCIDENT # APPLIES

DATE: 2/14/07

PAGE: 1 of 1

PO #

SAP or GRMT #

1 3 5 7 8 4

SAMPLING COMPANY: Cambria Environmental Technology, Inc. **LOG CODE:** CETO

SITE ADDRESS: Street and City: 3790 Hopyard Rd., Pleasanton **State:** CA **GLOBAL ID NO.:** T0600101257

ADDRESS: 5900 Hollis Street, Suite A, Emeryville, CA 94608

EDP DELIVERABLE TO (Name, Company, Office Location): Brenda Carter **PHONE NO.:** (510) 420-0700 **E-MAIL:** shell.em.edf@cambria-env.com **CONSULTANT PROJECT NO.:** 207-1742-001

PROJECT CONTACT (Hardcopy or PDF Report to): Aubrey Cool

SAMPLER NAME(S) (Print): Celina Hernandez **LAB USE ONLY:** 5080321

TELEPHONE: 510-420-3336 **FAX:** (510) 420-3394 **E-MAIL:** accool@cambria-env.com

TAT (STD IS 10 BUSINESS DAYS / RUSH IS CALENDAR DAYS): STD 5 DAY 3 DAY 2 DAY 24 HOURS RESULTS NEEDED ON WEEKEND

REQUESTED ANALYSIS

LA - RWQCB REPORT FORMAT UST AGENCY:

SPECIAL INSTRUCTIONS OR NOTES:

- EDD NOT NEEDED
- SHELL CONTRACT RATE APPLIES
- STATE REIMB RATE APPLIES
- RECEIPT VERIFICATION REQUESTED

cc: Daviya Saleme, dsaleme@cambria-env.com

Call composite sample ID and field point name: PG-1

LAB USE ONLY	Field Sample Identification	SAMPLING		MATRIX	NO. OF CONT.	TPH - Purgeable (8260B)	TPH - Extractable (8015M) w/SGC	BTEX (8260B)	5 Oxygenates (8260B) (MTBE, TBA, DIBP, TAME, ETBE)	TRPH	Reactive Sulfide & Cyanide	PCBs by EPA 8082	TCLP VOCs by 8260B	TCLP Semi-Volatiles by 8270C	Lead <input type="checkbox"/> Total <input type="checkbox"/> STLC <input type="checkbox"/> TCLP	LUFTS <input type="checkbox"/> Total <input type="checkbox"/> STLC <input type="checkbox"/> TCLP	CAMP17 <input type="checkbox"/> Total <input type="checkbox"/> STLC <input type="checkbox"/> TCLP	Test for Disposal (see attached)	TEMPERATURE ON RECEIPT C°	FIELD NOTES: Container/Preservative or PID Readings or Laboratory Notes	
		DATE	TIME																		
01	PG-1A	2/14/2007	1115	soil	1	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	Please call
	PG-1B		1115		1	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	composite
	PG-1C		1115		1	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	sample
	PG-1D		1115		1	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	PG-1

Relinquished by: (Signature) *Celina Hernandez*

Relinquished by: (Signature) *[Signature]*

Relinquished by: (Signature) *[Signature]*

Received by: (Signature) *Secured location*

Received by: (Signature) *[Signature]*

Received by: (Signature) *John Yuell I/A*

Received by: (Signature) *John Yuell I/A*

Date: 2/14/07 Time: 1430

Date: 2/15/07 Time: 0845

Date: 2-15-07 Time: 1610

Date: 2/15/07 Time: 1900

ISSUED DATE: 05/23/97
 CANCELS ISSUE: 03/05/97
 ISSUED BY: RLG

MATERIAL: SOIL CONTAMINATED WITH WASTE OIL

USE FOR ARIZONA , CALIFORNIA AND NEVADA WASTE ONLY!!!

MINIMUM REQUIRED TESTING

TPHd, TPHg

TRPH = TOTAL RECOVERABLE PETROLEUM HYDROCARBONS = EPA 418.1

~~BTXE - EPA 8020~~

CAM METALS = TTLC ALL: **17**

STLC ON ALL TTLC METALS 10 X STLC MAXIMUM:

TTLC LEAD => 13 MG/KG REQUIRES ORGANIC ANALYSIS

TCLP EXTRACTION = EPA 1311 AND

VOC ON EXTRACT = EPA ~~8240~~ **8260**

SVOC ON EXTRACT = EPA 8270

~~METALS ON EXTRACT - EPA 6010, (USE 7470 FOR Hg)~~

NOTE: IF PESTICIDES = EPA 8080 (ON EXTRACT)

IF HERBICIDES = EPA 8150 (ON EXTRACT)

PCBs = EPA METHOD 8080 (NOT ON EXTRACT)

HYDROGEN SULFIDE = SW-846 (7.3.4.2) (REACTIVITY)

HYDROGEN CYANIDE = SW-846 (7.3.3.2) (REACTIVITY)

~~pH (CORROSIVITY)~~

If TPH > 5000 ppm,

AQUATIC BIOASSAY (FISH TOX) = PART 800 OF "STANDARD METHODS FOR THE EXAMINATION OF WATER AND WASTEWATER (15TH EDITION)"

LABORATORY INSTRUCTIONS (MINIMUM GUIDELINES ONLY)

~~TRPH REQUIRED ON ALL SAMPLES~~

- ALL OTHER TESTS REQUIRED TO BE RUN ON COMPOSITE(S). MAXIMUM 4 SAMPLES PER COMPOSITE.
- STLC REQUIRED FOR METALS WITH TTLC VALUE 10 X STLC MAXIMUM.
- ORGANIC ANALYSIS REQUIRED FOR TTLC LEAD OF 13 MG/KG OR GREATER.
- LABORATORY IS TO SUPPLY QA/QC INFORMATION WITH ALL ANALYTICAL REPORTS.

~~MAIL OR FAX ALL ANALYSIS TO PERSON REQUESTING ANALYSIS.~~

PROCEDURE ORIGINAL DATE: 07/10/90

PROCEDURE REVISED DATE: 03/05/97

ATTACHMENT C

Unauthorized Release Report

UNDERGROUND STORAGE TANK UNAUTHORIZED RELEASE (LEAK) / CONTAMINATION SITE REPORT			
EMERGENCY <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		HAS STATE OFFICE OF EMERGENCY SERVICES REPORT BEEN FILED? <input type="checkbox"/> Yes <input type="checkbox"/> No	
REPORT DATE 3/7/2007		CASE #	
FOR LOCAL AGENCY USE ONLY I HEREBY CERTIFY THAT I AM A DESIGNATED GOVERNMENT EMPLOYEE AND THAT I HAVE REPORTED THIS INFORMATION TO LOCAL OFFICIALS PURSUANT TO SECTION 88190.7 OF THE HEALTH AND SAFETY CODE. <i>Aura Sibley</i> SIGNED: _____ DATE: 3/7/07			
REPORTED BY	NAME OF INDIVIDUAL FILING REPORT Aura Sibley		PHONE (916) 240-1610
	REPRESENTING <input type="checkbox"/> LOCAL AGENCY <input type="checkbox"/> REGIONAL BOARD <input checked="" type="checkbox"/> OWNER/OPERATOR <input type="checkbox"/> OTHER		COMPANY OR AGENCY NAME Shell Oil Products US
RESPONSIBLE PARTY	ADDRESS 20945 S. Wilmington Avenue		CARSON CA 90810
	NAME Shell Oil Products US		CONTACT PERSON Denis Brown
SITE LOCATION	FACILITY NAME (IF APPLICABLE) Shell-branded Service Station		OPERATOR Robert J. Wood
	ADDRESS 3790 Hopyard Road		Pleasanton Alameda 94588
IMPLEMENTING AGENCIES	LOCAL AGENCY AGENCY NAME Alameda County Health Care Services Agency		PHONE (510) 567-6791
	REGIONAL BOARD San Francisco Bay		PHONE (510) 622-2300
SUBSTANCES INVOLVED	(1) NAME Benzene - 0.67 ug/l (WO-W)		QUANTITY LOST (GALLONS) <input checked="" type="checkbox"/> Unknown
	(2) NAME MTBE - 1.6 ug/l (WO-W)		QUANTITY LOST (GALLONS) <input checked="" type="checkbox"/> Unknown
DISCOVERY/DATE	DATE DISCOVERED 3/5/2007	HOW DISCOVERED <input type="checkbox"/> Tank Test <input checked="" type="checkbox"/> Tank Removal <input type="checkbox"/> Nuisance Conditions <input type="checkbox"/> Inventory Control <input type="checkbox"/> Subsurface Monitoring <input type="checkbox"/> Other	
	DATE DISCHARGE BEGAN	METHOD USED TO STOP DISCHARGE (CHECK ALL THAT APPLY) <input type="checkbox"/> Remove Contents <input checked="" type="checkbox"/> Close Tank <input type="checkbox"/> Repair Tank <input type="checkbox"/> Change Procedure <input type="checkbox"/> Replace Tank <input type="checkbox"/> Other <input type="checkbox"/> Repair Piping	
SOURCE/CAUSE	HAS DISCHARGE BEEN STOPPED? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO IF YES, DATE 2/14/2007		CAUSE(S) <input type="checkbox"/> Tank Leak <input type="checkbox"/> Piping Leak <input checked="" type="checkbox"/> Unknown <input type="checkbox"/> Other <input type="checkbox"/> Overfill <input type="checkbox"/> Corrosion <input type="checkbox"/> Rupture/Failure <input checked="" type="checkbox"/> Unknown <input type="checkbox"/> Spill <input type="checkbox"/> Other
	CHECK ONE ONLY <input type="checkbox"/> Undetermined <input type="checkbox"/> Soil Only <input checked="" type="checkbox"/> Groundwater <input type="checkbox"/> Drinking Water - (CHECK ONLY IF WATER WELLS HAVE ACTUALLY BEEN AFFECTED)		
CURRENT STATUS	CHECK ONE ONLY <input checked="" type="checkbox"/> No Action Taken <input type="checkbox"/> Case Closed (Cleanup Completed or Unnecessary) <input type="checkbox"/> Leak Being Confirmed <input type="checkbox"/> Pollution Characterization <input type="checkbox"/> Remediation Plan <input type="checkbox"/> Post Cleanup Monitoring In Progress <input type="checkbox"/> Preliminary Site Assessment Workplan Submitted <input type="checkbox"/> Cleanup Underway <input type="checkbox"/> Preliminary Site Assessment Underway		
	CHECK APPROPRIATE ACTION(S) <input type="checkbox"/> Cap Site (CD) <input type="checkbox"/> Excavate & Treat (ET) <input type="checkbox"/> Treatment At Hookup (HU) <input checked="" type="checkbox"/> Other - pending agency evaluation <input type="checkbox"/> Contamination Barrier (CB) <input type="checkbox"/> No Action Required (NA) <input type="checkbox"/> Enhanced Bio Degradation (BT) <input type="checkbox"/> Vacuum Extract (VE) <input type="checkbox"/> Remove Free Product (FP) <input type="checkbox"/> Replace Supply (RS) <input type="checkbox"/> Excavate & Dispose (ED) <input type="checkbox"/> Pump & Treat Groundwater (GT) <input type="checkbox"/> Vent Soil (VS)		
COMMENTS	Soil and groundwater concentrations were found during waste oil tank removal activities including TPH gasoline, benzene, toluene, ethylbenzene, xylenes, MTBE, chromium, lead, nickel, and zinc. Cambria Environmental Technology, Inc. notified the Livermore-Pleasanton Fire Department on 3/6/2007 at 11:05 AM. Cambria left a voice mail for inspector Paul Smith. A report documenting the reported findings will be submitted to the agency within 60 days.		