

RECEIVED

By Alameda County Environmental Health 10:20 am, Dec 02, 2015

November 23, 2015

To: Mr. Jerry Wickham
Senior Hazardous Materials Specialist
Alameda County Department of Environmental Health
Health Protection
1131 Harbor Bay Parkway, Suite 250
Alameda, California 94502-6577

Re: Perjury Statement
3rd Quarter 2015 Quarterly Groundwater Monitoring and
System Evaluation Report
Bill Chun Service Station
2301 Santa Clara Avenue
Alameda, California 94501
SLIC # RO0000382
Geotracker Global ID # T0600100980

I declare, under penalty of perjury, that the information or recommendations contained in the attached report are true and correct to the best of my knowledge.

Ms. Carolyn Fong, Trustee

Ms. Carolyn Fong
Trustee for Lily A. Chun 1991 Trust
711 E. Hermosa Drive
San Gabriel, California 91775

**3RD QUARTER 2015 GROUNDWATER MONITORING AND
SYSTEM EVALUATION REPORT
BILL CHUN SERVICE STATION
2301 SANTA CLARA AVENUE
ALAMEDA, CALIFORNIA
FUEL LEAK CASE # RO0000382
GEOTRACKER GLOBAL ID # T0600100980**

PREPARED FOR:

Ms. Carolyn C. Fong
Trustee, Lily A. Chun 1991 Trust
720 East Hermosa Drive
San Gabriel, California 91775

PREPARED BY:

Ninyo & Moore
Geotechnical and Environmental Sciences Consultants
1956 Webster Street, Suite 400
Oakland, California 94612

November 19, 2015
Project No. 401896004

November 19, 2015
Project No. 401896004

Ms. Carolyn C. Fong
Trustee, Lily A. Chun 1991 Trust
720 East Hermosa Drive
San Gabriel, California 91775

Subject: 3rd Quarter 2015 Groundwater Monitoring and System Evaluation Report
2301 Santa Clara Avenue
Alameda, California
Fuel Leak Case # RO0000382
GeoTracker Global ID # T0600100980

Dear Ms. Fong:

Ninyo & Moore is pleased to present this 3rd Quarter 2015 Quarterly Groundwater Monitoring and System Evaluation Report for the above-referenced site. This report discusses the results and presents conclusions and recommendations of our groundwater monitoring activities and provides details of the groundwater remediation system installation. We appreciate the opportunity to be of service to you on this project.

Sincerely,
NINYO & MOORE



Emily Dirksen
Staff Environmental Scientist



Jason Grant, PE C64624
Senior Project Engineer



Peter Sims
Project Environmental Geologist

ERD/JG/PDS/vmp

Distribution: (1) Addressee (via e-mail)
(1) Jerry Wickham, Alameda County Environmental Health (via e-mail)

TABLE OF CONTENTS

	<u>Page</u>
1. INTRODUCTION	1
1.1. Purpose	1
1.2. Site Description	1
1.3. Site Background.....	1
2. HISTORICAL CONSTITUENT OF CONCERN CONCENTRATIONS IN GROUNDWATER	2
3. REMEDIATION SYSTEM OPERATIONS AND MAINTENANCE.....	2
3.1. Biweekly O&M	2
3.2. Bag Filter Change Out	3
3.3. Monthly O&M.....	3
3.3.1. Remediation System Sample Collection.....	3
3.3.2. Remediation System Sample Analysis	4
3.3.3. Remediation System Sample Analytical Results	4
3.4. Remediation System Injection Rate Decrease.....	4
4. GROUNDWATER MONITORING	4
4.1. Depth to Groundwater Measurement.....	5
4.2. Groundwater Sampling	5
4.3. Decontamination Procedures	6
4.4. Investigation Derived Waste.....	6
4.5. Laboratory Analysis.....	6
5. GROUNDWATER SAMPLING RESULTS	7
5.1. Depth to Groundwater and Groundwater Flow Direction	7
5.2. Groundwater Sample Laboratory Results.....	7
5.2.1. Total Petroleum Hydrocarbons as Gasoline in Groundwater	8
5.2.2. Benzene in Groundwater.....	8
5.2.3. Other VOCs in Groundwater	9
5.2.4. Bioattenuation Parameters	10
5.2.4.1. Oxidation Reduction Potential	10
5.2.4.2. Dissolved Oxygen	10
5.2.4.3. Nitrate.....	11
5.2.4.4. Ferric Iron.....	11
5.2.4.5. Manganese.....	12
5.2.4.6. Sulfate	12
5.2.4.7. Methane.....	12
5.2.4.8. Bioattenuation Summary.....	13
6. QUALITY ASSURANCE/QUALITY CONTROL	13
6.1. Laboratory QA/QC Samples.....	14
6.2. Sample Dilutions	14
6.3. QA/QC Conclusions	14

7. REMEDIAL ACTION OBJECTIVES	14
7.1. Low-Threat Closure.....	14
8. CONCLUSIONS	15
9. RECOMMENDATIONS.....	17
10. LIMITATIONS.....	17
11. REFERENCES	19

Tables

- Table 1 – Monitoring Well Inventory
- Table 2 – Remediation System Operations & Maintenance Summary
- Table 3 – Groundwater Elevation Data
- Table 4 – Summary of Groundwater Sample Analytical Results – TPHg and VOCs
- Table 5 – Bioattenuation Monitoring

Graphs

- Graph 1 – TPHg Concentrations in Groundwater
- Graph 2 – Benzene Concentrations in Groundwater

Figures

- Figure 1 – Site Location
- Figure 2 – Site Vicinity
- Figure 3 – Site Plan
- Figure 4 – Remediation System Plan
- Figure 5 – Remediation System Schematic
- Figure 6 –Groundwater Elevation Contour
- Figure 7 – Total Petroleum Hydrocarbons as Gasoline Concentrations in Groundwater
- Figure 8 – Benzene Concentrations in Groundwater

Appendices

- Appendix A – Historical Constituent of Concern Concentrations
- Appendix B – Operations & Maintenance Field Forms
- Appendix C – Laboratory Analytical Reports
- Appendix D – Groundwater Monitoring Data Sheets

1. INTRODUCTION

Ninyo & Moore has conducted remediation system operations and maintenance (O&M) activities and groundwater monitoring at the Bill Chun Service Station property located at 2301 Santa Clara Avenue in Alameda, California (site). This report was prepared in general accordance with the proposed methodology presented in the Corrective Action Plan (CAP) dated August 1, 2013 (Ninyo & Moore, 2013a). The CAP was approved in the Alameda County Environmental Health (ACEH) directive letter dated March 17, 2014.

1.1. Purpose

The purpose of this report is to document field activities relating to the remediation system O&M and present the findings for the groundwater sample collection and analysis of site contaminants of concern (COCs), which include total petroleum hydrocarbons as gasoline (TPHg) and benzene. This report will also discuss the COC groundwater plumes and bioattenuation parameter trends.

1.2. Site Description

The site is located at 2301 Santa Clara Avenue, in the City and County of Alameda, California, as presented on Figure 1. The rectangular lot measures approximately 85 feet long by 40 feet wide. The site is occupied by a small vacant kiosk, a canopy, and a garage. The site is located in a mostly commercial area with some residential buildings, and is bordered by Oak Street to the northwest, a meeting hall and residences to the northeast and east, a retail store to the southeast (formerly Towata Flowers) and by Santa Clara Avenue to the southwest. The site vicinity is presented on Figure 2, with the site plan and adjacent properties presented on Figure 3.

1.3. Site Background

The site is a former gasoline service station, and has been the subject of subsurface assessments, remedial actions, groundwater monitoring, and closure petitions since 1993, when three underground storage tanks (USTs) were removed. The site is listed as a Leaking Underground Storage Tank (LUST) facility in the State Water Resources Control Board

(SWRCB) GeoTracker database and as a Leaking Underground Fuel Tank (LUFT) and Spills, Leaks, Investigation and Cleanup (SLIC) facility in the ACEH database.

Several groundwater monitoring wells were installed on the site in separate occasions during 1993 and 2005. All wells installed in 1993 were either properly abandoned or redeveloped in 2012 for monitoring purposes, and new wells were installed in 2005. Injection wells were installed in 2002, 2004, and 2014. Injection wells installed in 2002 and 2004 were redeveloped in 2014, and all but one well installed in 2002 were abandoned. Extraction wells were installed in 2014. An inventory of all wells at the site is presented in Table 1. Between October and November 2014, the remediation system was installed at the site (Figures 3, 4, and 5). The remediation system started operating on November 21, 2014.

2. HISTORICAL CONSTITUENT OF CONCERN CONCENTRATIONS IN GROUNDWATER

In a directive letter dated September 8, 2011, ACEH requested historical COC concentrations in each well be presented in a clear and concise manner. As part of the June 2012 *Well Installation and Groundwater Sampling Report*, Ninyo & Moore obtained historical data from reports found in the online GeoTracker database. Appendix A provides historical concentrations of COCs presented in separate tables for each well.

3. REMEDIATION SYSTEM OPERATIONS AND MAINTENANCE

O&M on the site's remediation system includes both biweekly and monthly events, which for the 3rd Quarter 2015 were performed by Ninyo & Moore from August 11, 2015, through October 8, 2015. Remediation system O&M field forms are provided in Appendix B. O&M sample laboratory analytical reports are provided in Appendix C. Remediation system flow meter readings are presented in Table 2. The analytical laboratory results for the O&M samples collected from the remediation system are presented in Table 4.

3.1. Biweekly O&M

From August 11, 2015, through October 8, 2015, Ninyo & Moore conducted site visits once every two weeks to perform O&M activities. During each biweekly O&M event, the

remediation system was checked for proper operation, pressure gauge and flow meter readings were recorded on field forms, and 50 pounds of Custom Blend Nutrient (CBN) nutrient mix were added to the mixing tank.

3.2. Bag Filter Change Out

The remediation system's bag filters were changed out following the biweekly O&M visits conducted on August 27 and September 11, 2015, due to elevated pressure readings. During these change outs, a reddish-brown bacterial slime was observed in the bag filters, which is evidence of biofouling. The slimy consistency is attributed to bacterial growth and the reddish brown color signifies ferric iron precipitate. Biofouling in the bag filters is expected and indicates the remediation system is operating properly by encouraging bacterial growth.

3.3. Monthly O&M

On August 27 and September 24, 2015, in addition to the tasks described in Section 3.1, O&M activities included collection of water samples from the remediation system. Influent (INF), GAC vessel (GAC), and effluent (EFF) samples were collected from the remediation system at the sample ports shown on Figure 5. The INF sample was collected from the sample port after the bag filter assembly to determine the cumulative concentrations of COCs in water entering the remediation system. The GAC sample was collected from the sample port between the lead and lag GAC vessels to evaluate whether breakthrough of COCs occurred in the lead GAC vessel. The EFF sample was collected from the sample port after the lag GAC vessel to evaluate breakthrough of COCs in the lag GAC vessel.

3.3.1. Remediation System Sample Collection

Samples collected from the remediation system sample ports were transferred directly into the appropriate laboratory supplied containers, labeled with the location ID, covered with bubble wrap for protection, placed into a cooler containing ice and transported under chain-of-custody documentation to TestAmerica, a State of California ELAP certified analytical laboratory located in Pleasanton, California.

3.3.2. Remediation System Sample Analysis

Remediation system samples were analyzed by TestAmerica for TPHg and volatile organic compounds (VOCs), which includes benzene, by United States Environmental Protection Agency (USEPA) Method 8260B.

3.3.3. Remediation System Sample Analytical Results

The analytical results for remediation system samples are presented in Table 4. Concentrations of TPHg and benzene increased in samples collected at INF between each monitoring event this quarter. These results indicate the remediation of the site is progressing as intended as the increased concentrations indicate COCs are desorbing from the subsurface soil and being captured by the remediation system.

The samples collected at GAC and EFF were non-detect for the site COCs analyzed. This indicates the lead GAC vessel is effectively treating the influent water, and the amended water pumped back into the subsurface contains no detectable concentrations of site COCs. In addition, change out of the granulated carbon in the lead GAC vessel is not yet needed.

3.4. Remediation System Injection Rate Decrease

On September 1, 2015, water was observed surfacing from injection well EW-18. Later that afternoon, the injection flow rate was reduced for EW-18 and EW-19, which are connected on the same injection manifold. The injection rate for the combined EW-18 and EW-19 had ranged from 0.06 to 0.07 gallons per minute (gpm) prior to reducing the flow rate. The flow rate was monitored at 0.03 to 0.04 gallons per minute after it was reduced. No other surfacing was noted in subsequent site visits.

4. GROUNDWATER MONITORING

Ninyo & Moore conducted the 3rd Quarter 2015 groundwater monitoring event on August 10 and 11, 2015. The following wells were included in the groundwater monitoring program: MW-4R, MW-5R, MW-6R, MW-7R, MW-8, MW-9, MW-10, MW-11R, MW-12, MW-13, MW-14, MW-15, and MW-16. Shallow groundwater elevation contours are illustrated on Figure 6, and

detected concentrations of TPHg and benzene are illustrated on Figures 7 and 8, respectively. Groundwater elevation data is summarized in Table 3, and groundwater sample analytical results are presented in Table 4 and Table 5.

4.1. Depth to Groundwater Measurement

Prior to groundwater sampling, depth-to-groundwater measurements were obtained from each well. In order to allow the groundwater level to reach equilibrium, the well caps were removed approximately 20 minutes prior to measurement. The depth to static groundwater was measured from the top of casing using a water level meter accurate to 0.01 feet. The water-level meter was decontaminated between wells. The remediation system continued operating during collection of depth to groundwater measurements. Therefore, shallow groundwater elevation contours illustrated on Figure 6 show the influence the remediation system is exerting on groundwater gradients at the site and its surrounding vicinity.

4.2. Groundwater Sampling

Prior to sample collection, a minimum of three casing volumes of groundwater were purged from each monitoring well using a peristaltic pump or disposable bailer. Dedicated pump tubing and/or new disposable bailers were used in each well to minimize the likelihood of cross contamination between wells. Groundwater parameters (pH, temperature, electrical conductivity, dissolved oxygen, and oxidation-reduction potential) and physical characteristics (odor and color) were recorded during purging. Copies of the groundwater sampling field data sheets are provided in Appendix D.

Subsequent to purging, groundwater samples were collected from each well using a peristaltic pump or disposable bailer. During sample collection, the pump was operated at low speed to minimize disturbance of groundwater. The groundwater samples were collected in the appropriate laboratory-provided sample containers, labeled with the well ID, covered with bubble wrap for protection, placed into a cooler containing ice and transported under chain-of-custody documentation to TestAmerica.

4.3. Decontamination Procedures

Reusable equipment that came into contact with potentially contaminated water was decontaminated to assure the quality of samples collected and reduce potential cross contamination. Dedicated pump tubing or new disposable bailers were employed at each well during purging to prevent cross contamination. Disposable equipment intended for one-time use and disposal was not decontaminated. Decontamination occurred prior to and after each use of a piece of reusable equipment which came in contact with groundwater. Decontamination was performed using a triple rinse consisting of an initial rinse with a non-phosphate based detergent solution, a secondary rinse in distilled water, and a final rinse in distilled water. Nitrile gloves were changed between each sample collection to minimize the likelihood of cross contamination.

4.4. Investigation Derived Waste

Investigation-derived waste (IDW) consisting of purged groundwater and decontamination rinsate water was stored in properly labeled 55-gallon steel drums, which were left in a secure location on the site. Following waste profiling, the 55-gallon drums of IDW were transported by a California licensed waste hauler to an appropriate facility for disposal as non-hazardous waste. Copies of the waste disposal documentation are maintained in the project files. Disposable equipment intended for one time use (nitrile gloves, bailers, etc.) were disposed of as municipal waste.

4.5. Laboratory Analysis

The groundwater samples collected from each well were analyzed by TestAmerica for:

- TPHg by USEPA Method 8015B;
- VOCs by USEPA Method 8260B;
- iron, manganese, and potassium by USEPA Method 200.7;
- nitrate, nitrite, phosphate, and sulfate by USEPA Method 300.0;
- ferric iron by calculation;
- ferrous iron by Standard Method (SM) 3500-Fe D; and,
- nitrogen as ammonia by SM 4500-NH3 D.

5. GROUNDWATER SAMPLING RESULTS

The following section summarizes the results of the 3rd Quarter Groundwater Monitoring event, and presents a discussion of the groundwater monitoring trends.

5.1. Depth to Groundwater and Groundwater Flow Direction

The groundwater level measurements and the calculated groundwater elevations are presented in Table 3. Shallow groundwater elevation contours are shown on Figure 6. Based on the contours shown on Figure 6, the groundwater gradient appears to be strongly influenced by the operation of the remediation system. Groundwater elevation has been historically, and continues to be, highest at well MW-7R due to the presence of the horizontal injection wells (injection piping IN-1 through IN-3), and is also elevated across the portion of the site where vertical injection of amended water is occurring (injection wells EW-14 through EW-19).

The groundwater elevation gradient slopes downward most steeply to the north-northeast toward extraction wells EW-21 and EW-22, and to the southwest toward extraction well EW-20, indicating the remediation system is successfully influencing and controlling groundwater flow beneath the site. Less steep groundwater elevation gradients to the southeast and northwest are present due to the mounded groundwater at the injection wells and horizontal injection piping located in these areas.

5.2. Groundwater Sample Laboratory Results

A summary of the groundwater sample analytical results are presented in Tables 4 and 5, and a copy of the certified TestAmerica analytical laboratory report is provided in Appendix C. The laboratory results are compared against Table F-1A of the San Francisco Bay Regional Water Quality Control Board (RWQCB) Environmental Screening Levels (ESLs), dated December 2013, “Residential Land Use, Groundwater is Current or Potential Source of Drinking Water”. As discussed in Section 7, the remedial action objectives are to meet the criteria established in the SWRCB *Low-Threat Underground Storage Tank Case Closure Policy*, adopted May 1, 2012.

5.2.1. Total Petroleum Hydrocarbons as Gasoline in Groundwater

Concentrations of TPHg in shallow groundwater are presented on Figure 7. The ESL for TPHg is 100 micrograms per liter ($\mu\text{g/L}$). TPHg was not detected above the laboratory reporting limit of 50 $\mu\text{g/L}$ in wells MW-9, MW-10, MW-13, MW-15, and MW-16. TPHg was reported at concentrations ranging from not detected above the laboratory reporting limit to 69,000 $\mu\text{g/L}$, with the highest concentration detected in well MW-7R.

Trends in TPHg concentrations in groundwater samples collected from wells MW-4R, MW-5R, MW-6R, MW-7R, MW-11R, and MW-14 are presented on Graph 1 and are discussed below:

- TPHg concentrations in groundwater samples collected from wells MW-6R, MW-11R and MW-14 have increased since the 2nd Quarter 2015 (previous) monitoring event. The concentration of TPHg detected in MW-6R increased only slightly over the previous quarter and remains relatively stable. The rate of TPHg increase in MW-11R is greater than that observed during the 2nd Quarter 2015. The increase in TPHg concentration in groundwater collected from MW-14 has risen since the last monitoring event, but remains below the maximum concentration detected in this well.
- TPHg concentrations in groundwater samples collected from wells MW-4R, MW-5R, and MW-7R have continued to decrease since the previous monitoring event. Well MW-7R represents the most contaminated area of the site, therefore, the decrease in TPHg concentration in this well indicates remediation continues to successfully move forward. The decrease in TPHg concentration in MW-4R indicates the remediation system is continuing to remediate the southwestern extent of the site's groundwater plume.

5.2.2. Benzene in Groundwater

Benzene concentrations in shallow groundwater are presented on Figure 8. The ESL for benzene is 1.0 $\mu\text{g/L}$. Benzene was not detected above the laboratory reporting limit in wells MW-9, MW-10, MW-13, MW-15, and MW-16. Benzene was reported at concentrations ranging from not detected above the laboratory reporting limit to 2,700 $\mu\text{g/L}$, with the highest concentration detected in well MW-14.

Trends in benzene concentrations in groundwater samples collected from wells MW-4R, MW-5R, MW-6R, MW7R, MW-11R, and MW14 are presented on Graph 2 and are discussed below:

- Benzene concentrations in groundwater samples collected from wells MW-6R, MW-8, MW-11R, MW-12, and MW-14 have increased since the previous monitoring event as contaminants continue to be desorbed from the soil matrix.
- Benzene concentrations in groundwater samples collected from wells MW-4R, MW-5R, and MW-7R have decreased since the previous monitoring event. With the exception of this monitoring event, well MW-7R historically represents the most contaminated area of the site; therefore, the decrease in benzene concentration in well MW-7R indicates remediation continues to successfully move forward in the center of the plume. MW-7R is also located in the center of the highest measured groundwater elevation; desorbing constituents may be flowing down from this relatively higher point.
- The concentration in MW-14 now represents the highest detected concentration of benzene onsite. The increase in benzene concentration in MW-14 may indicate the remediation system is causing increased desorption of site COCs, which are tending to flow toward the eastern extent of the site's groundwater plume where they are measured in increased values in wells MW-11R and MW-14. The current benzene concentration in MW-14 does not exceed its historical maximum.

5.2.3. Other VOCs in Groundwater

Other VOCs detected in the groundwater samples at concentrations which exceeded their respective ESLs included toluene, ethylbenzene, total xylenes, naphthalene, and 1,2-dichloroethane.

- The concentrations of toluene reported ranged from not detected above the laboratory reporting limit to 20,000 µg/L in MW-7R.
- The concentrations of ethylbenzene reported ranged from not detected above the laboratory reporting limit to 3,200 µg/L in MW-7R.
- The concentrations of naphthalene reported ranged from not detected above the laboratory reporting limit to 590 µg/L in MW-5R.
- The concentrations of total xylenes reported ranged from not detected above the laboratory reporting limit to 22,000 µg/L in MW-7R.

- The concentrations of 1,2-dichloroethane reported ranged from not detected above the laboratory reporting limit to 2.8 µg/L in MW-13.

5.2.4. Bioattenuation Parameters

Groundwater samples were submitted for laboratory analysis of iron, manganese, potassium, nitrate, nitrite, phosphate, sulfate, ferric iron, ferrous iron, and nitrogen as ammonia. Groundwater temperature, conductivity, pH, oxidation-reduction potential (ORP), and dissolved oxygen (DO) was measured in the field using a hand-held Horriba U-53.

The bioattenuation process remediating the site's groundwater plume can occur in either aerobic or anaerobic conditions, which is generally indicated by positive or negative ORP values, respectively. Aerobic bioattenuation takes place as aerobic respiration and is evaluated by DO concentrations. Anaerobic bioattenuation takes place as anaerobic respiration and occurs in five typical stages: denitrification, manganese reduction, ferric iron reduction, sulfate reduction, and methanogenesis.

5.2.4.1. Oxidation Reduction Potential

ORP is a measure of electron activity and is an indicator of the relative tendency of a solute species to gain or lose electrons. ORP values in groundwater generally range from -400 millivolts (mV) to 800 mV (USEPA, 2004). Positive ORP values in groundwater are indicative of aerobic reducing conditions and negative ORP values are indicative of anaerobic reducing conditions. ORP values recorded during the 3rd Quarter 2015 monitoring event ranged from -150 mV to 171 mv. Since the remediation system startup, ORP values have overall remained positive or trended toward more positive values. This is likely the result of the addition of dissolved oxygen in the amended water supplied to the subsurface by the remediation system.

5.2.4.2. Dissolved Oxygen

DO is the most thermodynamically favored electron acceptor in the bioattenuation of petroleum hydrocarbons. Because water monitored for DO is easily oxygenated,

it is difficult to accurately quantify DO. Therefore, individual DO concentrations are evaluated relative to the range of DO concentrations recorded during a groundwater monitoring event (USEPA, 2004). DO concentrations recorded during the 3rd quarter 2015 monitoring event ranged from 0.95 milligrams per liter (mg/L) to 8.84 mg/L. Levels of DO are relatively higher and considered favorable to aerobic respiration and oxidation of petroleum hydrocarbons in wells MW-8, MW-9, MW-10, MW-12, MW-13, MW-14, MW-15, and MW-16. Wells MW-4R, MW-5R, MW-6R, MW-7 and MW-11 had recorded DO levels that were relatively lower, likely due to microbial consumption of DO at a rate exceeding that at which it is replenished by the remediation system.

5.2.4.3. Nitrate

Nitrate can be consumed during the anaerobic biodegradation of petroleum hydrocarbons after DO has been depleted in groundwater. In this process, called denitrification, nitrate is reduced to nitrite and ultimately nitrogen gas. Addition of the CBN to the amended water injected into the subsurface by the remediation system has increased the concentration of nitrate in groundwater from background levels collected during the June 25 and 26, 2014, monitoring event prior to remediation system startup. Nitrite concentrations observed since the previous monitoring event have decreased or remained stable, with the exception of MW-7R. Similarly, nitrogen concentrations have increased relative to the previous monitoring event in monitoring wells MW-4R and MW-7R, while concentrations in the remaining wells have decreased or remained stable. This is likely due to the initial mass loading of CBN during startup activities, microbial utilization of the nitrate over time, as well as increasingly aerobic conditions in the groundwater.

5.2.4.4. Ferric Iron

Ferric iron can be reduced to ferrous iron after DO and nitrate are depleted in anaerobic reducing conditions in groundwater. Ferrous iron is soluble in water and its presence in groundwater samples is an indication that reduction of ferric iron has

occurred. The concentration of ferrous iron reported in wells ranged from non-detect to concentrations of 6.3 mg/L in MW-14 and 19 mg/l in MW-8. Elevated ferrous iron concentrations indicate that ferric iron is being reduced to ferrous iron due to anaerobic bioattenuation.

5.2.4.5. *Manganese*

Manganese (IV) oxide can be reduced to manganese (II) by anaerobic bioattenuation after DO, nitrate, and ferric iron are depleted. The presence of manganese (II) in groundwater samples is an indication that reduction of manganese (IV) oxide has occurred. The concentrations of manganese (II) reported in wells ranged from 0.21 mg/L in MW-16 to 4.1 mg/L in MW-9. The detected manganese (II) concentrations indicate that manganese (IV) oxide is being reduced to manganese (II) due to anaerobic bioattenuation.

5.2.4.6. *Sulfate*

Sulfate can be consumed by anaerobic bioattenuation after DO, nitrate, ferric iron, and manganese are depleted. However, the addition of DO and nitrate to the subsurface via the amended injection water is expected to inhibit the use of sulfate as an electron acceptor. Sulfate concentrations that vary inversely with petroleum hydrocarbon concentrations are indicative of anaerobic bioattenuation. At this time, an inverse relationship between sulfate and petroleum hydrocarbon concentrations has not been established indicating that aerobic reducing conditions dominate, followed by the more preferential anaerobic reducing mechanisms (nitrate, manganese and ferric iron reduction).

5.2.4.7. *Methane*

Methanogenesis is the final step in the anaerobic bioattenuation process. When all soluble electron acceptors (DO, nitrate, ferric iron, manganese, and sulfate) are depleted, groundwater conditions become conducive to generation of methane due to reduction of carbon dioxide. Similarly to sulfate, an inverse relationship between

methane and petroleum hydrocarbon concentrations would be indicative of anaerobic bioattenuation of carbon dioxide. Because sulfate reducing conditions have not been observed, it is unlikely that carbon dioxide is being reduced and therefore methane is not currently included in the monitored bioattenuation analytes.

5.2.4.8. *Bioattenuation Summary*

Overall, the monitored wells are trending toward ORP values that remain positive or are trending toward more positive values indicating a trend toward stronger aerobic bioattenuation. Exceptions to this overall trend are in wells MW-4R, MW-5R, MW-6R, MW-7 and MW-11, which had recorded DO levels that were relatively lower, likely due to microbial consumption of DO at a rate exceeding that at which it is replenished by the remediation system. Anaerobic bioattenuation appears to be taking place particularly in the center of the plume, though at lower rates as indicated by generally decreasing concentrations of indicator compounds. Continued microbial growth in the subsurface appears to be taking place, as evidenced by biofouling in the bag filters. During future O&M events, Ninyo & Moore will be evaluating the oxygen injection rates and injection pressures of the remediation system with the goal of producing positive ORP values and higher concentrations of DO in all wells in future groundwater monitoring events.

6. QUALITY ASSURANCE/QUALITY CONTROL

Upon collection, quality assurance/quality control (QA/QC) groundwater samples were immediately placed on ice for storage during field activities, pending transportation to the laboratory. QA/QC samples collected during the 3rd Quarter 2015 included XXX. At the conclusion of the sampling event, the samples were transferred to TestAmerica, under the appropriate chain-of-custody documentation.

6.1. Laboratory QA/QC Samples

The laboratory analyses followed the approved methods. Laboratory QA/QC samples included method blanks, laboratory control samples (LCS), matrix spikes (MS), and matrix spike duplicates (MSD). The percentage recoveries were within the specific acceptance limits for these types of samples. Groundwater MS and MSD recoveries were outside of the acceptance limit so the analytical batch was validated by the LCS. Therefore the relevant QA/QC results were satisfactory and acceptable.

6.2. Sample Dilutions

Due to the high concentrations of petroleum constituents and/or possible matrix interference in some of the samples, dilution factors ranging from 5 to 500 were required prior to analysis of groundwater samples. Because of the required sample dilution, detection limits were increased.

6.3. QA/QC Conclusions

No outstanding issues were identified during the course of the QA/QC review. Overall, the presented data are reliable and useable for project decision making.

7. REMEDIAL ACTION OBJECTIVES

The ultimate objectives of remedial activities in the plume area are to reduce the concentrations of COCs in soil, soil vapor, indoor air, and groundwater to less than the RWQCB ESLs, and to ensure that the risk to human health and the environment is less than risk thresholds. The immediate objective of the remedial activities is to reduce the concentrations of COCs in groundwater such that the regulatory limits will be achieved through natural attenuation processes within a reasonable time frame and pose a low threat to human health and the environment as specified in the *Low-Threat Underground Storage Tank Case Closure Policy (Low-Threat Closure Policy)*, adopted May 1, 2012, established by the SWRCB.

7.1. Low-Threat Closure

The *Low-Threat Closure Policy* conditions that remain to be met at the time of the preparation of the *CAP*, as well as progress meeting those conditions, are discussed below:

- **Secondary source must be removed to the extent practicable** – Secondary source continues to be removed through operation of the remediation system in order to meet this condition.
- **Groundwater affected by the unauthorized release, defined as the contaminant plume that exceeds water quality objectives, must be stable or decreasing in areal extent** – The areal extent of the contaminated groundwater plume has decreased in size in the east-west direction as evidenced by wells MW-10, MW-15, and MW-16 that formerly had detectable concentrations of COCs, which have been non-detect since at least January 2015. The areal extent of the contaminated groundwater has appeared to decrease in the north-south direction based on separation of the plume between MW-4R and MW-8, which is influenced by the groundwater extraction occurring at well EW-20. Reductions in overall concentrations of COCs in the contaminated groundwater plume are expected to lead to overall decrease in the area of the plume in the future in order to meet this condition.
- **The contaminant plume that exceeds water quality objectives (RWQCB ESLs) must be less than 100 feet in length** – The contaminated groundwater plume is currently approximately 180 feet long. Operation of the remediation system appears to have cut off the southern end of the plume between MW-4R and MW-8, thereby reducing the total length of the plume. Continued reductions in overall concentrations of COCs in the contaminated groundwater plume are expected to lead to overall decreases in the length of the plume in the future in order to meet this condition.
- **Benzene concentrations in groundwater in the remaining contaminant plume will be less than 1,000 µg/L** – The maximum concentration of benzene detected in the contaminated groundwater plume has decreased from 18,000 µg/L in June 2014, to 2,700 µg/L in June 2015. This six fold reduction in the concentration of benzene in groundwater shows significant progress toward meeting this condition.
- **Benzene, ethylbenzene, and naphthalene concentrations in soil 5 to 10 feet below ground surface (bgs) will be less than the concentrations presented in Table 8 of the CAP (Ninyo & Moore, 2013a)** – Continued operation of the remediation system is expected to meet this condition. Confirmation soil samples will be collected following the completion of the remedial action to evaluate this criterion.

8. CONCLUSIONS

Ninyo & Moore presents the following conclusions:

- Remediation system O&M activities were performed biweekly between August 11, and October 8, 2015. Biweekly and monthly O&M activities included monitoring the remediation system for proper operation and adding biological amendments (50 pounds of CBN nutrient mix) to the remediation system. Because of elevated pressure readings

observed on the bag filter assembly, the bag filters were changed out on August 27, September 11, and October 9, 2015.

- Collection of remediation system samples was performed monthly on August 27 and September 24, 2015. Analysis of remediation system samples indicated that the remediation system is operating properly and the lead GAC vessel does not yet require change out.
- 3rd quarter 2015 groundwater monitoring and sample collection was performed on August 10 and 11, 2015.
 - Based on depth to water measurements collected during the 3rd Quarter 2015 groundwater monitoring event, groundwater appears to be flowing to the north-northeast and southwest due to the influence of extraction of groundwater at wells EW-20, EW-21, and EW-22. Groundwater elevations indicate that groundwater has mounded at the site due to injection of amended water through the vertical injection wells and horizontal injection piping.
 - Dissolved phase TPHg and/or VOC concentrations in groundwater exceed their respective ESLs in wells MW-4R through MW-7R, MW-8, MW-11R, MW-12, MW-13, MW-14 and MW-15.
 - Monitoring wells MW-4R, MW-5R, MW-7R, and MW-12, have decreased TPHg concentrations; MW-6R, MW-8, MW-11R, and MW-14, have increased or stable TPHg concentrations; and MW-9, MW-10, MW-13, MW-15, and MW-16 remained non-detect for TPHg.
 - Monitoring wells MW-4R, MW-5R, and MW-7R have decreased benzene concentrations; MW-6R, MW-8, MW-11R, MW-12, and MW-14 have increased benzene concentrations; and MW-9, MW-10, MW-13, MW-15, and MW-16 remained non-detect for benzene.
 - Reductions in the maximum TPHg and benzene concentrations detected in groundwater samples and the reduction in total area of the plume indicate the groundwater plume is being remediated. The area of the TPHg and benzene dissolved phase groundwater plume reduced in the north-south direction and in the east-west direction compared to the groundwater monitoring event performed before remediation system startup in June of 2014. Concentrations of TPHg and benzene in wells still remain relatively high indicating that a significant mass of contaminants remains sorbed to site soil.
 - Aerobic bioattenuation is the main driver of the remediation process in the groundwater plume. Anaerobic bioattenuation is occurring secondarily. Since the remediation system is supplying DO and nitrate to the subsurface through amended water injection, and DO reduction is thermodynamically preferred followed by nitrate reduction, the remediation system is operating as expected.

9. RECOMMENDATIONS

Based on the conclusions discussed above, Ninyo & Moore recommends continued implementation of the preferred remedial alternative (groundwater recirculation and enhanced bioremediation) presented in the *CAP*, dated August 1, 2013, including ongoing O&M activities and groundwater monitoring as detailed in the *O&M Plan*, dated December 24, 2013. In addition, due to remaining relatively high concentrations of site contaminants in groundwater, Ninyo & Moore recommends performing an additional round of targeted hydrogen peroxide injection in order to chemically oxidize site contaminants, promote desorption of contaminants from the soil matrix, increase the effective porosity of the soil formation, and generate high concentrations of dissolved oxygen as a byproduct. The hydrogen peroxide injection will be targeted at EW-18 and EW-19 in order to target the relative stable, high concentrations of contaminants reported in well MW-5R. During future O&M events, Ninyo & Moore will be evaluating the oxygen injection rates and injection pressures of the remediation system with the goal of producing positive ORP values and higher concentrations of DO in all wells in future groundwater monitoring events.

10. LIMITATIONS

The environmental services described in this report have been conducted in general accordance with current regulatory guidelines and the standard-of-care exercised by environmental consultants performing similar work in the project area. No warranty, expressed or implied, is made regarding the professional opinions presented in this report. Variations in site conditions may exist and conditions not observed or described in this report may be encountered during subsequent activities. Please also note that this assessment did not include an evaluation of geotechnical conditions or potential geologic hazards.

Ninyo & Moore's opinions and recommendations regarding environmental conditions, as presented in this report, are based on limited subsurface assessment and chemical analysis. Further assessment of potential adverse environmental impacts from past on-site and/or nearby use of hazardous materials may be accomplished by a more comprehensive assessment. The samples collected and used for testing, and the observations made, are believed to be

representative of the area(s) evaluated; however, conditions can vary significantly between sampling locations. Variations in soil and/or groundwater conditions will exist beyond the points explored in this evaluation.

The environmental interpretations and opinions contained in this report are based on the results of laboratory tests and analyses intended to detect the presence and concentration of specific chemical or physical constituents in samples collected from the subject site. The testing and analyses have been conducted by an independent laboratory which is certified by the State of California to conduct such tests. Ninyo & Moore has no involvement in, or control over, such testing and analysis. Ninyo & Moore, therefore, disclaims responsibility for any inaccuracy in such laboratory results.

Ninyo & Moore's conclusions, recommendations, and opinions are based on an analysis of the observed site conditions. It should be understood that the conditions of a site could change with time as a result of natural processes or the activities of man at the subject site or nearby sites. In addition, changes to the applicable laws, regulations, codes, and standards of practice may occur due to government action or the broadening of knowledge. The findings of this report may, therefore, be invalidated over time, in part or in whole, by changes over which Ninyo & Moore has no control.

This document is intended to be used only in its entirety. No portion of the document, by itself, is designed to completely represent any aspect of the project described herein. Ninyo & Moore should be contacted if the reader requires any additional information, or has questions regarding content, interpretations presented, or completeness of this document.

This report is intended exclusively for use by the client. Any use or reuse of the findings, conclusions, and/or recommendations of this report by parties other than those noted is undertaken at said parties' sole risk.

11. REFERENCES

- Ninyo & Moore, 2013a, Corrective Action Plan, Bill Chun Service Station, 2301 Santa Clara Avenue, Alameda, California, dated August 1.
- Ninyo & Moore, 2013b, Operations and Maintenance Plan, Bill Chun Service Station, 2301 Santa Clara Avenue, Alameda, California, dated December 24.
- Ninyo & Moore, 2015, Initial Groundwater Monitoring and System Evaluation Report, 2301 Santa Clara Avenue, Alameda, California, dated June 5.
- San Francisco Bay Regional Water Quality Control Board, Environmental Screening Levels, Interim Final, Oakland, California, December 2013.
- SWRCB, 2012, Low-Threat UST Case Closure Policy, dated May 1.
- USEPA, 2004, How to Evaluate Alternative Cleanup Technologies for Underground Storage Tank Sites, EPA 510-R-04-002, dated May.

TABLE 1 – MONITORING WELL INVENTORY

Monitoring Well ID	Date Installed	Total Depth bgs	Riser Interval bgs	Screened Interval bgs ⁽¹⁾	Casing Diameter	Notes
MW-1	1/1993	25.0	0-10	10-25	2"	Abandoned 5/2012 because the riser was too deep
MW-2	1/1993	25.0	0-10	10-25	2"	Abandoned 5/2012 because the riser was too deep and an ORC sock was stuck in the well
MW-2R	5/2012	25.0	0-5	5-25	2"	Replaced MW-2
MW-3	1/1993	25.0	0-10	10-25	2"	Abandoned 5/2012 because the riser was too deep
MW-4	9/1993	25.0	0-7	7-25	2"	Abandoned 5/2012 because the riser was too deep
MW-4R	5/2012	25.0	0-5	5-25	2"	Replaced MW-4
MW-5	9/1993	25.0	0-7	7-25	2"	Abandoned 5/2012 because the riser was too deep
MW-5R	5/2012	25.0	0-5	5-25	2"	Replaced MW-5
MW-6	9/1993	25.0	0-7	7-25	2"	Abandoned 5/2012 because the riser was too deep
MW-6R	5/2012	25.0	0-5	5-25	2"	Replaced MW-6
MW-7	9/1993	25.0	0-7	7-25	2"	Abandoned 5/2012 because the casing was damaged and an ORC sock was stuck in the well
MW-7R	5/2012	25.0	0-5	5-25	2"	Replaced MW-7
MW-8	11/1995	14.0	0-5	5-14	2"	Redeveloped in 5/2012
MW-9	11/1995	20.0	0-5	5-20	2"	Redeveloped in 5/2012
MW-10	11/1995	16.5	0-6.5	6.5-16.5	2"	Redeveloped in 5/2012
MW-11	11/1995	20.0	0-5	5-20	2"	Abandoned 5/2012 because the well casing was not schedule 40 PVC (too thin)
MW-11R	5/2012	25.0	0-5	5-25	2"	Replaced MW-11
BJ	5/2005	13.0	0-8	8-13	--	The well could not be located during the May 22, 2012 well survey or any time since
BK	5/2005	11.0	0-6	6-11	--	The well could not be located during the May 22, 2012 well survey or any time since
MW-12 (former BL)	5/2005	24.0	0-14	14-24	2"	Well ID was changed from BL to MW-12 to conform with site well identification scheme
MW-13 (former BG)	5/2005	20.0	0-15	15-20	2"	Well ID was changed from BG to MW-13 to conform with site well identification scheme
MW-14 (former BF)	5/2005	15.0	0-5	5-15	2"	Well ID was changed from BF to MW-14 to conform with site well identification scheme
MW-15 (former BH)	5/2005	30.0	0-20	20-30	2"	Well ID was changed from BH to MW-15 to conform with site well identification scheme
MW-16 (former BM)	5/2005	30.0	0-20	20-30	2"	Well ID was changed from BM to MW-16 to conform with site well identification scheme
EW-12	10/2002	25.0 ⁽²⁾	0-7	7-25	4"	Abandoned 5/2012 because the riser was too deep
EW-13	10/2002	25.0 ⁽²⁾	0-7	7-25	4"	Abandoned 5/2012 because the seal is cracked
EW-14	10/2002	25.0 ⁽²⁾	0-7	7-25	4"	TOC was cut down to fit in well box, redeveloped in 5/2012; converted to injection well in 11/2014
EW-15	1/2004	25.0 ⁽²⁾	0-7	7-25	4"	Redeveloped in 5/2012; converted to injection well in 11/2014
EW-16	1/2004	25.0 ⁽²⁾	0-7	7-25	4"	Redeveloped in 5/2012; converted to injection well in 11/2014
EW-17	1/2004	25.0 ⁽²⁾	0-7	7-25	4"	Redeveloped in 5/2012; converted to injection well in 11/2014
EW-18	4/2014	15.0	0-5	5-15	4"	Converted to injection well in 11/2014
EW-19	4/2014	15.0	0-5	5-15	4"	Converted to injection well in 11/2014
EW-20	4/2014	25.0	0-5	5-25	4"	Converted to extraction well in 11/2014
EW-21	4/2014	25.0	0-5	5-25	4"	Converted to extraction well in 11/2014
EW-22	4/2014	25.0	0-5	5-25	4"	Converted to extraction well in 11/2014

Notes:

DTW = depth to water measured from TOC on May 10, 2012.

bgs = feet below ground surface

TOC = top of casing

(1) Screened interval data for wells installed prior to May 2012 is based on historical documents in databases.

(2) Reported as 22 feet bgs on GeoTracker and 25 feet bgs in historical reports. Field measurements indicate the total well depths are approximately 25 feet from TOC.

TABLE 2 - REMEDIATION SYSTEM OPERATIONS & MAINTENANCE SUMMARY

Date/Time	Elapsed Time	Extraction Flow Rate	Extraction Total	Totalizer	Products Added		Comments
	(min)	(gpm)	(gal)	(gal)	CBN (pounds)	PS (gal)	
11/21/14 14:00	0	--	0	0	0	0	System startup and test for 3 hours/cycles to evaluate leaks, etc.. Shut down system at 5 pm. Will start up 24/7 tomorrow.
11/22/14 8:00	1,080	0.8	870	700	250	0	System startup. BT onsite. Product addition started.
11/23/14 8:50	1,490	1.7	2,480	2,900	250	0	Slight surfacing at IN-18, reduced flow and injection time to 1 min.
11/24/14 7:30	1,360	1.6	2,130	5,010	50	50	950 lbs CBN left onsite, lots of PS remaining.
12/2/14 12:30	11,820	--	--	--	100	10	Connected 18 and 19 together. 19 was surfacing a little. Flow meter taken out for 18.
12/4/14 9:00	14,490	1.2	17,570	23,110	50	5	
12/10/14 10:50	8,750	1.0	8,370	31,410	50	5	
12/18/14 16:12	11,842	1.0	11,900	42,870	50	5	
1/2/15 11:12	21,300	1.2	24,970	65,390	50	5	
1/6/15 13:07	5,875	1.3	7,410	71,890	100	5	
1/16/15 9:50	14,203	1.2	17,460	87,090	50	5	
1/30/15 17:15	20,605	1.0	21,000	104,720	50	5	Mixing tank pH = 6.90.
2/6/15 15:00	9,945	1.1	10,630	113,350	50	5	Mixing tank pH = 7.30.
2/12/15 7:00	8,160	1.1	8,830	120,440	50	5	Mixing tank pH = 7.51 and holding tank pH = 7.67.
2/19/15 11:16	10,336	1.1	11,440	129,550	50	5	
2/27/15 9:55	11,439	1.1	12,590	139,800	50	5	Mixing tank pH = 7.07 and holding tank pH = 6.99.
3/5/15 15:35	8,980	1.1	9,990	147,850	50	5	Mixing tank pH = 7.10 and holding tank pH = 7.04.
3/13/15 12:00	11,305	1.1	12,580	157,900	50	5	Mixing tank pH = 7.05 and holding tank pH = 7.01.
3/25/15 12:43	17,323	1.1	18,280	172,300	50	5	Mixing tank pH = 7.30 and holding tank pH = 7.17. Dilute hydrogen peroxide injection was performed on March 18 through 21, 2015.
4/9/15 14:20	21,697	1.2	26,140	190,650	0	0	5 gallons of EZT-A2 TPH bacterial consortium added to remediation system. Mixing Tank pH = 7.83.
4/23/15 15:30	20,230	1.5	29,910	208,070	0	0	
5/8/15 9:30	21,240	1.4	29,460	228,260	50	0	
5/21/15 15:40	19,090	1.9	35,680	248,880	50	0	
6/4/15 9:05	19,765	1.8	36,260	270,030	50	0	Bag filters changed out on May 28, 2015.
6/18/15 8:25	20,120	2.1	41,810	294,370	50	0	Bag filters changed out on June 11, 2015
7/1/15 16:15	19,190	2.7	52,130	320,500	50	0	Bag filters changed out on June 25, 2015.
7/16/15 11:32	21,317	2.9	61,830	320,500	50	0	Bag filters changed out on July 8, 2015.
7/29/15 8:24	18,532	2.9	54,610	375,000	50	0	Bag filters changed out on July 30, 2015.
8/11/15 14:00	19,056	2.9	55,210	399,720	50	0	
8/27/15 16:00	23,160	3.0	69,430	429,540	50	0	Bag filters changed out on August 27, 2015
9/10/15 16:00	20,160	3.1	62,370	455,560	50	0	Bag filters changed out on September 11, 2015
9/24/15 15:30	20,130	3.4	68,180	482,680	50	0	
Totals	453,990		821,520		1,950	130	

TABLE 2 - REMEDIATION SYSTEM OPERATIONS & MAINTENANCE SUMMARY

Date/Time	Elapsed Time	INJECTION WELLS																				
		EW-18			EW-19			EW-19/18			EW-16			IN-2/3			IN-1 and EW-17			EW-14/15		
		Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate
		(min)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)
11/21/14 14:00	0	493,150	--	--	0	--	--	--	--	--	0	--	--	0	--	--	0	--	--	0	--	--
11/22/14 8:00	1,080	493,250	100	0.09	80	80	0.07	--	--	--	102	102	0.09	90	90	0.08	80	80	0.07	80	80	0.07
11/23/14 8:50	1,490	493,660	410	0.28	450	370	0.25	--	--	--	420	318	0.21	620	530	0.36	420	340	0.23	440	360	0.24
11/24/14 7:30	1,360	493,800	140	0.10	760	310	0.23	--	--	--	735	315	0.23	1,030	410	0.30	870	450	0.33	900	460	0.34
12/2/14 12:30	11,820	494,670	870	0.07	2,810	2,050	0.17	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
12/4/14 9:00	14,490	--	--	--	--	--	--	2,980	2,980	0.21	3,600	2,865	0.20	4,930	3,900	0.27	5,280	4,410	0.30	4,590	3,690	0.25
12/10/14 10:50	8,750	--	--	--	--	--	--	3,520	540	0.06	5,090	1,490	0.17	6,980	2,050	0.23	7,570	2,290	0.26	6,530	1,940	0.22
12/18/14 16:12	11,842	--	--	--	--	--	--	4,250	730	0.06	7,130	2,040	0.17	9,820	2,840	0.24	10,720	3,150	0.27	9,210	2,680	0.23
1/2/15 11:12	21,300	--	--	--	--	--	--	5,700	1,450	0.07	11,000	3,870	0.18	15,100	5,280	0.25	16,870	6,150	0.29	14,410	5,200	0.24
1/6/15 13:07	5,875	--	--	--	--	--	--	6,120	420	0.07	12,110	1,110	0.19	16,600	1,500	0.26	18,620	1,750	0.30	15,940	1,530	0.26
1/16/15 9:50	14,203	--	--	--	--	--	--	7,100	980	0.07	14,700	2,590	0.18	20,120	3,520	0.25	22,680	4,060	0.29	19,530	3,590	0.25
1/30/15 17:15	20,605	--	--	--	--	--	--	8,230	1,130	0.05	17,670	2,970	0.14	24,310	4,190	0.20	27,370	4,690	0.23	23,420	3,890	0.19
2/6/15 15:00	9,945	--	--	--	--	--	--	8,790	560	0.06	18,120	450	0.05	26,170	1,860	0.19	29,660	2,290	0.23	25,250	1,830	0.18
2/12/15 7:00	8,160	--	--	--	--	--	--	9,240	450	0.06	20,300	2,180	0.27	28,030	1,860	0.23	31,550	1,890	0.23	26,750	1,500	0.18
2/19/15 11:16	10,336	--	--	--	--	--	--	9,820	580	0.06	21,820	1,520	0.15	30,170	2,140	0.21	33,950	2,400	0.23	28,650	1,900	0.18
2/27/15 9:55	11,439	--	--	--	--	--	--	10,460	640	0.06	23,520	1,700	0.15	32,560	2,390	0.21	36,670	2,720	0.24	30,760	2,110	0.18
3/5/15 15:35	8,980	--	--	--	--	--	--	10,970	510	0.06	24,850	1,330	0.15	34,440	1,880	0.21	38,800	2,130	0.24	32,400	1,640	0.18
3/13/15 12:00	11,305	--	--	--	--	--	--	11,600	630	0.06	26,510	1,660	0.15	36,750	2,310	0.20	41,450	2,650	0.23	34,450	2,050	0.18
3/25/15 12:43	17,323	--	--	--	--	--	--	12,490	890	0.05	28,510	2,000	0.12	40,670	3,920	0.23	45,350	3,900	0.23	37,390	2,940	0.17
4/9/15 14:20	21,697	--	--	--	--	--	--	13,900	1,410	0.06	31,210	2,700	0.12	46,130	5,460	0.25	49,990	4,640	0.21	41,060	3,670	0.17
4/23/15 15:30	20,230	--	--	--	--	--	--	15,220	1,320	0.07	33,730	2,520	0.12	51,230	5,100	0.25	54,600	4,610	0.23	44,460	3,400	0.17
5/8/15 9:30	21,240	--	--	--	--	--	--	16,340	1,120	0.05	35,860	2,130	0.10	55,720	4,490	0.21	63,440	8,840	0.42	47,510	3,050	0.14
5/21/15 15:40	19,090	--	--	--	--	--	--	17,430	1,090	0.06	38,040	2,180	0.11	62,420	6,700	0.35	69,260	5,820	0.30	51,770	4,260	0.22
6/4/15 9:05	19,765	--	--	--	--	--	--	18,450	1,020	0.05	40,030	1,990	0.10	69,520	7,100	0.36	75,420	6,160	0.31	56,260	4,490	0.23
6/18/15 8:25	20,120	--	--	--	--	--	--	19,580	1,130	0.06	42,230	2,200	0.11	77,470	7,950	0.40	82,660	7,240	0.36	61,620	5,360	0.27
7/1/15 16:15	19,190	--	--	--	--	--	--	20,870	1,290	0.07	44,810	2,580	0.13	86,070	8,600	0.45	90,270	7,610	0.40	66,960	5,340	0.28
7/16/15 11:32	21,317	--	--	--	--	--	--	22,330	1,460	0.07	47,750	2,940	0.14	95,720	9,650	0.45	98,840	8,570	0.40	73,050	6,090	0.29
7/29/15 8:24	18,532	--	--	--	--	--	--	23,560	1,230	0.07	50,230	2,480	0.13	104,050	8,330	0.45	106,170	7,330	0.40	78,300	5,250	0.28
8/11/15 14:00	19,056	--	--	--	--	--	--	24,770	1,210	0.06	52,640	2,410	0.13	112,230	8,180	0.43	113,340	7,170	0.38	83,500	5,200	0.27
8/27/15 16:00	23,160	--	--	--	--	--	--	26,210	1,440	0.06	55,510	2,870	0.12	121,890	9,660	0.42	121,750	8,410	0.36	89,950	6,450	0.28
9/10/15 16:00	20,160	--	--	--	--	--	--	27,040	830	0.04	58,080	2,570	0.13	130,450	8,560	0.42	129,080	7,330	0.36	95,710	5,760	0.29
9/24/15 15:30	20,130	--	--	--	--	--	--	27,630	590	0.03	60,850	2,770	0.14	139,580	9,130	0.45	136,900	7,820	0.39	101,590	5,880	0.29

TABLE 2 - REMEDIATION SYSTEM OPERATIONS & MAINTENANCE SUMMARY

Date/Time	Elapsed Time	EXTRACTION WELLS								
		EW-20			EW-22			EW-21		
		Reading	Volume	Rate	Reading	Volume	Rate	Reading	Volume	Rate
(min)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	(gal)	(gal)	(gpm)	
11/21/14 14:00	0	0	--	--	0	--	--	0	--	--
11/22/14 8:00	1,080	420	420	0.39	250	250	0.23	200	200	0.19
11/23/14 8:50	1,490	1,750	1,330	0.89	930	680	0.46	670	470	0.32
11/24/14 7:30	1,360	2,750	1,000	0.74	1,450	520	0.38	1,280	610	0.45
12/2/14 12:30	11,820	--	--	--	--	--	--	--	--	--
12/4/14 9:00	14,490	13,130	10,380	0.72	2,210	760	0.05	7,710	6,430	0.44
12/10/14 10:50	8,750	16,720	3,590	0.41	4,320	2,110	0.24	10,380	2,670	0.31
12/18/14 16:12	11,842	21,310	4,590	0.39	7,540	3,220	0.27	14,470	4,090	0.35
1/2/15 11:12	21,300	32,170	10,860	0.51	13,900	6,360	0.30	22,220	7,750	0.36
1/6/15 13:07	5,875	35,590	3,420	0.58	15,660	1,760	0.30	24,450	2,230	0.38
1/16/15 9:50	14,203	43,480	7,890	0.56	20,010	4,350	0.31	29,670	5,220	0.37
1/30/15 17:15	20,605	53,090	9,610	0.47	24,740	4,730	0.23	36,330	6,660	0.32
2/6/15 15:00	9,945	58,110	5,020	0.50	27,160	2,420	0.24	39,520	3,190	0.32
2/12/15 7:00	8,160	62,180	4,070	0.50	29,170	2,010	0.25	42,270	2,750	0.34
2/19/15 11:16	10,336	67,480	5,300	0.51	31,830	2,660	0.26	45,750	3,480	0.34
2/27/15 9:55	11,439	73,460	5,980	0.52	34,990	3,160	0.28	49,200	3,450	0.30
3/5/15 15:35	8,980	78,160	4,700	0.52	37,610	2,620	0.29	51,870	2,670	0.30
3/13/15 12:00	11,305	84,030	5,870	0.52	40,990	3,380	0.30	55,200	3,330	0.29
3/25/15 12:43	17,323	92,520	8,490	0.49	45,660	4,670	0.27	60,320	5,120	0.30
4/9/15 14:20	21,697	105,020	12,500	0.58	51,780	6,120	0.28	67,840	7,520	0.35
4/23/15 15:30	20,230	118,220	13,200	0.65	58,050	6,270	0.31	78,280	10,440	0.52
5/8/15 9:30	21,240	134,470	16,250	0.77	65,210	7,160	0.34	84,330	6,050	0.28
5/21/15 15:40	19,090	153,100	18,630	0.98	72,510	7,300	0.38	94,080	9,750	0.51
6/4/15 9:05	19,765	171,210	18,110	0.92	79,820	7,310	0.37	104,920	10,840	0.55
6/18/15 8:25	20,120	192,250	21,040	1.05	88,080	8,260	0.41	117,430	12,510	0.62
7/1/15 16:15	19,190	222,140	29,890	1.56	97,150	9,070	0.47	130,600	13,170	0.69
7/16/15 11:32	21,317	259,080	36,940	1.73	107,650	10,500	0.49	144,990	14,390	0.68
7/29/15 8:24	18,532	291,890	32,810	1.77	116,490	8,840	0.48	157,950	12,960	0.70
8/11/15 14:00	19,056	325,290	33,400	1.75	125,280	8,790	0.46	170,970	13,020	0.68
8/27/15 16:00	23,160	368,880	43,590	1.88	135,900	10,620	0.46	186,190	15,220	0.66
9/10/15 16:00	20,160	408,090	39,210	1.94	145,590	9,690	0.48	199,660	13,470	0.67
9/24/15 15:30	20,130	451,090	43,000	2.14	156,180	10,590	0.53	214,250	14,590	0.72

Notes:

Remediation system startup: NOV 21, 2014.

Product addition began: NOV 22, 2014

min = minutes

gpm = gallons per minute

gal = gallons

CBN = Nutrients Added

A2 = bacterial consortium added

PS = Surfactant Added

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-2R	05/10/12	28.56	25.18	7.81	7.81	0.00	20.75	NA	NA	2" Diameter well
MW-2R	11/14/12	28.56	NM	NM	NM	ND	NA	NA	NA	Not Sampled and only gauged for LPH
MW-2R	04/17/13	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	06/25/14	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	12/04/14	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	12/31/14	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	01/22/15	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	02/19/15	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	6/11/15	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-2R	08/11/15	28.56	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
MW-4R	05/10/12	28.45	25.13	7.86	7.86	0.00	20.59	NA	NA	2" Diameter well
MW-4R	11/14/12	28.45	25.12	8.58	8.58	0.00	19.87	Decrease	-0.72	
MW-4R	04/17/13	28.45	25.10	8.13	8.13	0.00	20.32	Rise	0.45	
MW-4R	06/25/14	28.45	24.87	8.84	8.84	0.00	19.61	Decrease	-0.71	
MW-4R	12/04/14	28.45	24.90	9.00	9.00	0.00	19.45	Decrease	-0.16	slight hydrocarbon odor
MW-4R	12/31/14	28.45	24.90	7.45	7.45	0.00	21.00	Rise	1.55	
MW-4R	01/22/15	28.45	24.90	8.25	8.25	0.00	20.20	Decrease	-0.80	
MW-4R	02/19/15	28.45	24.90	8.15	8.15	0.00	20.30	Rise	0.10	
MW-4R	06/11/15	28.45	29.18	9.08	9.08	0.00	19.37	Decrease	-0.93	
MW-4R	08/11/15	28.45	25.19	9.98	9.98	0.00	18.47	Decrease	-0.90	
MW-5R	05/10/12	28.25	23.79	7.46	7.46	0.00	20.79	NA	NA	2" Diameter well
MW-5R	11/14/12	28.25	23.78	8.41	8.41	0.00	19.84	Decrease	-0.95	
MW-5R	04/17/13	28.25	23.70	7.65	7.65	0.00	20.60	Rise	0.76	
MW-5R	06/25/14	28.25	23.50	8.57	8.57	0.00	19.68	Decrease	-0.92	
MW-5R	12/04/14	28.25	23.50	7.40	7.40	0.00	20.85	Rise	1.17	
MW-5R	12/31/14	28.25	23.50	6.20	6.20	0.00	22.05	Rise	1.20	
MW-5R	01/22/15	28.25	23.50	7.05	7.05	0.00	21.20	Decrease	-0.85	
MW-5R	02/19/15	28.25	23.50	7.10	7.10	0.00	21.15	Decrease	-0.05	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-5R	06/11/15	28.25	23.79	7.84	7.84	0.00	20.42	Decrease	-0.73	Brown water, has distinct hydrocarbon odor
MW-5R	08/11/15	28.25	24.79	8.11	8.11	0.00	20.14	Decrease	-0.27	
MW-6R	05/10/12	28.07	25.22	7.21	7.21	0.00	20.86	NA	NA	2" Diameter well
MW-6R	11/14/12	28.07	25.20	8.31	8.31	0.00	19.76	Decrease	-1.10	
MW-6R	04/17/13	28.07	24.90	7.60	7.60	0.00	20.47	Rise	0.71	
MW-6R	06/25/14	28.07	24.87	8.49	8.49	0.00	19.58	Decrease	-0.89	
MW-6R	12/04/14	28.07	24.90	7.40	7.40	0.00	20.67	Rise	1.09	
MW-6R	12/31/14	28.07	24.90	6.00	6.00	0.00	22.07	Rise	1.40	
MW-6R	01/22/15	28.07	24.90	7.00	7.00	0.00	21.07	Decrease	-1.00	
MW-6R	02/19/15	28.07	24.90	7.05	7.05	0.00	21.02	Decrease	-0.05	
MW-6R	06/11/15	28.07	25.18	7.78	7.78	0.00	20.29	Decrease	-0.73	
MW-6R	08/11/15	28.07	25.18	8.20	8.20	0.00	19.87	Decrease	-0.42	
MW-7R	05/10/12	28.41	25.33	7.63	7.63	0.00	20.78	NA	NA	2" Diameter well
MW-7R	11/14/12	28.41	25.30	8.68	8.68	0.00	19.73	Decrease	-2.48	
MW-7R	04/17/13	28.41	24.95	7.85	7.85	0.00	20.56	Rise	0.83	
MW-7R	06/25/14	28.41	24.97	8.79	8.79	0.00	19.62	Decrease	-0.94	
MW-7R	12/04/14	28.41	24.95	7.65	7.65	0.00	20.76	Rise	1.14	
MW-7R	12/31/14	28.41	24.95	6.15	6.15	0.00	22.26	Rise	1.50	
MW-7R	01/22/15	28.41	24.95	7.05	7.05	0.00	21.36	Decrease	-0.90	
MW-7R	02/19/15	28.41	24.95	7.10	7.10	0.00	21.31	Decrease	-0.05	
MW-7R	06/11/15	28.41	25.28	7.84	7.84	0.00	20.57	Decrease	-0.74	
MW-7R	08/11/15	28.41	25.29	8.25	8.25	0.00	20.16	Decrease	-0.41	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-8	05/10/12	28.01	14.16	7.74	7.74	0.00	20.27	NA	NA	2" Diameter well
MW-8	11/14/12	28.01	14.15	8.09	8.09	0.00	19.92	Decrease	-0.35	
MW-8	04/17/13	28.01	14.00	7.68	7.68	0.00	20.33	Rise	0.41	
MW-8	06/25/14	28.01	13.84	8.25	8.25	0.00	19.76	Decrease	-0.57	
MW-8	12/05/14	28.01	13.85	7.45	7.45	0.00	20.56	Rise	0.80	
MW-8	12/31/14	28.01	14.00	7.55	7.55	0.00	20.46	Decrease	-0.10	
MW-8	01/22/15	28.01	14.00	7.90	7.90	0.00	20.11	Decrease	-0.35	
MW-8	02/19/15	28.01	14.00	7.85	7.85	0.00	20.16	Rise	0.05	
MW-8	06/11/15	28.01	14.26	8.34	8.34	0.00	19.67	Decrease	-0.49	
MW-8	08/11/15	28.01	14.24	8.69	8.69	0.00	19.32	Decrease	-0.35	
MW-9	05/10/12	27.23	15.09	6.25	6.25	0.00	20.98	NA	NA	2" Diameter well
MW-9	11/14/12	27.23	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-9	04/17/13	27.23	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-9	06/26/14	27.23	14.82	7.78	7.78	0.00	19.45	NA	NA	
MW-9	12/05/14	27.23	14.84	7.10	7.10	0.00	20.13	Rise	0.68	
MW-9	12/31/14	27.23	14.8	5.80	5.80	0.00	21.43	Rise	1.30	
MW-9	01/22/15	27.23	14.8	6.45	6.45	0.00	20.78	Decrease	-0.65	
MW-9	02/19/15	27.23	14.75	6.55	6.55	0.00	20.68	Decrease	-0.10	
MW-9	06/11/15	27.23	15.06	7.59	7.59	0.00	19.64	Decrease	-1.04	
MW-9	08/10/15	27.23	15.03	8.21	8.21	0.00	19.02	Decrease	-0.62	
MW-10	05/10/12	27.45	13.12	6.49	6.49	0.00	20.96	NA	NA	2" Diameter well
MW-10	11/14/12	27.45	13.12	7.31	7.31	0.00	20.14	Decrease	-0.82	
MW-10	04/18/13	27.45	12.95	7.04	7.04	0.00	20.41	Rise	0.27	
MW-10	06/26/14	27.45	12.86	7.86	7.86	0.00	19.59	Decrease	-0.82	
MW-10	12/05/14	27.45	12.81	6.89	6.89	0.00	20.56	Rise	0.97	Slow-moving water, copious bubbles
MW-10	12/31/14	27.45	12.95	5.80	5.80	0.00	21.65	Rise	1.09	
MW-10	01/22/15	27.45	12.95	6.60	6.60	0.00	20.85	Decrease	-0.80	
MW-10	02/19/15	27.45	12.95	6.75	6.75	0.00	20.70	Decrease	-0.15	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-10	06/11/15	27.45	13.19	7.62	7.62	0.00	19.83	Decrease	-0.87	
MW-10	08/10/15	27.45	13.16	8.19	8.19	0.00	19.26	Decrease	-0.57	Turb flashed 1,000
MW-11R	05/10/12	28.92	23.87	8.02	8.02	0.00	20.90	NA	NA	2" Diameter well
MW-11R	11/14/12	28.92	23.95	9.18	9.18	0.00	19.74	Decrease	-1.16	
MW-11R	04/17/13	28.92	24.4	8.14	8.14	0.00	20.78	Rise	1.04	
MW-11R	06/26/14	28.92	23.64	9.30	9.30	0.00	19.62	Decrease	-1.16	
MW-11R	12/04/14	28.92	23.65	8.90	8.90	0.00	20.02	Rise	0.40	
MW-11R	12/31/14	28.92	23.65	8.15	8.15	0.00	20.77	Rise	0.75	
MW-11R	01/23/15	28.92	23.65	8.40	8.40	0.00	20.52	Decrease	-0.25	Turbidity reading repeatedly flashed "0.00"
MW-11R	02/20/15	28.92	23.65	8.60	8.60	0.00	20.32	Decrease	-0.20	
MW-11R	06/12/15	28.92	23.89	10.06	10.06	0.00	18.86	Decrease	-1.46	
MW-11R	08/10/15	28.92	23.91	10.92	10.92	0.00	18.00	Decrease	-0.86	
MW-12	05/10/12	28.73	24.37	7.96	7.96	0.00	20.77	NA	NA	2" Diameter well
MW-12	11/14/12	28.73	24.35	9.37	9.37	0.00	19.36	Decrease	-1.41	
MW-12	04/17/13	28.73	24.30	9.10	9.10	0.00	19.63	Rise	0.27	
MW-12	06/26/12	28.73	24.33	8.86	8.86	0.00	19.87	Rise	0.24	
MW-12	12/04/14	28.73	24.35	9.95	9.95	0.00	18.78	Decrease	-1.09	
MW-12	12/31/14	28.73	24.35	8.20	8.20	0.00	20.53	Rise	1.75	
MW-12	01/23/15	28.73	24.35	8.80	8.80	0.00	19.93	Decrease	-0.60	
MW-12	02/16/15	28.73	24.35	9.50	9.50	0.00	19.23	Decrease	-0.70	
MW-12	06/12/15	28.73	24.56	10.03	10.03	0.00	18.70	Decrease	-0.53	
MW-12	08/10/15	28.73	24.59	10.82	10.82	0.00	17.91	Decrease	-0.79	
MW-13	05/10/12	29.21	20.02	8.57	8.57	0.00	20.64	NA	NA	2" Diameter well
MW-13	11/14/12	29.21	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-13	04/17/13	29.21	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-13	06/26/14	29.21	20.02	9.87	9.87	0.00	19.34	NA	NA	
MW-13	12/04/14	29.21	20.00	9.25	9.25	0.00	19.96	Rise	0.62	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-13	12/31/14	29.21	NM	NM	NM	NM	NA	NA	NA	Property closed, couldn't access well.
MW-13	01/23/15	29.21	20.00	11.20	11.20	0.00	18.01	Decrease	-1.95	
MW-13	02/20/15	29.21	20.00	11.55	11.55	0.00	17.66	Decrease	-0.35	
MW-13	06/12/15	29.21	20.28	9.39	9.39	0.00	19.82	Rise	2.16	
MW-13	08/10/15	29.21	20.32	9.87	9.87	0.00	19.34	Decrease	-0.48	Turbidity flashed 0.0

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-14	05/10/12	29.02	11.62	8.28	8.28	0.00	20.74	NA	NA	2" Diameter well
MW-14	11/14/12	29.02	11.71	9.20	9.20	0.00	19.82	Decrease	-0.92	
MW-14	04/17/13	29.02	11.60	8.45	8.45	0.00	20.57	Rise	0.75	
MW-14	06/26/14	29.02	11.38	9.34	9.34	0.00	19.68	Decrease	-0.89	
MW-14	12/04/14	29.02	11.40	8.30	8.30	0.00	20.72	Rise	1.04	
MW-14	12/31/14	29.02	NM	NM	NM	NM	NA	NA	NA	Property closed, couldn't access well.
MW-14	01/23/15	29.02	11.50	8.25	8.25	0.00	20.77	Rise	0.05	
MW-14	02/20/15	29.02	11.40	8.30	8.30	0.00	20.72	Decrease	-0.05	
MW-14	06/12/15	29.02	10.67	9.18	9.18	0.00	19.84	Decrease	-0.88	
MW-14	08/10/15	29.02	11.66	9.65	9.65	0.00	19.37	Decrease	-0.47	
MW-15	05/10/12	28.53	29.70	7.90	7.90	0.00	20.63	NA	NA	2" Diameter well
MW-15	11/14/12	28.53	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-15	04/17/13	28.53	NM	NM	NM	NM	NA	NA	NA	Not gauged nor sampled
MW-15	06/26/14	28.53	29.39	9.85	9.85	0.00	18.68	NA	NA	
MW-15	12/05/14	28.53	29.57	9.39	9.39	0.00	19.14	Rise	0.46	
MW-15	12/31/14	28.53	29.4	7.95	7.95	0.00	20.58	Rise	1.44	
MW-15	01/23/15	28.53	29.4	8.85	8.85	0.00	19.68	Decrease	-0.90	
MW-15	02/20/15	28.53	29.4	9.05	9.05	0.00	19.48	Decrease	-0.20	
MW-15	06/12/15	28.53	29.64	9.85	9.85	0.00	18.68	Decrease	-0.80	
MW-15	08/10/15	28.53	29.69	10.38	10.38	0.00	18.15	Decrease	-0.53	Turbidity flashed "0.0"
MW-16	05/10/12	28.52	29.38	7.86	7.86	0.00	20.66	NA	NA	2" Diameter well
MW-16	11/14/12	28.52	29.37	8.92	8.92	0.00	19.60	Decrease	-1.06	
MW-16	04/17/13	28.52	24.75	7.63	7.63	0.00	20.89	Rise	1.29	
MW-16	06/26/14	28.52	29.37	9.04	9.04	0.00	19.48	Decrease	-1.41	
MW-16	12/05/14	28.52	29.4	8.20	8.20	0.00	20.32	Rise	0.84	
MW-16	12/31/14	28.52	29.4	7.65	7.65	0.00	20.87	Rise	0.55	
MW-16	01/23/15	28.52	29.4	8.45	8.45	0.00	20.07	Decrease	-0.80	
MW-16	02/20/15	28.52	29.4	8.50	8.50	0.00	20.02	Decrease	-0.05	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
MW-16	06/12/15	28.52	29.67	9.33	9.33	0.00	19.19	Decrease	-0.83	
MW-16	08/10/15	28.52	26.5	9.88	9.88	0.00	18.64	Decrease	-0.55	
EW-14	05/10/12	28.89	24.80	8.15	8.15	0.00	20.74	NA	NA	4" Diameter well
EW-14	11/14/12	28.89	NM	NM	NM	ND	NA	NA	NA	Not Sampled and only gauged for LPH
EW-14	04/17/13	29.89	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
EW-14	06/25/14	29.89	24.41	9.24	9.24	0.00	20.65	NA	NA	
EW-14	12/05/14	29.89	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-14	12/31/14	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-14	01/23/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-14	02/20/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-14	06/11/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-14	08/10/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-15	05/10/12	28.66	24.50	8.06	8.06	0.00	20.60	NA	NA	4" Diameter well
EW-15	11/14/12	28.66	NM	NM	NM	ND	NA	NA	NA	Not Sampled and only gauged for LPH
EW-15	04/17/13	28.66	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
EW-15	06/25/14	28.66	24.14	9.03	9.03	0.00	19.63	NA	NA	
EW-15	12/05/14	28.66	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-15	12/31/14	28.66	NM	NM	NM	ND	NA	NA	NA	
EW-15	01/23/15	28.66	NM	NM	NM	ND	NA	NA	NA	
EW-15	02/20/15	28.66	NM	NM	NM	ND	NA	NA	NA	
EW-15	06/11/15	28.66	NM	NM	NM	ND	NA	NA	NA	
EW-15	08/10/15	28.66	NM	NM	NM	ND	NA	NA	NA	
EW-16	05/10/12	28.99	24.80	8.37	8.37	0.00	20.62	NA	NA	4" Diameter well
EW-16	11/14/12	28.99	NM	NM	NM	ND	NA	NA	NA	Not Sampled and only gauged for LPH
EW-16	04/17/13	29.99	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
EW-16	06/26/14	29.99	22.74	9.29	9.29	0.00	20.70	NA	NA	
EW-16	12/05/14	29.99	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
EW-16	12/31/14	29.99	NM	NM	NM	ND	NA	NA	NA	
EW-16	01/23/15	29.99	NM	NM	NM	ND	NA	NA	NA	
EW-16	02/20/15	29.99	NM	NM	NM	ND	NA	NA	NA	
EW-16	06/11/15	29.99	NM	NM	NM	ND	NA	NA	NA	
EW-16	08/10/15	29.99	NM	NM	NM	ND	NA	NA	NA	
EW-17	05/10/12	28.89	25.29	8.19	8.19	0.00	20.70	NA	NA	4" Diameter well
EW-17	11/14/12	28.89	NM	NM	NM	ND	NA	NA	NA	Not Sampled and only gauged for LPH
EW-17	04/17/13	29.89	NM	NM	NM	ND	NA	NA	NA	Not gauged nor sampled
EW-17	06/25/14	29.89	24.12	9.27	9.27	0.00	20.62	NA	NA	
EW-17	12/05/14	29.89	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
EW-17	12/31/14	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-17	01/23/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-17	02/20/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-17	06/11/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-17	08/10/15	29.89	NM	NM	NM	ND	NA	NA	NA	
EW-18	06/25/14	28.47	14.74	8.91	8.91	0.00	19.56	NA	NA	4" Diameter well
EW-18	12/05/14	28.47	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-18	12/31/14	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-18	01/23/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-18	02/20/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-18	06/11/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-18	08/10/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-19	06/25/14	28.34	14.56	8.74	8.74	0.00	19.60	NA	NA	4" Diameter well
EW-19	12/05/14	28.34	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-19	12/31/14	28.34	NM	NM	NM	ND	NA	NA	NA	
EW-19	01/23/15	28.34	NM	NM	NM	ND	NA	NA	NA	
EW-19	02/20/15	28.34	NM	NM	NM	ND	NA	NA	NA	
EW-19	06/11/15	28.34	NM	NM	NM	ND	NA	NA	NA	
EW-19	08/10/15	28.34	NM	NM	NM	ND	NA	NA	NA	
EW-20	06/25/14	28.52	24.2	8.90	8.90	0.00	19.62	NA	NA	4" Diameter well
EW-20	12/05/14	28.52	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-20	12/31/14	28.52	NM	NM	NM	ND	NA	NA	NA	
EW-20	01/23/15	28.52	NM	NM	NM	ND	NA	NA	NA	
EW-20	02/20/15	28.52	NM	NM	NM	ND	NA	NA	NA	
EW-20	06/11/15	28.52	NM	NM	NM	ND	NA	NA	NA	
EW-20	08/10/15	28.52	NM	NM	NM	ND	NA	NA	NA	

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)		Comments
EW-21	06/26/14	29.09	24.54	9.75	9.75	0.00	19.34	NA	NA	4" Diameter well
EW-21	12/05/14	29.09	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-21	12/31/14	29.09	NM	NM	NM	ND	NA	NA	NA	
EW-21	01/23/15	29.09	NM	NM	NM	ND	NA	NA	NA	
EW-21	02/20/15	29.09	NM	NM	NM	ND	NA	NA	NA	
EW-21	06/11/15	29.09	NM	NM	NM	ND	NA	NA	NA	
EW-21	08/10/15	29.09	NM	NM	NM	ND	NA	NA	NA	
EW-22	06/26/14	28.47	23.86	8.91	8.91	0.00	19.56	NA	NA	4" Diameter well
EW-22	12/05/14	28.47	NM	NM	NM	ND	NA	NA	NA	Converted to an injection well
EW-22	12/31/14	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-22	01/23/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-22	02/20/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-22	06/11/15	28.47	NM	NM	NM	ND	NA	NA	NA	
EW-22	08/10/15	28.47	NM	NM	NM	ND	NA	NA	NA	
	Date	Gradient and Groundwater Flow Direction		Average Groundwater Elevation (feet MSL)		Change in Average GW Elevation (feet)				
	05/10/12	0.002	SW	20.72		NA				
	11/14/12	0.004	NE	19.78		0.94				
	04/17/13	0.005/ 0.012	WSW/ NE	20.46		-0.68				
	06/26/14	Varies	Varies	19.69		0.76				
	12/05/14	Varies	Varies	20.15		-0.45				
	12/31/14	Varies	Varies	21.24		-1.10				
	01/23/15	Varies	Varies	20.35		0.89				
	02/20/15	Varies	Varies	20.21		0.14				
	06/12/15	Varies	Varies	19.61		0.61				

**TABLE 3 -
GROUNDWATER ELEVATION DATA**

Well No.	Date	TOC Elevation (feet MSL)	Total Well Depth (feet)	Depth to Liquid (feet)	Depth to Water (feet)	SPH Thickness (feet)	Groundwater Elevation (feet MSL)	Change in Groundwater Elevation (feet)	Comments
		08/10/15		Varies	Varies		19.05	0.56	

Notes:

Top-of-Casing (TOC) elevations were surveyed by Virgil Chavez Land Surveying on May 10, 2012.

MSL=Mean Sea Level

NM = Not Measured

NA = Not Applicable

ND = Not Detected

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene	
																													Analytical Results (ug/L)
MW-2R	5/10/2012	57,000	9,400	6,500	1,100	5,100	<25	380	<25	<25	<25	<25	1,100	310	30	<25	<25	<25	<25	<25	<25	<25	96	51	270	<25	<25	<25	<25
MW-2R	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	6/25/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	12/4/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	1/22/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	2/19/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-4R	5/10/2012	3,300	3.3	17	180	824	<10	89	<0.50	<0.50	<0.50	<0.50	210	63	2.7	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	42	13	91	10	<0.50	<0.50	<0.50	
MW-4R	11/14/2012	420	51	0.66	0.66	2.54	<10	68	<0.50	<0.50	<0.50	<0.50	3.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	47	3.9	7.8	9.1	<0.50	<0.50	<0.50	
MW-4R	4/17/2013	2,000	190	140	46	155	<10	62	<0.50	1.0	<0.50	<0.50	28	7.4	<0.50	<0.50	<0.50	<0.50	<0.50	0.33 J	<0.50	30	4.6	51	7.0	<0.50	<0.50	<0.50	
MW-4R	6/25/2014	740	55	0.37J	1.7	0.59J	<10	46	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	13	2.3	27	3.0	<0.50	<0.50	<0.50		
MW-4R	12/4/2014	2,000	160	1.3	4.7	12	<10	150	<0.50	<0.50	<0.50	<0.50	4.2	1.3	<0.50	<0.50	<0.50	<0.50	<0.50	--	<0.50	70	18	140	11	<0.50	<0.50	<0.50	
MW-4R	12/31/2014	1,200	13	21	3.1	340	<50	57	<2.5	<2.5	<2.5	<2.5	130	20	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	12	5.8	5.5	<5.0	<2.5	<5.0	<2.5	
MW-4R	1/22/2015	1,800	140	87	15	720	<50	96	<2.5	<2.5	<2.5	<2.5	180	11	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	12	<5.0	8	<5.0	<2.5	<5.0	<2.5	
MW-4R	2/19/2015	4,000	880	130	23	1,300	<50	240	<2.5	<2.5	<2.5	<2.5	270	21	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	27	8.6	16	6	<2.5	<5.0	<2.5	
MW-4R	6/11/2015	1,600	590	24	6.8	340	<50	280	<2.5	<2.5	<2.5	<2.5	65	6.3	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	70	6.0	<5.0	10	<2.5	<5.0	<2.5	
MW-4R	8/11/2015	1,200	360	<5.0	<5.0	130	<50	200	<2.5	<2.5	<2.5	<2.5	<5.0	<5.0	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	62	<5.0	<5.0	<5.0	<2.5	<5.0	<2.5	
MW-5R	5/10/2012	33,000	150	2,700	2,500	11,100	<500	680	<25	<25	<25	<25	2,400	620	52	<25	<25	<25	<25	<25	<25	210	99	630	46	<25	<25	<25	
MW-5R	11/14/2012	32,000	130	2,400	2,900	15,200	<100	620	<5.0	<5.0	<5.0	<5.0	3,600	720	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	180	90	490	33	<5.0	<5.0	<5.0	
MW-5R	4/17/2013	35,000	240	2,400	2,000	9,500	<100	400	<5.0	<5.0	<5.0	<5.0	2,200	510	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	140	59	390	<5.0	4.7 J	<5.0	<5.0	
MW-5R	6/25/2014	32,000	210	970	1,700	7,900	<100	470	<5.0	<5.0	<5.0	<5.0	2,200	400	40	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	120	55	330	20	<5.0	<5.0	<5.0	
MW-5R	12/4/2014	32,000	1,400	3,700	2,100	9,500	<1,000	720	<50	<50	<50	<50	1,700	410	<100	<50	<100	<100	<50	--	<100	170	<100	470	<100	<50	<100	<50	
MW-5R	12/31/2014	47,000	1,000	5,900	2,100	14,000	<1,000	890	<50	<50	<50	<50	2,900	620	<100	<50	<100	<100	<50	--	<100	160	<100	380	<100	<50	<100	<50	
MW-5R	1/22/2015	45,000	1,200	8,900	2,300	15,000	<1,000	870	<50	<50	<50	<50	2,500	510	<100	<50	<100	<100	<50	--	<100	160	<100	340	<100	<50	<100	<50	
MW-5R	2/19/2015	50,000	1,600	11,000	2,600	17,000	<1,000	760	<50	<50	<50	<50	2,600	520	<100	<50	<100	<100	<50	--	<100	150	<100	300	<100	<50	<100	<50	
MW-5R	6/11/2015	51,000	1,800	7,600	4,200	23,000	<1,000	1,000	<50	<50	<50	<50	3,200	760	<100	<50	<100	<100	<50	--	<100	220	<100	450	<100	<50	<100	<50	
MW-5R	8/11/2015	39,000	1,200	4,100	2,900	17,000	<1,000	590	<50	<50	<50	<50	1,800	390	<100	<50	<100	<100	<50	--	<100	100	<100	210	<100	<50	<100	<50	
MW-6R	5/10/2012	3,600	8.6	52	120	680	<10	79	<0.50	<0.50	<0.50	<0.50	210	67	16	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	20	25	50	9.9	<0.50	<0.50	<0.50	
MW-6R	11/14/2012	900	2.4	7.1	83	131	<10	30	<0.50	<0.50	<0.50	<0.50	61	13	0.61	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	12	3.2	28	3.1	<0.50	<0.50	<0.50	
MW-6R	4/17/2013	1,800	220	21	64	157	<10	29	<0.50	<0.50	<0.50	<0.50	60	14	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	24	2.1	27	7.6	<0.50	<0.50	<0.50	
MW-6R	6/25/2014	1,700	4.3	9.4	55	181	<10	49	<0.50	<0.50	<0.50	<0.50	72	13	2.7	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	17	3.4	32	4.5	<0.50	<0.50	<0.50	
MW-6R	12/4/2014	3,700	73	38	79	810	<10	160	<0.50	<0.50	<0.50	<0.50	210	74	1.2	<0.50	<0.50	<0.50	19	--	<1.0	66	16	140	10	<0.50	<1.0	<0.50	
MW-6R	12/31/2014	1,800	5.0	22	9.0	250	<50	240	<2.5	<2.5	<2.5	<2.5	90	21	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	66	14	42	11	<2.5	<5.0	<2.5	
MW-6R	1/22/2015	2,000	110	27	9.7	390	<50	260	<2.5	<2.5	<2.5	<2.5	140	30	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	59	13	9.2	13	<2.5	<5.0	<2.5	
MW-6R	2/19/2015	2,700	54	53	18	730	<50	230	<2.5	<2.5	<2.5	<2.5	260	55	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	47	13	11	12	<2.5	<5.0	<2.5	
MW-6R	6/11/2015	1,600	12	46	32	620	<50	120	<2.5	<2.5	<2.5	<2.5	170	29	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	30	9.4	17	8.7	<2.5	<5.0	<2.5	
MW-6R	8/11/2015	1,700	22	91	60	580	<50	69	<2.5	<2.5	<2.5	<2.5	110	13	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	18	<5.0	8.9	<5.0	<2.5	<5.0	<2.5	
MW-7R	5/10/2012	160,000	14,000	42,000	3,900	26,700	<1,000	660	<25	<25	<25	<25	3,300	960	49	<25	<25	<25	<25	<25	<25	120	<25	370	26	<25	<25	<25	

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene	
																													Analytical Results (ug/L)
MW-7R	11/14/2012	84,000	15,000	26,000	3,700	19,300	<1,000	480	<100	<100	<100	<100	2,300	610	<100	<100	<100	<100	<100	<100	<100	120	48 J	370	<100	<100	<100	<100	
MW-7R	4/17/2013	160,000	17,000	45,000	4,500	22,300	<1,000	350	<100	<100	<100	<100	2,000	580	<100	<100	<100	<100	<100	<100	<100	98 J	<100	300	<100	<100	<100	<100	
MW-7R	6/25/2014	240,000	18,000	38,000	3,900	21,100	<1,000	630	<50	<50	<50	<50	2,200	560	180	<50	<50	<50	<50	<50	<50	89	<50	270	<50	<50	<50	<50	
MW-7R	12/4/2014	110,000	15,000	36,000	4,000	21,000	<1,000	660	<50	<50	<50	<50	2,400	630	<100	<50	<100	<100	<50	--	<100	110	<100	320	<100	<50	<100	<50	
MW-7R	12/31/2014	110,000	11,000	38,000	3,800	22,000	<5,000	690	<250	<250	<250	<250	2,100	560	<500	<250	<500	<500	<250	--	<500	<250	<500	<500	<500	<250	<500	<250	
MW-7R	1/22/2015	110,000	11,000	42,000	4,000	23,000	<5,000	720	<250	<250	<250	<250	2,100	520	<500	<250	<500	<500	<250	--	<500	<250	<500	<500	<500	<250	<500	<250	
MW-7R	2/19/2015	92,000	7,000	33,000	3,400	20,000	<5,000	520	<250	<250	<250	<250	1,900	460	<500	<250	<500	<500	<250	--	<500	<250	<500	<500	<500	<250	<500	<250	
MW-7R	6/11/2015	78,000	3,200	29,000	3,800	23,000	<5,000	730	<250	<250	<250	<250	2,100	560	<500	<250	<500	<500	<250	--	<500	<250	<500	<500	<500	<250	<500	<250	
MW-7R	8/11/2015	69,000	1,600	20,000	3,200	22,000	<5,000	520	<250	<250	<250	<250	1,700	400	<500	<250	<500	<500	<250	--	<500	<250	<500	<500	<500	<250	<500	<250	
MW-8	5/10/2012	2,700	15	20	5.3	34	<10	72	<1.0	<1.0	<1.0	<1.0	<1.0	1.4	<0.50	<0.50	<1.0	<1.0	<1.0	<1.0	<1.0	24	1.7	24	3.8	<1.0	<1.0	<1.0	
MW-8	11/14/2012	790	14	3.0	0.98	5.83	<10	14	<0.50	<0.50	<0.50	<0.50	0.39 J	0.41 J	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	13	0.80	13	2.2	<0.50	0.38 J	<0.50	
MW-8	4/17/2013	1,100	6.8	6.4	5.6	16.8	<10	21	<0.50	<0.50	<0.50	<0.50	1.9	1.6	<0.50	<0.50	2.0	<0.50	<0.50	<0.50	<0.50	9.9	0.89	11	1.6	<0.50	0.25 J	<0.50	
MW-8	6/25/2014	420	2.4	2.2	0.6	3.64J	<10	12	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	3.8	0.26J	3.7	0.67	0.91	<0.50	<0.50	
MW-8	12/5/2014	1,900	22	52.0	11	63	<10	46	<0.50	<0.50	<0.50	<0.50	6.30	2.4	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	20	2.3	21	4.1	<0.50	<1.0	<0.50	
MW-8	12/31/2014	960	9.8	5.9	2.0	12	<10	34	<0.50	<0.50	<0.50	<0.50	<0.50	0.70	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	12	1.4	13	2.3	<0.50	<1.0	<0.50	
MW-8	1/22/2015	1,400	7.8	7.7	2.7	15	<10	45	<0.50	<0.50	<0.50	<0.50	<0.50	0.74	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	14	1.4	14	2.4	<0.50	<1.0	<0.50	
MW-8	2/19/2015	1,600	7.2	7.8	2.8	16	22	50	<0.50	<0.50	<0.50	<0.50	<0.50	0.76	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	15	1.6	16	2.6	<0.50	<1.0	<0.50	
MW-8	6/11/2015	1,400	6.6	9.8	2.9	17	<10	39	<0.50	<0.50	<0.50	<0.50	<0.50	0.81	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	17	1.7	16	3.1	<0.50	<1.0	<0.50	
MW-8	8/11/2015	1,600	15	15.0	3.7	23	18	83	<0.50	<0.50	<0.50	<0.50	<0.50	1.10	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	22	2.1	23	3.5	<0.50	<1.0	<0.50	
MW-9	5/10/2012	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
MW-9	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-9	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-9	6/25/2014	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
MW-9	12/5/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<0.50	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-9	12/31/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<0.50	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-9	1/22/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<0.50	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-9	2/19/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<0.50	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-9	6/11/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-9	8/10/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<0.50	<0.50	--	<1.0	1.7	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-10	5/10/2012	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
MW-10	11/14/2012	<50	<0.50	<0.50	<0.50	ND<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
MW-10	4/18/2013	530	20	110	19	97	<10	2.6	<0.50	<0.50	<0.50	<0.50	12	3.5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.65	0.23 J	2.1	<0.50	<0.50	<0.50	<0.50	
MW-10	6/25/2014	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
MW-10	12/5/2014	530	5.4	100	28	170	<10	7.4	<0.50	<0.50	<0.50	<0.50	22	6.5	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	1.5	<1.0	3.6	<1.0	<0.50	<1.0	<0.50	
MW-10	12/31/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-10	1/22/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-10	2/19/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-10	6/11/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-10	8/10/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-11R	5/10/2012	22,000	<25	170	910	6,300	<500	440	<25	<25	<25	<25	2,500	760	58	<25	<25	40	<25	<25	<25	92	<25	240	<25	<25	<25	<25	
MW-11R	11/14/2012	29,000	2.6	330	1,400	9,700	<100	660	<5.0	<5.0	<5																		

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene
		Analytical Results (ug/L)																										
MW-11R	4/17/2013	22,000	<5.0	6.5	580	3,970	<100	280	<5.0	<5.0	<5.0	<5.0	2,600	720	<5.0	<5.0	<5.0	25	<5.0	<5.0	<5.0	110	61	320	<5.0	<5.0	<5.0	<5.0
MW-11R	6/25/2014	15,000	<5.0	<5.0	260	1,130	<100	280	<5.0	<5.0	<5.0	<5.0	2,100	580	45	<5.0	<5.0	11	<5.0	<5.0	<5.0	72	<5.0	220	18	<5.0	<5.0	<5.0
MW-11R	12/4/2014	21,000	<50	340	520	5,100	<1,000	320	<50	<50	<50	<50	2,100	680	<100	<50	<100	<100	<50	--	<100	71	<100	170	<100	<50	<100	<50
MW-11R	12/31/2014	23,000	<50	240	480	5,400	<1,000	350	<50	<50	<50	<50	2,300	680	<100	<50	<100	<100	<50	--	<100	71	<100	190	<100	<50	<100	<50
MW-11R	1/22/2015	20,000	<50	330	730	5,100	<1,000	350	<50	<50	<50	<50	2,200	600	<100	<50	<100	<100	<50	--	<100	80	<100	200	<100	<50	<100	<50
MW-11R	2/20/2015	25,000	<50	580	980	6,700	<1,000	380	<50	<50	<50	<50	2,500	670	<100	<50	<100	<100	<50	--	<100	87	<100	200	<100	<50	<100	<50
MW-11R	6/12/2015	29,000	180	1,400	1,600	9,900	<1,000	470	<50	<50	<50	<50	2,900	770	<100	<50	<100	<100	<50	--	<100	120	<100	330	<100	<50	<100	<50
MW-11R	8/10/2015	38,000	660	4,600	2,000	14,000	<1,000	500	<50	<50	<50	<50	2,800	670	<100	<50	<100	<100	<50	--	<100	100	<100	310	<100	<50	<100	<50

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene	Analytical Results (ug/L)																								
MW-12	5/10/2012	2,700	600	4.7	160	207	<10	26	<0.50	<0.50	<0.50	<0.50	13	23	0.60	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	10	2.3	17	2.3	<0.50	<0.50	<0.50																								
MW-12	11/14/2012	1,600	470	2.1	140	63.4	<20	26	<1.0	<1.0	<1.0	<1.0	2.3	20	0.40 J	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	8.5	2.1	14	2.1	<1.0	<1.0	1.2																									
MW-12	4/17/2013	5,200	760	3.4	330	409	<40	40	<2.0	1.2 J	<2.0	<2.0	60	49	1.6 J	<2.0	<2.0	<2.0	<2.0	<2.0	1.8 J	22	3.7	36	7.4	<2.0	<2.0	<2.0																									
MW-12	6/25/2014	2,700	350	4.8	200	51	<20	93	<1.0	<1.0	<1.0	<1.0	11	28	4.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	17	3.9	23	3.2	<1.0	<1.0	<1.0																									
MW-12	12/4/2014	1,700	260	150	160	130	<10	66	<0.50	<0.50	<0.50	<0.50	12	21	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	15	<5.0	20	2.3	<0.50	<1.0	<0.50																									
MW-12	12/31/2014	680	120	<2.5	74	10	<50	34	<2.5	<2.5	<2.5	<2.5	<2.5	6.7	<5.0	<2.5	<5.0	<5.0	<5.0	<2.5	--	<5.0	7.6	<5.0	11	<5.0	<2.5	<5.0	<2.5																								
MW-12	1/22/2015	950	110	<2.5	110	12	<50	26	<2.5	<2.5	<2.5	<2.5	<2.5	12	<5.0	<2.5	<5.0	<5.0	<2.5	--	<5.0	9.4	<5.0	14	<5.0	<2.5	<5.0	<2.5																									
MW-12	2/19/2015	410	43	<0.50	30	4.0	<10	7.7	1.4	1.0	<0.50	<0.50	<0.50	3.4	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	3.1	<1.0	4.2	<1.0	<0.5	<1.0	<0.5																									
MW-12	6/12/2015	470	17	54	19	68	<10	5.2	4.5	2.0	<0.50	<0.50	5.5	1.8	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	1.5	<1.0	2.0	<1.0	<0.5	<1.0	<0.5																									
MW-12	8/10/2015	350	25	59	18	130.0	<10	5.0	6.4	2.5	<0.50	<0.50	13	2.9	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	0.71	<1.0	1.0	<1.0	<0.5	<1.0	<0.5																									
MW-13	5/10/2012	50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	8.2	3.7	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50																									
MW-13	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-13	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-13	6/25/2014	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	0.48 J	0.68	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50																									
MW-13	12/4/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	1.1	1.1	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-13	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-13	1/23/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	2.6	1.6	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-13	2/20/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	2.3	1.2	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-13	6/12/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	5.5	2.0	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-13	8/10/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	8.2	2.8	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-14	5/10/2012	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50																									
MW-14	11/14/2012	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50																									
MW-14	4/17/2013	60	<0.50	<0.50	2.9	15.7	<10	1.0	<0.50	<0.50	<0.50	<0.50	5.6	1.5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.27 J	<0.50	0.60	<0.50	<0.50	<0.50	<0.50																									
MW-14	6/25/2014	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50																									
MW-14	12/4/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<0.50	<0.50	<0.50	<0.50																									
MW-14	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-14	1/23/2015	4,700	2,300	91	160	560	<500	<50	<25	<25	<25	<25	200	<25	<50	<25	<50	<50	<50	<25	--	<50	<25	<50	<50	<50	<25	<50	<25																								
MW-14	2/20/2015	12,000	6,200	230	76	1,500	<500	190	<25	<25	<25	<25	490	75	<50	<25	<50	<50	<50	<25	--	<50	46	<50	<50	<50	<25	<50	<25																								
MW-14	6/12/2015	3,800	1,500	31	140	140	<500	160	<25	<25	<25	<25	68	38	<50	<25	<50	<50	<25	--	<50	55	<50	<50	<50	<25	<50	<25																									
MW-14	8/10/2015	5,900	2,700	130	600	430	<500	210	<25	<25	<25	<25	400	83	<50	<25	<50	<50	<25	--	<50	47	<50	70	<50	<25	<50	<25																									
MW-15	5/10/2012	1,800	1.6	1.4	130	38	<10	14	4.4	2.2	<0.50	<0.50	6.2	23	3.0	<0.50	<0.50	<0.50		<0.50	<0.50	22	3.2	28	7.0	<0.50	<0.50	<0.50																									
MW-15	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-15	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--																								
MW-15	6/25/2014	140	<0.50	<0.50	<0.50	<0.50	<10	0.36 J	0.72	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.26 J	<0.50	<0.50	<0.50																									
MW-15	12/5/2014	260	1.6	34	10	57	11	3.7	1.2	<0.50	1.5	3.9	8.0	2.1	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	1.1	<1.0	<1.0	<1.0	<0.50																									
MW-15	12/31/2014	440	9.9	110	17	110	<10	5.3	1.2	<0.50	<0.50	<0.50	16	3.7	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	0.64	<1.0	1.7	<1.0	<0.50	<1.0	<0.50																									
MW-15	1/23/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	3.0	0.59	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-15	2/20/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	3.2	0.59	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-15	6/12/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	4.7	0.97	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-15	8/10/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	5.2	1.1	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50																									
MW-16	5/10/2012	180	<0.50	<0.50	<0.50	<1.5	<10	<0.5	2.3	2.6	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	1.2	<0.5	<0.5	5.8	<0.50	<0.50	<0.50																									

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene	
		Analytical Results (ug/L)																											
MW-16	11/14/2012	<50	<0.50	<0.50	<0.50	<1.5	<10	<0.5	1.2	2.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.5	<0.5	<0.5	1.5	<0.50	<0.50	<0.50	
MW-16	4/17/2013	2,900	3.3	1.1	230	11.3	<10	59	0.35 J	<0.50	<0.50	<0.50	3.4	26	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	43	12	72	13	<0.50	0.42 J	<0.50	
MW-16	6/25/2014	100	<0.50	<0.50	<0.50	<0.50	<10	<0.50	0.59	0.53	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	4.0	<0.50	<0.50	
MW-16	12/5/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-16	12/31/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-16	1/23/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	0.61	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-16	2/20/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	0.5	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-16	6/12/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	0.5	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
MW-16	8/10/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	0.56	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50	
EW-14	5/10/2012	33,000	4,200	3,300	2,200	10,100	<500	280	<25	<25	<25	<25	1,200	300	<25	<25	<25	<25	<25	<25	<25	73	<25	190	<25	<25	<25	<25	
EW-14	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	6/25/2014	19,000	5,200	80	290	558	<200	270	<10	<10	<10	<10	79	26	<10	<10	<10	<10	<10	<10	<10	53	11	100	8.4J	<10	<10	<10	
EW-14	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-14	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	5/10/2012	34,000	6,300	6,500	1,200	5,600	<500	160	<25	<25	<25	<25	690	180	<25	<25	<25	<25	<25	<25	<25	41	<25	110	<25	<25	<25	<25	
EW-15	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	6/25/2014	35,000	8,000	850	630	1,700	<500	460	<25	<25	<25	<25	420	110	<25	<25	<25	<25	<25	<25	<25	63	16J	170	<25	<25	<25	<25	
EW-15	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-15	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	5/10/2012	360	40	1.6	1.3	11.4	<10	10	0.86	0.60	<0.50	<0.50	3.5	1.1	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	9.3	<0.5	5.8	1.6	<0.50	<25	<25	
EW-16	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	6/25/2014	<50	<0.50	<0.50	<0.50	<0.50	<10	<0.50	1.5	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	
EW-16	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-16	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	5/10/2012	11,000	2,800	1,600	240	1,280	<500	210	<25	<25	<25	<27	160	50	<25	<25	<25	<25	<25	<25	<25	52	<25	140	<25	<25	<25	<25	
EW-17	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene	
		Analytical Results (ug/L)																											
EW-17	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	6/25/2014	12,000	1,900	100	330	500	<100	720	<5.0	<5.0	<5.0	<5.0	200	64	19	<5.0	<5.0	<5.0	<5.0	<5.0	<5.0	79	23	210	13	<5.0	<5.0	<5.0	
EW-17	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-17	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	6/25/2014	21,000	140	23	1,100	3,960	<50	480	<2.5	<2.5	<2.5	<2.5	730	240	23	<2.5	<2.5	<2.5	<2.5	<2.5	<2.5	140	58	370	23	<2.5	<2.5	<2.5	
EW-18	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-18	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	6/25/2014	12,000	620	160	460	1,770	<20	480	<1.0	<1.0	<1.0	<1.0	360	110	9.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	120	40	310	22	<1.0	<1.0	<1.0	
EW-19	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-19	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	6/25/2014	3,900	400	8.1	24	79	<20	190	<1.0	2.7	<1.0	<1.0	12	4.2	3.5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	82	9.6	120	14	<1.0	0.94J	<1.0	
EW-20	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-20	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	6/25/2014	60	0.46J	0.25J	0.31J	0.7	<10	0.4J	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	0.53	<0.50	<0.50	<0.50	
EW-21	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-21	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene
		Analytical Results (ug/L)																										
EW-22	6/25/2014	50	0.59	0.41J	1.1	1.76	<10	0.55	<0.50	<0.50	<0.50	<0.50	0.35J	0.29J	<0.50	0.77	<0.50	8.0	<0.50	<0.50	<0.50	0.31J	0.46J	1.2	0.27J	<0.50	<0.50	<0.50
EW-22	12/5/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-22	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-22	1/23/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-22	2/20/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-22	6/11/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
EW-22	8/10/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
INF	12/4/2014	270	<0.50	<0.50	<0.50	14	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	6.8	<1.0	<0.50	<1.0	2.4	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
INF	1/2/2015	810	58	27	5.4	68	<10	9.4	1.0	1.2	<0.50	<0.50	3.1	18	<1.0	<0.50	<1.0	2.3	<0.50	--	<1.0	0.85	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
INF	1/22/2015	980	97	27	4.2	110	<10	18	0.83	1.5	<0.50	<0.50	1.5	39	<1.0	<0.50	<1.0	2.4	<0.50	--	<1.0	0.75	2.5	<1.0	<1.0	<0.50	<1.0	<0.50
INF	2/19/2015	750	91	15	7.2	78	<10	1.9	0.71	0.98	<0.50	<0.50	1.5	32	<1.0	<0.50	<1.0	2.0	<0.50	--	<1.0	0.56	1.9	<1.0	<1.0	<0.50	<1.0	<0.50
INF	3/25/2015	750	20	3.9	1.6	87	<10	3.7	<0.50	<0.50	<0.50	<0.50	0.9	39	<1.0	<0.50	<1.0	2.3	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
INF	4/23/2015	760	2.6	1.3	<0.50	100	<10	5.5	<0.50	0.62	<0.50	<0.50	<0.50	44	<1.0	<0.50	<1.0	2.0	<0.50	--	<1.0	<0.50	2.2	<1.0	<1.0	<0.50	<1.0	<0.50
INF	5/21/2015	370	0.57	<0.50	<0.50	25	<10	1.6	0.67	<0.50	<0.50	<0.50	<0.50	17	<1.0	<0.50	<1.0	1.7	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
INF	6/18/2015	630	4.0	2.7	<0.50	100	<10	5.1	0.88	<0.50	<0.50	<0.50	2.4	30	<1.0	<0.50	<1.0	2.1	<0.50	--	<1.0	<0.50	1.6	<1.0	<1.0	<0.50	<1.0	<0.50
INF	7/16/2015	740	6.0	6.6	<0.50	170	<10	9.1	0.84	<0.50	<0.50	<0.50	9.3	39	<1.0	<0.50	<1.0	1.9	<0.50	--	<1.0	<0.50	2	<1.0	<1.0	<0.50	<1.0	<0.50
INF	8/27/2015	750	8.0	4.8	<0.50	100	<10	17	1.00	<0.50	<0.50	<0.50	<0.50	43	<1.0	<0.50	<1.0	1.6	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
INF	9/24/2015	950	20	8.9	<0.50	190	<10	20	1.00	<0.50	<0.50	<0.50	5.4	43	<1.0	<0.50	<1.0	1.7	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	12/4/2014	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	1/2/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC*	1/22/2015	990	89	24	3.3	110	<10	18	0.84	1.5	<0.50	<0.50	1.4	40	1.0	<0.50	<1.0	2.4	<0.50	--	<1.0	0.63	2.1	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	2/16/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	3/25/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	4/23/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	5/21/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
GAC	6/18/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	7/16/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	8/27/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
GAC	9/24/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	12/4/2014	<2500	<25	<25	<25	<50	<500	<50	<25	<25	<25	<25	<25	<25	<50	<25	<50	<50	<25	--	<50	<25	<50	<50	<50	<25	<50	<25
EFF	1/2/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	1/22/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	2/19/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	3/25/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	4/23/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	5/21/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	6/18/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	7/16/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	8/27/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
EFF	9/24/2015	<50	<0.50	<0.50	<0.50	<1.0	<10	<1.0	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50	<1.0	<0.50	<1.0	<1.0	<0.50	--	<1.0	<0.50	<1.0	<1.0	<1.0	<0.50	<1.0	<0.50
ESLs		100	1.0	40	30	20	NE	6.1	5.0	0.5	6.0	62	NE	NE	NE	80	100	80	NE	NE	0.86	NE	NE	NE	NE	10	NE	5.0

**TABLE 4 -
SUMMARY OF GROUNDWATER SAMPLE ANALYTICAL RESULTS
TPHg and VOCs**

Monitoring Well/Sample ID	Sample Date	TPH-g	Benzene	Toluene	Ethylbenzene	Total Xylenes	Vinyl Acetate	Naphthalene	MTBE	1,2-Dichloroethane	cis-1,2-Dichloroethene	1,1,1-Trichloroethane	1,2,4-Trimethylbenzene	1,3,5-Trimethylbenzene	4-Isopropyltoluene	Bromodichloromethane	Bromoform	Chloroform	2-Chlorotoluene	Di-isopropylether	Hexachlorobutadiene	Isopropylbenzene	n-Butylbenzene	n-Propylbenzene	sec-Butylbenzene	Styrene	tert-Butylbenzene	Tetrachloroethene
		Analytical Results (ug/L)																										

Notes:
Only constituents with a concentration above laboratory detection limits are presented.
 Total Petroleum Hydrocarbons as gasoline was analyzed using EPA Method 8015B.
 Volatile Organic Compounds were analyzed using EPA Method 8260B.
 µg/L = micrograms per liter
 ESL = Regional Water Quality Control Board, Residential Land Use, Environmental Screening Level (groundwater is a current or potential source of drinking water, Table F-1A)
BOLD indicates concentration exceeds the ESL.
 NE = ESL not established.
 < X = indicates not detected above laboratory detection limit of x (detection limits vary, see lab report).
 J = Analyte detected below the Practical Quantitation Limit but above or equal to the Method Detection Limit. Result is an estimated concentration.
¹ - The GAC sample collected on 1/22/15 was mistakenly collected from the INF sample port and therefore these results do not represent breakthrough of COCs in the lead GAC vessel.

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-2R	5/10/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	11/14/2012	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	4/17/2013	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	6/25/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	12/4/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	1/22/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-2R	2/19/2015	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-4R	6/25/2014	4.90	1.40	0.91	0.50	<0.20	<0.10	9.70	4.90	<0.10	0.22	20.60	603.0	6.72	--	--	--	
MW-4R	12/4/2014	25.00	7.80	1.10	730.00	<1.0	0.27	13.00	1.00	24.00	<0.20	21.99	1,560.0	7.39	--	-71	*	
MW-4R	12/30/2014	1.87	1.60	<1.0	80.00	<1.0	<0.020	22.00	1.40	0.47	<0.20	21.02	422.0	4.81	214	5	*	
MW-4R	1/22/2015	1.60	1.60	<1.0	82.00	2.00	<0.020	27.00	1.60	<0.10	<0.20	20.10	544.0	4.72	32.4	83	6.44	
MW-4R	2/19/2015	<0.20	1.70	<1.0	83.00	2.20	<0.020	32.00	<0.10	<0.10	<0.20	19.74	639.0	6.79	1.56	15	1.18	
MW-4R	6/11/2015	<0.20	1.40	<1.0	64.00	2.00	0.024	32.00	<0.10	<0.10	1.50	20.25	639.0	6.90 ¹	0.28	196	3.62	
MW-4R	8/11/2015	1.20	1.30	1.00	5.00	<1.0	0.061	33.00	0.43	0.77	4.50	21.72	570.0	6.58	2.64	-22	1.06	
MW-5R	6/25/2014	<0.50	<0.50	1.50	<0.20	<0.20	<0.10	8.40	<0.50	<0.10	0.17	20.00	434.4	10.62	--	-230.5	*	
MW-5R	12/4/2014	15.60	4.10	1.10	210	5.70	0.51	16.00	15.00	0.60	0.24	21.23	1,200.0	7.39	--	-118.0	*	
MW-5R	12/30/2014	19.30	4.80	1.30	560	7.50	0.42	55.00	16.00	3.30	<0.20	19.82	1,540.0	4.54	64.7	-111.0	7.53	
MW-5R	1/22/2015	9.74	2.80	<1.0	310	32.00	0.28	50.00	9.50	0.24	<0.20	18.67	1,260.0	4.58	28.9	-95.0	5.67	
MW-5R	2/19/2015	11.14	2.80	<1.0	210	17.00	0.32	47.00	11.00	0.14	0.22	18.39	1,140.0	6.94	28.2	-109.0	2.91	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-5R	6/11/2015	3.79	0.99	<1.0	1.50	18.00	0.15	35.00	2.80	0.99	0.28	20.40	460.0	--	49.9	-52.0	48.00	
MW-5R	8/11/2015	3.80	0.88	<1.0	19	1.30	0.35	31.00	2.60	1.20	<0.20	22.91	739.0	6.92	50.1	-98.0	0.95	
MW-6R	6/25/2014	2.90	1.30	0.71	<0.20	<0.20	<0.10	12.00	2.90	<0.10	0.45	20.20	530.7	6.87	--	-114.1	*	
MW-6R	12/4/2014	2.84	3.10	<1.0	150	3.40	0.21	26.00	2.50	0.34	0.24	21.77	909.0	7.24	--	-66.0	*	
MW-6R	12/30/2014	<0.20	1.20	3.70	250	56	4.10	33.00	<0.10	<0.10	7.20	20.32	971.0	4.80	34.2	47.0	6.99	
MW-6R	1/22/2015	<0.20	2.70	1.00	200	32	0.93	74.00	<0.10	<0.10	2.10	19.70	929.0	4.55	0.4	93.0	5.19	
MW-6R	2/19/2015	<0.20	2.20	1.30	270	24	1.40	69.00	<0.10	<0.10	4.60	19.42	1,050.0	6.72	0.15	80.0	2.16	
MW-6R	6/11/2015	0.73	0.93	1.50	350	2.2	1.60	44.00	0.73	<0.10	1.80	21.56	975.0	7.03 ¹	2.05	121.0	2.98	
MW-6R	8/11/2015	0.91	1.10	1.10	240	1.4	1.70	43.00	0.91	<0.10	0.69	23.96	678.0	5.89	22.1	101.0	1.04	
MW-7R	6/25/2014	35.00	3.40	2.00	<0.20	<0.20	<0.10	<2.0	35.00	<0.10	0.39	19.60	774.0	6.61	--	-87.2	*	
MW-7R	12/4/2014	29.00	3.00	<1.0	28.00	<1.0	0.16	<0.1	<0.10	29.00	0.50	20.62	695.0	7.13	--	-78.0	*	
MW-7R	12/30/2014	15.20	3.30	<1.0	250.00	<1.0	0.13	28.00	3.20	12.00	<0.20	19.56	777.0	5.00	20.9	-41.0	6.65	
MW-7R	1/22/2015	18.56	3.90	<1.0	330.00	10.00	0.038	31.00	18.00	0.56	0.34	18.69	1,050.0	4.62	11.1	-37.0	4.82	
MW-7R	2/19/2015	17.00	3.50	<1.0	330.00	10.00	0.10	27.00	14.00	3.00	<0.20	18.53	986.0	6.54	21.1	-51.0	1.29	
MW-7R	6/11/2015	19.90	2.90	1.70	350.00	2.70	<0.020	31.00	15.00	4.90	1.00	22.96	943.0	6.14 ¹	11.9	-24.0	1.89	
MW-7R	8/11/2015	8.90	2.10	1.70	270.00	3.00	0.08	25.00	4.50	4.40	1.20	22.57	850.0	6.01	8.07	-20.0	0.95	
MW-8	6/25/2014	6.10	1.10	0.71	<0.20	<0.20	<0.10	4.10	6.10	<0.10	0.34	22.60	444.9	6.77	--	-112.0	*	
MW-8	12/5/2014	5.60	1.00	<1.0	<1.0	<1.0	0.83	1.70	0.70	4.90	0.24	22.73	321.0	7.20	--	-96.0	*	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-8	12/30/2014	8.30	0.89	<1.0	<1.0	<1.0	0.20	12.00	3.10	5.20	<0.20	19.67	328.0	4.98	334	-40.0	6.2	
MW-8	1/22/2015	7.80	0.83	<1.0	<1.0	<1.0	0.18	12.00	3.00	4.80	<0.20	19.86	400.0	4.68	259	-49.0	4.6	
MW-8	2/19/2015	14.00	1.00	1.50	2.10	<1.0	0.14	13.00	8.00	6.00	0.26	19.85	401.0	6.97	366	-66.0	4.53	
MW-8	6/11/2015	21.00	1.50	1.70	2.40	<1.0	0.03	12.00	9.00	12.00	0.28	0.93	240.0	6.65 ¹	249	-88.0	2.35	
MW-8	8/11/2015	29.00	1.70	3.00	<1.0	<1.0	0.25	1.20	10.00	19.00	0.28	18.82	313.0	8.18	477	-150.0	5.93	
MW-9	6/26/2014	44.00	10.00	4.00	0.50	<0.20	<0.10	28.00	44.00	<0.10	0.04	19.60	495.5	6.71	--	142.3	*	
MW-9	12/5/2014	51.00	9.70	4.60	4.10	<1.0	0.075	38.00	51.00	<0.10	<0.20	19.91	456.0	6.94	--	43.0	*	
MW-9	12/30/2014	5.20	0.95	1.10	3.20	<1.0	0.060	35.00	5.20	<0.10	<0.20	18.66	401.0	4.93	557	151.0	6.82	
MW-9	1/22/2015	9.40	1.30	1.00	3.00	<1.0	0.057	42.00	9.40	<0.10	<0.20	18.40	478.0	4.67	441	132.0	5.55	
MW-9	2/19/2015	66.00	5.30	5.70	4.10	<1.0	0.088	47.00	66.00	<0.10	<0.20	18.67	490.0	7.11	816	55.0	4.12	
MW-9	6/11/2015	45.16	4.70	3.60	12.00	<1.0	<0.020	33.00	45.00	0.16	<0.20	25.29	162.0	6.92 ¹	814	84.0	5.54	
MW-9	8/10/2015	38.00	4.10	3.20	3.40	<1.0	0.063	52.00	37.00	1.20	<0.20	22.15	365.0	7.23	611	111.0	3.89	
MW-10	6/26/2014	42.00	0.65	4.50	2.10	<0.20	0.40	11.00	42.00	<0.10	<0.03	20.30	306.7	6.24	--	131.3	*	
MW-10	12/5/2014	<0.20	<0.020	<1.0	10.00	<1.0	0.021	14.00	<0.10	<0.10	<0.20	20.80	271.0	7.35	--	73.0	*	
MW-10	12/30/2014	3.70	0.20	<1.0	12.00	<1.0	<0.020	13.00	3.70	<0.10	<0.20	18.90	292.0	4.73	147	127.0	8.73	
MW-10	1/22/2015	5.30	0.18	<1.0	12.00	<1.0	0.032	13.00	5.30	<0.10	<0.20	18.88	306.0	4.74	414	192.0	5.11	
MW-10	2/19/2015	35.00	0.47	3.50	12.00	<1.0	0.050	13.00	35.00	<0.10	<0.20	18.59	303.0	6.80	936	133.0	4.72	
MW-10	6/11/2015	67.11	0.82	5.40	11.00	<1.0	<0.020	19.00	67.00	0.11	<0.20	21.99	0.0	6.60 ¹	34.1	115.0	6.23	
MW-10	8/10/2015	40.00	0.59	4.30	7.60	<1.0	0.035	28.00	40.00	<0.10	<0.20	21.72	272.0	6.79	1000	129.0	3.92	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-11R	6/26/2014	120.00	2.00	10.00	0.66	<0.20	<0.10	<2.0	120.00	<0.10	0.03	18.70	153.3	7.01	--	-80.3	*	
MW-11R	12/4/2014	0.91	0.78	<1.0	1.40	<1.0	0.14	4.20	<0.1	0.91	<0.20	19.78	185.0	7.14	--	-46.0	*	
MW-11R	12/31/2014	13.00	1.60	1.30	2.40	<1.0	0.089	6.40	4.40	8.60	<0.20	17.90	288.0	5.27	1000	-32.0	9.39	
MW-11R	1/23/2015	20.00	1.30	1.30	<1.0	<1.0	0.027	2.80	8.00	12.00	<0.20	16.10	223.0	5.78	0	162.0	10.15	
MW-11R	2/20/2015	3.10	0.55	<1.0	<1.0	<1.0	0.110	2.00	2.00	1.10	<0.20	17.63	161.0	6.98	131	-35.0	3.18	
MW-11R	6/12/2015	1.40	0.81	<1.0	<1.0	<1.0	0.150	1.20	<0.10	1.40	<0.20	20.51	186.0	6.94 ¹	2.46	-14.0	1.83	
MW-11R	8/10/2015	2.20	1.50	<1.0	1.30	<1.0	0.120	1.10	<0.10	2.20	<0.20	20.17	332.0	5.94	7.25	-45.0	1.53	
MW-12	6/26/2014	15.00	1.70	2.20	2.00	<0.20	<0.10	2.20	15.00	<0.10	<0.03	19.20	544.4	6.39	--	5.4	*	
MW-12	12/4/2014	0.69	1.00	<1.0	29.00	<1.0	<0.020	10.00	0.32	0.37	<0.20	20.13	393.0	7.05	--	26.0	*	
MW-12	12/31/2014	6.21	1.50	<1.0	13.00	<1.0	0.028	8.60	5.70	0.51	<0.20	18.71	362.0	5.32	136	91.0	8.40	
MW-12	1/23/2015	7.30	1.50	<1.0	12.00	<1.0	<0.020	9.30	6.20	1.10	<0.20	17.75	425.0	4.72	789	19.0	6.54	
MW-12	2/19/2015	96.91	3.10	8.00	2.30	<1.0	0.034	7.60	96.00	0.91	<0.20	19.07	422.0	6.75	567	8.0	4.56	
MW-12	6/12/2015	1.10	1.30	<1.0	2.20	<1.0	0.035	9.30	<0.10	1.10	2.20	19.94	522.0	6.75 ¹	271	27.0	3.93	
MW-12	8/10/2015	0.85	1.10	<1.0	<1.0	<1.0	0.035	15.00	<0.10	0.78	<0.20	20.70	536.0	6.03	7.09	-8.0	3.41	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-13	6/26/2014	3.80	<0.5	1.20	1.20	<0.20	0.140	10.00	3.80	<0.10	0.04	18.50	242.2	6.62	--	124.4	*	
MW-13	12/4/2014	170.19	2.70	11.00	17.00	<1.0	0.190	13.00	170.00	0.19	0.27	19.85	308.0	6.80	--	55.0	*	
MW-13	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-13	1/23/2015	23.00	0.71	2.30	6.80	<1.0	0.081	12.00	23.00	<0.10	<0.20	17.66	291.0	6.75	808	149.0	9.02	
MW-13	2/20/2015	29.00	1.20	3.10	4.40	<1.0	0.082	12.00	29.00	<0.10	<0.20	18.72	366.0	6.84	475	181.0	5.41	
MW-13	6/12/2015	53.14	1.80	7.40	<1.0	5.60	<0.020	12.00	53.00	0.14	<0.20	21.73	5.0	--	17.5	86.0	6.04	
MW-13	8/10/2015	29.00	0.95	3.70	38.00	1.20	0.086	16.00	29.00	<0.10	<0.20	20.25	643.0	6.51	0	171.0	7.91	
MW-14	6/26/2014	28.00	1.20	2.30	7.70	<0.20	<0.10	15.00	28.00	<0.10	0.06	17.70	251.6	6.69	--	142.2	*	
MW-14	12/4/2014	26.19	1.10	1.80	49.00	<1.0	0.046	20.00	26.00	0.19	<0.20	19.54	187.0	6.70	--	44.5	*	
MW-14	12/31/2014	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	
MW-14	1/23/2015	29.14	1.00	2.20	6.20	<1.0	<0.020	13.00	29.00	0.14	<0.20	17.58	385.0	6.86	503	187.0	10.3	
MW-14	2/20/2015	23.19	1.90	1.90	21.00	<1.0	<0.020	12.00	23.00	0.19	<0.20	17.78	617.0	6.82	246	191.0	5.99	
MW-14	6/12/2015	34.10	1.80	2.70	<1.0	<1.0	<0.020	11.00	28.00	6.10	<0.20	25.76	0.0	--	9.53	8.0	6.18	
MW-14	8/10/2015	27.30	1.70	2.50	<1.0	<1.0	0.031	11.00	21.00	6.30	<0.20	19.15	1.0	7.50	10.7	28.0	8.84	
MW-15	6/26/2014	54.00	0.77	5.20	<0.20	<0.20	<0.10	3.90	54.00	<0.10	<0.03	19.00	260.1	6.87	--	-76.1	*	
MW-15	12/5/2014	1.30	0.36	<1.0	<1.0	<1.0	0.095	5.50	<0.10	1.30	<0.20	19.95	250.0	7.32	--	-59.0	*	
MW-15	12/31/2014	0.78	0.22	<1.0	<1.0	<1.0	0.082	5.30	<0.10	0.78	<0.20	19.93	208.0	5.38	24.2	-41.0	7.82	
MW-15	1/23/2015	29.80	0.58	3.30	<1.0	<1.0	0.035	16.00	26.00	3.80	<0.20	19.89	329.0	7.09	932	-3.0	7.65	
MW-15	2/20/2015	28.60	0.60	3.30	<1.0	<1.0	0.029	23.00	25.00	3.60	<0.20	19.81	425.0	6.99	551	8.0	5.02	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
MW-15	6/12/2015	55.40	0.80	5.00	4.30	4.30	<0.020	42.00	54.00	1.40	<0.20	20.88	299.0	--	575	119.0	3.12	
MW-15	8/10/2015	46.00	0.72	5.30	13.00	1.60	0.036	50.00	45.00	0.77	<0.20	21.39	600.0	6.69	0	100.0	5.62	
MW-16	6/26/2014	<0.5	<0.5	<0.5	<0.20	<0.20	<0.10	3.10	<0.5	<0.10	<0.03	18.30	401.5	6.68	--	-70.7	*	
MW-16	12/5/2014	2.64	0.30	<1.0	<1.0	<1.0	0.037	6.50	2.50	0.14	<0.20	19.01	330.0	7.30	--	9.0	*	
MW-16	12/31/2014	2.15	0.29	<1.0	<1.0	<1.0	0.038	8.10	1.60	0.55	<0.20	16.51	272.0	5.06	309	58.0	8.25	
MW-16	1/23/2015	5.49	0.27	<1.0	<1.0	<1.0	<0.020	9.50	5.30	0.19	<0.20	18.11	300.0	6.77	202	133.0	10.10	
MW-16	2/20/2015	4.86	0.31	<1.0	<1.0	<1.0	<0.020	10.00	4.70	0.16	<0.20	17.77	337.0	6.82	88.9	102.0	3.66	
MW-16	6/12/2015	3.44	0.29	<1.0	<1.0	<1.0	0.040	10.00	3.30	0.14	<0.20	19.37	312.0	6.84 ¹	90.6	130.0	2.95	
MW-16	8/10/2015	2.50	0.21	<1.0	1.40	<1.0	0.040	9.70	2.50	<0.10	<0.20	19.72	287.0	5.98	68.8	149.0	5.02	
EW-14	6/25/2014	6.20	1.00	3.20	<0.20	<0.20	<0.10	4.00	6.20	<0.10	0.54	19.3	1,258.0	6.98	--	-122.8	*	
EW-15	6/25/2014	21.00	2.90	1.60	<0.20	<0.20	<0.10	<2.0	21.00	<0.10	<0.15	19.3	870.0	6.81	--	-96.1	*	
EW-16	6/26/2014	3.50	1.40	0.77	<0.20	<0.20	15.00	19.00	3.50	<0.10	<0.15	20.1	916.0	6.80	--	-89.3	*	
EW-17	6/25/2014	31.00	1.60	0.75	<0.20	<0.20	<0.10	3.40	31.00	<0.10	0.34	19.5	1,494.0	7.09	--	-119.0	*	
EW-18	6/25/2014	73.00	2.90	9.50	<0.20	<0.20	<0.10	<2.0	73.00	<0.10	0.30	21.2	870.0	6.82	--	-101.4	*	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0				Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)											Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia							
EW-19	6/25/2014	43.00	3.30	7.10	<0.20	<0.20	0.17	<2.0	43.00	<0.10	0.50	20.5	926.0	6.66	--	-91.1	*	
EW-20	6/25/2014	110.00	2.60	9.10	0.22	<0.20	0.14	7.00	110.00	<0.10	0.36	21.0	750.0	6.85	--	-107.2	*	
EW-21	6/26/2014	1.60	<0.5	6.10	6.10	<0.20	<0.10	15.00	1.60	<0.10	<0.03	20.0	422.2	6.90	--	10.0	*	
EW-22	6/26/2014	23.00	<0.5	3.60	0.47	<0.20	<0.10	8.60	23.00	<0.10	0.03	18.8	173.7	6.63	--	141.3	*	

TABLE 5 – BIOATTENUATION MONITORING

Sample ID	Sample Date	EPA 200.7			EPA Method 300.0			Ferric Iron by Calculation	SM 3500-Fe D	SM 4500-NH3 D	Field Instrument						
		(mg/l)										Temperature (°C)	Conductivity (µs/cm)	pH	Turbidity (NTU)	ORP (mV)	Dissolved Oxygen* mg/L
		Iron	Manganese	Potassium	Nitrate	Nitrite	Phosphate	Sulfate	Ferric Iron	Ferrous Iron	Nitrogen, Ammonia						

Notes:

ID – identification

EPA – United States Environmental Protection Agency

mg/l – milligrams per liter

SM – Standard Method

°C - degrees centigrade

µs/cm – microsiemens

NTU - nephelometric turbidity units

ORP – oxidation-reduction potential

mV – millivolts

% - percent


<X - not detected at or above the laboratory reporting limit of X

1 - pH readings taken on 6/22/15 and not on sample date.


-- – Not analyzed or not applicable

*- Dissolved oxygen content was mistakenly measured in percent (%) during the 6/25/14 and 6/26/14 sampling event as well as the 12/4/14 and 12/5/14 sampling event. These results are hidden to avoid confusion. Samples taken on and after 12/30/2014 are measured in mg/L

Graph 1 - TPHg Concentrations in Groundwater

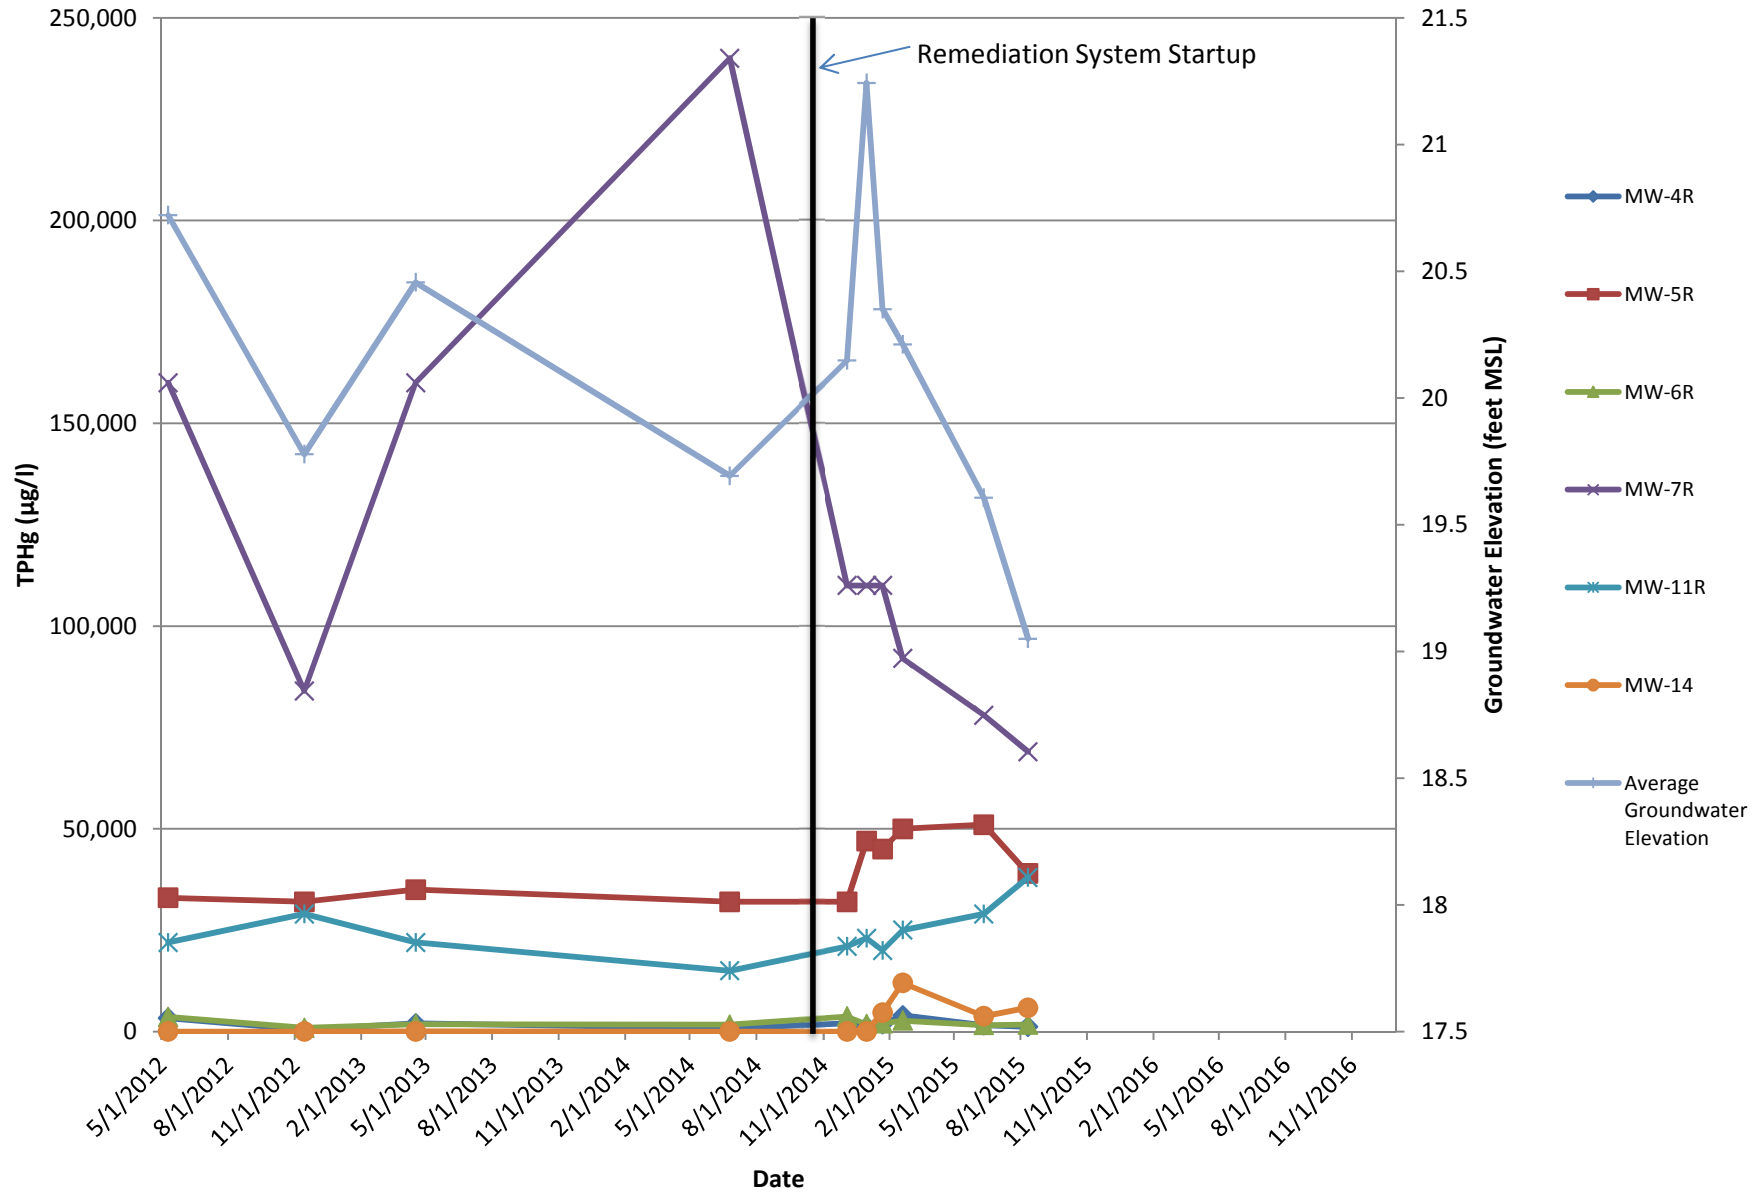

Graph 2 - Benzene Concentrations in Groundwater

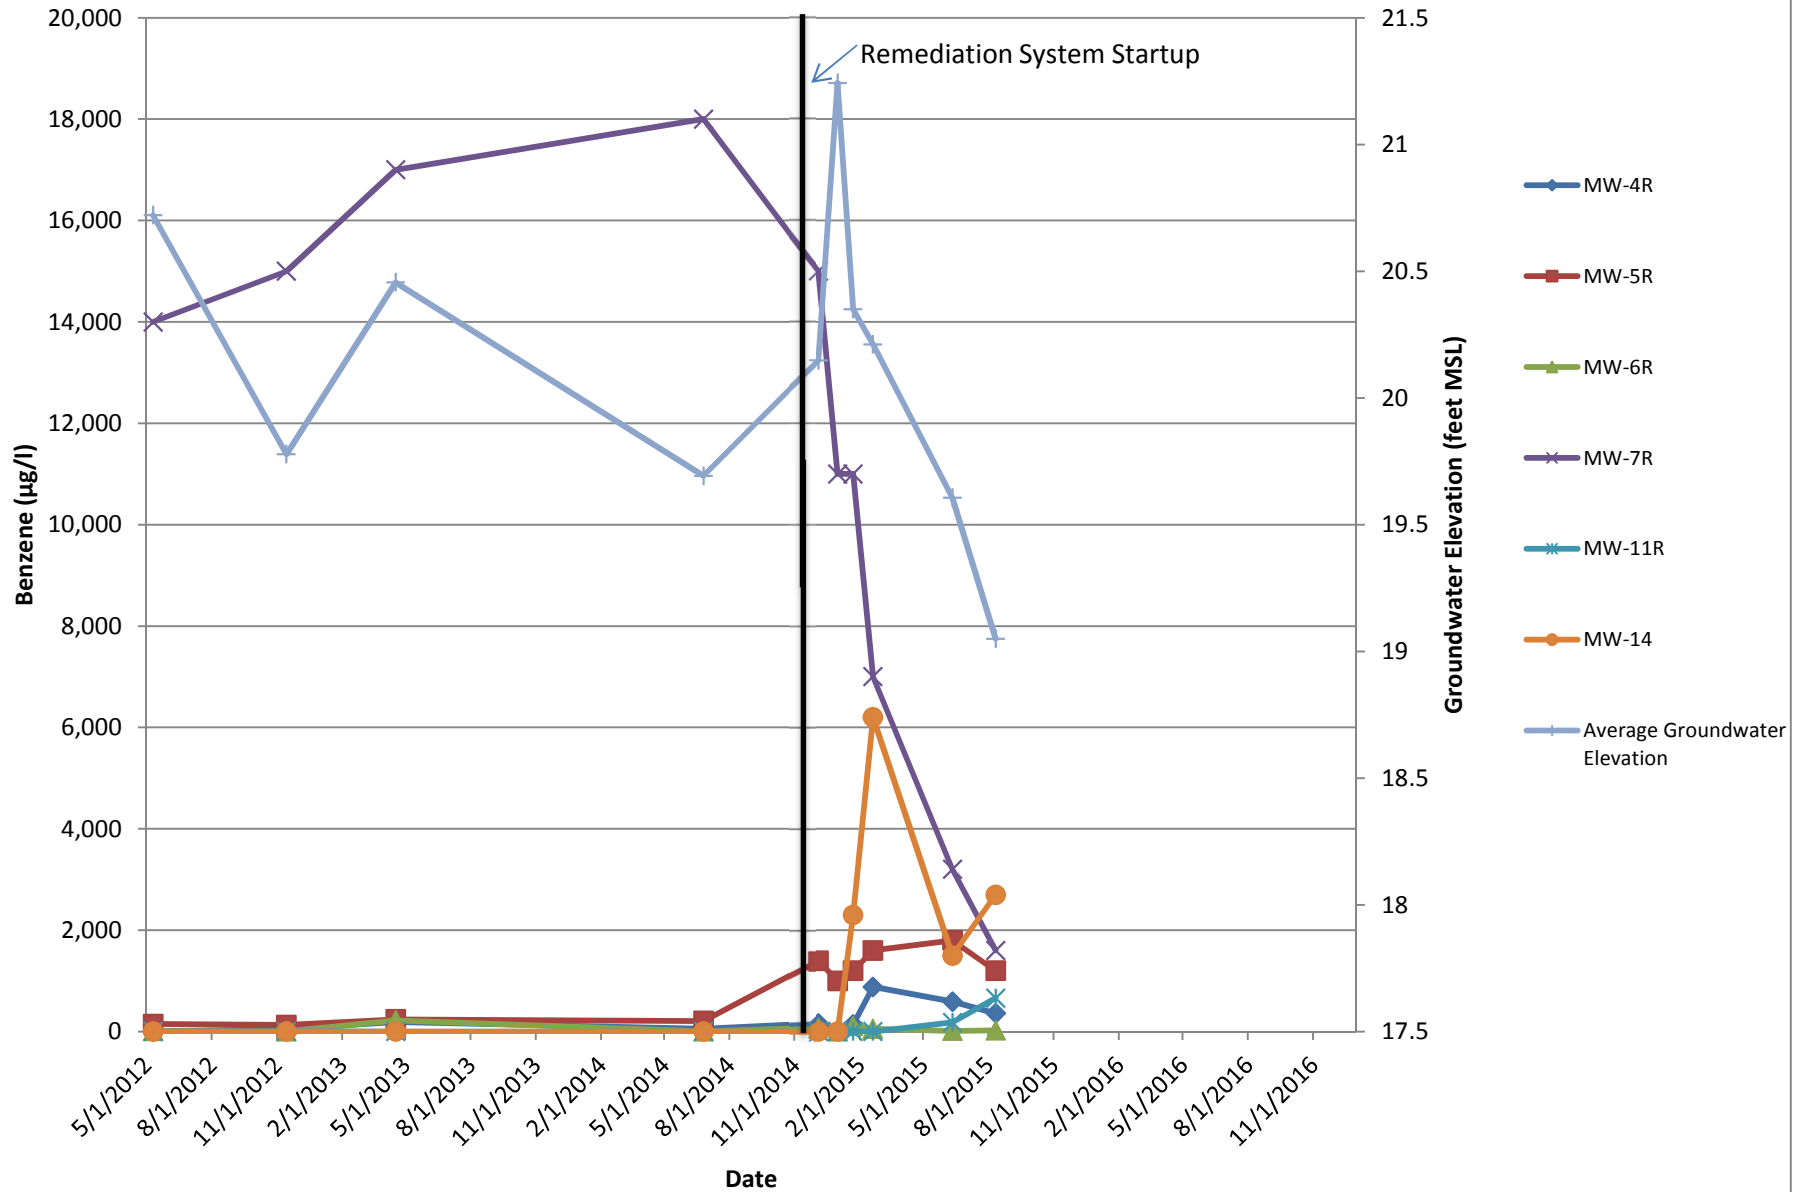



REFERENCE: METRO AREAS OF ALAMEDA, CONTRA COSTA, MARIN, SAN FRANCISCO, SAN MATEO, AND SANTA CLARA COUNTIES, THOMAS GUIDE, 2008.



SCALE IN FEET



NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

Ninyo & Moore

SITE LOCATION

FIGURE

PROJECT NO.	DATE
401896004	11/15

2301 SANTA CLARA AVENUE
ALAMEDA, CALIFORNIA

1


401896004-FIG1.dwg, Nov. 06, 2015, 1:02pm, snguyen



REFERENCE: GOOGLE EARTH, 2012.



SCALE IN FEET





NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

LEGEND

APPROXIMATE SITE BOUNDARY

481896004-FIG2.dwg, Nov. 06, 2015, 1:03pm, snguyen

<i>Ninyo & Moore</i>		SITE VICINITY	FIGURE
PROJECT NO.	DATE	2301 SANTA CLARA AVENUE ALAMEDA, CALIFORNIA	2
401896004	11/15		

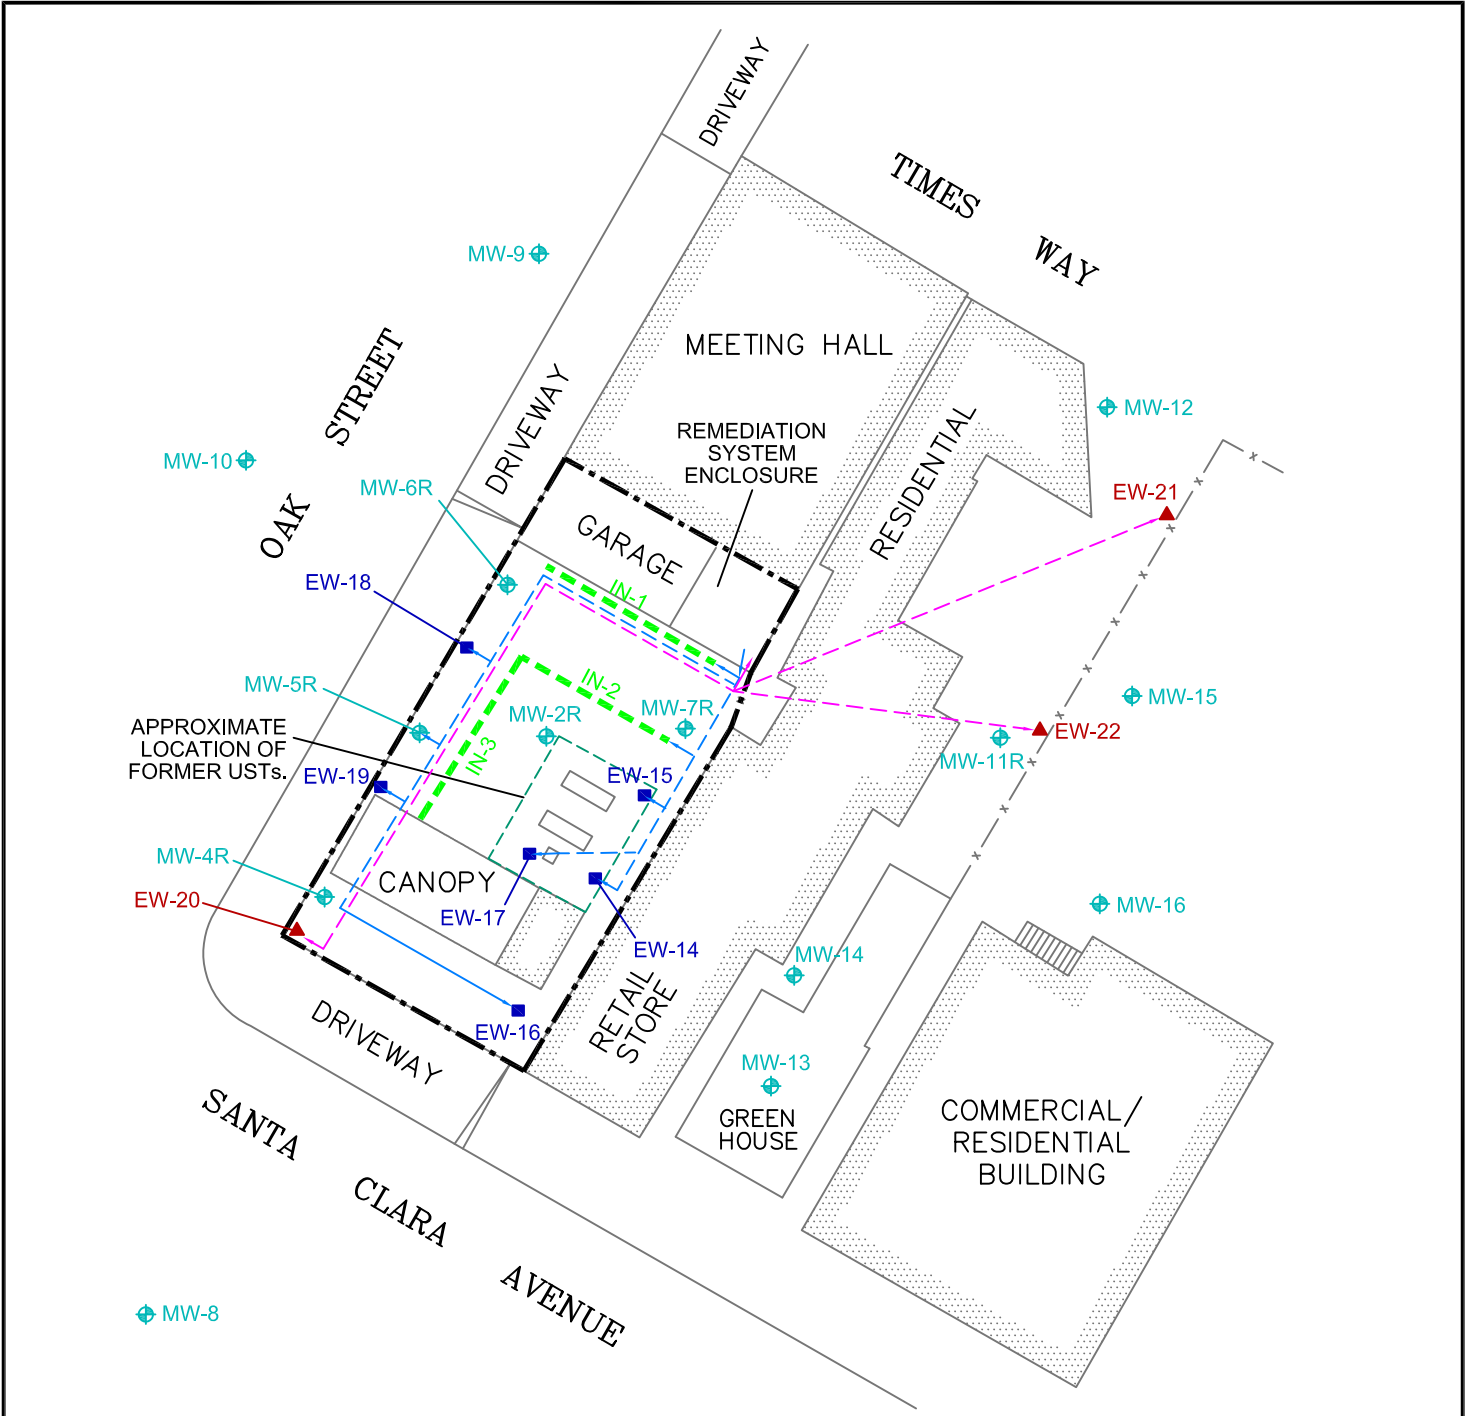


NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

LEGEND	
	APPROXIMATE SITE BOUNDARY
	FENCE
	EXTRACTION WATER SUPPLY LINE AND POWER CONDUIT
	INJECTION WATER SUPPLY LINE
	SLOTTED HORIZONTAL INJECTION PIPING
	GROUNDWATER MONITORING WELL
	GROUNDWATER EXTRACTION WELL
	GROUNDWATER INJECTION WELL

REFERENCE: VIRGIL CHAVEZ LAND SURVEYING, 2012.


		SITE PLAN 2301 SANTA CLARA AVENUE ALAMEDA, CALIFORNIA		FIGURE 3
401896004	11/15			

401896004-FIG3.dwg, Nov. 06, 2015, 1:04pm, snguyen

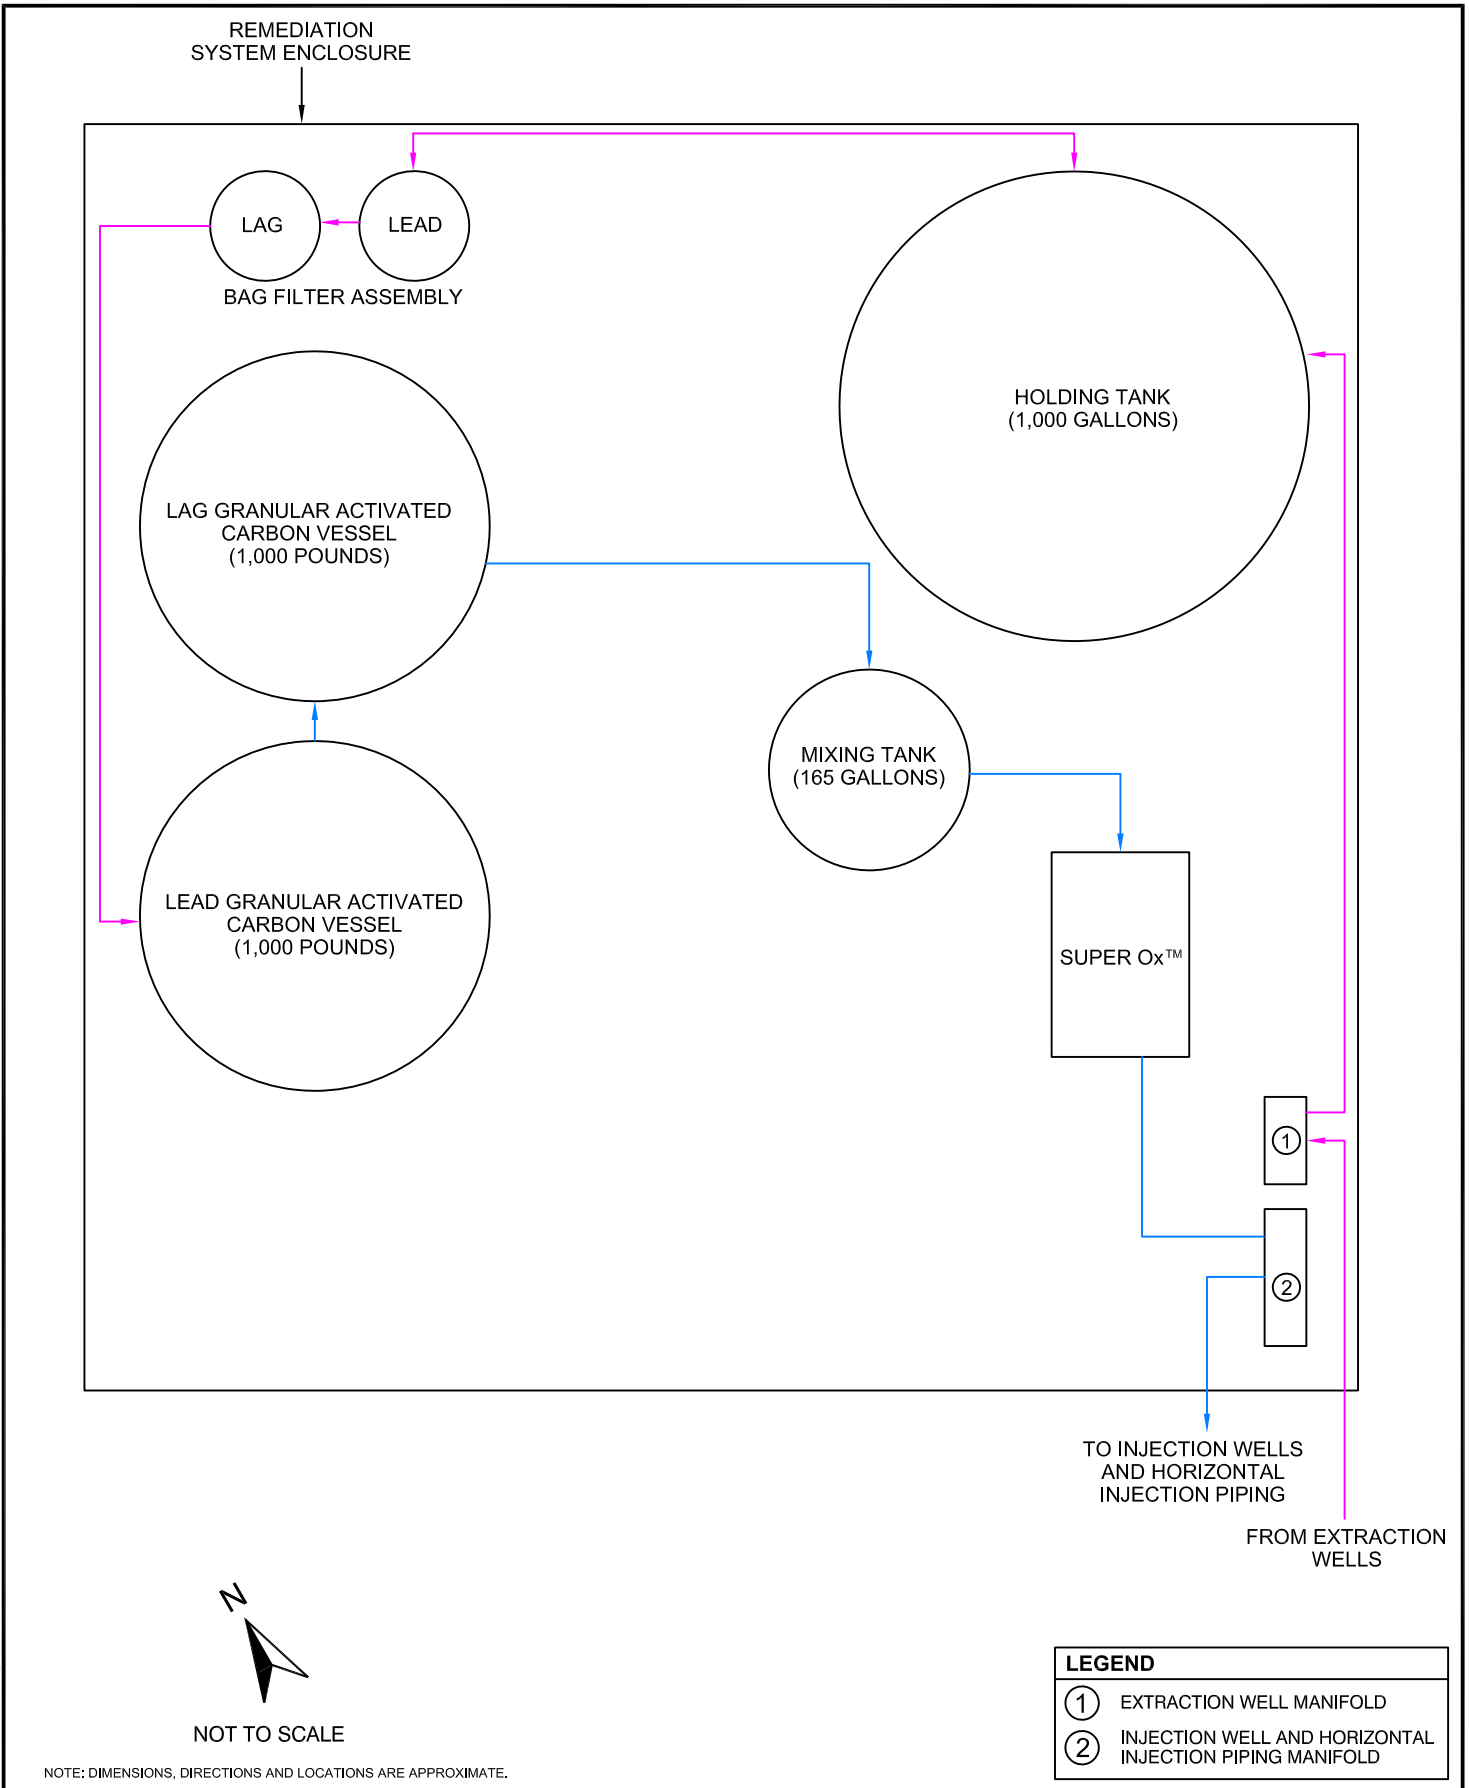

401896004-FIG4.dwg, Nov. 06, 2015, 1:04pm, snguyenv

		REMEDIAL SYSTEM PLAN		FIGURE 4

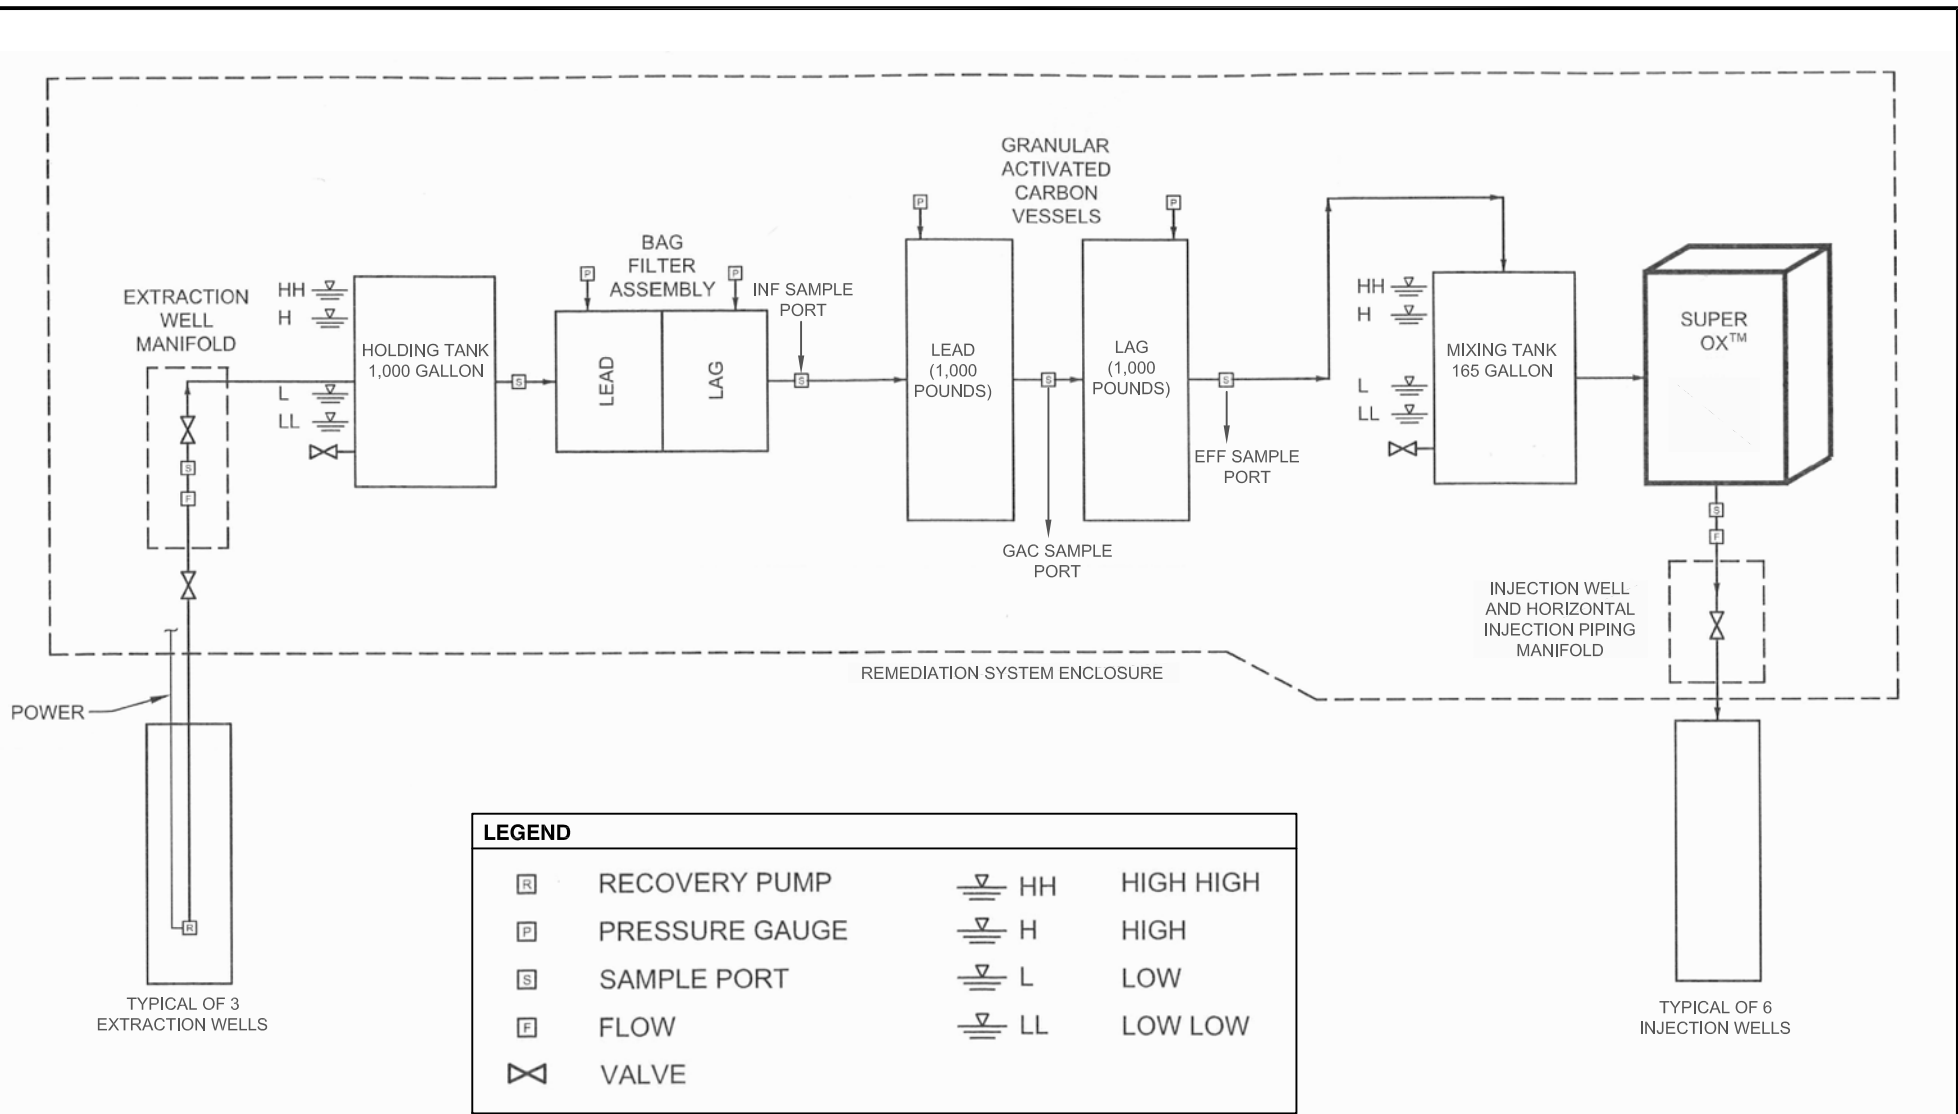

REFERENCE: KENNEDY/JENKS CONSULTANTS, FIGURE 12, JANUARY 2010.

Ninyo & Moore

REMEDATION SYSTEM SCHEMATIC

FIGURE

NOT TO SCALE

PROJECT NO.

DATE


2301 SANTA CLARA AVENUE
ALAMEDA, CALIFORNIA

401896004

11/15

5

NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

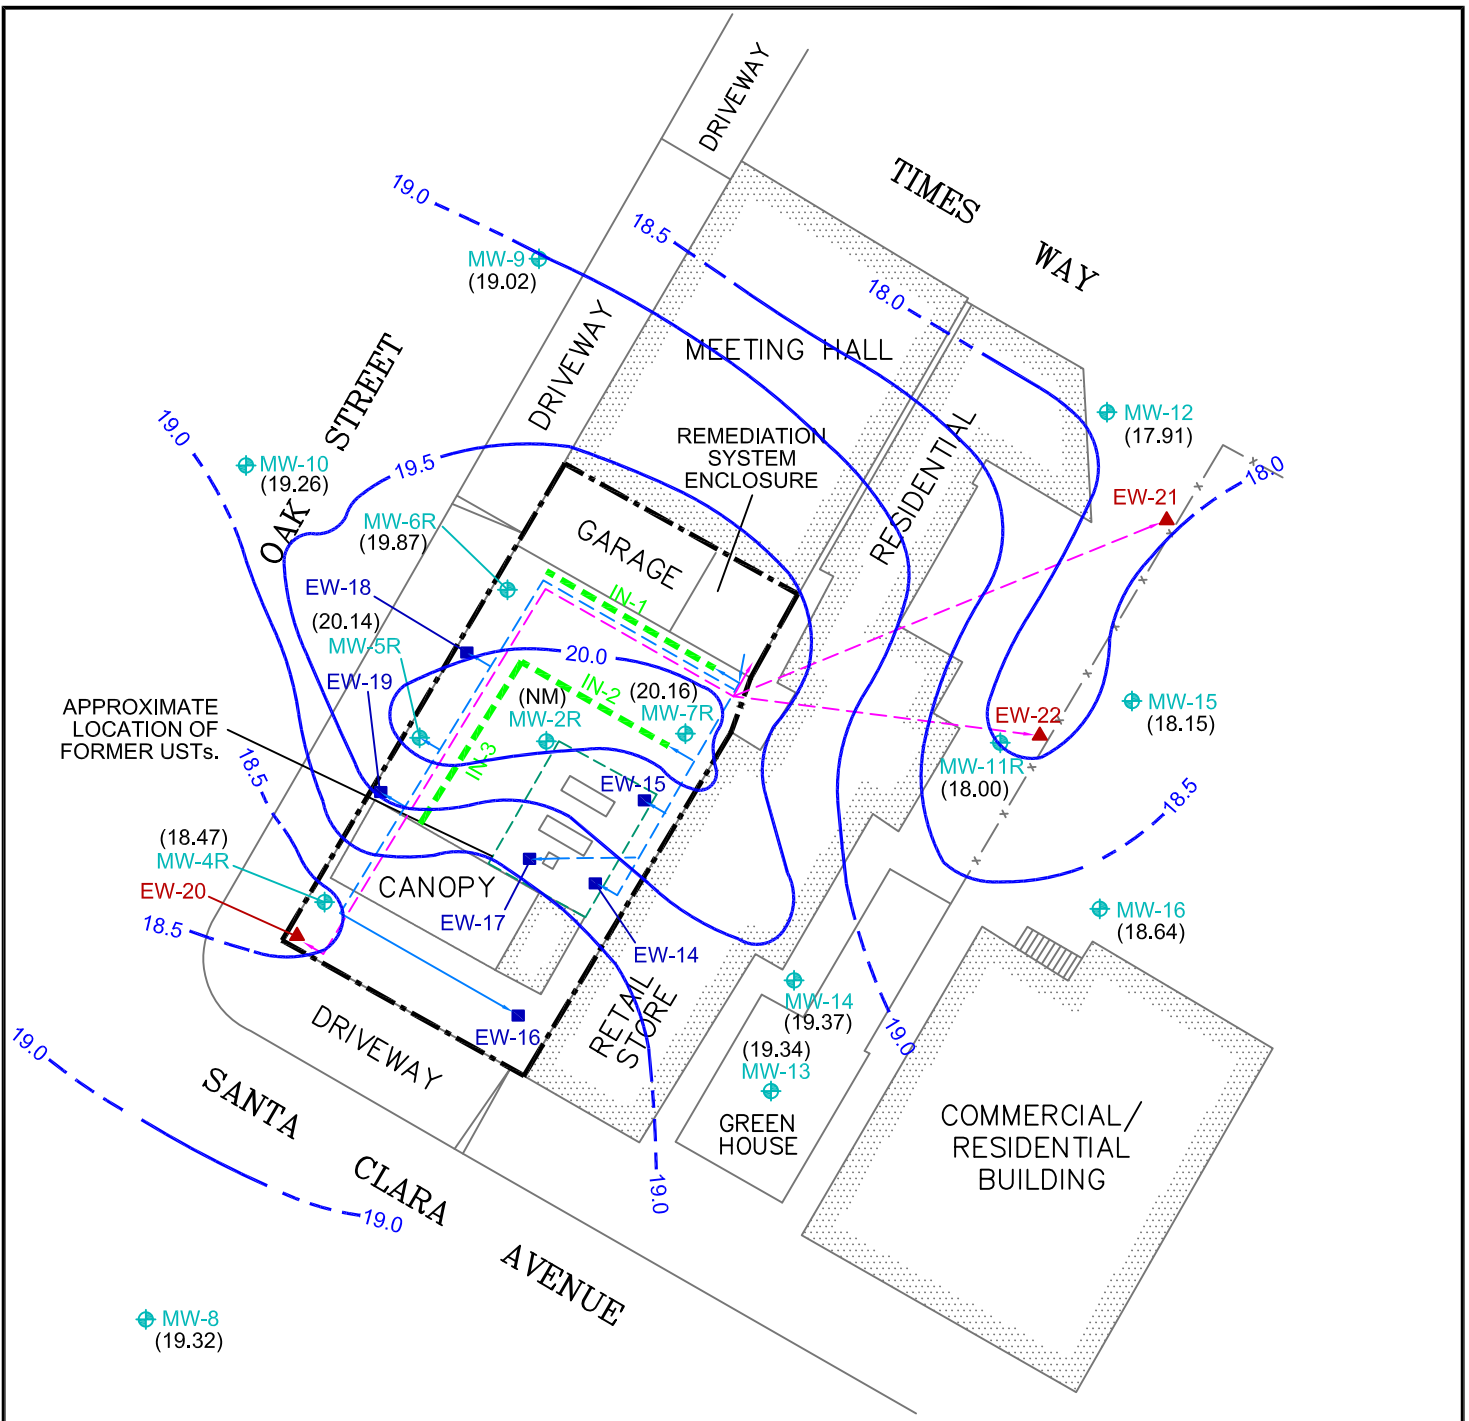


APPROXIMATE LOCATION OF FORMER USTs.

MW-8 (19.32)



SCALE IN FEET




NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

LEGEND	
	APPROXIMATE SITE BOUNDARY
	FENCE
	EXTRACTION WATER SUPPLY LINE AND POWER CONDUIT
	INJECTION WATER SUPPLY LINE
	SLOTTED HORIZONTAL INJECTION PIPING CONTOUR
	CONTOUR
	MW-16 GROUNDWATER MONITORING WELL
	EW-22 GROUNDWATER EXTRACTION WELL
	EW-19 GROUNDWATER INJECTION WELL

REFERENCE: VIRGIL CHAVEZ LAND SURVEYING, 2012.

		GROUNDWATER ELEVATION CONTOUR 8/10/15 - 8/11/15		FIGURE 6
		2301 SANTA CLARA AVENUE ALAMEDA, CALIFORNIA		

401896004-F1G6.dwg, Nov. 06, 2015, 1:20pm, snguyen

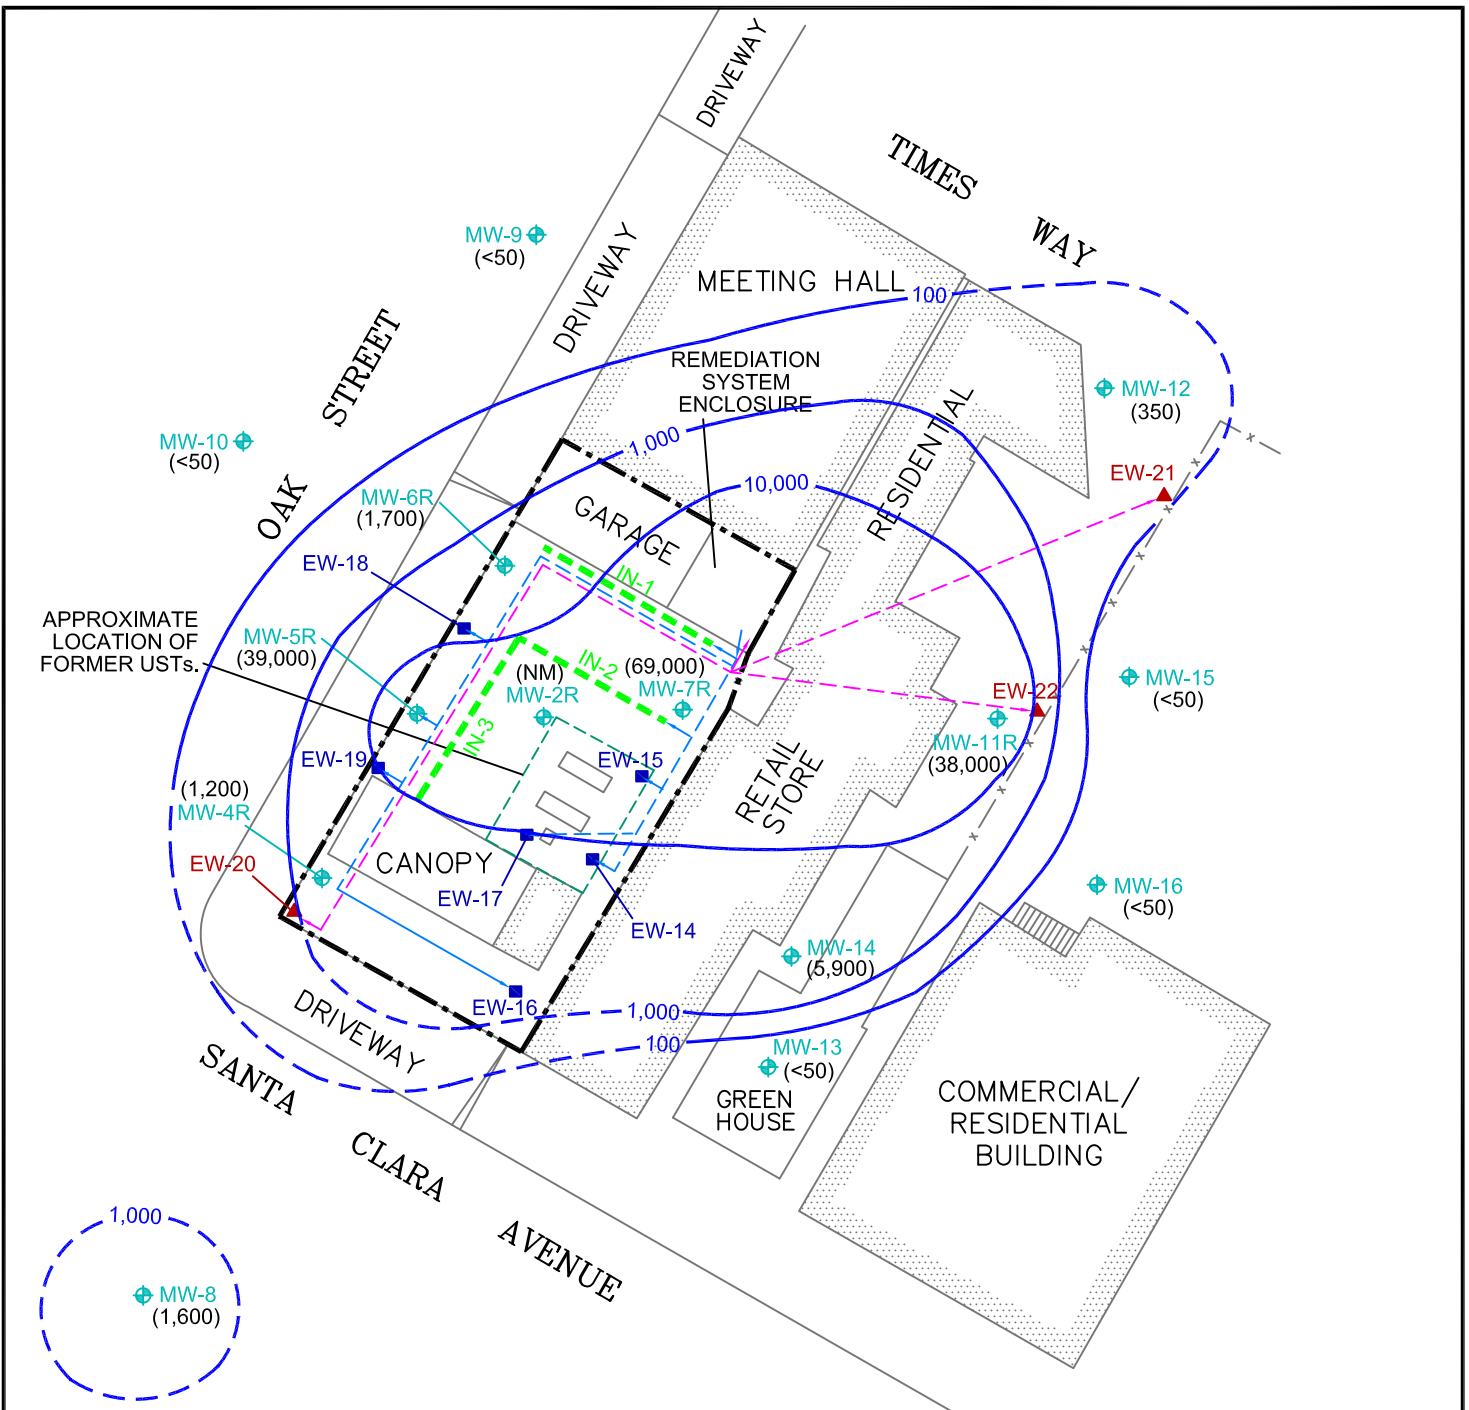


LEGEND	
	APPROXIMATE SITE BOUNDARY
	FENCE
	EXTRACTION WATER SUPPLY LINE AND POWER CONDUIT
	INJECTION WATER SUPPLY LINE
	SLOTTED HORIZONTAL INJECTION PIPING CONTOUR
	CONTOUR
	GROUNDWATER MONITORING WELL
	GROUNDWATER EXTRACTION WELL
	GROUNDWATER INJECTION WELL

NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.


REFERENCE: VIRGIL CHAVEZ LAND SURVEYING, 2012.

		TOTAL PETROLEUM HYDROCARBONS AS GASOLINE CONCENTRATIONS IN GROUNDWATER 8/10/15 - 8/11/15		FIGURE 7
PROJECT NO.	DATE			
401896004	11/15			

401896004-FIG7.dwg, Nov. 06, 2015, 1:44pm, snguyen

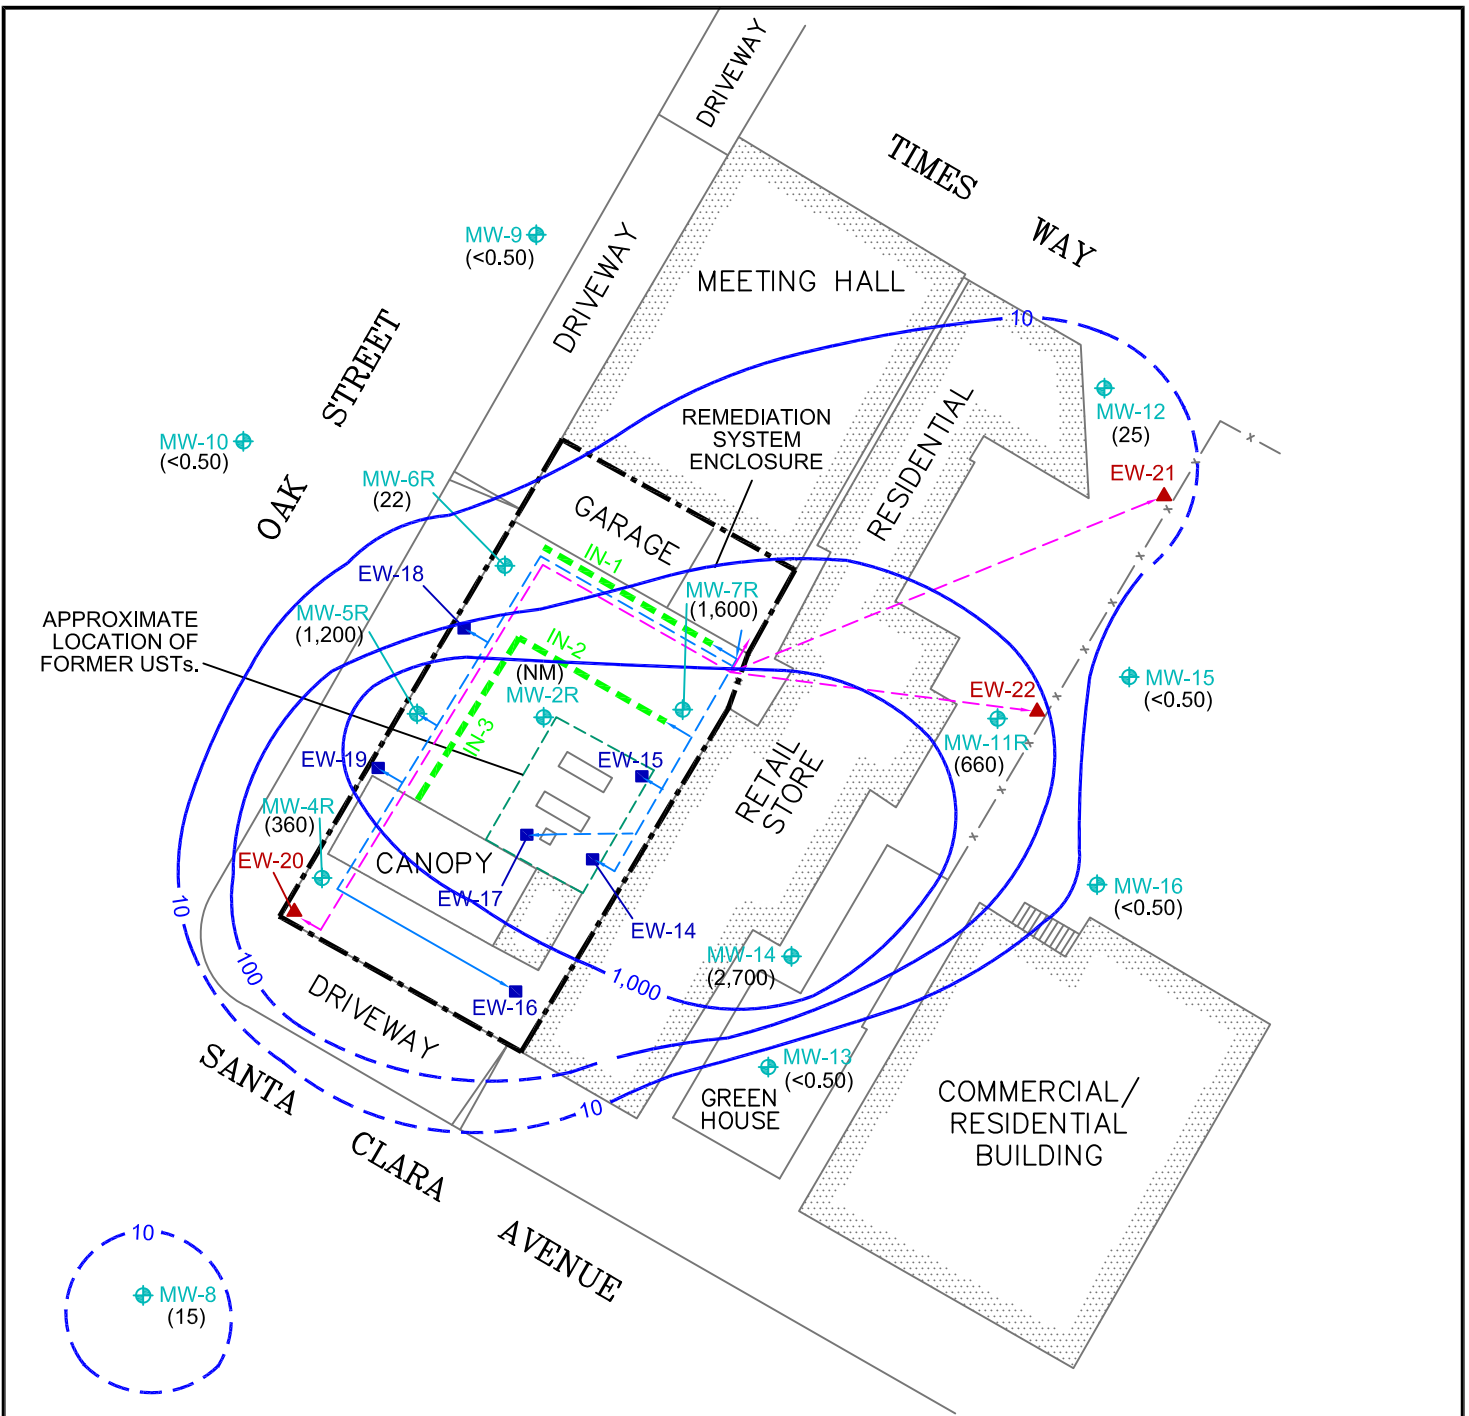

LEGEND	
	APPROXIMATE SITE BOUNDARY
	FENCE
	EXTRACTION WATER SUPPLY LINE AND POWER CONDUIT
	INJECTION WATER SUPPLY LINE
	SLOTTED HORIZONTAL INJECTION PIPING CONTOUR
	CONTOUR
	GROUNDWATER MONITORING WELL
	GROUNDWATER EXTRACTION WELL
	GROUNDWATER INJECTION WELL

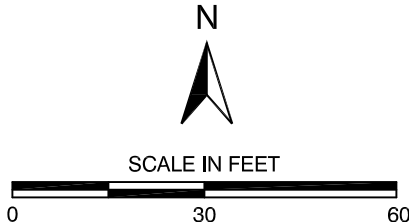

NOTE: DIMENSIONS, DIRECTIONS AND LOCATIONS ARE APPROXIMATE.

REFERENCE: VIRGIL CHAVEZ LAND SURVEYING, 2012.

		BENZENE CONCENTRATIONS IN GROUNDWATER 8/10/15 - 8/11/15		FIGURE 8
		2301 SANTA CLARA AVENUE ALAMEDA, CALIFORNIA		
PROJECT NO.	DATE			
401896004	11/15			

401896004-FI08.dwg, Nov. 06, 2015, 1:44pm, snguyen

APPENDIX A

HISTORICAL CONSTITUENTS OF CONCERN CONCENTRATIONS

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-1
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	E ₂ BE	M ₂ BE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
9/17/2000	65,000	15,000	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	43,000	7,200													
9/20/2003	19,000	4,900													
12/25/2003	12,000	3,400													
4/24/2004	33,000	8,000													
8/8/2004	29,000	9,700													
8/20/2005	35,000	14,000	6,500	1,600	5,000	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA
3/13/2006	72,000	17,000	16,000	3,000	10,400	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA
6/11/2006	65,000	21,000	16,000	2,900	9,900	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA
9/5/2006	62,000	17,000	12,000	2,300	8,600	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA
1/4/2007	46,000	6,500	4,200	980	4,890	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA
7/8/2007	57,000	11,000	11,000	2,200	9,600	ND	ND	ND	ND	ND	ND	ND	600	340	1,400
9/23/2007	22,000	4,700	4,100	950	4,100	ND	ND	ND	ND	ND	ND	2.7	390	140	640
9/6/2008	8,300	2,300	740	160	700	ND	ND	ND	ND	ND	ND	ND	200	34	130
9/26/2009	4,100	1,600	310	150	610	ND	ND	ND	ND	ND	ND	ND	75	32	120
2/27/2010	1,600	1,200	110	9.2	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/21/2010	3,100	1,300	54	ND	640	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	12,000	5,200	1,700	270	1,790	ND	ND	ND	ND	ND	ND	ND	230	68	230

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was abandoned in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-2
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	140,000	21,000	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	41,000	5,600													
9/21/2003	27,000	2,400													
12/25/2003	46,000	6,100													
4/24/2004	44,000	8,400													
8/8/2004	21,000	6,800													
8/20/2005	31,000	10,000	5,100	1,400	7,100	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/13/2006	50,000	15,000	5,200	970	4,400	ND	ND	ND	ND	ND	ND	ND			
6/11/2006	37,000	12,000	8,500	1,700	6,200	ND	ND	ND	ND	ND	ND	ND			
9/5/2006	24,000	8,100	1,400	840	3,090	ND	ND	ND	ND	ND	ND	ND			
1/4/2007	17,000	4,300	2,400	590	2,100	ND	ND	ND	ND	ND	ND	ND			
7/8/2007	ND	5,400	170	320	750	ND	ND	ND	ND	ND	ND	ND			
9/23/2007	2,500	6,700	540	300	940	ND	ND	ND	3.3	ND	ND	6.6	310	97	260
9/6/2008	6,300	3,000	440	10	290	ND	ND	ND	ND	ND	ND	ND	120	22	12
9/26/2009	5,500	1,800	610	140	680	ND	ND	ND	ND	ND	ND	ND	90	52	180
2/27/2010	3,600	2,500	430	42	6.4	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/21/2010	4,700	1,500	550	ND	860	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	11,000	6,300	790	ND	1,230	ND	ND	ND	ND	ND	ND	ND	210	69	170

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-2R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-3
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	9,300	3,000	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	10,000	2,300													
9/21/2003	2,700	320													
12/25/2003	3,300	290													
4/24/2004	3,100	1,000													
8/8/2004	2,500	400													
8/20/2005	5,500	3,000	27	140	740	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/13/2006	6,400	2,100	19	150	530	ND	ND	ND	ND	ND	ND	ND			
6/11/2006	7,000	2,000	52	380	940	ND	ND	ND	31	ND	ND	ND			
9/5/2006	6,000	1,500	31	180	720	ND	ND	ND	27	ND	ND	ND			
1/4/2007	5,500	1,400	ND	77	297	ND	ND	ND	ND	ND	ND	ND			
7/8/2007	5,600	1,500	87	180	740	ND	ND	ND	38	ND	ND	ND			
9/22/2007	5,600	1,300	35	57	189	ND	ND	ND	28	ND	ND	ND	120	8.6	30
9/6/2008	2,600	500	13	19	125	ND	ND	ND	20	ND	ND	ND	33	4.1	11
9/26/2009	2,200	240	12	14	104	ND	ND	ND	4.6	ND	ND	ND	69	3.0	11
2/27/2010	7,270	120	5.4	7.9	44	ND	ND	ND	4.6	ND	ND	ND	38	1.3	2.1
8/21/2010	100	ND	ND	ND	4.6	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	1,100	120	2.4	2.4	88	ND	ND	ND	ND	ND	ND	ND	54	7.2	7.2

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was abandoned in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-4
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	ND	ND	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	ND	ND													
9/20/2003	ND	ND													
12/25/2003	ND	ND													
4/24/2004	3,000	1.0													
8/8/2004	ND	ND													
8/20/2005	1,100	1.5	ND	ND	63	ND	ND	ND	ND	ND	ND	ND			
3/13/2006	320	ND	ND	1.4	17	ND	ND	ND	ND	ND	ND	ND			
6/12/2006	1,500	0.9	3.8	78	236	ND	ND	ND	ND	ND	ND	ND			
9/5/2006	760	ND	ND	1.6	60	ND	ND	ND	ND	ND	ND	ND			
1/4/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND			
7/8/2007	ND	ND	ND	ND	1.2	ND	ND	ND	ND	ND	ND	ND	13	ND	ND
9/23/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2008	170	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/26/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	3.7	ND	2.6
2/27/2010	130	ND	0.6	3.6	27	ND	ND	ND	ND	ND	ND	ND	ND	1.8	3.2
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-4R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-5
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	44,000	490	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	16,000	89													
9/21/2003	8,700	ND													
12/25/2003	2,300	140													
4/24/2004	13,000	97													
8/8/2004	13,000	82													
8/20/2005	19,000	130	750	1,000	4,400	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/14/2006	21,000	61	350	700	3,330	ND	ND	ND	ND	ND	ND	ND			
6/12/2006	14,000	91	620	1,000	4,340	ND	ND	ND	ND	ND	ND	ND			
9/5/2006	15,000	56	550	890	3,910	ND	ND	ND	ND	ND	ND	ND			
1/4/2007	20,000	110	680	1,200	4,250	ND	ND	ND	ND	ND	ND	ND			
7/8/2007	23,000	72	1,200	ND	5,300	ND	ND	ND	ND	ND	ND	ND			
9/24/2007	6,100	490	770	950	4,140	ND	ND	ND	ND	ND	ND	ND	360	250	1,300
9/5/2008	740	ND	1.1	0.8	22	ND	ND	ND	ND	ND	ND	ND	27	22	1.2
9/27/2009	4,000	7.9	47	120	670	ND	ND	ND	ND	ND	ND	ND	86	86	370
2/27/2010	2,100	5.8	34	86	400	ND	ND	ND	ND	ND	ND	ND	92	26	130
8/20/2010	840	0.7	0.5	ND	162	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	2,500	6.8	32	13	431	ND	ND	ND	ND	ND	ND	ND	93	45	69

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-5R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-6
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	10,000	110	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	3,900	29													
9/20/2003	500	15													
12/25/2003	1,200	18													
4/24/2004	110	3.6													
8/8/2004	320	2.7													
8/20/2005	810	ND	ND	ND	180	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
6/12/2006	9,140	3.3	13	46	173	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2006	1,100	4.4	10	50	190	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1/4/2007	390	2.0	14	23	85	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/8/2007	720	2.8	3.2	33	42	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/23/2007	1,200	2.8	7.3	56	142	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2008	730	2.0	4.0	16	116	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/26/2009	170	0.7	ND	ND	1.8	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/27/2010	230	1.3	1.0	5.8	18	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/21/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4/21/2011	360	1.2	1.6	ND	9.4	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-6R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-7
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	220,000	32,000	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/4/2002	140,000	15,000													
9/21/2003	110,000	4,200													
12/25/2003	110,000	12,000													
4/24/2004	100,000	10,000													
8/8/2004	92,000	9,300													

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-7R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-8
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	ND	1.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/3/2002	ND	1.1													
9/20/2003	ND	ND													
12/25/2003	ND	ND													
4/24/2004	ND	ND													
8/8/2004	NA	NA													
8/22/2005	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
6/12/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/6/2006	ND	1.4	0.7	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1/6/2007	390	4.4	4.7	0.9	5.6	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/21/2007	ND	2.0	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2008	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/26/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-9
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	ND	ND	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/3/2002	ND	ND													
9/20/2003	ND	ND													
12/25/2003	ND	ND													
4/24/2004	ND	ND													
8/22/2005	ND	ND													
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
6/13/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/7/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1/6/2007	ND	ND	1.5	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/21/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2008	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/26/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-10
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/17/2000	ND	ND	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
7/3/2002	ND	ND													
9/20/2003	ND	ND													
12/25/2003	ND	ND													
4/24/2004	ND	ND													
8/22/2004	ND	ND													
8/22/2005	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
6/13/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/7/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1/6/2007	ND	ND	1.2	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/21/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/5/2008	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/26/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-11
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
10/24/2002	59,000	5,100	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9/22/2003	46,000	1,700													
12/25/2003	14,000	1,400													
4/24/2004	38,000	5,000													
8/8/2004	29,000	3,100													
8/20/2005	31,000	5,100	1,500	3,400	17,800	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/14/2006	47,000	5,600	2,400	1,900	10,100	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
6/12/2006	44,000	5,900	2,200	3,600	15,700	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
9/6/2006	36,000	5,900	2,100	3,000	16,000	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
1/5/2007	50,000	2,200	450.0	2,100	13,300	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
7/7/2007	54,000	2,800	1,200.0	3,100	16,400	ND	ND	ND	ND	ND	ND	ND	610	750	2900
9/22/2007	21,000	2,000	1,000	3,100	9,700	ND	ND	ND	ND	ND	ND	ND	490	310	2,700
9/5/2008	11,000	770	160	940	3,100	ND	ND	ND	ND	ND	ND	ND	440	160	1,300
9/26/2009	14,000	280	2,900	560	4,800	ND	ND	ND	ND	ND	ND	ND	150	170	690
2/27/2010	13,000	53	860	700	4,900	ND	ND	ND	ND	ND	ND	ND	180	150	670
8/20/2010	57,000	ND	97	190	2,120	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/22/2011	19,000	ND	29	30	6,500	ND	ND	ND	ND	ND	ND	ND	410	380	1,500

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was replaced with well MW-11R in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-12 (formerly BL)
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/22/2005	ND	17	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/14/2006	400	110	ND	ND	ND	ND	ND	ND	ND	ND	ND	11			
6/12/2006	ND	6.8	ND	ND	ND	ND	ND	ND	2.2	ND	ND	2.9			
9/7/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND			
1/5/2007	ND	ND	1.4	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	0.92	ND	ND	ND	ND	ND	ND
9/22/2007	ND	8.6	ND	ND	ND	ND	ND	ND	2.8	ND	ND	3.5	ND	ND	ND
9/4/2008	ND	ND	ND	ND	ND	ND	21	ND	3.6	ND	ND	5.0	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/27/2010	ND	1.0	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

**HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-13 (formerly BG)
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS**

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/22/2005	100	5.9	ND	ND	ND	ND	ND	ND	13	ND	ND	39	NA	NA	NA
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	3.7			
6/12/2006	110	7.6	ND	ND	ND	ND	31	ND	16	ND	ND	48			
9/7/2006	ND	3.3	ND	ND	ND	ND	ND	ND	20	ND	ND	40			
1/5/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	40			
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	13	ND	ND	30	ND	ND	ND
9/22/2007	ND	ND	ND	ND	ND	ND	ND	ND	21	ND	ND	37	ND	ND	ND
9/5/2008	ND	ND	ND	ND	ND	ND	ND	ND	12	ND	ND	31	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	2.2	ND	ND	6.2	ND	ND	ND
2/28/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	2.5	NA	NA	NA
4/22/2011	ND	ND	ND	ND	ND	ND	ND	ND	2.5	ND	ND	6.8	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-14 (formerly BF)
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/20/2005	3,800	89	4.7	150	3.4	ND	80	ND	19	ND	ND	42	NA	NA	NA
3/14/2006	ND	5,300	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND			
6/12/2006	14,000	11,000	ND	600	ND	ND	ND	ND	ND	ND	ND	ND			
9/6/2006	ND	6,500	ND	170	ND	ND	ND	ND	ND	ND	ND	ND			
1/5/2007	13,000	5,200	5.7	190	71	ND	ND	ND	ND	ND	ND	ND	97	48	73
7/7/2007	6,900	3,700	54	550	582	ND	ND	ND	ND	ND	ND	ND	49	22	14
9/22/2007	3,200	2,600	19	310	160	ND	ND	ND	ND	ND	ND	3.9	11	ND	3.2
9/5/2008	690	280	ND	ND	19	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	32	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/28/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/22/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-15 (formerly BH)
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/20/2005	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	31	NA	NA	NA
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	38			
6/12/2006	ND	0.93	ND	ND	ND	ND	130	ND	6.0	ND	ND	55			
9/6/2006	ND	ND	ND	ND	ND	ND	31	ND	3.8	ND	ND	38			
1/5/2007	140	12	44	3.6	19.9	ND	ND	ND	ND	ND	ND	ND			
7/7/2007	ND	ND	ND	ND	ND	ND	90	ND	4.8	ND	ND	60	ND	ND	ND
9/22/2007	ND	ND	ND	ND	ND	ND	29	ND	2.5	ND	ND	27	ND	ND	ND
9/4/2008	ND	1.1	ND	ND	ND	ND	ND	ND	3.0	ND	ND	20	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/26/2010	ND	ND	ND	ND	ND	ND	ND	ND	1.6	ND	ND	3.6	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	1.8	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - MW-16 (formerly BM)
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/20/2005	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	7.0	NA	NA	NA
3/14/2006	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10			
6/12/2006	ND	ND	ND	ND	ND	ND	29	ND	5.0	ND	ND	14			
9/6/2006	ND	ND	ND	ND	ND	ND	12	ND	5.8	ND	ND	4.7			
1/6/2007	ND	ND	ND	ND	ND	ND	ND	ND	4.1	ND	ND	11	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	3.4	ND	ND	4.5	ND	ND	ND
9/22/2007	ND	ND	ND	ND	ND	ND	ND	ND	4.2	ND	ND	6.8	ND	ND	ND
9/4/2008	ND	ND	ND	ND	ND	ND	ND	ND	3.5	ND	ND	9.1	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/27/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-12
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
10/31/2002	5,840	76	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9/21/2003	19,000	590													
12/25/2003	9,900	790													
4/24/2004	12,000	920													

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was abandoned in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-13
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
10/31/2002	109,200	9,120	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
9/21/2003	71,000	10,000													
12/25/2003	110,000	17,000													
4/24/2004	100,000	19,000													
8/8/2004	NA	NA													
8/22/2005	130,000	27,000	5,500	4,200	21,700	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/13/2006	140,000	16,000	46,000	3,300	19,300	ND	ND	ND	ND	ND	ND	1,400			
6/11/2006	130,000	23,000	48,000	3,000	18,800	ND	ND	ND	ND	ND	ND	ND			
9/5/2006	120,000	12,000	40,000	3,200	17,800	ND	ND	ND	ND	ND	ND	ND			
1/5/2007	410,000	57,000	43,000	17,000	75,000	ND	ND	ND	ND	ND	ND	ND			
7/9/2007	140,000	10,000	45,000	4,400	22,800	ND	ND	ND	ND	ND	ND	ND	ND	600	2,200
9/24/2007	27,000	5,400	35,000	3,600	18,600	ND	ND	ND	ND	ND	ND	ND	410	280	1,700
9/6/2008	73,000	7,900	21,000	730	11,300	ND	ND	ND	ND	ND	ND	ND	ND	210	860
9/27/2009	12,000	1,200	3,900	440	2,630	ND	ND	ND	ND	ND	ND	ND	74	71	300
2/27/2010	11,000	3,500	4,300	380	730	ND	ND	ND	ND	ND	ND	ND	57	ND	ND
8/22/2010	14,000	2,600	2,400	30	2,180	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	44,000	7,900	13,000	350	9,500	ND	ND	ND	ND	ND	ND	ND	240	210	890

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This well was abandoned in May 2012.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-14
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
9/22/2003	68,000	4,100	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
12/25/2003	26,000	5,300													
4/24/2004	9,400	4,100													
8/8/2004	14,000	6,300													
8/22/2005	26,000	7,100													
3/13/2006	1,300	360	110	35	119	13	ND	ND	ND	ND	ND	ND	NA	NA	NA
6/11/2006	2,300	1,100	260	45	198	ND	ND	ND	3.3	ND	ND	ND			
9/6/2006	20,000	4,700	4,200	980	3,800	ND	ND	ND	ND	ND	ND	ND			
1/4/2007	30,000	7,000	4,500	1,100	5,000	ND	ND	ND	ND	ND	ND	ND			
7/9/2007	54,000	14,000	8,800	2,400	10,000	ND	ND	ND	ND	ND	ND	ND			
9/23/2007	19,000	9,900	7,700	2,100	9,300	ND	ND	ND	ND	ND	ND	12	290	220	1,100
9/6/2008	12,000	4,000	900	66	1,980	ND	ND	ND	ND	ND	ND	ND	110	53	220
9/27/2009	1,700	520	49	41	373	ND	ND	ND	ND	ND	ND	ND	19	15	64
2/27/2010	ND	ND	ND	2.2	373	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.9
8/21/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-15
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
1/21/2004	72,000	8,400	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8/8/2004	36,000	3,300													
8/22/2005	670,000	11,000													
3/13/2006	12,000	1,900													
6/11/2006	25,000	2,900	11,000	2,300	11,200	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
9/6/2006	51,000	8,200													
1/5/2007	30,000	9,700													
7/9/2007	46,000	5,200	3,800	2,500	11,500	ND	ND	ND	ND	ND	ND	ND	500	630	2,300
9/23/2007	59,000	14,000	5,800	3,600	16,000	ND	ND	ND	4.1	ND	ND	2.5	660	440	2,400
9/6/2008	19,000	7,100	1,000	57	2,730	ND	ND	ND	3.1	ND	ND	4.4	180	130	280
9/26/2009	8,800	1,400	530	280	2,650	ND	ND	ND	ND	ND	ND	ND	96	140	480
2/27/2010	720	250	57	50	113	ND	ND	ND	ND	ND	ND	ND	6.3	1.6	1.5
8/22/2010	1,600	200	4.1	ND	357	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	3,600	680	870	27	780	ND	ND	ND	ND	ND	ND	ND	25	21	31

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-16
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
1/21/2004	1,500	290	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8/8/2004	2,500	590													
8/20/2005	1,600	410	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND			
3/13/2006	900	400	0.7	ND	ND	ND	ND	ND	ND	ND	ND	ND			
6/11/2006	1,400	680	4.1	13	23	ND	ND	ND	ND	ND	ND	ND			
9/5/2006	2,100	210	ND	2.6	ND	ND	ND	ND	14	ND	ND	ND			
1/4/2007	370	2.9	ND	ND	ND	ND	ND	ND	6.6	ND	ND	ND			
7/9/2007	2,300	53	ND	ND	ND	ND	ND	ND	2.0	ND	ND	ND	59	ND	ND
9/22/2007	680	4.2	ND	1.1	1.5	ND	ND	ND	ND	ND	ND	ND	29	ND	ND
9/5/2008	310	ND	ND	ND	ND	ND	ND	ND	2.4	ND	ND	ND	7.3	ND	ND
9/26/2009	390	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	7.4	ND	ND
2/27/2010	220	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/21/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	190	2.2	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - EW-17
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPH _g	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
1/21/2004	18,000	2,600	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
8/8/2004	30,000	6,800													
8/22/2005	42,000	13,000	9,300	1,700	8,100	ND	ND	ND	ND	ND	ND	ND			
3/13/2006	29,000	6,500	6,500	1,100	5,500	ND	ND	ND	ND	ND	ND	ND			
6/11/2006	38,000	9,700	9,500	1,600	7,300	ND	ND	ND	ND	ND	ND	ND			
9/6/2006	26,000	8,900	6,900	1,300	6,200	ND	ND	ND	ND	ND	ND	ND			
1/4/2007	27,000	8,100	3,200	890	3,410	ND	ND	ND	ND	ND	ND	ND			
7/9/2007	40,000	7,600	6,400	1,400	7,000	ND	ND	ND	ND	ND	ND	ND	430	220	940
9/23/2007	6,800	5,300	5,300	1,300	5,700	ND	ND	ND	4.2	ND	ND	2.0	210	180	920
9/6/2008	7,500	3,200	530	18	680	ND	ND	ND	ND	ND	ND	ND	87	26	85
9/27/2009	4,200	1,400	580	110	730	ND	ND	ND	ND	ND	ND	ND	64	26	130
2/27/2010	2,600	1,500	400	56	614	ND	ND	ND	ND	ND	ND	ND	50	ND	ND
8/21/2010	2,900	1,200	110	ND	570	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/21/2011	6,500	3,000	110	ND	1,300	ND	ND	ND	ND	ND	ND	ND	100	51	150

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - Monitoring Well BJ
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/22/2005	1500	14	100	38	224	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/13/2006	790	ND	6.6	6.5	57	ND	ND	ND	ND	ND	ND	ND			
6/11/2006	ND	ND	0.9	0.6	4.5	ND	ND	ND	ND	ND	ND	ND			
9/7/2006	ND	1.4	3.8	1.5	9.1	ND	ND	ND	ND	ND	ND	ND			
1/6/2007	ND	ND	2.4	1.4	16	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/22/2007	150	4.0	2.2	0.5	8.9	ND	ND	ND	ND	ND	ND	ND	ND	1.3	4.2
9/5/2008	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/28/2010	ND	ND	ND	1.1	3.4	ND	ND	ND	ND	ND	ND	ND	3.3	ND	0.9
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/22/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This monitoring well was not located in May 2012

HISTORICAL GROUNDWATER SAMPLE ANALYTICAL RESULTS - Monitoring Well BK
TOTAL PETROLEUM HYDROCARBONS AS GASOLINE AND VOLATILE ORGANIC COMPOUNDS

Date	TPHg	Benzene	Toluene	Ethylbenzene	Total Xylenes	TAME	TBA	EDB	EDC	DIPE	EtBE	MtBE	Naphthalene	1,3,5-Trimethylbenzene	1,2,4-Trimethylbenzene
	Analytical Results (µg/L)														
8/22/2005	3,600	22	61	64	330	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
3/13/2006	1,800	ND	14	41	276	ND	ND	ND	ND	ND	ND	28			
6/11/2006	700	ND	0.91	9.8	59	ND	ND	ND	ND	ND	ND	ND			
9/7/2006	1100	0.54	4.9	8.5	70	ND	ND	ND	ND	ND	ND	ND			
1/6/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND			
7/7/2007	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/22/2007	ND	ND	ND	ND	7.8	ND	ND	ND	ND	ND	ND	ND	ND	1.8	1.5
9/5/2008	450	18	45	3.2	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/25/2009	ND	0.67	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2/28/2010	ND	ND	ND	ND	1.2	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
8/20/2010	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NA	NA	NA
4/22/2011	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

Notes:

µg/L = micrograms per liter

NA = not analyzed

ND = concentration not detected above laboratory reporting limits

Analytical data was taken from historical monitoring reports in Geotracker.

This monitoring well was not located in May 2012.

APPENDIX B

OPERATIONS AND MAINTENANCE FIELD FORMS

Field Form for Treatment System Operations and Maintenance

Enhanced Biodegradation and Groundwater Recirculation Project
Former Bill Chun Facility, Alameda, CA

Visit Type: weekly monthly quarterly unplanned

Date: 8/11/15

Field Tech: Emily Dirksen

Time: 14:00

Wells

Well ID	METER READING	Pressure (psi)	GW Depth (ft)	DO (mg/L)	pH (units)	ORP (mV)	EC (µS/cm)
Extraction							
EX-20	325790	--	--	--	--	--	--
EX-22	125280	--	--	--	--	--	--
EX-21	170970	--	--	--	--	--	--
		--	--	--	--	--	--
Injection							
IN-18 + IN-19	24770	--	--	--	--	--	--
IN-16	52640	--	--	--	--	--	--
Trenches 2+3	11230	--	--	--	--	--	--
Trench 1 + IN 17	113340	--	--	--	--	--	--
IN 14 +15	83500	--	--	--	--	--	--

Treatment System

Totalizer (digital): 399720 gal
 DO-IT System Pressure: 22 psi (analog)
 O2 Flow: 7.2 scfh

GAC Lead Pressure: 12 psi
 GAC Polish Pressure: 0 psi
 Bag Filter 1 Pressure: 38 psi
 Bag Filter 2 Pressure: 26 psi
 Mixing Tank pH:
 Holding Tank pH:

Weekly Maintenance Checklist

- Check O2 Flow
- Check All Flow Meters and Pressure Gauges
- Add Amendment to Holding Tank
 _____ cups soda ash pH buffer

- Add Amendment to Mixing Tank
 SD lbs CBN nutrient mix
 _____ gal EZT-EA biosurfactant
 _____ cups soda ash pH buffer

Quarterly Maintenance Checklist

- Clean Mixing Tank
- Clean Flow Meters
- Y Strainer
- Bag Filters
- Check GW Extraction Flow Rate
- Check Grundfos Extraction Pumps

Field Form for Treatment System Operations and Maintenance

Enhanced Biodegradation and Groundwater Recirculation Project
Former Bill Chun Facility, Alameda, CA

Visit Type: weekly monthly quarterly unplanned

Date: 8/27/15

Field Tech: CRD

Time: 16:00

Wells

Well ID	METER READING	Pressure (psi)	GW Depth (ft)	DO (mg/L)	pH (units)	ORP (mV)	EC (µS/cm)
Extraction							
EX-20	308850	--	--	--	--	--	--
EX-22	135900	--	--	--	--	--	--
EX-21	180950	--	--	--	--	--	--
		--	--	--	--	--	--
Injection							
IN-18 + IN-19	26210	--	--	--	--	--	--
IN-16	55510	--	--	--	--	--	--
Trenches 2+3	121890	--	--	--	--	--	--
Trench 1 + IN 17	121750	--	--	--	--	--	--
IN 14 +15	89950	--	--	--	--	--	--

Treatment System

Totalizer (digital): 429540 gal
 DO-IT System Pressure: 20 psi (analog)
 O2 Flow: 6.4 scfh

GAC Lead Pressure: 11 psi
 GAC Polish Pressure: 0 psi
 Bag Filter 1 Pressure: 12 psi
 Bag Filter 2 Pressure: 16 psi
 Mixing Tank pH: _____
 Holding Tank pH: _____

Weekly Maintenance Checklist

- Check O2 Flow
- Check All Flow Meters and Pressure Gauges
- Add Amendment to Holding Tank
_____ cups soda ash pH buffer

Add Amendment to Mixing Tank
50 lbs CBN nutrient mix
 _____ gal EZT-EA biosurfactant
 _____ cups soda ash pH buffer

Quarterly Maintenance Checklist

- Clean Mixing Tank
- Clean Flow Meters
- Y Strainer
- Bag Filters
- Check GW Extraction Flow Rate
- Check Grundfos Extraction Pumps

Field Form for Treatment System Operations and Maintenance

Enhanced Biodegradation and Groundwater Recirculation Project
Former Bill Chun Facility, Alameda, CA

Visit Type: weekly monthly quarterly unplanned

Date: 9 / 10 / 15

Field Tech: CWD

Time: 6:00

Wells

Well ID	METER READING	Pressure (psi)	GW Depth (ft)	DO (mg/L)	pH (units)	ORP (mV)	EC (µS/cm)
Extraction							
EX-20	408090	--	--	--	--	--	--
EX-22	145590	--	--	--	--	--	--
EX-21	199660	--	--	--	--	--	--
		--	--	--	--	--	--
Injection							
IN-18 + IN-19	27040	--	--	--	--	--	--
IN-16	58080	--	--	--	--	--	--
Trenches 2+3	130450	--	--	--	--	--	--
Trench 1 + IN 17	129080	--	--	--	--	--	--
IN 14 + 15	95710	--	--	--	--	--	--

Treatment System

Totalizer (digital): 455500 gal
 DO-IT System Pressure: 22 psi (analog)
 O2 Flow: 6.4 scfh

GAC Lead Pressure: 6 psi
 GAC Polish Pressure: 5 psi
 Bag Filter 1 Pressure: 40 psi
 Bag Filter 2 Pressure: 30 psi
 Mixing Tank pH: _____
 Holding Tank pH: _____

Weekly Maintenance Checklist

- Check O2 Flow
- Check All Flow Meters and Pressure Gauges
- Add Amendment to Holding Tank
_____ cups soda ash pH buffer

- Add Amendment to Mixing Tank
50 lbs CBN nutrient mix
 _____ gal EZT-EA biosurfactant
 _____ cups soda ash pH buffer

Quarterly Maintenance Checklist

- Clean Mixing Tank
- Clean Flow Meters
- Y Strainer
- Bag Filters
- Check GW Extraction Flow Rate
- Check Grundfos Extraction Pumps

APPENDIX C

LABORATORY ANALYTICAL REPORTS

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING


ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Pleasanton
1220 Quarry Lane
Pleasanton, CA 94566
Tel: (925)484-1919

TestAmerica Job ID: 720-66611-1
Client Project/Site: Chun

For:
Ninyo & Moore
1956 Webster Street
Suite 400
Oakland, California 94612

Attn: Mr. Peter D. Sims



Authorized for release by:
8/17/2015 3:42:34 PM

Dimple Sharma, Senior Project Manager
(925)484-1919
dimple.sharma@testamericainc.com

LINKS

Review your project
results through
TotalAccess

Have a Question?



Visit us at:
www.testamericainc.com

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15



Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	8
Surrogate Summary	24
QC Sample Results	25
QC Association Summary	38
Lab Chronicle	42
Certification Summary	45
Method Summary	46
Sample Summary	47
Chain of Custody	48
Receipt Checklists	49

Definitions/Glossary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Qualifiers

General Chemistry

Qualifier	Qualifier Description
HF	Field parameter with a holding time of 15 minutes. Test performed by laboratory at client's request.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Job ID: 720-66611-1

Laboratory: TestAmerica Pleasanton

Narrative

Job Narrative
720-66611-1

Comments

No additional comments.

Receipt

The samples were received on 8/10/2015 5:03 PM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 2.2° C.

Receipt Exceptions

The Chain-of-Custody (COC) was incomplete as received and/or improperly completed. Received 2-amber 40ml Hcl Ferrous Iron vials. Project was set up for Ferrous Iron, Ferric Iron, and Total Iron. Received 6-Trip Blanks not listed on the COC, logged on HOLD.

GC/MS VOA

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Metals

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

General Chemistry

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.



Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-13

Lab Sample ID: 720-66611-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	8.2		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,2-Dichloroethane	2.8		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Nitrite as NO2	1.2		1.0		mg/L	1		300.0	Total/NA
Sulfate	16		1.0		mg/L	1		300.0	Total/NA
Nitrate as NO3	38		10		mg/L	10		300.0	Total/NA
Iron	29		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	0.95		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	3.7		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	29	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.086		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-14

Lab Sample ID: 720-66611-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	2700		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
Ethylbenzene	600		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	47		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
Naphthalene	210		50		ug/L	50		8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	70		50		ug/L	50		8260B/CA_LUFT MS	Total/NA
Toluene	130		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	400		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	83		25		ug/L	50		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	430		50		ug/L	50		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO)	5900		2500		ug/L	50		8260B/CA_LUFT MS	Total/NA
-C5-C12									
Sulfate	11		1.0		mg/L	1		300.0	Total/NA
Iron	27		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.7		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	2.5		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	21	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	6.3	HF	0.20		mg/L	2		SM 3500 FE D	Total/NA
Orthophosphate as P	0.031		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-11R

Lab Sample ID: 720-66611-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	660		50		ug/L	100		8260B/CA_LUFT MS	Total/NA
Ethylbenzene	2000		50		ug/L	100		8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	100		50		ug/L	100		8260B/CA_LUFT MS	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-11R (Continued)

Lab Sample ID: 720-66611-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Naphthalene	500		100		ug/L	100		8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	310		100		ug/L	100		8260B/CA_LUFT MS	Total/NA
Toluene	4600		50		ug/L	100		8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	2800		50		ug/L	100		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	670		50		ug/L	100		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	14000		100		ug/L	100		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	38000		5000		ug/L	100		8260B/CA_LUFT MS	Total/NA
Sulfate	1.1		1.0		mg/L	1		300.0	Total/NA
Nitrate as NO3	1.3		1.0		mg/L	1		300.0	Total/NA
Iron	2.2		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.5		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Ferrous Iron	2.2	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.12		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-12

Lab Sample ID: 720-66611-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	6.4		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Benzene	25		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,2-Dichloroethane	2.5		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Ethylbenzene	18		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	0.71		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Naphthalene	5.0		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	1.0		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Toluene	59		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	13		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	2.9		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	130		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	350		50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Sulfate	15		1.0		mg/L	1		300.0	Total/NA
Iron	0.85		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.1		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Ferrous Iron	0.78	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.035		0.020		mg/L	1		SM 4500 P E	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-15

Lab Sample ID: 720-66611-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	5.2		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,2-Dichloroethane	1.1		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Nitrite as NO2	1.6		1.0		mg/L	1		300.0	Total/NA
Sulfate	50		10		mg/L	10		300.0	Total/NA
Nitrate as NO3	13		1.0		mg/L	1		300.0	Total/NA
Iron	46		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	0.72		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	5.3		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	45	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	0.77	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.036		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-16

Lab Sample ID: 720-66611-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	0.56		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Sulfate	9.7		1.0		mg/L	1		300.0	Total/NA
Nitrate as NO3	1.4		1.0		mg/L	1		300.0	Total/NA
Iron	2.5		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	0.21		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	2.5	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.040		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-9

Lab Sample ID: 720-66611-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Isopropylbenzene	1.7		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Sulfate	52		10		mg/L	10		300.0	Total/NA
Nitrate as NO3	3.4		1.0		mg/L	1		300.0	Total/NA
Iron	38		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	4.1		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	3.2		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	37	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	1.2	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.063		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-10

Lab Sample ID: 720-66611-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Sulfate	28		10		mg/L	10		300.0	Total/NA
Nitrate as NO3	7.6		1.0		mg/L	1		300.0	Total/NA
Iron	40		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	0.59		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	4.3		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	40	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Orthophosphate as P	0.035		0.020		mg/L	1		SM 4500 P E	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-13

Date Collected: 08/10/15 09:15

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-1

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	8.2		0.50		ug/L			08/14/15 14:29	1
Acetone	ND		50		ug/L			08/14/15 14:29	1
Benzene	ND		0.50		ug/L			08/14/15 14:29	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 14:29	1
Bromobenzene	ND		1.0		ug/L			08/14/15 14:29	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 14:29	1
Bromoform	ND		1.0		ug/L			08/14/15 14:29	1
Bromomethane	ND		1.0		ug/L			08/14/15 14:29	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 14:29	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 14:29	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 14:29	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 14:29	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 14:29	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 14:29	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 14:29	1
Chloroethane	ND		1.0		ug/L			08/14/15 14:29	1
Chloroform	ND		1.0		ug/L			08/14/15 14:29	1
Chloromethane	ND		1.0		ug/L			08/14/15 14:29	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 14:29	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 14:29	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 14:29	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 14:29	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 14:29	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 14:29	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 14:29	1
1,1-Dichloropropene	ND		0.50		ug/L			08/14/15 14:29	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 14:29	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 14:29	1
Dibromomethane	ND		0.50		ug/L			08/14/15 14:29	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 14:29	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 14:29	1
1,2-Dichloroethane	2.8		0.50		ug/L			08/14/15 14:29	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 14:29	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 14:29	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 14:29	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 14:29	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 14:29	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 14:29	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 14:29	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 14:29	1
2-Hexanone	ND		50		ug/L			08/14/15 14:29	1
Isopropylbenzene	ND		0.50		ug/L			08/14/15 14:29	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 14:29	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 14:29	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 14:29	1
Naphthalene	ND		1.0		ug/L			08/14/15 14:29	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 14:29	1
Styrene	ND		0.50		ug/L			08/14/15 14:29	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 14:29	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-13
Date Collected: 08/10/15 09:15
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-1
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 14:29	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 14:29	1
Toluene	ND		0.50		ug/L			08/14/15 14:29	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 14:29	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 14:29	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 14:29	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 14:29	1
Trichloroethene	ND		0.50		ug/L			08/14/15 14:29	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 14:29	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 14:29	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 14:29	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 14:29	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 14:29	1
Vinyl acetate	ND		10		ug/L			08/14/15 14:29	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 14:29	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 14:29	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 14:29	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 14:29	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	99		67 - 130		08/14/15 14:29	1
1,2-Dichloroethane-d4 (Surr)	114		72 - 130		08/14/15 14:29	1
Toluene-d8 (Surr)	98		70 - 130		08/14/15 14:29	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	1.2		1.0		mg/L			08/10/15 22:01	1
Sulfate	16		1.0		mg/L			08/10/15 22:01	1
Nitrate as NO3	38		10		mg/L			08/10/15 22:19	10

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	29		0.50		mg/L		08/11/15 09:43	08/11/15 23:28	1
Manganese	0.95		0.020		mg/L		08/11/15 09:43	08/11/15 23:28	1
Potassium	3.7		1.0		mg/L		08/11/15 09:43	08/11/15 23:28	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	29	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	ND	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:16	1
Orthophosphate as P	0.086		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-14

Date Collected: 08/10/15 10:00

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-2

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		25		ug/L			08/14/15 15:53	50
Acetone	ND		2500		ug/L			08/14/15 15:53	50
Benzene	2700		25		ug/L			08/14/15 15:53	50
Dichlorobromomethane	ND		25		ug/L			08/14/15 15:53	50
Bromobenzene	ND		50		ug/L			08/14/15 15:53	50
Chlorobromomethane	ND		50		ug/L			08/14/15 15:53	50
Bromoform	ND		50		ug/L			08/14/15 15:53	50
Bromomethane	ND		50		ug/L			08/14/15 15:53	50
2-Butanone (MEK)	ND		2500		ug/L			08/14/15 15:53	50
n-Butylbenzene	ND		50		ug/L			08/14/15 15:53	50
sec-Butylbenzene	ND		50		ug/L			08/14/15 15:53	50
tert-Butylbenzene	ND		50		ug/L			08/14/15 15:53	50
Carbon disulfide	ND		250		ug/L			08/14/15 15:53	50
Carbon tetrachloride	ND		25		ug/L			08/14/15 15:53	50
Chlorobenzene	ND		25		ug/L			08/14/15 15:53	50
Chloroethane	ND		50		ug/L			08/14/15 15:53	50
Chloroform	ND		50		ug/L			08/14/15 15:53	50
Chloromethane	ND		50		ug/L			08/14/15 15:53	50
2-Chlorotoluene	ND		25		ug/L			08/14/15 15:53	50
4-Chlorotoluene	ND		25		ug/L			08/14/15 15:53	50
Chlorodibromomethane	ND		25		ug/L			08/14/15 15:53	50
1,2-Dichlorobenzene	ND		25		ug/L			08/14/15 15:53	50
1,3-Dichlorobenzene	ND		25		ug/L			08/14/15 15:53	50
1,4-Dichlorobenzene	ND		25		ug/L			08/14/15 15:53	50
1,3-Dichloropropane	ND		50		ug/L			08/14/15 15:53	50
1,1-Dichloropropene	ND		25		ug/L			08/14/15 15:53	50
1,2-Dibromo-3-Chloropropane	ND		50		ug/L			08/14/15 15:53	50
Ethylene Dibromide	ND		25		ug/L			08/14/15 15:53	50
Dibromomethane	ND		25		ug/L			08/14/15 15:53	50
Dichlorodifluoromethane	ND		25		ug/L			08/14/15 15:53	50
1,1-Dichloroethane	ND		25		ug/L			08/14/15 15:53	50
1,2-Dichloroethane	ND		25		ug/L			08/14/15 15:53	50
1,1-Dichloroethene	ND		25		ug/L			08/14/15 15:53	50
cis-1,2-Dichloroethene	ND		25		ug/L			08/14/15 15:53	50
trans-1,2-Dichloroethene	ND		25		ug/L			08/14/15 15:53	50
1,2-Dichloropropane	ND		25		ug/L			08/14/15 15:53	50
cis-1,3-Dichloropropene	ND		25		ug/L			08/14/15 15:53	50
trans-1,3-Dichloropropene	ND		25		ug/L			08/14/15 15:53	50
Ethylbenzene	600		25		ug/L			08/14/15 15:53	50
Hexachlorobutadiene	ND		50		ug/L			08/14/15 15:53	50
2-Hexanone	ND		2500		ug/L			08/14/15 15:53	50
Isopropylbenzene	47		25		ug/L			08/14/15 15:53	50
4-Isopropyltoluene	ND		50		ug/L			08/14/15 15:53	50
Methylene Chloride	ND		250		ug/L			08/14/15 15:53	50
4-Methyl-2-pentanone (MIBK)	ND		2500		ug/L			08/14/15 15:53	50
Naphthalene	210		50		ug/L			08/14/15 15:53	50
N-Propylbenzene	70		50		ug/L			08/14/15 15:53	50
Styrene	ND		25		ug/L			08/14/15 15:53	50
1,1,1,2-Tetrachloroethane	ND		25		ug/L			08/14/15 15:53	50

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-14
Date Collected: 08/10/15 10:00
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		25		ug/L			08/14/15 15:53	50
Tetrachloroethene	ND		25		ug/L			08/14/15 15:53	50
Toluene	130		25		ug/L			08/14/15 15:53	50
1,2,3-Trichlorobenzene	ND		50		ug/L			08/14/15 15:53	50
1,2,4-Trichlorobenzene	ND		50		ug/L			08/14/15 15:53	50
1,1,1-Trichloroethane	ND		25		ug/L			08/14/15 15:53	50
1,1,2-Trichloroethane	ND		25		ug/L			08/14/15 15:53	50
Trichloroethene	ND		25		ug/L			08/14/15 15:53	50
Trichlorofluoromethane	ND		50		ug/L			08/14/15 15:53	50
1,2,3-Trichloropropane	ND		25		ug/L			08/14/15 15:53	50
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25		ug/L			08/14/15 15:53	50
1,2,4-Trimethylbenzene	400		25		ug/L			08/14/15 15:53	50
1,3,5-Trimethylbenzene	83		25		ug/L			08/14/15 15:53	50
Vinyl acetate	ND		500		ug/L			08/14/15 15:53	50
Vinyl chloride	ND		25		ug/L			08/14/15 15:53	50
Xylenes, Total	430		50		ug/L			08/14/15 15:53	50
2,2-Dichloropropane	ND		25		ug/L			08/14/15 15:53	50
Gasoline Range Organics (GRO)	5900		2500		ug/L			08/14/15 15:53	50
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	99		67 - 130		08/14/15 15:53	50
1,2-Dichloroethane-d4 (Surr)	106		72 - 130		08/14/15 15:53	50
Toluene-d8 (Surr)	98		70 - 130		08/14/15 15:53	50

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/10/15 23:10	1
Sulfate	11		1.0		mg/L			08/10/15 23:10	1
Nitrate as NO3	ND		1.0		mg/L			08/10/15 23:10	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	27		0.50		mg/L		08/11/15 09:43	08/11/15 23:33	1
Manganese	1.7		0.020		mg/L		08/11/15 09:43	08/11/15 23:33	1
Potassium	2.5		1.0		mg/L		08/11/15 09:43	08/11/15 23:33	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	21	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	6.3	HF	0.20		mg/L			08/11/15 10:02	2
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:19	1
Orthophosphate as P	0.031		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-11R

Date Collected: 08/10/15 10:48

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-3

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		50		ug/L			08/14/15 16:21	100
Acetone	ND		5000		ug/L			08/14/15 16:21	100
Benzene	660		50		ug/L			08/14/15 16:21	100
Dichlorobromomethane	ND		50		ug/L			08/14/15 16:21	100
Bromobenzene	ND		100		ug/L			08/14/15 16:21	100
Chlorobromomethane	ND		100		ug/L			08/14/15 16:21	100
Bromoform	ND		100		ug/L			08/14/15 16:21	100
Bromomethane	ND		100		ug/L			08/14/15 16:21	100
2-Butanone (MEK)	ND		5000		ug/L			08/14/15 16:21	100
n-Butylbenzene	ND		100		ug/L			08/14/15 16:21	100
sec-Butylbenzene	ND		100		ug/L			08/14/15 16:21	100
tert-Butylbenzene	ND		100		ug/L			08/14/15 16:21	100
Carbon disulfide	ND		500		ug/L			08/14/15 16:21	100
Carbon tetrachloride	ND		50		ug/L			08/14/15 16:21	100
Chlorobenzene	ND		50		ug/L			08/14/15 16:21	100
Chloroethane	ND		100		ug/L			08/14/15 16:21	100
Chloroform	ND		100		ug/L			08/14/15 16:21	100
Chloromethane	ND		100		ug/L			08/14/15 16:21	100
2-Chlorotoluene	ND		50		ug/L			08/14/15 16:21	100
4-Chlorotoluene	ND		50		ug/L			08/14/15 16:21	100
Chlorodibromomethane	ND		50		ug/L			08/14/15 16:21	100
1,2-Dichlorobenzene	ND		50		ug/L			08/14/15 16:21	100
1,3-Dichlorobenzene	ND		50		ug/L			08/14/15 16:21	100
1,4-Dichlorobenzene	ND		50		ug/L			08/14/15 16:21	100
1,3-Dichloropropane	ND		100		ug/L			08/14/15 16:21	100
1,1-Dichloropropene	ND		50		ug/L			08/14/15 16:21	100
1,2-Dibromo-3-Chloropropane	ND		100		ug/L			08/14/15 16:21	100
Ethylene Dibromide	ND		50		ug/L			08/14/15 16:21	100
Dibromomethane	ND		50		ug/L			08/14/15 16:21	100
Dichlorodifluoromethane	ND		50		ug/L			08/14/15 16:21	100
1,1-Dichloroethane	ND		50		ug/L			08/14/15 16:21	100
1,2-Dichloroethane	ND		50		ug/L			08/14/15 16:21	100
1,1-Dichloroethene	ND		50		ug/L			08/14/15 16:21	100
cis-1,2-Dichloroethene	ND		50		ug/L			08/14/15 16:21	100
trans-1,2-Dichloroethene	ND		50		ug/L			08/14/15 16:21	100
1,2-Dichloropropane	ND		50		ug/L			08/14/15 16:21	100
cis-1,3-Dichloropropene	ND		50		ug/L			08/14/15 16:21	100
trans-1,3-Dichloropropene	ND		50		ug/L			08/14/15 16:21	100
Ethylbenzene	2000		50		ug/L			08/14/15 16:21	100
Hexachlorobutadiene	ND		100		ug/L			08/14/15 16:21	100
2-Hexanone	ND		5000		ug/L			08/14/15 16:21	100
Isopropylbenzene	100		50		ug/L			08/14/15 16:21	100
4-Isopropyltoluene	ND		100		ug/L			08/14/15 16:21	100
Methylene Chloride	ND		500		ug/L			08/14/15 16:21	100
4-Methyl-2-pentanone (MIBK)	ND		5000		ug/L			08/14/15 16:21	100
Naphthalene	500		100		ug/L			08/14/15 16:21	100
N-Propylbenzene	310		100		ug/L			08/14/15 16:21	100
Styrene	ND		50		ug/L			08/14/15 16:21	100
1,1,1,2-Tetrachloroethane	ND		50		ug/L			08/14/15 16:21	100

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-11R

Lab Sample ID: 720-66611-3

Date Collected: 08/10/15 10:48

Matrix: Water

Date Received: 08/10/15 17:03

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		50		ug/L			08/14/15 16:21	100
Tetrachloroethene	ND		50		ug/L			08/14/15 16:21	100
Toluene	4600		50		ug/L			08/14/15 16:21	100
1,2,3-Trichlorobenzene	ND		100		ug/L			08/14/15 16:21	100
1,2,4-Trichlorobenzene	ND		100		ug/L			08/14/15 16:21	100
1,1,1-Trichloroethane	ND		50		ug/L			08/14/15 16:21	100
1,1,2-Trichloroethane	ND		50		ug/L			08/14/15 16:21	100
Trichloroethene	ND		50		ug/L			08/14/15 16:21	100
Trichlorofluoromethane	ND		100		ug/L			08/14/15 16:21	100
1,2,3-Trichloropropane	ND		50		ug/L			08/14/15 16:21	100
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		50		ug/L			08/14/15 16:21	100
1,2,4-Trimethylbenzene	2800		50		ug/L			08/14/15 16:21	100
1,3,5-Trimethylbenzene	670		50		ug/L			08/14/15 16:21	100
Vinyl acetate	ND		1000		ug/L			08/14/15 16:21	100
Vinyl chloride	ND		50		ug/L			08/14/15 16:21	100
Xylenes, Total	14000		100		ug/L			08/14/15 16:21	100
2,2-Dichloropropane	ND		50		ug/L			08/14/15 16:21	100
Gasoline Range Organics (GRO)	38000		5000		ug/L			08/14/15 16:21	100
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	98		67 - 130		08/14/15 16:21	100
1,2-Dichloroethane-d4 (Surr)	106		72 - 130		08/14/15 16:21	100
Toluene-d8 (Surr)	99		70 - 130		08/14/15 16:21	100

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/10/15 23:44	1
Sulfate	1.1		1.0		mg/L			08/10/15 23:44	1
Nitrate as NO3	1.3		1.0		mg/L			08/10/15 23:44	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	2.2		0.50		mg/L		08/11/15 09:43	08/11/15 23:38	1
Manganese	1.5		0.020		mg/L		08/11/15 09:43	08/11/15 23:38	1
Potassium	ND		1.0		mg/L		08/11/15 09:43	08/11/15 23:38	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	ND	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	2.2	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:22	1
Orthophosphate as P	0.12		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-12

Date Collected: 08/10/15 11:25

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-4

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	6.4		0.50		ug/L			08/14/15 16:49	1
Acetone	ND		50		ug/L			08/14/15 16:49	1
Benzene	25		0.50		ug/L			08/14/15 16:49	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 16:49	1
Bromobenzene	ND		1.0		ug/L			08/14/15 16:49	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 16:49	1
Bromoform	ND		1.0		ug/L			08/14/15 16:49	1
Bromomethane	ND		1.0		ug/L			08/14/15 16:49	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 16:49	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 16:49	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 16:49	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 16:49	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 16:49	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 16:49	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 16:49	1
Chloroethane	ND		1.0		ug/L			08/14/15 16:49	1
Chloroform	ND		1.0		ug/L			08/14/15 16:49	1
Chloromethane	ND		1.0		ug/L			08/14/15 16:49	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 16:49	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 16:49	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 16:49	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 16:49	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 16:49	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 16:49	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 16:49	1
1,1-Dichloropropane	ND		0.50		ug/L			08/14/15 16:49	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 16:49	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 16:49	1
Dibromomethane	ND		0.50		ug/L			08/14/15 16:49	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 16:49	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 16:49	1
1,2-Dichloroethane	2.5		0.50		ug/L			08/14/15 16:49	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 16:49	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 16:49	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 16:49	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 16:49	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 16:49	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 16:49	1
Ethylbenzene	18		0.50		ug/L			08/14/15 16:49	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 16:49	1
2-Hexanone	ND		50		ug/L			08/14/15 16:49	1
Isopropylbenzene	0.71		0.50		ug/L			08/14/15 16:49	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 16:49	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 16:49	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 16:49	1
Naphthalene	5.0		1.0		ug/L			08/14/15 16:49	1
N-Propylbenzene	1.0		1.0		ug/L			08/14/15 16:49	1
Styrene	ND		0.50		ug/L			08/14/15 16:49	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 16:49	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-12

Lab Sample ID: 720-66611-4

Date Collected: 08/10/15 11:25

Matrix: Water

Date Received: 08/10/15 17:03

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 16:49	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 16:49	1
Toluene	59		0.50		ug/L			08/14/15 16:49	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 16:49	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 16:49	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 16:49	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 16:49	1
Trichloroethene	ND		0.50		ug/L			08/14/15 16:49	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 16:49	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 16:49	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 16:49	1
1,2,4-Trimethylbenzene	13		0.50		ug/L			08/14/15 16:49	1
1,3,5-Trimethylbenzene	2.9		0.50		ug/L			08/14/15 16:49	1
Vinyl acetate	ND		10		ug/L			08/14/15 16:49	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 16:49	1
Xylenes, Total	130		1.0		ug/L			08/14/15 16:49	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 16:49	1
Gasoline Range Organics (GRO)	350		50		ug/L			08/14/15 16:49	1
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	98		67 - 130		08/14/15 16:49	1
1,2-Dichloroethane-d4 (Surr)	109		72 - 130		08/14/15 16:49	1
Toluene-d8 (Surr)	98		70 - 130		08/14/15 16:49	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 00:52	1
Sulfate	15		1.0		mg/L			08/11/15 00:52	1
Nitrate as NO3	ND		1.0		mg/L			08/11/15 00:52	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	0.85		0.50		mg/L		08/11/15 09:43	08/11/15 23:43	1
Manganese	1.1		0.020		mg/L		08/11/15 09:43	08/11/15 23:43	1
Potassium	ND		1.0		mg/L		08/11/15 09:43	08/11/15 23:43	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	ND	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	0.78	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:25	1
Orthophosphate as P	0.035		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-15
Date Collected: 08/10/15 12:40
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-5
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	5.2		0.50		ug/L			08/14/15 17:17	1
Acetone	ND		50		ug/L			08/14/15 17:17	1
Benzene	ND		0.50		ug/L			08/14/15 17:17	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 17:17	1
Bromobenzene	ND		1.0		ug/L			08/14/15 17:17	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 17:17	1
Bromoform	ND		1.0		ug/L			08/14/15 17:17	1
Bromomethane	ND		1.0		ug/L			08/14/15 17:17	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 17:17	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 17:17	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 17:17	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 17:17	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 17:17	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 17:17	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 17:17	1
Chloroethane	ND		1.0		ug/L			08/14/15 17:17	1
Chloroform	ND		1.0		ug/L			08/14/15 17:17	1
Chloromethane	ND		1.0		ug/L			08/14/15 17:17	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 17:17	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 17:17	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 17:17	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:17	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:17	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:17	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 17:17	1
1,1-Dichloropropane	ND		0.50		ug/L			08/14/15 17:17	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 17:17	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 17:17	1
Dibromomethane	ND		0.50		ug/L			08/14/15 17:17	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 17:17	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 17:17	1
1,2-Dichloroethane	1.1		0.50		ug/L			08/14/15 17:17	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 17:17	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 17:17	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 17:17	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 17:17	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 17:17	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 17:17	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 17:17	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 17:17	1
2-Hexanone	ND		50		ug/L			08/14/15 17:17	1
Isopropylbenzene	ND		0.50		ug/L			08/14/15 17:17	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 17:17	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 17:17	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 17:17	1
Naphthalene	ND		1.0		ug/L			08/14/15 17:17	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 17:17	1
Styrene	ND		0.50		ug/L			08/14/15 17:17	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 17:17	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-15
Date Collected: 08/10/15 12:40
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-5
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 17:17	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 17:17	1
Toluene	ND		0.50		ug/L			08/14/15 17:17	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 17:17	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 17:17	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 17:17	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 17:17	1
Trichloroethene	ND		0.50		ug/L			08/14/15 17:17	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 17:17	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 17:17	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 17:17	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 17:17	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 17:17	1
Vinyl acetate	ND		10		ug/L			08/14/15 17:17	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 17:17	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 17:17	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 17:17	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 17:17	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	97		67 - 130					08/14/15 17:17	1
1,2-Dichloroethane-d4 (Surr)	110		72 - 130					08/14/15 17:17	1
Toluene-d8 (Surr)	98		70 - 130					08/14/15 17:17	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	1.6		1.0		mg/L			08/11/15 01:27	1
Sulfate	50		10		mg/L			08/11/15 01:44	10
Nitrate as NO3	13		1.0		mg/L			08/11/15 01:27	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	46		0.50		mg/L		08/11/15 09:43	08/11/15 23:48	1
Manganese	0.72		0.020		mg/L		08/11/15 09:43	08/11/15 23:48	1
Potassium	5.3		1.0		mg/L		08/11/15 09:43	08/11/15 23:48	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	45	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	0.77	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:28	1
Orthophosphate as P	0.036		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-16

Date Collected: 08/10/15 13:25

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-6

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	0.56		0.50		ug/L			08/14/15 17:45	1
Acetone	ND		50		ug/L			08/14/15 17:45	1
Benzene	ND		0.50		ug/L			08/14/15 17:45	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 17:45	1
Bromobenzene	ND		1.0		ug/L			08/14/15 17:45	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 17:45	1
Bromoform	ND		1.0		ug/L			08/14/15 17:45	1
Bromomethane	ND		1.0		ug/L			08/14/15 17:45	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 17:45	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 17:45	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 17:45	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 17:45	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 17:45	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 17:45	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 17:45	1
Chloroethane	ND		1.0		ug/L			08/14/15 17:45	1
Chloroform	ND		1.0		ug/L			08/14/15 17:45	1
Chloromethane	ND		1.0		ug/L			08/14/15 17:45	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 17:45	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 17:45	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 17:45	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:45	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:45	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 17:45	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 17:45	1
1,1-Dichloropropane	ND		0.50		ug/L			08/14/15 17:45	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 17:45	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 17:45	1
Dibromomethane	ND		0.50		ug/L			08/14/15 17:45	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 17:45	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 17:45	1
1,2-Dichloroethane	ND		0.50		ug/L			08/14/15 17:45	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 17:45	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 17:45	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 17:45	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 17:45	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 17:45	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 17:45	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 17:45	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 17:45	1
2-Hexanone	ND		50		ug/L			08/14/15 17:45	1
Isopropylbenzene	ND		0.50		ug/L			08/14/15 17:45	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 17:45	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 17:45	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 17:45	1
Naphthalene	ND		1.0		ug/L			08/14/15 17:45	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 17:45	1
Styrene	ND		0.50		ug/L			08/14/15 17:45	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 17:45	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-16

Lab Sample ID: 720-66611-6

Date Collected: 08/10/15 13:25

Matrix: Water

Date Received: 08/10/15 17:03

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 17:45	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 17:45	1
Toluene	ND		0.50		ug/L			08/14/15 17:45	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 17:45	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 17:45	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 17:45	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 17:45	1
Trichloroethene	ND		0.50		ug/L			08/14/15 17:45	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 17:45	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 17:45	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 17:45	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 17:45	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 17:45	1
Vinyl acetate	ND		10		ug/L			08/14/15 17:45	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 17:45	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 17:45	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 17:45	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 17:45	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	97		67 - 130		08/14/15 17:45	1
1,2-Dichloroethane-d4 (Surr)	109		72 - 130		08/14/15 17:45	1
Toluene-d8 (Surr)	98		70 - 130		08/14/15 17:45	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 02:01	1
Sulfate	9.7		1.0		mg/L			08/11/15 02:01	1
Nitrate as NO3	1.4		1.0		mg/L			08/11/15 02:01	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	2.5		0.50		mg/L		08/11/15 09:44	08/12/15 00:02	1
Manganese	0.21		0.020		mg/L		08/11/15 09:44	08/12/15 00:02	1
Potassium	ND		1.0		mg/L		08/11/15 09:44	08/12/15 00:02	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	2.5	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	ND	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:31	1
Orthophosphate as P	0.040		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-9
Date Collected: 08/10/15 14:50
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-7
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			08/14/15 18:13	1
Acetone	ND		50		ug/L			08/14/15 18:13	1
Benzene	ND		0.50		ug/L			08/14/15 18:13	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 18:13	1
Bromobenzene	ND		1.0		ug/L			08/14/15 18:13	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 18:13	1
Bromoform	ND		1.0		ug/L			08/14/15 18:13	1
Bromomethane	ND		1.0		ug/L			08/14/15 18:13	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 18:13	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 18:13	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 18:13	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 18:13	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 18:13	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 18:13	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 18:13	1
Chloroethane	ND		1.0		ug/L			08/14/15 18:13	1
Chloroform	ND		1.0		ug/L			08/14/15 18:13	1
Chloromethane	ND		1.0		ug/L			08/14/15 18:13	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 18:13	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 18:13	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 18:13	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:13	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:13	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:13	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 18:13	1
1,1-Dichloropropane	ND		0.50		ug/L			08/14/15 18:13	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 18:13	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 18:13	1
Dibromomethane	ND		0.50		ug/L			08/14/15 18:13	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 18:13	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 18:13	1
1,2-Dichloroethane	ND		0.50		ug/L			08/14/15 18:13	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 18:13	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 18:13	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 18:13	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 18:13	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 18:13	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 18:13	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 18:13	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 18:13	1
2-Hexanone	ND		50		ug/L			08/14/15 18:13	1
Isopropylbenzene	1.7		0.50		ug/L			08/14/15 18:13	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 18:13	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 18:13	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 18:13	1
Naphthalene	ND		1.0		ug/L			08/14/15 18:13	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 18:13	1
Styrene	ND		0.50		ug/L			08/14/15 18:13	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 18:13	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-9
Date Collected: 08/10/15 14:50
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-7
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 18:13	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 18:13	1
Toluene	ND		0.50		ug/L			08/14/15 18:13	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 18:13	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 18:13	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 18:13	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 18:13	1
Trichloroethene	ND		0.50		ug/L			08/14/15 18:13	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 18:13	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 18:13	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 18:13	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 18:13	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 18:13	1
Vinyl acetate	ND		10		ug/L			08/14/15 18:13	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 18:13	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 18:13	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 18:13	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 18:13	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	97		67 - 130					08/14/15 18:13	1
1,2-Dichloroethane-d4 (Surr)	109		72 - 130					08/14/15 18:13	1
Toluene-d8 (Surr)	98		70 - 130					08/14/15 18:13	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 02:35	1
Sulfate	52		10		mg/L			08/11/15 02:52	10
Nitrate as NO3	3.4		1.0		mg/L			08/11/15 02:35	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	38		0.50		mg/L		08/11/15 09:48	08/12/15 00:08	1
Manganese	4.1		0.020		mg/L		08/11/15 09:48	08/12/15 00:08	1
Potassium	3.2		1.0		mg/L		08/11/15 09:48	08/12/15 00:08	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	37	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	1.2	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:45	1
Orthophosphate as P	0.063		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-10
Date Collected: 08/10/15 15:20
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-8
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			08/14/15 18:41	1
Acetone	ND		50		ug/L			08/14/15 18:41	1
Benzene	ND		0.50		ug/L			08/14/15 18:41	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 18:41	1
Bromobenzene	ND		1.0		ug/L			08/14/15 18:41	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 18:41	1
Bromoform	ND		1.0		ug/L			08/14/15 18:41	1
Bromomethane	ND		1.0		ug/L			08/14/15 18:41	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 18:41	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 18:41	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 18:41	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 18:41	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 18:41	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 18:41	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 18:41	1
Chloroethane	ND		1.0		ug/L			08/14/15 18:41	1
Chloroform	ND		1.0		ug/L			08/14/15 18:41	1
Chloromethane	ND		1.0		ug/L			08/14/15 18:41	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 18:41	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 18:41	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 18:41	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:41	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:41	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 18:41	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 18:41	1
1,1-Dichloropropane	ND		0.50		ug/L			08/14/15 18:41	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 18:41	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 18:41	1
Dibromomethane	ND		0.50		ug/L			08/14/15 18:41	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 18:41	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 18:41	1
1,2-Dichloroethane	ND		0.50		ug/L			08/14/15 18:41	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 18:41	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 18:41	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 18:41	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 18:41	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 18:41	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 18:41	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 18:41	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 18:41	1
2-Hexanone	ND		50		ug/L			08/14/15 18:41	1
Isopropylbenzene	ND		0.50		ug/L			08/14/15 18:41	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 18:41	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 18:41	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 18:41	1
Naphthalene	ND		1.0		ug/L			08/14/15 18:41	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 18:41	1
Styrene	ND		0.50		ug/L			08/14/15 18:41	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 18:41	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-10
Date Collected: 08/10/15 15:20
Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-8
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 18:41	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 18:41	1
Toluene	ND		0.50		ug/L			08/14/15 18:41	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 18:41	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 18:41	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 18:41	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 18:41	1
Trichloroethene	ND		0.50		ug/L			08/14/15 18:41	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 18:41	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 18:41	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 18:41	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 18:41	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 18:41	1
Vinyl acetate	ND		10		ug/L			08/14/15 18:41	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 18:41	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 18:41	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 18:41	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 18:41	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	97		67 - 130					08/14/15 18:41	1
1,2-Dichloroethane-d4 (Surr)	110		72 - 130					08/14/15 18:41	1
Toluene-d8 (Surr)	96		70 - 130					08/14/15 18:41	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 03:09	1
Sulfate	28		10		mg/L			08/11/15 03:26	10
Nitrate as NO3	7.6		1.0		mg/L			08/11/15 03:09	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	40		0.50		mg/L		08/11/15 09:48	08/12/15 00:13	1
Manganese	0.59		0.020		mg/L		08/11/15 09:48	08/12/15 00:13	1
Potassium	4.3		1.0		mg/L		08/11/15 09:48	08/12/15 00:13	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	40	HF	0.10		mg/L			08/11/15 10:10	1
Ferrous Iron	ND	HF	0.10		mg/L			08/11/15 10:02	1
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 22:48	1
Orthophosphate as P	0.035		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

Surrogate Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Matrix: Water

Prep Type: Total/NA

Percent Surrogate Recovery (Acceptance Limits)

Lab Sample ID	Client Sample ID	BFB (67-130)	12DCE (72-130)	TOL (70-130)
720-66611-1	MW-13	99	114	98
720-66611-1 MS	MW-13	101	108	100
720-66611-1 MSD	MW-13	98	105	98
720-66611-2	MW-14	99	106	98
720-66611-3	MW-11R	98	106	99
720-66611-4	MW-12	98	109	98
720-66611-5	MW-15	97	110	98
720-66611-6	MW-16	97	109	98
720-66611-7	MW-9	97	109	98
720-66611-8	MW-10	97	110	96
LCS 720-186968/10	Lab Control Sample	99	104	99
LCS 720-186968/8	Lab Control Sample	98	102	97
LCSD 720-186968/11	Lab Control Sample Dup	100	106	98
LCSD 720-186968/9	Lab Control Sample Dup	97	103	99
MB 720-186968/7	Method Blank	96	105	97

Surrogate Legend

BFB = 4-Bromofluorobenzene

12DCE = 1,2-Dichloroethane-d4 (Surr)

TOL = Toluene-d8 (Surr)

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Lab Sample ID: MB 720-186968/7

Matrix: Water

Analysis Batch: 186968

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			08/14/15 09:21	1
Acetone	ND		50		ug/L			08/14/15 09:21	1
Benzene	ND		0.50		ug/L			08/14/15 09:21	1
Dichlorobromomethane	ND		0.50		ug/L			08/14/15 09:21	1
Bromobenzene	ND		1.0		ug/L			08/14/15 09:21	1
Chlorobromomethane	ND		1.0		ug/L			08/14/15 09:21	1
Bromoform	ND		1.0		ug/L			08/14/15 09:21	1
Bromomethane	ND		1.0		ug/L			08/14/15 09:21	1
2-Butanone (MEK)	ND		50		ug/L			08/14/15 09:21	1
n-Butylbenzene	ND		1.0		ug/L			08/14/15 09:21	1
sec-Butylbenzene	ND		1.0		ug/L			08/14/15 09:21	1
tert-Butylbenzene	ND		1.0		ug/L			08/14/15 09:21	1
Carbon disulfide	ND		5.0		ug/L			08/14/15 09:21	1
Carbon tetrachloride	ND		0.50		ug/L			08/14/15 09:21	1
Chlorobenzene	ND		0.50		ug/L			08/14/15 09:21	1
Chloroethane	ND		1.0		ug/L			08/14/15 09:21	1
Chloroform	ND		1.0		ug/L			08/14/15 09:21	1
Chloromethane	ND		1.0		ug/L			08/14/15 09:21	1
2-Chlorotoluene	ND		0.50		ug/L			08/14/15 09:21	1
4-Chlorotoluene	ND		0.50		ug/L			08/14/15 09:21	1
Chlorodibromomethane	ND		0.50		ug/L			08/14/15 09:21	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/14/15 09:21	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/14/15 09:21	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/14/15 09:21	1
1,3-Dichloropropane	ND		1.0		ug/L			08/14/15 09:21	1
1,1-Dichloropropene	ND		0.50		ug/L			08/14/15 09:21	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/14/15 09:21	1
Ethylene Dibromide	ND		0.50		ug/L			08/14/15 09:21	1
Dibromomethane	ND		0.50		ug/L			08/14/15 09:21	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/14/15 09:21	1
1,1-Dichloroethane	ND		0.50		ug/L			08/14/15 09:21	1
1,2-Dichloroethane	ND		0.50		ug/L			08/14/15 09:21	1
1,1-Dichloroethene	ND		0.50		ug/L			08/14/15 09:21	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 09:21	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/14/15 09:21	1
1,2-Dichloropropane	ND		0.50		ug/L			08/14/15 09:21	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 09:21	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/14/15 09:21	1
Ethylbenzene	ND		0.50		ug/L			08/14/15 09:21	1
Hexachlorobutadiene	ND		1.0		ug/L			08/14/15 09:21	1
2-Hexanone	ND		50		ug/L			08/14/15 09:21	1
Isopropylbenzene	ND		0.50		ug/L			08/14/15 09:21	1
4-Isopropyltoluene	ND		1.0		ug/L			08/14/15 09:21	1
Methylene Chloride	ND		5.0		ug/L			08/14/15 09:21	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/14/15 09:21	1
Naphthalene	ND		1.0		ug/L			08/14/15 09:21	1
N-Propylbenzene	ND		1.0		ug/L			08/14/15 09:21	1
Styrene	ND		0.50		ug/L			08/14/15 09:21	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-186968/7
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 09:21	1
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/14/15 09:21	1
Tetrachloroethene	ND		0.50		ug/L			08/14/15 09:21	1
Toluene	ND		0.50		ug/L			08/14/15 09:21	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/14/15 09:21	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/14/15 09:21	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/14/15 09:21	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/14/15 09:21	1
Trichloroethene	ND		0.50		ug/L			08/14/15 09:21	1
Trichlorofluoromethane	ND		1.0		ug/L			08/14/15 09:21	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/14/15 09:21	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/14/15 09:21	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/14/15 09:21	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/14/15 09:21	1
Vinyl acetate	ND		10		ug/L			08/14/15 09:21	1
Vinyl chloride	ND		0.50		ug/L			08/14/15 09:21	1
Xylenes, Total	ND		1.0		ug/L			08/14/15 09:21	1
2,2-Dichloropropane	ND		0.50		ug/L			08/14/15 09:21	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/14/15 09:21	1

Surrogate	MB	MB	Limits	Prepared	Analyzed	Dil Fac
	%Recovery	Qualifier				
4-Bromofluorobenzene	96		67 - 130		08/14/15 09:21	1
1,2-Dichloroethane-d4 (Surr)	105		72 - 130		08/14/15 09:21	1
Toluene-d8 (Surr)	97		70 - 130		08/14/15 09:21	1

Lab Sample ID: LCS 720-186968/10
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec. Limits
		Result	Qualifier				
Gasoline Range Organics (GRO) -C5-C12	500	458		ug/L		92	62 - 120

Surrogate	LCS	LCS	Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	99		67 - 130
1,2-Dichloroethane-d4 (Surr)	104		72 - 130
Toluene-d8 (Surr)	99		70 - 130

Lab Sample ID: LCS 720-186968/8
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec. Limits
		Result	Qualifier				
Methyl tert-butyl ether	25.0	25.3		ug/L		101	62 - 130
Acetone	125	121		ug/L		97	26 - 180
Benzene	25.0	25.4		ug/L		101	79 - 130
Dichlorobromomethane	25.0	25.9		ug/L		104	70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-186968/8
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Bromobenzene	25.0	24.5		ug/L		98	70 - 130
Chlorobromomethane	25.0	24.5		ug/L		98	70 - 130
Bromoform	25.0	26.2		ug/L		105	68 - 136
Bromomethane	25.0	25.6		ug/L		102	43 - 151
2-Butanone (MEK)	125	126		ug/L		101	54 - 130
n-Butylbenzene	25.0	25.7		ug/L		103	70 - 142
sec-Butylbenzene	25.0	25.8		ug/L		103	70 - 134
tert-Butylbenzene	25.0	25.8		ug/L		103	70 - 135
Carbon disulfide	25.0	23.4		ug/L		94	58 - 130
Carbon tetrachloride	25.0	27.2		ug/L		109	70 - 146
Chlorobenzene	25.0	26.5		ug/L		106	70 - 130
Chloroethane	25.0	25.6		ug/L		102	62 - 138
Chloroform	25.0	25.8		ug/L		103	70 - 130
Chloromethane	25.0	23.0		ug/L		92	52 - 175
2-Chlorotoluene	25.0	25.9		ug/L		104	70 - 130
4-Chlorotoluene	25.0	26.0		ug/L		104	70 - 130
Chlorodibromomethane	25.0	26.3		ug/L		105	70 - 145
1,2-Dichlorobenzene	25.0	25.2		ug/L		101	70 - 130
1,3-Dichlorobenzene	25.0	25.7		ug/L		103	70 - 130
1,4-Dichlorobenzene	25.0	25.9		ug/L		104	70 - 130
1,3-Dichloropropane	25.0	24.0		ug/L		96	70 - 130
1,1-Dichloropropane	25.0	27.0		ug/L		108	70 - 130
1,2-Dibromo-3-Chloropropane	25.0	24.6		ug/L		98	70 - 136
Ethylene Dibromide	25.0	24.9		ug/L		100	70 - 130
Dibromomethane	25.0	24.5		ug/L		98	70 - 130
Dichlorodifluoromethane	25.0	21.9		ug/L		88	34 - 132
1,1-Dichloroethane	25.0	25.5		ug/L		102	70 - 130
1,2-Dichloroethane	25.0	25.1		ug/L		100	61 - 132
1,1-Dichloroethene	25.0	22.5		ug/L		90	64 - 128
cis-1,2-Dichloroethene	25.0	25.5		ug/L		102	70 - 130
trans-1,2-Dichloroethene	25.0	24.3		ug/L		97	68 - 130
1,2-Dichloropropane	25.0	24.9		ug/L		99	70 - 130
cis-1,3-Dichloropropene	25.0	25.8		ug/L		103	70 - 130
trans-1,3-Dichloropropene	25.0	28.0		ug/L		112	70 - 140
Ethylbenzene	25.0	27.4		ug/L		109	80 - 120
Hexachlorobutadiene	25.0	25.8		ug/L		103	70 - 130
2-Hexanone	125	127		ug/L		101	60 - 164
Isopropylbenzene	25.0	26.4		ug/L		106	70 - 130
4-Isopropyltoluene	25.0	25.6		ug/L		102	70 - 130
Methylene Chloride	25.0	24.3		ug/L		97	70 - 147
4-Methyl-2-pentanone (MIBK)	125	126		ug/L		101	58 - 130
Naphthalene	25.0	23.3		ug/L		93	70 - 130
N-Propylbenzene	25.0	27.0		ug/L		108	70 - 130
Styrene	25.0	25.2		ug/L		101	70 - 130
1,1,1,2-Tetrachloroethane	25.0	26.3		ug/L		105	70 - 130
1,1,2,2-Tetrachloroethane	25.0	23.5		ug/L		94	70 - 130
Tetrachloroethene	25.0	25.8		ug/L		103	70 - 130
Toluene	25.0	26.4		ug/L		106	78 - 120

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-186968/8
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
1,2,3-Trichlorobenzene	25.0	24.3		ug/L		97	70 - 130
1,2,4-Trichlorobenzene	25.0	25.8		ug/L		103	70 - 130
1,1,1-Trichloroethane	25.0	26.0		ug/L		104	70 - 130
1,1,2-Trichloroethane	25.0	24.1		ug/L		96	70 - 130
Trichloroethene	25.0	25.6		ug/L		102	70 - 130
Trichlorofluoromethane	25.0	26.3		ug/L		105	66 - 132
1,2,3-Trichloropropane	25.0	24.1		ug/L		96	70 - 130
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	24.3		ug/L		97	42 - 162
1,2,4-Trimethylbenzene	25.0	26.1		ug/L		104	70 - 132
1,3,5-Trimethylbenzene	25.0	25.5		ug/L		102	70 - 130
Vinyl acetate	25.0	24.2		ug/L		97	43 - 163
Vinyl chloride	25.0	23.9		ug/L		96	54 - 135
m-Xylene & p-Xylene	25.0	27.3		ug/L		109	70 - 142
o-Xylene	25.0	27.5		ug/L		110	70 - 130
2,2-Dichloropropane	25.0	26.7		ug/L		107	70 - 140

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	102		72 - 130
Toluene-d8 (Surr)	97		70 - 130

Lab Sample ID: LCSD 720-186968/11
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Gasoline Range Organics (GRO) -C5-C12	500	458		ug/L		92	62 - 120	0	20

Surrogate	LCSD %Recovery	LCSD Qualifier	Limits
4-Bromofluorobenzene	100		67 - 130
1,2-Dichloroethane-d4 (Surr)	106		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCSD 720-186968/9
Matrix: Water
Analysis Batch: 186968

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	25.0	26.4		ug/L		106	62 - 130	4	20
Acetone	125	125		ug/L		100	26 - 180	4	30
Benzene	25.0	25.9		ug/L		104	79 - 130	2	20
Dichlorobromomethane	25.0	26.8		ug/L		107	70 - 130	3	20
Bromobenzene	25.0	25.1		ug/L		100	70 - 130	2	20
Chlorobromomethane	25.0	25.1		ug/L		100	70 - 130	2	20
Bromoform	25.0	26.8		ug/L		107	68 - 136	2	20
Bromomethane	25.0	25.5		ug/L		102	43 - 151	0	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-186968/9

Client Sample ID: Lab Control Sample Dup

Matrix: Water

Prep Type: Total/NA

Analysis Batch: 186968

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
2-Butanone (MEK)	125	134		ug/L		107	54 - 130	6	20
n-Butylbenzene	25.0	25.5		ug/L		102	70 - 142	1	20
sec-Butylbenzene	25.0	25.6		ug/L		102	70 - 134	1	20
tert-Butylbenzene	25.0	25.5		ug/L		102	70 - 135	1	20
Carbon disulfide	25.0	23.4		ug/L		93	58 - 130	0	20
Carbon tetrachloride	25.0	26.9		ug/L		108	70 - 146	1	20
Chlorobenzene	25.0	26.4		ug/L		106	70 - 130	0	20
Chloroethane	25.0	25.5		ug/L		102	62 - 138	1	20
Chloroform	25.0	26.0		ug/L		104	70 - 130	1	20
Chloromethane	25.0	22.7		ug/L		91	52 - 175	1	20
2-Chlorotoluene	25.0	26.1		ug/L		104	70 - 130	0	20
4-Chlorotoluene	25.0	26.3		ug/L		105	70 - 130	1	20
Chlorodibromomethane	25.0	27.1		ug/L		108	70 - 145	3	20
1,2-Dichlorobenzene	25.0	25.5		ug/L		102	70 - 130	1	20
1,3-Dichlorobenzene	25.0	25.6		ug/L		102	70 - 130	1	20
1,4-Dichlorobenzene	25.0	26.2		ug/L		105	70 - 130	1	20
1,3-Dichloropropane	25.0	25.0		ug/L		100	70 - 130	4	20
1,1-Dichloropropane	25.0	27.4		ug/L		109	70 - 130	1	20
1,2-Dibromo-3-Chloropropane	25.0	26.9		ug/L		108	70 - 136	9	20
Ethylene Dibromide	25.0	25.7		ug/L		103	70 - 130	3	20
Dibromomethane	25.0	25.4		ug/L		102	70 - 130	4	20
Dichlorodifluoromethane	25.0	21.4		ug/L		86	34 - 132	2	20
1,1-Dichloroethane	25.0	25.6		ug/L		102	70 - 130	0	20
1,2-Dichloroethane	25.0	25.5		ug/L		102	61 - 132	2	20
1,1-Dichloroethene	25.0	22.6		ug/L		90	64 - 128	1	20
cis-1,2-Dichloroethene	25.0	25.6		ug/L		103	70 - 130	1	20
trans-1,2-Dichloroethene	25.0	24.7		ug/L		99	68 - 130	2	20
1,2-Dichloropropane	25.0	25.4		ug/L		102	70 - 130	2	20
cis-1,3-Dichloropropene	25.0	27.1		ug/L		108	70 - 130	5	20
trans-1,3-Dichloropropene	25.0	29.0		ug/L		116	70 - 140	4	20
Ethylbenzene	25.0	27.2		ug/L		109	80 - 120	1	20
Hexachlorobutadiene	25.0	26.0		ug/L		104	70 - 130	1	20
2-Hexanone	125	138		ug/L		110	60 - 164	8	20
Isopropylbenzene	25.0	26.1		ug/L		105	70 - 130	1	20
4-Isopropyltoluene	25.0	25.3		ug/L		101	70 - 130	1	20
Methylene Chloride	25.0	24.6		ug/L		98	70 - 147	1	20
4-Methyl-2-pentanone (MIBK)	125	135		ug/L		108	58 - 130	6	20
Naphthalene	25.0	25.6		ug/L		102	70 - 130	9	20
N-Propylbenzene	25.0	27.0		ug/L		108	70 - 130	0	20
Styrene	25.0	25.5		ug/L		102	70 - 130	1	20
1,1,1,2-Tetrachloroethane	25.0	26.5		ug/L		106	70 - 130	1	20
1,1,2,2-Tetrachloroethane	25.0	25.1		ug/L		100	70 - 130	6	20
Tetrachloroethene	25.0	25.5		ug/L		102	70 - 130	1	20
Toluene	25.0	26.5		ug/L		106	78 - 120	0	20
1,2,3-Trichlorobenzene	25.0	25.8		ug/L		103	70 - 130	6	20
1,2,4-Trichlorobenzene	25.0	26.4		ug/L		106	70 - 130	2	20
1,1,1-Trichloroethane	25.0	26.0		ug/L		104	70 - 130	0	20
1,1,2-Trichloroethane	25.0	25.1		ug/L		100	70 - 130	4	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-186968/9

Matrix: Water

Analysis Batch: 186968

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Trichloroethene	25.0	25.7		ug/L		103	70 - 130	0	20
Trichlorofluoromethane	25.0	26.1		ug/L		104	66 - 132	1	20
1,2,3-Trichloropropane	25.0	26.1		ug/L		104	70 - 130	8	20
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	24.0		ug/L		96	42 - 162	1	20
1,2,4-Trimethylbenzene	25.0	26.1		ug/L		104	70 - 132	0	20
1,3,5-Trimethylbenzene	25.0	25.4		ug/L		102	70 - 130	0	20
Vinyl acetate	25.0	25.5		ug/L		102	43 - 163	5	20
Vinyl chloride	25.0	23.9		ug/L		96	54 - 135	0	20
m-Xylene & p-Xylene	25.0	27.0		ug/L		108	70 - 142	1	20
o-Xylene	25.0	27.3		ug/L		109	70 - 130	1	20
2,2-Dichloropropane	25.0	26.1		ug/L		104	70 - 140	2	20

Surrogate	LCSD %Recovery	LCSD Qualifier	Limits
4-Bromofluorobenzene	97		67 - 130
1,2-Dichloroethane-d4 (Surr)	103		72 - 130
Toluene-d8 (Surr)	99		70 - 130

Lab Sample ID: 720-66611-1 MS

Matrix: Water

Analysis Batch: 186968

Client Sample ID: MW-13

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	8.2		25.0	36.6		ug/L		113	60 - 138
Acetone	ND		125	113		ug/L		91	60 - 140
Benzene	ND		25.0	25.7		ug/L		103	60 - 140
Dichlorobromomethane	ND		25.0	27.5		ug/L		110	60 - 140
Bromobenzene	ND		25.0	25.4		ug/L		101	60 - 140
Chlorobromomethane	ND		25.0	25.3		ug/L		101	60 - 140
Bromoform	ND		25.0	28.4		ug/L		114	56 - 140
Bromomethane	ND		25.0	25.0		ug/L		100	23 - 140
2-Butanone (MEK)	ND		125	133		ug/L		106	60 - 140
n-Butylbenzene	ND		25.0	24.3		ug/L		97	60 - 140
sec-Butylbenzene	ND		25.0	24.8		ug/L		99	60 - 140
tert-Butylbenzene	ND		25.0	25.0		ug/L		100	60 - 140
Carbon disulfide	ND		25.0	22.2		ug/L		89	38 - 140
Carbon tetrachloride	ND		25.0	26.7		ug/L		107	60 - 140
Chlorobenzene	ND		25.0	26.0		ug/L		104	60 - 140
Chloroethane	ND		25.0	24.6		ug/L		98	51 - 140
Chloroform	ND		25.0	26.3		ug/L		105	60 - 140
Chloromethane	ND		25.0	20.7		ug/L		83	52 - 140
2-Chlorotoluene	ND		25.0	25.5		ug/L		102	60 - 140
4-Chlorotoluene	ND		25.0	25.6		ug/L		102	60 - 140
Chlorodibromomethane	ND		25.0	28.6		ug/L		114	60 - 140
1,2-Dichlorobenzene	ND		25.0	25.8		ug/L		103	60 - 140
1,3-Dichlorobenzene	ND		25.0	25.7		ug/L		103	60 - 140
1,4-Dichlorobenzene	ND		25.0	26.1		ug/L		104	60 - 140
1,3-Dichloropropane	ND		25.0	26.0		ug/L		104	60 - 140

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-66611-1 MS

Matrix: Water

Analysis Batch: 186968

Client Sample ID: MW-13

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
1,1-Dichloropropene	ND		25.0	26.4		ug/L		105	60 - 140
1,2-Dibromo-3-Chloropropane	ND		25.0	27.0		ug/L		108	60 - 140
Ethylene Dibromide	ND		25.0	26.8		ug/L		107	60 - 140
Dibromomethane	ND		25.0	26.2		ug/L		105	60 - 140
Dichlorodifluoromethane	ND		25.0	20.6		ug/L		82	38 - 140
1,1-Dichloroethane	ND		25.0	25.5		ug/L		102	60 - 140
1,2-Dichloroethane	2.8		25.0	30.2		ug/L		110	60 - 140
1,1-Dichloroethene	ND		25.0	21.4		ug/L		85	60 - 140
cis-1,2-Dichloroethene	ND		25.0	25.7		ug/L		103	60 - 140
trans-1,2-Dichloroethene	ND		25.0	24.0		ug/L		96	60 - 140
1,2-Dichloropropane	ND		25.0	26.0		ug/L		104	60 - 140
cis-1,3-Dichloropropene	ND		25.0	27.4		ug/L		110	60 - 140
trans-1,3-Dichloropropene	ND		25.0	30.0		ug/L		120	60 - 140
Ethylbenzene	ND		25.0	26.4		ug/L		106	60 - 140
Hexachlorobutadiene	ND		25.0	25.2		ug/L		101	60 - 140
2-Hexanone	ND		125	141		ug/L		112	60 - 140
Isopropylbenzene	ND		25.0	25.6		ug/L		102	60 - 140
4-Isopropyltoluene	ND		25.0	24.4		ug/L		98	60 - 140
Methylene Chloride	ND		25.0	26.2		ug/L		105	40 - 140
4-Methyl-2-pentanone (MIBK)	ND		125	140		ug/L		112	58 - 130
Naphthalene	ND		25.0	25.9		ug/L		104	56 - 140
N-Propylbenzene	ND		25.0	25.9		ug/L		103	60 - 140
Styrene	ND		25.0	24.7		ug/L		99	60 - 140
1,1,1,2-Tetrachloroethane	ND		25.0	26.6		ug/L		106	60 - 140
1,1,1,2,2-Tetrachloroethane	ND		25.0	25.2		ug/L		101	60 - 140
Tetrachloroethene	ND		25.0	24.9		ug/L		100	60 - 140
Toluene	ND		25.0	25.4		ug/L		102	60 - 140
1,2,3-Trichlorobenzene	ND		25.0	26.3		ug/L		105	60 - 140
1,2,4-Trichlorobenzene	ND		25.0	26.6		ug/L		106	60 - 140
1,1,1-Trichloroethane	ND		25.0	25.9		ug/L		103	60 - 140
1,1,1,2-Trichloroethane	ND		25.0	26.1		ug/L		104	60 - 140
Trichloroethene	ND		25.0	24.9		ug/L		100	60 - 140
Trichlorofluoromethane	ND		25.0	25.3		ug/L		101	60 - 140
1,2,3-Trichloropropane	ND		25.0	26.3		ug/L		105	60 - 140
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	23.0		ug/L		92	60 - 140
1,2,4-Trimethylbenzene	ND		25.0	26.0		ug/L		104	60 - 140
1,3,5-Trimethylbenzene	ND		25.0	24.6		ug/L		98	60 - 140
Vinyl acetate	ND		25.0	26.2		ug/L		105	40 - 140
Vinyl chloride	ND		25.0	22.9		ug/L		92	58 - 140
m-Xylene & p-Xylene	ND		25.0	26.3		ug/L		105	60 - 140
o-Xylene	ND		25.0	27.3		ug/L		109	60 - 140
2,2-Dichloropropane	ND		25.0	25.0		ug/L		100	60 - 140

Surrogate	MS %Recovery	MS Qualifier	Limits
4-Bromofluorobenzene	101		67 - 130
1,2-Dichloroethane-d4 (Surr)	108		72 - 130
Toluene-d8 (Surr)	100		70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Lab Sample ID: 720-66611-1 MSD
Matrix: Water
Analysis Batch: 186968

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	8.2		25.0	35.4		ug/L		109	60 - 138	3	20
Acetone	ND		125	104		ug/L		83	60 - 140	9	20
Benzene	ND		25.0	25.7		ug/L		103	60 - 140	0	20
Dichlorobromomethane	ND		25.0	27.1		ug/L		108	60 - 140	2	20
Bromobenzene	ND		25.0	24.9		ug/L		99	60 - 140	2	20
Chlorobromomethane	ND		25.0	25.3		ug/L		101	60 - 140	0	20
Bromoform	ND		25.0	27.6		ug/L		110	56 - 140	3	20
Bromomethane	ND		25.0	25.0		ug/L		100	23 - 140	0	20
2-Butanone (MEK)	ND		125	123		ug/L		99	60 - 140	8	20
n-Butylbenzene	ND		25.0	24.5		ug/L		98	60 - 140	1	20
sec-Butylbenzene	ND		25.0	24.9		ug/L		100	60 - 140	0	20
tert-Butylbenzene	ND		25.0	25.0		ug/L		100	60 - 140	0	20
Carbon disulfide	ND		25.0	22.5		ug/L		90	38 - 140	2	20
Carbon tetrachloride	ND		25.0	26.2		ug/L		105	60 - 140	2	20
Chlorobenzene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
Chloroethane	ND		25.0	24.8		ug/L		99	51 - 140	1	20
Chloroform	ND		25.0	26.2		ug/L		105	60 - 140	1	20
Chloromethane	ND		25.0	21.3		ug/L		85	52 - 140	3	20
2-Chlorotoluene	ND		25.0	25.5		ug/L		102	60 - 140	0	20
4-Chlorotoluene	ND		25.0	25.5		ug/L		102	60 - 140	0	20
Chlorodibromomethane	ND		25.0	28.0		ug/L		112	60 - 140	2	20
1,2-Dichlorobenzene	ND		25.0	25.6		ug/L		103	60 - 140	1	20
1,3-Dichlorobenzene	ND		25.0	25.5		ug/L		102	60 - 140	1	20
1,4-Dichlorobenzene	ND		25.0	26.1		ug/L		104	60 - 140	0	20
1,3-Dichloropropane	ND		25.0	25.3		ug/L		101	60 - 140	3	20
1,1-Dichloropropane	ND		25.0	26.2		ug/L		105	60 - 140	1	20
1,2-Dibromo-3-Chloropropane	ND		25.0	25.4		ug/L		102	60 - 140	6	20
Ethylene Dibromide	ND		25.0	25.5		ug/L		102	60 - 140	5	20
Dibromomethane	ND		25.0	25.2		ug/L		101	60 - 140	4	20
Dichlorodifluoromethane	ND		25.0	20.5		ug/L		82	38 - 140	0	20
1,1-Dichloroethane	ND		25.0	25.4		ug/L		101	60 - 140	0	20
1,2-Dichloroethane	2.8		25.0	29.2		ug/L		106	60 - 140	3	20
1,1-Dichloroethene	ND		25.0	21.6		ug/L		86	60 - 140	1	20
cis-1,2-Dichloroethene	ND		25.0	25.5		ug/L		102	60 - 140	1	20
trans-1,2-Dichloroethene	ND		25.0	24.1		ug/L		96	60 - 140	1	20
1,2-Dichloropropane	ND		25.0	25.5		ug/L		102	60 - 140	2	20
cis-1,3-Dichloropropene	ND		25.0	26.8		ug/L		107	60 - 140	2	20
trans-1,3-Dichloropropene	ND		25.0	29.1		ug/L		116	60 - 140	3	20
Ethylbenzene	ND		25.0	26.4		ug/L		106	60 - 140	0	20
Hexachlorobutadiene	ND		25.0	25.2		ug/L		101	60 - 140	0	20
2-Hexanone	ND		125	128		ug/L		102	60 - 140	9	20
Isopropylbenzene	ND		25.0	25.5		ug/L		102	60 - 140	0	20
4-Isopropyltoluene	ND		25.0	24.5		ug/L		98	60 - 140	0	20
Methylene Chloride	ND		25.0	26.2		ug/L		105	40 - 140	0	20
4-Methyl-2-pentanone (MIBK)	ND		125	130		ug/L		104	58 - 130	8	20
Naphthalene	ND		25.0	24.4		ug/L		98	56 - 140	6	20
N-Propylbenzene	ND		25.0	25.7		ug/L		103	60 - 140	1	20
Styrene	ND		25.0	24.4		ug/L		97	60 - 140	1	20
1,1,1,2-Tetrachloroethane	ND		25.0	26.8		ug/L		107	60 - 140	0	20
1,1,2,2-Tetrachloroethane	ND		25.0	24.4		ug/L		98	60 - 140	3	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-66611-1 MSD
Matrix: Water
Analysis Batch: 186968

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Tetrachloroethene	ND		25.0	24.4		ug/L		98	60 - 140	2	20
Toluene	ND		25.0	25.5		ug/L		102	60 - 140	0	20
1,2,3-Trichlorobenzene	ND		25.0	25.5		ug/L		102	60 - 140	3	20
1,2,4-Trichlorobenzene	ND		25.0	26.0		ug/L		104	60 - 140	2	20
1,1,1-Trichloroethane	ND		25.0	25.7		ug/L		103	60 - 140	1	20
1,1,2-Trichloroethane	ND		25.0	25.0		ug/L		100	60 - 140	4	20
Trichloroethene	ND		25.0	24.8		ug/L		99	60 - 140	1	20
Trichlorofluoromethane	ND		25.0	24.9		ug/L		100	60 - 140	1	20
1,2,3-Trichloropropane	ND		25.0	24.8		ug/L		99	60 - 140	6	20
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	22.7		ug/L		91	60 - 140	1	20
1,2,4-Trimethylbenzene	ND		25.0	25.7		ug/L		103	60 - 140	1	20
1,3,5-Trimethylbenzene	ND		25.0	24.7		ug/L		99	60 - 140	1	20
Vinyl acetate	ND		25.0	23.9		ug/L		96	40 - 140	9	20
Vinyl chloride	ND		25.0	23.2		ug/L		93	58 - 140	1	20
m-Xylene & p-Xylene	ND		25.0	26.2		ug/L		105	60 - 140	0	20
o-Xylene	ND		25.0	27.1		ug/L		109	60 - 140	0	20
2,2-Dichloropropane	ND		25.0	26.1		ug/L		104	60 - 140	4	20

Surrogate	MSD %Recovery	MSD Qualifier	Limits
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	105		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Method: 300.0 - Anions, Ion Chromatography

Lab Sample ID: MB 720-186700/4
Matrix: Water
Analysis Batch: 186700

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	ND		1.0		mg/L			08/10/15 20:46	1

Lab Sample ID: LCS 720-186700/5
Matrix: Water
Analysis Batch: 186700

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Sulfate	10.0	9.69		mg/L		97	90 - 110

Lab Sample ID: 720-66611-1 MS
Matrix: Water
Analysis Batch: 186700

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Sulfate	16		100	112		mg/L		97	80 - 120

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 300.0 - Anions, Ion Chromatography (Continued)

Lab Sample ID: 720-66611-1 MSD
Matrix: Water
Analysis Batch: 186700

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Sulfate	16		100	113		mg/L		97	80 - 120	0	20

Lab Sample ID: MB 720-186701/4
Matrix: Water
Analysis Batch: 186701

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/10/15 20:46	1
Nitrate as NO3	ND		1.0		mg/L			08/10/15 20:46	1

Lab Sample ID: LCS 720-186701/5
Matrix: Water
Analysis Batch: 186701

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrite as NO2	10.0	9.82		mg/L		98	90 - 110
Nitrate as NO3	10.0	9.49		mg/L		95	90 - 110

Lab Sample ID: 720-66611-1 MS
Matrix: Water
Analysis Batch: 186701

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrite as NO2	ND		100	102		mg/L		102	80 - 120
Nitrate as NO3	38		100	133		mg/L		95	80 - 120

Lab Sample ID: 720-66611-1 MSD
Matrix: Water
Analysis Batch: 186701

Client Sample ID: MW-13
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Nitrite as NO2	ND		100	103		mg/L		103	80 - 120	1	20
Nitrate as NO3	38		100	134		mg/L		96	80 - 120	1	20

Method: 200.7 Rev 4.4 - Metals (ICP)

Lab Sample ID: MB 720-186726/1-A
Matrix: Water
Analysis Batch: 186802

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 186726

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	ND		0.50		mg/L		08/11/15 09:43	08/11/15 22:27	1
Manganese	ND		0.020		mg/L		08/11/15 09:43	08/11/15 22:27	1
Potassium	ND		1.0		mg/L		08/11/15 09:43	08/11/15 22:27	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: 200.7 Rev 4.4 - Metals (ICP) (Continued)

Lab Sample ID: LCS 720-186726/2-A
Matrix: Water
Analysis Batch: 186802

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 186726

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Iron	10.0	9.66		mg/L		97	85 - 115
Manganese	1.00	0.961		mg/L		96	85 - 115
Potassium	10.0	9.65		mg/L		96	85 - 115

Lab Sample ID: LCSD 720-186726/3-A
Matrix: Water
Analysis Batch: 186802

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 186726

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Iron	10.0	9.70		mg/L		97	85 - 115	0	20
Manganese	1.00	0.963		mg/L		96	85 - 115	0	20
Potassium	10.0	9.57		mg/L		96	85 - 115	1	20

Lab Sample ID: 720-66611-6 MS
Matrix: Water
Analysis Batch: 186802

Client Sample ID: MW-16
Prep Type: Total/NA
Prep Batch: 186726

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Iron	2.5		10.0	12.1		mg/L		96	85 - 115
Manganese	0.21		1.00	1.17		mg/L		97	85 - 115
Potassium	ND		10.0	10.4		mg/L		100	85 - 115

Lab Sample ID: 720-66611-6 MSD
Matrix: Water
Analysis Batch: 186802

Client Sample ID: MW-16
Prep Type: Total/NA
Prep Batch: 186726

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Iron	2.5		10.0	12.0		mg/L		95	85 - 115	1	20
Manganese	0.21		1.00	1.16		mg/L		95	85 - 115	1	20
Potassium	ND		10.0	10.1		mg/L		97	85 - 115	3	20

Method: SM 3500 FE D - Iron, Ferrous and Ferric

Lab Sample ID: MB 720-186728/8
Matrix: Water
Analysis Batch: 186728

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferrous Iron	ND		0.10		mg/L			08/11/15 10:02	1

Lab Sample ID: LCS 720-186728/9
Matrix: Water
Analysis Batch: 186728

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Ferrous Iron	1.00	0.994		mg/L		99	80 - 120

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: SM 3500 FE D - Iron, Ferrous and Ferric (Continued)

Lab Sample ID: 720-66611-8 MS
Matrix: Water
Analysis Batch: 186728

Client Sample ID: MW-10
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Ferrous Iron	ND	HF	1.00	1.10		mg/L		110	75 - 125

Lab Sample ID: 720-66611-8 MSD
Matrix: Water
Analysis Batch: 186728

Client Sample ID: MW-10
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Ferrous Iron	ND	HF	1.00	1.06		mg/L		106	75 - 125	4	20

Method: SM 4500 NH3 G - Ammonia

Lab Sample ID: MB 500-299922/1-A
Matrix: Water
Analysis Batch: 299960

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 299922

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia	ND		0.20		mg/L		08/13/15 17:40	08/13/15 21:31	1

Lab Sample ID: LCS 500-299922/2-A
Matrix: Water
Analysis Batch: 299960

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 299922

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	2.50	2.32		mg/L		93	80 - 120

Lab Sample ID: 720-66611-6 MS
Matrix: Water
Analysis Batch: 299960

Client Sample ID: MW-16
Prep Type: Total/NA
Prep Batch: 299922

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	ND		2.50	2.27		mg/L		91	75 - 125

Lab Sample ID: 720-66611-6 MSD
Matrix: Water
Analysis Batch: 299960

Client Sample ID: MW-16
Prep Type: Total/NA
Prep Batch: 299922

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Ammonia	ND		2.50	2.40		mg/L		96	75 - 125	6	20

Method: SM 4500 P E - Orthophosphate

Lab Sample ID: MB 720-186760/7
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Orthophosphate as P	ND		0.020		mg/L			08/11/15 15:18	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method: SM 4500 P E - Orthophosphate (Continued)

Lab Sample ID: LCS 720-186760/8
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Orthophosphate as P	0.200	0.202		mg/L		101	90 - 110

Lab Sample ID: LCSD 720-186760/9
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Orthophosphate as P	0.200	0.203		mg/L		101	90 - 110	0	15

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

GC/MS VOA

Analysis Batch: 186968

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-1 MS	MW-13	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-1 MSD	MW-13	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-2	MW-14	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-3	MW-11R	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-4	MW-12	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-5	MW-15	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-6	MW-16	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-7	MW-9	Total/NA	Water	8260B/CA_LUFT MS	
720-66611-8	MW-10	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-186968/10	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-186968/8	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-186968/11	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-186968/9	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
MB 720-186968/7	Method Blank	Total/NA	Water	8260B/CA_LUFT MS	

HPLC/IC

Analysis Batch: 186700

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	300.0	
720-66611-1	MW-13	Total/NA	Water	300.0	
720-66611-1 MS	MW-13	Total/NA	Water	300.0	
720-66611-1 MSD	MW-13	Total/NA	Water	300.0	
720-66611-2	MW-14	Total/NA	Water	300.0	
720-66611-3	MW-11R	Total/NA	Water	300.0	
720-66611-4	MW-12	Total/NA	Water	300.0	
720-66611-5	MW-15	Total/NA	Water	300.0	
720-66611-6	MW-16	Total/NA	Water	300.0	
720-66611-7	MW-9	Total/NA	Water	300.0	
720-66611-8	MW-10	Total/NA	Water	300.0	
LCS 720-186700/5	Lab Control Sample	Total/NA	Water	300.0	
MB 720-186700/4	Method Blank	Total/NA	Water	300.0	

Analysis Batch: 186701

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	300.0	
720-66611-1	MW-13	Total/NA	Water	300.0	
720-66611-1 MS	MW-13	Total/NA	Water	300.0	

TestAmerica Pleasanton

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

HPLC/IC (Continued)

Analysis Batch: 186701 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1 MSD	MW-13	Total/NA	Water	300.0	
720-66611-2	MW-14	Total/NA	Water	300.0	
720-66611-3	MW-11R	Total/NA	Water	300.0	
720-66611-4	MW-12	Total/NA	Water	300.0	
720-66611-5	MW-15	Total/NA	Water	300.0	
720-66611-6	MW-16	Total/NA	Water	300.0	
720-66611-7	MW-9	Total/NA	Water	300.0	
720-66611-8	MW-10	Total/NA	Water	300.0	
LCS 720-186701/5	Lab Control Sample	Total/NA	Water	300.0	
MB 720-186701/4	Method Blank	Total/NA	Water	300.0	

Metals

Prep Batch: 186726

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	200.7	
720-66611-2	MW-14	Total/NA	Water	200.7	
720-66611-3	MW-11R	Total/NA	Water	200.7	
720-66611-4	MW-12	Total/NA	Water	200.7	
720-66611-5	MW-15	Total/NA	Water	200.7	
720-66611-6	MW-16	Total/NA	Water	200.7	
720-66611-6 MS	MW-16	Total/NA	Water	200.7	
720-66611-6 MSD	MW-16	Total/NA	Water	200.7	
720-66611-7	MW-9	Total/NA	Water	200.7	
720-66611-8	MW-10	Total/NA	Water	200.7	
LCS 720-186726/2-A	Lab Control Sample	Total/NA	Water	200.7	
LCSD 720-186726/3-A	Lab Control Sample Dup	Total/NA	Water	200.7	
MB 720-186726/1-A	Method Blank	Total/NA	Water	200.7	

Analysis Batch: 186802

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-2	MW-14	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-3	MW-11R	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-4	MW-12	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-5	MW-15	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-6	MW-16	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-6 MS	MW-16	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-6 MSD	MW-16	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-7	MW-9	Total/NA	Water	200.7 Rev 4.4	186726
720-66611-8	MW-10	Total/NA	Water	200.7 Rev 4.4	186726
LCS 720-186726/2-A	Lab Control Sample	Total/NA	Water	200.7 Rev 4.4	186726
LCSD 720-186726/3-A	Lab Control Sample Dup	Total/NA	Water	200.7 Rev 4.4	186726
MB 720-186726/1-A	Method Blank	Total/NA	Water	200.7 Rev 4.4	186726

General Chemistry

Analysis Batch: 186728

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	SM 3500 FE D	

TestAmerica Pleasanton

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

General Chemistry (Continued)

Analysis Batch: 186728 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-2	MW-14	Total/NA	Water	SM 3500 FE D	
720-66611-3	MW-11R	Total/NA	Water	SM 3500 FE D	
720-66611-4	MW-12	Total/NA	Water	SM 3500 FE D	
720-66611-5	MW-15	Total/NA	Water	SM 3500 FE D	
720-66611-6	MW-16	Total/NA	Water	SM 3500 FE D	
720-66611-7	MW-9	Total/NA	Water	SM 3500 FE D	
720-66611-8	MW-10	Total/NA	Water	SM 3500 FE D	
720-66611-8 MS	MW-10	Total/NA	Water	SM 3500 FE D	
720-66611-8 MSD	MW-10	Total/NA	Water	SM 3500 FE D	
LCS 720-186728/9	Lab Control Sample	Total/NA	Water	SM 3500 FE D	
MB 720-186728/8	Method Blank	Total/NA	Water	SM 3500 FE D	

Analysis Batch: 186760

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	SM 4500 P E	
720-66611-2	MW-14	Total/NA	Water	SM 4500 P E	
720-66611-3	MW-11R	Total/NA	Water	SM 4500 P E	
720-66611-4	MW-12	Total/NA	Water	SM 4500 P E	
720-66611-5	MW-15	Total/NA	Water	SM 4500 P E	
720-66611-6	MW-16	Total/NA	Water	SM 4500 P E	
720-66611-7	MW-9	Total/NA	Water	SM 4500 P E	
720-66611-8	MW-10	Total/NA	Water	SM 4500 P E	
LCS 720-186760/8	Lab Control Sample	Total/NA	Water	SM 4500 P E	
LCSD 720-186760/9	Lab Control Sample Dup	Total/NA	Water	SM 4500 P E	
MB 720-186760/7	Method Blank	Total/NA	Water	SM 4500 P E	

Analysis Batch: 187082

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	SM 3500 FE D	
720-66611-2	MW-14	Total/NA	Water	SM 3500 FE D	
720-66611-3	MW-11R	Total/NA	Water	SM 3500 FE D	
720-66611-4	MW-12	Total/NA	Water	SM 3500 FE D	
720-66611-5	MW-15	Total/NA	Water	SM 3500 FE D	
720-66611-6	MW-16	Total/NA	Water	SM 3500 FE D	
720-66611-7	MW-9	Total/NA	Water	SM 3500 FE D	
720-66611-8	MW-10	Total/NA	Water	SM 3500 FE D	

Prep Batch: 299922

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	SM 4500 NH3 B	
720-66611-2	MW-14	Total/NA	Water	SM 4500 NH3 B	
720-66611-3	MW-11R	Total/NA	Water	SM 4500 NH3 B	
720-66611-4	MW-12	Total/NA	Water	SM 4500 NH3 B	
720-66611-5	MW-15	Total/NA	Water	SM 4500 NH3 B	
720-66611-6	MW-16	Total/NA	Water	SM 4500 NH3 B	
720-66611-6 MS	MW-16	Total/NA	Water	SM 4500 NH3 B	
720-66611-6 MSD	MW-16	Total/NA	Water	SM 4500 NH3 B	
720-66611-7	MW-9	Total/NA	Water	SM 4500 NH3 B	
720-66611-8	MW-10	Total/NA	Water	SM 4500 NH3 B	
LCS 500-299922/2-A	Lab Control Sample	Total/NA	Water	SM 4500 NH3 B	
MB 500-299922/1-A	Method Blank	Total/NA	Water	SM 4500 NH3 B	

TestAmerica Pleasanton

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Analysis Batch: 299960

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66611-1	MW-13	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-2	MW-14	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-3	MW-11R	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-4	MW-12	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-5	MW-15	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-6	MW-16	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-6 MS	MW-16	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-6 MSD	MW-16	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-7	MW-9	Total/NA	Water	SM 4500 NH3 G	299922
720-66611-8	MW-10	Total/NA	Water	SM 4500 NH3 G	299922
LCS 500-299922/2-A	Lab Control Sample	Total/NA	Water	SM 4500 NH3 G	299922
MB 500-299922/1-A	Method Blank	Total/NA	Water	SM 4500 NH3 G	299922

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-13

Date Collected: 08/10/15 09:15

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 14:29	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186700	08/10/15 22:01	EYT	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/10/15 22:01	EYT	TAL PLS
Total/NA	Analysis	300.0		10	186700	08/10/15 22:19	EYT	TAL PLS
Total/NA	Analysis	300.0		10	186701	08/10/15 22:19	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:43	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/11/15 23:28	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:16	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-14

Date Collected: 08/10/15 10:00

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		50	186968	08/14/15 15:53	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186700	08/10/15 23:10	EYT	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/10/15 23:10	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:43	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/11/15 23:33	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		2	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:19	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-11R

Date Collected: 08/10/15 10:48

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		100	186968	08/14/15 16:21	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186700	08/10/15 23:44	EYT	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/10/15 23:44	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:43	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/11/15 23:38	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS

TestAmerica Pleasanton

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Client Sample ID: MW-11R

Date Collected: 08/10/15 10:48

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:22	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-12

Date Collected: 08/10/15 11:25

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 16:49	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186700	08/11/15 00:52	EYT	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/11/15 00:52	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:43	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/11/15 23:43	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:25	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-15

Date Collected: 08/10/15 12:40

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 17:17	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/11/15 01:27	EYT	TAL PLS
Total/NA	Analysis	300.0		10	186700	08/11/15 01:44	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:43	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/11/15 23:48	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:28	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-16

Date Collected: 08/10/15 13:25

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 17:45	LPL	TAL PLS

TestAmerica Pleasanton

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	300.0		1	186700	08/11/15 02:01	EYT	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/11/15 02:01	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:44	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/12/15 00:02	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:31	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-9

Date Collected: 08/10/15 14:50

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 18:13	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/11/15 02:35	EYT	TAL PLS
Total/NA	Analysis	300.0		10	186700	08/11/15 02:52	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:48	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/12/15 00:08	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:45	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Client Sample ID: MW-10

Date Collected: 08/10/15 15:20

Date Received: 08/10/15 17:03

Lab Sample ID: 720-66611-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	186968	08/14/15 18:41	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186701	08/11/15 03:09	EYT	TAL PLS
Total/NA	Analysis	300.0		10	186700	08/11/15 03:26	EYT	TAL PLS
Total/NA	Prep	200.7			186726	08/11/15 09:48	EFH	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	186802	08/12/15 00:13	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186728	08/11/15 10:02	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187082	08/11/15 10:10	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			299922	08/13/15 17:40	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	299960	08/13/15 22:48	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 15:18	EYT	TAL PLS

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

TestAmerica Pleasanton

Certification Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Laboratory: TestAmerica Pleasanton

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
California	State Program	9	2496	01-31-16

Analysis Method	Prep Method	Matrix	Analyte

Laboratory: TestAmerica Chicago

All certifications held by this laboratory are listed. Not all certifications are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
Alabama	State Program	4	40461	04-30-16
California	State Program	9	2903	04-30-16
Georgia	State Program	4	N/A	04-30-16
Georgia	State Program	4	939	04-30-16
Hawaii	State Program	9	N/A	04-30-16
Illinois	NELAP	5	100201	04-30-16
Indiana	State Program	5	C-IL-02	04-30-16
Iowa	State Program	7	82	05-01-16
Kansas	NELAP	7	E-10161	10-31-15
Kentucky (UST)	State Program	4	66	04-30-16
Kentucky (WW)	State Program	4	KY90023	12-31-15
Massachusetts	State Program	1	M-IL035	06-30-16
Mississippi	State Program	4	N/A	04-30-16
New York	NELAP	2	IL00035	04-01-16
North Carolina (WW/SW)	State Program	4	291	12-31-15 *
North Dakota	State Program	8	R-194	04-30-16
Oklahoma	State Program	6	8908	08-31-15 *
South Carolina	State Program	4	77001	04-30-16
USDA	Federal		P330-15-00038	02-11-18
Wisconsin	State Program	5	999580010	08-31-15 *
Wyoming	State Program	8	8TMS-Q	04-30-16

* Certification renewal pending - certification considered valid.

Method Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Method	Method Description	Protocol	Laboratory
8260B/CA_LUFTM S	8260B / CA LUFT MS	SW846	TAL PLS
300.0	Anions, Ion Chromatography	MCAWW	TAL PLS
200.7 Rev 4.4	Metals (ICP)	EPA	TAL PLS
SM 3500 FE D	Iron, Ferrous and Ferric	SM	TAL PLS
SM 4500 NH3 G	Ammonia	SM	TAL CHI
SM 4500 P E	Orthophosphate	SM	TAL PLS

Protocol References:

EPA = US Environmental Protection Agency

MCAWW = "Methods For Chemical Analysis Of Water And Wastes", EPA-600/4-79-020, March 1983 And Subsequent Revisions.

SM = "Standard Methods For The Examination Of Water And Wastewater",

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

Sample Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66611-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
720-66611-1	MW-13	Water	08/10/15 09:15	08/10/15 17:03
720-66611-2	MW-14	Water	08/10/15 10:00	08/10/15 17:03
720-66611-3	MW-11R	Water	08/10/15 10:48	08/10/15 17:03
720-66611-4	MW-12	Water	08/10/15 11:25	08/10/15 17:03
720-66611-5	MW-15	Water	08/10/15 12:40	08/10/15 17:03
720-66611-6	MW-16	Water	08/10/15 13:25	08/10/15 17:03
720-66611-7	MW-9	Water	08/10/15 14:50	08/10/15 17:03
720-66611-8	MW-10	Water	08/10/15 15:20	08/10/15 17:03

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

TestAmerica

THE LABORATORY ENVIRONMENTAL TESTING

TESTAMERICA Pleasanton Chain of Custody
 1220 Quarry Lane • Pleasanton CA 94566-4756
 Phone: (925) 484-1919 • Fax: (925) 600-3002

Reference #: 162984
 Date: 10 Aug 2015 Page 1 of 1

Analysis Request

Report To

Attn: Peter Sims
 Company: Ningo and Moore
 Address: 1915 Webster St, Ste 400
 Email: Psims@ningoandmoore.com
 Bill To: Peter Sims
 Sampled By: Emily Divsen
 Phone: 510-343-2000

Sample ID	Date	Time	Mat	Preserv	Fix	Other
MW-13	8/10	0915				
MW-14		1000				
MW-11E		1048				
MW-12		1125				
MW-15		1240				
MW-14		1325				
MW-9		1450				
MW-10		1520				

<input checked="" type="checkbox"/> Volatile Organics GC/MS (VOCs)	<input checked="" type="checkbox"/> EPA 8260B	<input type="checkbox"/> EPA 8260B	<input type="checkbox"/> Gas	<input type="checkbox"/> BTEX	<input type="checkbox"/> 5 Oxygenates	<input type="checkbox"/> DCA, EDB	<input type="checkbox"/> Ethanol
<input type="checkbox"/> HVOCS by	<input type="checkbox"/> EPA 8260B						
<input type="checkbox"/> TEPH EPA 8015B	<input type="checkbox"/> Silica Gel	<input type="checkbox"/> Diesel	<input type="checkbox"/> Motor Oil	<input type="checkbox"/> Other			
<input type="checkbox"/> SemiVolatile Organics GC/MS	<input type="checkbox"/> EPA 8270C						
<input type="checkbox"/> PNA/PAH's by	<input type="checkbox"/> 8270C	<input type="checkbox"/> 8270C SIM					
<input type="checkbox"/> Oil and Grease (EPA 1664/9071)	<input type="checkbox"/> Petroleum	<input type="checkbox"/> Total					
<input type="checkbox"/> Pesticides	<input type="checkbox"/> EPA 8081	<input type="checkbox"/> EPA 8082					
<input type="checkbox"/> CAM17 Metals (EPA 6010/7470/7471)							
<input type="checkbox"/> Metals: 6010B	<input type="checkbox"/> 200.7	<input type="checkbox"/> Lead	<input type="checkbox"/> LUFT	<input type="checkbox"/> RCRA	<input type="checkbox"/> Other: 200.7		
<input type="checkbox"/> Metals: 6020	<input type="checkbox"/> 200.8						
<input type="checkbox"/> W.E.T (STLC)	<input type="checkbox"/> W.E.T (DI)	<input type="checkbox"/> TCLP					
<input type="checkbox"/> Hex, Chrom by	<input type="checkbox"/> EPA 7196	<input type="checkbox"/> or EPA 7199					
<input type="checkbox"/> pH	<input type="checkbox"/> 9040	<input type="checkbox"/> SM4500					
<input type="checkbox"/> Spec Cond.	<input type="checkbox"/> Alkalinity	<input type="checkbox"/> TSS	<input type="checkbox"/> SS	<input type="checkbox"/> TDS			
<input type="checkbox"/> Anions: Cl	<input checked="" type="checkbox"/> SO ₄	<input checked="" type="checkbox"/> NO ₃	<input type="checkbox"/> F	<input type="checkbox"/> Br	<input checked="" type="checkbox"/> NO ₂	<input checked="" type="checkbox"/> PO ₄	
<input type="checkbox"/> Perchlorate by	EPA 314.0						
<input type="checkbox"/> COD	<input type="checkbox"/> EPA 410.4	<input type="checkbox"/> SM5220D					
<input type="checkbox"/> Turbidity							
<input type="checkbox"/> Iron							
<input type="checkbox"/> Iron by calc							

Project Info

Sample Receipt

Project Name/ #: Chun
 PO#: 401890004
 Head Space:
 Temp: 2.20c
 Credit Card Y/N:
 If yes, please call with payment information ASAP

1) Relinquished by:
 Signature: [Signature]
 Printed Name: Emily Divsen
 Date: 8/10/15
 Company: Ningo and Moore


2) Relinquished by:
 Signature: [Signature]
 Printed Name: T. Bullock
 Date: 8/10/15
 Company: [Company]

3) Relinquished by:
 Signature: [Signature]
 Printed Name: [Name]
 Date: [Date]
 Company: [Company]

T	10	5	4	3	2	1	Other:
A	Day	Day	Day	Day	Day	Day	

Report: Routine Level 3 Level 4 EDD EDF
 Special Instructions / Comments: Global ID

See Terms and Conditions on reverse

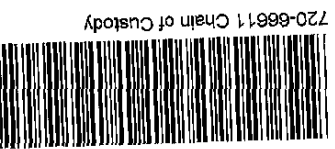

720-6661 Chain of Custody

Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-66611-1

Login Number: 66611

List Number: 1

Creator: Bullock, Tracy

List Source: TestAmerica Pleasanton

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	N/A	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	False	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-66611-1

Login Number: 66611

List Number: 2

Creator: Kelsey, Shawn M

List Source: TestAmerica Chicago

List Creation: 08/12/15 11:35 AM

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	True	

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING


ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Pleasanton
1220 Quarry Lane
Pleasanton, CA 94566
Tel: (925)484-1919

TestAmerica Job ID: 720-66639-1
Client Project/Site: Chun

For:
Ninyo & Moore
1956 Webster Street
Suite 400
Oakland, California 94612

Attn: Mr. Peter D. Sims



Authorized for release by:
8/19/2015 1:58:37 PM

Dimple Sharma, Senior Project Manager
(925)484-1919
dimple.sharma@testamericainc.com

LINKS

Review your project
results through
TotalAccess

Have a Question?



Visit us at:
www.testamericainc.com

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15



Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	8
Surrogate Summary	18
QC Sample Results	19
QC Association Summary	32
Lab Chronicle	35
Certification Summary	38
Method Summary	39
Sample Summary	40
Chain of Custody	41
Receipt Checklists	43

Definitions/Glossary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Qualifiers

Metals

Qualifier	Qualifier Description
F1	MS and/or MSD Recovery is outside acceptance limits.

General Chemistry

Qualifier	Qualifier Description
HF	Field parameter with a holding time of 15 minutes. Test performed by laboratory at client's request.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Job ID: 720-66639-1

Laboratory: TestAmerica Pleasanton

Narrative

**Job Narrative
720-66639-1**

Comments

No additional comments.

Receipt

The samples were received on 8/11/2015 4:40 PM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 2.7° C.

GC/MS VOA

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Metals

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

General Chemistry

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-8

Lab Sample ID: 720-66639-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	15		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
n-Butylbenzene	2.1		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
sec-Butylbenzene	3.5		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Ethylbenzene	3.7		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	22		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Naphthalene	83		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	23		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Toluene	15		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	1.1		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Vinyl acetate	18		10		ug/L	1		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	23		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	1600		50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Sulfate	1.2		1.0		mg/L	1		300.0	Total/NA
Iron	29	F1	0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.7		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	3.0		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	10	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	19	HF	2.0		mg/L	20		SM 3500 FE D	Total/NA
Ammonia	0.28		0.20		mg/L	1		SM 4500 NH3 G	Total/NA
Orthophosphate as P	0.25		0.020		mg/L	1		SM 4500 P E	Total/NA

Client Sample ID: MW-4R

Lab Sample ID: 720-66639-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	360		5.0		ug/L	10		8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	62		5.0		ug/L	10		8260B/CA_LUFT MS	Total/NA
Naphthalene	200		10		ug/L	10		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	130		10		ug/L	10		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	1200		500		ug/L	10		8260B/CA_LUFT MS	Total/NA
Sulfate	33		10		mg/L	10		300.0	Total/NA
Nitrate as NO3	5.0		1.0		mg/L	1		300.0	Total/NA
Iron	1.2		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.3		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	1.0		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	0.43	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	0.77	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ammonia	4.5		0.20		mg/L	1		SM 4500 NH3 G	Total/NA
Orthophosphate as P	0.061		0.020		mg/L	1		SM 4500 P E	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-5R

Lab Sample ID: 720-66639-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil	Fac	D	Method	Prep Type
Benzene	1200		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
Ethylbenzene	2900		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	100		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
Naphthalene	590		100		ug/L	100			8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	210		100		ug/L	100			8260B/CA_LUFT MS	Total/NA
Toluene	4100		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	1800		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	390		50		ug/L	100			8260B/CA_LUFT MS	Total/NA
Xylenes, Total	17000		100		ug/L	100			8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO)	39000		5000		ug/L	100			8260B/CA_LUFT MS	Total/NA
-C5-C12										
Nitrite as NO2	1.3		1.0		mg/L	1			300.0	Total/NA
Sulfate	31		10		mg/L	10			300.0	Total/NA
Nitrate as NO3	19		1.0		mg/L	1			300.0	Total/NA
Iron	3.8		0.50		mg/L	1			200.7 Rev 4.4	Total/NA
Manganese	0.88		0.020		mg/L	1			200.7 Rev 4.4	Total/NA
Ferric Iron	2.6	HF	0.10		mg/L	1			SM 3500 FE D	Total/NA
Ferrous Iron	1.2	HF	0.10		mg/L	1			SM 3500 FE D	Total/NA
Orthophosphate as P	0.35		0.020		mg/L	1			SM 4500 P E	Total/NA

Client Sample ID: MW-6R

Lab Sample ID: 720-66639-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil	Fac	D	Method	Prep Type
Benzene	22		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
Ethylbenzene	60		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
Isopropylbenzene	18		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
Naphthalene	69		5.0		ug/L	5			8260B/CA_LUFT MS	Total/NA
N-Propylbenzene	8.9		5.0		ug/L	5			8260B/CA_LUFT MS	Total/NA
Toluene	91		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	110		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	13		2.5		ug/L	5			8260B/CA_LUFT MS	Total/NA
Xylenes, Total	580		5.0		ug/L	5			8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO)	1700		250		ug/L	5			8260B/CA_LUFT MS	Total/NA
-C5-C12										
Nitrite as NO2	1.4		1.0		mg/L	1			300.0	Total/NA
Sulfate	43		10		mg/L	10			300.0	Total/NA
Nitrate as NO3	240		100		mg/L	100			300.0	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-6R (Continued)

Lab Sample ID: 720-66639-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Iron	0.91		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	1.1		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	1.1		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	0.91	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ammonia	0.69		0.20		mg/L	1		SM 4500 NH3 G	Total/NA
Orthophosphate as P	1.7		0.20		mg/L	10		SM 4500 P E	Total/NA

Client Sample ID: MW-7R

Lab Sample ID: 720-66639-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	1600		250		ug/L	500		8260B/CA_LUFT MS	Total/NA
Ethylbenzene	3200		250		ug/L	500		8260B/CA_LUFT MS	Total/NA
Naphthalene	520		500		ug/L	500		8260B/CA_LUFT MS	Total/NA
Toluene	20000		250		ug/L	500		8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	1700		250		ug/L	500		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	400		250		ug/L	500		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	22000		500		ug/L	500		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	69000		25000		ug/L	500		8260B/CA_LUFT MS	Total/NA
Nitrite as NO2	3.0		1.0		mg/L	1		300.0	Total/NA
Sulfate	25		10		mg/L	10		300.0	Total/NA
Nitrate as NO3	270		50		mg/L	50		300.0	Total/NA
Iron	8.9		0.50		mg/L	1		200.7 Rev 4.4	Total/NA
Manganese	2.1		0.020		mg/L	1		200.7 Rev 4.4	Total/NA
Potassium	1.7		1.0		mg/L	1		200.7 Rev 4.4	Total/NA
Ferric Iron	4.5	HF	0.10		mg/L	1		SM 3500 FE D	Total/NA
Ferrous Iron	4.4	HF	0.20		mg/L	2		SM 3500 FE D	Total/NA
Ammonia	1.2		0.20		mg/L	1		SM 4500 NH3 G	Total/NA
Orthophosphate as P	0.083		0.020		mg/L	1		SM 4500 P E	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-8
Date Collected: 08/11/15 08:40
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-1
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			08/17/15 15:49	1
Acetone	ND		50		ug/L			08/17/15 15:49	1
Benzene	15		0.50		ug/L			08/17/15 15:49	1
Dichlorobromomethane	ND		0.50		ug/L			08/17/15 15:49	1
Bromobenzene	ND		1.0		ug/L			08/17/15 15:49	1
Chlorobromomethane	ND		1.0		ug/L			08/17/15 15:49	1
Bromoform	ND		1.0		ug/L			08/17/15 15:49	1
Bromomethane	ND		1.0		ug/L			08/17/15 15:49	1
2-Butanone (MEK)	ND		50		ug/L			08/17/15 15:49	1
n-Butylbenzene	2.1		1.0		ug/L			08/17/15 15:49	1
sec-Butylbenzene	3.5		1.0		ug/L			08/17/15 15:49	1
tert-Butylbenzene	ND		1.0		ug/L			08/17/15 15:49	1
Carbon disulfide	ND		5.0		ug/L			08/17/15 15:49	1
Carbon tetrachloride	ND		0.50		ug/L			08/17/15 15:49	1
Chlorobenzene	ND		0.50		ug/L			08/17/15 15:49	1
Chloroethane	ND		1.0		ug/L			08/17/15 15:49	1
Chloroform	ND		1.0		ug/L			08/17/15 15:49	1
Chloromethane	ND		1.0		ug/L			08/17/15 15:49	1
2-Chlorotoluene	ND		0.50		ug/L			08/17/15 15:49	1
4-Chlorotoluene	ND		0.50		ug/L			08/17/15 15:49	1
Chlorodibromomethane	ND		0.50		ug/L			08/17/15 15:49	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/17/15 15:49	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/17/15 15:49	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/17/15 15:49	1
1,3-Dichloropropane	ND		1.0		ug/L			08/17/15 15:49	1
1,1-Dichloropropane	ND		0.50		ug/L			08/17/15 15:49	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/17/15 15:49	1
Ethylene Dibromide	ND		0.50		ug/L			08/17/15 15:49	1
Dibromomethane	ND		0.50		ug/L			08/17/15 15:49	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/17/15 15:49	1
1,1-Dichloroethane	ND		0.50		ug/L			08/17/15 15:49	1
1,2-Dichloroethane	ND		0.50		ug/L			08/17/15 15:49	1
1,1-Dichloroethene	ND		0.50		ug/L			08/17/15 15:49	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/17/15 15:49	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/17/15 15:49	1
1,2-Dichloropropane	ND		0.50		ug/L			08/17/15 15:49	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/17/15 15:49	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/17/15 15:49	1
Ethylbenzene	3.7		0.50		ug/L			08/17/15 15:49	1
Hexachlorobutadiene	ND		1.0		ug/L			08/17/15 15:49	1
2-Hexanone	ND		50		ug/L			08/17/15 15:49	1
Isopropylbenzene	22		0.50		ug/L			08/17/15 15:49	1
4-Isopropyltoluene	ND		1.0		ug/L			08/17/15 15:49	1
Methylene Chloride	ND		5.0		ug/L			08/17/15 15:49	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/17/15 15:49	1
Naphthalene	83		1.0		ug/L			08/17/15 15:49	1
N-Propylbenzene	23		1.0		ug/L			08/17/15 15:49	1
Styrene	ND		0.50		ug/L			08/17/15 15:49	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/17/15 15:49	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-8
Date Collected: 08/11/15 08:40
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-1
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/17/15 15:49	1
Tetrachloroethene	ND		0.50		ug/L			08/17/15 15:49	1
Toluene	15		0.50		ug/L			08/17/15 15:49	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/17/15 15:49	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/17/15 15:49	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/17/15 15:49	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/17/15 15:49	1
Trichloroethene	ND		0.50		ug/L			08/17/15 15:49	1
Trichlorofluoromethane	ND		1.0		ug/L			08/17/15 15:49	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/17/15 15:49	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/17/15 15:49	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/17/15 15:49	1
1,3,5-Trimethylbenzene	1.1		0.50		ug/L			08/17/15 15:49	1
Vinyl acetate	18		10		ug/L			08/17/15 15:49	1
Vinyl chloride	ND		0.50		ug/L			08/17/15 15:49	1
Xylenes, Total	23		1.0		ug/L			08/17/15 15:49	1
2,2-Dichloropropane	ND		0.50		ug/L			08/17/15 15:49	1
Gasoline Range Organics (GRO)	1600		50		ug/L			08/17/15 15:49	1
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	103		67 - 130		08/17/15 15:49	1
1,2-Dichloroethane-d4 (Surr)	104		72 - 130		08/17/15 15:49	1
Toluene-d8 (Surr)	99		70 - 130		08/17/15 15:49	1

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 19:06	1
Sulfate	1.2		1.0		mg/L			08/11/15 19:06	1
Nitrate as NO3	ND		1.0		mg/L			08/11/15 19:06	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	29	F1	0.50		mg/L		08/12/15 10:37	08/17/15 23:36	1
Manganese	1.7		0.020		mg/L		08/12/15 10:37	08/15/15 02:03	1
Potassium	3.0		1.0		mg/L		08/12/15 10:37	08/15/15 02:03	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	10	HF	0.10		mg/L			08/12/15 10:00	1
Ferrous Iron	19	HF	2.0		mg/L			08/12/15 09:50	20
Ammonia	0.28		0.20		mg/L		08/14/15 20:35	08/15/15 00:02	1
Orthophosphate as P	0.25		0.020		mg/L			08/11/15 20:10	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-4R
Date Collected: 08/11/15 10:00
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		5.0		ug/L			08/17/15 12:33	10
Acetone	ND		500		ug/L			08/17/15 12:33	10
Benzene	360		5.0		ug/L			08/17/15 12:33	10
Dichlorobromomethane	ND		5.0		ug/L			08/17/15 12:33	10
Bromobenzene	ND		10		ug/L			08/17/15 12:33	10
Chlorobromomethane	ND		10		ug/L			08/17/15 12:33	10
Bromoform	ND		10		ug/L			08/17/15 12:33	10
Bromomethane	ND		10		ug/L			08/17/15 12:33	10
2-Butanone (MEK)	ND		500		ug/L			08/17/15 12:33	10
n-Butylbenzene	ND		10		ug/L			08/17/15 12:33	10
sec-Butylbenzene	ND		10		ug/L			08/17/15 12:33	10
tert-Butylbenzene	ND		10		ug/L			08/17/15 12:33	10
Carbon disulfide	ND		50		ug/L			08/17/15 12:33	10
Carbon tetrachloride	ND		5.0		ug/L			08/17/15 12:33	10
Chlorobenzene	ND		5.0		ug/L			08/17/15 12:33	10
Chloroethane	ND		10		ug/L			08/17/15 12:33	10
Chloroform	ND		10		ug/L			08/17/15 12:33	10
Chloromethane	ND		10		ug/L			08/17/15 12:33	10
2-Chlorotoluene	ND		5.0		ug/L			08/17/15 12:33	10
4-Chlorotoluene	ND		5.0		ug/L			08/17/15 12:33	10
Chlorodibromomethane	ND		5.0		ug/L			08/17/15 12:33	10
1,2-Dichlorobenzene	ND		5.0		ug/L			08/17/15 12:33	10
1,3-Dichlorobenzene	ND		5.0		ug/L			08/17/15 12:33	10
1,4-Dichlorobenzene	ND		5.0		ug/L			08/17/15 12:33	10
1,3-Dichloropropane	ND		10		ug/L			08/17/15 12:33	10
1,1-Dichloropropane	ND		5.0		ug/L			08/17/15 12:33	10
1,2-Dibromo-3-Chloropropane	ND		10		ug/L			08/17/15 12:33	10
Ethylene Dibromide	ND		5.0		ug/L			08/17/15 12:33	10
Dibromomethane	ND		5.0		ug/L			08/17/15 12:33	10
Dichlorodifluoromethane	ND		5.0		ug/L			08/17/15 12:33	10
1,1-Dichloroethane	ND		5.0		ug/L			08/17/15 12:33	10
1,2-Dichloroethane	ND		5.0		ug/L			08/17/15 12:33	10
1,1-Dichloroethene	ND		5.0		ug/L			08/17/15 12:33	10
cis-1,2-Dichloroethene	ND		5.0		ug/L			08/17/15 12:33	10
trans-1,2-Dichloroethene	ND		5.0		ug/L			08/17/15 12:33	10
1,2-Dichloropropane	ND		5.0		ug/L			08/17/15 12:33	10
cis-1,3-Dichloropropene	ND		5.0		ug/L			08/17/15 12:33	10
trans-1,3-Dichloropropene	ND		5.0		ug/L			08/17/15 12:33	10
Ethylbenzene	ND		5.0		ug/L			08/17/15 12:33	10
Hexachlorobutadiene	ND		10		ug/L			08/17/15 12:33	10
2-Hexanone	ND		500		ug/L			08/17/15 12:33	10
Isopropylbenzene	62		5.0		ug/L			08/17/15 12:33	10
4-Isopropyltoluene	ND		10		ug/L			08/17/15 12:33	10
Methylene Chloride	ND		50		ug/L			08/17/15 12:33	10
4-Methyl-2-pentanone (MIBK)	ND		500		ug/L			08/17/15 12:33	10
Naphthalene	200		10		ug/L			08/17/15 12:33	10
N-Propylbenzene	ND		10		ug/L			08/17/15 12:33	10
Styrene	ND		5.0		ug/L			08/17/15 12:33	10
1,1,1,2-Tetrachloroethane	ND		5.0		ug/L			08/17/15 12:33	10

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-4R

Lab Sample ID: 720-66639-2

Date Collected: 08/11/15 10:00

Matrix: Water

Date Received: 08/11/15 16:40

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		5.0		ug/L			08/17/15 12:33	10
Tetrachloroethene	ND		5.0		ug/L			08/17/15 12:33	10
Toluene	ND		5.0		ug/L			08/17/15 12:33	10
1,2,3-Trichlorobenzene	ND		10		ug/L			08/17/15 12:33	10
1,2,4-Trichlorobenzene	ND		10		ug/L			08/17/15 12:33	10
1,1,1-Trichloroethane	ND		5.0		ug/L			08/17/15 12:33	10
1,1,2-Trichloroethane	ND		5.0		ug/L			08/17/15 12:33	10
Trichloroethene	ND		5.0		ug/L			08/17/15 12:33	10
Trichlorofluoromethane	ND		10		ug/L			08/17/15 12:33	10
1,2,3-Trichloropropane	ND		5.0		ug/L			08/17/15 12:33	10
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		5.0		ug/L			08/17/15 12:33	10
1,2,4-Trimethylbenzene	ND		5.0		ug/L			08/17/15 12:33	10
1,3,5-Trimethylbenzene	ND		5.0		ug/L			08/17/15 12:33	10
Vinyl acetate	ND		100		ug/L			08/17/15 12:33	10
Vinyl chloride	ND		5.0		ug/L			08/17/15 12:33	10
Xylenes, Total	130		10		ug/L			08/17/15 12:33	10
2,2-Dichloropropane	ND		5.0		ug/L			08/17/15 12:33	10
Gasoline Range Organics (GRO)	1200		500		ug/L			08/17/15 12:33	10
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	108		67 - 130		08/17/15 12:33	10
1,2-Dichloroethane-d4 (Surr)	105		72 - 130		08/17/15 12:33	10
Toluene-d8 (Surr)	104		70 - 130		08/17/15 12:33	10

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 19:40	1
Sulfate	33		10		mg/L			08/11/15 19:57	10
Nitrate as NO3	5.0		1.0		mg/L			08/11/15 19:40	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	1.2		0.50		mg/L		08/12/15 10:37	08/17/15 23:41	1
Manganese	1.3		0.020		mg/L		08/12/15 10:37	08/15/15 02:08	1
Potassium	1.0		1.0		mg/L		08/12/15 10:37	08/15/15 02:08	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	0.43	HF	0.10		mg/L			08/12/15 10:00	1
Ferrous Iron	0.77	HF	0.10		mg/L			08/12/15 09:50	1
Ammonia	4.5		0.20		mg/L		08/14/15 20:35	08/16/15 14:18	1
Orthophosphate as P	0.061		0.020		mg/L			08/11/15 20:10	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-5R

Date Collected: 08/11/15 11:25

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-3

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		50		ug/L			08/17/15 12:05	100
Acetone	ND		5000		ug/L			08/17/15 12:05	100
Benzene	1200		50		ug/L			08/17/15 12:05	100
Dichlorobromomethane	ND		50		ug/L			08/17/15 12:05	100
Bromobenzene	ND		100		ug/L			08/17/15 12:05	100
Chlorobromomethane	ND		100		ug/L			08/17/15 12:05	100
Bromoform	ND		100		ug/L			08/17/15 12:05	100
Bromomethane	ND		100		ug/L			08/17/15 12:05	100
2-Butanone (MEK)	ND		5000		ug/L			08/17/15 12:05	100
n-Butylbenzene	ND		100		ug/L			08/17/15 12:05	100
sec-Butylbenzene	ND		100		ug/L			08/17/15 12:05	100
tert-Butylbenzene	ND		100		ug/L			08/17/15 12:05	100
Carbon disulfide	ND		500		ug/L			08/17/15 12:05	100
Carbon tetrachloride	ND		50		ug/L			08/17/15 12:05	100
Chlorobenzene	ND		50		ug/L			08/17/15 12:05	100
Chloroethane	ND		100		ug/L			08/17/15 12:05	100
Chloroform	ND		100		ug/L			08/17/15 12:05	100
Chloromethane	ND		100		ug/L			08/17/15 12:05	100
2-Chlorotoluene	ND		50		ug/L			08/17/15 12:05	100
4-Chlorotoluene	ND		50		ug/L			08/17/15 12:05	100
Chlorodibromomethane	ND		50		ug/L			08/17/15 12:05	100
1,2-Dichlorobenzene	ND		50		ug/L			08/17/15 12:05	100
1,3-Dichlorobenzene	ND		50		ug/L			08/17/15 12:05	100
1,4-Dichlorobenzene	ND		50		ug/L			08/17/15 12:05	100
1,3-Dichloropropane	ND		100		ug/L			08/17/15 12:05	100
1,1-Dichloropropene	ND		50		ug/L			08/17/15 12:05	100
1,2-Dibromo-3-Chloropropane	ND		100		ug/L			08/17/15 12:05	100
Ethylene Dibromide	ND		50		ug/L			08/17/15 12:05	100
Dibromomethane	ND		50		ug/L			08/17/15 12:05	100
Dichlorodifluoromethane	ND		50		ug/L			08/17/15 12:05	100
1,1-Dichloroethane	ND		50		ug/L			08/17/15 12:05	100
1,2-Dichloroethane	ND		50		ug/L			08/17/15 12:05	100
1,1-Dichloroethene	ND		50		ug/L			08/17/15 12:05	100
cis-1,2-Dichloroethene	ND		50		ug/L			08/17/15 12:05	100
trans-1,2-Dichloroethene	ND		50		ug/L			08/17/15 12:05	100
1,2-Dichloropropane	ND		50		ug/L			08/17/15 12:05	100
cis-1,3-Dichloropropene	ND		50		ug/L			08/17/15 12:05	100
trans-1,3-Dichloropropene	ND		50		ug/L			08/17/15 12:05	100
Ethylbenzene	2900		50		ug/L			08/17/15 12:05	100
Hexachlorobutadiene	ND		100		ug/L			08/17/15 12:05	100
2-Hexanone	ND		5000		ug/L			08/17/15 12:05	100
Isopropylbenzene	100		50		ug/L			08/17/15 12:05	100
4-Isopropyltoluene	ND		100		ug/L			08/17/15 12:05	100
Methylene Chloride	ND		500		ug/L			08/17/15 12:05	100
4-Methyl-2-pentanone (MIBK)	ND		5000		ug/L			08/17/15 12:05	100
Naphthalene	590		100		ug/L			08/17/15 12:05	100
N-Propylbenzene	210		100		ug/L			08/17/15 12:05	100
Styrene	ND		50		ug/L			08/17/15 12:05	100
1,1,1,2-Tetrachloroethane	ND		50		ug/L			08/17/15 12:05	100

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-5R

Lab Sample ID: 720-66639-3

Date Collected: 08/11/15 11:25

Matrix: Water

Date Received: 08/11/15 16:40

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		50		ug/L			08/17/15 12:05	100
Tetrachloroethene	ND		50		ug/L			08/17/15 12:05	100
Toluene	4100		50		ug/L			08/17/15 12:05	100
1,2,3-Trichlorobenzene	ND		100		ug/L			08/17/15 12:05	100
1,2,4-Trichlorobenzene	ND		100		ug/L			08/17/15 12:05	100
1,1,1-Trichloroethane	ND		50		ug/L			08/17/15 12:05	100
1,1,2-Trichloroethane	ND		50		ug/L			08/17/15 12:05	100
Trichloroethene	ND		50		ug/L			08/17/15 12:05	100
Trichlorofluoromethane	ND		100		ug/L			08/17/15 12:05	100
1,2,3-Trichloropropane	ND		50		ug/L			08/17/15 12:05	100
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		50		ug/L			08/17/15 12:05	100
1,2,4-Trimethylbenzene	1800		50		ug/L			08/17/15 12:05	100
1,3,5-Trimethylbenzene	390		50		ug/L			08/17/15 12:05	100
Vinyl acetate	ND		1000		ug/L			08/17/15 12:05	100
Vinyl chloride	ND		50		ug/L			08/17/15 12:05	100
Xylenes, Total	17000		100		ug/L			08/17/15 12:05	100
2,2-Dichloropropane	ND		50		ug/L			08/17/15 12:05	100
Gasoline Range Organics (GRO)	39000		5000		ug/L			08/17/15 12:05	100
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	104		67 - 130		08/17/15 12:05	100
1,2-Dichloroethane-d4 (Surr)	107		72 - 130		08/17/15 12:05	100
Toluene-d8 (Surr)	101		70 - 130		08/17/15 12:05	100

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	1.3		1.0		mg/L			08/11/15 20:14	1
Sulfate	31		10		mg/L			08/11/15 20:31	10
Nitrate as NO3	19		1.0		mg/L			08/11/15 20:14	1

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	3.8		0.50		mg/L		08/12/15 10:37	08/17/15 23:46	1
Manganese	0.88		0.020		mg/L		08/12/15 10:37	08/15/15 02:14	1
Potassium	ND		1.0		mg/L		08/12/15 10:37	08/15/15 02:14	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	2.6	HF	0.10		mg/L			08/12/15 10:00	1
Ferrous Iron	1.2	HF	0.10		mg/L			08/12/15 09:50	1
Ammonia	ND		0.20		mg/L		08/14/15 20:35	08/15/15 00:14	1
Orthophosphate as P	0.35		0.020		mg/L			08/11/15 20:10	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-6R
Date Collected: 08/11/15 12:15
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-4
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		2.5		ug/L			08/17/15 13:01	5
Acetone	ND		250		ug/L			08/17/15 13:01	5
Benzene	22		2.5		ug/L			08/17/15 13:01	5
Dichlorobromomethane	ND		2.5		ug/L			08/17/15 13:01	5
Bromobenzene	ND		5.0		ug/L			08/17/15 13:01	5
Chlorobromomethane	ND		5.0		ug/L			08/17/15 13:01	5
Bromoform	ND		5.0		ug/L			08/17/15 13:01	5
Bromomethane	ND		5.0		ug/L			08/17/15 13:01	5
2-Butanone (MEK)	ND		250		ug/L			08/17/15 13:01	5
n-Butylbenzene	ND		5.0		ug/L			08/17/15 13:01	5
sec-Butylbenzene	ND		5.0		ug/L			08/17/15 13:01	5
tert-Butylbenzene	ND		5.0		ug/L			08/17/15 13:01	5
Carbon disulfide	ND		25		ug/L			08/17/15 13:01	5
Carbon tetrachloride	ND		2.5		ug/L			08/17/15 13:01	5
Chlorobenzene	ND		2.5		ug/L			08/17/15 13:01	5
Chloroethane	ND		5.0		ug/L			08/17/15 13:01	5
Chloroform	ND		5.0		ug/L			08/17/15 13:01	5
Chloromethane	ND		5.0		ug/L			08/17/15 13:01	5
2-Chlorotoluene	ND		2.5		ug/L			08/17/15 13:01	5
4-Chlorotoluene	ND		2.5		ug/L			08/17/15 13:01	5
Chlorodibromomethane	ND		2.5		ug/L			08/17/15 13:01	5
1,2-Dichlorobenzene	ND		2.5		ug/L			08/17/15 13:01	5
1,3-Dichlorobenzene	ND		2.5		ug/L			08/17/15 13:01	5
1,4-Dichlorobenzene	ND		2.5		ug/L			08/17/15 13:01	5
1,3-Dichloropropane	ND		5.0		ug/L			08/17/15 13:01	5
1,1-Dichloropropene	ND		2.5		ug/L			08/17/15 13:01	5
1,2-Dibromo-3-Chloropropane	ND		5.0		ug/L			08/17/15 13:01	5
Ethylene Dibromide	ND		2.5		ug/L			08/17/15 13:01	5
Dibromomethane	ND		2.5		ug/L			08/17/15 13:01	5
Dichlorodifluoromethane	ND		2.5		ug/L			08/17/15 13:01	5
1,1-Dichloroethane	ND		2.5		ug/L			08/17/15 13:01	5
1,2-Dichloroethane	ND		2.5		ug/L			08/17/15 13:01	5
1,1-Dichloroethene	ND		2.5		ug/L			08/17/15 13:01	5
cis-1,2-Dichloroethene	ND		2.5		ug/L			08/17/15 13:01	5
trans-1,2-Dichloroethene	ND		2.5		ug/L			08/17/15 13:01	5
1,2-Dichloropropane	ND		2.5		ug/L			08/17/15 13:01	5
cis-1,3-Dichloropropene	ND		2.5		ug/L			08/17/15 13:01	5
trans-1,3-Dichloropropene	ND		2.5		ug/L			08/17/15 13:01	5
Ethylbenzene	60		2.5		ug/L			08/17/15 13:01	5
Hexachlorobutadiene	ND		5.0		ug/L			08/17/15 13:01	5
2-Hexanone	ND		250		ug/L			08/17/15 13:01	5
Isopropylbenzene	18		2.5		ug/L			08/17/15 13:01	5
4-Isopropyltoluene	ND		5.0		ug/L			08/17/15 13:01	5
Methylene Chloride	ND		25		ug/L			08/17/15 13:01	5
4-Methyl-2-pentanone (MIBK)	ND		250		ug/L			08/17/15 13:01	5
Naphthalene	69		5.0		ug/L			08/17/15 13:01	5
N-Propylbenzene	8.9		5.0		ug/L			08/17/15 13:01	5
Styrene	ND		2.5		ug/L			08/17/15 13:01	5
1,1,1,2-Tetrachloroethane	ND		2.5		ug/L			08/17/15 13:01	5

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-6R

Lab Sample ID: 720-66639-4

Date Collected: 08/11/15 12:15

Matrix: Water

Date Received: 08/11/15 16:40

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		2.5		ug/L			08/17/15 13:01	5
Tetrachloroethene	ND		2.5		ug/L			08/17/15 13:01	5
Toluene	91		2.5		ug/L			08/17/15 13:01	5
1,2,3-Trichlorobenzene	ND		5.0		ug/L			08/17/15 13:01	5
1,2,4-Trichlorobenzene	ND		5.0		ug/L			08/17/15 13:01	5
1,1,1-Trichloroethane	ND		2.5		ug/L			08/17/15 13:01	5
1,1,2-Trichloroethane	ND		2.5		ug/L			08/17/15 13:01	5
Trichloroethene	ND		2.5		ug/L			08/17/15 13:01	5
Trichlorofluoromethane	ND		5.0		ug/L			08/17/15 13:01	5
1,2,3-Trichloropropane	ND		2.5		ug/L			08/17/15 13:01	5
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		2.5		ug/L			08/17/15 13:01	5
1,2,4-Trimethylbenzene	110		2.5		ug/L			08/17/15 13:01	5
1,3,5-Trimethylbenzene	13		2.5		ug/L			08/17/15 13:01	5
Vinyl acetate	ND		50		ug/L			08/17/15 13:01	5
Vinyl chloride	ND		2.5		ug/L			08/17/15 13:01	5
Xylenes, Total	580		5.0		ug/L			08/17/15 13:01	5
2,2-Dichloropropane	ND		2.5		ug/L			08/17/15 13:01	5
Gasoline Range Organics (GRO)	1700		250		ug/L			08/17/15 13:01	5
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	108		67 - 130		08/17/15 13:01	5
1,2-Dichloroethane-d4 (Surr)	106		72 - 130		08/17/15 13:01	5
Toluene-d8 (Surr)	105		70 - 130		08/17/15 13:01	5

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	1.4		1.0		mg/L			08/11/15 20:48	1
Sulfate	43		10		mg/L			08/11/15 21:05	10
Nitrate as NO3	240		100		mg/L			08/11/15 22:39	100

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	0.91		0.50		mg/L		08/12/15 10:37	08/17/15 23:51	1
Manganese	1.1		0.020		mg/L		08/12/15 10:37	08/15/15 02:19	1
Potassium	1.1		1.0		mg/L		08/12/15 10:37	08/15/15 02:19	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	0.91	HF	0.10		mg/L			08/12/15 10:00	1
Ferrous Iron	ND	HF	0.10		mg/L			08/12/15 09:50	1
Ammonia	0.69		0.20		mg/L		08/14/15 20:35	08/15/15 00:17	1
Orthophosphate as P	1.7		0.20		mg/L			08/11/15 20:10	10

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-7R

Date Collected: 08/11/15 13:20

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-5

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		250		ug/L			08/17/15 13:29	500
Acetone	ND		25000		ug/L			08/17/15 13:29	500
Benzene	1600		250		ug/L			08/17/15 13:29	500
Dichlorobromomethane	ND		250		ug/L			08/17/15 13:29	500
Bromobenzene	ND		500		ug/L			08/17/15 13:29	500
Chlorobromomethane	ND		500		ug/L			08/17/15 13:29	500
Bromoform	ND		500		ug/L			08/17/15 13:29	500
Bromomethane	ND		500		ug/L			08/17/15 13:29	500
2-Butanone (MEK)	ND		25000		ug/L			08/17/15 13:29	500
n-Butylbenzene	ND		500		ug/L			08/17/15 13:29	500
sec-Butylbenzene	ND		500		ug/L			08/17/15 13:29	500
tert-Butylbenzene	ND		500		ug/L			08/17/15 13:29	500
Carbon disulfide	ND		2500		ug/L			08/17/15 13:29	500
Carbon tetrachloride	ND		250		ug/L			08/17/15 13:29	500
Chlorobenzene	ND		250		ug/L			08/17/15 13:29	500
Chloroethane	ND		500		ug/L			08/17/15 13:29	500
Chloroform	ND		500		ug/L			08/17/15 13:29	500
Chloromethane	ND		500		ug/L			08/17/15 13:29	500
2-Chlorotoluene	ND		250		ug/L			08/17/15 13:29	500
4-Chlorotoluene	ND		250		ug/L			08/17/15 13:29	500
Chlorodibromomethane	ND		250		ug/L			08/17/15 13:29	500
1,2-Dichlorobenzene	ND		250		ug/L			08/17/15 13:29	500
1,3-Dichlorobenzene	ND		250		ug/L			08/17/15 13:29	500
1,4-Dichlorobenzene	ND		250		ug/L			08/17/15 13:29	500
1,3-Dichloropropane	ND		500		ug/L			08/17/15 13:29	500
1,1-Dichloropropene	ND		250		ug/L			08/17/15 13:29	500
1,2-Dibromo-3-Chloropropane	ND		500		ug/L			08/17/15 13:29	500
Ethylene Dibromide	ND		250		ug/L			08/17/15 13:29	500
Dibromomethane	ND		250		ug/L			08/17/15 13:29	500
Dichlorodifluoromethane	ND		250		ug/L			08/17/15 13:29	500
1,1-Dichloroethane	ND		250		ug/L			08/17/15 13:29	500
1,2-Dichloroethane	ND		250		ug/L			08/17/15 13:29	500
1,1-Dichloroethene	ND		250		ug/L			08/17/15 13:29	500
cis-1,2-Dichloroethene	ND		250		ug/L			08/17/15 13:29	500
trans-1,2-Dichloroethene	ND		250		ug/L			08/17/15 13:29	500
1,2-Dichloropropane	ND		250		ug/L			08/17/15 13:29	500
cis-1,3-Dichloropropene	ND		250		ug/L			08/17/15 13:29	500
trans-1,3-Dichloropropene	ND		250		ug/L			08/17/15 13:29	500
Ethylbenzene	3200		250		ug/L			08/17/15 13:29	500
Hexachlorobutadiene	ND		500		ug/L			08/17/15 13:29	500
2-Hexanone	ND		25000		ug/L			08/17/15 13:29	500
Isopropylbenzene	ND		250		ug/L			08/17/15 13:29	500
4-Isopropyltoluene	ND		500		ug/L			08/17/15 13:29	500
Methylene Chloride	ND		2500		ug/L			08/17/15 13:29	500
4-Methyl-2-pentanone (MIBK)	ND		25000		ug/L			08/17/15 13:29	500
Naphthalene	520		500		ug/L			08/17/15 13:29	500
N-Propylbenzene	ND		500		ug/L			08/17/15 13:29	500
Styrene	ND		250		ug/L			08/17/15 13:29	500
1,1,1,2-Tetrachloroethane	ND		250		ug/L			08/17/15 13:29	500

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-7R

Lab Sample ID: 720-66639-5

Date Collected: 08/11/15 13:20

Matrix: Water

Date Received: 08/11/15 16:40

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		250		ug/L			08/17/15 13:29	500
Tetrachloroethene	ND		250		ug/L			08/17/15 13:29	500
Toluene	20000		250		ug/L			08/17/15 13:29	500
1,2,3-Trichlorobenzene	ND		500		ug/L			08/17/15 13:29	500
1,2,4-Trichlorobenzene	ND		500		ug/L			08/17/15 13:29	500
1,1,1-Trichloroethane	ND		250		ug/L			08/17/15 13:29	500
1,1,2-Trichloroethane	ND		250		ug/L			08/17/15 13:29	500
Trichloroethene	ND		250		ug/L			08/17/15 13:29	500
Trichlorofluoromethane	ND		500		ug/L			08/17/15 13:29	500
1,2,3-Trichloropropane	ND		250		ug/L			08/17/15 13:29	500
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		250		ug/L			08/17/15 13:29	500
1,2,4-Trimethylbenzene	1700		250		ug/L			08/17/15 13:29	500
1,3,5-Trimethylbenzene	400		250		ug/L			08/17/15 13:29	500
Vinyl acetate	ND		5000		ug/L			08/17/15 13:29	500
Vinyl chloride	ND		250		ug/L			08/17/15 13:29	500
Xylenes, Total	22000		500		ug/L			08/17/15 13:29	500
2,2-Dichloropropane	ND		250		ug/L			08/17/15 13:29	500
Gasoline Range Organics (GRO)	69000		25000		ug/L			08/17/15 13:29	500
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	103		67 - 130		08/17/15 13:29	500
1,2-Dichloroethane-d4 (Surr)	108		72 - 130		08/17/15 13:29	500
Toluene-d8 (Surr)	102		70 - 130		08/17/15 13:29	500

Method: 300.0 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	3.0		1.0		mg/L			08/11/15 21:22	1
Sulfate	25		10		mg/L			08/11/15 21:39	10
Nitrate as NO3	270		50		mg/L			08/11/15 23:47	50

Method: 200.7 Rev 4.4 - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	8.9		0.50		mg/L		08/12/15 10:37	08/17/15 23:56	1
Manganese	2.1		0.020		mg/L		08/12/15 10:37	08/15/15 02:24	1
Potassium	1.7		1.0		mg/L		08/12/15 10:37	08/15/15 02:24	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferric Iron	4.5	HF	0.10		mg/L			08/12/15 10:00	1
Ferrous Iron	4.4	HF	0.20		mg/L			08/12/15 09:50	2
Ammonia	1.2		0.20		mg/L		08/14/15 20:35	08/15/15 00:19	1
Orthophosphate as P	0.083		0.020		mg/L			08/11/15 20:10	1

TestAmerica Pleasanton

Surrogate Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Matrix: Water

Prep Type: Total/NA

Percent Surrogate Recovery (Acceptance Limits)

Lab Sample ID	Client Sample ID	BFB (67-130)	12DCE (72-130)	TOL (70-130)
720-66639-1	MW-8	103	104	99
720-66639-1 MS	MW-8	98	105	100
720-66639-1 MSD	MW-8	101	103	99
720-66639-2	MW-4R	108	105	104
720-66639-3	MW-5R	104	107	101
720-66639-4	MW-6R	108	106	105
720-66639-5	MW-7R	103	108	102
LCS 720-187037/6	Lab Control Sample	97	104	98
LCS 720-187037/8	Lab Control Sample	102	110	101
LCSD 720-187037/7	Lab Control Sample Dup	98	105	100
LCSD 720-187037/9	Lab Control Sample Dup	99	107	99
MB 720-187037/5	Method Blank	101	106	97

Surrogate Legend

BFB = 4-Bromofluorobenzene

12DCE = 1,2-Dichloroethane-d4 (Surr)

TOL = Toluene-d8 (Surr)

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Lab Sample ID: MB 720-187037/5

Matrix: Water

Analysis Batch: 187037

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			08/17/15 09:21	1
Acetone	ND		50		ug/L			08/17/15 09:21	1
Benzene	ND		0.50		ug/L			08/17/15 09:21	1
Dichlorobromomethane	ND		0.50		ug/L			08/17/15 09:21	1
Bromobenzene	ND		1.0		ug/L			08/17/15 09:21	1
Chlorobromomethane	ND		1.0		ug/L			08/17/15 09:21	1
Bromoform	ND		1.0		ug/L			08/17/15 09:21	1
Bromomethane	ND		1.0		ug/L			08/17/15 09:21	1
2-Butanone (MEK)	ND		50		ug/L			08/17/15 09:21	1
n-Butylbenzene	ND		1.0		ug/L			08/17/15 09:21	1
sec-Butylbenzene	ND		1.0		ug/L			08/17/15 09:21	1
tert-Butylbenzene	ND		1.0		ug/L			08/17/15 09:21	1
Carbon disulfide	ND		5.0		ug/L			08/17/15 09:21	1
Carbon tetrachloride	ND		0.50		ug/L			08/17/15 09:21	1
Chlorobenzene	ND		0.50		ug/L			08/17/15 09:21	1
Chloroethane	ND		1.0		ug/L			08/17/15 09:21	1
Chloroform	ND		1.0		ug/L			08/17/15 09:21	1
Chloromethane	ND		1.0		ug/L			08/17/15 09:21	1
2-Chlorotoluene	ND		0.50		ug/L			08/17/15 09:21	1
4-Chlorotoluene	ND		0.50		ug/L			08/17/15 09:21	1
Chlorodibromomethane	ND		0.50		ug/L			08/17/15 09:21	1
1,2-Dichlorobenzene	ND		0.50		ug/L			08/17/15 09:21	1
1,3-Dichlorobenzene	ND		0.50		ug/L			08/17/15 09:21	1
1,4-Dichlorobenzene	ND		0.50		ug/L			08/17/15 09:21	1
1,3-Dichloropropane	ND		1.0		ug/L			08/17/15 09:21	1
1,1-Dichloropropene	ND		0.50		ug/L			08/17/15 09:21	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			08/17/15 09:21	1
Ethylene Dibromide	ND		0.50		ug/L			08/17/15 09:21	1
Dibromomethane	ND		0.50		ug/L			08/17/15 09:21	1
Dichlorodifluoromethane	ND		0.50		ug/L			08/17/15 09:21	1
1,1-Dichloroethane	ND		0.50		ug/L			08/17/15 09:21	1
1,2-Dichloroethane	ND		0.50		ug/L			08/17/15 09:21	1
1,1-Dichloroethene	ND		0.50		ug/L			08/17/15 09:21	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			08/17/15 09:21	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			08/17/15 09:21	1
1,2-Dichloropropane	ND		0.50		ug/L			08/17/15 09:21	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			08/17/15 09:21	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			08/17/15 09:21	1
Ethylbenzene	ND		0.50		ug/L			08/17/15 09:21	1
Hexachlorobutadiene	ND		1.0		ug/L			08/17/15 09:21	1
2-Hexanone	ND		50		ug/L			08/17/15 09:21	1
Isopropylbenzene	ND		0.50		ug/L			08/17/15 09:21	1
4-Isopropyltoluene	ND		1.0		ug/L			08/17/15 09:21	1
Methylene Chloride	ND		5.0		ug/L			08/17/15 09:21	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			08/17/15 09:21	1
Naphthalene	ND		1.0		ug/L			08/17/15 09:21	1
N-Propylbenzene	ND		1.0		ug/L			08/17/15 09:21	1
Styrene	ND		0.50		ug/L			08/17/15 09:21	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-187037/5
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			08/17/15 09:21	1
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			08/17/15 09:21	1
Tetrachloroethene	ND		0.50		ug/L			08/17/15 09:21	1
Toluene	ND		0.50		ug/L			08/17/15 09:21	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			08/17/15 09:21	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			08/17/15 09:21	1
1,1,1-Trichloroethane	ND		0.50		ug/L			08/17/15 09:21	1
1,1,2-Trichloroethane	ND		0.50		ug/L			08/17/15 09:21	1
Trichloroethene	ND		0.50		ug/L			08/17/15 09:21	1
Trichlorofluoromethane	ND		1.0		ug/L			08/17/15 09:21	1
1,2,3-Trichloropropane	ND		0.50		ug/L			08/17/15 09:21	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			08/17/15 09:21	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			08/17/15 09:21	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			08/17/15 09:21	1
Vinyl acetate	ND		10		ug/L			08/17/15 09:21	1
Vinyl chloride	ND		0.50		ug/L			08/17/15 09:21	1
Xylenes, Total	ND		1.0		ug/L			08/17/15 09:21	1
2,2-Dichloropropane	ND		0.50		ug/L			08/17/15 09:21	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			08/17/15 09:21	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	101		67 - 130		08/17/15 09:21	1
1,2-Dichloroethane-d4 (Surr)	106		72 - 130		08/17/15 09:21	1
Toluene-d8 (Surr)	97		70 - 130		08/17/15 09:21	1

Lab Sample ID: LCS 720-187037/6
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	25.0	25.5		ug/L		102	62 - 130
Acetone	125	130		ug/L		104	26 - 180
Benzene	25.0	25.5		ug/L		102	79 - 130
Dichlorobromomethane	25.0	26.2		ug/L		105	70 - 130
Bromobenzene	25.0	25.1		ug/L		100	70 - 130
Chlorobromomethane	25.0	24.7		ug/L		99	70 - 130
Bromoform	25.0	27.1		ug/L		108	68 - 136
Bromomethane	25.0	25.8		ug/L		103	43 - 151
2-Butanone (MEK)	125	139		ug/L		111	54 - 130
n-Butylbenzene	25.0	25.6		ug/L		103	70 - 142
sec-Butylbenzene	25.0	26.3		ug/L		105	70 - 134
tert-Butylbenzene	25.0	25.9		ug/L		103	70 - 135
Carbon disulfide	25.0	23.6		ug/L		94	58 - 130
Carbon tetrachloride	25.0	28.2		ug/L		113	70 - 146
Chlorobenzene	25.0	26.4		ug/L		106	70 - 130
Chloroethane	25.0	25.6		ug/L		103	62 - 138
Chloroform	25.0	25.9		ug/L		104	70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-187037/6
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Chloromethane	25.0	22.6		ug/L		90	52 - 175
2-Chlorotoluene	25.0	26.4		ug/L		106	70 - 130
4-Chlorotoluene	25.0	26.5		ug/L		106	70 - 130
Chlorodibromomethane	25.0	26.8		ug/L		107	70 - 145
1,2-Dichlorobenzene	25.0	25.3		ug/L		101	70 - 130
1,3-Dichlorobenzene	25.0	25.9		ug/L		104	70 - 130
1,4-Dichlorobenzene	25.0	26.3		ug/L		105	70 - 130
1,3-Dichloropropane	25.0	24.4		ug/L		97	70 - 130
1,1-Dichloropropene	25.0	27.7		ug/L		111	70 - 130
1,2-Dibromo-3-Chloropropane	25.0	27.8		ug/L		111	70 - 136
Ethylene Dibromide	25.0	25.3		ug/L		101	70 - 130
Dibromomethane	25.0	25.3		ug/L		101	70 - 130
Dichlorodifluoromethane	25.0	20.7		ug/L		83	34 - 132
1,1-Dichloroethane	25.0	25.7		ug/L		103	70 - 130
1,2-Dichloroethane	25.0	25.8		ug/L		103	61 - 132
1,1-Dichloroethene	25.0	23.1		ug/L		92	64 - 128
cis-1,2-Dichloroethene	25.0	25.6		ug/L		103	70 - 130
trans-1,2-Dichloroethene	25.0	25.3		ug/L		101	68 - 130
1,2-Dichloropropane	25.0	24.8		ug/L		99	70 - 130
cis-1,3-Dichloropropene	25.0	26.2		ug/L		105	70 - 130
trans-1,3-Dichloropropene	25.0	28.7		ug/L		115	70 - 140
Ethylbenzene	25.0	27.4		ug/L		110	80 - 120
Hexachlorobutadiene	25.0	25.7		ug/L		103	70 - 130
2-Hexanone	125	141		ug/L		113	60 - 164
Isopropylbenzene	25.0	26.5		ug/L		106	70 - 130
4-Isopropyltoluene	25.0	25.8		ug/L		103	70 - 130
Methylene Chloride	25.0	24.4		ug/L		98	70 - 147
4-Methyl-2-pentanone (MIBK)	125	139		ug/L		111	58 - 130
Naphthalene	25.0	25.5		ug/L		102	70 - 130
N-Propylbenzene	25.0	27.6		ug/L		110	70 - 130
Styrene	25.0	25.0		ug/L		100	70 - 130
1,1,1,2-Tetrachloroethane	25.0	26.2		ug/L		105	70 - 130
1,1,1,2,2-Tetrachloroethane	25.0	25.3		ug/L		101	70 - 130
Tetrachloroethene	25.0	26.2		ug/L		105	70 - 130
Toluene	25.0	26.4		ug/L		106	78 - 120
1,2,3-Trichlorobenzene	25.0	25.1		ug/L		100	70 - 130
1,2,4-Trichlorobenzene	25.0	26.1		ug/L		104	70 - 130
1,1,1-Trichloroethane	25.0	27.0		ug/L		108	70 - 130
1,1,2-Trichloroethane	25.0	24.7		ug/L		99	70 - 130
Trichloroethene	25.0	25.8		ug/L		103	70 - 130
Trichlorofluoromethane	25.0	27.3		ug/L		109	66 - 132
1,2,3-Trichloropropane	25.0	26.6		ug/L		106	70 - 130
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	24.5		ug/L		98	42 - 162
1,2,4-Trimethylbenzene	25.0	26.3		ug/L		105	70 - 132
1,3,5-Trimethylbenzene	25.0	25.7		ug/L		103	70 - 130
Vinyl acetate	25.0	25.5		ug/L		102	43 - 163
Vinyl chloride	25.0	24.5		ug/L		98	54 - 135

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-187037/6
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
m-Xylene & p-Xylene	25.0	27.3		ug/L		109	70 - 142
o-Xylene	25.0	27.6		ug/L		110	70 - 130
2,2-Dichloropropane	25.0	27.8		ug/L		111	70 - 140

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	97		67 - 130
1,2-Dichloroethane-d4 (Surr)	104		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCS 720-187037/8
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Gasoline Range Organics (GRO) -C5-C12	500	458		ug/L		92	62 - 120

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	102		67 - 130
1,2-Dichloroethane-d4 (Surr)	110		72 - 130
Toluene-d8 (Surr)	101		70 - 130

Lab Sample ID: LCSD 720-187037/7
Matrix: Water
Analysis Batch: 187037

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	25.0	27.4		ug/L		110	62 - 130	7	20
Acetone	125	143		ug/L		115	26 - 180	10	30
Benzene	25.0	25.7		ug/L		103	79 - 130	1	20
Dichlorobromomethane	25.0	26.8		ug/L		107	70 - 130	2	20
Bromobenzene	25.0	24.8		ug/L		99	70 - 130	1	20
Chlorobromomethane	25.0	25.5		ug/L		102	70 - 130	3	20
Bromoform	25.0	28.3		ug/L		113	68 - 136	4	20
Bromomethane	25.0	26.3		ug/L		105	43 - 151	2	20
2-Butanone (MEK)	125	152		ug/L		121	54 - 130	8	20
n-Butylbenzene	25.0	25.7		ug/L		103	70 - 142	0	20
sec-Butylbenzene	25.0	26.1		ug/L		105	70 - 134	0	20
tert-Butylbenzene	25.0	25.9		ug/L		104	70 - 135	0	20
Carbon disulfide	25.0	23.7		ug/L		95	58 - 130	1	20
Carbon tetrachloride	25.0	28.3		ug/L		113	70 - 146	0	20
Chlorobenzene	25.0	26.6		ug/L		106	70 - 130	1	20
Chloroethane	25.0	26.0		ug/L		104	62 - 138	2	20
Chloroform	25.0	26.3		ug/L		105	70 - 130	1	20
Chloromethane	25.0	23.2		ug/L		93	52 - 175	3	20
2-Chlorotoluene	25.0	25.8		ug/L		103	70 - 130	3	20
4-Chlorotoluene	25.0	26.1		ug/L		104	70 - 130	1	20
Chlorodibromomethane	25.0	27.8		ug/L		111	70 - 145	4	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-187037/7

Matrix: Water

Analysis Batch: 187037

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,2-Dichlorobenzene	25.0	25.5		ug/L		102	70 - 130	1	20
1,3-Dichlorobenzene	25.0	25.8		ug/L		103	70 - 130	1	20
1,4-Dichlorobenzene	25.0	26.3		ug/L		105	70 - 130	0	20
1,3-Dichloropropane	25.0	25.6		ug/L		102	70 - 130	5	20
1,1-Dichloropropene	25.0	27.6		ug/L		110	70 - 130	1	20
1,2-Dibromo-3-Chloropropane	25.0	29.0		ug/L		116	70 - 136	4	20
Ethylene Dibromide	25.0	26.3		ug/L		105	70 - 130	4	20
Dibromomethane	25.0	26.1		ug/L		104	70 - 130	3	20
Dichlorodifluoromethane	25.0	21.0		ug/L		84	34 - 132	1	20
1,1-Dichloroethane	25.0	25.9		ug/L		104	70 - 130	1	20
1,2-Dichloroethane	25.0	26.5		ug/L		106	61 - 132	3	20
1,1-Dichloroethene	25.0	23.4		ug/L		94	64 - 128	1	20
cis-1,2-Dichloroethene	25.0	25.9		ug/L		103	70 - 130	1	20
trans-1,2-Dichloroethene	25.0	25.0		ug/L		100	68 - 130	1	20
1,2-Dichloropropane	25.0	25.7		ug/L		103	70 - 130	3	20
cis-1,3-Dichloropropene	25.0	27.0		ug/L		108	70 - 130	3	20
trans-1,3-Dichloropropene	25.0	29.5		ug/L		118	70 - 140	3	20
Ethylbenzene	25.0	27.1		ug/L		109	80 - 120	1	20
Hexachlorobutadiene	25.0	25.8		ug/L		103	70 - 130	0	20
2-Hexanone	125	163		ug/L		130	60 - 164	14	20
Isopropylbenzene	25.0	26.7		ug/L		107	70 - 130	1	20
4-Isopropyltoluene	25.0	25.5		ug/L		102	70 - 130	1	20
Methylene Chloride	25.0	24.8		ug/L		99	70 - 147	2	20
4-Methyl-2-pentanone (MIBK)	125	154		ug/L		123	58 - 130	10	20
Naphthalene	25.0	26.2		ug/L		105	70 - 130	3	20
N-Propylbenzene	25.0	26.9		ug/L		108	70 - 130	2	20
Styrene	25.0	25.4		ug/L		101	70 - 130	1	20
1,1,1,2-Tetrachloroethane	25.0	26.5		ug/L		106	70 - 130	1	20
1,1,2,2-Tetrachloroethane	25.0	26.1		ug/L		104	70 - 130	3	20
Tetrachloroethene	25.0	26.1		ug/L		105	70 - 130	0	20
Toluene	25.0	26.5		ug/L		106	78 - 120	0	20
1,2,3-Trichlorobenzene	25.0	25.0		ug/L		100	70 - 130	0	20
1,2,4-Trichlorobenzene	25.0	26.2		ug/L		105	70 - 130	0	20
1,1,1-Trichloroethane	25.0	26.9		ug/L		108	70 - 130	0	20
1,1,2-Trichloroethane	25.0	26.0		ug/L		104	70 - 130	5	20
Trichloroethene	25.0	26.0		ug/L		104	70 - 130	1	20
Trichlorofluoromethane	25.0	27.2		ug/L		109	66 - 132	0	20
1,2,3-Trichloropropane	25.0	27.7		ug/L		111	70 - 130	4	20
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	25.1		ug/L		100	42 - 162	2	20
1,2,4-Trimethylbenzene	25.0	26.0		ug/L		104	70 - 132	1	20
1,3,5-Trimethylbenzene	25.0	25.3		ug/L		101	70 - 130	1	20
Vinyl acetate	25.0	26.1		ug/L		104	43 - 163	2	20
Vinyl chloride	25.0	24.6		ug/L		99	54 - 135	1	20
m-Xylene & p-Xylene	25.0	27.1		ug/L		108	70 - 142	1	20
o-Xylene	25.0	27.6		ug/L		110	70 - 130	0	20
2,2-Dichloropropane	25.0	26.9		ug/L		107	70 - 140	4	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-187037/7

Matrix: Water

Analysis Batch: 187037

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	105		72 - 130
Toluene-d8 (Surr)	100		70 - 130

Lab Sample ID: LCSD 720-187037/9

Matrix: Water

Analysis Batch: 187037

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Gasoline Range Organics (GRO) -C5-C12	500	462		ug/L		92	62 - 120	1	20

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	99		67 - 130
1,2-Dichloroethane-d4 (Surr)	107		72 - 130
Toluene-d8 (Surr)	99		70 - 130

Lab Sample ID: 720-66639-1 MS

Matrix: Water

Analysis Batch: 187037

Client Sample ID: MW-8

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS		Unit	D	%Rec	%Rec. Limits
				Result	Qualifier				
Methyl tert-butyl ether	ND		25.0	26.8		ug/L		107	60 - 138
Acetone	ND		125	138		ug/L		110	60 - 140
Benzene	15		25.0	45.1		ug/L		121	60 - 140
Dichlorobromomethane	ND		25.0	26.8		ug/L		107	60 - 140
Bromobenzene	ND		25.0	24.9		ug/L		99	60 - 140
Chlorobromomethane	ND		25.0	24.9		ug/L		100	60 - 140
Bromoform	ND		25.0	28.0		ug/L		112	56 - 140
Bromomethane	ND		25.0	23.5		ug/L		94	23 - 140
2-Butanone (MEK)	ND		125	131		ug/L		105	60 - 140
n-Butylbenzene	2.1		25.0	27.6		ug/L		102	60 - 140
sec-Butylbenzene	3.5		25.0	29.7		ug/L		105	60 - 140
tert-Butylbenzene	ND		25.0	25.5		ug/L		101	60 - 140
Carbon disulfide	ND		25.0	22.1		ug/L		88	38 - 140
Carbon tetrachloride	ND		25.0	25.6		ug/L		102	60 - 140
Chlorobenzene	ND		25.0	26.2		ug/L		105	60 - 140
Chloroethane	ND		25.0	24.8		ug/L		99	51 - 140
Chloroform	ND		25.0	26.0		ug/L		104	60 - 140
Chloromethane	ND		25.0	19.8		ug/L		79	52 - 140
2-Chlorotoluene	ND		25.0	25.8		ug/L		103	60 - 140
4-Chlorotoluene	ND		25.0	26.2		ug/L		105	60 - 140
Chlorodibromomethane	ND		25.0	28.1		ug/L		113	60 - 140
1,2-Dichlorobenzene	ND		25.0	25.6		ug/L		103	60 - 140
1,3-Dichlorobenzene	ND		25.0	25.6		ug/L		102	60 - 140
1,4-Dichlorobenzene	ND		25.0	26.1		ug/L		104	60 - 140
1,3-Dichloropropane	ND		25.0	25.3		ug/L		101	60 - 140
1,1-Dichloropropene	ND		25.0	25.6		ug/L		102	60 - 140

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-66639-1 MS

Matrix: Water

Analysis Batch: 187037

Client Sample ID: MW-8

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
1,2-Dibromo-3-Chloropropane	ND		25.0	26.9		ug/L		108	60 - 140
Ethylene Dibromide	ND		25.0	25.4		ug/L		101	60 - 140
Dibromomethane	ND		25.0	25.8		ug/L		103	60 - 140
Dichlorodifluoromethane	ND		25.0	18.1		ug/L		72	38 - 140
1,1-Dichloroethane	ND		25.0	25.3		ug/L		101	60 - 140
1,2-Dichloroethane	ND		25.0	26.0		ug/L		104	60 - 140
1,1-Dichloroethene	ND		25.0	21.2		ug/L		85	60 - 140
cis-1,2-Dichloroethene	ND		25.0	25.5		ug/L		102	60 - 140
trans-1,2-Dichloroethene	ND		25.0	23.3		ug/L		93	60 - 140
1,2-Dichloropropane	ND		25.0	26.1		ug/L		105	60 - 140
cis-1,3-Dichloropropene	ND		25.0	26.6		ug/L		106	60 - 140
trans-1,3-Dichloropropene	ND		25.0	29.2		ug/L		117	60 - 140
Ethylbenzene	3.7		25.0	31.5		ug/L		111	60 - 140
Hexachlorobutadiene	ND		25.0	25.1		ug/L		100	60 - 140
2-Hexanone	ND		125	141		ug/L		113	60 - 140
Isopropylbenzene	22		25.0	54.4		ug/L		128	60 - 140
4-Isopropyltoluene	ND		25.0	24.7		ug/L		99	60 - 140
Methylene Chloride	ND		25.0	24.6		ug/L		99	40 - 140
4-Methyl-2-pentanone (MIBK)	ND		125	140		ug/L		112	58 - 130
Naphthalene	83		25.0	112		ug/L		115	56 - 140
N-Propylbenzene	23		25.0	56.5		ug/L		133	60 - 140
Styrene	ND		25.0	25.2		ug/L		101	60 - 140
1,1,1,2-Tetrachloroethane	ND		25.0	26.5		ug/L		106	60 - 140
1,1,2,2-Tetrachloroethane	ND		25.0	26.4		ug/L		106	60 - 140
Tetrachloroethene	ND		25.0	24.4		ug/L		98	60 - 140
Toluene	15		25.0	45.6		ug/L		121	60 - 140
1,2,3-Trichlorobenzene	ND		25.0	26.5		ug/L		106	60 - 140
1,2,4-Trichlorobenzene	ND		25.0	26.3		ug/L		105	60 - 140
1,1,1-Trichloroethane	ND		25.0	25.1		ug/L		100	60 - 140
1,1,2-Trichloroethane	ND		25.0	27.1		ug/L		108	60 - 140
Trichloroethene	ND		25.0	24.6		ug/L		98	60 - 140
Trichlorofluoromethane	ND		25.0	24.3		ug/L		97	60 - 140
1,2,3-Trichloropropane	ND		25.0	25.4		ug/L		102	60 - 140
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	22.5		ug/L		90	60 - 140
1,2,4-Trimethylbenzene	ND		25.0	26.2		ug/L		105	60 - 140
1,3,5-Trimethylbenzene	1.1		25.0	26.2		ug/L		101	60 - 140
Vinyl acetate	18		25.0	51.0		ug/L		132	40 - 140
Vinyl chloride	ND		25.0	22.6		ug/L		90	58 - 140
m-Xylene & p-Xylene	21		25.0	53.6		ug/L		129	60 - 140
o-Xylene	1.5		25.0	29.1		ug/L		111	60 - 140
2,2-Dichloropropane	ND		25.0	23.5		ug/L		94	60 - 140

Surrogate	MS %Recovery	MS Qualifier	MS Limits
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	105		72 - 130
Toluene-d8 (Surr)	100		70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-66639-1 MSD
Matrix: Water
Analysis Batch: 187037

Client Sample ID: MW-8
Prep Type: Total/NA

Analyte	Sample	Sample Qualifier	Spike Added	MSD	MSD Qualifier	Unit	D	%Rec	%Rec.	RPD	RPD Limit
	Result			Result					Limits		
Methyl tert-butyl ether	ND		25.0	26.6		ug/L		106	60 - 138	1	20
Acetone	ND		125	139		ug/L		111	60 - 140	1	20
Benzene	15		25.0	45.2		ug/L		121	60 - 140	0	20
Dichlorobromomethane	ND		25.0	26.9		ug/L		108	60 - 140	0	20
Bromobenzene	ND		25.0	25.0		ug/L		100	60 - 140	0	20
Chlorobromomethane	ND		25.0	25.0		ug/L		100	60 - 140	0	20
Bromoform	ND		25.0	28.8		ug/L		115	56 - 140	3	20
Bromomethane	ND		25.0	24.1		ug/L		96	23 - 140	3	20
2-Butanone (MEK)	ND		125	133		ug/L		106	60 - 140	1	20
n-Butylbenzene	2.1		25.0	27.9		ug/L		103	60 - 140	1	20
sec-Butylbenzene	3.5		25.0	30.4		ug/L		108	60 - 140	2	20
tert-Butylbenzene	ND		25.0	25.8		ug/L		102	60 - 140	1	20
Carbon disulfide	ND		25.0	22.2		ug/L		89	38 - 140	0	20
Carbon tetrachloride	ND		25.0	25.3		ug/L		101	60 - 140	1	20
Chlorobenzene	ND		25.0	26.4		ug/L		106	60 - 140	1	20
Chloroethane	ND		25.0	25.3		ug/L		101	51 - 140	2	20
Chloroform	ND		25.0	25.8		ug/L		103	60 - 140	1	20
Chloromethane	ND		25.0	19.3		ug/L		77	52 - 140	3	20
2-Chlorotoluene	ND		25.0	25.6		ug/L		103	60 - 140	1	20
4-Chlorotoluene	ND		25.0	26.2		ug/L		105	60 - 140	0	20
Chlorodibromomethane	ND		25.0	27.7		ug/L		111	60 - 140	2	20
1,2-Dichlorobenzene	ND		25.0	26.0		ug/L		104	60 - 140	1	20
1,3-Dichlorobenzene	ND		25.0	26.1		ug/L		104	60 - 140	2	20
1,4-Dichlorobenzene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
1,3-Dichloropropane	ND		25.0	25.4		ug/L		102	60 - 140	0	20
1,1-Dichloropropene	ND		25.0	25.5		ug/L		102	60 - 140	0	20
1,2-Dibromo-3-Chloropropane	ND		25.0	28.0		ug/L		112	60 - 140	4	20
Ethylene Dibromide	ND		25.0	25.8		ug/L		103	60 - 140	2	20
Dibromomethane	ND		25.0	25.2		ug/L		101	60 - 140	2	20
Dichlorodifluoromethane	ND		25.0	17.9		ug/L		71	38 - 140	1	20
1,1-Dichloroethane	ND		25.0	25.0		ug/L		100	60 - 140	1	20
1,2-Dichloroethane	ND		25.0	25.1		ug/L		100	60 - 140	3	20
1,1-Dichloroethene	ND		25.0	21.6		ug/L		86	60 - 140	2	20
cis-1,2-Dichloroethene	ND		25.0	25.1		ug/L		100	60 - 140	2	20
trans-1,2-Dichloroethene	ND		25.0	23.4		ug/L		93	60 - 140	0	20
1,2-Dichloropropane	ND		25.0	26.2		ug/L		105	60 - 140	0	20
cis-1,3-Dichloropropene	ND		25.0	26.6		ug/L		106	60 - 140	0	20
trans-1,3-Dichloropropene	ND		25.0	28.7		ug/L		115	60 - 140	2	20
Ethylbenzene	3.7		25.0	31.6		ug/L		112	60 - 140	0	20
Hexachlorobutadiene	ND		25.0	24.6		ug/L		98	60 - 140	2	20
2-Hexanone	ND		125	141		ug/L		112	60 - 140	0	20
Isopropylbenzene	22		25.0	55.3		ug/L		132	60 - 140	2	20
4-Isopropyltoluene	ND		25.0	25.1		ug/L		100	60 - 140	2	20
Methylene Chloride	ND		25.0	24.9		ug/L		100	40 - 140	1	20
4-Methyl-2-pentanone (MIBK)	ND		125	140		ug/L		112	58 - 130	0	20
Naphthalene	83		25.0	114		ug/L		122	56 - 140	2	20
N-Propylbenzene	23		25.0	57.4		ug/L		136	60 - 140	2	20
Styrene	ND		25.0	25.6		ug/L		102	60 - 140	1	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-66639-1 MSD
Matrix: Water
Analysis Batch: 187037

Client Sample ID: MW-8
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		25.0	26.6		ug/L		106	60 - 140	0	20
1,1,2,2-Tetrachloroethane	ND		25.0	27.3		ug/L		109	60 - 140	3	20
Tetrachloroethene	ND		25.0	24.2		ug/L		97	60 - 140	1	20
Toluene	15		25.0	45.9		ug/L		122	60 - 140	1	20
1,2,3-Trichlorobenzene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
1,2,4-Trichlorobenzene	ND		25.0	26.7		ug/L		107	60 - 140	1	20
1,1,1-Trichloroethane	ND		25.0	24.7		ug/L		99	60 - 140	2	20
1,1,2-Trichloroethane	ND		25.0	25.7		ug/L		103	60 - 140	5	20
Trichloroethene	ND		25.0	24.4		ug/L		98	60 - 140	1	20
Trichlorofluoromethane	ND		25.0	23.9		ug/L		95	60 - 140	2	20
1,2,3-Trichloropropane	ND		25.0	25.3		ug/L		101	60 - 140	1	20
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	22.5		ug/L		90	60 - 140	0	20
1,2,4-Trimethylbenzene	ND		25.0	26.4		ug/L		105	60 - 140	1	20
1,3,5-Trimethylbenzene	1.1		25.0	26.5		ug/L		102	60 - 140	1	20
Vinyl acetate	18		25.0	51.9		ug/L		136	40 - 140	2	20
Vinyl chloride	ND		25.0	22.4		ug/L		90	58 - 140	1	20
m-Xylene & p-Xylene	21		25.0	54.2		ug/L		132	60 - 140	1	20
o-Xylene	1.5		25.0	29.4		ug/L		112	60 - 140	1	20
2,2-Dichloropropane	ND		25.0	23.8		ug/L		95	60 - 140	1	20

Surrogate	MSD %Recovery	MSD Qualifier	MSD Limits
4-Bromofluorobenzene	101		67 - 130
1,2-Dichloroethane-d4 (Surr)	103		72 - 130
Toluene-d8 (Surr)	99		70 - 130

Method: 300.0 - Anions, Ion Chromatography

Lab Sample ID: MB 720-186743/4
Matrix: Water
Analysis Batch: 186743

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	ND		1.0		mg/L			08/11/15 14:34	1

Lab Sample ID: LCS 720-186743/5
Matrix: Water
Analysis Batch: 186743

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Sulfate	10.0	9.82		mg/L		98	90 - 110

Lab Sample ID: MB 720-186744/4
Matrix: Water
Analysis Batch: 186744

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrite as NO2	ND		1.0		mg/L			08/11/15 14:34	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 300.0 - Anions, Ion Chromatography (Continued)

Lab Sample ID: MB 720-186744/4
Matrix: Water
Analysis Batch: 186744

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nitrate as NO3	ND		1.0		mg/L			08/11/15 14:34	1

Lab Sample ID: LCS 720-186744/5
Matrix: Water
Analysis Batch: 186744

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Nitrite as NO2	10.0	10.5		mg/L		105	90 - 110
Nitrate as NO3	10.0	9.72		mg/L		97	90 - 110

Method: 200.7 Rev 4.4 - Metals (ICP)

Lab Sample ID: MB 720-186812/1-A
Matrix: Water
Analysis Batch: 187051

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 186812

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Iron	ND		0.50		mg/L		08/12/15 10:36	08/15/15 00:23	1
Manganese	ND		0.020		mg/L		08/12/15 10:36	08/15/15 00:23	1
Potassium	ND		1.0		mg/L		08/12/15 10:36	08/15/15 00:23	1

Lab Sample ID: LCS 720-186812/2-A
Matrix: Water
Analysis Batch: 187051

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Iron	10.0	9.07		mg/L		91	85 - 115
Manganese	1.00	0.949		mg/L		95	85 - 115
Potassium	10.0	10.1		mg/L		101	85 - 115

Lab Sample ID: LCSD 720-186812/3-A
Matrix: Water
Analysis Batch: 187051

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Iron	10.0	8.99		mg/L		90	85 - 115	1	20
Manganese	1.00	0.934		mg/L		93	85 - 115	2	20
Potassium	10.0	9.97		mg/L		100	85 - 115	1	20

Lab Sample ID: 720-66639-1 MS
Matrix: Water
Analysis Batch: 187051

Client Sample ID: MW-8
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Manganese	1.7		1.00	2.77		mg/L		103	85 - 115
Potassium	3.0		10.0	12.7		mg/L		97	85 - 115

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: 200.7 Rev 4.4 - Metals (ICP) (Continued)

Lab Sample ID: 720-66639-1 MS
Matrix: Water
Analysis Batch: 187153

Client Sample ID: MW-8
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Iron	29	F1	10.0	41.0	F1	mg/L		122	85 - 115

Lab Sample ID: 720-66639-1 MSD
Matrix: Water
Analysis Batch: 187051

Client Sample ID: MW-8
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Manganese	1.7		1.00	2.72		mg/L		97	85 - 115	2	20
Potassium	3.0		10.0	12.5		mg/L		96	85 - 115	1	20

Lab Sample ID: 720-66639-1 MSD
Matrix: Water
Analysis Batch: 187153

Client Sample ID: MW-8
Prep Type: Total/NA
Prep Batch: 186812

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Iron	29	F1	10.0	39.4		mg/L		106	85 - 115	4	20

Method: SM 3500 FE D - Iron, Ferrous and Ferric

Lab Sample ID: MB 720-186807/8
Matrix: Water
Analysis Batch: 186807

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ferrous Iron	ND		0.10		mg/L			08/12/15 09:50	1

Lab Sample ID: LCS 720-186807/9
Matrix: Water
Analysis Batch: 186807

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ferrous Iron	1.00	0.961		mg/L		96	80 - 120

Lab Sample ID: 720-66639-5 MS
Matrix: Water
Analysis Batch: 186807

Client Sample ID: MW-7R
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Ferrous Iron	4.4	HF	2.00	6.27		mg/L		94	75 - 125

Lab Sample ID: 720-66639-5 MSD
Matrix: Water
Analysis Batch: 186807

Client Sample ID: MW-7R
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Ferrous Iron	4.4	HF	2.00	6.25		mg/L		94	75 - 125	0	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: SM 4500 NH3 G - Ammonia

Lab Sample ID: MB 500-300143/1-A
Matrix: Water
Analysis Batch: 300181

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 300143

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia	ND		0.20		mg/L		08/14/15 20:35	08/14/15 23:03	1

Lab Sample ID: MB 500-300143/1-A
Matrix: Water
Analysis Batch: 300195

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 300143

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Ammonia	ND		0.20		mg/L		08/14/15 20:35	08/16/15 14:06	1

Lab Sample ID: LCS 500-300143/2-A
Matrix: Water
Analysis Batch: 300181

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 300143

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	2.50	2.42		mg/L		97	80 - 120

Lab Sample ID: LCS 500-300143/2-A
Matrix: Water
Analysis Batch: 300195

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 300143

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Ammonia	2.50	2.41		mg/L		97	80 - 120

Method: SM 4500 P E - Orthophosphate

Lab Sample ID: MB 720-186760/7
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Orthophosphate as P	ND		0.020		mg/L			08/11/15 15:18	1

Lab Sample ID: LCS 720-186760/8
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Orthophosphate as P	0.200	0.202		mg/L		101	90 - 110

Lab Sample ID: LCSD 720-186760/9
Matrix: Water
Analysis Batch: 186760

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Orthophosphate as P	0.200	0.203		mg/L		101	90 - 110	0	15

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method: SM 4500 P E - Orthophosphate (Continued)

Lab Sample ID: 720-66639-4 MS
Matrix: Water
Analysis Batch: 186760

Client Sample ID: MW-6R
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Orthophosphate as P	1.7		2.00	3.91		mg/L		110	75 - 125

Lab Sample ID: 720-66639-4 MSD
Matrix: Water
Analysis Batch: 186760

Client Sample ID: MW-6R
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Orthophosphate as P	1.7		2.00	3.91		mg/L		110	75 - 125	0	20



QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

GC/MS VOA

Analysis Batch: 187037

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-1 MS	MW-8	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-1 MSD	MW-8	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-2	MW-4R	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-3	MW-5R	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-4	MW-6R	Total/NA	Water	8260B/CA_LUFT MS	
720-66639-5	MW-7R	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-187037/6	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-187037/8	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-187037/7	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-187037/9	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
MB 720-187037/5	Method Blank	Total/NA	Water	8260B/CA_LUFT MS	

HPLC/IC

Analysis Batch: 186743

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	300.0	
720-66639-2	MW-4R	Total/NA	Water	300.0	
720-66639-3	MW-5R	Total/NA	Water	300.0	
720-66639-4	MW-6R	Total/NA	Water	300.0	
720-66639-5	MW-7R	Total/NA	Water	300.0	
LCS 720-186743/5	Lab Control Sample	Total/NA	Water	300.0	
MB 720-186743/4	Method Blank	Total/NA	Water	300.0	

Analysis Batch: 186744

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	300.0	
720-66639-2	MW-4R	Total/NA	Water	300.0	
720-66639-3	MW-5R	Total/NA	Water	300.0	
720-66639-4	MW-6R	Total/NA	Water	300.0	
720-66639-4	MW-6R	Total/NA	Water	300.0	
720-66639-5	MW-7R	Total/NA	Water	300.0	
720-66639-5	MW-7R	Total/NA	Water	300.0	
LCS 720-186744/5	Lab Control Sample	Total/NA	Water	300.0	
MB 720-186744/4	Method Blank	Total/NA	Water	300.0	

TestAmerica Pleasanton

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Metals

Prep Batch: 186812

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	200.7	
720-66639-1 MS	MW-8	Total/NA	Water	200.7	
720-66639-1 MSD	MW-8	Total/NA	Water	200.7	
720-66639-2	MW-4R	Total/NA	Water	200.7	
720-66639-3	MW-5R	Total/NA	Water	200.7	
720-66639-4	MW-6R	Total/NA	Water	200.7	
720-66639-5	MW-7R	Total/NA	Water	200.7	
LCS 720-186812/2-A	Lab Control Sample	Total/NA	Water	200.7	
LCSD 720-186812/3-A	Lab Control Sample Dup	Total/NA	Water	200.7	
MB 720-186812/1-A	Method Blank	Total/NA	Water	200.7	

Analysis Batch: 187051

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-1 MS	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-1 MSD	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-2	MW-4R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-3	MW-5R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-4	MW-6R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-5	MW-7R	Total/NA	Water	200.7 Rev 4.4	186812
LCS 720-186812/2-A	Lab Control Sample	Total/NA	Water	200.7 Rev 4.4	186812
LCSD 720-186812/3-A	Lab Control Sample Dup	Total/NA	Water	200.7 Rev 4.4	186812
MB 720-186812/1-A	Method Blank	Total/NA	Water	200.7 Rev 4.4	186812

Analysis Batch: 187153

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-1 MS	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-1 MSD	MW-8	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-2	MW-4R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-3	MW-5R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-4	MW-6R	Total/NA	Water	200.7 Rev 4.4	186812
720-66639-5	MW-7R	Total/NA	Water	200.7 Rev 4.4	186812

General Chemistry

Analysis Batch: 186760

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	SM 4500 P E	
720-66639-2	MW-4R	Total/NA	Water	SM 4500 P E	
720-66639-3	MW-5R	Total/NA	Water	SM 4500 P E	
720-66639-4	MW-6R	Total/NA	Water	SM 4500 P E	
720-66639-4 MS	MW-6R	Total/NA	Water	SM 4500 P E	
720-66639-4 MSD	MW-6R	Total/NA	Water	SM 4500 P E	
720-66639-5	MW-7R	Total/NA	Water	SM 4500 P E	
LCS 720-186760/8	Lab Control Sample	Total/NA	Water	SM 4500 P E	
LCSD 720-186760/9	Lab Control Sample Dup	Total/NA	Water	SM 4500 P E	
MB 720-186760/7	Method Blank	Total/NA	Water	SM 4500 P E	

TestAmerica Pleasanton

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

General Chemistry (Continued)

Analysis Batch: 186807

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	SM 3500 FE D	
720-66639-2	MW-4R	Total/NA	Water	SM 3500 FE D	
720-66639-3	MW-5R	Total/NA	Water	SM 3500 FE D	
720-66639-4	MW-6R	Total/NA	Water	SM 3500 FE D	
720-66639-5	MW-7R	Total/NA	Water	SM 3500 FE D	
720-66639-5 MS	MW-7R	Total/NA	Water	SM 3500 FE D	
720-66639-5 MSD	MW-7R	Total/NA	Water	SM 3500 FE D	
LCS 720-186807/9	Lab Control Sample	Total/NA	Water	SM 3500 FE D	
MB 720-186807/8	Method Blank	Total/NA	Water	SM 3500 FE D	

Analysis Batch: 187178

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	SM 3500 FE D	
720-66639-2	MW-4R	Total/NA	Water	SM 3500 FE D	
720-66639-3	MW-5R	Total/NA	Water	SM 3500 FE D	
720-66639-4	MW-6R	Total/NA	Water	SM 3500 FE D	
720-66639-5	MW-7R	Total/NA	Water	SM 3500 FE D	

Prep Batch: 300143

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	SM 4500 NH3 B	
720-66639-2	MW-4R	Total/NA	Water	SM 4500 NH3 B	
720-66639-3	MW-5R	Total/NA	Water	SM 4500 NH3 B	
720-66639-4	MW-6R	Total/NA	Water	SM 4500 NH3 B	
720-66639-5	MW-7R	Total/NA	Water	SM 4500 NH3 B	
LCS 500-300143/2-A	Lab Control Sample	Total/NA	Water	SM 4500 NH3 B	
MB 500-300143/1-A	Method Blank	Total/NA	Water	SM 4500 NH3 B	

Analysis Batch: 300181

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-1	MW-8	Total/NA	Water	SM 4500 NH3 G	300143
720-66639-3	MW-5R	Total/NA	Water	SM 4500 NH3 G	300143
720-66639-4	MW-6R	Total/NA	Water	SM 4500 NH3 G	300143
720-66639-5	MW-7R	Total/NA	Water	SM 4500 NH3 G	300143
LCS 500-300143/2-A	Lab Control Sample	Total/NA	Water	SM 4500 NH3 G	300143
MB 500-300143/1-A	Method Blank	Total/NA	Water	SM 4500 NH3 G	300143

Analysis Batch: 300195

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-66639-2	MW-4R	Total/NA	Water	SM 4500 NH3 G	300143
LCS 500-300143/2-A	Lab Control Sample	Total/NA	Water	SM 4500 NH3 G	300143
MB 500-300143/1-A	Method Blank	Total/NA	Water	SM 4500 NH3 G	300143

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-8
Date Collected: 08/11/15 08:40
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-1
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	187037	08/17/15 15:49	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186743	08/11/15 19:06	MJK	TAL PLS
Total/NA	Analysis	300.0		1	186744	08/11/15 19:06	MJK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187051	08/15/15 02:03	SLK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187153	08/17/15 23:36	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		20	186807	08/12/15 09:50	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187178	08/12/15 10:00	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			300143	08/14/15 20:35	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	300181	08/15/15 00:02	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 20:10	EYT	TAL PLS

Client Sample ID: MW-4R
Date Collected: 08/11/15 10:00
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-2
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		10	187037	08/17/15 12:33	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186744	08/11/15 19:40	MJK	TAL PLS
Total/NA	Analysis	300.0		10	186743	08/11/15 19:57	MJK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187051	08/15/15 02:08	SLK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187153	08/17/15 23:41	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186807	08/12/15 09:50	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187178	08/12/15 10:00	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			300143	08/14/15 20:35	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	300195	08/16/15 14:18	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 20:10	EYT	TAL PLS

Client Sample ID: MW-5R
Date Collected: 08/11/15 11:25
Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-3
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		100	187037	08/17/15 12:05	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186744	08/11/15 20:14	MJK	TAL PLS
Total/NA	Analysis	300.0		10	186743	08/11/15 20:31	MJK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187051	08/15/15 02:14	SLK	TAL PLS

TestAmerica Pleasanton

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-5R

Date Collected: 08/11/15 11:25

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187153	08/17/15 23:46	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186807	08/12/15 09:50	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187178	08/12/15 10:00	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			300143	08/14/15 20:35	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	300181	08/15/15 00:14	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 20:10	EYT	TAL PLS

Client Sample ID: MW-6R

Date Collected: 08/11/15 12:15

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		5	187037	08/17/15 13:01	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186744	08/11/15 20:48	MJK	TAL PLS
Total/NA	Analysis	300.0		10	186743	08/11/15 21:05	MJK	TAL PLS
Total/NA	Analysis	300.0		100	186744	08/11/15 22:39	MJK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187051	08/15/15 02:19	SLK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187153	08/17/15 23:51	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	186807	08/12/15 09:50	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187178	08/12/15 10:00	MJK	TAL PLS
Total/NA	Prep	SM 4500 NH3 B			300143	08/14/15 20:35	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	300181	08/15/15 00:17	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		10	186760	08/11/15 20:10	EYT	TAL PLS

Client Sample ID: MW-7R

Date Collected: 08/11/15 13:20

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		500	187037	08/17/15 13:29	LPL	TAL PLS
Total/NA	Analysis	300.0		1	186744	08/11/15 21:22	MJK	TAL PLS
Total/NA	Analysis	300.0		10	186743	08/11/15 21:39	MJK	TAL PLS
Total/NA	Analysis	300.0		50	186744	08/11/15 23:47	MJK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187051	08/15/15 02:24	SLK	TAL PLS
Total/NA	Prep	200.7			186812	08/12/15 10:37	ECT	TAL PLS
Total/NA	Analysis	200.7 Rev 4.4		1	187153	08/17/15 23:56	SLK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		2	186807	08/12/15 09:50	MJK	TAL PLS
Total/NA	Analysis	SM 3500 FE D		1	187178	08/12/15 10:00	MJK	TAL PLS

TestAmerica Pleasanton

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Client Sample ID: MW-7R

Date Collected: 08/11/15 13:20

Date Received: 08/11/15 16:40

Lab Sample ID: 720-66639-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	SM 4500 NH3 B			300143	08/14/15 20:35	HMW	TAL CHI
Total/NA	Analysis	SM 4500 NH3 G		1	300181	08/15/15 00:19	HMW	TAL CHI
Total/NA	Analysis	SM 4500 P E		1	186760	08/11/15 20:10	EYT	TAL PLS

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

Certification Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Laboratory: TestAmerica Pleasanton

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
California	State Program	9	2496	01-31-16

Analysis Method	Prep Method	Matrix	Analyte

Laboratory: TestAmerica Chicago

All certifications held by this laboratory are listed. Not all certifications are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
Alabama	State Program	4	40461	04-30-16
California	State Program	9	2903	04-30-16
Georgia	State Program	4	N/A	04-30-16
Georgia	State Program	4	939	04-30-16
Hawaii	State Program	9	N/A	04-30-16
Illinois	NELAP	5	100201	04-30-16
Indiana	State Program	5	C-IL-02	04-30-16
Iowa	State Program	7	82	05-01-16
Kansas	NELAP	7	E-10161	10-31-15
Kentucky (UST)	State Program	4	66	04-30-16
Kentucky (WW)	State Program	4	KY90023	12-31-15
Massachusetts	State Program	1	M-IL035	06-30-16
Mississippi	State Program	4	N/A	04-30-16
New York	NELAP	2	IL00035	04-01-16
North Carolina (WW/SW)	State Program	4	291	12-31-15 *
North Dakota	State Program	8	R-194	04-30-16
Oklahoma	State Program	6	8908	08-31-15 *
South Carolina	State Program	4	77001	04-30-16
USDA	Federal		P330-15-00038	02-11-18
Wisconsin	State Program	5	999580010	08-31-15 *
Wyoming	State Program	8	8TMS-Q	04-30-16

* Certification renewal pending - certification considered valid.

Method Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Method	Method Description	Protocol	Laboratory
8260B/CA_LUFTM S	8260B / CA LUFT MS	SW846	TAL PLS
300.0	Anions, Ion Chromatography	MCAWW	TAL PLS
200.7 Rev 4.4	Metals (ICP)	EPA	TAL PLS
SM 3500 FE D	Iron, Ferrous and Ferric	SM	TAL PLS
SM 4500 NH3 G	Ammonia	SM	TAL CHI
SM 4500 P E	Orthophosphate	SM	TAL PLS

Protocol References:

EPA = US Environmental Protection Agency

MCAWW = "Methods For Chemical Analysis Of Water And Wastes", EPA-600/4-79-020, March 1983 And Subsequent Revisions.

SM = "Standard Methods For The Examination Of Water And Wastewater",

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

Sample Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-66639-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
720-66639-1	MW-8	Water	08/11/15 08:40	08/11/15 16:40
720-66639-2	MW-4R	Water	08/11/15 10:00	08/11/15 16:40
720-66639-3	MW-5R	Water	08/11/15 11:25	08/11/15 16:40
720-66639-4	MW-6R	Water	08/11/15 12:15	08/11/15 16:40
720-66639-5	MW-7R	Water	08/11/15 13:20	08/11/15 16:40

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

720-66639

TESTAMERICA Pleasanton Chain of Custody

1220 Quarry Lane • Pleasanton CA 94566-4756
 Phone: (925) 484-1919 • Fax: (925) 600-3002

Reference #: 163011

Date: 11 Aug 15 Page 1 of 1

8/19/2015

Report To

Analysis Request

Attn: Peter Sims
 Company: Ningo and Moore
 Address: 1914 Webster St, Ste 400
 Email: psims@ningoandmoore.com
 Bill To: Peter Sims
 Sampled By: Emily Divisen
 Attn: P. Sims Phone: 510-343-3000
 Sample ID Date Time Mat Preserv

Volatile Organics GC/MS (VOCs) EPA 8260B HVOCs by <input type="checkbox"/> EPA 8260B	<input type="checkbox"/> Gas <input type="checkbox"/> BTEX <input type="checkbox"/> 5 Oxygenates <input type="checkbox"/> DCA, EDB <input type="checkbox"/> Ethanol	TEPH EPA 8015B <input type="checkbox"/> Silica Gel <input type="checkbox"/> Diesel <input type="checkbox"/> Motor Oil <input type="checkbox"/> Other	SemiVolatile Organics GC/MS EPA 8270C	PNA/PAH's by <input type="checkbox"/> 8270C <input type="checkbox"/> 8270C SIM	Oil and Grease <input type="checkbox"/> Petroleum (EPA 1664/9071) <input type="checkbox"/> Total	Pesticides <input type="checkbox"/> EPA 8081 <input type="checkbox"/> EPA 8082	CAM17 Metals (EPA 6010/7470/7471)	Metals: <input type="checkbox"/> 6010B <input type="checkbox"/> 200.7 <input type="checkbox"/> Lead <input type="checkbox"/> LUFT <input type="checkbox"/> RCRA <input type="checkbox"/> Other: 200.7 Potassium, manganese	Metals: <input type="checkbox"/> 6020 <input type="checkbox"/> 200.8 (ICP-MS):	<input type="checkbox"/> W.E.T (STLC) <input type="checkbox"/> W.E.T (DI) <input type="checkbox"/> TCLP	Hex. Chrom by <input type="checkbox"/> EPA 7196 <input type="checkbox"/> or EPA 7199	pH <input type="checkbox"/> 9040 <input type="checkbox"/> SM4500	<input type="checkbox"/> Spec. Cond. <input type="checkbox"/> Alkalinity <input type="checkbox"/> TSS <input type="checkbox"/> SS <input type="checkbox"/> TDS	Anions: <input type="checkbox"/> Cl <input checked="" type="checkbox"/> SO ₄ <input type="checkbox"/> NO ₃ <input type="checkbox"/> F <input type="checkbox"/> Br <input checked="" type="checkbox"/> NO ₂ <input type="checkbox"/> PO ₄ 300.0 Ammonia <input checked="" type="checkbox"/> Smt 500 <input checked="" type="checkbox"/> NH ₂	<input type="checkbox"/> Perchlorate by EPA 314.0	COD <input type="checkbox"/> EPA 410.4 <input type="checkbox"/> SM5220D <input type="checkbox"/> Turbidity	Number of Containers																
																		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
																		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X



720-66639 Chain of Custody

Project Info Sample Receipt

Project Name/ #: CNUN
 PO#: 401894004
 Head Space:
 Temp: 27°C
 Credit Card VIN:
 If yes, please call with payment information ASAP

Project Name/ #	PO#	Head Space	Temp
CNUN	401894004		27°C

Day	Day	Day	Day	Day	Other
10	5	4	3	2	1
Day	Day	Day	Day	Day	Day

1) Relinquished by: Emily Divisen 8/11/15 1502
 Signature: [Signature]
 Printed Name: Emily Divisen
 Date: 8/11/15
 Company: Ningo and Moore

2) Received by: Victor Romo 8/11/15 1518
 Signature: [Signature]
 Printed Name: Victor Romo
 Date: 8-11-15
 Company: N+M

3) Relinquished by: Victor Romo 8/11/15 1640
 Signature: [Signature]
 Printed Name: Victor Romo
 Date: 8/11/15
 Company: TA

4) Received by: Jhonny 8/11/15 1640
 Signature: [Signature]
 Printed Name: Jhonny
 Date: 8/11/15
 Company: TA

TestAmerica

720-66639

TESTAMERICA Pleasanton Chain of Custody
 1220 Quarry Lane • Pleasanton CA 94566-4756
 Phone: (925) 484-1919 • Fax: (925) 600-3002

Reference #: 163011

Date: 11 Aug 15 Page 1 of 1

8/19/2015

Report To

Attn: Peter Sims
 Company: Ningo and Moore
 Address: 1916 Webster St, Ste 400
 Email: psims@ningoandmoore.com
 Bill To: Peter Sims
 Sampled By: Emily Divisen
 Attn: P. Sims
 Phone: 510-343-3000

Analysis Request

Volatile Organics GC/MS (VOCs)
 EPA 8260B
 HVOcs by EPA 8260B
 EPA 8260B: Gas BTEX
 5 Oxygenates DCA, EDB Ethanol
 TEPH EPA 8015B Silica Gel
 Diesel Motor Oil Other: _____
 SemiVolatile Organics GC/MS
 EPA 8270C
 PNA/PAH's by 8270C
 8270C SIM
 Oil and Grease Petroleum
 (EPA 1664/9071) Total
 Pesticides EPA 8081
 EPA 8082
 CAM17 Metals
 (EPA 8010/7470/7471)
 Metals: 6010B 200.7
 Lead LUFT CRCA
 Other: 200.7 Potassium, manganese
 Metals: 6020 200.8
 (ICP-MS): _____
 W.E.T (STLC)
 W.E.T (DI) TCLP
 Hex. Chrom by EPA 7196
 or EPA 7199
 pH 9040
 SM4500
 Spec Cond. Alkalinity
 TSS SS TDS
 Anions: Cl SO₄ NO₃ F
 Br NO₂ PO₄
 300.0
 Perchlorate by EPA 314.0
 COD EPA 410.4 SM5220D
 Turbidity
 Number of Containers

Sample ID	Date	Time	Met	Preserv
MMW-8	8/11	0840	End	
MMW-4E		1000		X
MMW-5E		1105		X
MMW-6E		1215		X
MMW-7E		1320		X



720-66639 Chain of Custody

Project Info

Project Name: CHUVN
 PO#: 401896004
 Credit Card Y/N: _____
 If yes, please call with payment information ASAP

Sample Receipt

of Containers: _____
 Head Space: _____
 Temp: 2.7°C

1) Relinquished by:

Signature: Emily Divisen
 Printed Name: Emily Divisen
 Date: 8/11/15
 Company: Ningo and Moore

2) Relinquished by:

Signature: Peter Sims
 Printed Name: Peter Sims
 Date: 8-11-15
 Company: N+M

3) Relinquished by:

Signature: Victor Rano
 Printed Name: Victor Rano
 Date: 8/11/15
 Company: TA

T	A	Day	Day	Day	Day	Day	Other:
		10	5	4	3	2	1

1) Received by: Peter Sims
 Signature: Peter Sims
 Printed Name: Peter Sims
 Date: 8/11/15
 Company: N+M

2) Received by: Victor Rano
 Signature: Victor Rano
 Printed Name: Victor Rano
 Date: 8/11/15
 Company: TA

3) Received by: Jhonny
 Signature: Jhonny
 Printed Name: Jhonny
 Date: 8/11/15
 Company: TA

Report: Routine Level 3 Level 4 EDD EDF
 Special Instructions / Comments: Global ID _____

See Terms and Conditions on reverse

Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-66639-1

Login Number: 66639

List Number: 1

Creator: Bullock, Tracy

List Source: TestAmerica Pleasanton

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	N/A	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-66639-1

Login Number: 66639
List Number: 2
Creator: Sanchez, Ariel M

List Source: TestAmerica Chicago
List Creation: 08/13/15 12:38 PM

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	0.6
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Pleasanton
1220 Quarry Lane
Pleasanton, CA 94566
Tel: (925)484-1919

TestAmerica Job ID: 720-67069-1
Client Project/Site: Chun

For:
Ninyo & Moore
1956 Webster Street
Suite 400
Oakland, California 94612

Attn: Mr. Peter D. Sims



Authorized for release by:
9/4/2015 12:54:17 PM
Afsaneh Salimpour, Senior Project Manager
afsaneh.salimpour@testamericainc.com
Designee for
Dimple Sharma, Senior Project Manager
(925)484-1919
dimple.sharma@testamericainc.com

LINKS

Review your project
results through
TotalAccess

Have a Question?



Visit us at:
www.testamericainc.com

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15



Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	6
Surrogate Summary	12
QC Sample Results	13
QC Association Summary	31
Lab Chronicle	32
Certification Summary	33
Method Summary	34
Sample Summary	35
Chain of Custody	36
Receipt Checklists	37

Definitions/Glossary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Job ID: 720-67069-1

Laboratory: TestAmerica Pleasanton

Narrative

**Job Narrative
720-67069-1**

Comments

No additional comments.

Receipt

The samples were received on 8/28/2015 12:14 PM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 3.1° C.

GC/MS VOA

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: INF

Lab Sample ID: 720-67069-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	1.0		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Benzene	8.0		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Chloroform	1.6		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Naphthalene	17		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Toluene	4.8		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	43		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	100		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	750		50		ug/L	1		8260B/CA_LUFT MS	Total/NA

Client Sample ID: EFF

Lab Sample ID: 720-67069-2

No Detections.

Client Sample ID: GAC

Lab Sample ID: 720-67069-3

No Detections.

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: INF

Date Collected: 08/27/15 13:10

Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-1

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	1.0		0.50		ug/L			09/02/15 18:59	1
Acetone	ND		50		ug/L			09/02/15 18:59	1
Benzene	8.0		0.50		ug/L			09/02/15 18:59	1
Dichlorobromomethane	ND		0.50		ug/L			09/02/15 18:59	1
Bromobenzene	ND		1.0		ug/L			09/02/15 18:59	1
Chlorobromomethane	ND		1.0		ug/L			09/02/15 18:59	1
Bromoform	ND		1.0		ug/L			09/02/15 18:59	1
Bromomethane	ND		1.0		ug/L			09/02/15 18:59	1
2-Butanone (MEK)	ND		50		ug/L			09/02/15 18:59	1
n-Butylbenzene	ND		1.0		ug/L			09/02/15 18:59	1
sec-Butylbenzene	ND		1.0		ug/L			09/02/15 18:59	1
tert-Butylbenzene	ND		1.0		ug/L			09/02/15 18:59	1
Carbon disulfide	ND		5.0		ug/L			09/02/15 18:59	1
Carbon tetrachloride	ND		0.50		ug/L			09/02/15 18:59	1
Chlorobenzene	ND		0.50		ug/L			09/02/15 18:59	1
Chloroethane	ND		1.0		ug/L			09/02/15 18:59	1
Chloroform	1.6		1.0		ug/L			09/02/15 18:59	1
Chloromethane	ND		1.0		ug/L			09/02/15 18:59	1
2-Chlorotoluene	ND		0.50		ug/L			09/02/15 18:59	1
4-Chlorotoluene	ND		0.50		ug/L			09/02/15 18:59	1
Chlorodibromomethane	ND		0.50		ug/L			09/02/15 18:59	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:59	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:59	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:59	1
1,3-Dichloropropane	ND		1.0		ug/L			09/02/15 18:59	1
1,1-Dichloropropane	ND		0.50		ug/L			09/02/15 18:59	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/02/15 18:59	1
Ethylene Dibromide	ND		0.50		ug/L			09/02/15 18:59	1
Dibromomethane	ND		0.50		ug/L			09/02/15 18:59	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/02/15 18:59	1
1,1-Dichloroethane	ND		0.50		ug/L			09/02/15 18:59	1
1,2-Dichloroethane	ND		0.50		ug/L			09/02/15 18:59	1
1,1-Dichloroethene	ND		0.50		ug/L			09/02/15 18:59	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 18:59	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 18:59	1
1,2-Dichloropropane	ND		0.50		ug/L			09/02/15 18:59	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 18:59	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 18:59	1
Ethylbenzene	ND		0.50		ug/L			09/02/15 18:59	1
Hexachlorobutadiene	ND		1.0		ug/L			09/02/15 18:59	1
2-Hexanone	ND		50		ug/L			09/02/15 18:59	1
Isopropylbenzene	ND		0.50		ug/L			09/02/15 18:59	1
4-Isopropyltoluene	ND		1.0		ug/L			09/02/15 18:59	1
Methylene Chloride	ND		5.0		ug/L			09/02/15 18:59	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/02/15 18:59	1
Naphthalene	17		1.0		ug/L			09/02/15 18:59	1
N-Propylbenzene	ND		1.0		ug/L			09/02/15 18:59	1
Styrene	ND		0.50		ug/L			09/02/15 18:59	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 18:59	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: INF

Lab Sample ID: 720-67069-1

Date Collected: 08/27/15 13:10

Matrix: Water

Date Received: 08/28/15 12:14

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 18:59	1
Tetrachloroethene	ND		0.50		ug/L			09/02/15 18:59	1
Toluene	4.8		0.50		ug/L			09/02/15 18:59	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/02/15 18:59	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/02/15 18:59	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/02/15 18:59	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/02/15 18:59	1
Trichloroethene	ND		0.50		ug/L			09/02/15 18:59	1
Trichlorofluoromethane	ND		1.0		ug/L			09/02/15 18:59	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/02/15 18:59	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/02/15 18:59	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/02/15 18:59	1
1,3,5-Trimethylbenzene	43		0.50		ug/L			09/02/15 18:59	1
Vinyl acetate	ND		10		ug/L			09/02/15 18:59	1
Vinyl chloride	ND		0.50		ug/L			09/02/15 18:59	1
Xylenes, Total	100		1.0		ug/L			09/03/15 14:33	1
2,2-Dichloropropane	ND		0.50		ug/L			09/02/15 18:59	1
Gasoline Range Organics (GRO)	750		50		ug/L			09/02/15 18:59	1
-C5-C12									

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	100		67 - 130		09/02/15 18:59	1
4-Bromofluorobenzene	94		67 - 130		09/03/15 14:33	1
1,2-Dichloroethane-d4 (Surr)	103		72 - 130		09/02/15 18:59	1
1,2-Dichloroethane-d4 (Surr)	103		72 - 130		09/03/15 14:33	1
Toluene-d8 (Surr)	99		70 - 130		09/02/15 18:59	1
Toluene-d8 (Surr)	96		70 - 130		09/03/15 14:33	1

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: EFF
Date Collected: 08/27/15 13:10
Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/02/15 18:30	1
Acetone	ND		50		ug/L			09/02/15 18:30	1
Benzene	ND		0.50		ug/L			09/02/15 18:30	1
Dichlorobromomethane	ND		0.50		ug/L			09/02/15 18:30	1
Bromobenzene	ND		1.0		ug/L			09/02/15 18:30	1
Chlorobromomethane	ND		1.0		ug/L			09/02/15 18:30	1
Bromoform	ND		1.0		ug/L			09/02/15 18:30	1
Bromomethane	ND		1.0		ug/L			09/02/15 18:30	1
2-Butanone (MEK)	ND		50		ug/L			09/02/15 18:30	1
n-Butylbenzene	ND		1.0		ug/L			09/02/15 18:30	1
sec-Butylbenzene	ND		1.0		ug/L			09/02/15 18:30	1
tert-Butylbenzene	ND		1.0		ug/L			09/02/15 18:30	1
Carbon disulfide	ND		5.0		ug/L			09/02/15 18:30	1
Carbon tetrachloride	ND		0.50		ug/L			09/02/15 18:30	1
Chlorobenzene	ND		0.50		ug/L			09/02/15 18:30	1
Chloroethane	ND		1.0		ug/L			09/02/15 18:30	1
Chloroform	ND		1.0		ug/L			09/02/15 18:30	1
Chloromethane	ND		1.0		ug/L			09/02/15 18:30	1
2-Chlorotoluene	ND		0.50		ug/L			09/02/15 18:30	1
4-Chlorotoluene	ND		0.50		ug/L			09/02/15 18:30	1
Chlorodibromomethane	ND		0.50		ug/L			09/02/15 18:30	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:30	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:30	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/02/15 18:30	1
1,3-Dichloropropane	ND		1.0		ug/L			09/02/15 18:30	1
1,1-Dichloropropene	ND		0.50		ug/L			09/02/15 18:30	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/02/15 18:30	1
Ethylene Dibromide	ND		0.50		ug/L			09/02/15 18:30	1
Dibromomethane	ND		0.50		ug/L			09/02/15 18:30	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/02/15 18:30	1
1,1-Dichloroethane	ND		0.50		ug/L			09/02/15 18:30	1
1,2-Dichloroethane	ND		0.50		ug/L			09/02/15 18:30	1
1,1-Dichloroethene	ND		0.50		ug/L			09/02/15 18:30	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 18:30	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 18:30	1
1,2-Dichloropropane	ND		0.50		ug/L			09/02/15 18:30	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 18:30	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 18:30	1
Ethylbenzene	ND		0.50		ug/L			09/02/15 18:30	1
Hexachlorobutadiene	ND		1.0		ug/L			09/02/15 18:30	1
2-Hexanone	ND		50		ug/L			09/02/15 18:30	1
Isopropylbenzene	ND		0.50		ug/L			09/02/15 18:30	1
4-Isopropyltoluene	ND		1.0		ug/L			09/02/15 18:30	1
Methylene Chloride	ND		5.0		ug/L			09/02/15 18:30	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/02/15 18:30	1
Naphthalene	ND		1.0		ug/L			09/02/15 18:30	1
N-Propylbenzene	ND		1.0		ug/L			09/02/15 18:30	1
Styrene	ND		0.50		ug/L			09/02/15 18:30	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 18:30	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: EFF
Date Collected: 08/27/15 13:10
Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 18:30	1
Tetrachloroethene	ND		0.50		ug/L			09/02/15 18:30	1
Toluene	ND		0.50		ug/L			09/02/15 18:30	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/02/15 18:30	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/02/15 18:30	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/02/15 18:30	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/02/15 18:30	1
Trichloroethene	ND		0.50		ug/L			09/02/15 18:30	1
Trichlorofluoromethane	ND		1.0		ug/L			09/02/15 18:30	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/02/15 18:30	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/02/15 18:30	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/02/15 18:30	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/02/15 18:30	1
Vinyl acetate	ND		10		ug/L			09/02/15 18:30	1
Vinyl chloride	ND		0.50		ug/L			09/02/15 18:30	1
Xylenes, Total	ND		1.0		ug/L			09/02/15 18:30	1
2,2-Dichloropropane	ND		0.50		ug/L			09/02/15 18:30	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/02/15 18:30	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	95		67 - 130					09/02/15 18:30	1
1,2-Dichloroethane-d4 (Surr)	98		72 - 130					09/02/15 18:30	1
Toluene-d8 (Surr)	96		70 - 130					09/02/15 18:30	1

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: GAC
Date Collected: 08/27/15 13:10
Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-3
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/02/15 19:28	1
Acetone	ND		50		ug/L			09/02/15 19:28	1
Benzene	ND		0.50		ug/L			09/02/15 19:28	1
Dichlorobromomethane	ND		0.50		ug/L			09/02/15 19:28	1
Bromobenzene	ND		1.0		ug/L			09/02/15 19:28	1
Chlorobromomethane	ND		1.0		ug/L			09/02/15 19:28	1
Bromoform	ND		1.0		ug/L			09/02/15 19:28	1
Bromomethane	ND		1.0		ug/L			09/02/15 19:28	1
2-Butanone (MEK)	ND		50		ug/L			09/02/15 19:28	1
n-Butylbenzene	ND		1.0		ug/L			09/02/15 19:28	1
sec-Butylbenzene	ND		1.0		ug/L			09/02/15 19:28	1
tert-Butylbenzene	ND		1.0		ug/L			09/02/15 19:28	1
Carbon disulfide	ND		5.0		ug/L			09/02/15 19:28	1
Carbon tetrachloride	ND		0.50		ug/L			09/02/15 19:28	1
Chlorobenzene	ND		0.50		ug/L			09/02/15 19:28	1
Chloroethane	ND		1.0		ug/L			09/02/15 19:28	1
Chloroform	ND		1.0		ug/L			09/02/15 19:28	1
Chloromethane	ND		1.0		ug/L			09/02/15 19:28	1
2-Chlorotoluene	ND		0.50		ug/L			09/02/15 19:28	1
4-Chlorotoluene	ND		0.50		ug/L			09/02/15 19:28	1
Chlorodibromomethane	ND		0.50		ug/L			09/02/15 19:28	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/02/15 19:28	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/02/15 19:28	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/02/15 19:28	1
1,3-Dichloropropane	ND		1.0		ug/L			09/02/15 19:28	1
1,1-Dichloropropene	ND		0.50		ug/L			09/02/15 19:28	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/02/15 19:28	1
Ethylene Dibromide	ND		0.50		ug/L			09/02/15 19:28	1
Dibromomethane	ND		0.50		ug/L			09/02/15 19:28	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/02/15 19:28	1
1,1-Dichloroethane	ND		0.50		ug/L			09/02/15 19:28	1
1,2-Dichloroethane	ND		0.50		ug/L			09/02/15 19:28	1
1,1-Dichloroethene	ND		0.50		ug/L			09/02/15 19:28	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 19:28	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 19:28	1
1,2-Dichloropropane	ND		0.50		ug/L			09/02/15 19:28	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 19:28	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 19:28	1
Ethylbenzene	ND		0.50		ug/L			09/02/15 19:28	1
Hexachlorobutadiene	ND		1.0		ug/L			09/02/15 19:28	1
2-Hexanone	ND		50		ug/L			09/02/15 19:28	1
Isopropylbenzene	ND		0.50		ug/L			09/02/15 19:28	1
4-Isopropyltoluene	ND		1.0		ug/L			09/02/15 19:28	1
Methylene Chloride	ND		5.0		ug/L			09/02/15 19:28	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/02/15 19:28	1
Naphthalene	ND		1.0		ug/L			09/02/15 19:28	1
N-Propylbenzene	ND		1.0		ug/L			09/02/15 19:28	1
Styrene	ND		0.50		ug/L			09/02/15 19:28	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 19:28	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: GAC

Lab Sample ID: 720-67069-3

Date Collected: 08/27/15 13:10

Matrix: Water

Date Received: 08/28/15 12:14

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 19:28	1
Tetrachloroethene	ND		0.50		ug/L			09/02/15 19:28	1
Toluene	ND		0.50		ug/L			09/02/15 19:28	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/02/15 19:28	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/02/15 19:28	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/02/15 19:28	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/02/15 19:28	1
Trichloroethene	ND		0.50		ug/L			09/02/15 19:28	1
Trichlorofluoromethane	ND		1.0		ug/L			09/02/15 19:28	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/02/15 19:28	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/02/15 19:28	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/02/15 19:28	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/02/15 19:28	1
Vinyl acetate	ND		10		ug/L			09/02/15 19:28	1
Vinyl chloride	ND		0.50		ug/L			09/02/15 19:28	1
Xylenes, Total	ND		1.0		ug/L			09/02/15 19:28	1
2,2-Dichloropropane	ND		0.50		ug/L			09/02/15 19:28	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/02/15 19:28	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	95		67 - 130					09/02/15 19:28	1
1,2-Dichloroethane-d4 (Surr)	99		72 - 130					09/02/15 19:28	1
Toluene-d8 (Surr)	96		70 - 130					09/02/15 19:28	1

Surrogate Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Matrix: Water

Prep Type: Total/NA

Percent Surrogate Recovery (Acceptance Limits)

Lab Sample ID	Client Sample ID	BFB (67-130)	12DCE (72-130)	TOL (70-130)
720-67069-1	INF	100	103	99
720-67069-1	INF	94	103	96
720-67069-1 MS	INF	86	101	95
720-67069-1 MSD	INF	91	99	96
720-67069-2	EFF	95	98	96
720-67069-2 MS	EFF	98	97	98
720-67069-2 MSD	EFF	98	93	98
720-67069-3	GAC	95	99	96
LCS 720-188153/6	Lab Control Sample	94	90	98
LCS 720-188153/8	Lab Control Sample	99	101	96
LCS 720-188209/5	Lab Control Sample	91	101	98
LCS 720-188209/7	Lab Control Sample	92	104	97
LCSD 720-188153/7	Lab Control Sample Dup	98	93	98
LCSD 720-188153/9	Lab Control Sample Dup	100	101	96
LCSD 720-188209/6	Lab Control Sample Dup	90	100	96
LCSD 720-188209/8	Lab Control Sample Dup	93	107	97
MB 720-188153/5	Method Blank	96	97	96
MB 720-188209/4	Method Blank	91	105	94

Surrogate Legend

BFB = 4-Bromofluorobenzene

12DCE = 1,2-Dichloroethane-d4 (Surr)

TOL = Toluene-d8 (Surr)

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Lab Sample ID: MB 720-188153/5
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/02/15 12:11	1
Acetone	ND		50		ug/L			09/02/15 12:11	1
Benzene	ND		0.50		ug/L			09/02/15 12:11	1
Dichlorobromomethane	ND		0.50		ug/L			09/02/15 12:11	1
Bromobenzene	ND		1.0		ug/L			09/02/15 12:11	1
Chlorobromomethane	ND		1.0		ug/L			09/02/15 12:11	1
Bromoform	ND		1.0		ug/L			09/02/15 12:11	1
Bromomethane	ND		1.0		ug/L			09/02/15 12:11	1
2-Butanone (MEK)	ND		50		ug/L			09/02/15 12:11	1
n-Butylbenzene	ND		1.0		ug/L			09/02/15 12:11	1
sec-Butylbenzene	ND		1.0		ug/L			09/02/15 12:11	1
tert-Butylbenzene	ND		1.0		ug/L			09/02/15 12:11	1
Carbon disulfide	ND		5.0		ug/L			09/02/15 12:11	1
Carbon tetrachloride	ND		0.50		ug/L			09/02/15 12:11	1
Chlorobenzene	ND		0.50		ug/L			09/02/15 12:11	1
Chloroethane	ND		1.0		ug/L			09/02/15 12:11	1
Chloroform	ND		1.0		ug/L			09/02/15 12:11	1
Chloromethane	ND		1.0		ug/L			09/02/15 12:11	1
2-Chlorotoluene	ND		0.50		ug/L			09/02/15 12:11	1
4-Chlorotoluene	ND		0.50		ug/L			09/02/15 12:11	1
Chlorodibromomethane	ND		0.50		ug/L			09/02/15 12:11	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/02/15 12:11	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/02/15 12:11	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/02/15 12:11	1
1,3-Dichloropropane	ND		1.0		ug/L			09/02/15 12:11	1
1,1-Dichloropropene	ND		0.50		ug/L			09/02/15 12:11	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/02/15 12:11	1
Ethylene Dibromide	ND		0.50		ug/L			09/02/15 12:11	1
Dibromomethane	ND		0.50		ug/L			09/02/15 12:11	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/02/15 12:11	1
1,1-Dichloroethane	ND		0.50		ug/L			09/02/15 12:11	1
1,2-Dichloroethane	ND		0.50		ug/L			09/02/15 12:11	1
1,1-Dichloroethene	ND		0.50		ug/L			09/02/15 12:11	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 12:11	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/02/15 12:11	1
1,2-Dichloropropane	ND		0.50		ug/L			09/02/15 12:11	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 12:11	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/02/15 12:11	1
Ethylbenzene	ND		0.50		ug/L			09/02/15 12:11	1
Hexachlorobutadiene	ND		1.0		ug/L			09/02/15 12:11	1
2-Hexanone	ND		50		ug/L			09/02/15 12:11	1
Isopropylbenzene	ND		0.50		ug/L			09/02/15 12:11	1
4-Isopropyltoluene	ND		1.0		ug/L			09/02/15 12:11	1
Methylene Chloride	ND		5.0		ug/L			09/02/15 12:11	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/02/15 12:11	1
Naphthalene	ND		1.0		ug/L			09/02/15 12:11	1
N-Propylbenzene	ND		1.0		ug/L			09/02/15 12:11	1
Styrene	ND		0.50		ug/L			09/02/15 12:11	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-188153/5
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 12:11	1
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/02/15 12:11	1
Tetrachloroethene	ND		0.50		ug/L			09/02/15 12:11	1
Toluene	ND		0.50		ug/L			09/02/15 12:11	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/02/15 12:11	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/02/15 12:11	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/02/15 12:11	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/02/15 12:11	1
Trichloroethene	ND		0.50		ug/L			09/02/15 12:11	1
Trichlorofluoromethane	ND		1.0		ug/L			09/02/15 12:11	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/02/15 12:11	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/02/15 12:11	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/02/15 12:11	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/02/15 12:11	1
Vinyl acetate	ND		10		ug/L			09/02/15 12:11	1
Vinyl chloride	ND		0.50		ug/L			09/02/15 12:11	1
Xylenes, Total	ND		1.0		ug/L			09/02/15 12:11	1
2,2-Dichloropropane	ND		0.50		ug/L			09/02/15 12:11	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/02/15 12:11	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	96		67 - 130		09/02/15 12:11	1
1,2-Dichloroethane-d4 (Surr)	97		72 - 130		09/02/15 12:11	1
Toluene-d8 (Surr)	96		70 - 130		09/02/15 12:11	1

Lab Sample ID: LCS 720-188153/6
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	25.0	24.9		ug/L		100	62 - 130
Acetone	125	138		ug/L		110	26 - 180
Benzene	25.0	26.4		ug/L		105	79 - 130
Dichlorobromomethane	25.0	26.4		ug/L		106	70 - 130
Bromobenzene	25.0	26.9		ug/L		108	70 - 130
Chlorobromomethane	25.0	24.1		ug/L		96	70 - 130
Bromoform	25.0	25.2		ug/L		101	68 - 136
Bromomethane	25.0	27.2		ug/L		109	43 - 151
2-Butanone (MEK)	125	127		ug/L		102	54 - 130
n-Butylbenzene	25.0	29.8		ug/L		119	70 - 142
sec-Butylbenzene	25.0	28.6		ug/L		114	70 - 134
tert-Butylbenzene	25.0	26.5		ug/L		106	70 - 135
Carbon disulfide	25.0	23.3		ug/L		93	58 - 130
Carbon tetrachloride	25.0	28.9		ug/L		116	70 - 146
Chlorobenzene	25.0	26.2		ug/L		105	70 - 130
Chloroethane	25.0	28.3		ug/L		113	62 - 138
Chloroform	25.0	25.4		ug/L		102	70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-188153/6

Matrix: Water

Analysis Batch: 188153

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Chloromethane	25.0	22.1		ug/L		89	52 - 175
2-Chlorotoluene	25.0	27.9		ug/L		111	70 - 130
4-Chlorotoluene	25.0	28.0		ug/L		112	70 - 130
Chlorodibromomethane	25.0	26.9		ug/L		107	70 - 145
1,2-Dichlorobenzene	25.0	26.8		ug/L		107	70 - 130
1,3-Dichlorobenzene	25.0	27.6		ug/L		111	70 - 130
1,4-Dichlorobenzene	25.0	27.9		ug/L		112	70 - 130
1,3-Dichloropropane	25.0	23.6		ug/L		94	70 - 130
1,1-Dichloropropene	25.0	27.1		ug/L		108	70 - 130
1,2-Dibromo-3-Chloropropane	25.0	21.6		ug/L		86	70 - 136
Ethylene Dibromide	25.0	23.8		ug/L		95	70 - 130
Dibromomethane	25.0	24.8		ug/L		99	70 - 130
Dichlorodifluoromethane	25.0	22.1		ug/L		89	34 - 132
1,1-Dichloroethane	25.0	26.0		ug/L		104	70 - 130
1,2-Dichloroethane	25.0	24.2		ug/L		97	61 - 132
1,1-Dichloroethene	25.0	22.8		ug/L		91	64 - 128
cis-1,2-Dichloroethene	25.0	25.1		ug/L		100	70 - 130
trans-1,2-Dichloroethene	25.0	25.4		ug/L		102	68 - 130
1,2-Dichloropropane	25.0	25.9		ug/L		104	70 - 130
cis-1,3-Dichloropropene	25.0	27.2		ug/L		109	70 - 130
trans-1,3-Dichloropropene	25.0	29.5		ug/L		118	70 - 140
Ethylbenzene	25.0	25.7		ug/L		103	80 - 120
Hexachlorobutadiene	25.0	30.2		ug/L		121	70 - 130
2-Hexanone	125	131		ug/L		105	60 - 164
Isopropylbenzene	25.0	26.3		ug/L		105	70 - 130
4-Isopropyltoluene	25.0	27.6		ug/L		111	70 - 130
Methylene Chloride	25.0	26.8		ug/L		107	70 - 147
4-Methyl-2-pentanone (MIBK)	125	131		ug/L		105	58 - 130
Naphthalene	25.0	24.1		ug/L		96	70 - 130
N-Propylbenzene	25.0	27.5		ug/L		110	70 - 130
Styrene	25.0	24.2		ug/L		97	70 - 130
1,1,1,2-Tetrachloroethane	25.0	27.8		ug/L		111	70 - 130
1,1,1,2-Tetrachloroethane	25.0	24.1		ug/L		97	70 - 130
Tetrachloroethene	25.0	27.4		ug/L		110	70 - 130
Toluene	25.0	26.1		ug/L		105	78 - 120
1,2,3-Trichlorobenzene	25.0	27.0		ug/L		108	70 - 130
1,2,4-Trichlorobenzene	25.0	29.8		ug/L		119	70 - 130
1,1,1-Trichloroethane	25.0	26.8		ug/L		107	70 - 130
1,1,2-Trichloroethane	25.0	24.0		ug/L		96	70 - 130
Trichloroethene	25.0	27.1		ug/L		108	70 - 130
Trichlorofluoromethane	25.0	26.5		ug/L		106	66 - 132
1,2,3-Trichloropropane	25.0	23.7		ug/L		95	70 - 130
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	24.1		ug/L		96	42 - 162
1,2,4-Trimethylbenzene	25.0	24.8		ug/L		99	70 - 132
1,3,5-Trimethylbenzene	25.0	28.6		ug/L		114	70 - 130
Vinyl acetate	25.0	23.3		ug/L		93	43 - 163
Vinyl chloride	25.0	27.1		ug/L		109	54 - 135

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-188153/6
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
m-Xylene & p-Xylene	25.0	27.4		ug/L		110	70 - 142
o-Xylene	25.0	25.8		ug/L		103	70 - 130
2,2-Dichloropropane	25.0	31.8		ug/L		127	70 - 140

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	94		67 - 130
1,2-Dichloroethane-d4 (Surr)	90		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCS 720-188153/8
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Gasoline Range Organics (GRO) -C5-C12	500	504		ug/L		101	62 - 120

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	99		67 - 130
1,2-Dichloroethane-d4 (Surr)	101		72 - 130
Toluene-d8 (Surr)	96		70 - 130

Lab Sample ID: LCSD 720-188153/7
Matrix: Water
Analysis Batch: 188153

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	25.0	27.4		ug/L		110	62 - 130	10	20
Acetone	125	158		ug/L		127	26 - 180	14	30
Benzene	25.0	26.3		ug/L		105	79 - 130	0	20
Dichlorobromomethane	25.0	26.9		ug/L		108	70 - 130	2	20
Bromobenzene	25.0	27.5		ug/L		110	70 - 130	2	20
Chlorobromomethane	25.0	25.1		ug/L		100	70 - 130	4	20
Bromoform	25.0	28.6		ug/L		115	68 - 136	13	20
Bromomethane	25.0	26.5		ug/L		106	43 - 151	3	20
2-Butanone (MEK)	125	147		ug/L		117	54 - 130	14	20
n-Butylbenzene	25.0	29.0		ug/L		116	70 - 142	3	20
sec-Butylbenzene	25.0	28.0		ug/L		112	70 - 134	2	20
tert-Butylbenzene	25.0	26.4		ug/L		106	70 - 135	0	20
Carbon disulfide	25.0	23.1		ug/L		92	58 - 130	1	20
Carbon tetrachloride	25.0	28.7		ug/L		115	70 - 146	1	20
Chlorobenzene	25.0	27.1		ug/L		109	70 - 130	3	20
Chloroethane	25.0	27.8		ug/L		111	62 - 138	2	20
Chloroform	25.0	25.6		ug/L		102	70 - 130	1	20
Chloromethane	25.0	21.8		ug/L		87	52 - 175	2	20
2-Chlorotoluene	25.0	27.5		ug/L		110	70 - 130	1	20
4-Chlorotoluene	25.0	27.8		ug/L		111	70 - 130	1	20
Chlorodibromomethane	25.0	28.4		ug/L		114	70 - 145	6	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-188153/7

Matrix: Water

Analysis Batch: 188153

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,2-Dichlorobenzene	25.0	27.4		ug/L		109	70 - 130	2	20
1,3-Dichlorobenzene	25.0	27.5		ug/L		110	70 - 130	0	20
1,4-Dichlorobenzene	25.0	27.5		ug/L		110	70 - 130	1	20
1,3-Dichloropropane	25.0	25.2		ug/L		101	70 - 130	7	20
1,1-Dichloropropene	25.0	26.7		ug/L		107	70 - 130	1	20
1,2-Dibromo-3-Chloropropane	25.0	25.2		ug/L		101	70 - 136	15	20
Ethylene Dibromide	25.0	25.9		ug/L		104	70 - 130	8	20
Dibromomethane	25.0	26.6		ug/L		106	70 - 130	7	20
Dichlorodifluoromethane	25.0	21.5		ug/L		86	34 - 132	3	20
1,1-Dichloroethane	25.0	26.1		ug/L		104	70 - 130	0	20
1,2-Dichloroethane	25.0	25.4		ug/L		102	61 - 132	5	20
1,1-Dichloroethene	25.0	23.0		ug/L		92	64 - 128	1	20
cis-1,2-Dichloroethene	25.0	25.0		ug/L		100	70 - 130	0	20
trans-1,2-Dichloroethene	25.0	25.4		ug/L		102	68 - 130	0	20
1,2-Dichloropropane	25.0	26.4		ug/L		105	70 - 130	2	20
cis-1,3-Dichloropropene	25.0	28.4		ug/L		114	70 - 130	4	20
trans-1,3-Dichloropropene	25.0	31.2		ug/L		125	70 - 140	5	20
Ethylbenzene	25.0	26.3		ug/L		105	80 - 120	2	20
Hexachlorobutadiene	25.0	29.5		ug/L		118	70 - 130	3	20
2-Hexanone	125	152		ug/L		122	60 - 164	15	20
Isopropylbenzene	25.0	26.9		ug/L		108	70 - 130	2	20
4-Isopropyltoluene	25.0	27.1		ug/L		108	70 - 130	2	20
Methylene Chloride	25.0	27.4		ug/L		109	70 - 147	2	20
4-Methyl-2-pentanone (MIBK)	125	150		ug/L		120	58 - 130	13	20
Naphthalene	25.0	25.9		ug/L		104	70 - 130	7	20
N-Propylbenzene	25.0	27.0		ug/L		108	70 - 130	2	20
Styrene	25.0	25.3		ug/L		101	70 - 130	4	20
1,1,1,2-Tetrachloroethane	25.0	29.2		ug/L		117	70 - 130	5	20
1,1,1,2,2-Tetrachloroethane	25.0	26.1		ug/L		104	70 - 130	8	20
Tetrachloroethene	25.0	27.4		ug/L		110	70 - 130	0	20
Toluene	25.0	26.6		ug/L		106	78 - 120	2	20
1,2,3-Trichlorobenzene	25.0	27.6		ug/L		110	70 - 130	2	20
1,2,4-Trichlorobenzene	25.0	29.7		ug/L		119	70 - 130	0	20
1,1,1-Trichloroethane	25.0	26.8		ug/L		107	70 - 130	0	20
1,1,2-Trichloroethane	25.0	25.6		ug/L		103	70 - 130	7	20
Trichloroethene	25.0	27.0		ug/L		108	70 - 130	0	20
Trichlorofluoromethane	25.0	25.8		ug/L		103	66 - 132	3	20
1,2,3-Trichloropropane	25.0	26.4		ug/L		106	70 - 130	11	20
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	23.6		ug/L		95	42 - 162	2	20
1,2,4-Trimethylbenzene	25.0	24.9		ug/L		99	70 - 132	0	20
1,3,5-Trimethylbenzene	25.0	28.4		ug/L		113	70 - 130	1	20
Vinyl acetate	25.0	25.3		ug/L		101	43 - 163	8	20
Vinyl chloride	25.0	25.4		ug/L		102	54 - 135	7	20
m-Xylene & p-Xylene	25.0	28.2		ug/L		113	70 - 142	3	20
o-Xylene	25.0	26.8		ug/L		107	70 - 130	4	20
2,2-Dichloropropane	25.0	30.9		ug/L		123	70 - 140	3	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-188153/7

Matrix: Water

Analysis Batch: 188153

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	93		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCSD 720-188153/9

Matrix: Water

Analysis Batch: 188153

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits		RPD	RPD Limit
Gasoline Range Organics (GRO) -C5-C12	500	493		ug/L		99	62 - 120	2	20	

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	100		67 - 130
1,2-Dichloroethane-d4 (Surr)	101		72 - 130
Toluene-d8 (Surr)	96		70 - 130

Lab Sample ID: 720-67069-2 MS

Matrix: Water

Analysis Batch: 188153

Client Sample ID: EFF

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS		Unit	D	%Rec	%Rec. Limits	
				Result	Qualifier					
Methyl tert-butyl ether	ND		25.0	27.4		ug/L		110	60 - 138	
Acetone	ND		125	135		ug/L		108	60 - 140	
Benzene	ND		25.0	26.3		ug/L		105	60 - 140	
Dichlorobromomethane	ND		25.0	27.1		ug/L		108	60 - 140	
Bromobenzene	ND		25.0	27.6		ug/L		110	60 - 140	
Chlorobromomethane	ND		25.0	24.9		ug/L		100	60 - 140	
Bromoform	ND		25.0	27.7		ug/L		111	56 - 140	
Bromomethane	ND		25.0	25.1		ug/L		100	23 - 140	
2-Butanone (MEK)	ND		125	140		ug/L		112	60 - 140	
n-Butylbenzene	ND		25.0	28.6		ug/L		114	60 - 140	
sec-Butylbenzene	ND		25.0	27.6		ug/L		110	60 - 140	
tert-Butylbenzene	ND		25.0	26.2		ug/L		105	60 - 140	
Carbon disulfide	ND		25.0	22.9		ug/L		91	38 - 140	
Carbon tetrachloride	ND		25.0	28.1		ug/L		112	60 - 140	
Chlorobenzene	ND		25.0	26.8		ug/L		107	60 - 140	
Chloroethane	ND		25.0	26.6		ug/L		106	51 - 140	
Chloroform	ND		25.0	25.6		ug/L		102	60 - 140	
Chloromethane	ND		25.0	17.9		ug/L		72	52 - 140	
2-Chlorotoluene	ND		25.0	27.6		ug/L		110	60 - 140	
4-Chlorotoluene	ND		25.0	27.8		ug/L		111	60 - 140	
Chlorodibromomethane	ND		25.0	28.0		ug/L		112	60 - 140	
1,2-Dichlorobenzene	ND		25.0	27.3		ug/L		109	60 - 140	
1,3-Dichlorobenzene	ND		25.0	27.2		ug/L		109	60 - 140	
1,4-Dichlorobenzene	ND		25.0	27.4		ug/L		110	60 - 140	
1,3-Dichloropropane	ND		25.0	25.3		ug/L		101	60 - 140	
1,1-Dichloropropene	ND		25.0	26.5		ug/L		106	60 - 140	

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-2 MS

Matrix: Water

Analysis Batch: 188153

Client Sample ID: EFF
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
1,2-Dibromo-3-Chloropropane	ND		25.0	25.4		ug/L		102	60 - 140
Ethylene Dibromide	ND		25.0	25.6		ug/L		103	60 - 140
Dibromomethane	ND		25.0	26.5		ug/L		106	60 - 140
Dichlorodifluoromethane	ND		25.0	19.8		ug/L		79	38 - 140
1,1-Dichloroethane	ND		25.0	26.1		ug/L		104	60 - 140
1,2-Dichloroethane	ND		25.0	25.5		ug/L		102	60 - 140
1,1-Dichloroethene	ND		25.0	22.4		ug/L		90	60 - 140
cis-1,2-Dichloroethene	ND		25.0	25.2		ug/L		101	60 - 140
trans-1,2-Dichloroethene	ND		25.0	25.1		ug/L		101	60 - 140
1,2-Dichloropropane	ND		25.0	26.3		ug/L		105	60 - 140
cis-1,3-Dichloropropene	ND		25.0	28.0		ug/L		112	60 - 140
trans-1,3-Dichloropropene	ND		25.0	31.2		ug/L		125	60 - 140
Ethylbenzene	ND		25.0	26.3		ug/L		105	60 - 140
Hexachlorobutadiene	ND		25.0	28.5		ug/L		114	60 - 140
2-Hexanone	ND		125	144		ug/L		115	60 - 140
Isopropylbenzene	ND		25.0	26.5		ug/L		106	60 - 140
4-Isopropyltoluene	ND		25.0	26.8		ug/L		107	60 - 140
Methylene Chloride	ND		25.0	26.8		ug/L		107	40 - 140
4-Methyl-2-pentanone (MIBK)	ND		125	145		ug/L		116	58 - 130
Naphthalene	ND		25.0	25.9		ug/L		104	56 - 140
N-Propylbenzene	ND		25.0	26.7		ug/L		107	60 - 140
Styrene	ND		25.0	24.6		ug/L		98	60 - 140
1,1,1,2-Tetrachloroethane	ND		25.0	29.1		ug/L		116	60 - 140
1,1,2,2-Tetrachloroethane	ND		25.0	26.4		ug/L		106	60 - 140
Tetrachloroethene	ND		25.0	26.9		ug/L		108	60 - 140
Toluene	ND		25.0	26.7		ug/L		107	60 - 140
1,2,3-Trichlorobenzene	ND		25.0	28.0		ug/L		112	60 - 140
1,2,4-Trichlorobenzene	ND		25.0	29.6		ug/L		118	60 - 140
1,1,1-Trichloroethane	ND		25.0	26.7		ug/L		107	60 - 140
1,1,2-Trichloroethane	ND		25.0	25.6		ug/L		102	60 - 140
Trichloroethene	ND		25.0	26.6		ug/L		106	60 - 140
Trichlorofluoromethane	ND		25.0	24.5		ug/L		98	60 - 140
1,2,3-Trichloropropane	ND		25.0	26.2		ug/L		105	60 - 140
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	23.2		ug/L		93	60 - 140
1,2,4-Trimethylbenzene	ND		25.0	24.7		ug/L		99	60 - 140
1,3,5-Trimethylbenzene	ND		25.0	28.0		ug/L		112	60 - 140
Vinyl acetate	ND		25.0	24.9		ug/L		100	40 - 140
Vinyl chloride	ND		25.0	23.2		ug/L		93	58 - 140
m-Xylene & p-Xylene	ND		25.0	28.0		ug/L		112	60 - 140
o-Xylene	ND		25.0	26.4		ug/L		106	60 - 140
2,2-Dichloropropane	ND		25.0	29.5		ug/L		118	60 - 140

Surrogate	MS %Recovery	MS Qualifier	Limits
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	97		72 - 130
Toluene-d8 (Surr)	98		70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-2 MSD
Matrix: Water
Analysis Batch: 188153

Client Sample ID: EFF
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	ND		25.0	27.1		ug/L		108	60 - 138	1	20
Acetone	ND		125	124		ug/L		99	60 - 140	9	20
Benzene	ND		25.0	26.4		ug/L		106	60 - 140	1	20
Dichlorobromomethane	ND		25.0	27.1		ug/L		108	60 - 140	0	20
Bromobenzene	ND		25.0	27.6		ug/L		110	60 - 140	0	20
Chlorobromomethane	ND		25.0	25.1		ug/L		100	60 - 140	1	20
Bromoform	ND		25.0	28.0		ug/L		112	56 - 140	1	20
Bromomethane	ND		25.0	24.6		ug/L		99	23 - 140	2	20
2-Butanone (MEK)	ND		125	135		ug/L		108	60 - 140	4	20
n-Butylbenzene	ND		25.0	28.4		ug/L		114	60 - 140	1	20
sec-Butylbenzene	ND		25.0	27.7		ug/L		111	60 - 140	1	20
tert-Butylbenzene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
Carbon disulfide	ND		25.0	22.7		ug/L		91	38 - 140	1	20
Carbon tetrachloride	ND		25.0	28.2		ug/L		113	60 - 140	0	20
Chlorobenzene	ND		25.0	26.8		ug/L		107	60 - 140	0	20
Chloroethane	ND		25.0	26.0		ug/L		104	51 - 140	2	20
Chloroform	ND		25.0	25.6		ug/L		103	60 - 140	0	20
Chloromethane	ND		25.0	17.1		ug/L		68	52 - 140	5	20
2-Chlorotoluene	ND		25.0	27.6		ug/L		110	60 - 140	0	20
4-Chlorotoluene	ND		25.0	27.6		ug/L		110	60 - 140	1	20
Chlorodibromomethane	ND		25.0	28.5		ug/L		114	60 - 140	2	20
1,2-Dichlorobenzene	ND		25.0	27.5		ug/L		110	60 - 140	1	20
1,3-Dichlorobenzene	ND		25.0	27.6		ug/L		110	60 - 140	1	20
1,4-Dichlorobenzene	ND		25.0	27.5		ug/L		110	60 - 140	0	20
1,3-Dichloropropane	ND		25.0	25.1		ug/L		101	60 - 140	1	20
1,1-Dichloropropene	ND		25.0	26.2		ug/L		105	60 - 140	1	20
1,2-Dibromo-3-Chloropropane	ND		25.0	24.0		ug/L		96	60 - 140	5	20
Ethylene Dibromide	ND		25.0	25.6		ug/L		102	60 - 140	0	20
Dibromomethane	ND		25.0	26.2		ug/L		105	60 - 140	1	20
Dichlorodifluoromethane	ND		25.0	18.3		ug/L		73	38 - 140	8	20
1,1-Dichloroethane	ND		25.0	25.9		ug/L		103	60 - 140	1	20
1,2-Dichloroethane	ND		25.0	28.4		ug/L		114	60 - 140	11	20
1,1-Dichloroethene	ND		25.0	22.0		ug/L		88	60 - 140	2	20
cis-1,2-Dichloroethene	ND		25.0	25.0		ug/L		100	60 - 140	1	20
trans-1,2-Dichloroethene	ND		25.0	25.2		ug/L		101	60 - 140	0	20
1,2-Dichloropropane	ND		25.0	26.2		ug/L		105	60 - 140	0	20
cis-1,3-Dichloropropene	ND		25.0	28.2		ug/L		113	60 - 140	1	20
trans-1,3-Dichloropropene	ND		25.0	30.8		ug/L		123	60 - 140	1	20
Ethylbenzene	ND		25.0	26.0		ug/L		104	60 - 140	1	20
Hexachlorobutadiene	ND		25.0	28.6		ug/L		114	60 - 140	0	20
2-Hexanone	ND		125	139		ug/L		111	60 - 140	3	20
Isopropylbenzene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
4-Isopropyltoluene	ND		25.0	26.9		ug/L		107	60 - 140	0	20
Methylene Chloride	ND		25.0	26.7		ug/L		107	40 - 140	0	20
4-Methyl-2-pentanone (MIBK)	ND		125	141		ug/L		113	58 - 130	3	20
Naphthalene	ND		25.0	26.0		ug/L		104	56 - 140	0	20
N-Propylbenzene	ND		25.0	26.9		ug/L		108	60 - 140	1	20
Styrene	ND		25.0	24.4		ug/L		98	60 - 140	1	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-2 MSD
Matrix: Water
Analysis Batch: 188153

Client Sample ID: EFF
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,1,1,2-Tetrachloroethane	ND		25.0	29.3		ug/L		117	60 - 140	1	20
1,1,2,2-Tetrachloroethane	ND		25.0	26.2		ug/L		105	60 - 140	1	20
Tetrachloroethene	ND		25.0	27.0		ug/L		108	60 - 140	0	20
Toluene	ND		25.0	26.5		ug/L		106	60 - 140	1	20
1,2,3-Trichlorobenzene	ND		25.0	28.0		ug/L		112	60 - 140	0	20
1,2,4-Trichlorobenzene	ND		25.0	29.7		ug/L		119	60 - 140	1	20
1,1,1-Trichloroethane	ND		25.0	26.7		ug/L		107	60 - 140	0	20
1,1,2-Trichloroethane	ND		25.0	25.5		ug/L		102	60 - 140	0	20
Trichloroethene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
Trichlorofluoromethane	ND		25.0	24.3		ug/L		97	60 - 140	1	20
1,2,3-Trichloropropane	ND		25.0	25.6		ug/L		102	60 - 140	2	20
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	22.9		ug/L		92	60 - 140	1	20
1,2,4-Trimethylbenzene	ND		25.0	24.7		ug/L		99	60 - 140	0	20
1,3,5-Trimethylbenzene	ND		25.0	28.2		ug/L		113	60 - 140	1	20
Vinyl acetate	ND		25.0	24.5		ug/L		98	40 - 140	1	20
Vinyl chloride	ND		25.0	22.9		ug/L		92	58 - 140	1	20
m-Xylene & p-Xylene	ND		25.0	27.7		ug/L		111	60 - 140	1	20
o-Xylene	ND		25.0	26.5		ug/L		106	60 - 140	0	20
2,2-Dichloropropane	ND		25.0	29.0		ug/L		116	60 - 140	2	20

Surrogate	MSD %Recovery	MSD Qualifier	MSD Limits
4-Bromofluorobenzene	98		67 - 130
1,2-Dichloroethane-d4 (Surr)	93		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: MB 720-188209/4
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/03/15 08:37	1
Acetone	ND		50		ug/L			09/03/15 08:37	1
Benzene	ND		0.50		ug/L			09/03/15 08:37	1
Dichlorobromomethane	ND		0.50		ug/L			09/03/15 08:37	1
Bromobenzene	ND		1.0		ug/L			09/03/15 08:37	1
Chlorobromomethane	ND		1.0		ug/L			09/03/15 08:37	1
Bromoform	ND		1.0		ug/L			09/03/15 08:37	1
Bromomethane	ND		1.0		ug/L			09/03/15 08:37	1
2-Butanone (MEK)	ND		50		ug/L			09/03/15 08:37	1
n-Butylbenzene	ND		1.0		ug/L			09/03/15 08:37	1
sec-Butylbenzene	ND		1.0		ug/L			09/03/15 08:37	1
tert-Butylbenzene	ND		1.0		ug/L			09/03/15 08:37	1
Carbon disulfide	ND		5.0		ug/L			09/03/15 08:37	1
Carbon tetrachloride	ND		0.50		ug/L			09/03/15 08:37	1
Chlorobenzene	ND		0.50		ug/L			09/03/15 08:37	1
Chloroethane	ND		1.0		ug/L			09/03/15 08:37	1
Chloroform	ND		1.0		ug/L			09/03/15 08:37	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-188209/4
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloromethane	ND		1.0		ug/L			09/03/15 08:37	1
2-Chlorotoluene	ND		0.50		ug/L			09/03/15 08:37	1
4-Chlorotoluene	ND		0.50		ug/L			09/03/15 08:37	1
Chlorodibromomethane	ND		0.50		ug/L			09/03/15 08:37	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/03/15 08:37	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/03/15 08:37	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/03/15 08:37	1
1,3-Dichloropropane	ND		1.0		ug/L			09/03/15 08:37	1
1,1-Dichloropropene	ND		0.50		ug/L			09/03/15 08:37	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/03/15 08:37	1
Ethylene Dibromide	ND		0.50		ug/L			09/03/15 08:37	1
Dibromomethane	ND		0.50		ug/L			09/03/15 08:37	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/03/15 08:37	1
1,1-Dichloroethane	ND		0.50		ug/L			09/03/15 08:37	1
1,2-Dichloroethane	ND		0.50		ug/L			09/03/15 08:37	1
1,1-Dichloroethene	ND		0.50		ug/L			09/03/15 08:37	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/03/15 08:37	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/03/15 08:37	1
1,2-Dichloropropane	ND		0.50		ug/L			09/03/15 08:37	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/03/15 08:37	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/03/15 08:37	1
Ethylbenzene	ND		0.50		ug/L			09/03/15 08:37	1
Hexachlorobutadiene	ND		1.0		ug/L			09/03/15 08:37	1
2-Hexanone	ND		50		ug/L			09/03/15 08:37	1
Isopropylbenzene	ND		0.50		ug/L			09/03/15 08:37	1
4-Isopropyltoluene	ND		1.0		ug/L			09/03/15 08:37	1
Methylene Chloride	ND		5.0		ug/L			09/03/15 08:37	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/03/15 08:37	1
Naphthalene	ND		1.0		ug/L			09/03/15 08:37	1
N-Propylbenzene	ND		1.0		ug/L			09/03/15 08:37	1
Styrene	ND		0.50		ug/L			09/03/15 08:37	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/03/15 08:37	1
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/03/15 08:37	1
Tetrachloroethene	ND		0.50		ug/L			09/03/15 08:37	1
Toluene	ND		0.50		ug/L			09/03/15 08:37	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/03/15 08:37	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/03/15 08:37	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/03/15 08:37	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/03/15 08:37	1
Trichloroethene	ND		0.50		ug/L			09/03/15 08:37	1
Trichlorofluoromethane	ND		1.0		ug/L			09/03/15 08:37	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/03/15 08:37	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/03/15 08:37	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/03/15 08:37	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/03/15 08:37	1
Vinyl acetate	ND		10		ug/L			09/03/15 08:37	1
Vinyl chloride	ND		0.50		ug/L			09/03/15 08:37	1
Xylenes, Total	ND		1.0		ug/L			09/03/15 08:37	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-188209/4
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2,2-Dichloropropane	ND		0.50		ug/L			09/03/15 08:37	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/03/15 08:37	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	91		67 - 130		09/03/15 08:37	1
1,2-Dichloroethane-d4 (Surr)	105		72 - 130		09/03/15 08:37	1
Toluene-d8 (Surr)	94		70 - 130		09/03/15 08:37	1

Lab Sample ID: LCS 720-188209/5
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	25.0	22.9		ug/L		92	62 - 130
Acetone	125	148		ug/L		118	26 - 180
Benzene	25.0	24.5		ug/L		98	79 - 130
Dichlorobromomethane	25.0	23.7		ug/L		95	70 - 130
Bromobenzene	25.0	26.9		ug/L		108	70 - 130
Chlorobromomethane	25.0	23.3		ug/L		93	70 - 130
Bromoform	25.0	24.0		ug/L		96	68 - 136
Bromomethane	25.0	23.2		ug/L		93	43 - 151
2-Butanone (MEK)	125	124		ug/L		99	54 - 130
n-Butylbenzene	25.0	26.5		ug/L		106	70 - 142
sec-Butylbenzene	25.0	27.5		ug/L		110	70 - 134
tert-Butylbenzene	25.0	25.6		ug/L		103	70 - 135
Carbon disulfide	25.0	19.4		ug/L		78	58 - 130
Carbon tetrachloride	25.0	23.0		ug/L		92	70 - 146
Chlorobenzene	25.0	27.6		ug/L		110	70 - 130
Chloroethane	25.0	23.2		ug/L		93	62 - 138
Chloroform	25.0	23.5		ug/L		94	70 - 130
Chloromethane	25.0	24.1		ug/L		96	52 - 175
2-Chlorotoluene	25.0	26.5		ug/L		106	70 - 130
4-Chlorotoluene	25.0	26.6		ug/L		106	70 - 130
Chlorodibromomethane	25.0	24.4		ug/L		97	70 - 145
1,2-Dichlorobenzene	25.0	26.9		ug/L		108	70 - 130
1,3-Dichlorobenzene	25.0	28.3		ug/L		113	70 - 130
1,4-Dichlorobenzene	25.0	27.4		ug/L		109	70 - 130
1,3-Dichloropropane	25.0	24.9		ug/L		100	70 - 130
1,1-Dichloropropene	25.0	23.9		ug/L		96	70 - 130
1,2-Dibromo-3-Chloropropane	25.0	22.3		ug/L		89	70 - 136
Ethylene Dibromide	25.0	24.4		ug/L		98	70 - 130
Dibromomethane	25.0	23.7		ug/L		95	70 - 130
Dichlorodifluoromethane	25.0	15.1		ug/L		60	34 - 132
1,1-Dichloroethane	25.0	24.0		ug/L		96	70 - 130
1,2-Dichloroethane	25.0	25.1		ug/L		100	61 - 132
1,1-Dichloroethene	25.0	20.1		ug/L		80	64 - 128
cis-1,2-Dichloroethene	25.0	24.4		ug/L		98	70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-188209/5

Matrix: Water

Analysis Batch: 188209

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
trans-1,2-Dichloroethene	25.0	23.0		ug/L		92	68 - 130
1,2-Dichloropropane	25.0	24.4		ug/L		98	70 - 130
cis-1,3-Dichloropropene	25.0	24.6		ug/L		99	70 - 130
trans-1,3-Dichloropropene	25.0	26.4		ug/L		105	70 - 140
Ethylbenzene	25.0	26.1		ug/L		104	80 - 120
Hexachlorobutadiene	25.0	24.8		ug/L		99	70 - 130
2-Hexanone	125	144		ug/L		115	60 - 164
Isopropylbenzene	25.0	25.7		ug/L		103	70 - 130
4-Isopropyltoluene	25.0	26.4		ug/L		106	70 - 130
Methylene Chloride	25.0	23.9		ug/L		96	70 - 147
4-Methyl-2-pentanone (MIBK)	125	149		ug/L		119	58 - 130
Naphthalene	25.0	25.1		ug/L		100	70 - 130
N-Propylbenzene	25.0	27.1		ug/L		108	70 - 130
Styrene	25.0	23.6		ug/L		94	70 - 130
1,1,1,2-Tetrachloroethane	25.0	26.5		ug/L		106	70 - 130
1,1,2,2-Tetrachloroethane	25.0	25.6		ug/L		102	70 - 130
Tetrachloroethene	25.0	22.6		ug/L		90	70 - 130
Toluene	25.0	24.8		ug/L		99	78 - 120
1,2,3-Trichlorobenzene	25.0	26.4		ug/L		106	70 - 130
1,2,4-Trichlorobenzene	25.0	27.3		ug/L		109	70 - 130
1,1,1-Trichloroethane	25.0	22.5		ug/L		90	70 - 130
1,1,2-Trichloroethane	25.0	23.4		ug/L		94	70 - 130
Trichloroethene	25.0	25.1		ug/L		100	70 - 130
Trichlorofluoromethane	25.0	23.3		ug/L		93	66 - 132
1,2,3-Trichloropropane	25.0	26.8		ug/L		107	70 - 130
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	19.3		ug/L		77	42 - 162
1,2,4-Trimethylbenzene	25.0	26.5		ug/L		106	70 - 132
1,3,5-Trimethylbenzene	25.0	25.8		ug/L		103	70 - 130
Vinyl acetate	25.0	29.6		ug/L		118	43 - 163
Vinyl chloride	25.0	22.5		ug/L		90	54 - 135
m-Xylene & p-Xylene	25.0	25.7		ug/L		103	70 - 142
o-Xylene	25.0	25.6		ug/L		102	70 - 130
2,2-Dichloropropane	25.0	24.4		ug/L		98	70 - 140

Surrogate	LCS LCS		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	91		67 - 130
1,2-Dichloroethane-d4 (Surr)	101		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCS 720-188209/7

Matrix: Water

Analysis Batch: 188209

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Gasoline Range Organics (GRO) -C5-C12	500	553		ug/L		111	62 - 120

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-188209/7

Matrix: Water

Analysis Batch: 188209

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Surrogate	LCS		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	92		67 - 130
1,2-Dichloroethane-d4 (Surr)	104		72 - 130
Toluene-d8 (Surr)	97		70 - 130

Lab Sample ID: LCSD 720-188209/6

Matrix: Water

Analysis Batch: 188209

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec.		RPD	RPD Limit
							Limits	RPD		
Methyl tert-butyl ether	25.0	22.3		ug/L		89	62 - 130	3	20	
Acetone	125	131		ug/L		105	26 - 180	12	30	
Benzene	25.0	24.9		ug/L		99	79 - 130	1	20	
Dichlorobromomethane	25.0	23.7		ug/L		95	70 - 130	0	20	
Bromobenzene	25.0	27.2		ug/L		109	70 - 130	1	20	
Chlorobromomethane	25.0	23.6		ug/L		94	70 - 130	1	20	
Bromoform	25.0	22.8		ug/L		91	68 - 136	5	20	
Bromomethane	25.0	23.8		ug/L		95	43 - 151	2	20	
2-Butanone (MEK)	125	108		ug/L		87	54 - 130	13	20	
n-Butylbenzene	25.0	26.6		ug/L		106	70 - 142	0	20	
sec-Butylbenzene	25.0	27.9		ug/L		112	70 - 134	2	20	
tert-Butylbenzene	25.0	25.9		ug/L		104	70 - 135	1	20	
Carbon disulfide	25.0	19.7		ug/L		79	58 - 130	1	20	
Carbon tetrachloride	25.0	23.4		ug/L		94	70 - 146	2	20	
Chlorobenzene	25.0	27.8		ug/L		111	70 - 130	1	20	
Chloroethane	25.0	23.5		ug/L		94	62 - 138	1	20	
Chloroform	25.0	23.8		ug/L		95	70 - 130	2	20	
Chloromethane	25.0	23.7		ug/L		95	52 - 175	2	20	
2-Chlorotoluene	25.0	26.9		ug/L		108	70 - 130	2	20	
4-Chlorotoluene	25.0	26.8		ug/L		107	70 - 130	1	20	
Chlorodibromomethane	25.0	23.9		ug/L		96	70 - 145	2	20	
1,2-Dichlorobenzene	25.0	27.2		ug/L		109	70 - 130	1	20	
1,3-Dichlorobenzene	25.0	28.2		ug/L		113	70 - 130	0	20	
1,4-Dichlorobenzene	25.0	27.6		ug/L		110	70 - 130	1	20	
1,3-Dichloropropane	25.0	24.8		ug/L		99	70 - 130	0	20	
1,1-Dichloropropane	25.0	24.1		ug/L		96	70 - 130	1	20	
1,2-Dibromo-3-Chloropropane	25.0	20.1		ug/L		81	70 - 136	10	20	
Ethylene Dibromide	25.0	23.4		ug/L		94	70 - 130	4	20	
Dibromomethane	25.0	23.2		ug/L		93	70 - 130	2	20	
Dichlorodifluoromethane	25.0	15.4		ug/L		62	34 - 132	2	20	
1,1-Dichloroethane	25.0	24.3		ug/L		97	70 - 130	1	20	
1,2-Dichloroethane	25.0	24.8		ug/L		99	61 - 132	1	20	
1,1-Dichloroethene	25.0	20.4		ug/L		82	64 - 128	2	20	
cis-1,2-Dichloroethene	25.0	24.7		ug/L		99	70 - 130	1	20	
trans-1,2-Dichloroethene	25.0	23.8		ug/L		95	68 - 130	3	20	
1,2-Dichloropropane	25.0	24.9		ug/L		100	70 - 130	2	20	
cis-1,3-Dichloropropene	25.0	24.5		ug/L		98	70 - 130	0	20	
trans-1,3-Dichloropropene	25.0	25.8		ug/L		103	70 - 140	2	20	
Ethylbenzene	25.0	26.3		ug/L		105	80 - 120	1	20	

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-188209/6
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Hexachlorobutadiene	25.0	24.3		ug/L		97	70 - 130	2	20
2-Hexanone	125	123		ug/L		99	60 - 164	15	20
Isopropylbenzene	25.0	25.8		ug/L		103	70 - 130	0	20
4-Isopropyltoluene	25.0	26.6		ug/L		107	70 - 130	1	20
Methylene Chloride	25.0	24.1		ug/L		97	70 - 147	1	20
4-Methyl-2-pentanone (MIBK)	125	132		ug/L		105	58 - 130	13	20
Naphthalene	25.0	23.2		ug/L		93	70 - 130	8	20
N-Propylbenzene	25.0	27.2		ug/L		109	70 - 130	0	20
Styrene	25.0	23.6		ug/L		94	70 - 130	0	20
1,1,1,2-Tetrachloroethane	25.0	26.9		ug/L		108	70 - 130	2	20
1,1,2,2-Tetrachloroethane	25.0	24.0		ug/L		96	70 - 130	6	20
Tetrachloroethene	25.0	22.8		ug/L		91	70 - 130	1	20
Toluene	25.0	25.2		ug/L		101	78 - 120	2	20
1,2,3-Trichlorobenzene	25.0	25.5		ug/L		102	70 - 130	3	20
1,2,4-Trichlorobenzene	25.0	26.6		ug/L		107	70 - 130	2	20
1,1,1-Trichloroethane	25.0	22.9		ug/L		92	70 - 130	2	20
1,1,2-Trichloroethane	25.0	23.1		ug/L		92	70 - 130	1	20
Trichloroethene	25.0	25.4		ug/L		102	70 - 130	1	20
Trichlorofluoromethane	25.0	23.2		ug/L		93	66 - 132	0	20
1,2,3-Trichloropropane	25.0	24.7		ug/L		99	70 - 130	8	20
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	19.6		ug/L		78	42 - 162	1	20
1,2,4-Trimethylbenzene	25.0	26.7		ug/L		107	70 - 132	1	20
1,3,5-Trimethylbenzene	25.0	26.1		ug/L		104	70 - 130	1	20
Vinyl acetate	25.0	28.0		ug/L		112	43 - 163	5	20
Vinyl chloride	25.0	22.8		ug/L		91	54 - 135	1	20
m-Xylene & p-Xylene	25.0	25.8		ug/L		103	70 - 142	0	20
o-Xylene	25.0	25.5		ug/L		102	70 - 130	0	20
2,2-Dichloropropane	25.0	24.5		ug/L		98	70 - 140	0	20

Surrogate	LCSD %Recovery	LCSD Qualifier	LCSD Limits
4-Bromofluorobenzene	90		67 - 130
1,2-Dichloroethane-d4 (Surr)	100		72 - 130
Toluene-d8 (Surr)	96		70 - 130

Lab Sample ID: LCSD 720-188209/8
Matrix: Water
Analysis Batch: 188209

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Gasoline Range Organics (GRO) -C5-C12	500	519		ug/L		104	62 - 120	6	20

Surrogate	LCSD %Recovery	LCSD Qualifier	LCSD Limits
4-Bromofluorobenzene	93		67 - 130
1,2-Dichloroethane-d4 (Surr)	107		72 - 130
Toluene-d8 (Surr)	97		70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-1 MS

Matrix: Water

Analysis Batch: 188209

Client Sample ID: INF

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	1.0		25.0	22.0		ug/L		84	60 - 138
Acetone	ND		125	117		ug/L		94	60 - 140
Benzene	7.1		25.0	30.0		ug/L		92	60 - 140
Dichlorobromomethane	ND		25.0	22.4		ug/L		90	60 - 140
Bromobenzene	ND		25.0	25.0		ug/L		100	60 - 140
Chlorobromomethane	ND		25.0	22.3		ug/L		89	60 - 140
Bromoform	ND		25.0	21.9		ug/L		87	56 - 140
Bromomethane	ND		25.0	22.1		ug/L		88	23 - 140
2-Butanone (MEK)	ND		125	107		ug/L		85	60 - 140
n-Butylbenzene	1.7		25.0	26.3		ug/L		98	60 - 140
sec-Butylbenzene	ND		25.0	25.3		ug/L		101	60 - 140
tert-Butylbenzene	ND		25.0	23.7		ug/L		95	60 - 140
Carbon disulfide	ND		25.0	18.1		ug/L		72	38 - 140
Carbon tetrachloride	ND		25.0	21.5		ug/L		86	60 - 140
Chlorobenzene	ND		25.0	25.6		ug/L		102	60 - 140
Chloroethane	ND		25.0	21.6		ug/L		87	51 - 140
Chloroform	1.5		25.0	23.6		ug/L		89	60 - 140
Chloromethane	ND		25.0	20.5		ug/L		82	52 - 140
2-Chlorotoluene	ND		25.0	24.6		ug/L		98	60 - 140
4-Chlorotoluene	1.2		25.0	26.2		ug/L		100	60 - 140
Chlorodibromomethane	ND		25.0	22.9		ug/L		92	60 - 140
1,2-Dichlorobenzene	ND		25.0	25.7		ug/L		103	60 - 140
1,3-Dichlorobenzene	ND		25.0	26.7		ug/L		107	60 - 140
1,4-Dichlorobenzene	ND		25.0	26.1		ug/L		104	60 - 140
1,3-Dichloropropane	ND		25.0	22.9		ug/L		92	60 - 140
1,1-Dichloropropene	ND		25.0	22.3		ug/L		89	60 - 140
1,2-Dibromo-3-Chloropropane	ND		25.0	19.9		ug/L		80	60 - 140
Ethylene Dibromide	ND		25.0	22.7		ug/L		91	60 - 140
Dibromomethane	ND		25.0	21.7		ug/L		87	60 - 140
Dichlorodifluoromethane	ND		25.0	13.2		ug/L		53	38 - 140
1,1-Dichloroethane	ND		25.0	22.8		ug/L		91	60 - 140
1,2-Dichloroethane	ND		25.0	24.0		ug/L		95	60 - 140
1,1-Dichloroethene	ND		25.0	18.7		ug/L		75	60 - 140
cis-1,2-Dichloroethene	ND		25.0	22.9		ug/L		92	60 - 140
trans-1,2-Dichloroethene	ND		25.0	21.5		ug/L		86	60 - 140
1,2-Dichloropropane	ND		25.0	23.0		ug/L		92	60 - 140
cis-1,3-Dichloropropene	ND		25.0	23.4		ug/L		93	60 - 140
trans-1,3-Dichloropropene	ND		25.0	24.4		ug/L		98	60 - 140
Ethylbenzene	ND		25.0	23.9		ug/L		96	60 - 140
Hexachlorobutadiene	ND		25.0	23.1		ug/L		93	60 - 140
2-Hexanone	ND		125	118		ug/L		94	60 - 140
Isopropylbenzene	ND		25.0	23.4		ug/L		94	60 - 140
4-Isopropyltoluene	ND		25.0	24.8		ug/L		99	60 - 140
Methylene Chloride	ND		25.0	22.7		ug/L		91	40 - 140
4-Methyl-2-pentanone (MIBK)	ND		125	126		ug/L		101	58 - 130
Naphthalene	16		25.0	38.5		ug/L		90	56 - 140
N-Propylbenzene	ND		25.0	24.9		ug/L		99	60 - 140
Styrene	ND		25.0	21.7		ug/L		87	60 - 140

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-1 MS

Matrix: Water

Analysis Batch: 188209

Client Sample ID: INF

Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec. Limits
	Result	Qualifier	Added	Result	Qualifier				
1,1,1,2-Tetrachloroethane	ND		25.0	24.7		ug/L		99	60 - 140
1,1,2,2-Tetrachloroethane	ND		25.0	22.7		ug/L		91	60 - 140
Tetrachloroethene	ND		25.0	21.2		ug/L		85	60 - 140
Toluene	4.4		25.0	26.9		ug/L		90	60 - 140
1,2,3-Trichlorobenzene	ND		25.0	25.2		ug/L		101	60 - 140
1,2,4-Trichlorobenzene	ND		25.0	26.2		ug/L		105	60 - 140
1,1,1-Trichloroethane	ND		25.0	21.3		ug/L		85	60 - 140
1,1,2-Trichloroethane	ND		25.0	22.3		ug/L		89	60 - 140
Trichloroethene	ND		25.0	23.7		ug/L		95	60 - 140
Trichlorofluoromethane	ND		25.0	21.3		ug/L		85	60 - 140
1,2,3-Trichloropropane	ND		25.0	23.1		ug/L		93	60 - 140
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	17.9		ug/L		72	60 - 140
1,2,4-Trimethylbenzene	ND		25.0	24.9		ug/L		99	60 - 140
1,3,5-Trimethylbenzene	37		25.0	60.4		ug/L		92	60 - 140
Vinyl acetate	ND		25.0	27.1		ug/L		88	40 - 140
Vinyl chloride	ND		25.0	20.3		ug/L		81	58 - 140
m-Xylene & p-Xylene	18		25.0	40.4		ug/L		89	60 - 140
o-Xylene	86		25.0	101		ug/L		63	60 - 140
2,2-Dichloropropane	ND		25.0	21.9		ug/L		88	60 - 140
		MS	MS						
Surrogate		%Recovery	Qualifier	Limits					
4-Bromofluorobenzene		86		67 - 130					
1,2-Dichloroethane-d4 (Surr)		101		72 - 130					
Toluene-d8 (Surr)		95		70 - 130					

Lab Sample ID: 720-67069-1 MSD

Matrix: Water

Analysis Batch: 188209

Client Sample ID: INF

Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
	Result	Qualifier	Added	Result	Qualifier						
Methyl tert-butyl ether	1.0		25.0	23.3		ug/L		89	60 - 138	5	20
Acetone	ND		125	125		ug/L		100	60 - 140	7	20
Benzene	7.1		25.0	31.5		ug/L		98	60 - 140	5	20
Dichlorobromomethane	ND		25.0	23.4		ug/L		94	60 - 140	4	20
Bromobenzene	ND		25.0	26.3		ug/L		105	60 - 140	5	20
Chlorobromomethane	ND		25.0	23.5		ug/L		94	60 - 140	5	20
Bromoform	ND		25.0	24.1		ug/L		97	56 - 140	10	20
Bromomethane	ND		25.0	23.4		ug/L		94	23 - 140	6	20
2-Butanone (MEK)	ND		125	111		ug/L		89	60 - 140	4	20
n-Butylbenzene	1.7		25.0	27.4		ug/L		103	60 - 140	4	20
sec-Butylbenzene	ND		25.0	26.6		ug/L		106	60 - 140	5	20
tert-Butylbenzene	ND		25.0	25.0		ug/L		100	60 - 140	5	20
Carbon disulfide	ND		25.0	19.3		ug/L		77	38 - 140	6	20
Carbon tetrachloride	ND		25.0	22.7		ug/L		91	60 - 140	5	20
Chlorobenzene	ND		25.0	27.8		ug/L		111	60 - 140	8	20
Chloroethane	ND		25.0	22.8		ug/L		91	51 - 140	5	20
Chloroform	1.5		25.0	24.9		ug/L		94	60 - 140	5	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-1 MSD
Matrix: Water
Analysis Batch: 188209

Client Sample ID: INF
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Chloromethane	ND		25.0	19.7		ug/L		79	52 - 140	4	20
2-Chlorotoluene	ND		25.0	25.9		ug/L		103	60 - 140	5	20
4-Chlorotoluene	1.2		25.0	27.9		ug/L		107	60 - 140	6	20
Chlorodibromomethane	ND		25.0	24.1		ug/L		96	60 - 140	5	20
1,2-Dichlorobenzene	ND		25.0	27.0		ug/L		108	60 - 140	5	20
1,3-Dichlorobenzene	ND		25.0	28.0		ug/L		112	60 - 140	5	20
1,4-Dichlorobenzene	ND		25.0	27.4		ug/L		110	60 - 140	5	20
1,3-Dichloropropane	ND		25.0	24.7		ug/L		99	60 - 140	8	20
1,1-Dichloropropene	ND		25.0	23.1		ug/L		92	60 - 140	3	20
1,2-Dibromo-3-Chloropropane	ND		25.0	22.3		ug/L		89	60 - 140	11	20
Ethylene Dibromide	ND		25.0	23.6		ug/L		95	60 - 140	4	20
Dibromomethane	ND		25.0	22.7		ug/L		91	60 - 140	4	20
Dichlorodifluoromethane	ND		25.0	13.3		ug/L		53	38 - 140	1	20
1,1-Dichloroethane	ND		25.0	23.8		ug/L		95	60 - 140	4	20
1,2-Dichloroethane	ND		25.0	24.7		ug/L		98	60 - 140	3	20
1,1-Dichloroethene	ND		25.0	20.0		ug/L		80	60 - 140	6	20
cis-1,2-Dichloroethene	ND		25.0	23.9		ug/L		96	60 - 140	4	20
trans-1,2-Dichloroethene	ND		25.0	22.9		ug/L		91	60 - 140	6	20
1,2-Dichloropropane	ND		25.0	24.5		ug/L		98	60 - 140	6	20
cis-1,3-Dichloropropene	ND		25.0	24.4		ug/L		97	60 - 140	4	20
trans-1,3-Dichloropropene	ND		25.0	25.9		ug/L		103	60 - 140	6	20
Ethylbenzene	ND		25.0	25.9		ug/L		104	60 - 140	8	20
Hexachlorobutadiene	ND		25.0	25.3		ug/L		101	60 - 140	9	20
2-Hexanone	ND		125	118		ug/L		94	60 - 140	0	20
Isopropylbenzene	ND		25.0	25.5		ug/L		102	60 - 140	8	20
4-Isopropyltoluene	ND		25.0	26.2		ug/L		105	60 - 140	6	20
Methylene Chloride	ND		25.0	24.4		ug/L		97	40 - 140	7	20
4-Methyl-2-pentanone (MIBK)	ND		125	125		ug/L		100	58 - 130	1	20
Naphthalene	16		25.0	42.2		ug/L		105	56 - 140	9	20
N-Propylbenzene	ND		25.0	25.8		ug/L		103	60 - 140	4	20
Styrene	ND		25.0	23.5		ug/L		94	60 - 140	8	20
1,1,1,2-Tetrachloroethane	ND		25.0	27.1		ug/L		108	60 - 140	9	20
1,1,1,2-Tetrachloroethane	ND		25.0	24.2		ug/L		97	60 - 140	6	20
Tetrachloroethene	ND		25.0	22.1		ug/L		89	60 - 140	4	20
Toluene	4.4		25.0	29.3		ug/L		100	60 - 140	9	20
1,2,3-Trichlorobenzene	ND		25.0	27.7		ug/L		111	60 - 140	10	20
1,2,4-Trichlorobenzene	ND		25.0	28.3		ug/L		113	60 - 140	8	20
1,1,1-Trichloroethane	ND		25.0	22.4		ug/L		90	60 - 140	5	20
1,1,2-Trichloroethane	ND		25.0	23.5		ug/L		94	60 - 140	5	20
Trichloroethene	ND		25.0	24.8		ug/L		99	60 - 140	5	20
Trichlorofluoromethane	ND		25.0	22.2		ug/L		89	60 - 140	4	20
1,2,3-Trichloropropane	ND		25.0	24.4		ug/L		98	60 - 140	5	20
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	19.4		ug/L		78	60 - 140	8	20
1,2,4-Trimethylbenzene	ND		25.0	26.4		ug/L		105	60 - 140	6	20
1,3,5-Trimethylbenzene	37		25.0	63.8		ug/L		106	60 - 140	6	20
Vinyl acetate	ND		25.0	26.6		ug/L		86	40 - 140	2	20
Vinyl chloride	ND		25.0	21.1		ug/L		84	58 - 140	4	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67069-1 MSD

Matrix: Water

Analysis Batch: 188209

Client Sample ID: INF

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
m-Xylene & p-Xylene	18		25.0	43.7		ug/L		102	60 - 140	8	20
o-Xylene	86		25.0	110		ug/L		99	60 - 140	8	20
2,2-Dichloropropane	ND		25.0	22.9		ug/L		92	60 - 140	4	20

Surrogate	MSD %Recovery	MSD Qualifier	MSD Limits
4-Bromofluorobenzene	91		67 - 130
1,2-Dichloroethane-d4 (Surr)	99		72 - 130
Toluene-d8 (Surr)	96		70 - 130

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

GC/MS VOA

Analysis Batch: 188153

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-67069-1	INF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-2	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-2 MS	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-2 MSD	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-3	GAC	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-188153/6	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-188153/8	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-188153/7	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-188153/9	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
MB 720-188153/5	Method Blank	Total/NA	Water	8260B/CA_LUFT MS	

Analysis Batch: 188209

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-67069-1	INF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-1 MS	INF	Total/NA	Water	8260B/CA_LUFT MS	
720-67069-1 MSD	INF	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-188209/5	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-188209/7	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-188209/6	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-188209/8	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
MB 720-188209/4	Method Blank	Total/NA	Water	8260B/CA_LUFT MS	

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Client Sample ID: INF

Date Collected: 08/27/15 13:10

Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	188209	09/03/15 14:33	PRD	TAL PLS
Total/NA	Analysis	8260B/CA_LUFTMS		1	188153	09/02/15 18:59	PRD	TAL PLS

Client Sample ID: EFF

Date Collected: 08/27/15 13:10

Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	188153	09/02/15 18:30	PRD	TAL PLS

Client Sample ID: GAC

Date Collected: 08/27/15 13:10

Date Received: 08/28/15 12:14

Lab Sample ID: 720-67069-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	188153	09/02/15 19:28	PRD	TAL PLS

Laboratory References:

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

Certification Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Laboratory: TestAmerica Pleasanton

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
California	State Program	9	2496	01-31-16

Analysis Method	Prep Method	Matrix	Analyte
-----------------	-------------	--------	---------

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

Method Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Method	Method Description	Protocol	Laboratory
8260B/CA_LUFTM S	8260B / CA LUFT MS	SW846	TAL PLS

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919



Sample Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67069-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
720-67069-1	INF	Water	08/27/15 13:10	08/28/15 12:14
720-67069-2	EFF	Water	08/27/15 13:10	08/28/15 12:14
720-67069-3	GAC	Water	08/27/15 13:10	08/28/15 12:14

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

720-67069

TESTAMERICA Pleasanton Chain of Custody
 1220 Quarry Lane • Pleasanton CA 94566-4756
 Phone: (925) 484-1919 • Fax: (925) 600-3002

Reference #: 103442
 Date 8/12/15 Page 1 of 1

Report To

Client: Forest McFarland
 Company: Ninyo & Moore
 Address: 1956 Webster St, Dublin, CA
 Mail: Forest McFarland Environmental
 Ill To: 40189600Y Sampled by: ESH
 Phone: 810-243-3000

Analysis Request

Volatile Organics GC/MS (VOCs) EPA 8260B
 HVOCs by EPA 8260B
 EPA 8260B: Gas BTEX
 5 Oxygenates DCA, EDB Ethanol
 TEPH EPA 8015B Silica Gel
 Diesel Motor Oil Other _____
 SemiVolatile Organics GC/MS
 EPA 8270C
 PNA/PAH's by 8270C
 8270C SIM
 Oil and Grease Petroleum
 (EPA 1664/9071) Total
 Pesticides EPA 8081
 PCBs EPA 8082
 CAM17 Metals
 (EPA 6010/7470/7471)
 Metals: 6010B 200.7
 Lead LUFT RCRA Other: _____
 Metals: 6020 200.8
 (ICP-MS): _____
 W.E.T (STLC)
 W.E.T (DI) TCLP
 Hex Chrom by EPA 7196
 or EPA 7199
 pH 9040
 SM4500
 Spec. Cond. Alkalinity
 TSS SS TDS
 Anions: Cl SO₄ NO₃ F
 Br NO₂ PO₄
 Perchlorate by EPA 314.0
 COD EPA 410.4 SM5220D
 Turbidity

Sample ID	Date	Time	Met. Present	Number of Containers
109F	8/27/15	13:00	W	1
EFFE	8/27/15	13:10	W	1
GAC	8/27/15	13:00	W	1



Project Name/ #: CH44N
 O#: 40189600Y
 Temp: 3.10°C

Project Info

Sample Receipt

of Containers: 9
 Head Space: _____

Relinquished by:

1) Relinquished by: Forest McFarland Signature
W. Moore Printed Name
8/29/15 Date
 Company: Ninyo & Moore

2) Relinquished by: Victor Romo Signature
Victor Romo Printed Name
8/28/15 Date
 Company: TA

3) Relinquished by: _____ Signature
 _____ Printed Name
 _____ Date
 Company: _____

Received by:

1) Received by: Victor Romo Signature
Victor Romo Printed Name
8/28/15 Date
 Company: TA

2) Received by: Victor Romo Signature
Victor Romo Printed Name
8/28/15 Date
 Company: TA

3) Received by: _____ Signature
 _____ Printed Name
 _____ Date
 Company: _____

Other: STD.

5 Day 4 Day 3 Day 2 Day 1 Day

Y/N: _____

If yes, please call with payment information ASAP

Report: Routine Level 3 Level 4 EDD EDF
 Special Instructions / Comments: Global ID _____

See Terms and Conditions on reverse

Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-67069-1

Login Number: 67069

List Number: 1

Creator: Gonzales, Justinn

List Source: TestAmerica Pleasanton

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	N/A	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING


ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Pleasanton
1220 Quarry Lane
Pleasanton, CA 94566
Tel: (925)484-1919

TestAmerica Job ID: 720-67592-1
Client Project/Site: Chun

For:
Ninyo & Moore
1956 Webster Street
Suite 400
Oakland, California 94612

Attn: Mr. Peter D. Sims



Authorized for release by:
10/1/2015 1:01:48 PM

Dimple Sharma, Senior Project Manager
(925)484-1919
dimple.sharma@testamericainc.com

LINKS

Review your project
results through
TotalAccess

Have a Question?



Visit us at:
www.testamericainc.com

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15



Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	6
Surrogate Summary	12
QC Sample Results	13
QC Association Summary	22
Lab Chronicle	23
Certification Summary	24
Method Summary	25
Sample Summary	26
Chain of Custody	27
Receipt Checklists	28

Definitions/Glossary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
F2	MS/MSD RPD exceeds control limits

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Job ID: 720-67592-1

Laboratory: TestAmerica Pleasanton

Narrative

Job Narrative
720-67592-1

Comments

No additional comments.

Receipt

The samples were received on 9/24/2015 7:11 PM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 2.4° C.

GC/MS VOA

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

Detection Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: INF

Lab Sample ID: 720-67592-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Methyl tert-butyl ether	1.0		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Benzene	20		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Chloroform	1.7		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Naphthalene	20		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Toluene	8.9		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,2,4-Trimethylbenzene	5.4		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
1,3,5-Trimethylbenzene	43		0.50		ug/L	1		8260B/CA_LUFT MS	Total/NA
Xylenes, Total	190		1.0		ug/L	1		8260B/CA_LUFT MS	Total/NA
Gasoline Range Organics (GRO) -C5-C12	950		50		ug/L	1		8260B/CA_LUFT MS	Total/NA

Client Sample ID: EFF

Lab Sample ID: 720-67592-2

No Detections.

Client Sample ID: GAC

Lab Sample ID: 720-67592-3

No Detections.

This Detection Summary does not include radiochemical test results.

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: INF

Date Collected: 09/24/15 16:15

Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-1

Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	1.0		0.50		ug/L			09/30/15 01:28	1
Acetone	ND		50		ug/L			09/30/15 01:28	1
Benzene	20		0.50		ug/L			09/30/15 01:28	1
Dichlorobromomethane	ND		0.50		ug/L			09/30/15 01:28	1
Bromobenzene	ND		1.0		ug/L			09/30/15 01:28	1
Chlorobromomethane	ND		1.0		ug/L			09/30/15 01:28	1
Bromoform	ND		1.0		ug/L			09/30/15 01:28	1
Bromomethane	ND		1.0		ug/L			09/30/15 01:28	1
2-Butanone (MEK)	ND		50		ug/L			09/30/15 01:28	1
n-Butylbenzene	ND		1.0		ug/L			09/30/15 01:28	1
sec-Butylbenzene	ND		1.0		ug/L			09/30/15 01:28	1
tert-Butylbenzene	ND		1.0		ug/L			09/30/15 01:28	1
Carbon disulfide	ND		5.0		ug/L			09/30/15 01:28	1
Carbon tetrachloride	ND		0.50		ug/L			09/30/15 01:28	1
Chlorobenzene	ND		0.50		ug/L			09/30/15 01:28	1
Chloroethane	ND		1.0		ug/L			09/30/15 01:28	1
Chloroform	1.7		1.0		ug/L			09/30/15 01:28	1
Chloromethane	ND		1.0		ug/L			09/30/15 01:28	1
2-Chlorotoluene	ND		0.50		ug/L			09/30/15 01:28	1
4-Chlorotoluene	ND		0.50		ug/L			09/30/15 01:28	1
Chlorodibromomethane	ND		0.50		ug/L			09/30/15 01:28	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:28	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:28	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:28	1
1,3-Dichloropropane	ND		1.0		ug/L			09/30/15 01:28	1
1,1-Dichloropropane	ND		0.50		ug/L			09/30/15 01:28	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/30/15 01:28	1
Ethylene Dibromide	ND		0.50		ug/L			09/30/15 01:28	1
Dibromomethane	ND		0.50		ug/L			09/30/15 01:28	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/30/15 01:28	1
1,1-Dichloroethane	ND		0.50		ug/L			09/30/15 01:28	1
1,2-Dichloroethane	ND		0.50		ug/L			09/30/15 01:28	1
1,1-Dichloroethene	ND		0.50		ug/L			09/30/15 01:28	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 01:28	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 01:28	1
1,2-Dichloropropane	ND		0.50		ug/L			09/30/15 01:28	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 01:28	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 01:28	1
Ethylbenzene	ND		0.50		ug/L			09/30/15 01:28	1
Hexachlorobutadiene	ND		1.0		ug/L			09/30/15 01:28	1
2-Hexanone	ND		50		ug/L			09/30/15 01:28	1
Isopropylbenzene	ND		0.50		ug/L			09/30/15 01:28	1
4-Isopropyltoluene	ND		1.0		ug/L			09/30/15 01:28	1
Methylene Chloride	ND		5.0		ug/L			09/30/15 01:28	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/30/15 01:28	1
Naphthalene	20		1.0		ug/L			09/30/15 01:28	1
N-Propylbenzene	ND		1.0		ug/L			09/30/15 01:28	1
Styrene	ND		0.50		ug/L			09/30/15 01:28	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 01:28	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: INF

Lab Sample ID: 720-67592-1

Date Collected: 09/24/15 16:15

Matrix: Water

Date Received: 09/24/15 19:11

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 01:28	1
Tetrachloroethene	ND		0.50		ug/L			09/30/15 01:28	1
Toluene	8.9		0.50		ug/L			09/30/15 01:28	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/30/15 01:28	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/30/15 01:28	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/30/15 01:28	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/30/15 01:28	1
Trichloroethene	ND		0.50		ug/L			09/30/15 01:28	1
Trichlorofluoromethane	ND		1.0		ug/L			09/30/15 01:28	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/30/15 01:28	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/30/15 01:28	1
1,2,4-Trimethylbenzene	5.4		0.50		ug/L			09/30/15 01:28	1
1,3,5-Trimethylbenzene	43		0.50		ug/L			09/30/15 01:28	1
Vinyl acetate	ND		10		ug/L			09/30/15 01:28	1
Vinyl chloride	ND		0.50		ug/L			09/30/15 01:28	1
Xylenes, Total	190		1.0		ug/L			09/30/15 01:28	1
2,2-Dichloropropane	ND		0.50		ug/L			09/30/15 01:28	1
Gasoline Range Organics (GRO)	950		50		ug/L			09/30/15 01:28	1
-C5-C12									
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	96		67 - 130					09/30/15 01:28	1
1,2-Dichloroethane-d4 (Surr)	113		72 - 130					09/30/15 01:28	1
Toluene-d8 (Surr)	99		70 - 130					09/30/15 01:28	1

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: EFF
Date Collected: 09/24/15 16:15
Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/30/15 00:58	1
Acetone	ND	F2	50		ug/L			09/30/15 00:58	1
Benzene	ND		0.50		ug/L			09/30/15 00:58	1
Dichlorobromomethane	ND		0.50		ug/L			09/30/15 00:58	1
Bromobenzene	ND		1.0		ug/L			09/30/15 00:58	1
Chlorobromomethane	ND		1.0		ug/L			09/30/15 00:58	1
Bromoform	ND		1.0		ug/L			09/30/15 00:58	1
Bromomethane	ND		1.0		ug/L			09/30/15 00:58	1
2-Butanone (MEK)	ND		50		ug/L			09/30/15 00:58	1
n-Butylbenzene	ND		1.0		ug/L			09/30/15 00:58	1
sec-Butylbenzene	ND		1.0		ug/L			09/30/15 00:58	1
tert-Butylbenzene	ND		1.0		ug/L			09/30/15 00:58	1
Carbon disulfide	ND		5.0		ug/L			09/30/15 00:58	1
Carbon tetrachloride	ND		0.50		ug/L			09/30/15 00:58	1
Chlorobenzene	ND		0.50		ug/L			09/30/15 00:58	1
Chloroethane	ND		1.0		ug/L			09/30/15 00:58	1
Chloroform	ND		1.0		ug/L			09/30/15 00:58	1
Chloromethane	ND		1.0		ug/L			09/30/15 00:58	1
2-Chlorotoluene	ND		0.50		ug/L			09/30/15 00:58	1
4-Chlorotoluene	ND		0.50		ug/L			09/30/15 00:58	1
Chlorodibromomethane	ND		0.50		ug/L			09/30/15 00:58	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/30/15 00:58	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/30/15 00:58	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/30/15 00:58	1
1,3-Dichloropropane	ND		1.0		ug/L			09/30/15 00:58	1
1,1-Dichloropropene	ND		0.50		ug/L			09/30/15 00:58	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/30/15 00:58	1
Ethylene Dibromide	ND		0.50		ug/L			09/30/15 00:58	1
Dibromomethane	ND		0.50		ug/L			09/30/15 00:58	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/30/15 00:58	1
1,1-Dichloroethane	ND		0.50		ug/L			09/30/15 00:58	1
1,2-Dichloroethane	ND		0.50		ug/L			09/30/15 00:58	1
1,1-Dichloroethene	ND		0.50		ug/L			09/30/15 00:58	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 00:58	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 00:58	1
1,2-Dichloropropane	ND		0.50		ug/L			09/30/15 00:58	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 00:58	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 00:58	1
Ethylbenzene	ND		0.50		ug/L			09/30/15 00:58	1
Hexachlorobutadiene	ND		1.0		ug/L			09/30/15 00:58	1
2-Hexanone	ND	F2	50		ug/L			09/30/15 00:58	1
Isopropylbenzene	ND		0.50		ug/L			09/30/15 00:58	1
4-Isopropyltoluene	ND		1.0		ug/L			09/30/15 00:58	1
Methylene Chloride	ND		5.0		ug/L			09/30/15 00:58	1
4-Methyl-2-pentanone (MIBK)	ND	F2	50		ug/L			09/30/15 00:58	1
Naphthalene	ND		1.0		ug/L			09/30/15 00:58	1
N-Propylbenzene	ND		1.0		ug/L			09/30/15 00:58	1
Styrene	ND		0.50		ug/L			09/30/15 00:58	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 00:58	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: EFF
Date Collected: 09/24/15 16:15
Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-2
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 00:58	1
Tetrachloroethene	ND		0.50		ug/L			09/30/15 00:58	1
Toluene	ND		0.50		ug/L			09/30/15 00:58	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/30/15 00:58	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/30/15 00:58	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/30/15 00:58	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/30/15 00:58	1
Trichloroethene	ND		0.50		ug/L			09/30/15 00:58	1
Trichlorofluoromethane	ND		1.0		ug/L			09/30/15 00:58	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/30/15 00:58	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/30/15 00:58	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/30/15 00:58	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/30/15 00:58	1
Vinyl acetate	ND		10		ug/L			09/30/15 00:58	1
Vinyl chloride	ND		0.50		ug/L			09/30/15 00:58	1
Xylenes, Total	ND		1.0		ug/L			09/30/15 00:58	1
2,2-Dichloropropane	ND		0.50		ug/L			09/30/15 00:58	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/30/15 00:58	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	94		67 - 130					09/30/15 00:58	1
1,2-Dichloroethane-d4 (Surr)	111		72 - 130					09/30/15 00:58	1
Toluene-d8 (Surr)	99		70 - 130					09/30/15 00:58	1

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: GAC
Date Collected: 09/24/15 16:15
Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-3
Matrix: Water

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/30/15 01:57	1
Acetone	ND		50		ug/L			09/30/15 01:57	1
Benzene	ND		0.50		ug/L			09/30/15 01:57	1
Dichlorobromomethane	ND		0.50		ug/L			09/30/15 01:57	1
Bromobenzene	ND		1.0		ug/L			09/30/15 01:57	1
Chlorobromomethane	ND		1.0		ug/L			09/30/15 01:57	1
Bromoform	ND		1.0		ug/L			09/30/15 01:57	1
Bromomethane	ND		1.0		ug/L			09/30/15 01:57	1
2-Butanone (MEK)	ND		50		ug/L			09/30/15 01:57	1
n-Butylbenzene	ND		1.0		ug/L			09/30/15 01:57	1
sec-Butylbenzene	ND		1.0		ug/L			09/30/15 01:57	1
tert-Butylbenzene	ND		1.0		ug/L			09/30/15 01:57	1
Carbon disulfide	ND		5.0		ug/L			09/30/15 01:57	1
Carbon tetrachloride	ND		0.50		ug/L			09/30/15 01:57	1
Chlorobenzene	ND		0.50		ug/L			09/30/15 01:57	1
Chloroethane	ND		1.0		ug/L			09/30/15 01:57	1
Chloroform	ND		1.0		ug/L			09/30/15 01:57	1
Chloromethane	ND		1.0		ug/L			09/30/15 01:57	1
2-Chlorotoluene	ND		0.50		ug/L			09/30/15 01:57	1
4-Chlorotoluene	ND		0.50		ug/L			09/30/15 01:57	1
Chlorodibromomethane	ND		0.50		ug/L			09/30/15 01:57	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:57	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:57	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/30/15 01:57	1
1,3-Dichloropropane	ND		1.0		ug/L			09/30/15 01:57	1
1,1-Dichloropropene	ND		0.50		ug/L			09/30/15 01:57	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/30/15 01:57	1
Ethylene Dibromide	ND		0.50		ug/L			09/30/15 01:57	1
Dibromomethane	ND		0.50		ug/L			09/30/15 01:57	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/30/15 01:57	1
1,1-Dichloroethane	ND		0.50		ug/L			09/30/15 01:57	1
1,2-Dichloroethane	ND		0.50		ug/L			09/30/15 01:57	1
1,1-Dichloroethene	ND		0.50		ug/L			09/30/15 01:57	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 01:57	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/30/15 01:57	1
1,2-Dichloropropane	ND		0.50		ug/L			09/30/15 01:57	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 01:57	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/30/15 01:57	1
Ethylbenzene	ND		0.50		ug/L			09/30/15 01:57	1
Hexachlorobutadiene	ND		1.0		ug/L			09/30/15 01:57	1
2-Hexanone	ND		50		ug/L			09/30/15 01:57	1
Isopropylbenzene	ND		0.50		ug/L			09/30/15 01:57	1
4-Isopropyltoluene	ND		1.0		ug/L			09/30/15 01:57	1
Methylene Chloride	ND		5.0		ug/L			09/30/15 01:57	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/30/15 01:57	1
Naphthalene	ND		1.0		ug/L			09/30/15 01:57	1
N-Propylbenzene	ND		1.0		ug/L			09/30/15 01:57	1
Styrene	ND		0.50		ug/L			09/30/15 01:57	1
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 01:57	1

TestAmerica Pleasanton

Client Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: GAC

Lab Sample ID: 720-67592-3

Date Collected: 09/24/15 16:15

Matrix: Water

Date Received: 09/24/15 19:11

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/30/15 01:57	1
Tetrachloroethene	ND		0.50		ug/L			09/30/15 01:57	1
Toluene	ND		0.50		ug/L			09/30/15 01:57	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/30/15 01:57	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/30/15 01:57	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/30/15 01:57	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/30/15 01:57	1
Trichloroethene	ND		0.50		ug/L			09/30/15 01:57	1
Trichlorofluoromethane	ND		1.0		ug/L			09/30/15 01:57	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/30/15 01:57	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/30/15 01:57	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/30/15 01:57	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/30/15 01:57	1
Vinyl acetate	ND		10		ug/L			09/30/15 01:57	1
Vinyl chloride	ND		0.50		ug/L			09/30/15 01:57	1
Xylenes, Total	ND		1.0		ug/L			09/30/15 01:57	1
2,2-Dichloropropane	ND		0.50		ug/L			09/30/15 01:57	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/30/15 01:57	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	93		67 - 130		09/30/15 01:57	1
1,2-Dichloroethane-d4 (Surr)	114		72 - 130		09/30/15 01:57	1
Toluene-d8 (Surr)	99		70 - 130		09/30/15 01:57	1

Surrogate Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Matrix: Water

Prep Type: Total/NA

Percent Surrogate Recovery (Acceptance Limits)

Lab Sample ID	Client Sample ID	BFB (67-130)	12DCE (72-130)	TOL (70-130)
720-67592-1	INF	96	113	99
720-67592-2	EFF	94	111	99
720-67592-2 MS	EFF	94	109	100
720-67592-2 MSD	EFF	92	103	99
720-67592-3	GAC	93	114	99
LCS 720-189849/5	Lab Control Sample	90	102	96
LCS 720-189849/7	Lab Control Sample	96	107	98
LCSD 720-189849/6	Lab Control Sample Dup	90	101	97
LCSD 720-189849/8	Lab Control Sample Dup	94	111	99
MB 720-189849/4	Method Blank	91	107	96

Surrogate Legend

BFB = 4-Bromofluorobenzene

12DCE = 1,2-Dichloroethane-d4 (Surr)

TOL = Toluene-d8 (Surr)

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS

Lab Sample ID: MB 720-189849/4

Matrix: Water

Analysis Batch: 189849

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Methyl tert-butyl ether	ND		0.50		ug/L			09/29/15 20:31	1
Acetone	ND		50		ug/L			09/29/15 20:31	1
Benzene	ND		0.50		ug/L			09/29/15 20:31	1
Dichlorobromomethane	ND		0.50		ug/L			09/29/15 20:31	1
Bromobenzene	ND		1.0		ug/L			09/29/15 20:31	1
Chlorobromomethane	ND		1.0		ug/L			09/29/15 20:31	1
Bromoform	ND		1.0		ug/L			09/29/15 20:31	1
Bromomethane	ND		1.0		ug/L			09/29/15 20:31	1
2-Butanone (MEK)	ND		50		ug/L			09/29/15 20:31	1
n-Butylbenzene	ND		1.0		ug/L			09/29/15 20:31	1
sec-Butylbenzene	ND		1.0		ug/L			09/29/15 20:31	1
tert-Butylbenzene	ND		1.0		ug/L			09/29/15 20:31	1
Carbon disulfide	ND		5.0		ug/L			09/29/15 20:31	1
Carbon tetrachloride	ND		0.50		ug/L			09/29/15 20:31	1
Chlorobenzene	ND		0.50		ug/L			09/29/15 20:31	1
Chloroethane	ND		1.0		ug/L			09/29/15 20:31	1
Chloroform	ND		1.0		ug/L			09/29/15 20:31	1
Chloromethane	ND		1.0		ug/L			09/29/15 20:31	1
2-Chlorotoluene	ND		0.50		ug/L			09/29/15 20:31	1
4-Chlorotoluene	ND		0.50		ug/L			09/29/15 20:31	1
Chlorodibromomethane	ND		0.50		ug/L			09/29/15 20:31	1
1,2-Dichlorobenzene	ND		0.50		ug/L			09/29/15 20:31	1
1,3-Dichlorobenzene	ND		0.50		ug/L			09/29/15 20:31	1
1,4-Dichlorobenzene	ND		0.50		ug/L			09/29/15 20:31	1
1,3-Dichloropropane	ND		1.0		ug/L			09/29/15 20:31	1
1,1-Dichloropropene	ND		0.50		ug/L			09/29/15 20:31	1
1,2-Dibromo-3-Chloropropane	ND		1.0		ug/L			09/29/15 20:31	1
Ethylene Dibromide	ND		0.50		ug/L			09/29/15 20:31	1
Dibromomethane	ND		0.50		ug/L			09/29/15 20:31	1
Dichlorodifluoromethane	ND		0.50		ug/L			09/29/15 20:31	1
1,1-Dichloroethane	ND		0.50		ug/L			09/29/15 20:31	1
1,2-Dichloroethane	ND		0.50		ug/L			09/29/15 20:31	1
1,1-Dichloroethene	ND		0.50		ug/L			09/29/15 20:31	1
cis-1,2-Dichloroethene	ND		0.50		ug/L			09/29/15 20:31	1
trans-1,2-Dichloroethene	ND		0.50		ug/L			09/29/15 20:31	1
1,2-Dichloropropane	ND		0.50		ug/L			09/29/15 20:31	1
cis-1,3-Dichloropropene	ND		0.50		ug/L			09/29/15 20:31	1
trans-1,3-Dichloropropene	ND		0.50		ug/L			09/29/15 20:31	1
Ethylbenzene	ND		0.50		ug/L			09/29/15 20:31	1
Hexachlorobutadiene	ND		1.0		ug/L			09/29/15 20:31	1
2-Hexanone	ND		50		ug/L			09/29/15 20:31	1
Isopropylbenzene	ND		0.50		ug/L			09/29/15 20:31	1
4-Isopropyltoluene	ND		1.0		ug/L			09/29/15 20:31	1
Methylene Chloride	ND		5.0		ug/L			09/29/15 20:31	1
4-Methyl-2-pentanone (MIBK)	ND		50		ug/L			09/29/15 20:31	1
Naphthalene	ND		1.0		ug/L			09/29/15 20:31	1
N-Propylbenzene	ND		1.0		ug/L			09/29/15 20:31	1
Styrene	ND		0.50		ug/L			09/29/15 20:31	1

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: MB 720-189849/4
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,1,1,2-Tetrachloroethane	ND		0.50		ug/L			09/29/15 20:31	1
1,1,2,2-Tetrachloroethane	ND		0.50		ug/L			09/29/15 20:31	1
Tetrachloroethene	ND		0.50		ug/L			09/29/15 20:31	1
Toluene	ND		0.50		ug/L			09/29/15 20:31	1
1,2,3-Trichlorobenzene	ND		1.0		ug/L			09/29/15 20:31	1
1,2,4-Trichlorobenzene	ND		1.0		ug/L			09/29/15 20:31	1
1,1,1-Trichloroethane	ND		0.50		ug/L			09/29/15 20:31	1
1,1,2-Trichloroethane	ND		0.50		ug/L			09/29/15 20:31	1
Trichloroethene	ND		0.50		ug/L			09/29/15 20:31	1
Trichlorofluoromethane	ND		1.0		ug/L			09/29/15 20:31	1
1,2,3-Trichloropropane	ND		0.50		ug/L			09/29/15 20:31	1
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		0.50		ug/L			09/29/15 20:31	1
1,2,4-Trimethylbenzene	ND		0.50		ug/L			09/29/15 20:31	1
1,3,5-Trimethylbenzene	ND		0.50		ug/L			09/29/15 20:31	1
Vinyl acetate	ND		10		ug/L			09/29/15 20:31	1
Vinyl chloride	ND		0.50		ug/L			09/29/15 20:31	1
Xylenes, Total	ND		1.0		ug/L			09/29/15 20:31	1
2,2-Dichloropropane	ND		0.50		ug/L			09/29/15 20:31	1
Gasoline Range Organics (GRO) -C5-C12	ND		50		ug/L			09/29/15 20:31	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	91		67 - 130		09/29/15 20:31	1
1,2-Dichloroethane-d4 (Surr)	107		72 - 130		09/29/15 20:31	1
Toluene-d8 (Surr)	96		70 - 130		09/29/15 20:31	1

Lab Sample ID: LCS 720-189849/5
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Methyl tert-butyl ether	25.0	19.0		ug/L		76	62 - 130
Acetone	125	143		ug/L		115	26 - 180
Benzene	25.0	20.6		ug/L		82	79 - 130
Dichlorobromomethane	25.0	20.8		ug/L		83	70 - 130
Bromobenzene	25.0	23.2		ug/L		93	70 - 130
Chlorobromomethane	25.0	20.9		ug/L		84	70 - 130
Bromoform	25.0	23.3		ug/L		93	68 - 136
Bromomethane	25.0	24.6		ug/L		99	43 - 151
2-Butanone (MEK)	125	117		ug/L		94	54 - 130
n-Butylbenzene	25.0	23.7		ug/L		95	70 - 142
sec-Butylbenzene	25.0	24.5		ug/L		98	70 - 134
tert-Butylbenzene	25.0	22.8		ug/L		91	70 - 135
Carbon disulfide	25.0	17.9		ug/L		72	58 - 130
Carbon tetrachloride	25.0	21.5		ug/L		86	70 - 146
Chlorobenzene	25.0	23.4		ug/L		94	70 - 130
Chloroethane	25.0	24.1		ug/L		96	62 - 138
Chloroform	25.0	20.6		ug/L		83	70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-189849/5

Matrix: Water

Analysis Batch: 189849

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Chloromethane	25.0	27.9		ug/L		111	52 - 175
2-Chlorotoluene	25.0	23.0		ug/L		92	70 - 130
4-Chlorotoluene	25.0	23.1		ug/L		92	70 - 130
Chlorodibromomethane	25.0	22.0		ug/L		88	70 - 145
1,2-Dichlorobenzene	25.0	23.9		ug/L		96	70 - 130
1,3-Dichlorobenzene	25.0	24.8		ug/L		99	70 - 130
1,4-Dichlorobenzene	25.0	24.7		ug/L		99	70 - 130
1,3-Dichloropropane	25.0	21.4		ug/L		85	70 - 130
1,1-Dichloropropene	25.0	19.4		ug/L		78	70 - 130
1,2-Dibromo-3-Chloropropane	25.0	23.5		ug/L		94	70 - 136
Ethylene Dibromide	25.0	21.8		ug/L		87	70 - 130
Dibromomethane	25.0	20.7		ug/L		83	70 - 130
Dichlorodifluoromethane	25.0	22.1		ug/L		88	34 - 132
1,1-Dichloroethane	25.0	21.0		ug/L		84	70 - 130
1,2-Dichloroethane	25.0	22.6		ug/L		91	61 - 132
1,1-Dichloroethene	25.0	19.1		ug/L		77	64 - 128
cis-1,2-Dichloroethene	25.0	22.2		ug/L		89	70 - 130
trans-1,2-Dichloroethene	25.0	20.3		ug/L		81	68 - 130
1,2-Dichloropropane	25.0	21.2		ug/L		85	70 - 130
cis-1,3-Dichloropropene	25.0	19.8		ug/L		79	70 - 130
trans-1,3-Dichloropropene	25.0	20.3		ug/L		81	70 - 140
Ethylbenzene	25.0	22.7		ug/L		91	80 - 120
Hexachlorobutadiene	25.0	22.3		ug/L		89	70 - 130
2-Hexanone	125	146		ug/L		117	60 - 164
Isopropylbenzene	25.0	22.5		ug/L		90	70 - 130
4-Isopropyltoluene	25.0	23.9		ug/L		96	70 - 130
Methylene Chloride	25.0	21.7		ug/L		87	70 - 147
4-Methyl-2-pentanone (MIBK)	125	145		ug/L		116	58 - 130
Naphthalene	25.0	22.7		ug/L		91	70 - 130
N-Propylbenzene	25.0	23.2		ug/L		93	70 - 130
Styrene	25.0	20.4		ug/L		81	70 - 130
1,1,1,2-Tetrachloroethane	25.0	23.7		ug/L		95	70 - 130
1,1,1,2,2-Tetrachloroethane	25.0	24.0		ug/L		96	70 - 130
Tetrachloroethene	25.0	20.1		ug/L		80	70 - 130
Toluene	25.0	21.3		ug/L		85	78 - 120
1,2,3-Trichlorobenzene	25.0	23.2		ug/L		93	70 - 130
1,2,4-Trichlorobenzene	25.0	23.3		ug/L		93	70 - 130
1,1,1-Trichloroethane	25.0	21.6		ug/L		86	70 - 130
1,1,2-Trichloroethane	25.0	20.3		ug/L		81	70 - 130
Trichloroethene	25.0	22.3		ug/L		89	70 - 130
Trichlorofluoromethane	25.0	25.5		ug/L		102	66 - 132
1,2,3-Trichloropropane	25.0	24.7		ug/L		99	70 - 130
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	20.1		ug/L		80	42 - 162
1,2,4-Trimethylbenzene	25.0	23.4		ug/L		94	70 - 132
1,3,5-Trimethylbenzene	25.0	22.5		ug/L		90	70 - 130
Vinyl acetate	25.0	34.6		ug/L		138	43 - 163
Vinyl chloride	25.0	25.5		ug/L		102	54 - 135

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCS 720-189849/5
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
m-Xylene & p-Xylene	25.0	22.2		ug/L		89	70 - 142
o-Xylene	25.0	21.9		ug/L		88	70 - 130
2,2-Dichloropropane	25.0	22.5		ug/L		90	70 - 140

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	90		67 - 130
1,2-Dichloroethane-d4 (Surr)	102		72 - 130
Toluene-d8 (Surr)	96		70 - 130

Lab Sample ID: LCS 720-189849/7
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Gasoline Range Organics (GRO) -C5-C12	500	542		ug/L		108	62 - 120

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene	96		67 - 130
1,2-Dichloroethane-d4 (Surr)	107		72 - 130
Toluene-d8 (Surr)	98		70 - 130

Lab Sample ID: LCSD 720-189849/6
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Methyl tert-butyl ether	25.0	18.6		ug/L		74	62 - 130	2	20
Acetone	125	129		ug/L		103	26 - 180	10	30
Benzene	25.0	20.7		ug/L		83	79 - 130	0	20
Dichlorobromomethane	25.0	20.9		ug/L		83	70 - 130	0	20
Bromobenzene	25.0	23.6		ug/L		94	70 - 130	2	20
Chlorobromomethane	25.0	20.5		ug/L		82	70 - 130	2	20
Bromoform	25.0	22.6		ug/L		90	68 - 136	3	20
Bromomethane	25.0	23.5		ug/L		94	43 - 151	5	20
2-Butanone (MEK)	125	108		ug/L		86	54 - 130	8	20
n-Butylbenzene	25.0	24.2		ug/L		97	70 - 142	2	20
sec-Butylbenzene	25.0	25.5		ug/L		102	70 - 134	4	20
tert-Butylbenzene	25.0	24.3		ug/L		97	70 - 135	7	20
Carbon disulfide	25.0	18.0		ug/L		72	58 - 130	1	20
Carbon tetrachloride	25.0	22.4		ug/L		90	70 - 146	4	20
Chlorobenzene	25.0	23.6		ug/L		94	70 - 130	1	20
Chloroethane	25.0	23.6		ug/L		94	62 - 138	2	20
Chloroform	25.0	20.9		ug/L		83	70 - 130	1	20
Chloromethane	25.0	27.1		ug/L		108	52 - 175	3	20
2-Chlorotoluene	25.0	23.7		ug/L		95	70 - 130	3	20
4-Chlorotoluene	25.0	23.7		ug/L		95	70 - 130	3	20
Chlorodibromomethane	25.0	21.3		ug/L		85	70 - 145	4	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-189849/6

Matrix: Water

Analysis Batch: 189849

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,2-Dichlorobenzene	25.0	23.7		ug/L		95	70 - 130	1	20
1,3-Dichlorobenzene	25.0	24.9		ug/L		100	70 - 130	1	20
1,4-Dichlorobenzene	25.0	24.1		ug/L		96	70 - 130	3	20
1,3-Dichloropropane	25.0	20.1		ug/L		80	70 - 130	6	20
1,1-Dichloropropene	25.0	20.2		ug/L		81	70 - 130	4	20
1,2-Dibromo-3-Chloropropane	25.0	21.9		ug/L		88	70 - 136	7	20
Ethylene Dibromide	25.0	21.0		ug/L		84	70 - 130	4	20
Dibromomethane	25.0	20.4		ug/L		82	70 - 130	1	20
Dichlorodifluoromethane	25.0	22.4		ug/L		89	34 - 132	1	20
1,1-Dichloroethane	25.0	21.3		ug/L		85	70 - 130	1	20
1,2-Dichloroethane	25.0	22.3		ug/L		89	61 - 132	2	20
1,1-Dichloroethene	25.0	19.4		ug/L		78	64 - 128	1	20
cis-1,2-Dichloroethene	25.0	22.0		ug/L		88	70 - 130	1	20
trans-1,2-Dichloroethene	25.0	20.6		ug/L		83	68 - 130	2	20
1,2-Dichloropropane	25.0	21.2		ug/L		85	70 - 130	0	20
cis-1,3-Dichloropropene	25.0	19.4		ug/L		78	70 - 130	2	20
trans-1,3-Dichloropropene	25.0	19.9		ug/L		79	70 - 140	2	20
Ethylbenzene	25.0	23.1		ug/L		92	80 - 120	2	20
Hexachlorobutadiene	25.0	23.0		ug/L		92	70 - 130	3	20
2-Hexanone	125	129		ug/L		103	60 - 164	12	20
Isopropylbenzene	25.0	23.0		ug/L		92	70 - 130	2	20
4-Isopropyltoluene	25.0	25.0		ug/L		100	70 - 130	4	20
Methylene Chloride	25.0	20.9		ug/L		84	70 - 147	4	20
4-Methyl-2-pentanone (MIBK)	125	130		ug/L		104	58 - 130	11	20
Naphthalene	25.0	22.2		ug/L		89	70 - 130	2	20
N-Propylbenzene	25.0	24.4		ug/L		98	70 - 130	5	20
Styrene	25.0	20.5		ug/L		82	70 - 130	1	20
1,1,1,2-Tetrachloroethane	25.0	23.8		ug/L		95	70 - 130	0	20
1,1,2,2-Tetrachloroethane	25.0	22.9		ug/L		92	70 - 130	5	20
Tetrachloroethene	25.0	20.8		ug/L		83	70 - 130	4	20
Toluene	25.0	21.5		ug/L		86	78 - 120	1	20
1,2,3-Trichlorobenzene	25.0	23.0		ug/L		92	70 - 130	1	20
1,2,4-Trichlorobenzene	25.0	22.7		ug/L		91	70 - 130	2	20
1,1,1-Trichloroethane	25.0	22.4		ug/L		90	70 - 130	4	20
1,1,2-Trichloroethane	25.0	19.3		ug/L		77	70 - 130	5	20
Trichloroethene	25.0	22.9		ug/L		92	70 - 130	3	20
Trichlorofluoromethane	25.0	26.1		ug/L		104	66 - 132	2	20
1,2,3-Trichloropropane	25.0	24.0		ug/L		96	70 - 130	3	20
1,1,2-Trichloro-1,2,2-trifluoroethane	25.0	20.3		ug/L		81	42 - 162	1	20
1,2,4-Trimethylbenzene	25.0	23.8		ug/L		95	70 - 132	2	20
1,3,5-Trimethylbenzene	25.0	23.4		ug/L		94	70 - 130	4	20
Vinyl acetate	25.0	33.3		ug/L		133	43 - 163	4	20
Vinyl chloride	25.0	25.7		ug/L		103	54 - 135	1	20
m-Xylene & p-Xylene	25.0	22.7		ug/L		91	70 - 142	2	20
o-Xylene	25.0	22.1		ug/L		88	70 - 130	1	20
2,2-Dichloropropane	25.0	23.6		ug/L		94	70 - 140	5	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: LCSD 720-189849/6
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	90		67 - 130
1,2-Dichloroethane-d4 (Surr)	101		72 - 130
Toluene-d8 (Surr)	97		70 - 130

Lab Sample ID: LCSD 720-189849/8
Matrix: Water
Analysis Batch: 189849

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA

Analyte	Spike Added	LCSD		Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
		Result	Qualifier						
Gasoline Range Organics (GRO) -C5-C12	500	521		ug/L		104	62 - 120	4	20

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	94		67 - 130
1,2-Dichloroethane-d4 (Surr)	111		72 - 130
Toluene-d8 (Surr)	99		70 - 130

Lab Sample ID: 720-67592-2 MS
Matrix: Water
Analysis Batch: 189849

Client Sample ID: EFF
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS		Unit	D	%Rec	%Rec. Limits
				Result	Qualifier				
Methyl tert-butyl ether	ND		25.0	25.1		ug/L		100	60 - 138
Acetone	ND	F2	125	122		ug/L		98	60 - 140
Benzene	ND		25.0	25.4		ug/L		102	60 - 140
Dichlorobromomethane	ND		25.0	26.1		ug/L		104	60 - 140
Bromobenzene	ND		25.0	27.4		ug/L		109	60 - 140
Chlorobromomethane	ND		25.0	26.1		ug/L		104	60 - 140
Bromoform	ND		25.0	27.3		ug/L		109	56 - 140
Bromomethane	ND		25.0	25.5		ug/L		102	23 - 140
2-Butanone (MEK)	ND		125	107		ug/L		85	60 - 140
n-Butylbenzene	ND		25.0	26.3		ug/L		105	60 - 140
sec-Butylbenzene	ND		25.0	27.2		ug/L		109	60 - 140
tert-Butylbenzene	ND		25.0	25.7		ug/L		103	60 - 140
Carbon disulfide	ND		25.0	22.4		ug/L		90	38 - 140
Carbon tetrachloride	ND		25.0	26.3		ug/L		105	60 - 140
Chlorobenzene	ND		25.0	27.9		ug/L		111	60 - 140
Chloroethane	ND		25.0	23.6		ug/L		94	51 - 140
Chloroform	ND		25.0	25.7		ug/L		103	60 - 140
Chloromethane	ND		25.0	23.2		ug/L		93	52 - 140
2-Chlorotoluene	ND		25.0	26.0		ug/L		104	60 - 140
4-Chlorotoluene	ND		25.0	26.7		ug/L		107	60 - 140
Chlorodibromomethane	ND		25.0	28.2		ug/L		113	60 - 140
1,2-Dichlorobenzene	ND		25.0	27.9		ug/L		112	60 - 140
1,3-Dichlorobenzene	ND		25.0	29.1		ug/L		116	60 - 140
1,4-Dichlorobenzene	ND		25.0	28.6		ug/L		114	60 - 140
1,3-Dichloropropane	ND		25.0	27.2		ug/L		109	60 - 140
1,1-Dichloropropene	ND		25.0	24.8		ug/L		99	60 - 140

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67592-2 MS

Matrix: Water

Analysis Batch: 189849

Client Sample ID: EFF

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
1,2-Dibromo-3-Chloropropane	ND		25.0	23.6		ug/L		95	60 - 140
Ethylene Dibromide	ND		25.0	27.3		ug/L		109	60 - 140
Dibromomethane	ND		25.0	25.9		ug/L		104	60 - 140
Dichlorodifluoromethane	ND		25.0	20.9		ug/L		83	38 - 140
1,1-Dichloroethane	ND		25.0	26.1		ug/L		104	60 - 140
1,2-Dichloroethane	ND		25.0	28.5		ug/L		114	60 - 140
1,1-Dichloroethene	ND		25.0	22.1		ug/L		88	60 - 140
cis-1,2-Dichloroethene	ND		25.0	27.1		ug/L		108	60 - 140
trans-1,2-Dichloroethene	ND		25.0	24.8		ug/L		99	60 - 140
1,2-Dichloropropane	ND		25.0	26.5		ug/L		106	60 - 140
cis-1,3-Dichloropropene	ND		25.0	26.4		ug/L		106	60 - 140
trans-1,3-Dichloropropene	ND		25.0	28.9		ug/L		116	60 - 140
Ethylbenzene	ND		25.0	26.1		ug/L		104	60 - 140
Hexachlorobutadiene	ND		25.0	24.3		ug/L		97	60 - 140
2-Hexanone	ND	F2	125	130		ug/L		104	60 - 140
Isopropylbenzene	ND		25.0	26.0		ug/L		104	60 - 140
4-Isopropyltoluene	ND		25.0	26.6		ug/L		106	60 - 140
Methylene Chloride	ND		25.0	26.7		ug/L		107	40 - 140
4-Methyl-2-pentanone (MIBK)	ND	F2	125	132		ug/L		105	58 - 130
Naphthalene	ND		25.0	24.7		ug/L		99	56 - 140
N-Propylbenzene	ND		25.0	26.2		ug/L		105	60 - 140
Styrene	ND		25.0	23.9		ug/L		95	60 - 140
1,1,1,2-Tetrachloroethane	ND		25.0	28.6		ug/L		114	60 - 140
1,1,2,2-Tetrachloroethane	ND		25.0	25.8		ug/L		103	60 - 140
Tetrachloroethene	ND		25.0	24.6		ug/L		98	60 - 140
Toluene	ND		25.0	24.3		ug/L		97	60 - 140
1,2,3-Trichlorobenzene	ND		25.0	26.7		ug/L		107	60 - 140
1,2,4-Trichlorobenzene	ND		25.0	28.0		ug/L		112	60 - 140
1,1,1-Trichloroethane	ND		25.0	25.6		ug/L		102	60 - 140
1,1,2-Trichloroethane	ND		25.0	25.5		ug/L		102	60 - 140
Trichloroethene	ND		25.0	27.2		ug/L		109	60 - 140
Trichlorofluoromethane	ND		25.0	24.2		ug/L		97	60 - 140
1,2,3-Trichloropropane	ND		25.0	27.5		ug/L		110	60 - 140
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	23.3		ug/L		93	60 - 140
1,2,4-Trimethylbenzene	ND		25.0	26.6		ug/L		106	60 - 140
1,3,5-Trimethylbenzene	ND		25.0	25.8		ug/L		103	60 - 140
Vinyl acetate	ND		25.0	25.4		ug/L		102	40 - 140
Vinyl chloride	ND		25.0	22.5		ug/L		90	58 - 140
m-Xylene & p-Xylene	ND		25.0	26.0		ug/L		104	60 - 140
o-Xylene	ND		25.0	26.0		ug/L		104	60 - 140
2,2-Dichloropropane	ND		25.0	26.9		ug/L		107	60 - 140

Surrogate	MS %Recovery	MS Qualifier	MS Limits
4-Bromofluorobenzene	94		67 - 130
1,2-Dichloroethane-d4 (Surr)	109		72 - 130
Toluene-d8 (Surr)	100		70 - 130

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67592-2 MSD

Matrix: Water

Analysis Batch: 189849

Client Sample ID: EFF

Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec.	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier				Limits		
Methyl tert-butyl ether	ND		25.0	23.3		ug/L		93	60 - 138	7	20
Acetone	ND	F2	125	96.2	F2	ug/L		77	60 - 140	24	20
Benzene	ND		25.0	25.8		ug/L		103	60 - 140	2	20
Dichlorobromomethane	ND		25.0	26.1		ug/L		104	60 - 140	0	20
Bromobenzene	ND		25.0	28.4		ug/L		114	60 - 140	4	20
Chlorobromomethane	ND		25.0	25.9		ug/L		103	60 - 140	1	20
Bromoform	ND		25.0	25.0		ug/L		100	56 - 140	9	20
Bromomethane	ND		25.0	25.8		ug/L		103	23 - 140	1	20
2-Butanone (MEK)	ND		125	89.5		ug/L		72	60 - 140	18	20
n-Butylbenzene	ND		25.0	27.1		ug/L		109	60 - 140	3	20
sec-Butylbenzene	ND		25.0	28.1		ug/L		112	60 - 140	3	20
tert-Butylbenzene	ND		25.0	26.7		ug/L		107	60 - 140	4	20
Carbon disulfide	ND		25.0	22.3		ug/L		89	38 - 140	1	20
Carbon tetrachloride	ND		25.0	26.5		ug/L		106	60 - 140	1	20
Chlorobenzene	ND		25.0	28.5		ug/L		114	60 - 140	2	20
Chloroethane	ND		25.0	23.0		ug/L		92	51 - 140	2	20
Chloroform	ND		25.0	26.2		ug/L		105	60 - 140	2	20
Chloromethane	ND		25.0	21.5		ug/L		86	52 - 140	8	20
2-Chlorotoluene	ND		25.0	27.5		ug/L		110	60 - 140	5	20
4-Chlorotoluene	ND		25.0	28.1		ug/L		112	60 - 140	5	20
Chlorodibromomethane	ND		25.0	27.2		ug/L		109	60 - 140	4	20
1,2-Dichlorobenzene	ND		25.0	28.0		ug/L		112	60 - 140	0	20
1,3-Dichlorobenzene	ND		25.0	30.0		ug/L		120	60 - 140	3	20
1,4-Dichlorobenzene	ND		25.0	29.1		ug/L		116	60 - 140	2	20
1,3-Dichloropropane	ND		25.0	25.2		ug/L		101	60 - 140	8	20
1,1-Dichloropropene	ND		25.0	25.4		ug/L		101	60 - 140	2	20
1,2-Dibromo-3-Chloropropane	ND		25.0	19.9		ug/L		80	60 - 140	17	20
Ethylene Dibromide	ND		25.0	25.5		ug/L		102	60 - 140	7	20
Dibromomethane	ND		25.0	24.6		ug/L		98	60 - 140	5	20
Dichlorodifluoromethane	ND		25.0	20.6		ug/L		82	38 - 140	1	20
1,1-Dichloroethane	ND		25.0	26.7		ug/L		107	60 - 140	2	20
1,2-Dichloroethane	ND		25.0	27.7		ug/L		111	60 - 140	3	20
1,1-Dichloroethene	ND		25.0	21.9		ug/L		88	60 - 140	1	20
cis-1,2-Dichloroethene	ND		25.0	27.5		ug/L		110	60 - 140	1	20
trans-1,2-Dichloroethene	ND		25.0	25.5		ug/L		102	60 - 140	3	20
1,2-Dichloropropane	ND		25.0	27.1		ug/L		108	60 - 140	2	20
cis-1,3-Dichloropropene	ND		25.0	26.2		ug/L		105	60 - 140	1	20
trans-1,3-Dichloropropene	ND		25.0	27.8		ug/L		111	60 - 140	4	20
Ethylbenzene	ND		25.0	26.8		ug/L		107	60 - 140	3	20
Hexachlorobutadiene	ND		25.0	25.4		ug/L		102	60 - 140	4	20
2-Hexanone	ND	F2	125	99.4	F2	ug/L		79	60 - 140	27	20
Isopropylbenzene	ND		25.0	26.5		ug/L		106	60 - 140	2	20
4-Isopropyltoluene	ND		25.0	27.6		ug/L		110	60 - 140	4	20
Methylene Chloride	ND		25.0	25.9		ug/L		103	40 - 140	3	20
4-Methyl-2-pentanone (MIBK)	ND	F2	125	105	F2	ug/L		84	58 - 130	23	20
Naphthalene	ND		25.0	23.1		ug/L		92	56 - 140	7	20
N-Propylbenzene	ND		25.0	27.6		ug/L		111	60 - 140	6	20
Styrene	ND		25.0	23.8		ug/L		95	60 - 140	0	20

TestAmerica Pleasanton

QC Sample Results

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method: 8260B/CA_LUFTMS - 8260B / CA LUFT MS (Continued)

Lab Sample ID: 720-67592-2 MSD
Matrix: Water
Analysis Batch: 189849

Client Sample ID: EFF
Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec.	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier				Limits		Limit
1,1,1,2-Tetrachloroethane	ND		25.0	28.7		ug/L		115	60 - 140	1	20
1,1,2,2-Tetrachloroethane	ND		25.0	23.3		ug/L		93	60 - 140	10	20
Tetrachloroethene	ND		25.0	25.1		ug/L		100	60 - 140	2	20
Toluene	ND		25.0	24.9		ug/L		100	60 - 140	2	20
1,2,3-Trichlorobenzene	ND		25.0	26.6		ug/L		106	60 - 140	0	20
1,2,4-Trichlorobenzene	ND		25.0	28.4		ug/L		114	60 - 140	2	20
1,1,1-Trichloroethane	ND		25.0	26.1		ug/L		104	60 - 140	2	20
1,1,2-Trichloroethane	ND		25.0	24.2		ug/L		97	60 - 140	5	20
Trichloroethene	ND		25.0	28.0		ug/L		112	60 - 140	3	20
Trichlorofluoromethane	ND		25.0	24.0		ug/L		96	60 - 140	1	20
1,2,3-Trichloropropane	ND		25.0	24.4		ug/L		98	60 - 140	12	20
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		25.0	22.8		ug/L		91	60 - 140	2	20
1,2,4-Trimethylbenzene	ND		25.0	27.8		ug/L		111	60 - 140	4	20
1,3,5-Trimethylbenzene	ND		25.0	27.0		ug/L		108	60 - 140	4	20
Vinyl acetate	ND		25.0	22.2		ug/L		89	40 - 140	13	20
Vinyl chloride	ND		25.0	22.9		ug/L		92	58 - 140	2	20
m-Xylene & p-Xylene	ND		25.0	26.3		ug/L		105	60 - 140	1	20
o-Xylene	ND		25.0	26.6		ug/L		106	60 - 140	2	20
2,2-Dichloropropane	ND		25.0	27.4		ug/L		110	60 - 140	2	20

Surrogate	MSD	MSD	Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	92		67 - 130
1,2-Dichloroethane-d4 (Surr)	103		72 - 130
Toluene-d8 (Surr)	99		70 - 130

QC Association Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

GC/MS VOA

Analysis Batch: 189849

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
720-67592-1	INF	Total/NA	Water	8260B/CA_LUFT MS	
720-67592-2	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67592-2 MS	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67592-2 MSD	EFF	Total/NA	Water	8260B/CA_LUFT MS	
720-67592-3	GAC	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-189849/5	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCS 720-189849/7	Lab Control Sample	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-189849/6	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
LCSD 720-189849/8	Lab Control Sample Dup	Total/NA	Water	8260B/CA_LUFT MS	
MB 720-189849/4	Method Blank	Total/NA	Water	8260B/CA_LUFT MS	

Lab Chronicle

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Client Sample ID: INF

Date Collected: 09/24/15 16:15

Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	189849	09/30/15 01:28	PRD	TAL PLS

Client Sample ID: EFF

Date Collected: 09/24/15 16:15

Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	189849	09/30/15 00:58	PRD	TAL PLS

Client Sample ID: GAC

Date Collected: 09/24/15 16:15

Date Received: 09/24/15 19:11

Lab Sample ID: 720-67592-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B/CA_LUFTMS		1	189849	09/30/15 01:57	PRD	TAL PLS

Laboratory References:

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

Certification Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Laboratory: TestAmerica Pleasanton

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
California	State Program	9	2496	01-31-16

Analysis Method	Prep Method	Matrix	Analyte
-----------------	-------------	--------	---------

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

Method Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Method	Method Description	Protocol	Laboratory
8260B/CA_LUFTM S	8260B / CA LUFT MS	SW846	TAL PLS

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

TAL PLS = TestAmerica Pleasanton, 1220 Quarry Lane, Pleasanton, CA 94566, TEL (925)484-1919

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

Sample Summary

Client: Ninyo & Moore
Project/Site: Chun

TestAmerica Job ID: 720-67592-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
720-67592-1	INF	Water	09/24/15 16:15	09/24/15 19:11
720-67592-2	EFF	Water	09/24/15 16:15	09/24/15 19:11
720-67592-3	GAC	Water	09/24/15 16:15	09/24/15 19:11

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

Analysis Request

Report To
 Attn: Peter Sims
 Company: Ningo and Moore
 Address: 1945 Webster St, Ste 400
 Email: psims@ningoandmoore.com
 Bill To: Peter Sims
 Attn: Emily Dirksen
 Phone: 510-343-3000

Sample ID	Date	Time	Mat	Preserv	Number of Containers
INF	9/24	10:15	AW	WCI	
9FF	9/24	10:15			
GAC	9/24	10:15			



720-67592 Chain of Custody

Project Info: **Sample Receipt**
 Project Name: # CRUN
 Head Space: 401896004
 Temp: 2.4°C

1) Relinquished by: [Signature] 16:30
 Signature: [Signature] Time
 Printed Name: GARY EUGANS Date
 Company: WIMP + MOORE

2) Relinquished by: [Signature] 17:35
 Signature: [Signature] Time
 Printed Name: GARY EUGANS Date
 Company: TA

3) Relinquished by: [Signature]
 Signature: _____ Time
 Printed Name: _____ Date
 Company: _____

Credit Card Y/N: _____
 If yes, please call with payment information ASAP

T	10	5	4	3	2	1
A	Day	Day	Day	Day	Day	Day

Report: Routine Level 3 Level 4 EDD EDF
 Special Instructions / Comments: Global ID
Please call us at 720-67592 or ningoandmoore.com



Login Sample Receipt Checklist

Client: Ninyo & Moore

Job Number: 720-67592-1

Login Number: 67592

List Number: 1

Creator: Gonzales, Justinn

List Source: TestAmerica Pleasanton

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	N/A	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

APPENDIX D

GROUNDWATER MONITORING DATA SHEETS

MONITORING WELL SAMPLING FORM

Date: 11 Aug 2015

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location:

WELL NO. <u>MW-4R</u>	Depth to Liquid (DL): <u>9.98</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>9.98</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>25.19</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>15.21</u>
Purge Method: <u>Peri-Pump</u>	Casing Volume (TH*Factor): <u>2.43</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023	

7.3 gal purge

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>0932</u>	<u>2.5 g</u>	<u>19.23</u>	<u>403</u>	<u>7.49</u>	<u>3.24</u>	<u>-84</u>	<u>15.9</u>	
<u>0948</u>	<u>5 gal</u>	<u>21.41</u>	<u>587</u>	<u>6.56</u>	<u>0.99</u>	<u>-18</u>	<u>8.78</u>	
<u>0958</u>	<u>7.5 gal</u>	<u>21.72</u>	<u>570</u>	<u>6.58</u>	<u>1.06</u>	<u>-22</u>	<u>2.64</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>1000</u>	<u>MW-4R</u>										

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 11 Aug 2015

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location:

WELL NO. <u>MW-SR</u>	Depth to Liquid (DL): <u>8.11</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>6.11</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>24.79</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>16.68</u>
Purge Method: <u>p-pump</u>	Casing Volume (TH*Factor): <u>2.668</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>8.00 gal purge</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1106</u>	<u>2.5 g</u>	<u>22.01</u>	<u>647</u>	<u>6.79</u>	<u>1.64</u>	<u>-48</u>	<u>202</u>	
<u>1112</u>	<u>3 g</u>	<u>22.87</u>	<u>749</u>	<u>6.88</u>	<u>1.15</u>	<u>-90</u>	<u>62.7</u>	
<u>1123</u>	<u>7.5 g</u>	<u>22.91</u>	<u>739</u>	<u>6.92</u>	<u>0.95</u>	<u>-98</u>	<u>50.1</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
1125	<u>MW-4K</u>										
<u>1125</u>											

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 11 Aug 2015

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing. Well Location:

WELL NO. <u>MW-6R</u>	Depth to Liquid (DL): <u>8.2</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>8.2</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition:	Total Well Depth (TD): <u>25.18</u>
Well Box Condition:	Total head (TH=TD-DW1): <u>16.98</u>
Purge Method: <u>P. pump</u>	Casing Volume (TH*Factor): <u>2.7168</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023	

8.15 gal purge

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1143</u>	<u>3 gal</u>	<u>23.2</u>	<u>717</u>	<u>6.03</u>	<u>0.82</u>	<u>21</u>	<u>468</u>	
<u>1156</u>	<u>6 gal</u>	<u>23.72</u>	<u>486</u>	<u>5.32</u>	<u>0.95</u>	<u>136</u>	<u>84</u>	
<u>1210</u>	<u>9 gal</u>	<u>23.96</u>	<u>478</u>	<u>5.89</u>	<u>1.04</u>	<u>101</u>	<u>22.1</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>1215</u>	<u>MW-6R</u>										

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 11 August 2015

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location:

WELL NO. <u>MW-7R</u>	Depth to Liquid (DL): <u>8.25</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>8.25</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>25.29</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>17.04</u>
Purge Method: <u>P-PUMP</u>	Casing Volume (TH*Factor): <u>2.72</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>8.17 gal</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1250</u>	<u>2.5 gal</u>	<u>23.19</u>	<u>736</u>	<u>6.13</u>	<u>1.26</u>	<u>27</u>	<u>6.82</u>	
<u>1301</u>	<u>5 gal</u>	<u>22.26</u>	<u>830</u>	<u>6.05</u>	<u>1.48</u>	<u>-23</u>	<u>0.00</u>	
<u>1315</u>	<u>7.5 gal</u>	<u>22.57</u>	<u>850</u>	<u>6.01</u>	<u>0.95</u>	<u>-20</u>	<u>8.07</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>1315</u>	<u>MW-7R</u>										

Additional Comments

MONITORING WELL SAMPLING FORM Date: 11 Aug 2015

Project Name: Chun Client: Lily A. Chun Trust 1991 Job No: 401896004
 Address: 2301 Santa Clara Avenue Contact/Phone:
 City/State: Alameda, CA Technician Gauging/Sampling: E. Dirksen

Note: All measurements from top of casing. Well Location:

WELL NO. <u>mw-8</u>	Depth to Liquid (DL): <u>8.69</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>8.69</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL):
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>14.24</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>5.55</u>
Purge Method: <u>boiler</u>	Casing Volume (TH*Factor): <u>0.888</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>purge 2.47 gal</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>0832</u>	<u>1 gal</u>	<u>20.70</u>	<u>173</u>	<u>7.44</u>	<u>5.24</u>	<u>29</u>	<u>110</u>	
<u>0834</u>	<u>2 gal</u>	<u>19.73</u>	<u>150</u>	<u>8.21</u>	<u>7.72</u>	<u>-148</u>	<u>473</u>	
<u>0837</u>	<u>3 gal</u>	<u>18.82</u>	<u>313</u>	<u>8.18</u>	<u>5.93</u>	<u>-150</u>	<u>477</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>0840</u>	<u>mw-8</u>										

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 8/10

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location:

WELL NO. <u>mw-9</u>	Depth to Liquid (DL): <u>8.21</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>8.21</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>15.03</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>6.82</u>
Purge Method: <u>Bailor</u>	Casing Volume (TH*Factor): <u>1.09</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>3.3 gal purge</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1440</u>	<u>1g</u>	<u>21.10</u>	<u>369</u>	<u>6.91</u>	<u>6.47</u>	<u>113</u>	<u>222</u>	
<u>1443</u>	<u>2g</u>	<u>22.56</u>	<u>328</u>	<u>7.33</u>	<u>4.69</u>	<u>98</u>	<u>779</u>	
<u>1445</u>	<u>3g</u>	<u>22.15</u>	<u>345</u>	<u>7.13</u>	<u>3.89</u>	<u>111</u>	<u>611</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MIBE	8260	8010	OTHER
<u>1450</u>	<u>mw-9</u>										

Additional Comments

got very windy during purge. Continued to be very windy.

MONITORING WELL SAMPLING FORM

Date: **8/10**

Project Name: Chun	Client: Lily A. Chun Trust 1991	Job No: 401896004
Address: 2301 Santa Clara Avenue	Contact/Phone:	
City/State: Alameda, CA	Technician Gauging/Sampling: E. Dirksen	

Note: All measurements from top of casing.

Well Location:

WELL NO. mw-10	Depth to Liquid (DL): 8.19
Casing Material: PVC	Depth to Water (DW1): 8.19
Diameter: 2"	Product Thickness (PT=DW1-DL): 0
Well Head Condition: good	Total Well Depth (TD): 13.16
Well Box Condition: good	Total head (TH=TD-DW1): 4.97
Purge Method: Bailor	Casing Volume (TH*Factor): 0.7952
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 2.3 purge	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
1511	1 gal	21.77	178	7.13	3.87	105	256	
1514	2 gal	21.64	104	6.85	4.14	109	940	
1516	3 gal	21.72	272	6.79	3.92	129	Flashed 1000	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
1520	mw-10										

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 8/10/15

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location:

WELL NO. <u>MW-11R</u>	Depth to Liquid (DL): <u>10.92</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>10.92</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>23.91</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>12.99</u>
Purge Method: <u>pump</u>	Casing Volume (TH*Factor): <u>2.07</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>6.2 purge</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1031</u>	<u>2 gal</u>	<u>19.44</u>	<u>154</u>	<u>6.98</u>	<u>1.56</u>	<u>-10</u>	<u>146</u>	
<u>1036</u>	<u>4 gal</u>	<u>19.93</u>	<u>251</u>	<u>6.12</u>	<u>1.86</u>	<u>-53</u>	<u>82.4</u>	
<u>1048</u>	<u>4 gal</u>	<u>20.17</u>	<u>332</u>	<u>5.94</u>	<u>1.53</u>	<u>-45</u>	<u>7.25</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MIBE	8260	8010	OTHER
<u>1048</u>	<u>MW-11R</u>										

Additional Comments

MONITORING WELL SAMPLING FORM

Date:

8/10/15

Project Name: Chun	Client: Lily A. Chun Trust 1991	Job No: 401896004
Address: 2301 Santa Clara Avenue	Contact/Phone:	
City/State: Alameda, CA	Technician Gauging/Sampling: E. Dirksen	

Note: All measurements from top of casing.

Well Location:

WELL NO. mw-12	Depth to Liquid (DL): 10.82
Casing Material: PVC	Depth to Water (DW1): 10.82
Diameter: 2"	Product Thickness (PT=DW1-DL): 0
Well Head Condition: good	Total Well Depth (TD): 24.59
Well Box Condition: good	Total head (TH=TD-DW1): 13.77
Purge Method: pump	Casing Volume (TH*Factor): 2.2
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023	

purge 6.6

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
1107	2 gal	20.43	432	5.92	1.52	30	834	
1114	4 gal	20.66	558	5.94	1.43	70	5.48	
1123	6 gal	20.70	538	6.03	3.41	-8	7.09	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
1125	mw-12										

Additional Comments

MW-13

MONITORING WELL SAMPLING FORM	Date: 8/10
--------------------------------------	------------

Project Name: Chun	Client: Lily A. Chun Trust 1991	Job No: 401896004
Address: 2301 Santa Clara Avenue	Contact/Phone:	
City/State: Alameda, CA	Technician Gauging/Sampling: E. Dirksen	

Note: All measurements from top of casing. Well Location:

WELL NO. MW-13	Depth to Liquid (DL): 9.87
Casing Material: PVC	Depth to Water (DW1): 9.87
Diameter: 2"	Product Thickness (PT=DW1-DL): 0
Well Head Condition: good	Total Well Depth (TD): 20.32
Well Box Condition: good	Total head (TH=TD-DW1): 10.45
Purge Method: Bailor	Casing Volume (TH*Factor): 1.67
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 purge 5 gal	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
0904	1.5 gal	20.79	502	5.86	6.24	125	17.6	
0908	3 gal	20.53	597	6.17	6.50	149	0.55	
0914	4.5 gal	20.25	643	6.51	7.91	171	0.0	NTU Flashed

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
0915	MW-13										

Additional Comments

MW-14

MONITORING WELL SAMPLING FORM Date: 8/10/2015

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing. Well Location:

WELL NO. <u>mw-14</u>	Depth to Liquid (DL): <u>9.65</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>9.65</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>11.66</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>2.01</u>
Purge Method: <u>backflow</u>	Casing Volume (TH*Factor): <u>0.3214</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>purge 1gal</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>0951</u>	<u>0.3 gal</u>	<u>19.65</u>	<u>451</u>	<u>7.03</u>	<u>9.18</u>	<u>130</u>	<u>14.3</u>	
<u>0952</u>	<u>0.4 g</u>	<u>19.10</u>	<u>0.00</u>	<u>7.69</u>	<u>8.84</u>	<u>51</u>	<u>28.7</u>	
<u>0955</u>	<u>0.9 g</u>	<u>19.15</u>	<u>1</u>	<u>7.5</u>	<u>8.84</u>	<u>28</u>	<u>10.7</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>1006</u>	<u>mw-14</u>										

Additional Comments
well cap off on arrival. well cover on

MONITORING WELL SAMPLING FORM

Date: 8/10

Project Name: Chun	Client: Lily A. Chun Trust 1991	Job No: 401896004
Address: 2301 Santa Clara Avenue	Contact/Phone:	
City/State: Alameda, CA	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing. Well Location:

WELL NO. <u>mw-15</u>	Depth to Liquid (DL): <u>10.38</u>
Casing Material: PVC	Depth to Water (DW1): <u>10.38</u>
Diameter: 2"	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>29.69</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>19.31</u>
Purge Method: <u>Bailer</u>	Casing Volume (TH*Factor): <u>3.09</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>9.2 surge</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1217</u>	<u>3 g</u>	<u>21.18</u>	<u>521</u>	<u>6.34</u>	<u>7.34</u>	<u>116</u>	<u>11.8</u>	
<u>1224</u>	<u>6 g</u>	<u>22.05</u>	<u>563</u>	<u>6.79</u>	<u>4.03</u>	<u>77</u>	<u>2.52</u>	
<u>1231</u>	<u>9 g</u>	<u>21.39</u>	<u>600</u>	<u>6.69</u>	<u>5.62</u>	<u>100</u>	<u>0.0</u>	<u>turb flash</u>

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MITBE	8260	8010	OTHER
<u>1240</u>	<u>MW-15</u>										

Additional Comments

MONITORING WELL SAMPLING FORM

Date: 8/10

Project Name: <u>Chun</u>	Client: <u>Lily A. Chun Trust 1991</u>	Job No: <u>401896004</u>
Address: <u>2301 Santa Clara Avenue</u>	Contact/Phone:	
City/State: <u>Alameda, CA</u>	Technician Gauging/Sampling: <u>E. Dirksen</u>	

Note: All measurements from top of casing.

Well Location: 8

WELL NO. <u>mw-16</u>	Depth to Liquid (DL): <u>9.88</u>
Casing Material: <u>PVC</u>	Depth to Water (DW1): <u>9.88</u>
Diameter: <u>2"</u>	Product Thickness (PT=DW1-DL): <u>0</u>
Well Head Condition: <u>good</u>	Total Well Depth (TD): <u>26.5</u>
Well Box Condition: <u>good</u>	Total head (TH=TD-DW1): <u>16.62</u>
Purge Method: <u>tailor</u>	Casing Volume (TH*Factor): <u>2.65</u>
Casing Vol. Conv. Factors: 2" = 0.16; 3" = 0.36; 4" = 0.65; 6" = 1.5 gal/ft. 1/2" = 0.01; 3/4" = 0.023 <u>8 gal</u>	

Time	Vol. Purged	Temp (°F/°C)	Cond (uS/cm)	pH	DO (mg/l)	ORP (mV)	Turb (NTU)	Remarks
<u>1258</u>	<u>3 g</u>	<u>20.93</u>	<u>508</u>	<u>6.49</u>	<u>6.34</u>	<u>113</u>	<u>121</u>	
<u>1309</u>	<u>6 g</u>	<u>20.35</u>	<u>304</u>	<u>6.00</u>	<u>3.52</u>	<u>139</u>	<u>109</u>	
<u>1320</u>	<u>2 g</u>	<u>19.72</u>	<u>287</u>	<u>5.98</u>	<u>5.02</u>	<u>149</u>	<u>68.8</u>	

Well Recovery Data

Time	Depth to Water (DW2)	% Recovery (1-[DW2-DW1]/DW1)*100

Sample Information

Time	Sample ID	Temp (°F)	PH	Cond (uS/cm)	Turb (NTU)	TPH-g	TPH-d	BTEX /MTBE	8260	8010	OTHER
<u>1325</u>	<u>mw-16</u>										

Additional Comments
