

QUARTERLY MONITORING REPORT
SECOND QUARTER 1994
OLD GRAYSTONE FUELING AREA
SANTA RITA CORRECTIONAL FACILITY
DUBLIN, CALIFORNIA

ESE PROJECT #6-93-5074

PRESENTED TO:

ALAMEDA COUNTY GENERAL SERVICES AGENCY
4400 MACARTHUR BOULEVARD
OAKLAND, CALIFORNIA 94619


PREPARED BY:

ENVIRONMENTAL SCIENCE & ENGINEERING, INC.
4090 NELSON AVENUE, SUITE J
CONCORD, CALIFORNIA 94520
(510) 685-4053

JULY 12, 1994

This quarterly report has been prepared by Environmental Science & Engineering, Inc. (ESE) for the exclusive use of the Alameda County General Services Agency as it pertains to their site referred to as the Old Graystone Fueling Area located at the Santa Rita Correctional Facility, Dublin, California. This report was prepared with that degree of care and skill ordinarily exercised by other geologists and engineers practicing in this field. No other warranty, either express or implied, is made as to professional advice in this report.

REPORT PREPARED BY:

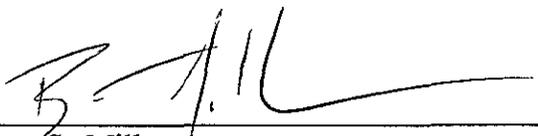

Bart S. Miller
Project Geologist

JULY 12, 1994
DATE

UNDER THE PROFESSIONAL SUPERVISION OF:



Michael E. Quillin
Senior Hydrogeologist
California Registered Geologist No. 5315

JULY 12, 1994
DATE



July 13, 1994

ESE Project No. 6-93-5074

TABLE OF CONTENTS

	page
1.0 INTRODUCTION	1
2.0 SITE HISTORY	2
3.0 FIELD METHODOLOGY	5
3.1 GROUND WATER MONITORING AND SAMPLING	5
3.2 WASTE MANAGEMENT	5
4.0 RESULTS	6
5.0 SUMMARY	7
6.0 REFERENCES	8

TABLES

- TABLE 1. GROUND-WATER ELEVATION DATA (5/13/94)
- TABLE 2. ANALYTICAL RESULTS OF GROUND WATER SAMPLES COLLECTED FROM MONITORING WELLS (5/13/94)

FIGURES

- FIGURE 1. LOCATION MAP
- FIGURE 2. SITE PLAN
- FIGURE 3. GROUND WATER ELEVATION MAP (5/13/94)

APPENDICES

- APPENDIX A. ESE STANDARD OPERATING PROCEDURE NO. 3
- APPENDIX B. SAMPLE COLLECTION LOGS
- APPENDIX C. ANALYTICAL REPORTS AND CHAIN OF CUSTODY DOCUMENTS



Environmental
Science &
Engineering, Inc.

RECEIVED
JUL 13 1994
9 11 10 5 11 01

TO: Alameda County Health Care Services Agency
Department of Environmental Health
1131 Harbor Bay Parkway
Alameda, CA 94502

DATE: July 12, 1994

ATTN: Mr. Scott Seery

JOB NUMBER: 6-93-5074

SUBJECT: Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California

WE ARE TRANSMITTING THE FOLLOWING:

One Ground Water Monitoring Report for the Second Quarter of 1994 for the subject property.

Sincerely,

DIST:
LB
FILE
ORIGINATOR

ENVIRONMENTAL SCIENCE & ENGINEERING, INC.

BY


Bart S. Miller
Project Geologist

QUARTERLY MONITORING REPORT
SECOND QUARTER, 1994
OLD GRAYSTONE FUELING AREA
SANTA RITA CORRECTIONAL FACILITY
DUBLIN, CALIFORNIA

1.0 INTRODUCTION

This report has been prepared by Environmental Science & Engineering, Inc. (ESE) for the Alameda County Health Care Services Agency (HCSA) on behalf of the Alameda County General Services Agency (GSA). It addresses ground water monitoring and sampling activities associated with three former underground storage tanks (USTs) at the Old Graystone fueling area of the Santa Rita Correctional Facility at Dublin, California (Figure 1 - Location Map).

The purpose of the fieldwork described in this report was to identify any potential petroleum hydrocarbon plume(s) in ground water at the former location of the USTs.

Site history, field methods for sampling and testing, and findings are described in the following sections. In addition, a summary of results is presented.

2.0 SITE HISTORY

The Old Graystone fueling area is located within the Santa Rita Correctional Facility property boundary approximately 1/2-mile west-northwest of the California Interstate 580 intersection with Tassajara Road at Dublin, California (Figure 1). The site is owned and managed by the GSA. At the site, the GSA formerly operated one 10,000-gallon unleaded gasoline UST, one 11,000-gallon regular gasoline UST, and one 500-gallon waste oil UST (Figure 2 - Site Plan). The UST for unleaded gasoline was constructed of fiberglass and the USTs for regular gasoline and waste oil were constructed of single-walled carbon-steel. The installation dates of the USTs are unknown.

Under permit from the HCSA and the Dougherty Regional Fire Authority (DRFA), ESE removed and disposed of the three USTs between May 18 and May 20, 1992. ESE submitted a closure report to the GSA and the HCSA for the three USTs on July 20, 1992 (ESE, 1992a). ESE also submitted an Underground Storage Tank Unauthorized Release (Leak) / Contamination Site Report to the HCSA on November 19, 1992. Under the direction of a HCSA representative, five soil samples were collected by ESE personnel from the bottom of the three UST excavations and submitted for analysis. Laboratory results reported concentrations of total petroleum hydrocarbons as gasoline (TPH-G) in all samples ranging between 13 to 730 milligrams per kilogram (mg/Kg) using EPA Method 8015 (modified per CA LUFT). Benzene, toluene, ethylbenzene, and total xylenes (BTEX) were also detected in all samples analyzed using EPA Method 8020.

On November 8, 1992, ESE conducted limited overexcavation and trench sampling at the site to excavate and characterize soil impacted with petroleum hydrocarbons. Soil occurring at a depth of approximately 22 feet below grade in the gasoline UST excavations was noted to be impacted with gasoline, exhibiting a grey discoloration and a fuel odor. No ground water was encountered during overexcavation activities. ESE documented all findings in a letter submitted to the GSA and the HCSA on January 8, 1993 (ESE, 1993a).

On November 18, 1992, ESE submitted a workplan to the GSA and the HCSA describing a subsurface investigation consisting of the collection of soil samples in borings and the collection of ground water samples in selected borings using a Hydropunch® (ESE, 1992b). The work was implemented on November 23, 1992. Detectable TPH-G and BTEX concentrations were reported to occur in one soil sample collected at a depth of 25 feet below grade from a boring located approximately 10 feet north of the former unleaded gasoline UST. In addition, detectable concentrations of TPH-G and BTEX were reported in seven ground water samples collected at distances ranging from 5 feet to 25 feet from the former UST locations. The reported concentrations of TPH-G and BTEX in ground water were noted to decrease radially outward from the former UST locations. ESE submitted a report documenting these findings to the GSA and the HCSA on January 15, 1993 and recommended that the impacted soil at the site be excavated and, subsequently, a ground water investigation be performed (ESE, 1993b).

A Corrective Action Plan for the excavation work was submitted by ESE to the GSA and the HCSA on February 1, 1993 (ESE, 1993c). During the period of February 17 through March 2, 1993, ESE supervised the excavation of soil impacted with petroleum hydrocarbons at the site. Impacted soil was identified and excavated to the depth of water saturation at approximately 24 feet below grade. ESE estimated the total volume of soil excavated to be 6,500 cubic yards. Of this volume, ESE initially estimated 5,000 cubic yards of soil to be impacted with petroleum hydrocarbons. All findings were documented in a Corrective Action Report submitted to the GSA and the HCSA on April 28, 1993 (ESE, 1993d).

ESE installed, developed, and sampled four ground water monitoring wells (OG1, OG2, OG3, and OG4; Figure 2) at locations surrounding the former location of the USTs on November 4 and 5, 1993. Ground water flow direction at the site was noted to be consistent with local topographic slope toward the southeast (ESE, 1994a). A ground water sample collected from well OG3 was reported to contain a total petroleum hydrocarbons as diesel (TPH-D) concentration of 75 micrograms per liter ($\mu\text{g/L}$). No other ground water samples were reported to contain detectable concentrations of petroleum hydrocarbons.

ESE monitored and sampled ground water at wells OG1, OG2, OG3, and OG4 during the first quarter of 1994. Ground water flow direction was noted to be toward the southeast at a gradient of approximately 0.001 foot per foot (ESE, 1994b). No detectable concentrations of TPH-D or TPH-G were reported in any of the ground water samples. A sample from OG2 was reported to contain a toluene, ethylbenzene, and total xylenes concentrations of 2.1, 0.51, and 3.5 $\mu\text{g/L}$, respectively.

3.0 FIELD METHODOLOGY

3.1 GROUND WATER MONITORING AND SAMPLING

All ground water monitoring and sampling activities were performed in accordance with HCSA and Tri-Regional Water Quality Control Board guidelines (State of California Water Quality Control Board, 1990). ESE monitored ground water levels in all wells at the site (OG1, OG2, OG3, and OG4). Ground water samples were collected from the site wells in accordance with ESE SOP No. 3 for Ground Water Monitoring and Sampling from Monitoring Wells (Appendix A).

Ground water samples ^{collected} from the site wells were placed in a cooler with ice and transported to McCampbell Analytical under chain of custody. Pursuant to the HCSA request, all samples were analyzed for TPH-G, TPH-D, and BTEX.

One duplicate ground water sample (DUP) was collected from well OG4 for Quality Assurance/Quality Control (QA/QC) purposes. The duplicate was submitted to the laboratory as a blind sample for BTEX analysis, and serves as a check on ESE's sample collection procedures and the laboratory's analytical methods. A travel blank was supplied by the laboratory for additional QA/QC purposes. The travel blank was analyzed for BTEX only and serves as a check on ESE's sample handling and transport procedures.

3.2 WASTE MANAGEMENT

All decontamination rinseates and purge water were placed in appropriately labeled 55-gallon capacity Department of Transportation (DOT) - approved drums for temporary storage at the site. Each drum of rinseate and purge water was labeled according to source location and date of collection. Integrated Wastestream Management (IWM) of Milpitas, California transported the drummed rinseate and purge water as non-hazardous waste using a licensed hauler to the Gibson Environmental Liquid Treatment and Recycling Facility located at Redwood City, California for recycling.

4.0 RESULTS

Depth to water measurements and ground water elevation data for the site wells are presented in Table 1 (Ground Water Elevation Data 5/13/94) and Appendix B (Sample Collection Logs). Ground water flow was observed to be toward the southeast at a gradient of approximately 0.0015 foot per foot (Figure 3 - Ground Water Elevation Map 5/13/94). The direction of ground water flow is consistent with local topographic slope toward the southeast and the ground water flow direction reported by the State of California Department of Water Resources (1974).

No detectable concentrations of TPH-G, TPH-D, or BTEX constituents were reported in any of the ground water samples collected at the site (Table 3 - Analytical Results for Ground Water Samples Collected From Monitoring Wells 5/13/94).

5.0 SUMMARY

Ground water flow was observed to be toward the southeast at a gradient of approximately 0.0015 foot per foot. No ground water samples collected at the site were reported to contain detectable concentrations of petroleum hydrocarbons.

6.0 REFERENCES

Environmental Science & Engineering, Inc. (ESE), 1992a. Unpublished Underground Storage Tank Closure Report for Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on July 20, 1992.

Environmental Science & Engineering, Inc. (ESE), 1992b. Unpublished Letter Workplan for a Subsurface Investigation at the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on November 18, 1992.

Environmental Science & Engineering, Inc. (ESE), 1993a. Unpublished Letter Report of Overexcavation Activities at the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on January 7, 1993.

Environmental Science & Engineering, Inc. (ESE), 1993b. Unpublished Report on Soil and Ground Water Investigation at the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on January 15, 1993.

Environmental Science & Engineering, Inc. (ESE), 1993c. Unpublished Corrective Action Plan for the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on February 1, 1993.

Environmental Science & Engineering, Inc. (ESE), 1993d. Unpublished Corrective Action Report for the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on April 27, 1993.

Environmental Science and Engineering, Inc. (ESE), 1993e. Unpublished Workplan For a Site Investigation at the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to Alameda County Health Care Services Agency on July 21, 1993.

Environmental Science & Engineering, Inc. (ESE), 1994a. Unpublished Site Assessment Report for the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to the Alameda County Health Care Services Agency on February 21, 1994.

Environmental Science & Engineering, Inc. (ESE), 1994b. Unpublished Quarterly Monitoring Report for the Old Graystone Fueling Area, Santa Rita Correctional Facility, Dublin, California; submitted to the Alameda County Health Care Services Agency on February 25, 1994.

State of California Department of Water Resources, 1974. Evaluation of Ground Water Resources: Livermore and Sunol Valleys; Bull. 118-2.

State of California Regional Water Quality Control Board (RWQCB), 1990. Tri-Regional Board Staff Recommendations for Preliminary Evaluation and Investigation of Underground Tank Site; August 10, 1990.

TABLES

TABLE 1
GROUND WATER ELEVATION DATA
(5/13/94)

Well No.	Date	Depth to Water (feet)	Top of Casing Elevation (feet AMSL)	Ground Water Elevation (feet AMSL)
OG1	11/05/93	23.56	351.90	328.34
	2/10/94	25.10		326.80
	5/13/94	25.50		326.4
OG2	11/05/93	22.48	350.53	328.05
	2/10/94	23.85		326.68
	5/13/94	24.23		326.30
OG3	11/05/93	22.75	350.75	328.00
	2/10/94	24.11		326.64
	5/13/94	24.52		326.23
OG4	11/05/93	22.24	350.26	328.02
	2/10/94	23.66		326.60
	5/13/94	24.06		326.20

NOTES:

AMSL refers to Above Mean Sea Level

TABLE 2

ANALYTICAL RESULTS FOR GROUND WATER
 SAMPLES COLLECTED FROM MONITORING WELLS
 (5/13/94)

Sample No.	Date	TPH-G (µg/L)	TPH-D (µg/L)	Benzene (µg/L)	Toluene (µg/L)	Ethylbenzene (µg/L)	Total Xylenes (µg/L)
OG1	11/05/93	ND	--	ND	ND	ND	ND
	2/10/94	ND	ND	ND	ND	ND	ND
	5/13/94	ND	ND	ND	ND	ND	ND
OG2	11/05/93	ND	--	ND	ND	ND	ND
	2/10/94	ND	ND	ND	2.1	0.51	3.5
	5/13/94	ND	ND	ND	ND	ND	ND
OG3	11/05/93	ND	75	ND	ND	ND	ND
	2/10/94	ND	ND	ND	ND	ND	ND
	5/13/94	ND	ND	ND	ND	ND	ND
OG4	11/05/93	ND	--	ND	ND	ND	ND
	2/10/94	ND	ND	ND	ND	ND	ND
	5/13/94	ND	ND	ND	ND	ND	ND

NOTES:

µg/L refers to micrograms per liter

TPH-G refers to Total Petroleum Hydrocarbons as Gasoline

TPH-D refers to Total Petroleum Hydrocarbons as Diesel

ND refers to not detected at analytical method detection limit

FIGURES



ADAPTED FROM U.S.G.S. DUBLIN AND LIVERMORE 7.5 MINUTE TOPOGRAPHIC QUADRANGLE MAPS, 1980.



**Environmental
Science &
Engineering, Inc.**

4090 NELSON AVENUE, SUITE J
CONCORD, CA 94520

DATE

2/94

REVISED

CAD FILE

50741004

LOCATION MAP

ALAMEDA COUNTY GENERAL SERVICES AGENCY
OLD GRAYSTONE FUELING AREA
SANTA RITA CORRECTIONAL FACILITY

FIGURE NO.

1

PROJ. NO.

6-93-5074

OG1




FORMER 10,000 GALLON CAPACITY UNLEADED GASOLINE UST

LIMIT OF EXCAVATION (MARCH 2, 1993)

FORMER 500 GALLON CAPACITY WASTE OIL UST

FORMER 11,000 GALLON CAPACITY REGULAR GASOLINE UST

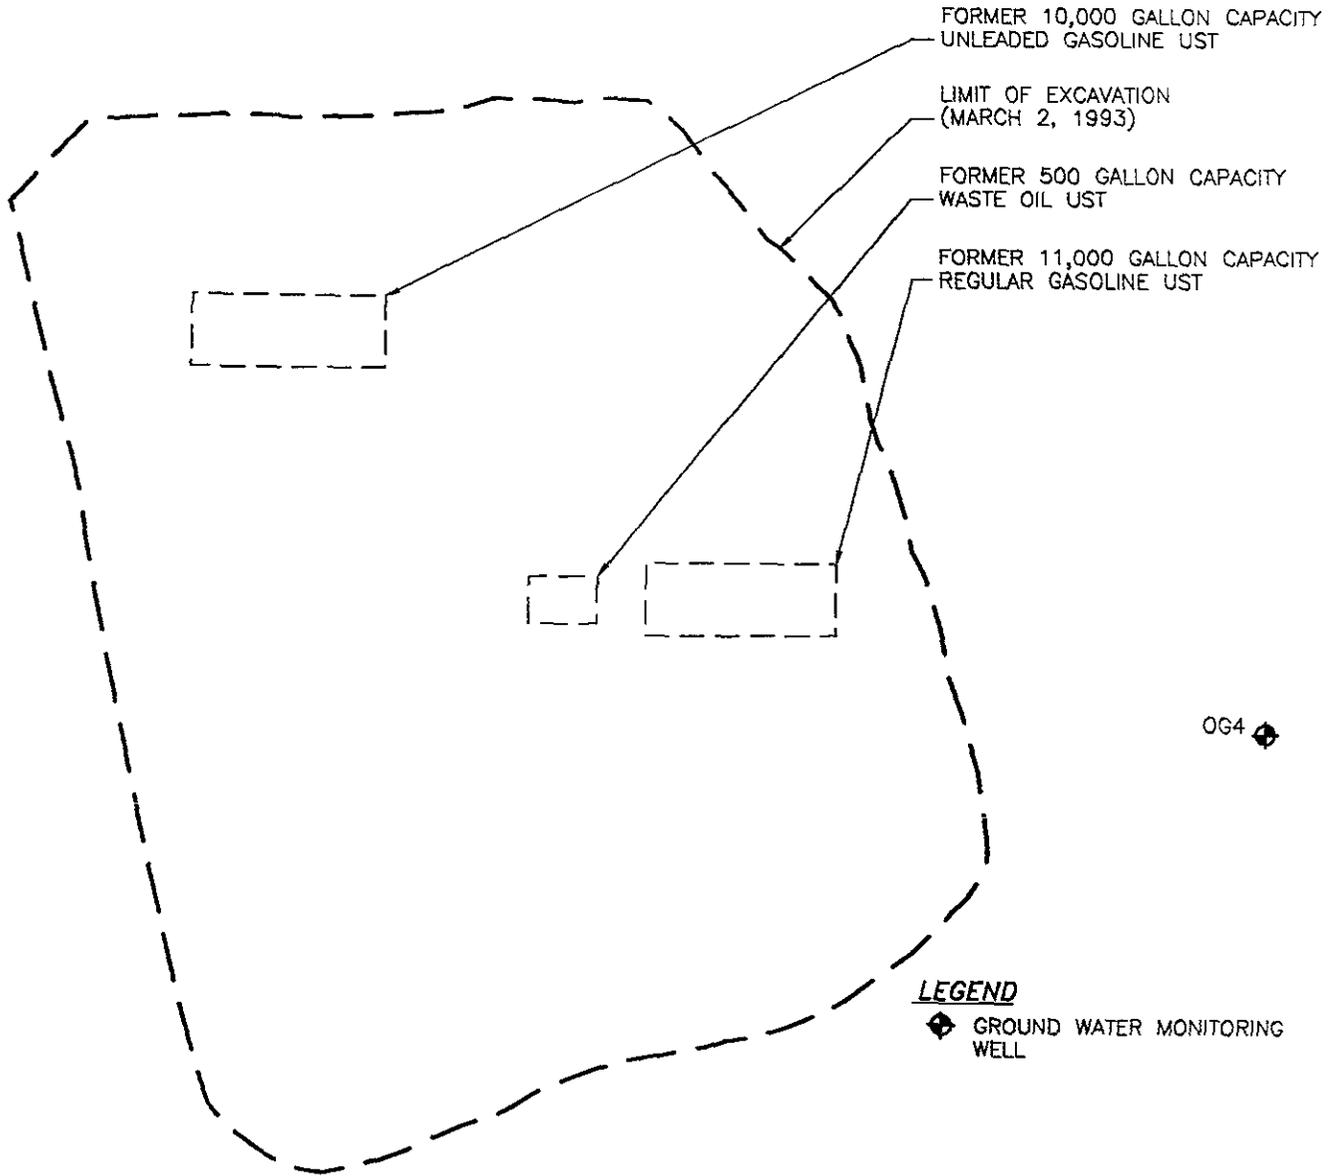

OG4


LEGEND

◆ GROUND WATER MONITORING WELL

OG2

OG3

SCALE



Environmental Science & Engineering, Inc.

DATE

2/94

REVISED

7/8/94

CAD FILE

50742001

SITE PLAN

FIGURE NO.

2

4090 NELSON AVENUE, SUITE J
CONCORD, CA 94520

ALAMEDA COUNTY GENERAL SERVICES AGENCY
OLD GRAYSTONE FUELING AREA
SANTA RITA CORRECTIONAL FACILITY

PROJ. NO.

6-93-5074



OG1
326.40
326.40

FORMER 10,000 GALLON CAPACITY
UNLEADED GASOLINE UST

LIMIT OF EXCAVATION
(MARCH 2, 1993)

FORMER 500 GALLON CAPACITY
WASTE OIL UST

FORMER 11,000 GALLON CAPACITY
REGULAR GASOLINE UST

LEGEND

- GROUND WATER MONITORING WELL
- 326.40 GROUND WATER ELEVATION IN FEET ABOVE MEAN SEAL LEVEL (MSL)
- 326.40 — GROUND WATER ELEVATION CONTOUR IN FEET MSL
- DIRECTION OF GROUND WATER FLOW

OG4
326.20



OG2
326.30
326.30

OG3
326.23

	DATE 2/94	GROUND WATER ELEVATION MAP MAY 13, 1994	FIGURE NO. 3
	REVISD 7/8/94		ALAMEDA COUNTY GENERAL SERVICES AGENCY OLD GRAYSTONE FUELING AREA SANTA RITA CORRECTIONAL FACILITY
4090 NELSON AVENUE, SUITE J CONCORD, CA 94520		CAD FILE 50742002	

APPENDIX A
ESE STANDARD OPERATING PROCEDURE NO. 3

**ENVIRONMENTAL SCIENCE & ENGINEERING, INC.
CONCORD, CALIFORNIA OFFICE**

**STANDARD OPERATING PROCEDURE NO. 3
FOR GROUND-WATER MONITORING AND SAMPLING FROM MONITORING
WELLS**

Environmental Science & Engineering, Inc. (ESE) typically performs ground-water monitoring at project sites on a quarterly basis. As part of the monitoring program an ESE staff member will first gauge the depth to water and free product (if present) in each well, then collect ground-water samples from each well. Depth to water measurements are taken by lowering an electric fiberglass tape measure into the well and recording the occurrence of water in feet below a fixed datum set on the top of the well-casing. If free-phase liquid hydrocarbons (free product) are known or suspected to be present in the well, then an electric oil/water interface probe is used to determine the depth to the occurrence of ground-water and the free product in feet below the fixed datum on the top of the well-casing. Depth to water and depth to product measurements are measured and recorded within an accuracy of 0.005-foot. The electric tape and the electric oil/water interface probe are washed with an Alconox® detergent and tap water solution then rinsed with tap water between uses in different wells.

Ground-water samples are collected from a well subsequent to purging a minimum of three to four well-casing volumes of ground water from the well, if the well bails dry prior to the removal of the required minimum volume, then the samples are collected upon the recovery of the ground water in that well to 80% of its initial static level. Ground water is typically purged from monitoring wells using either a hand-operated positive displacement pump, constructed of polyvinylchloride (PVC); a new (precleaned), disposable polyethylene bailer; or, a variable-flow submersible pump, constructed of stainless steel and Teflon®. The hand pumps and the submersible pumps are cleaned between each use with an Alconox® detergent and tap water solution followed by a tap water rinse. During the well purging process the conductivity, Ph and temperature of the ground water are monitored by the ESE staff member. Ground-water samples are collected from the well subsequent to the stabilization of the of the conductivity, Ph and temperature of the purge water, and the removal of four well-casing volumes of ground-water (unless the well bails dry). The parameters are deemed to have stabilized when two consecutive measurements are within 10% of each other, for each respective parameter. The temperature, Ph, conductivity and purge volume measurements, and observations of water clarity and sediment content will be documented by the ESE staff member on ESE Ground-Water Sampling Data Forms.

Ground-water samples are collected by lowering a new (precleaned), disposable polyethylene bailer into the well using new, disposable nylon cord. The filled bailer is retrieved, emptied, then filled again. The ground water from this bailer is decanted into appropriate laboratory supplied glassware and/or plastic containers (if sample preservatives are required, they are added to the empty containers at the laboratory prior to the sampling event). The containers are filled carefully so that no headspace is present to avoid volatilization of the sample. The filled sample containers are then labeled and placed in a cooler with ice for transport under chain of custody documentation to the designated analytical laboratory. The ESE staff member will document the time and method of sample collection, and the type of sample containers and preservatives (if any) used. These facts will appear on the ESE Ground-Water Sampling Data Forms. ESE will collect a duplicate ground-water sample from one well for every ten wells sampled at each site. The duplicate will be a blind sample (its well designation will be unknown to the laboratory). The duplicate sample is for Quality Assurance and Quality Control (QA/QC) purposes, and provides a check on ESE sampling procedures and laboratory sample handling procedures. When VOCs are included in the laboratory analyses, ESE will include a trip blank, if required, in the cooler with the ground-water samples for analysis for the identical VOCs. The trip blank is supplied by the laboratory and consists of deionized water. The trip blank is for QA/QC purposes and provides a check on both ESE and laboratory sample handling and storage procedures. Since disposable bailers are used for sample collection, and are not reused, no equipment blank (rinsate) samples are collected.

APPENDIX B
SAMPLE COLLECTION LOGS



Environmental
Science &
Engineering, Inc.

SAMPLE COLLECTION LOG

PROJECT NAME: ALAMEDA CO. GSA - OLD GRAYSTONE
PROJECT NO.: 6-93-5074
DATE: 5/13/94

SAMPLE LOCATION I.D.: OG1
SAMPLER: BART MILLER
PROJECT MANAGER: BART MILLER

CASING DIAMETER

2" _____
4" _____
Other _____

SAMPLE TYPE

Ground Water
Surface Water _____
Treat. Influent _____
Treat. Effluent _____
Other _____

WELL VOLUMES PER UNIT

Well Casing I.D. (inches)	Gal/Ft.
2.0	0.1632
4.0	0.6528
6.0	1.4690

DEPTH TO PRODUCT: _____ (ft.) PRODUCT THICKNESS: _____ (ft.) MINIMUM PURGE VOLUME
DEPTH TO WATER: 25.50 (ft.) WATER COLUMN: 12.37 (ft.) (3 or 4 WCV): 32.3 (gal)
DEPTH OF WELL: 37.87 (ft.) WELL CASING VOLUME: 8.08 (gal) ACTUAL VOLUME PURGED: 40 (gal)

TIME	Volume (GAL)	pH (Units)	E.C. (Micromhos)	Temperature (F°)	Turbid. (NTU)	Other	
<u>10:05</u>	<u>5</u>	<u>7.33</u>	<u>2480</u>	<u>62.2</u>	_____	<u>Translucent, no odor</u>	
<u>10:07</u>	<u>10</u>	<u>7.21</u>	<u>2480</u>	<u>62.2</u>	_____	<u>" , no odor</u>	
<u>10:10</u>	<u>20</u>	<u>7.28</u>	<u>2400</u>	<u>62.0</u>	_____	<u>" , no odor</u>	
<u>10:14</u>	<u>30</u>	<u>WELL PURGED DRY; ALLOWED TO RECOVER 5 MINUTES</u>				_____	<u>"</u>
<u>10:25</u>	<u>40</u>	<u>7.27</u>	<u>2410</u>	<u>61.6</u>	_____	<u>slightly Cloudy, no odor</u>	

INSTRUMENT CALIBRATION

pH/COND./TEMP.: TYPE HYDAC UNIT# 9308A DATE: 3/07/94 TIME: _____ BY: Bm
TURBIDITY: TYPE _____ UNIT# _____ DATE: _____ TIME: _____ BY: _____

PURGE METHOD

____ Displacement Pump ____ Other
____ Bailer (Teflon/PVC/SS) Submersible Pump

SAMPLE METHOD

____ Bailer (Teflon/PVC/SS) ____ Dedicated
 Bailer (Disposable) ____ Other

SAMPLES COLLECTED

SAMPLE	ID	TIME	DATE	LAB	ANALYSES
DUPLICATE	<u>OG1</u>	<u>12:30</u>	<u>5/13/94</u>	<u>M. CAMPBELL</u>	<u>TPH-G/TPH-D/BTEX</u>
SPLIT	_____	_____	_____	_____	_____
FIELD BLANK	_____	_____	_____	_____	_____

COMMENTS: _____

SAMPLER: BART MILLER

PROJECT MANAGER [Signature]



Environmental
Science &
Engineering, Inc.

SAMPLE COLLECTION LOG

PROJECT NAME: ALAMEDA CO. GSA - OLD GRAYSTONE
PROJECT NO.: 6-93-5074
DATE: 5/13/94

SAMPLE LOCATION I.D.: 062
SAMPLER: BART MILLER
PROJECT MANAGER: BART MILLER

CASING DIAMETER

2" _____
4" _____
Other _____

SAMPLE TYPE

Ground Water
Surface Water _____
Treat. Influent _____
Treat. Effluent _____
Other _____

WELL VOLUMES PER UNIT

Well Casing I.D. (inches)	Gal/Ft.
2.0	0.1632
4.0	0.6528
6.0	1.4690

DEPTH TO PRODUCT: _____ (ft.) PRODUCT THICKNESS: _____ (ft.) MINIMUM PURGE VOLUME
DEPTH TO WATER: 24.23 (ft.) WATER COLUMN: 13.23 (ft.) (3 or 4 WCV): 34.6 (gal)
DEPTH OF WELL: 57.46 (ft.) WELL CASING VOLUME: 8.64 (gal) ACTUAL VOLUME PURGED: 55 (gal)

TIME	Volume (GAL)	pH (Units)	E.C. (Micromhos)	Temperature (F°)	Turbid. (NTU)	Other
<u>10:49</u>	<u>5</u>	<u>7.73</u>	<u>2940</u>	<u>63.4</u>	_____	<u>Transparent, no odor</u>
<u>10:54</u>	<u>20</u>	<u>7.81</u>	<u>2940</u>	<u>63.4</u>	_____	<u>" , no odor</u>
<u>10:57</u>	<u>30</u>	<u>7.74</u>	<u>2920</u>	<u>62.7</u>	_____	<u>"</u>
<u>11:02</u>	<u>40</u>	<u>7.59</u>	<u>2900</u>	<u>62.2</u>	_____	<u>"</u>
<u>11:07</u>	<u>55</u>	<u>7.58</u>	<u>2900</u>	<u>62.1</u>	_____	<u>"</u>

INSTRUMENT CALIBRATION

pH/COND./TEMP.: TYPE HYDAC UNIT# 9308A DATE: 3/07/94 TIME: _____ BY: BMA
TURBIDITY: TYPE _____ UNIT# _____ DATE: _____ TIME: _____ BY: _____

PURGE METHOD

____ Displacement Pump ____ Other
____ Bailer (Teflon/PVC/SS) Submersible Pump

SAMPLE METHOD

Bailer (Teflon/PVC/SS) ____ Dedicated
 Bailer (Disposable) ____ Other

SAMPLES COLLECTED

SAMPLE	ID	TIME	DATE	LAB	ANALYSES
DUPLICATE	<u>062</u>	<u>12:42</u>	<u>5/13/94</u>	<u>M. Campbell</u>	<u>TPM-G/BTEX/TPM-D</u>
SPLIT	_____	_____	_____	_____	_____
FIELD BLANK	_____	_____	_____	_____	_____

COMMENTS: _____

SAMPLER: BART MILLER
4090 Nelson Avenue, Suite 1

Concord, CA 94520

PROJECT MANAGER

Phone (510) 685-4033

Fax (510) 685-5323



Environmental
Science &
Engineering, Inc.

SAMPLE COLLECTION LOG

PROJECT NAME: ALAMEDA CO. GSA - OLD GRANSTONE
PROJECT NO.: 6-93-5074
DATE: 5/13/94

SAMPLE LOCATION I.D.: OG3
SAMPLER: BART MILLER
PROJECT MANAGER: BART MILLER

CASING DIAMETER

2" _____
4" _____
Other _____

SAMPLE TYPE

Ground Water
Surface Water _____
Treat. Influent _____
Treat. Effluent _____
Other _____

WELL VOLUMES PER UNIT

Well Casing I.D. (inches)	Gal/Ft.
2.0	0.1632
4.0	0.6528
6.0	1.4690

DEPTH TO PRODUCT: _____ (ft.) PRODUCT THICKNESS: _____ (ft.) MINIMUM PURGE VOLUME
DEPTH TO WATER: 24.52 (ft.) WATER COLUMN: 13.19 (ft.) (3 or 4 WCV): 34.4 (gal)
DEPTH OF WELL: 37.71 (ft.) WELL CASING VOLUME: 8.61 (gal) ACTUAL VOLUME PURGED: 55 (gal)

TIME	Volume (GAL)	pH (Units)	E.C. (Micromhos)	Temperature (F°)	Turbid. (NTU)	Other
<u>11:24</u>	<u>10</u>	<u>7.35</u>	<u>3140</u>	<u>63.2</u>	_____	<u>Transparent; no odor</u>
<u>11:29</u>	<u>20</u>	<u>7.31</u>	<u>3080</u>	<u>63.1</u>	_____	"
<u>11:34</u>	<u>30</u>	<u>7.26</u>	<u>2960</u>	<u>62.9</u>	_____	"
<u>11:37</u>	<u>40</u>	<u>7.19</u>	<u>2940</u>	<u>61.4</u>	_____	"
<u>11:43</u>	<u>55</u>	<u>7.17</u>	<u>2940</u>	<u>61.2</u>	_____	"

INSTRUMENT CALIBRATION

pH/COND./TEMP.: TYPE H10AC UNIT# 9308A DATE: 3/07/94 TIME: _____ BY: BM
TURBIDITY: TYPE _____ UNIT# _____ DATE: _____ TIME: _____ BY: _____

PURGE METHOD

SAMPLE METHOD

____ Displacement Pump Other
____ Bailer (Teflon/PVC/SS) Submersible Pump

____ Bailer (Teflon/PVC/SS) ____ Dedicated
 Bailer (Disposable) ____ Other

SAMPLES COLLECTED

SAMPLE	ID	TIME	DATE	LAB	ANALYSES
DUPLICATE	<u>OG3</u>	<u>12:54</u>	<u>5/13/94</u>	<u>McCAMPBELL</u>	<u>TM-G/TPH-D/BTEX</u>
SPLIT	_____	_____	_____	_____	_____
FIELD BLANK	_____	_____	_____	_____	_____

COMMENTS: _____

SAMPLER: BART MILLER
4090 Nelson Avenue, Suite J

Concord, CA 94520

PROJECT MANAGER [Signature]

Phone (510) 685-4053

Fax (510) 685-5323



Environmental
Science &
Engineering, Inc.

SAMPLE COLLECTION LOG

PROJECT NAME: ALAMEDA CO. GSA - OLD GRAYSTONE
PROJECT NO.: 6-93-5074
DATE: 5/13/94

SAMPLE LOCATION I.D.: OG4
SAMPLER: BART MILLER
PROJECT MANAGER: BART MILLER

CASING DIAMETER

2" _____
4" _____
Other _____

SAMPLE TYPE

Ground Water
Surface Water _____
Treat. Influent _____
Treat. Effluent _____
Other _____

WELL VOLUMES PER UNIT

Well Casing I.D. (inches)	Gal/Ft.
2.0	0.1632
4.0	0.6528
6.0	1.4690

DEPTH TO PRODUCT: _____ (ft.) PRODUCT THICKNESS: _____ (ft.) MINIMUM PURGE VOLUME
DEPTH TO WATER: 24.06 (ft.) WATER COLUMN: 13.02 (ft.) (3 or 4 WCV): 34.0 (gal)
DEPTH OF WELL: 37.08 (ft.) WELL CASING VOLUME: 8.50 (gal) ACTUAL VOLUME PURGED: 55 (gal)

TIME	Volume (GAL)	pH (Units)	E.C. (Micromhos)	Temperature (F°)	Turbid. (NTU)	Other
<u>12:00</u>	<u>10</u>	<u>7.33</u>	<u>2480</u>	<u>62.0</u>	_____	<u>Transparent, no odor</u>
<u>12:04</u>	<u>20</u>	<u>7.28</u>	<u>2480</u>	<u>61.5</u>	_____	"
<u>12:09</u>	<u>30</u>	<u>7.27</u>	<u>2450</u>	<u>61.3</u>	_____	"
<u>12:12</u>	<u>40</u>	<u>7.19</u>	<u>2410</u>	<u>59.8</u>	_____	"
<u>12:18</u>	<u>55</u>	<u>7.18</u>	<u>2410</u>	<u>59.7</u>	_____	"

INSTRUMENT CALIBRATION

pH/COND./TEMP.: TYPE HYDAC UNIT# 9308A DATE: 3/07/94 TIME: _____ BY: Bm
TURBIDITY: TYPE _____ UNIT# _____ DATE: _____ TIME: _____ BY: _____

PURGE METHOD

____ Displacement Pump ____ Other
____ Bailer (Teflon/PVC/SS) Submersible Pump

SAMPLE METHOD

____ Bailer (Teflon/PVC/SS) ____ Dedicated
 Bailer (Disposable) ____ Other

SAMPLES COLLECTED

SAMPLE	ID	TIME	DATE	LAB	ANALYSES
DUPLICATE	<u>OG4</u>	<u>13:06</u>	<u>5/13/94</u>	<u>M. CAMPBELL</u>	<u>TPH-G / TPH-D / BTEX</u>
SPLIT	<u>DUP</u>	<u>13:06</u>	<u>5/13/94</u>	<u>M. CAMPBELL</u>	<u>TPH-G / TPH-D / BTEX</u>
FIELD BLANK	_____	_____	_____	_____	_____

COMMENTS: _____

SAMPLER: B. Miller
4090 Nelson Avenue, Suite J
Concord, CA 94520

PROJECT MANAGER: B. Miller
Phone (510) 685-4053 Fax (510) 685-5323

APPENDIX C
LABORATORY RESULTS AND CHAIN OF CUSTODY DOCUMENTS

McCAMPBELL ANALYTICAL INC.

110 2nd Avenue South, #D7, Pacheco, CA 94553
Tele: 510-798-1620 Fax: 510-798-1622

05/20/94

Dear Bart:

Enclosed are:

- 1). the results of 6 samples from your Alameda Co. GSA; Old GrayStone project,
- 2). a QC report for the above samples
- 3). a copy of the chain of custody, and
- 4). a bill for analytical services.

If you have any questions please contact me. McCampbell Analytical Laboratories strives for excellence in quality, service and cost. Thank you for your business and I look forward to working with you again.

Yours truly,



Edward Hamilton

QC REPORT FOR HYDROCARBON ANALYSES

Date: 05/14-05/16/94

Matrix: Water

Analyte	Concentration (ug/L)			Amount Spiked	% Recovery		
	Sample	MS	MSD		MS	MSD	RPD
TPH (gas)	0.0	99.2	93.4	100	99.2	93.4	6.0
Benzene	0	9.1	9.3	10	91.0	93.0	2.2
Toluene	0	9.6	9.4	10	96.0	94.0	2.1
Ethyl Benzene	0	9.7	9.5	10	97.0	95.0	2.1
Xylenes	0	29.9	29.6	30	99.7	98.7	1.0
TPH (diesel)	4	158	157	150	102	102	0.4
TRPH (oil & grease)	N/A	N/A	N/A	N/A	N/A	N/A	N/A

$$\% \text{ Rec.} = (\text{MS} - \text{Sample}) / \text{amount spiked} \times 100$$

$$\text{RPD} = (\text{MS} - \text{MSD}) / (\text{MS} + \text{MSD}) \times 2 \times 100$$

