



**PHASE I ENVIRONMENTAL  
SITE ASSESSMENT  
229 CASTRO STREET & 720 SECOND STREET  
OAKLAND, CALIFORNIA**

Project No. 044-00006  
February 16, 2000

Prepared for:  
Mr. Tom Lander  
MORTENSON  
700 Meadow Lane North  
Minneapolis, MN 55422

Prepared by:  
Krazan & Associates, Inc.  
550 Parrott Street, Suite One  
San Jose, California 95112  
(408) 271-2200

 **Krazan** & ASSOCIATES, INC.

SITE DEVELOPMENT ENGINEERS

**TABLE OF CONTENTS**  
Project No. 044-00006

**1.0 EXECUTIVE SUMMARY ..... 1**

**2.0 PURPOSE AND SCOPE OF ASSESSMENT ..... 2**

**3.0 PHYSICAL SETTING..... 2**

**4.0 SITE RECONNAISSANCE ..... 3**

    4.1 Observations ..... 3

    4.2 Adjacent Streets and Property Usage..... 5

    4.3 Asbestos Containing Building Materials ..... 6

    4.4 Potable Water Source..... 6

    4.5 Sewage Disposal System ..... 6

**5.0 SITE USAGE SURVEY..... 6**

    5.1 Site History ..... 7

    5.2 Agricultural Chemicals ..... 12

    5.3 Local Regulatory Agency Interface ..... 12

    5.4 Regulatory Agency Lists Review ..... 12

**6.0 CONCLUSIONS..... 15**

**7.0 LIMITATIONS ..... 16**

Maps

Vicinity Map ..... following text

Site Map ..... following Site Map

Color Photographs

Photographs ..... following Site Map

Appendices

Hazardous Materials Business Plan for 720 Second Street..... Appendix A

Sanborn Fire Insurance Maps..... Appendix B

VISTA Report and Regulatory Agency List Information ..... Appendix C

February 16, 2000

Project No. 044-00006

**PHASE I ENVIRONMENTAL SITE ASSESSMENT  
MORTENSON CONSTRUCTION SITE  
720 SECOND STREET & 229 CASTRO STREET  
OAKLAND, CALIFORNIA**

**1.0 EXECUTIVE SUMMARY**

Krazan & Associates, Inc. (Krazan) has performed a Phase I Environmental Site Assessment (ESA) of the property located at 720 Second Street and 229 Castro Street Oakland, California (subject site; Figure 1). This assessment has revealed no evidence of recognized environmental conditions in connection with the subject site with the exception of the following.

- Evidence of an underground storage tank in the form of a fill port and vent pipe were observed near the north side of the warehouse at 229 Castro Street. No information pertaining to the underground storage tank was present in the regulatory agency files. The potential exists for the subsurface of the site to be impacted from releases of hazardous materials from the underground storage tank.
- The western two thirds of the subject site was occupied by Phoenix Iron Works (PIW) from at least 1951 to approximately 1972, when the Port of Oakland acquired the subject site. The Oakland Fire Department and the Alameda County Environmental Health Service did not have information pertaining to the operation of the PIW. However, Sanborn Fire Insurance Maps (SFIMs) depict welding, pattern storage, foundry storage, flask yard and other uses by PIW. The 1967 and 1970 SFIMs depict a paint dip tank and drying rack on the north side of the main structure. Given the former existence of this paint dip tank and the long history of industrial use of the northern two thirds of the subject site, the potential exists for the subsurface to have been impacted by hazardous materials. Additionally, approximately two to five feet of fill material is present in the area of the subject site. The nature of the fill material is not known, and based on investigations of other properties in the vicinity of the subject site, the potential exists for the fill materials to be impacted by hazardous materials.

## 2.0 PURPOSE AND SCOPE OF ASSESSMENT

This Phase I ESA is designed to identify obvious recognized environmental conditions in connection with the previous and current uses and ownership of the subject site. Krazan performed this assessment in conformance with American Society for Testing and Materials (ASTM) E1527-97 *Standard Practice for Environmental Site Assessments: Phase I Environmental Site Assessment Process*. The scope of work was approved by Mr. Thomas Lander of Mortenson on January 13, 2000.

## 3.0 PHYSICAL SETTING

General property information and property use are summarized in Table I. Refer to the Vicinity Map (included in Appendix A).

**TABLE I**  
**Summary of Property Information**

Topographic Map:	U.S. Geological Survey, 7.5 minute Oakland West, California topographic quadrangle map, photorevised 1993
Topographic Map Location:	NE ¼, SE ¼ of Section 34, Township 1 South, Range 4 West, Mount Diablo Baseline and Meridian
Topography:	Subject site is gently sloping from northeast to southwest.
Geology & Hydrogeology:	The site area is located in the eastern portion of the San Francisco Bay Area, immediately east of the San Francisco Bay. The site is located within the Coast Ranges Geomorphic Province of California, which is characterized by northwest-trending structural features, including faults and geologic units. Based on the geotechnical investigation conducted by Krazan for the subject site, the site is underlain by two to five feet of uncharacterized fill material, which is underlain by beach and dune sand deposits of the Merrit Formation. This materials is described as loose, well-sorted, fine to medium grained sand with silt and clay.
General Location:	Subject site is north of Second Street, east of Brush Street, south of Third Street, and west of Castro Street.
Assessor's Parcel Number:	720 Second Street – 1-117-2; 229 Castro Street – 1-117-3
Approximate Depth to Groundwater:	7-12 feet below ground surface (bgs), San Francisco Bay Area Regional Water Quality Board (RWQCB)
Regional Groundwater Flow Direction:	South-southwest, RWQCB
Existing Use:	Commercial Properties



**4.0 SITE RECONNAISSANCE**

A site reconnaissance, which included a visual observation of the subject site and surrounding properties, was conducted by Krazan's environmental assessor on January 27, 2000. The objective of the site reconnaissance was to obtain information indicating the likelihood of identifying recognized environmental conditions, including hazardous substances and petroleum products, in connection with the property (including soils, surface waters, and groundwater).

**4.1 Observations**

Table II summarizes conditions encountered during the site reconnaissance. A discussion of physical observations follows Table II. Refer to the Site Map (Figure No. 1) and color photographs following the text for the locations of items discussed in this section of the report.

**TABLE II  
Summary of Site Reconnaissance**

<b>Feature</b>	<b>Observed</b>	<b>Not Observed</b>
Structures (existing)	X	
Evidence of past uses		X
Hazardous substances and/or petroleum products (including containers)	X	
Aboveground storage tanks (ASTs)		X
Underground storage tanks (USTs) or evidence of USTs	X	
Strong, pungent, or noxious odors		X
Pools of liquid likely to be hazardous materials or petroleum products		X
Drums	X	
Unidentified substance containers		X
Potential polychlorinated biphenyl (PCB) containing equipment		X
Subsurface hydraulic equipment		X
Heating/ventilation/air conditioning (HVAC)	X	
Stains or corrosion on floors, walls, or ceilings	X	
Floor drains and sumps		X
Pits, ponds, or lagoons		X
Stained soil and/or pavement		X
Stressed vegetation		X
Waste or wastewater discharges to surface or surface waters on subject site (including stormwater)		X
Wells (irrigation, domestic, dry, injection, abandoned, monitoring wells)		X
Septic Systems		X

- The subject site is located north of Second Street and south of Third Street between Castro Street on the east and Brush Street to the west. The subject site occupies the entire city block. The entire eastern one third of the subject site is occupied by a warehouse structure with the address of 229 Castro Street. However, the southwest corner of the building had the address of 201 Castro Street on the side of the building. The warehouse is occupied by Thai Kitchen, a distributor of food products. The western two thirds of the subject site is occupied by the Port of Oakland (Port) and used for maintenance and storage. There are three main structures associated with the Port parcel and several small, free-standing storage sheds. The Port parcel is identified

with the address of 720 Second Street. However, one of the structures on the Port parcel (Building E442) has the address of 747 Third Street.

- The building occupied by Thai Kitchen is constructed of reinforced brick walls, wood beam ceilings, and concrete floors and foundation. The southeast corner of the warehouse is occupied by the administrative activities of Thai Kitchen. This office area consists of ceramic and vinyl-floor tile, textured and painted gypsum board walls, and drop-ceiling panels. Small quantities of cleaning supplies are located in the office area of the warehouse. The warehouse area has concrete floors and exposed brick walls and wood ceilings. The warehouse is used for storage of packaged food products. No food processing is conducted at the subject site. Shipping of materials is conducted by outside contractors and loading docks currently in use are located along Castro Street. Two loading bays are located along Third Street, but are currently not used. The southwest portion of the warehouse was recently used as an office area for an architect and a small work area was present. Additionally, miscellaneous items are stored in the southwest corner of the warehouse. Some maintenance materials, including paints, cleaners, and lubricants, are located on shelves in this area. Stains or other indications of releases of these materials were not observed at the site. No floor drains were observed within the warehouse area. Furthermore, when used, stored, and disposed of in the manner for which they are intended, small quantities of cleaning and the other chemicals observed on the subject site do not ordinarily represent a significant environmental concern. A doorway is located along Castro Street, at street level, which was reported to have historically accessed the raised-floor level of the warehouse. Access is now present by stairs located along Castro Street west of this doorway. Heating and ventilation equipment is located above the offices within the warehouse.
- A vent pipe and fill port were observed adjacent to the warehouse building along Third Street. These features are typical of the presence of an underground storage tank (UST). Additionally, another pipe that terminates inside the warehouse is located adjacent to the vent pipe. The use of this suspected UST is not known.
- The Port parcel consists of the western two thirds of the subject site and is occupied by three main structures, with two of the structures sharing a common wall (these two structures are referred to as Building E417 by the Port). The majority of the Port parcel is paved with only a narrow strip of exposed dirt along the northern property boundary and the eastern property boundary north of Building E442. Entrance to the Port parcel is along Second Street near the corner of Brush Street. A small building is located near the corner of Second and Brush streets and is used for the storage of janitorial supplies. The two large structures on the Port parcel are steel frame buildings with tin siding and roofs with concrete floors. Interior partitions within the structures are constructed of bare wood.
- Near the entrance of the Port parcel is a waste materials accumulation area. The area has a concrete floor with raised concrete berms. The area is secured with steel cyclone fencing and is covered with tin roofing. Five 55-gallon drums were present in the area and contained waste latex paint, waste thinners, waste dry paint, waste oil, and waste diesel with asphalt roofing. The floor of this area was covered with absorbent material. No significant staining was noted within the waste accumulation area.
- The southwest building at the Port parcel is used for storage of maintenance materials and also contains a wood working shop. Mezzanine levels are located in the building and used to store parts. The wood working shop is relatively small and contains sawing and drilling machines. A minor amount of flammable materials, such as paints and lacquers, are located on shelving within the wood working shop. A small, metal flammable materials cabinet is located within the wood working shop and contained some paints and a plastic gasoline container. Some roof repair

materials, such as mastic and tar paper, were stored on a pallet in the southwest corner of this building. Other maintenance supplies and equipment were stored throughout this building. The concrete floor of the building appeared in good condition and had minor dark staining. A metal flammable materials locker is located east of this building. The locker has wood plank floor and wood shelving. A gasoline can, paint, and corrosive cleaners were stored in the locker. No staining or other evidence of a release of these materials was observed within the locker.

- The second large building located near the west central portion of the parcel is used for utility storage. Conduit piping, wire, and other hardware are stored within the building. A small wooden office/storage room is constructed inside of the building. Two empty flammable materials storage cabinets were present within the building. No significant quantities of hazardous materials were observed within the building.
- The southeast corner of the Port parcel is used as a transfer area for waste derived from Port operations. According to Mr. Bill Edward of the Port, no food waste is stored at the subject site and only yard waste and some municipal waste is stored onsite. A metal dumpster is located adjacent to the west of this area for the deposit of waste materials.
- Building E422 is located near the east central portion of the Port parcel along Third Street. The building has metal frames and walls on a concrete foundation. The interior of the building is insulated and contains parts used for cranes. The building is climate controlled with the heating and ventilation equipment located on the roof of the building. No hazardous materials were observed within the building.
- North of building E442 were three metal storage containers used for paint, plumbing, and electrical supplies. The container had wood plank flooring. Metal shelving was present within the paint storage container. Numerous one-quart to five-gallon containers of paint were present on the shelving. Additionally, one 55-gallon drum of lacquer thinner and one 55-gallon drum of paint thinner were observed in the southwest corner of the container. No significant staining was observed on the wood flooring. The plumbing and electrical supply storage containers contain conduit, copper tubing, fittings, meters, and other hardware. No hazardous materials were reportedly present within the plumbing and electrical supply containers.
- Hazardous materials used and stored at the Port parcel are summarized in the Hazardous Materials Business Plan (HMBP) included as Appendix A of this ESA report.

#### 4.2 Adjacent Streets and Property Usage

Table III summarizes the current adjacent roads and site uses observed during the site reconnaissance.

**TABLE III**  
**Adjacent Streets and Property Use**

<b>Direction</b>	<b>Adjacent Street</b>	<b>Adjacent Property Use</b>
North	Third Street	Arvey Office Supplies and an industrial business (possibly a plating shop)
East	Castro Street	Safe Keep Storage (self storage facility)
South	Second Street	Vacant building under renovation and PG&E facility
West	Brush Street	Port of Oakland building

Based on the uses of the adjacent properties, it is possible that hazardous materials are used at some of the neighboring properties. Facilities with reported releases of hazardous materials are discussed further in Section 5.4 of this report.

#### **4.3 Asbestos Containing Building Materials**

The structures located on the subject site were completed prior to 1950. Based on the age of the buildings, it is possible that asbestos containing materials (ACMs) are present within the buildings. Krazan did note the presence of duct wrapping in the warehouse building at 229 Castro Street. The duct wrapping appeared in good condition at the time of the reconnaissance. Prior to conducting any repair, renovation, or demolition work, an asbestos survey must be conducted. However, an asbestos survey and sampling of the on-site structure was not included within the scope of this assessment.

#### **4.4 Potable Water Source**

The water purveyor for the subject site is the East Bay Municipal Utility District (EBMUD). The EBMUD's water quality monitoring is an on-going program with water samples obtained on a regular basis. It is the responsibility of the EBMUD to provide customers with potable water in compliance with the California State Maximum Contaminant Levels (MCLs) for primary drinking water constituents in water supplied to the public. Mr. Mark Swearington of the New Business Office division of EBMUD stated that their utility began to deliver potable water to the 229 Castro Street address on November 21, 1950. He could find no information relating to the 720 Second Street address.

#### **4.5 Sewage Disposal System**

On February 3, 2000, the EBMUD, was contacted regarding historical sewage disposal practices at the property. According to EBMUD officials, sewer service has been provided to the subject site by the EBMUD since November 1950. Mr. Mark Swearington, with EBMUD, indicated only industrial facilities are monitored for sewer violations; therefore, no sewer violations are on file for the subject site.

#### **5.0 SITE USAGE SURVEY**

The property usage survey included assessing property history, and reviewing local, state, and federal regulatory agency records.

## 5.1 Site History

A review of historical aerial photographs, City of Oakland Building Permits Agency (COBPA) records, Haines Criss-Cross Directories (HCCDs) and Polk Guide Directories (PGDs), Sanborn Fire Insurance Maps (SFIMs), and a Phase I ESA Interview were used to assess the history of the subject site.

### Aerial Photograph Interpretation

Historical aerial photographs, dated 1946, 1950, 1958, 1965, 1968, 1974, 1980, 1991, and 1995, were reviewed to assess property history. These photographs were obtained from the United States Department of Agriculture (USDA) Natural Resources Conservation Service in Livermore, California, and the United States Geological Survey (USGS) McKelvey Library in Menlo Park, California. Aerial photograph coverage for the years prior to 1946 and more recent than 1995 were not reasonably ascertainable or available. The aerial photograph summary is provided below in Table IV.

**TABLE IV**  
**Summary of Aerial Photograph Review**

Year/Scale	Site Use	Site and Adjacent Property Observation
1946 1" = 2000'	Residential/ Commercial	The subject site appears to be occupied by several small structures, which may be residential and/or commercial in nature. The surrounding site vicinity is approximately 60 percent residential and 40 percent commercial and industrial. Several large aboveground storage tanks are located west of the site near the Port of Oakland. The Oakland Inner Harbor is located immediately west of the subject site.
1950 1" = 2000'	Commercial/ Industrial	A structure is present on the east (Castro Street) side of the subject site, which is similar in size and shape to the present-day structure. Two structures are located on the western two thirds of the subject site which appear different than the structures present today. The surrounding site vicinity is approximately 40 percent residential and 60 percent commercial. East-west trending Highway 880 has been constructed approximately 600 feet north of the site.
1958 1" = 2500'	Commercial/ Industrial	The subject site and the surrounding site vicinity are very similar as observed in the 1950 aerial photographs.
1965 1" = 1000'	Commercial/ Industrial	The subject site and the surrounding site vicinity are very similar as observed in the 1958 aerial photographs.
1968 1" = 2500'	Commercial/ Industrial	Two structures are present on the subject site, which are similar in size and shape to the structures currently at the location. A second building has been constructed on the Second Street (south side) portion of the subject site. The surrounding site vicinity is very similar as observed in the 1965 aerial photographs.
1974 1" = 1667'	Commercial/ Industrial	The subject site and the surrounding site vicinity are very similar as observed in the 1968 aerial photographs. In the surrounding site vicinity, Highway 980 appears to be under construction approximately two miles north of the site.
1980 1" = 2000'	Commercial/ Industrial	The subject site and the surrounding site vicinity are very similar as observed in the 1974 aerial photographs. In the surrounding site vicinity, Highway 980 continues to be under construction approximately one mile north of the site.

**TABLE IV (cont.)**  
**Summary of Aerial Photograph Review**

<b>Year/Scale</b>	<b>Site Use</b>	<b>Site and Adjacent Property Observation</b>
1991 1" = 2000'	Commercial/ Industrial	The subject site and the surrounding site vicinity are very similar as observed in the 1980 aerial photographs. In the surrounding site vicinity, Highway 980 has been completed north of the site.
1995 1" = 1000'	Commercial/ Industrial	There is a third, rectangular structure that appears in the northwest corner of the subject site (intersection of Third Street and Brush Street), but is smaller than the two other on-site buildings. The surrounding site vicinity is very similar as observed in the 1991 aerial photographs.

**City of Oakland-- Building Permits Agency**

On January 28, 2000, a records request was made to the City of Oakland-Building Permits (COBPA) for the subject site addresses of 229 Castro Street and 720 Second Street in Oakland, California. Several records were on file for the subject site addresses and these are listed below in Table V, including date of issue, type of record, and a brief description. Most of the records pertain to various renovations of the subject site. However, no permits for items such as underground structures, septic systems, building, demolition, or previous structures/features were on file for the subject site.

**TABLE V**  
**Summary of Building Department Records**

<b>Date</b>	<b>Record Type</b>	<b>Description</b>
<b>229 Castro Street</b>		
3/11/66	Building Permit	Inspection for legal exits
7/26/76	Letter	Release Construction Plans
8/17/76	Building Permit	New construction of warehouse
9/2/76	Building Permit	New construction of warehouse
9/22/76	Public easement of record	Proposed street opening
9/30/76	Electrical Permit	Clean up
10/1/76	Plumbing & Mechanical Inspection	Install gas outlets and meters and miscellaneous items
10/13/76	Electrical Permit	Remove unapproved extension cords, seal openings
7/17/77	Electrical Permit	Unknown
5/11/77	Plumbing & Mechanical Inspection	Install toilets, floor drains, and basins
1/23/77	Electrical Permit	Correction notice
5/23/77	Roofing Permit	Re-roofing and shingles
5/13/77	Electrical Permit	Wiring and code corrections
4/27/77	Building Permit	Construct ramp and stairway for building access
5/10/77	Electrical Permit	Install breakers
6/15/77	Electrical Permit	Inspect electrical outlets, fixtures, and receptacles
1/11/85	Mechanical Permit	Water heater and flues
1/24/83	Electrical Permit	Add two heaters in ceiling
11/27/85	Encroachment Application	Oakland Office of Public Works
11/20/85	Documentation of Unreasonable Hardship for Handicap Access	Explanation of construction of proposed ramp with costs and drawbacks of mandated design
11/27/85	Encroachment Application	Construct ramp and stairway for building access
12/10/85	Electrical Permit	Update / expand lighting and add receptacles
1/22/86	Letter	Explanation of ongoing business activity
1/31/86	Plumbing permit	Alter existing sinks and vents

**TABLE V (cont.)**  
**Summary of Building Department Records**

Date	Record Type	Description
3/11/86	Electrical Permit	Correction notice
3/11/86	Letter	No objections to final inspection
7/31/86	Building Permit	New partitions and walls, new electrical and windows
3/5/91	Building Permit	Dock improvement
4/18/97	Building Permit	Tenant improvement for offices in warehouse
4/18/97	Electrical Permit	Electrical improvement for offices in warehouse
4/22/87	Plumbing permit	Remove and replace furnace
4/22/87	Plumbing permit	Plumbing for new restroom
7/3/97	Plumbing permit	Gas meter request in curb for warehouse off 3 <sup>rd</sup> Street
9/28/98	Electrical Permit	New 300 Amp. Three phase service
10/16/98	Electrical Permit	Set pole off Brush Street
1/14/99	Building Permit	Voluntary seismic upgrade
<b>720 Second Street</b>		
12/17/36	Building Permit	Repair fire damage to structural steel and roof joists
1/4/65	Building Permit	Plan check for building addition
11/30/66	Building Permit	Plan check for building addition – existing warehouse
12/21/65	Building Permit	Dismantle existing steel & re-erect at new site (2 <sup>nd</sup> St.)
12/16/66	Building Permit	Plan check for building erected and inspected
5/23/68	Building Inspection -Corrections	Add mesh to existing skylights in new building addition
7/26/68	Building Inspection -Corrections	Required work has not been completed
8/12/68	Building Inspection -Corrections	Required work has not been completed

#### **Haines Criss-Cross and Polk Guide Directories**

Reasonably ascertainable HCCDs, dated 1973 through 1997, and PGDs, dated 1967 and 1969, were reviewed at the Oakland Main Library for the subject site addresses of 720 Second Street and 229 Castro Street. Also, 747 Third Street (one of the building occupied by the Port of Oakland), and 201 Castro Street (an address at the southwest corner of the subject site) were reviewed. Although PGDs dating from 1869 through 1943, 1967 and 1969 were available, only those from the years 1967 and 1969 contained reverse sections enabling the identification of an occupant of a particular address. There was no listing in the HCCDs and PGDs for 720 Second Street, 201 Castro Street, and 747 Third Street. Phoenix Iron Works is listed at 738 Second Street in the 1969 PGD. A number of business are listed as having once occupied 229 Castro Street. A summary of HCCDs/PGDs information for 229 Castro Street is presented below in Table VI.

**TABLE VI**  
**Haines Criss-Cross /Polk Guide Directory Summary**

Address	Owner/Occupant	Years
229 Castro Street	Howard C Fletcher, Co. MA Notch Corp.	1967 1969 through 1973
229 Castro Street	ESP Delivery System Newell Electric Co.	1975
229 Castro Street	D&I Delivery Service Western Packaging	1977
229 Castro Street	Arvey Paper & Supply	1979 to 1986
229 Castro Street	Arvey Paper & Supply Cary Children's Cloths	1990
229 Castro Street	All World Foods, Inc. Food Depot Inc.	1993
229 Castro Street	No listing	1996, 1997

**Sanborn Fire Insurance Maps**

Krazan typically reviews Sanborn Fire Insurance Maps (SFIMs) to evaluate prior land use at the subject site and adjacent properties. Krazan contracted with Vista Environmental Solutions, Inc. (Vista) to provide a Fire Insurance Maps Abstract indicating the availability of historic SFIMs for the subject site and adjoining properties as far back as 1867. Vista's search of collections at the Library of Congress, University Publications of America, and various public and local sources revealed coverage for the subject site and adjoining properties. The SFIM interpretation is provided in Table VII. Refer to Appendix B for a copy of the SFIMs.

**TABLE VII**  
**Summary of Sanborn Fire Insurance Maps**

Year	Site Use	Site and Adjacent Property Observation
1889	Residential/ Vacant	The subject site is depicted as being occupied by eight dwellings along Second and Third Streets with the remainder of the subject site being vacant. A water tank is depicted at one of the residences along Second Street. The adjacent properties to the east across Third Street are occupied by dwellings. To the west across Second Street is vacant land, a planing mill, and an iron works. To the south and north of the subject site are dwellings.
1902	Residential/ Commercial/ /Vacant	The subject site appears relatively unchanged from the 1889 SFIM with the exception of the addition of a feed mill and machinery depot along Brush Street, box storage along Second Street, and a store and additional residence along Third Street. The adjacent properties appear relatively unchanged from the 1889 SFIM with the exception of the properties to the west, where the planing mill is no longer depicted.



**TABLE VII (cont.)**  
**Summary of Sanborn Fire Insurance Maps**

Year	Site Use	Site and Adjacent Property Observation
1912	Residential/ Commercial /Vacant	The subject site appears similar as shown on the 1902 SFIM with the exception that some of the parcels used for commercial purposes are now labeled as storage. The parcel at the northeast corner of the subject site is labeled as "junk". Western Pacific Rail Road tracks are depicted within Third Street and the area east of Third Street is not depicted on this SFIM. The southern half of the city block, located west across Second Street, is now occupied by Phoenix Iron Works. The northern portion of this city block is occupied by a box company and another iron works. The parcels to the south are occupied by residences and a lumber yard.
1951	Industrial	The southern one third of the subject site is depicted with a structure that corresponds in size and shape to the structure present at the site during our reconnaissance. This structure is labeled as "poultry warehouse and packaging". The northern two thirds of the subject site is occupied by Phoenix Iron Work with several structures labeled as "storage" with the northern portion labeled as "storage yard". The area to the east of the subject site is not depicted on the map. The area to the west appears similar as observed in the 1912 SFIM except there is now a furniture company and warehouse on the northern portion. The property to the south is occupied by structure labeled as "bottle washing" and "rag storage".
1952, 1957, 1958, 1961	Industrial	The subject site and adjacent properties are depicted similarly as shown in the 1951 SFIM, except that the warehouse on the southern one third of the subject site is labeled as "plumbing and brass warehouse" in the 1961 SFIM.
1967, 1970	Industrial	The subject site and adjacent properties are depicted similarly as shown in the 1961 SFIM, except that the buildings formerly located on the northern two thirds of the subject site have been changed. The structures correspond in size and shape to the structures present at the site during our reconnaissance. The two structures are labeled as "machine shop" and "foundry material storage". A paint dip tank and iron drying rack are depicted on the eastern side of the buildings.

**Phase I Environmental Site Assessment Interview**

On January 27, 2000, a Phase I ESA Interview regarding the history of the northern two thirds of the subject site was conducted with Mr. Bill Edwards and Mr. John Stewart of the Port of Oakland. Mr. Edwards and Mr. Stewart have been with the Port of Oakland and familiar with the northern two thirds of the subject site for the past 12 and 20 years, respectively. No persons knowledgeable about the operation of the southern one third of the subject site were available for interview.

According to Mr. Edwards and Mr. Stewart, to the best of their knowledge, no on-site treatment and/or discharge of waste; no on-site leach fields, dry wells, sumps, or disposal ponds; no disposal of hazardous materials; no existing or former ASTs or USTs; no hazardous materials spills; no buried materials; no

monitoring, domestic, or irrigation wells; or any items of environmental concern are associated with the subject site.

## **5.2 Agricultural Chemicals**

Review of historical aerial photographs and Sanborn Fire Insurance Maps reveals that the subject site has not been used for agricultural purposes since at least 1889. Based upon this information, it is not anticipated that elevated concentrations of environmentally-persistent pesticides would be found in the near-surface soils of the subject site.

## **5.3 Local Regulatory Agency Interface**

A review of local regulatory agency records was conducted to help determine if hazardous materials have been handled, stored, or generated on the subject site and/or the adjacent properties and businesses.

### **Alameda County of Environmental Health Department**

Ms. Carrie Colin, Hazardous Materials Files Specialist with the Alameda County Environmental Health Department (ACEHD), indicated that no records are on file for the subject site addresses of 229 Castro Street or 720 Second Street.

### **Oakland Fire Department**

On January 28, 2000, Mr. Vibhor Jain, Hazardous Materials File Specialist for the Oakland Fire Department (OFD), was contacted. The Oakland Fire Department has jurisdiction for the fire protection for the subject site and the immediate vicinity. According to Mr. Jain, a Hazardous Materials Business Plan and Contingency Plan exists for the Port of Oakland Harbor Facilities Corporate Yard at 720 Second Street. Krazan obtained a copy of this hazardous materials business plan and it is included in Appendix A of this ESA report.

### **Regional Water Quality Control Board**

According to Ms. Cristina Abbott of the Regional Water Quality Control Board (RWQCB), there are no files in existence for the subject site or the LUST locations in the surrounding site vicinity.

## **5.4 Regulatory Agency Lists Review**

Several agencies have published documents that list businesses or properties which have handled hazardous materials or waste or may have experienced site contamination. The lists consulted in the course of this assessment were compiled by Vista and Krazan, and represent reasonably ascertainable current listings. Krazan did not verify the locations and distances of every property listed by VISTA.

Krazan verified location and distances of the properties deemed as having the potential to pose an environmental impact to the subject site. The actual location of the listed properties may differ from the VISTA listing. Table VIII summarizes the listed properties located within the ASTM Search Radii. The actual distances of the listed properties summarized in Table VIII are based on observations during Krazan's site reconnaissance. No unmapped (orphan) properties were determined to be located within the search radii specified for each of the following lists. General information for the Regulatory Agency Lists reviewed, the Regional Map, and the VISTA report, are included in Appendix C.

**TABLE VII**  
**Listed Properties**

List Name	List Date	Distance from site (miles)				
		Subject Site	Adj	Adj-¼	¼-½	½-1
US EPA CERCLIS	10/99	0	0	2	3	NS
US EPA CORRACTS (TSD)	9/99	0	0	2	0	2
US EPA ERNS	8/99	0	1	NS	NS	NS
US EPA Liens List	10/91 & 7/92	0	0	0	0	0
US EPA NPL	12/99	0	0	0	0	1
US EPA TRIS	1/98	0	0	0	NS	NS
US EPA RCRA-LG	9/99	0	0	1	NS	NS
US EPA RCRA-SG	9/99	0	0	6	NS	NS
US EPA RCRA TSD	9/99	0	0	0	0	NS
US EPA RCRAVIOL	9/99	0	0	3	NS	NS
Cal-EPA AWP (SPL)	10/99	0	0	0	0	4
Cal-EPA CalSites (SCL)	10/99	0	0	3	5	NS
Cal-EPA RDR List	6/94	0	0	0	0	0
Cal-EPA LUSTIS	10/99	0	0	20	30	NS
SWRCB AST	12/98	0	0	NS	NS	NS
SWRCB UST	4/99	0	2	23	NS	NS
RWQCB SLIC	11/99	0	0	2	2	NS
IWMB SWIS/SWLF	11/99	0	0	0	0	NS
State Cortese	4/98	0	0	11	8	NS
Munger Map Book	1999	0	0	0	0	NS

0 = No sites in radius identified

NS = Not Searched

Adj. = Adjacent Sites

The subject site was not listed on any of the databases that were searched. There are approximately 60 facilities with reported releases of hazardous materials to the subsurface located within a 1-mile radius of the subject site. In general, only potentially hazardous materials released from facilities located approximately up-gradient and within a few hundred feet of the site, or in a cross-gradient direction close to the site, were judged to have a reasonable potential of migrating to the site. This judgment is based on the assumption that materials generally do not migrate large distances laterally within the soil, but rather tend to migrate with groundwater in the general direction of groundwater flow. Based on available information, the groundwater flow direction in the vicinity of the subject site is south-southwest, toward the Oakland Inner Harbor. Of the 60 facilities with reported releases of hazardous materials, 57 are

located down- to cross-gradient from the subject site or are located sufficiently distant from the site so as to have a low likelihood of impacting the subject site. Of the three remaining facilities, one has achieved "no further action" status from the regulatory agency and is, therefore, not anticipated to impact the subject site. Information for the remaining two facilities was reviewed at the Oakland Fire Department and Alameda County Health Department and are discussed below.

Guarantee Forklift      300 feet northeast  
699 Fourth Street

In 1991 a 500-gallon tank was removed from under the sidewalk that is next to Fourth Street boundary of the Guarantee Forklift site in Oakland, California. Before removal, the gasoline tank had been emptied. It was thought that the tank might be in poor condition as it had been in service for 35 years. As the soil was excavated from on top of and around the tank, a number of holes were discovered that were about the diameter of a quarter dollar coin. The steel tank was badly corroded and there was a distinct odor of gasoline. Two soil samples were taken and sent to a laboratory for analyses. The soil that had been excavated was placed on a plastic sheet and also was covered with an additional sheet. The soil sample taken under the fill end of the tank contained 83,000 parts per million (ppm) Total Petroleum Hydrocarbon-Gasoline (TPHg) and 150 ppm benzene. The soil samples from the stockpiled soil contained 1,000 ppm TPHg and 200 ppm benzene. It was recommended at the time to perform additional excavation. A strong petroleum smell persisted until the UST excavation reached 12.5-feet below the ground surface, which was the depth to groundwater. Confirmation soil samples were collected and the excavation was then backfilled with clean fill. The contaminated soil was piled on plastic sheeting and soil samples were taken. Analyses revealed high levels of TPHg and benzene. The highest values were encountered in the south wall with 5,500 ppm TPHg and 41 ppm benzene. The soil pile values were 1,200 ppm TPHg and 6 ppm benzene. It was recommended that additional excavation not be performed as the worst of the soil contamination has been removed, the source of the contamination had been removed, and the high proportion of remaining pollution is under a building on the site. On June 28, 1993, the ACEHD asked Guarantee Fork Lift to begin a Workplan for a groundwater investigation of the 699 Fourth Street locale. They recommended that a minimum of three ground water monitoring wells be developed and that quarterly sampling and reporting commence. On April 4, 1996, Alameda County Environmental Department sent a letter to Guarantee Forklift detailing the minimum steps needed to complete for site closure. On, July 25, 1997, Toxic Technology Services prepared a Workplan for remediation of the site and the plan was accepted by ACEHD on August 11, 1997. No further information was present in the file for this facility. Due to its close proximity, this property has a potential to impact the groundwater underlying the subject site due to the presence of contamination. However, if contamination attributable to this property does migrate beneath the subject site, the expense and/or liability associated with the investigation and remediation would typically fall upon the responsible party (i.e., the owner of Guarantee Fork Lift).

Shell Service Station  
610 Market Street

600 feet north

In August 1995, Weiss Associates (WA) collected soil samples beneath the gasoline dispensers and product piping locations during station renovation. Renovation activities included replacing the gasoline dispensers and product piping. Up to 2,700 ppm TPHg and 0.70 ppm benzene were detected in soil samples collected beneath the center dispenser island. About 48 cubic yards of soil were excavated during renovation activities. Weiss Associates collected 12 initial and six confirmation soil samples. One sample each was collected from beneath each removed dispenser and one each from beneath the removed product lines. The confirmation samples were collected

from areas of soil staining and over-excavation. Soil samples for product lines were collected from 2.5 feet below ground surface (bgs), while confirmation over-excavation samples were collected from up to five feet bgs. TPHg was detected at greater than 1,000 ppm from three of the confirmation soil samples. Cambria Environmental Technology, Inc. (Cambria) conducted a subsurface investigation of the 610 Market Street on July 1, 1998 to determine the extent of hydrocarbon contamination of soils and groundwater beneath the site. Cambria installed three soil borings; one east of the pump island (SB-C), one south of the pump island (SB-A), and one west of the pump island (SB-B). One soil and one groundwater sample was collected from each boring. Less than two ppm TPHg, BTEX, and MTBE were detected in the soil samples from the three borings. Maximum concentrations in groundwater included 2,100 parts per billion (ppb) TPHg, 90 ppb benzene, and 14,000 ppb MTBE. On August 3, 1998, the ACEHD requested an investigation of the site to determine the extent of subsurface hydrocarbon contamination and Cambria proposed installing three groundwater monitoring wells on site. Those wells were drilled on November 17, 1998. Routine quarterly groundwater sampling was begun. Groundwater flow direction was south-southwest. Analyses of groundwater samples detected maximum concentrations of 30,000 ppb TPHg, 890 ppb benzene, and 42,500 ppb MTBE. Concentrations of TPHg, benzene, and MTBE in the groundwater had dropped dramatically during the December 1999 sampling event. Based on the distance of this facility to the subject site and the low concentrations of petroleum hydrocarbons, this property is not anticipated to pose an adverse impact to the subject site.

## 6.0 CONCLUSIONS

Krazan has conducted a Phase I ESA of the subject site in conformance with the scope and limitations of the ASTM E1527-97 *Standard Practice for Environmental Site Assessments: Phase I Environmental Site Assessment Process*. Any exceptions to or deletions from this practice were previously described in this report. This assessment has revealed no evidence of recognized environmental conditions in connection with the subject site with the exception of the following.

- Evidence of an underground storage tank in the form of a fill port and vent pipe were observed near the north side of the warehouse at 229 Castro Street. No information pertaining to the underground storage tank was present in the regulatory agency files. The potential exists for the subsurface of the site to be impacted from releases of hazardous materials from the underground storage tank.
- The western two thirds of the subject site was occupied by Phoenix Iron Works (PIW) from at least 1951 to approximately 1972, when the Port of Oakland acquired the subject site. The Oakland Fire Department and the Alameda County Environmental Health Service did not have information pertaining to the operation of the PIW. However, Sanborn Fire Insurance Maps (SFIMs) depict welding, pattern storage, foundry storage, flask yard and other uses by PIW. The 1967 and 1970 SFIMs depict a paint dip tank and drying rack on the north side of the main structure. Given the former existence of this paint dip tank and the long history of industrial use of the northern two thirds of the subject site, the potential exists for the subsurface to have been impacted by hazardous materials. Additionally, approximately two to five feet of fill material is present in the area of the subject site. The nature of the fill material is not known, and based on investigations of other properties in the vicinity of the subject site, the potential exists for the fill materials to be impacted by hazardous materials.

## 7.0 LIMITATIONS


This reconnaissance and review of the subject site has been limited in scope. This type of investigation is undertaken with the calculated risk that the presence, full nature, and extent of contamination would not be revealed by visual observation alone. Although a thorough site reconnaissance was conducted in accordance with ASTM Guidelines and employing a professional standard of care, no warranty is given, either expressed or implied, that hazardous material contamination or buried structures, which would not have been disclosed through this investigation, do not exist at the subject site. Therefore, the data obtained are clear and accurate only to the degree implied by the sources and methods used.

The findings presented in this report were based upon field observations during a single property visit, review of available data, and discussions with local regulatory and advisory agencies. Observations describe only the conditions present at the time of this investigation. The data reviewed and observations made are limited to accessible areas and currently available records searched. Krazan cannot guarantee the completeness or accuracy of the regulatory agency records reviewed. Additionally, in evaluating the property, Krazan has relied in good faith upon representations and information provided by individuals noted in the report with respect to present operations and existing property conditions, and the historic uses of the property. It must also be understood that changing circumstances in the property usage, proposed property usage, subject site zoning, and changes in the environmental status of the other nearby properties can alter the validity of conclusions and information contained in this report. Therefore, the data obtained are clear and accurate only to the degree implied by the sources and methods used.

This report is provided for the exclusive use of the client noted on the cover page and shall be subject to the terms and conditions in the applicable contract between the client and Krazan. Any third party use of this report, including use by Client's lender, shall also be subject to the terms and conditions governing the work in the contract between the client and Krazan. The unauthorized use of, reliance on, or release of the information contained in this report without the expressed written consent of Krazan is strictly prohibited and will be without risk or liability to Krazan.

Conclusions and recommendations contained in this report are based on the evaluation of information made available during the course of this assessment. It is not warranted that such data cannot be superseded by future environmental, legal, geotechnical or technical developments.

If you have any questions or if we can be of further assistance, please do not hesitate to contact our office at (408) 271-2200.

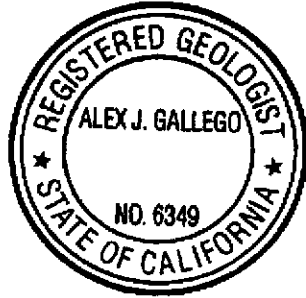

Respectfully submitted,  
KRAZAN & ASSOCIATES, INC.

A handwritten signature in black ink that reads "Alex J. Gallego".

Alex J. Gallego, RG 6349  
Environmental Department Manager  
San Francisco Bay Area Operations




A handwritten signature in black ink that reads "Dean Alexander".


Dean Alexander  
Principal Engineer  
RGE #002051/RCE #34274

AJG/DA/ag

8c: herewith

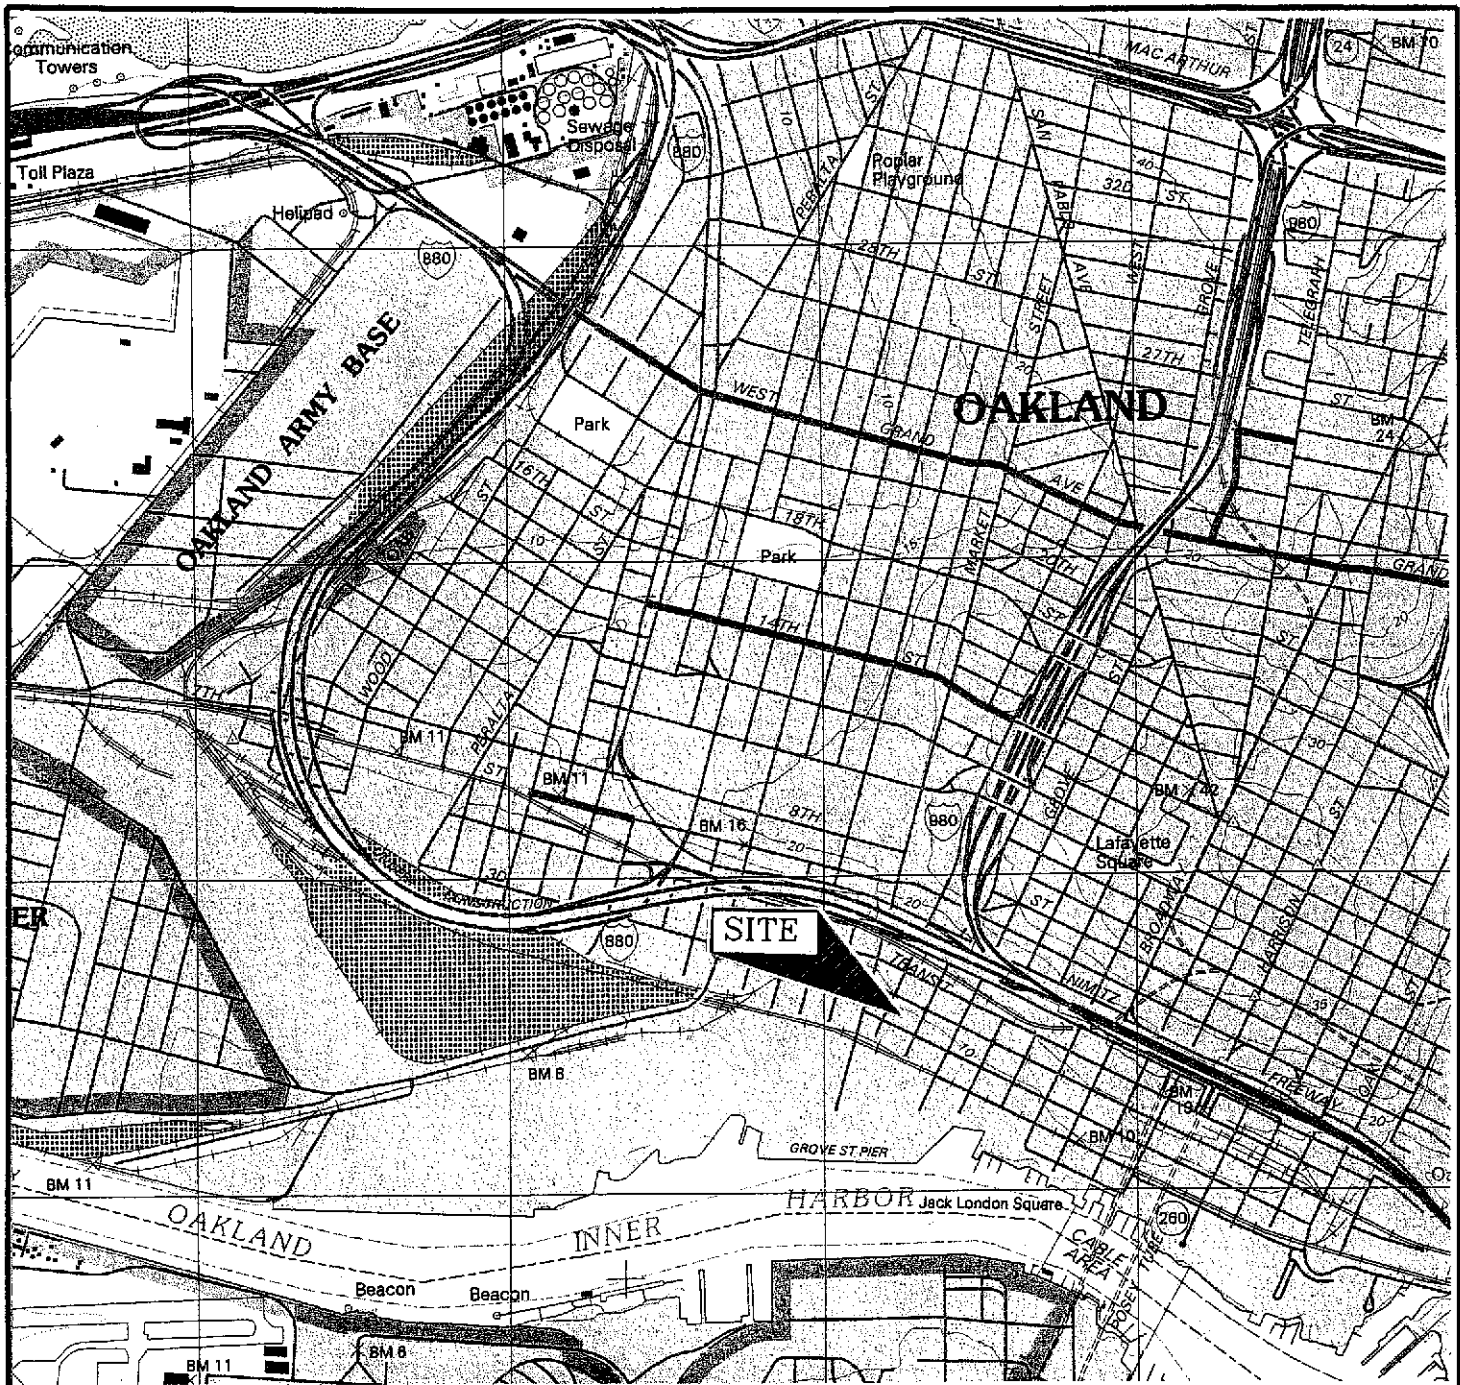

MAP SOURCE:  
 USGS QUADRANGLE, 7.5-MINUTE (TOPOGRAPHIC)  
 OAKLAND WEST (DATED 1993)




<b>VICINITY MAP</b>  City Block Bound By: Second, Third, Castro, & Brush Streets Oakland, California	Scale:	Date:	 <b>Krazan</b> ENGINEERS, GEOLOGISTS AND ENVIRONMENTAL SPECIALISTS <i>Offices Serving the Western United States</i>
	AS SHOWN	2/00	
	Drawn by:	Approved by:	
	AJG	AJG	
Project No.	Figure No.		
044-00006	1		



BRUSH STREET

Approximate Property Boundary

SECOND STREET

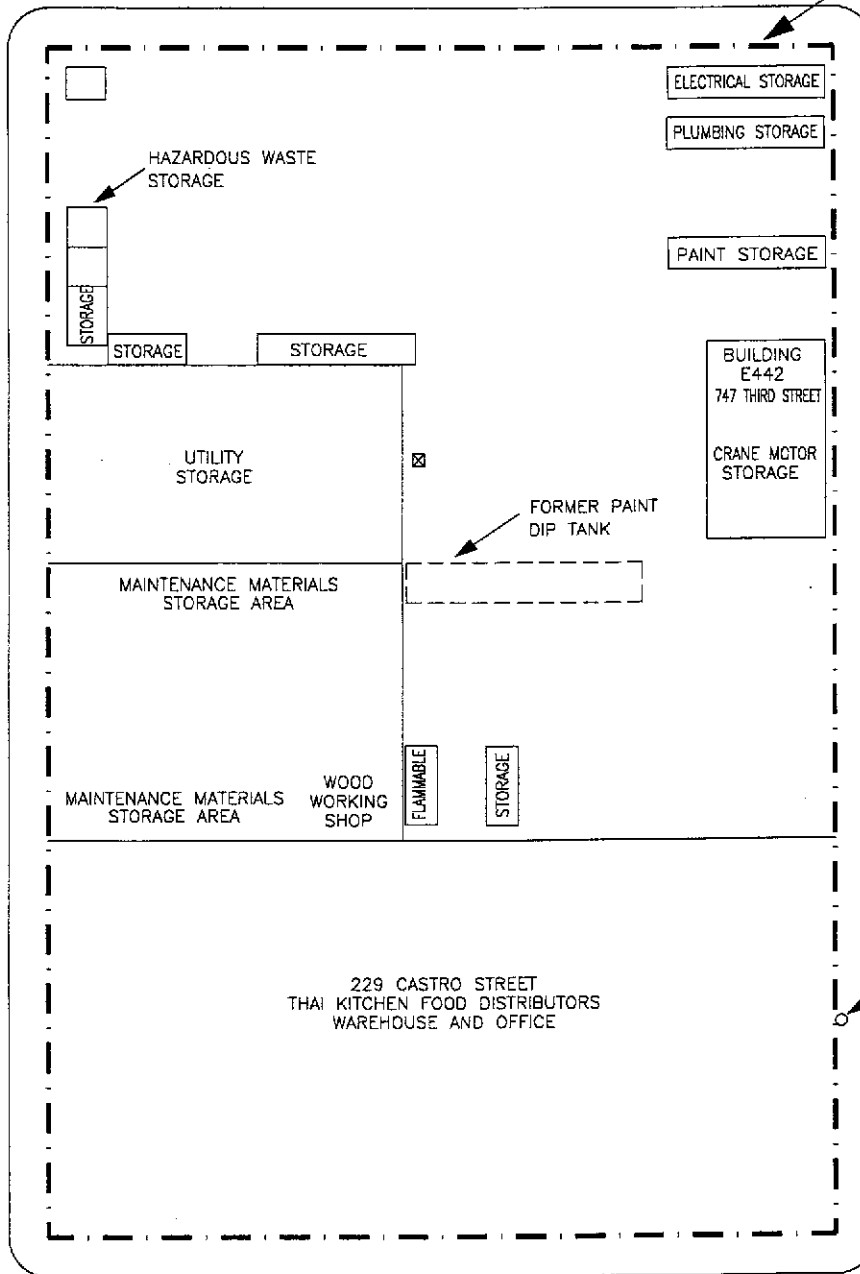


THIRD STREET

CASTRO STREET

EXPLANATION

☒ STORM DRAIN



NOTES:

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE
2. BASE MAP FROM FIELD MEASUREMENTS AND SANBORN MAPS

SITE MAP

City Block Bound By:  
Second, Third, Castro, &  
Brush Streets  
Oakland, California

Scale: AS SHOWN	Date: 02/00
Drawn by: AJG	Approved by: AJG
Project No. 044-00006	Figure No. 2

**Krazan**  
ENGINEERS, GEOLOGISTS AND ENVIRONMENTAL SPECIALISTS  
Offices Serving the Western United States



Photo 1: View of the interior office area of Thai Kitchen at 229 Castro Street.



Photo 2: View of packaged food storage in the warehouse of Thai Kitchen.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG

 **Krazan**



Photo 3: View of miscellaneous storage in the southwest corner of the warehouse of Thai Kitchen.



Photo 4: View of vent pipe located on the north side of the warehouse of Thai Kitchen.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG







Photo 5: View of duct wrapping on the second floor of the office area of Thai Kitchen.



Photo 6: View to the south of the entrance to the Port of Oakland parcel at 720 Second Street. Note small building at right and hazardous waste accumulation area at left.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG





Photo 7: View of hazardous waste accumulation area.



Photo 8: View of the interior of the hazardous waste accumulation area.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG





Photo 9: View to the east of the central portion of the Port of Oakland parcel.



Photo 10: View to the south of eastern portion of Building E417. Note Flammable storage locker at left.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG







Photo 11: View of the interior of the wood working shop. Note flammable cabinet at bottom right.



Photo 12: View of the waste transfer area at the northeast corner of the Port of Oakland parcel.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG





Photo 13: View of the interior of the western portion of Building E417.



Photo 14: View to the northeast of Building E422.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG







Photo 15: View of the interior of Building E422 showing crane parts storage.



Photo 16: View of the interior of the paint storage locker.

229 Castro Street and  
720 Second Street  
Oakland, California

Project No. 044-00006

Date: February, 2000

Approved by: AJG

 Krazan

---

**HAZARDOUS MATERIALS BUSINESS PLAN  
AND CONTINGENCY PLAN  
FOR  
HARBOR FACILITIES DEPARTMENT CORPORATION YARD  
777 THIRD STREET AND 720 SECOND STREET  
94607  
Oakland, California**

*Prepared for:*  
Port of Oakland  
Environmental Department  
530 Water Street  
Oakland, CA, 94607

by  
BASELINE ENVIRONMENTAL CONSULTING  
5900 Hollis Street, Suite D  
Emeryville, California 94608  
November 1992



**PORT OF OAKLAND**

**Rachel B. Hess**  
*Assistant Port Environmental  
Scientist*

*Environmental Health & Safety  
Compliance*

530 Water Street  
Oakland, California 94607  
(510) 272-1134  
Fax (510) 451-5916


*Rewritten/Updated by:*  
Port of Oakland  
Engineering Division  
Environmental Health & Safety Compliance  
June, 1997



# PORT OF OAKLAND

June 30, 1997

Mr. Leroy Griffin  
Supervisor, Hazardous Materials Program  
City of Oakland  
Fire Services Agency  
505 Fourteenth Street, Suite 702  
Oakland, CA 94612

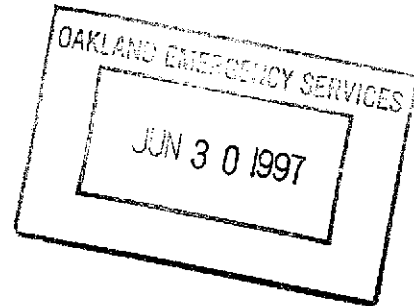

RE: 1997 Submittal of Hazardous Materials Business Plans for the Port of Oakland's Harbor Facilities Department and Harbor Facilities Corporate Yard

Dear Mr. Griffin:

The Port of Oakland is pleased to provide you with a copy of the following documents for your review:


"Hazardous Materials Business Plan and Contingency Plan for Harbor Facilities Department at 205 Brush Street, 209 Brush Street, 773 Third Street, 775 Third Street, and 234 Market Street"

"Hazardous Materials Business Plan and Contingency Plan for Harbor Facilities Department Corporation Yard at 777 Third Street and 720 Second Street"


This submittal is in compliance with your office's request for submission of the "Harbor Facility Garage E412" (part of the Harbor Facilities Department) HMBP by July 1, 1997. Because the two facilities are utilized as one by the Port, the documents were prepared and are submitted together. If you have any questions or comments regarding the above documents, please contact Rachel Hess at (510) 272-1134.

Mark O'Brien  
Manager Environmental Health & Safety Compliance

cc: Rachel Hess, Assistant Port Environmental Scientist  
Neil Werner, Supervisor Environmental Health & Safety Compliance



# PORT OF OAKLAND

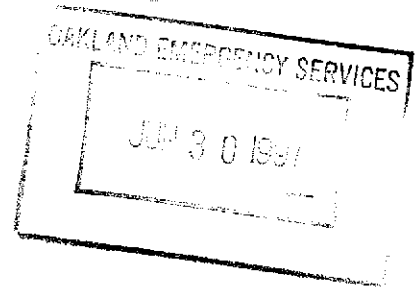

June 30, 1997

Mr. Leroy Griffin  
Supervisor, Hazardous Materials Program  
City of Oakland  
Fire Services Agency  
505 Fourteenth Street, Suite 702  
Oakland, CA 94612

RE: 1997 Submittal of Hazardous Materials Business Plans for the Port of Oakland's  
Harbor Facilities Department and Harbor Facilities Corporate Yard

Dear Mr. Griffin:

The Port of Oakland is pleased to provide you with a copy of the following documents  
for your review:

"Hazardous Materials Business Plan and Contingency Plan for Harbor Facilities  
Department at 205 Brush Street, 209 Brush Street, 773 Third Street, 775 Third  
Street, and 234 Market Street"

"Hazardous Materials Business Plan and Contingency Plan for Harbor Facilities  
Department Corporation Yard at 777 Third Street and 720 Second Street"

This submittal is in compliance with your office's request for submission of the "Harbor  
Facility Garage E412" (part of the Harbor Facilities Department) HMBP by July 1, 1997.  
Because the two facilities are utilized as one by the Port, the documents were prepared  
and are submitted together. If you have any questions or comments regarding the above  
documents, please contact Rachel Hess at (510) 272-1134.

Mark O'Brien  
Manager Environmental Health & Safety Compliance

cc: Rachel Hess, Assistant Port Environmental Scientist  
Neil Werner, Supervisor Environmental Health & Safety Compliance

---

**HAZARDOUS MATERIALS BUSINESS PLAN  
AND CONTINGENCY PLAN  
FOR  
HARBOR FACILITIES DEPARTMENT CORPORATION YARD  
777 THIRD STREET AND 720 SECOND STREET  
Oakland, California**

*Prepared for:*  
Port of Oakland  
Environmental Department  
530 Water Street  
Oakland, CA, 94607

by  
BASELINE ENVIRONMENTAL CONSULTING  
5900 Hollis Street, Suite D  
Emeryville, California 94608  
November 1992

*Rewritten/Updated by:*  
Port of Oakland  
Engineering Division  
Environmental Health & Safety Compliance  
June, 1997

**SITE INFORMATION**

---

**Location:** 777 Third Street, and 720 Second Street  
Oakland, California

**A. Business Name and Mailing Address:** **B. Business Phone:** (510) 272-1100  
Port of Oakland  
Environmental Health and Safety Compliance Department  
530 Water Street  
Oakland, CA 94607-2064

**C. Owner:** Port of Oakland **D. SIC Code:** 9199

**E. Site Address(es):** **F. Nature of Business:**  
777 Third Street Corporation Yard for Harbor Facilities  
720 Second Street Departments  
Oakland, CA 94607

<b>G. PORT Emergency Coordinator:</b>	<b>Phone Numbers</b>	
	<b>Business</b>	<b>Non-business</b>
<b>Primary:</b>		
<i>Mark O'Brien, Manager</i>		Pager
Environmental Health and Safety Compliance	(510) 272-1538	(510) 678-3815
<i>Neil Werner, Supervisor</i>		
Environmental Health and Safety Compliance	(510) 272-1176	(510) 522-4022
<i>Jeff Jones, Certified Industrial Hygienist</i>		Pager
Environmental Health and Safety Compliance	(510) 272-1360	(510) 720-2608
or		
<i>Nancy Humphrey, Principal Safety Administrator</i>	(510) 272-1554	

Alternate:

*Bill Thompson*, Central Facilities Engineer  
Facilities Department

(510) 272-1409

(510) 881-4831

Pager: (510) 678-3385

H. Number of Employees: 42

I. Site Area:

(most employees are off-site during business hours)

I certify that the information contained in this business plan is accurate, that the plan meets the requirements of Chapter 6.95 (Section 25500 et.seq.) of the Health and Safety Code, that amendments and revisions to it will be submitted in accordance with that Chapter, and that I am authorized to make this certification on behalf of the above-named business.

Signature *Bill Werner*

Title *Supervisor*

Date *6/27/97*

Alternate:

*Bill Thompson*, Central Facilities Engineer  
Facilities Department

(510) 272-1409

(510) 881-4831

Pager: (510) 678-3385

**H. Number of Employees:** 42

**I. Site Area:**

(most employees are off-site during business hours)

*(Most employees are off-site during business hours)*

I certify that the information contained in this business plan is accurate, that the plan meets the requirements of Chapter 6.95 (Section 25500 et.seq.) of the Health and Safety Code, that amendments and revisions to it will be submitted in accordance with that Chapter, and that I am authorized to make this certification on behalf of the above-named business.

Signature \_\_\_\_\_ Title \_\_\_\_\_ Date \_\_\_\_\_



## TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
1.0 INTRODUCTION.....	1
2.0 PROPERTY DESCRIPTION.....	2
2.1 Building E-417.....	5
2.2 Building E-422.....	5
2.3 Storage Shed and Former Guard Shack.....	5
2.4 Truck Bed Containers.....	5
2.5 Hazardous Waste Accumulation Area (HWAA).....	5
2.6 Storm Drainage.....	9
2.7 Fire Hydrants.....	9
2.8 Property Security.....	9
2.9 Users or Generators of Hazardous Materials.....	9
3.0 CHEMICAL INVENTORY.....	11
4.0 CONTINGENCY PLAN.....	12
4.1 PORT Emergency Coordinator.....	12
4.2 Emergency Response Agencies.....	13
4.3 Chain of Command.....	14
4.4 Locations of Emergency Equipment.....	15
5.0 PREPAREDNESS AND PREVENTION MEASURES.....	19
5.1 Training.....	19
5.2 Spill Cleanup Contractors.....	20
5.3 Emergency Equipment.....	20
5.4 Alarm Systems.....	20
5.5 Aisle Spaces.....	21
5.6 Plan Updates and Distribution.....	21
6.0 DEFINITION OF RESPONSIBILITIES.....	23
6.1 PORT Facilities Department.....	23
6.1.1 Management.....	23
6.1.2 Harbor Facilities Supervising Engineer.....	23
6.1.3 Supervisors/Foremen.....	24

6.1.4 Employees Using or Handling Hazardous Materials .....24  
6.2 PORT Construction Department .....25  
6.3 PORT Environmental Health and Safety Compliance Department.....25  
6.4 PORT Safety Administrator .....26

**LIST OF FIGURES**

- 1: Harbor Facilities Corporation Yard Regional Location
- 2: Adjacent Land Uses
- 3: Second Street Corporation Yard: Buildings E-417 and E-422
- 4: Building E-417 First Floor Plan
- 5: Building E-417 Second Floor Plan

## LIST OF TABLES

- 1: Users and Generators and Locations of Hazardous Materials
- 2: Notification Requirements in a Hazardous Materials Emergency
- 3: Plan Distribution List

## APPENDICES

- Appendix A California Hazardous Material Inventory Reporting Form: Business & Owner/Operator Identification Page
- Appendix B California Hazardous Material Inventory Reporting Form/Addendum: Chemical Description Pages
- Appendix C Emergency Numbers and Hazardous Materials Emergency Response Procedures
- Appendix D Emergency Notification Log Form
- Appendix E Safe Area and Building Egress Routes, Evacuation Routes
- Appendix F Complete Inventory of Hazardous and Non-Hazardous Material Stored at E-417

## 1.0 INTRODUCTION

Pursuant to requirements of the California Health and Safety Code, Chapter 6.95, Section 25500 *et seq.*, this Hazardous Materials Business Plan and Contingency Plan (Plan) has been updated for the PORT property located at 777 Third Street and 720 Second Street in Oakland, California. The property is occupied by the PORT's Corporation Yard for the Harbor Facilities Departments. The purpose of the Plan is to provide property personnel and emergency first responders with the necessary information for a prompt and effective response to an emergency involving a release (or threatened release) of hazardous materials.<sup>1</sup> This Plan contains the Owner/Operator Identification page (Appendix A) and the Chemical Description page for reportable quantities of hazardous materials stored on site (Appendix B). Annotated site maps showing hazardous materials storage areas (Figures 3 through 5) are presented in Section 2.0. This Plan also contains descriptions of the emergency response procedures and notification (Appendices C and D, respectively), the evacuation plan (Section 4.0 and Appendix E), the preparedness and prevention measures (Section 5.0) to minimize impacts of any emergencies, and definition of personnel responsibilities (Section 6.0). The complete inventory of hazardous and non-hazardous materials stored at the property is provided in Appendix F. Room numbers and codes on the complete inventory lists also correspond to those locations identified in Figures 3 through 5. The Plan was prepared in accordance with guidelines from the City of Oakland Fire Services Agency.

---

<sup>1</sup> A release is defined as any spilling,, leaking,, pumping,, pouring,, emitting,, emptying,, discharging, injecting,, escaping, leaching,, dumping, or disposing into the environment that is not authorized or permitted by a regulatory agency.



## 2.0 PROPERTY DESCRIPTION

The property is located approximately one-quarter of a mile north of the Oakland Estuary (Figure 1). It constitutes the major portion of the city block bordered to the northeast by Third Street, to the northwest by Brush Street, to the southwest by Second Street, and to the southeast by Castro Street<sup>2</sup> (Figure 2). The land uses in the vicinity of the property are predominately industrial and commercial (Figure 2). The nearest residential area is approximately one-quarter of a mile northwest of the property. The prevailing wind direction in the property vicinity is generally from the west.


The property is operated as a corporation yard and contains two buildings (E-417 and E-422), a storage shed, a former guard shack, six truck bed containers used for storage, a hazardous waste accumulation area, and a yard area (Figure 2). The property is fenced and covered with an asphalt surface. The corporation yard is used by the PORT Harbor Facilities Section of the PORT Facilities Department for general and utilities maintenance operations and storage of equipment, parts, supplies, and hazardous materials.

---

<sup>2</sup> The parcel located at the corner of Third and Brush streets (751 Third Street and 225 and 229 Brush Street) is not owned or operated by the Port and is not covered under this Plan.

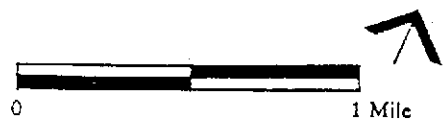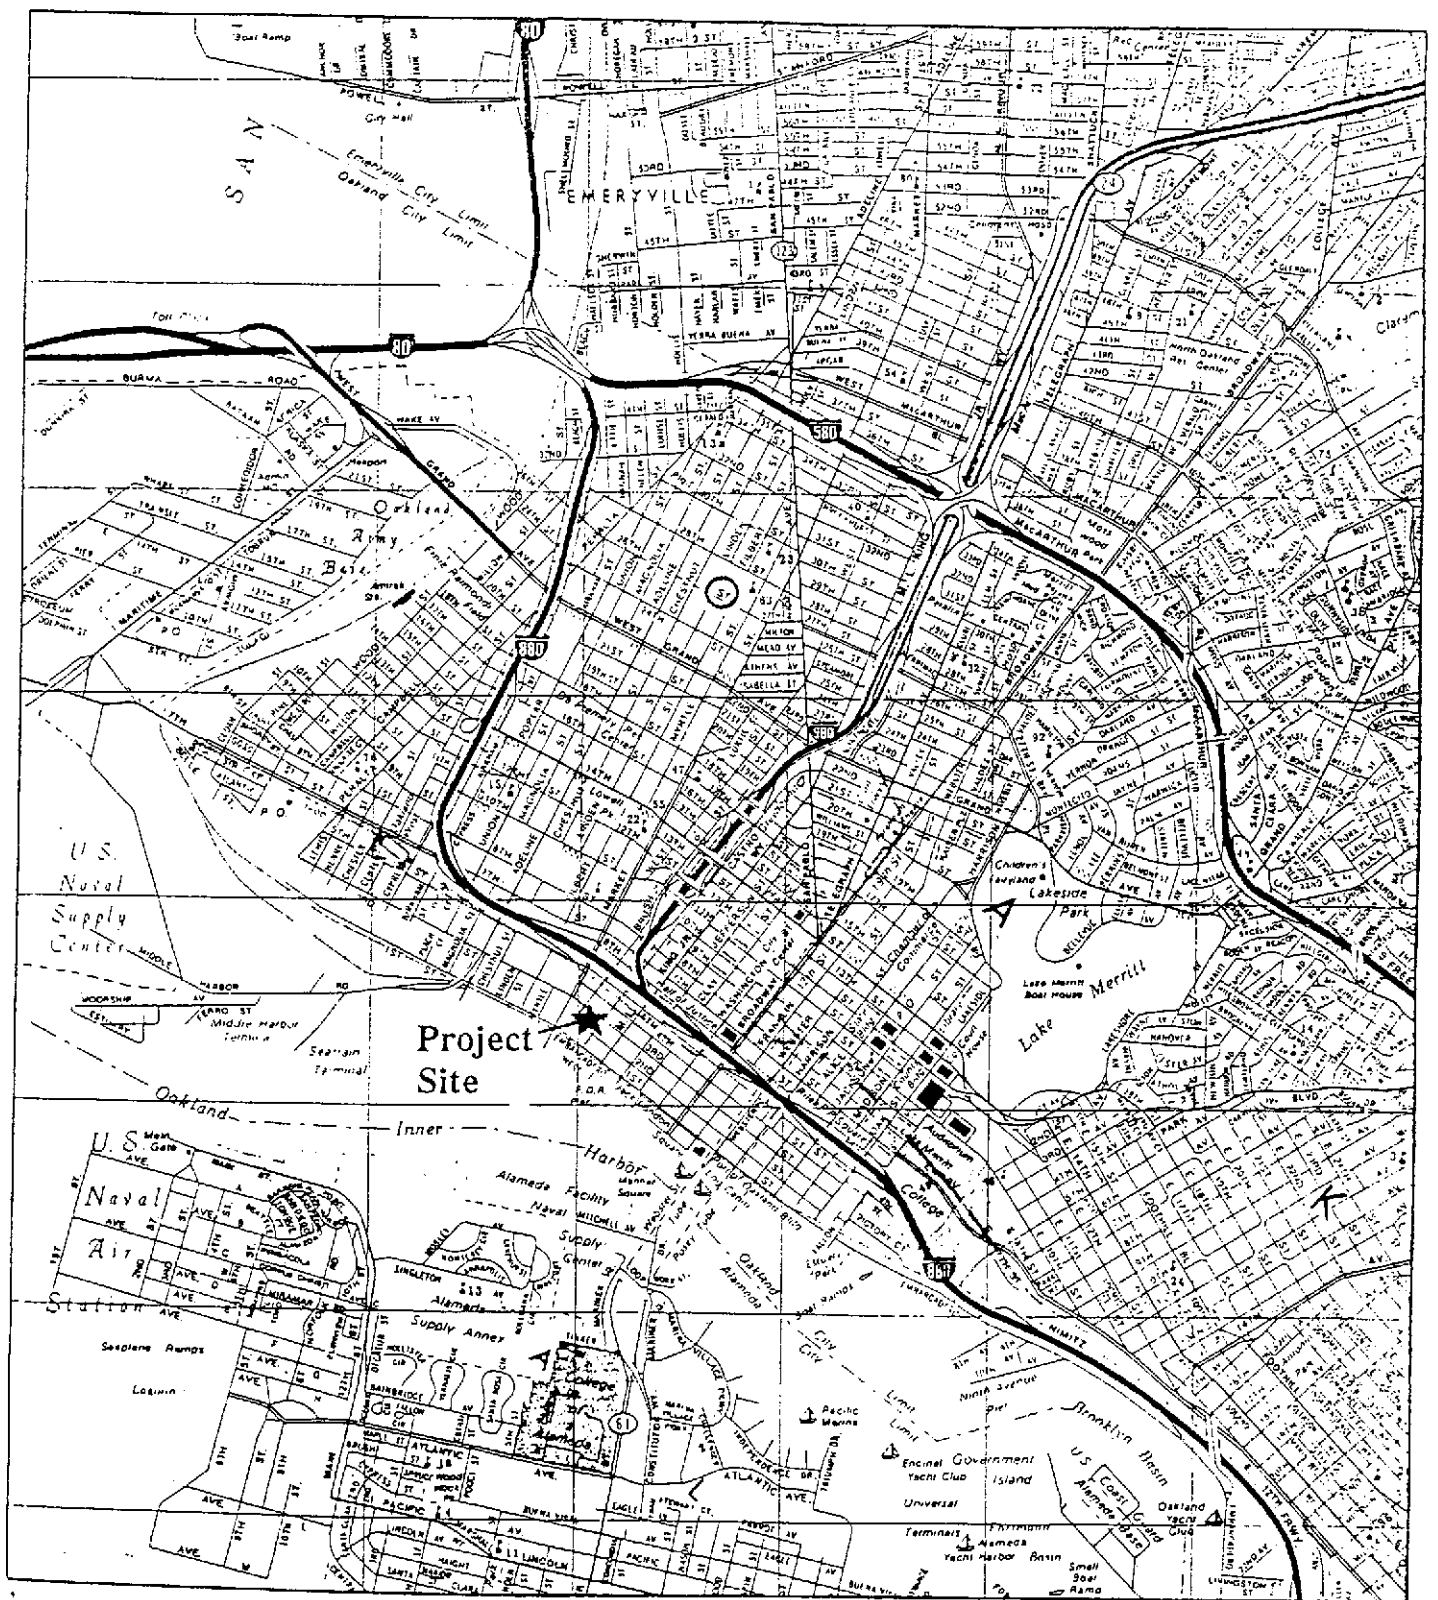

**Figure 1**  
**Harbor Facilities Corporation Yard Regional Location**  
**777 Third Street and 720 Second Street**  
**Port of Oakland, Oakland, California**

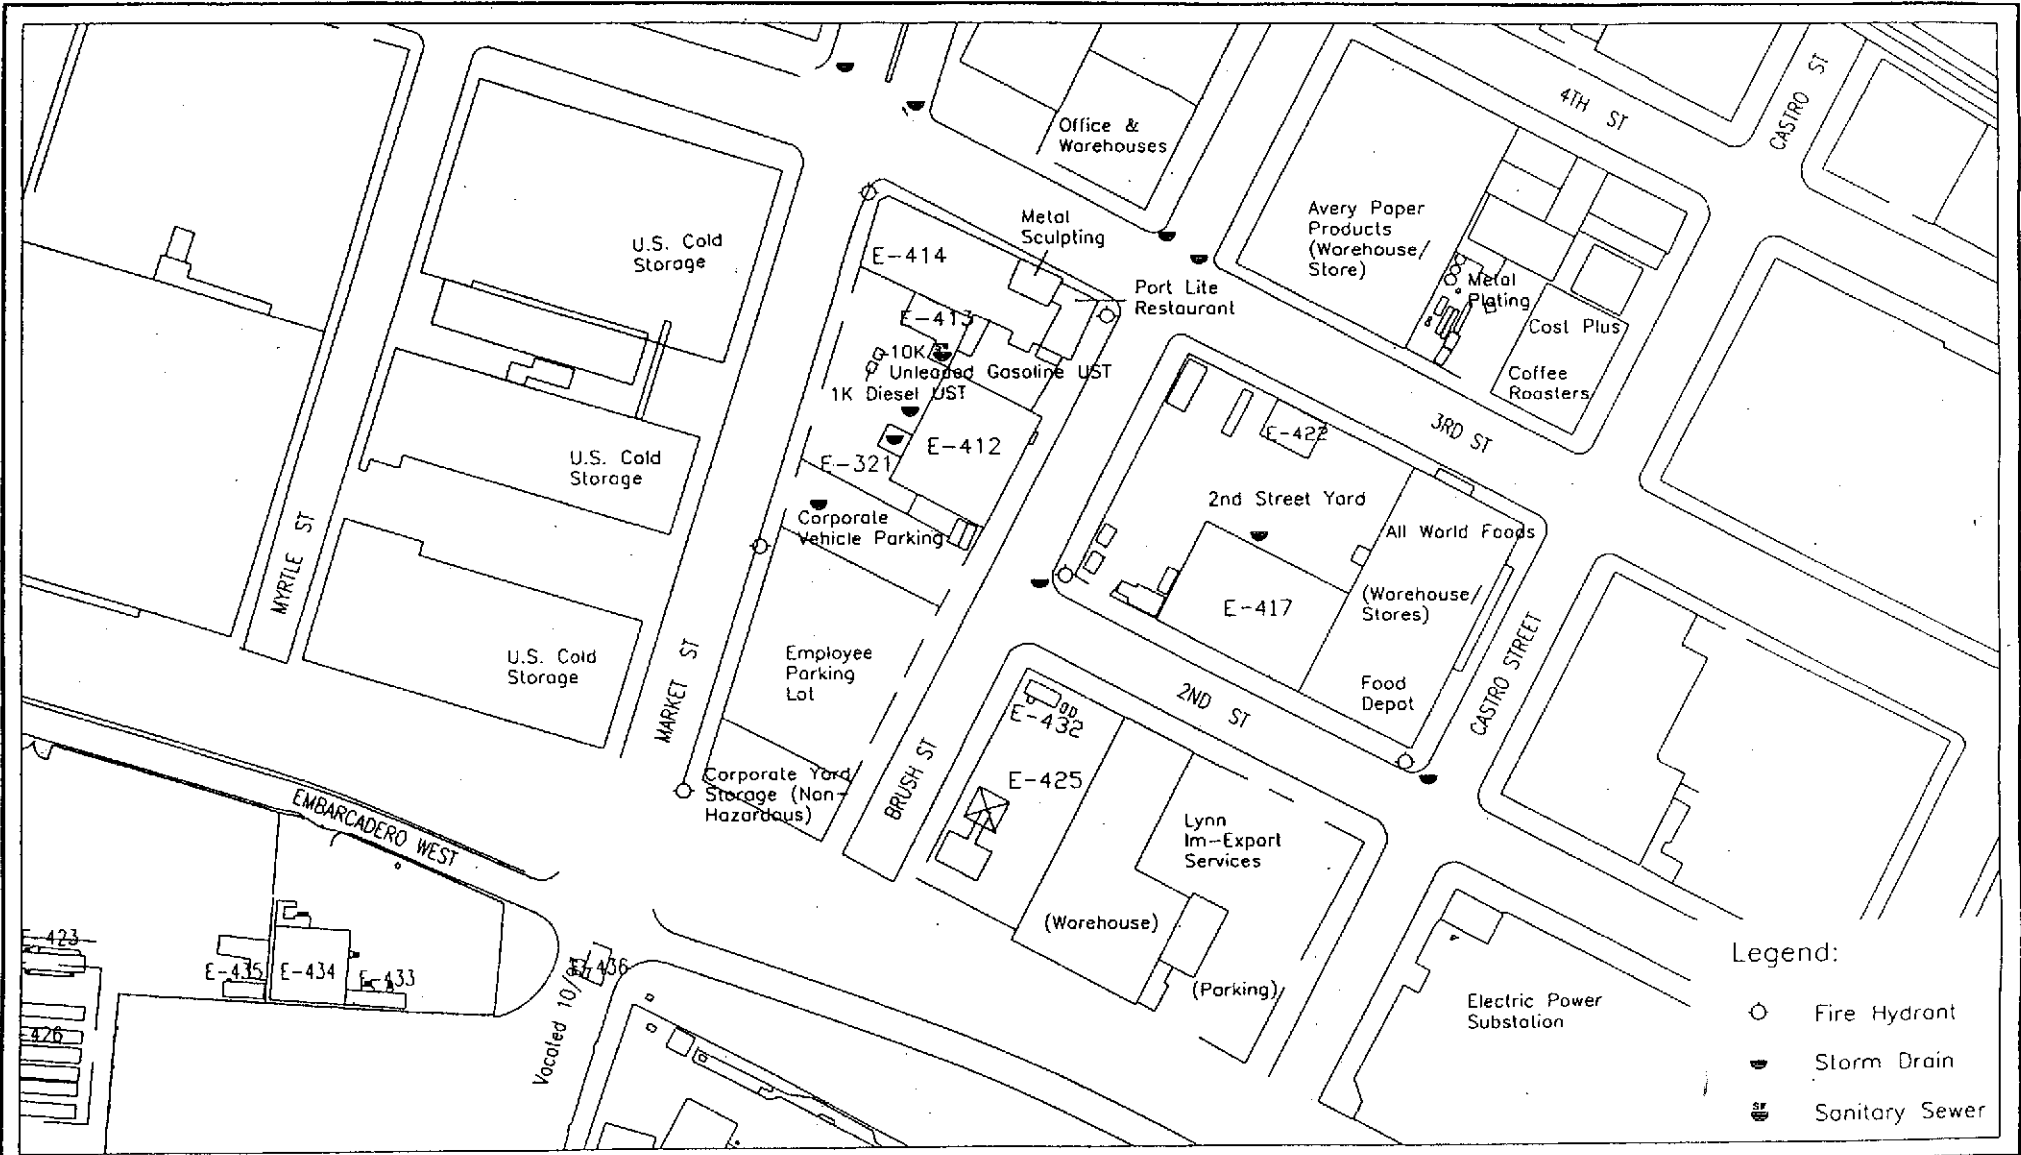

REFERENCE	DATE	BY	REVISION	DESCRIPTION

LAND RECORDS MANAGEMENT  
 Figure 2  
 Adjacent Land Use

**PORT OF OAKLAND**  
 530 WATER STREET OAKLAND, CALIFORNIA

DATE: 5/19/1997  
 SCALE: 1" = 100'  
 SHEETS: 1 OF 1  
 FILE: map\envr\hazard

## **2.1 Building E-417**

Building E-417 is a one-story structure located at 720 Second Street (Figure 3). E-417 contains a carpenter shop, electrical shop, work areas, hazardous materials storage areas, and equipment and supplies storage areas (Figures 4 and 5). In addition, three mezzanine levels within the building are used to store parts and equipment.

## **2.2 Building E-422**

Building E-422 is a one-story structure located at 777 Third Street (Figure 3). This building is used to store crane parts only.

## **2.3 Storage Shed and Former Guard Shack**

The storage shed is located on the southwestern portion of the site and is used to store roofing materials (Figure 3). The former Guard Shack, located at the southwest corner of the site, is used to store miscellaneous items used by the Facilities Department (Figure 3).

## **2.4 Truck Bed Containers**

The six truck bed containers are located throughout the site (Figure 3) and are used to store equipment, supplies, and hazardous substances (products). The containers are used by various PORT Facility department groups including general maintenance (painters, janitors), utilities (electricians, plumbers), and carpenters. The hazardous substances are, for the most part, stored (not used) at the site.


## **2.5 Hazardous Waste Accumulation Area (HWAA)**

A hazardous waste accumulation area (HWAA) is located adjacent to the storage shed on the southwestern portion of the site (Figure 3). The HWAA is operated and maintained in accordance with the state and federal requirements for the accumulation of hazardous waste. The HWAA is covered by a canopy and fenced. The gate is kept locked at all times, except when waste is being added or removed. The floor of the HWAA is concrete and bermed. There are 55-gallon drums in the HWAA designated and labeled to accept the following specific waste streams: waste diesel, waste oil solids, waste oil, waste paints, and waste





BRUSH STREET

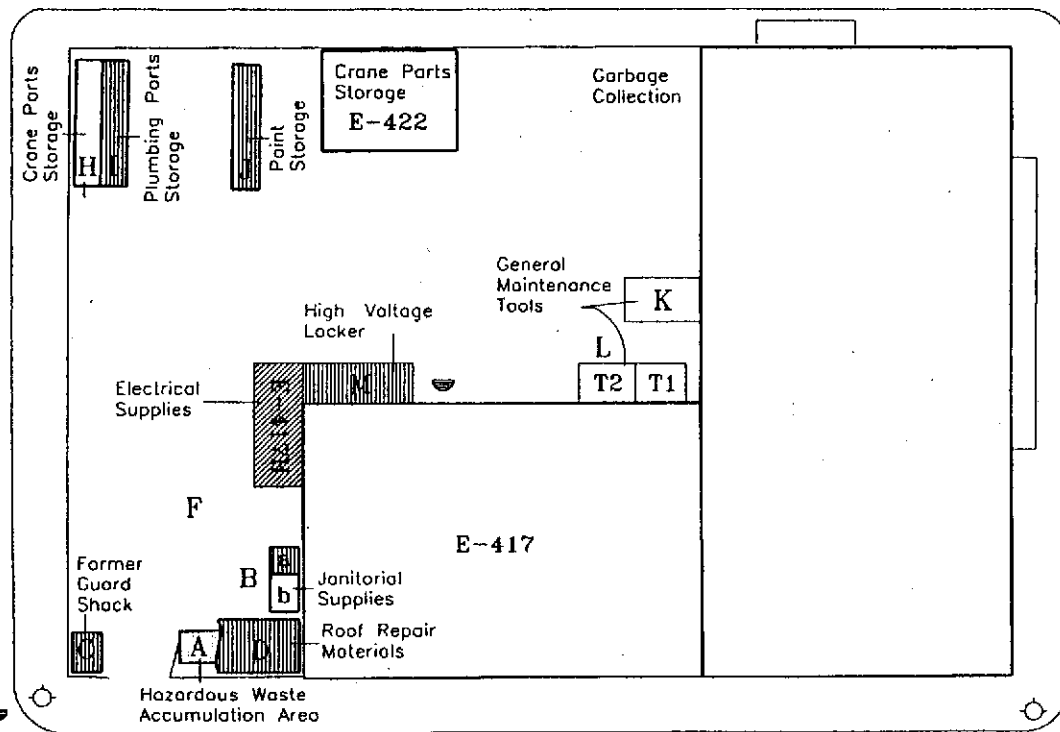

CASTRO STREET

2ND STREET

Legend

- Hazardous Materials Storage Area
- Drummed Hazardous Materials/Waste Storage Area
- Batteries
- Flammable Materials Storage Cabinet
- Electrical Equipment Containing Oil
- Compressed Gas Cylinder
- MSDS Repository
- SW Sanitary Sewer
- Storm Drain
- Doorway
- Roll Up Door
- Canopy
- 101 Room Number
- a Room Location Code
- Absorb. Material locations
- Fence
- Fire Extinguisher
- Storage Drum
- Material Safety Data Sheet
- Fire Hydrant



REFERENCE


Land Records Management  
 Figure 3  
 Second St. Corporation Yard  
 Buildings E-422 and E-417







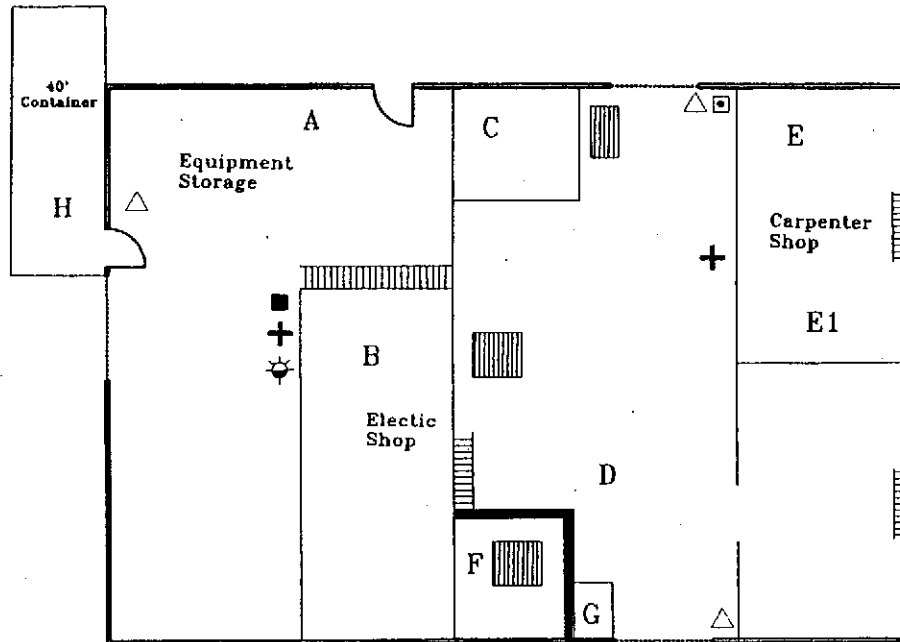



**PORT OF OAKLAND**

550 WATER STREET OAKLAND, CALIFORNIA

DATE 5/19/1997  
 SCALE 1" = 30'  
 SHEET 1 OF 1 SHEETS  
 FILE map\envir\o422hm



Legend

-  Hazardous Materials Storage Area
-  MSDS Repository
-  Doorway
-  Roll Up Door
-  Canopy
-  Room Location Code
-  Telephone (for emergency calls only)
-  Fire Extinguisher
-  First Aid Kit
-  Emergency Station

REFERENCE

\*PORT OF OAKLAND BAYWAY  
IS 1.50' BELOW MEAN SEA LEVEL.



DATE	2/26/1996
DRAWN BY	A. Chu
CHECKED BY	
DATE	
DRAWN BY	
CHECKED BY	
DATE	
DRAWN BY	
CHECKED BY	
DATE	
DRAWN BY	
CHECKED BY	
DATE	

Land Records Management  
**Figure 4**  
 Building E417  
 First Floor Plan






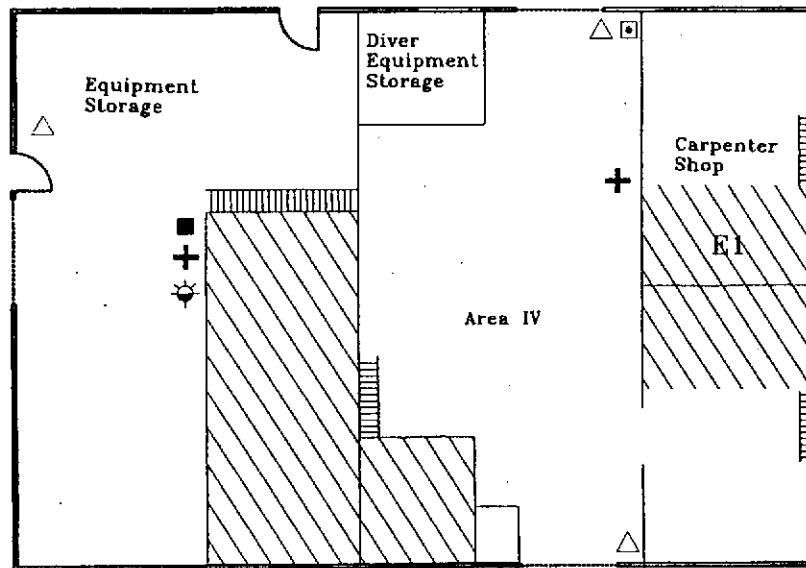


**PORT OF OAKLAND**

330 WATER STREET OAKLAND, CALIFORNIA

DATE	2/26/1996
SCALE	1" = 20'
SHEET	1 OF 1 SHEETS
FILE	map\envi\e417-1.htm



Legend

-  Mezzanine Levels
-  MSDS Repository
-  Room Location Code
-  Doorway
-  Roll Up Door
-  Telephone (for emergency calls only)
-  Fire Extinguisher
-  First Aid Kit
-  Emergency Station

REFERENCE

\*PORT OF OAKLAND GARAGE IS 3'0" BELOW MEAN SEA LEVEL


DATE	BY

Land Records Management  
**Figure 5**  
 Building E417  
 Second Floor Plan

PORT OF OAKLAND

 530 WATER STREET OAKLAND, CALIFORNIA

DATE 2/26/1996  
 SCALE 1" = 20'  
 SHEET 1 OF 1 SHEETS  
 FILE map\encl\417-2fm

flammable materials. The drums are inspected regularly for leaks or deterioration and are kept covered and closed (except when wastes are added). Inspection records are maintained by Bill Thompson, Central Facilities Engineer. Absorbent material, a broom, and a fire extinguisher are located nearby, for immediate accessibility in the event of emergency. A contingency plan has been prepared and is outlined in Section 4.0 of this plan. Personnel training is described in Section 5.1 of this plan.

## **2.6 Storm Drainage**

Surface runoff from the major portion of the Second Street Yard property flows into adjacent street and nearby storm drains. Storm drain locations on and near the property are shown on Figure 2. The storm drains adjacent to the property flow southwest along Brush Street. The storm drains discharge into the Oakland Estuary one quarter mile to the south, as the terminus of Martin Luther King Jr. Way.

## **2.7 Fire Hydrants**

Fire hydrants are located off-site at three locations surrounding the property. Two are located along Second Street and one at the corner of Brush Street and Third Street (Figure 3). No hydrants or standpipes are located on the property.

## **2.8 Property Security**

The property is secured with a fence and locking gates. Access is restricted during non-working hours. After working hours, the gates are locked and patrolled by guard dogs.

## **2.9 Users or Generators of Hazardous Materials**

Users and generators of hazardous materials are identified in Table 1. The HWAA is used by the Harbor Facilities Department personnel at 209 Brush Street, Oakland, California, as well. In these cases, waste is brought by PORT personnel who access the HWAA by crossing Brush Street (also PORT property).

TABLE 1

USERS AND GENERATORS AND LOCATIONS OF HAZARDOUS MATERIALS

777 Third Street and 720 Second Street

User	Supervisor/Foreman	Building	Room Number
Central Facilities	Bill Thompson	E-417, E-422 and trailers	H, K, L
Marine Facilities	Dave Cuthbertson	E-417H, and trailers	I
Commercial Real Estate Facilities	Larry Ross	Former Guard Shack	C
Painters/Roofers	Dave Nemcik	trailers	J and D
Janitors	Bill Thompson	shed	B
Hazardous Waste Accumulation Area	Bill Thompson	shed	A
2nd Street Yard at Brush Street	Bill Thompson	2nd St. Yard	

### 3.0 CHEMICAL INVENTORY

Chemical Description Pages for reportable quantities of hazardous materials stored at the property are presented in Appendix B. Locations of the storage areas for hazardous materials and wastes and locations of Material Safety Data Sheets are shown in Figures 3 through 5. The complete inventory of hazardous and non-hazardous materials stored at the property is provided in Appendix F. Room numbers and codes on the complete inventory lists also correspond to those locations identified in Figures 3 through 5.

## 4.0 CONTINGENCY PLAN

This section describes the procedures that should be followed in the event of an emergency involving hazardous materials. Response procedures are described for five categories of hazardous material emergencies — 1) minor spills of hazardous materials, 2) major spills, 3) fires and explosions, 4) poisoning, and 5) earthquake and other natural disasters. The procedures described in this section should be used only as general guidelines; common sense and good judgment based on incident-specific circumstances and employee knowledge/skills must always be exercised. Therefore, employee training and familiarity with the proper and safe handling of hazardous materials are critical in staging an effective emergency response.

### 4.1 PORT Emergency Coordinator

In the event of an emergency involving hazardous materials, a PORT Emergency Coordinator is available 24 hours a day, every day of the year. The PORT Emergency Coordinator will perform the following duties:

- Notify public emergency response agencies (e.g., fire and police);
- Provide assistance to PORT employees on minor spill cleanup procedures;
- Call in spill cleanup contractors, if needed;
- Coordinate emergency response actions taken by PORT personnel.

Trained staff of the Environmental Department are designated as primary Emergency Coordinators and should be contacted first in an emergency. If the designated staff cannot be contacted, then designated alternate emergency coordinators from other PORT departments should be contacted.<sup>3</sup> The primary and alternative emergency coordinators for this PORT property are as follows:

---

<sup>3</sup> Only trained and qualified staff of the Environmental Department may provide technical assistance to PORT employees performing cleanup of minor spills.



### Primary Emergency Coordinators

Mark O'Brien, Manager	Day:	(510) 272-1538
Environmental Health and Safety Compliance Department	Pager:	(510) 678-3815
Neil Werner, Environmental Compliance Supervisor	Day:	(510) 272-1176
Environmental Health and Safety Compliance Department	Evening:	(510) 522-4022
Jeff Jones, Certified Industrial Hygienist	Day:	(510) 272-1360
Environmental Health and Safety Compliance Department	Pager:	(510) 720-2608
or		
Nancy Humphrey, Principal Safety Administrator	Day:	(510) 272-1554

### Alternate Emergency Coordinators

<i>Bill Thompson</i> , Central Facilities Engineer	(510) 272-1409	(510) 881-4831
Facilities Department	Beeper:	(510) 678-3385

### 4.2 Emergency Response Agencies

In the event of an emergency, personnel should contact the City of Oakland's emergency response system by calling 911. The 911 operator will dispatch the Oakland Fire or, the Oakland Police Department and/or medical assistance to the scene, depending on the nature of the emergency. For emergencies involving hazardous materials, the Oakland Fire Department may dispatch its Hazardous Materials Team (Station 12) to the scene in addition to the engine closest to the scene. The Hazardous Materials Team may request the assistance of the Alameda County Hazardous Materials Division to identify any hazardous materials.

### 4.3 Chain of Command

During an emergency, the Incident Commander will have overall control of all response activities at the scene. All the decisions may not be made by the Incident Commander, but all information must be brought to the attention of the Incident Commander, and all actions must be coordinated through the Incident Commander. The Incident Commander is designated as the most qualified individual at the emergency site according to the chain-of-command listed below. Thus, whoever arrives on-scene first to act as Incident Commander will relinquish the position to any individual higher in the chain-of-command, who may arrive later at the scene.

#### CHAIN-OF-COMMAND

City of Oakland Fire Department (Most Qualified)

↑

City of Oakland Police Department

↑

PORT Emergency Coordinator

↑

PORT Harbor Facilities Supervising Engineer

↑

PORT Harbor Facilities Supervisor

↑

PORT Harbor Facilities Foreman

↑

PORT personnel on the scene

#### 4.4 Locations of Emergency Equipment

The locations of emergency equipment, such as fire extinguishers, first aid kits, and emergency stations are shown in Figures 3 through 5.

## EMERGENCY RESPONSE PROCEDURES

This emergency response plan provides for hazardous materials-related emergencies for five different categories of emergencies:

- Minor spills
- Major spills
- Fires and explosions
- Poisoning
- Earthquake and other natural disasters

Detailed information on the response procedures, personal protective equipment, and health hazards are contained in Appendix C (yellow paper) for each of the five categories of emergencies.

### AGENCY NOTIFICATION

On-site personnel shall notify the fire, police, or paramedics by dialing 911 when an emergency situation is recognized. All other agencies will be notified by the Emergency Coordinator as soon as practicable (notification requirements are listed in Table 2). All telephone calls must be recorded on an Emergency Notification Log Form (Appendix D). The information provided to agencies must be accurate, concise, verified, and consistent. Facts that should be reported include:

#### Notification

- Caller's identity and affiliation with the Port of Oakland.
- The exact location of the incident.
- Nature of hazardous materials emergency.
- Time of incident or time first noticed.
- Types or lists of materials involved and estimated quantities.
- What agencies have been notified and/or responded.
- Known or anticipated health or environmental hazards.
- Actions taken to minimize hazard or impact.
- Other factual information requested by the agency.

**TABLE 2**  
**NOTIFICATION REQUIREMENTS IN A HAZARDOUS MATERIALS EMERGENCY**  
**777 Third Street and 720 Market Street**

Emergency	Notify	Telephone
MINOR SPILLS:	· PORT Environmental Health and Safety Compliance Department	(510) 272-1176
MAJOR SPILLS:	· PORT Environmental Health and Safety Compliance Department	(510) 272-1178
	· California Office of Emergency Services	(800) 852-7550
	· City of Oakland Fire Department	911 or (510) 444-3322
	<i>If appropriate:</i> · City of Oakland Police Department	911
	· National Response Center	(800) 424-8802
	· Bay Area Air Quality Management District	(510) 771-6000
	· Regional Water Quality Control Board	(510) 464-1255
	· U.S. Coast Guard	(510) 437-3073
	· California Department of Fish and Game	(707) 944-5500
	· State Lands Division	(213) 590-5201
	· U.S. Environmental Protection Agency	(510) 271-4320
FIRES AND EXPLOSIONS:	· PORT Environmental Health and Safety Compliance Department	(510) 272-1176
	· California Office of Emergency Services	(800) 852-7550
	· City of Oakland Fire Department	911 or (510) 444-3322
	<i>If appropriate:</i> · City of Oakland Police Department	911
	· Bay Area Air Quality Management District	(510) 771-6000
	· Regional Water Quality Control Board	(510) 464-1255
	· California Department of Fish and Game	(707) 944-5500
	· State Lands Division	(213) 590-5201
	· U.S. Environmental Protection Agency	(510) 271-4320
POISONING:	· PORT Environmental Health and Safety Compliance Department	(510) 272-1176
	· City of Oakland Fire Department, Paramedics	911
	· CAL/OSHA	(510) 557-1677
EARTHQUAKE & OTHER NATURAL DISASTERS:	Agencies to be determined by PORT Emergency Coordinator	

## **EVACUATION PLAN**

It may be necessary to evacuate a work area or the property in the event of an emergency. Personnel will be alerted either by voice communication. Evacuated personnel will meet at a safe area, shown as location A in Figure F-1 (Appendix E). Building egress routes, in the event of an evacuation, are also depicted in the figure. During evacuation, employees should avoid blocking egress routes or exit doors and should avoid congregating close to the buildings where emergency operations may be occurring.

Supervisors and/or foremen will be responsible for moving their staff from the work areas to the safe area and will account for their staff at the safe area. As many of the staff work off-site during the day, each supervisor/foreman will attempt to verify that each person in their section is either in the safe area or is off-site.

## **POST-EMERGENCY PROCEDURES**

Following each hazardous materials/waste emergency, the Environmental Department will coordinate with all parties involved in the emergency to determine whether cleanup activities have been completed, to ensure proper removal, disposal, or decontamination of spill cleanup materials, to ensure that all required public agency notifications have been made, and to critique the effectiveness of the response activities. Findings from the critique will be distributed to PORT employees, PORT management, and public emergency response agencies.

## 5.0 PREPAREDNESS AND PREVENTION MEASURES

This section describes the preparedness and prevention measures that are taken at the property to minimize hazards to human health or the environment from unauthorized releases, fires, explosions, or earthquake and other natural disaster. The measures cover training of personnel, PORT arrangements with spill cleanup contractors, emergency equipment, alarm systems, and PORT procedures to update and distribute the Plan.

### 5.1 Training

All employees who work at the property have access to a copy of this Plan and are fully trained in the contingency procedures described in the Plan. Training includes familiarization with emergency procedures, the locations of material safety data sheets (MSDS), personal protective equipment, emergency equipment, evacuation routes, and evacuation safe areas. Employees who work with hazardous materials are instructed in the proper safety procedures for handling, storing, and disposal of hazardous materials.

Employees are instructed in the use of the emergency equipment (for example, absorbent materials) in their work environment, and the procedures to follow for each type of emergency. New employees will have access to a copy of this Plan, and will receive the training described above before handling any hazardous materials (or within six months after their assignment to the facility, whichever occurs sooner).

Employees will receive annual refresher training to review safety procedures and discuss any emergency situations that occurred in the past. The purpose of the review will be to refine emergency procedures and remind employees of proper conduct during emergencies. Refresher training will include instructions on the proper use of emergency equipment and safe handling and disposal practices for hazardous materials. Supervisors/foremen are responsible for coordinating monthly safety meetings to review safety procedures and for maintaining records of employee attendance.



Employees will become familiar with the contents of this Plan and with proper procedures for the handling, storage and disposal of hazardous materials through classroom and on-the-job training. The Environmental Department is responsible for developing and updating the classroom portions of the training program. Supervisors/foremen at the property are responsible for conducting on-the-job training. The PORT Safety Administrator audits training records and programs for PORT employees. Supervisors/foremen will maintain job descriptions and training records (logs) of each employee on his/her staff. The records are kept on-site for a minimum of three years after employee termination or job reassignment off-site.

## **5.2 Spill Cleanup Contractors**

The PORT Emergency Coordinator will immediately request the assistance of an emergency response contractor company if a hazardous material incident is beyond the response capacity of PORT personnel. These contractors will provide assistance during an emergency to clean up spills and/or coordinate spill cleanup activities when requested by the Emergency Coordinator. A list of emergency response contractors is provided in the Metropolitan Oakland International Airport Safety Directive 408.

## **5.3 Emergency Equipment**

The following emergency equipment is located on the property: portable fire extinguishers, eye washes, acid/base neutralizing solutions, emergency oxygen, first aid kits, oil absorbent pads, unused drums, and personal protective gear. The PORT Safety Administrator inspects the emergency and personal protective equipment periodically to ensure proper operations and an adequate supply; all fire extinguishers are serviced annually by a PORT-designated employee.

Fire hydrants are located off-site at five locations surrounding the property. Three are located along Market Street and two along Brush Street (Figure 3). There are no hydrants or standpipes on the property.

## **5.4 Alarm Systems**

Buildings E-417 and E-422 have telephones to summon emergency police, fire, or ambulance assistance. The buildings are equipped with burglar alarm systems; neither building is equipped with fire alarms or

sprinkler systems. Employees working at the site must rely on telephones and voice communication in the event of an emergency.

### **5.5 Aisle Spaces**

Aisle spaces in all buildings are maintained to allow unobstructed movement of personnel, fire protection equipment, and spill control equipment to any area. The property is inspected annually by the Oakland Fire Department to ensure fire safety. Employees who mix, pour, spread, or otherwise handle hazardous materials (including wastes) must perform this activity in an area where there is immediate access to a telephone or where other employees are working and can be contacted easily.

### **5.6 Plan Updates and Distribution**

This Plan will be revised by the Environmental Department when:

- applicable regulations are revised;
- the Plan is deemed inadequate or fails in an emergency;
- the property design, construction, operation, or maintenance changes such that emergency response procedures change;
- the list of Emergency Coordinators changes;
- the list of emergency equipment changes;
- the types of hazardous materials (including waste) changes;
- the notification procedures change.

Copies of the Plan and amendments will be maintained at each of the buildings and structures where employees use, handle, or store hazardous materials; in addition, copies will be distributed to the public agencies and local hospitals shown in Table 3.

TABLE 3

PLAN DISTRIBUTION LIST

- § City of Oakland Fire Department/ Oakland Office of Emergency Services
- § City of Oakland Police Department
- § Summit Hospital, Oakland
- § Port of Oakland: Harbor Facilities Department  
Environmental Health and Safety Compliance Department  
Safety Administrator

## 6.0 DEFINITION OF RESPONSIBILITIES

This section describes the responsibilities of the PORT Facilities, Construction, and Environmental departments, and the PORT Safety Administrator for preparation and implementation of this Plan. Within the Facilities and Construction departments, the responsibilities are defined for management, the supervising engineer (Facilities only), supervisors/foremen, and employees.

### 6.1 PORT Facilities Department

This section describes the responsibilities of the management, the Harbor Facilities Supervising Engineer, the supervisors/foremen, and the staff of the Facilities Department at the property for emergency preparedness and for proper emergency responses.

#### 6.1.1 Management

The management of the Facilities Department is responsible for:

- Ensuring overall environmental protection and employee health and safety at sites within the department that involve the use, storage, and disposal of hazardous materials and waste and that are staffed by employees of the Facilities Department;
- Ensuring the review, approval, implementation, and updating of emergency response plans for these sites;
- Ensuring that contingency plans, employee training, and capital improvements are implemented to minimize risks associated with the use, storage, or disposal of hazardous materials and wastes at these sites.

#### 6.1.2 Harbor Facilities Supervising Engineer

The Harbor Facilities Supervising Engineer is responsible for:

- Familiarity with all the operations on the site that involve hazardous materials;
- Familiarity with the details in the emergency response plan procedures;

- May act as Alternate Emergency Coordinator when a Primary Coordinator from the Environmental Department is not immediately available to coordinate emergency response activities.

### **6.1.3 Supervisors/Foremen**

The Facilities Department supervisors and foremen are responsible for:

- Familiarity with the hazardous materials and waste used or handled by their staff;
- Ensuring that their staff have received adequate training on the hazardous materials he/she handles in the course of their work and on emergency response procedures;
- Ensuring that their staff are handling hazardous materials safely and correctly;
- Ensuring that staff are storing and disposing of hazardous wastes safely and correctly;
- Providing adequate personal protective equipment to employees, as identified by the Environmental Department or by the PORT Safety Administrator;
- Ensuring that employees don proper personal protective gear for cleanup of minor spills of hazardous materials;
- Providing adequate spill cleanup material and personal protection equipment on-site at all times;
- Ensuring that a complete file of Material Safety Data Sheets is available for employee referral;
- Maintaining a job description and training record for each employee; keeping records for a minimum three years after termination or job assignment off-site.

### **6.1.4 Employees Using or Handling Hazardous Materials**

Employees who use or handle hazardous materials/waste are responsible for:

- Knowing both the environmental and the health and safety hazards of the materials;
- Using, storing, or disposing of hazardous materials or waste in a safe and proper manner;
- Wearing proper personal protective equipment when cleaning up minor spills;
- Properly storing, cleaning, and maintaining their own personal protective equipment.
- Familiarity with minor spill cleanup procedures;

- Notifying the supervisor/foreman when the employee is not familiar with cleanup procedures or does not have proper personal protective equipment.

## **6.2 PORT Construction Department**

### **Management**

(see PORT Facilities Department, above)

### **Supervisors/Foremen**

(see PORT Facilities Department, above)

### **Employees**

(see PORT Facilities Department, above)

## **6.3 PORT Environmental Health and Safety Compliance Department**

The EH&SC Department assists in the development and implementation of PORT policies on environmental protection and worker health and safety, and advises PORT management on the impacts of environmental and health and safety regulations on PORT operations. The Environmental Department is responsible for:

- Developing, updating, and enforcing PORT policies and procedures for emergency planning;
- Informing PORT management of the programs and resources necessary to ensure adequate emergency response capabilities at PORT sites;
- Developing and implementing employee hazardous materials training programs;
- Coordinating a critique of emergency response action after a major incident or emergency;
- Providing staff to act as Primary Emergency Coordinators.

#### 6.4 PORT Safety Administrator

The PORT Safety Administrator is responsible for:

- Auditing the PORT's training records and programs for hazardous materials and emergency response procedures (frequency of training, personnel who receive training, and type of training);
- Auditing the property periodically to ensure safe working conditions;
- Inspecting all emergency equipment (except for fire extinguishers) on a regular basis to ensure their proper operation and an adequate supply.

**OAKLAND FIRE SERVICES AGENCY**

Office of Emergency Services  
 Hazardous Materials Management Program  
 505 - 14th Street, Suite 702  
 Oakland, Ca 94612

10-22-97  
 #2015

Office: 510-238-3938

Fax: 510-238-7761

**HAZARDOUS MATERIALS BUSINESS PLAN**

1. Number of individuals handling hazardous materials: 42
2. Hazardous materials/waste storage and handling area in square feet: \_\_\_\_\_
3. Number of storage tanks on site: Above Ground 0 Under Ground 0
4. All hazardous substance or wastes:

	Gallons (Liquid)	Pounds (Solid)	Cubic Feet (Gaseous)	Number of Items
Hazardous Materials	1,010.51	270.4	7	59
Hazardous Waste	330.00			5
<b>TOTAL</b>	1,340.51	270.4	7	64

**FOR OFFICE USE ONLY**

<input type="checkbox"/> No Changes	<input type="checkbox"/> Number of Employees	<input type="checkbox"/> Address
<input type="checkbox"/> New Facility	<input type="checkbox"/> UST/AST	<input type="checkbox"/> Billing Adjustment
<input type="checkbox"/> Inventory	<input type="checkbox"/> Exempt	<input type="checkbox"/> Other _____
<input type="checkbox"/> Business Closed	<input type="checkbox"/> Inactive	_____

OAKLAND EMERGENCY SERVICES

JUN 30 1997



**APPENDIX B**

**CALIFORNIA HAZARDOUS MATERIALS INVENTORY REPORTING FORM/ADDENDUM**

**CHEMICAL DESCRIPTION PAGE**

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 2

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) BENJAMIN MOORE AQUAFLOW ENAMEL EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 3

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm L, T1/RmJ

CHEMICAL NAME (8) PAINT TRADE SECRET (11)  Y  N

COMMON NAME (9) BOWMAN ENAMEL PAINT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, ORM-D

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 61.85

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 61.85

LARGEST CONTAINER (21) 0.12 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	30 - 40	ACETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	67641
2	5 - 10	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
3	5 - 10	ETHYL ALCOHOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64175
4	5	METHYL ETHYL KETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	78933
5	5 - 10	DIACETONE ALCOHOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	123422

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 4

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BOWMAN MARKING PAINT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, ORM-D, UN1950

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 223.04

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 223.04

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	10 - 15	ACETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	67641
2	15 - 20	TOLUENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	108883
3	5 - 10	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
4	5 - 10	ALPHATIC HYDROCARBON	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64742898
5	10 - 15	PROPANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	74986

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 5

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING 2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BURKE ACRYLIC BONDER EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 16.69

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 16.69

LARGEST CONTAINER (21) 16.69 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 6

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) CALIFORNIA TRI-COAT CONCRETE PARTS A & B EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 10.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 10.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 7

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) WOOD STAIN TRADE SECRET (11)  Y  N

COMMON NAME (9) CHABOT DECKING STAIN EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 60.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 60.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 8 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) CORONADO SILCONE ALKYD PAINT EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION



(1)  ADD  DELETE  REVISE

PAGE (2) 9

OF (3) 85

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) DEVOE ENAMEL PAINT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 18.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 18.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 10

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) DEVDE EPOXY NON-SKID COATING 237M EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Flammable Liquid, Class IC

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 20.00

DAYS ON SITE (20) 365 IF EHS amounts must be in lbs AVG DAILY AMT (24) 20.00

LARGEST CONTAINER (21) 20.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 75	POLYIMIDE RESIN	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	68082291
2 20	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
3 5	246TRI(DIMETHYLAMINOMETHYL)PHE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	90722
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 11

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) DEVOE FLIGHT DECK TOPPING 929 EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13) Flammable Liquid, Classic

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 2.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 2.00

LARGEST CONTAINER (21) 2.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 40	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
2 30	POLYAMIDE RESIN	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	68082291
3 20	AROMATIC NAPHTHA, HIGH FLASH	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64742956
4 10	PHENOLIC COMPOUND	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	na
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 12

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) DIAMOND VOGAL PAINT

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)

GAL  CU FT  
 LBS  TONS

MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input checked="" type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 13

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) ALKYD METAL PRIMER TRADE SECRET (11)  Y  N

COMMON NAME (9) DUNNE ACRYLIC MAINTENANCE PRIMER & FINISH (METAL) EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Combustible Liquid, Class II

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 6.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 6.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 30	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
2 10	ZINC CHROMATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1103869
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 14

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) DUNNE ENAMEL PAINT

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 71.25

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 71.25

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	20	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
2	<5	LOW ODOR MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64742478
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

[Empty box for additional information]

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 15

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8) ALKYD RESIN WOOD STAIN TRADE SECRET (11)  Y  N

COMMON NAME (9) DUNNE CLEAR WOOD STAIN #17 EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Combustible Liquid, Class II

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 85	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
2 <5	ZIRCONIUM & COBALT CARBOXYLATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 16

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) ALKYD RESIN STIPPLE TRADE SECRET (11)  Y  N

COMMON NAME (9) DUNNE VARNISH EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Combustible Liquid, Class II

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 25	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
2 <5	XYCOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION



California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 17 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) URETHANE ALKYD ALUMINUM PAINT TRADE SECRET (11)  Y  N

COMMON NAME (9) DUNNE LIQUID ALUMINUM 1820 EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Combustible Liquid, Class II

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT MAX DAILY AMT (23) 1.25  
 LBS  TONS

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 1.25

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 40	LO ODOR MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64742478
2 10	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
3 <5	XYCOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 18 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) EURAPEL WATER REPELLENT FINISH EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 6.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 6.00

LARGEST CONTAINER (21) 6.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 19 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) PREMIUM PAINT & EPOXY REMOVER TRADE SECRET (11)  Y  N

COMMON NAME (9) JASCO PAINT REMOVER EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, toxic

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 4.25

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 4.25

LARGEST CONTAINER (21) 2.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 98	SOLV-METHYLENE CHLORDE/METHANO	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2 4	ADDITIVES	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 20 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) FLOOD CWF-UV CLEARWOOD FINISH EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 10.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 10.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 21

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) PAINT OIL TRADE SECRET (11)  Y  N

COMMON NAME (9) FLOOD E-B PRIMER EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Combustible Liquid, Class II

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 2.89

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 2.89

LARGEST CONTAINER (21) 0.50 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	65	ALIPHATIC PETROLEUM DISTILLATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Note: 0.14 gal stored at E-417, Rm A

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 22

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING.2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) KELLY MOORE PRIMER PAINT

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 31.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 31.00

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 23

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) KELLY MOORE LACQUER THINNER 67 EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 72.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 72.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 24

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) OLYMPIC OIL STAIN EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 48.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 49.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION



California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 25

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm L, T1

CHEMICAL NAME (8) ANGUS HOT ROD TRADE SECRET (11)  Y  N

COMMON NAME (9) EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 41.72

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 41.72

LARGEST CONTAINER (21) 41.72 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

[Empty box for additional locally collected information]

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 26 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING: 2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) ASPHALT PRIMER TRADE SECRET (11)  Y  N  
 COMMON NAME (9) APOC 103 ASPHALT PRIMER EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13) combustible liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 20.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 20.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 54	ASPHALT (PETROLEUM)	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2 46	SOLVENTS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	proprietary
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 27

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm D

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) APOC 105 LAP CEMENT

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) combustible liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365

IF EHS amounts must be in lbs

AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	67	ASPHALT (PETROLEUM)	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2	33	SOLVENTS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 28

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm D

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) APOC 252 GUNWHITE ELASTOMERIC

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input checked="" type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 29

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) APOC EMULSION ROOF COATING EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) combustible liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 35.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 35.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 60	ASPHALT	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2 26	SOLVENTS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	proprietary
3 4	ADDITIVES	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
4 13	ASBESTOS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 30

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) APOC PLASTIC ROOF CEMENT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 16.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 16.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	50	ASPHALT	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2	25	SOLVENT	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	proprietary
3	13	ASBESTOS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
4	12	ADDITIVES	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 31 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm L, T1

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) CUTTING TOOL COOLANT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, consumer commodity ORM-D

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT MAX DAILY AMT (23) 0.81

DAYS ON SITE (20) 365  LBS  TONS IF EHS amounts must be in lbs AVG DAILY AMT (24) 0.81

LARGEST CONTAINER (21) 0.15 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 70 - 80	1,1,1 TRICHLOROETHANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	71558
2 20 - 30	TETRACHLOROETHENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	127184
3 1 - 10	CARBON DIOXIDE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	124389
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 32

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 & 4

GRID# (7) Rm L, T1 & Rm B

CHEMICAL NAME (8) AEROSOL SOLVENT TRADE SECRET (11)  Y  N

COMMON NAME (9) BOWMAN SAFETY SOLVENT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, ORM-D, UN 1950

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.49

DAYS ON SITE (20) 385 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.49

LARGEST CONTAINER (21) 0.12 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 75	PERCHLOROETHYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	127184
2 25	METHYL CHLOROFORM	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	71556
3 <5	CARBON DIOXIDE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	124389
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Note: 0.12 gal stored at E-417, Rm B



California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 33

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BURKE BURKEPOXY EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

(1)  ADD  DELETE  REVISE

PAGE (2) 34

OF (3) 85

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) CARBOLINE CARBOMASTIC #15 EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 10.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 10.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 35

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm D and J

CHEMICAL NAME (8) MODIFIED URETHANE ELASTOMER TRADE SECRET (11)  Y  N

COMMON NAME (9) CARBOLINE ROOFLEX MEMBRANE 145 EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) pt A: combustible liquid, class II  
pt B: combustible liquid, class III B

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365 if EHS amounts must be in lbs AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 <5	METHYL ETHYL KETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	78933
2 <5	TOLUENE DIISOCYANATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
3 <1	METHYLENE PHENOL ISOCYANATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 36

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) ASPHALT PRODUCT TRADE SECRET (11)  Y  N

COMMON NAME (9) CERTIFIED REDI-SEAL ROOF PATCHING COMPOUND EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	ASPHALT PRODUCT	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 37

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm Ba

CHEMICAL NAME (8) SODIUM HYPOCHLORITE TRADE SECRET (11)  Y  N

COMMON NAME (9) CLOROX BLEACH EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) nonflammable

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 3.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 3.00

LARGEST CONTAINER (21) 3.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 5 - 12	SODIUM HYPOCHLORITE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	007681529
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

**APPENDIX A**

**CALIFORNIA HAZARDOUS MATERIALS INVENTORY REPORTING FORM**

**BUSINESS & OWNER/OPERATOR IDENTIFICATION PAGE**

PE 7/8/98

California Hazardous Materials Inventory Reporting Form - Business Owner/Operator Identification Page

CALENDER YEAR BEGINNING (1) 01/01/97 ENDING (2) 12/31/97 PAGE ONE OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD BUSINESS PHONE (5) (510)272-1409

SITE ADDRESS (6) 777 THIRD STREET AND 720 SECOND STREET

CITY (7) OAKLAND STATE (8) CA ZIP (9) 94607

DUN & BRADSTREET (10) 009235326 SIC CODE (4 DIGIT #) (11) 9199

OPERATOR NAME (12) PORT OF OAKLAND OPERATOR PHONE (13) (510)272-1409

OWNER INFORMATION

OWNER NAME (14) PORT OF OAKLAND OWNER PHONE (15) (510)272-1409

OWNER MAILING ADDRESS (16) 530 WATER STREET

CITY (17) OAKLAND STATE (18) CA ZIP (19) 94607

ENVIRONMENTAL CONTACT

CONTACT NAME (20) BILL THOMPSON CONTACT PHONE (21) (510)272-1409

MAILING ADDRESS (22) 777 THIRD STREET AND 720 SECOND STREET

CITY (23) OAKLAND STATE (24) CA ZIP (25) 94607

EMERGENCY CONTACT

Primary		Secondary	
NAME (26)	MARK O'BRIEN	NAME (31)	NEIL WERNER
TITLE (27)	MANAGER, EH&SC DEPARTMENT	TITLE (32)	SUPERVISOR, EH&SC DEPARTMENT
BUSINESS PHONE (28)	(510)272-1538	BUSINESS PHONE (33)	(510)272-1176
24-HOUR PHONE (29)	(510)878-3815	24-HOUR PHONE (34)	(510)522-4022
PAGER # (30)	( ) -	PAGER # (35)	( ) -

ACUTELY HAZARDOUS MATERIALS (AHM)

ON SITE AHM (36)  Yes  No

If yes and above Threshold Planning Quantities, attach a sheet of paper with a general description of the process and principal equipment.

ADDITIONAL LOCALLY COLLECTED INFORMATION

(37)

Certification : I certify under penalty of law that I have personally examined and familiar with the information submitted in this inventory and believe the information is true, accurate, and complete

Print Name of Document Preparer (38) \_\_\_\_\_

Signature of Owner/Operator (39) \_\_\_\_\_

DATE (40) 06/25/97

OAKLAND EMERGENCY SERVICES

JUN 30 1997

APPENDIX C

EMERGENCY NUMBERS AND HAZARDOUS MATERIALS EMERGENCY

RESPONSE PROCEDURES



# EMERGENCY PHONE NUMBERS

## EMERGENCY COORDINATOR:

### Primary:

*Mark O'Brien*, Manager  
Environmental Health and Safety Compliance

Business  
(510) 272-1538

Non-business  
Pager  
(510) 678-3815

*Neil Werner*, Supervisor  
Environmental Health and Safety Compliance

(510) 272-1176

(510) 522-4022

*Jeff Jones*, Certified Industrial Hygienist  
Environmental Health and Safety Compliance

(510) 272-1360

Pager  
(510) 720-2608

or

*Nancy Humphrey*, Principal Safety Administrator

(510) 272-1554

### Alternate:

*Bill Thompson*, Central Facilities Engineer  
Facilities Department

(510) 272-1409  
Pager: (510) 678-3385

(510) 881-4831

## POLICE, FIRE, PARAMEDICS:

(510) 577-4080 OR 911

Note: A **minor spill** involves less than one gallon of an identified material and can be cleaned by one or two persons. Only persons who have been trained in cleanup procedures for **minor spills** and who have been fitted and trained in the use of personal protective equipment may perform cleanup. Spills of PCB-contaminated, flammable solid, toxic, or unidentified material should be considered a **MAJOR SPILL**. If there is any question about the seriousness of a spill, treat as a MAJOR SPILL.

**Person Who Discovers the Spill Will:**

- 1) Notify Supervisor/Foreman of spill.

**Supervisor/Foreman Will:**

- 2) Identified spilled material and chemical class (*flammable liquid, acid, base, unknown*).
  - 3) Assign person(s) to clean up spill (if material is known).
- or
- 4) Contact Environmental Health and Safety Compliance Department to assist in identification and cleanup of spilled material.

**Person Who Discovers the Spill Will:**

- 5) Follow procedures in *Guidelines for Cleanup of Minor Spills* or recommendations of the Environmental Health and Safety Compliance Department.

## GUIDELINES FOR CLEANUP OF MINOR SPILLS

### FLAMMABLE LIQUIDS<sup>1</sup>:

Examples:	<i>Gasoline, organic solvents, paint thinner</i>
Health Hazards:	Inhalation of vapors can cause dizziness, headache, nausea. Liquid may be absorbed through skin and cause systemic effects.
Protective Clothing:	Chemical-protective gloves, respirator with organic vapor cartridges, safety goggles.
Response Procedures:	<ul style="list-style-type: none"><li>• Remove all sources of ignition</li><li>• Obtain medical attention for injured person(s) if necessary</li><li>• Restrict access to affected area</li><li>• Don protective clothing</li><li>• Spread absorbent material to contain and absorb liquid</li><li>• Use a shovel, if necessary, to dispose of used absorbent material</li><li>• Store used absorbent material in vapor tight drum</li><li>• Wash affected area with soap and water</li><li>• Dispose of used absorbent material as hazardous waste</li></ul>

<sup>1</sup> May also use these procedures for "Miscellaneous Liquids"

### CAUSTICS:

Examples:	<i>Strong bases, such as hydroxides</i>
Health Hazards:	Can cause severe burns to skin, eyes, and mucous membranes.
Protective Clothing:	Neoprene gloves, respirator with acid gas/organic vapor cartridges, safety goggles.
Response Procedures:	<ul style="list-style-type: none"><li>• Avoid contact with waste to extent possible</li><li>• if eyes affected, flush with water</li><li>• Remove all contaminated clothing and flood skin with water</li><li>• Wash affected skin areas with soap and water</li><li>• Obtain medical attention for injured person(s)</li><li>• Restrict access to affected area</li><li>• Don protective clothing</li><li>• Use absorbent material (for example, rags or towels) to contain and absorb spilled material</li><li>• Use shovel or other implement to store used absorbent material in covered drum</li><li>• Wash the spill area with soap and water (if spill is located near a drain, be sure to prevent runoff to drain by creating a berm around the drain using absorbent materials)</li><li>• Dispose of used absorbent material as hazardous waste</li></ul>

**ACIDS:**

- Examples: *Strong mineral acids such as sulfuric acid, nitric acid*
- Health Hazards: Liquid may cause severe burns to skin, eyes, and mucous membranes
- Protective Clothing: Neoprene gloves, respirator with acid gas/organic vapor cartridges, safety goggles.
- Response Procedures:
- Avoid contact with waste to extent possible
  - If eyes affected, flush with water
  - Remove all contaminated clothing and flood skin with water
  - Wash affected skin areas with soap and water
  - Obtain medical attention for injured person(s)
  - Restrict access to affected area
  - Don protective clothing
  - Use absorbent material to contain and absorb spilled material
  - **DO NOT USE RAGS OR TOWELS TO CLEAN UP SPILL AS SPONTANEOUS IGNITION COULD OCCUR**
  - Neutralize residual acid with sodium carbonate (soda) and water (until foaming ends)
  - Use absorbent material to pick up neutralized acid
  - Use shovel or other implement to store used absorbent material in covered drum
  - Wash the spill area with soap and water (if spill is located near a drain, be sure to prevent runoff to drain by creating a berm around the drain using absorbent materials)
  - Dispose of used absorbent material as hazardous waste

**AQUEOUS WASTE:**

- Examples: *Nonflammable water solutions, such as antifreeze*
- Health Hazards: Vapors may be irritating. Skin contact with waste may cause skin irritation or systemic effects
- Protective Clothing: Neoprene gloves, respirator with acid gas/organic vapor cartridges, safety goggles.
- Response Procedures:
- Obtain medical attention for injured person(s) if necessary
  - Restrict access to affected area
  - Don protective clothing
  - Use absorbent material to contain and absorb spilled material
  - Use shovel or other implement to store used absorbent material in covered drum
  - Wash the spill area with soap and water (if spill is located near a drain, be sure to prevent runoff to drain by creating a berm around the drain using absorbent materials)
  - Dispose of used absorbent material as hazardous waste

Note: A major spill involves more than one gallon of an identified material, requires more than two persons to clean up the spill, or involves an unknown chemical. The following procedures apply only to spills that do not pose an imminent fire or explosion hazard.

#### Person Who Discovers the Spill Will:

- 1) Stop discharge source if it is safe to do so.
- 2) Contact the Supervisor/Forman (if Supervisor has not been involved in the response).
- 3) Take care of injured only if it is safe to do so.
- 4) Contact City of Oakland Fire Department at 911 and state the nature of the incident (identify, quantity, and rate of flow, location, injuries, fire, police, and medical response requirements). The Emergency Coordinator will provide information on the potential health hazards and the requirements for personal protective clothing.
- 5) Evacuate and cordon off area to restrict access. If safe to do so, contain the release by constructing dikes around the spill; prevent discharge of spilled material into drains or off-site, to the maximum extent possible.
- 6) **DO NOT ENTER AREA OF SPILL UNLESS FULLY PROTECTED BY PROPER PERSONAL PROTECTIVE EQUIPMENT.**

#### Emergency Coordinator Will:

- 7) Evaluate the chemical, fire, and explosive, environmental, or other hazard and contact appropriate response agencies, medical assistance, and/or cleanup contractors.
- 8) Assemble available trained emergency response personnel (e.g., contractors and fire department personnel) on-site and brief them of the nature and extent of the emergency. Emergency Coordinator will relinquish chain-of-command to any individual higher on the chain-of-command.
- 9) Notify appropriate agencies of spill incident.

(continued)

- 
- 10) Monitor for leaks, pressure buildup, gas generation, ruptured valves, pipes, or other equipment if facility operations are disrupted or stopped. Continue monitoring until normal operations resume.
  - 11) Determine when cleanup activities have been completed, in consultation with agencies have jurisdiction (if appropriate).
  - 12) Ensure proper removal, disposal or decontamination of personal protective equipment and spill cleanup materials.
  - 13) Restrict reentry into the affected areas(s) until the area is deemed safe. Check that used emergency and personal protective equipment are cleaned and/or serviced for safe reuse.
  - 14) Critique effectiveness of emergency response actions and distribute findings to appropriate PORT departments.

Note: The procedures described below are for fires and explosions that involve hazardous materials. These procedures also apply to a *major spill* of hazardous materials that poses an imminent fire and explosion hazard.

**Person Who Discovers the Emergency Will:**

- 1) Alert people who are in immediate danger to evacuate building (and site if appropriate). Assist in the evacuation of injured, **only if it can be done safely.**
- 2) Contact City of Oakland Fire Department at 911 (24-hours). **Stay on the line** until the dispatcher has completed questioning and **hangs up.**
- 3) If the fire is minor, with no potential for explosion, and if a trained, qualified person is available on-site, then the person may attempt to put out the fire. Personnel putting out the fire must know the chemical hazard of the material, don proper protective equipment, and use the appropriate fire extinguisher. **DO NOT ENTER AREA OF FIRE IF POTENTIAL FOR EXPLOSION EXISTS.**
- 4) Contact the Supervisor/Foreman.
- 5) Contact the Emergency Coordinator.

**Supervisor/Foreman Will:**

- 6) Ensure that all personnel in their respected work groups are accounted for - either in the safe area or off-site.

**Emergency Coordinator Will:**

- 7) Assess the potential environmental impacts and contact the appropriate spill cleanup contractors.
- 8) Notify Appropriate agencies of the emergency.
- 9) Determine when cleanup activities have been completed, in consultation with agencies having jurisdiction (if appropriate).
- 10) Ensure proper removal, disposal, or decontamination of personal protective equipment and spill cleanup materials.

(continued)

- 
- 11) Restrict reentry into the affected area(s) until the area is deemed safe. Check that used emergency and personal protective equipment are cleaned and/or serviced for safe reuse.
  - 12) Critique effectiveness of emergency response actions and distribute findings to appropriate PORT departments.



Note: **Poisoning** can occur from ingestion, inhalation, or absorption of chemicals through the skin of chemicals (for example, pesticides and herbicides). Recognizing a case of poisoning may be difficult because the symptoms are varied and can be caused by other factors. Prompt medical attention is vital

**Person Who First Recognizes a Case of Poisoning Will:**

- 1) Attempt to identify the poison and estimate the quantity ingested.
- 2) Contact City of Oakland Fire Department at 911 (24-hours) to request medical assistance.
- 3) Notify the Supervisor.
- 4) Cover the patient while waiting for medical assistance and monitor the vital signs. **A trained and certified person may administer CPR if needed.**

**Personnel at the Site Will:**

- 1) During an earthquake, attempt to move under a doorway, desk, or table. Stay clear of windows, cabinets, and shelves. Leave hazardous waste storage areas if possible to do so safely. **DO NOT RUN THROUGH OR NEAR BUILDINGS.** If persons are outside, get into open areas away from buildings and power lines.

**Supervisor/Foreman Will:**

- 2) Turn off main gas valves and electrical switches when safe to do so.
- 3) Check for injuries.
- 4) Check for overturned or ruptured containers, if the earthquake was small or moderate, and no structural damage is obvious.
- 5) In the event of a *minor* or *major spill*, follow response procedures for *minor spills* or *major spills*.
- 6) In the event of fire, follow response procedures for fires or explosions.
- 7) Contact the Emergency Coordinator, if necessary, to perform air monitoring to confirm containers and gas lines are tight.

(1)  ADD  DELETE  REVISE

PAGE (2) 38

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 & 4 GRID# (7) Rm J & Rm B

CHEMICAL NAME (8) COLD GALVANIZING ZINC TRADE SECRET (11)  Y  N

COMMON NAME (9) CRC ZINC MATE EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 0.24

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 0.24

LARGEST CONTAINER (21) 0.13 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 15	PROPANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	74986
2 38	ZINC DUST	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	7440666
3 34	METHYL ETHYL KETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	78933
4 10	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Note: 0.11 gal stored at E-417, Rm B

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 39

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) ASPHALT PRODUCT TRADE SECRET (11)  Y  N

COMMON NAME (9) PLASTIC ROOF CEMENT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT MAX DAILY AMT (23) 10.00  
 LBS  TONS

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 10.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 50	ASPHALT	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2 25	SOLVENTS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	proprietary
3 13	ASBESTOS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
4 12	ADDITIVES	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

[Empty box for additional locally collected information]

(1)  ADD  DELETE  REVISE

PAGE (2) 40

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm D

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) DIXON RAILROAD #60 SWITCH PLATE LUBRICANT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 56	XYLENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	1330207
2 25	GRAPHITE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	7782425
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

(1)  ADD  DELETE  REVISE

PAGE (2) 41

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm J

CHEMICAL NAME (8) MINERAL SPIRITS TRADE SECRET (11)  Y  N

COMMON NAME (9) KELLY MOORE MINERAL SPIRITS EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 60.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 60.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	64475850
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 42

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) LP STAIN REMOVER EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 43

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm L, T2

CHEMICAL NAME (8) ORANGE TERPENES SOLVENT

TRADE SECRET (11)  Y  N

COMMON NAME (9) MANTEK FRESH FORCE

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) combustible liquid, irritant

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)

GAL  CU FT  
 LBS  TONS

MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input checked="" type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	D-LIMONENE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	5989275
2	GLYCOL ETHERS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	127087870
3	OCTYLPHENOXYPOLYETHONOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	9036195
4	PROPANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	74986
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION



California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 44

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm Ba

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) MANTEK LEM'N LIFT EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 5.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 5.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 45

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm L, T1

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) RICMAR GROUT WHITNER EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 2.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 2.00

LARGEST CONTAINER (21) 2.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 48

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm C

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) RUST POLY HD127 TAR AND ASPHALT REMOVER

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)

GAL  CU FT  
 LBS  TONS

MAX DAILY AMT (23) 20.00

DAYS ON SITE (20) 365

if EHS amounts must be in lbs

AVG DAILY AMT (24) 20.00

LARGEST CONTAINER (21) 10.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input checked="" type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 47

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) Building:2ND STREET YARD

MAP# (6) GRID# (7) /

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) TE-KA TEAK WOOD CLEANER FORMULA A EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 48 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) Building: E-417

MAP# (6) GRID# (7) /

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BOWMAN CUTTING TOOL COOLANT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 0.66

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 0.66

LARGEST CONTAINER (21) 0.66 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 49

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:E-417  
 MAP# (6) 4 GRID# (7) Rm B

CHEMICAL NAME (8) AREOSOL SPRAY TRADE SECRET (11)  Y  N  
 COMMON NAME (9) BOWMAN EASY ANTI-SEIZE EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13) flammable liquid

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 0.06

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 0.06

LARGEST CONTAINER (21) 0.06 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1 27	1,1,1 TRICHLOROETHANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	71556
2 27	ACETONE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	67841
3 15	PROPANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	74986
4 5	N-BUTANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	106978
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 50 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:E-417

MAP# (6) 4 GRID# (7) Rm B

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) KAR SHOP SOLVENT EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) flammable liquid, irritant

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 0.09

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 0.09

LARGEST CONTAINER (21) 0.09 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	97.00	1,1,1-TRICHLOROETHANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	71-55-6
2	3.00	CARBON DIOXIDE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	124-38-9
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 51 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm Ba

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) AJAX CLEANSER EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Irritant

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT MAX DAILY AMT (23) 0.49

DAYS ON SITE (20) 365 IF EHS amounts must be in lbs AVG DAILY AMT (24) 0.49

LARGEST CONTAINER (21) 0.12 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	CLOROX BLEACH	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.



(1)  ADD  DELETE  REVISE

PAGE (2) 52

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm Ba

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BORAXO POWDERED HAND SOAP EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16)

PHYSICAL STATE (17)  SOLID  LIQUID  GAS CURIES

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 50.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 50.00

LARGEST CONTAINER (21) 50.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

(1)  ADD  DELETE  REVISE

PAGE (2) 53 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm C

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) GASOLINE EHS (12)  Y  N

CAS # (10) 8006-61-9 IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Flammable Liquid (FL1B), Irritants (IR )

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 15.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 15.00

LARGEST CONTAINER (21) 15.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	GASOLINE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 54

OF (3) 85

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm L, T2

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) MANTEK MANULAR INSECTICIDE

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 0.99

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 0.99

LARGEST CONTAINER (21) 0.99

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

ABOVE GROUND TANK  CAN  BOX  TANK WAGON

UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR

TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....

STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE

PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 55

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (5) 3 GRID# (7) Rm J

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) PROPANE EHS (12)  Y  N  
 CAS # (10) 74-98-6 IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 7.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 7.00

LARGEST CONTAINER (21) 7.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	99.98	LIQUEFIED PETROLEUM GAS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	74-98-8
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 56

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm L, T2

CHEMICAL NAME (8) HOT PATCH UNIT

TRADE SECRET (11)  Y  N

COMMON NAME (9) QUICKRETE BLACK TOP PATCH

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) oxidizer

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 160.00

DAYS ON SITE (20) 365

if EHS amounts must be in lbs

AVG DAILY AMT (24) 180.00

LARGEST CONTAINER (21) 80.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  .....  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	ZINC OXIDE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
2	POTASSIUM NITRATE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
3	PARAFFINIC OIL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
4	IRON OXIDE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 57 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:E-417

MAP# (6) 4 GRID# (7) Rm A

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) GASOLINE EHS (12)  Y  N

CAS # (10) 8006-61-9 IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) Flammable Liquid (FL1B), Irritants (IR )

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 20.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 20.00

LARGEST CONTAINER (21) 10.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 58

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:E-417

MAP# (6) 4 GRID# (7) Rm B & Rm III E

CHEMICAL NAME (8) TRADE SECRET (11)  Y  N

COMMON NAME (9) BOWMAN HEAVY SILICONE LUBE EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13) consumer commodity, ORM-D, UN1954

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 0.14

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 0.14

LARGEST CONTAINER (21) 0.14 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	17	MINERAL SPIRITS	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	8052413
2	54	1,1,1 TRICHLOROETHANE	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	71556
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

(1)  ADD  DELETE  REVISE

PAGE (2) 59 OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm J

CHEMICAL NAME (8) ACRI-PELX LATEX TRADE SECRET (11)  Y  N

COMMON NAME (9) KELLY MOORE ACRYLIC FLAT FINISH EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 90.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 90.00

LARGEST CONTAINER (21) 5.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1	TEXANOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	25385774
2	ETHYLENE GLYCOL	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N	107415
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION



California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 60

OF (3) 85

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:E-417

MAP# (6) 4

GRID# (7) Rm E

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) TRAVCO GRAFITE EPOXY WATERPROOF SEALANT

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)  GAL  CU FT  LBS  TONS

MAX DAILY AMT (23) 1.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 1.00

LARGEST CONTAINER (21) 1.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input checked="" type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

Empty box for additional locally collected information.

(1)  ADD  DELETE  REVISE

PAGE (2) 61

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm A

CHEMICAL NAME (8)

TRADE SECRET (11)  Y  N

COMMON NAME (9) WASTE DIESEL

EHS (12)  Y  N

CAS # (10)

IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE

RADIOACTIVE (15)  Y  N

(16)

CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19)

UNITS (22)

GAL  CU FT  
 LBS  TONS

MAX DAILY AMT (23) 110.00

DAYS ON SITE (20) 365

If EHS amounts must be in lbs

AVG DAILY AMT (24) 110.00

LARGEST CONTAINER (21) 55.00

ANNUAL WASTE AMOUNT (25)

STORAGE (26)

<input type="checkbox"/> ABOVE GROUND TANK	<input type="checkbox"/> CAN	<input type="checkbox"/> BOX	<input type="checkbox"/> TANK WAGON
<input type="checkbox"/> UNDER GROUND TANK	<input type="checkbox"/> CARBOY	<input type="checkbox"/> CYLINDER	<input type="checkbox"/> RAIL CAR
<input type="checkbox"/> TANK INSIDE BUILDING	<input type="checkbox"/> SILO	<input type="checkbox"/> GLASS BOTTLE	<input type="checkbox"/> .....
<input checked="" type="checkbox"/> STEEL DRUM	<input type="checkbox"/> FIBER DRUM	<input type="checkbox"/> PLASTIC BOTTLE	
<input type="checkbox"/> PLASTIC/NONMETALIC DRUM	<input type="checkbox"/> BAG	<input type="checkbox"/> TOTE BIN	

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 62

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3

GRID# (7) Rm A

CHEMICAL NAME (8) WASTE FLAMMABLE LIQUIDS (LACQUER THINNER, GAS, MIN) TRADE SECRET (11)  Y  N

COMMON NAME (9) EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 55.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 55.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 63

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD

CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD

MAP# (6) 3 GRID# (7) Rm A

CHEMICAL NAME (8) WASTE OIL TRADE SECRET (11)  Y  N

COMMON NAME (9) EHS (12)  Y  N

CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS

FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 55.00

DAYS ON SITE (20) 365 IF EHS amounts must be in lbs AVG DAILY AMT (24) 55.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25) 55.00

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 64

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm A

CHEMICAL NAME (8) WASTE OIL SOLIDS (USED OIL RAGS) TRADE SECRET (11)  Y  N  
 COMMON NAME (9) EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 55.00

DAYS ON SITE (20) 365 If EHS amounts must be in lbs AVG DAILY AMT (24) 55.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1		<input type="checkbox"/> Y <input type="checkbox"/> N	
2		<input type="checkbox"/> Y <input type="checkbox"/> N	
3		<input type="checkbox"/> Y <input type="checkbox"/> N	
4		<input type="checkbox"/> Y <input type="checkbox"/> N	
5		<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

California Hazardous Materials Inventory Reporting Form - Chemical Description Page

(1)  ADD  DELETE  REVISE

PAGE (2) 65

OF (3) 65

BUSINESS NAME (4) HARBOR FACILITIES CORPORATION YARD  
 CHEMICAL LOCATION (5) BUILDING:2ND STREET YARD  
 MAP# (6) 3 GRID# (7) Rm A

CHEMICAL NAME (8) WASTE PAINTS TRADE SECRET (11)  Y  N  
 COMMON NAME (9) EHS (12)  Y  N  
 CAS # (10) IF EHS BOX IS "Y" ALL AMOUNTS MUST BE IN LBS  
 FIRE CODE HAZARD CLASS (13)

COMPLETE BLOCK (13) IF REQUESTED BY THE LOCAL FIRE CHIEF - REFER TO INSTRUCTIONS.

TYPE (14)  PURE  MIXTURE  WASTE RADIOACTIVE (15)  Y  N (16) CURIES

PHYSICAL STATE (17)  SOLID  LIQUID  GAS

FED HAZARD (18)  FIRE  REACTIVE  PRESSURE RELEASE  ACUTE HEALTH  CHRONIC HEALTH

STATE WASTE CODE (19) UNITS (22)  GAL  CU FT  LBS  TONS MAX DAILY AMT (23) 55.00

DAYS ON SITE (20) 385 If EHS amounts must be in lbs AVG DAILY AMT (24) 55.00

LARGEST CONTAINER (21) 55.00 ANNUAL WASTE AMOUNT (25)

STORAGE (26)  ABOVE GROUND TANK  CAN  BOX  TANK WAGON  
 UNDER GROUND TANK  CARBOY  CYLINDER  RAIL CAR  
 TANK INSIDE BUILDING  SILO  GLASS BOTTLE  
 STEEL DRUM  FIBER DRUM  PLASTIC BOTTLE  
 PLASTIC/NONMETALIC DRUM  BAG  TOTE BIN

STORAGE PRESSURE (27)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT

STORAGE TEMPERATURE (28)  AMBIENT  ABOVE AMBIENT  BELOW AMBIENT  CRYOGENIC

	(29) %WT	(30) HAZARDOUS COMPONENT	(31) EHS	(32) CAS#
1			<input type="checkbox"/> Y <input type="checkbox"/> N	
2			<input type="checkbox"/> Y <input type="checkbox"/> N	
3			<input type="checkbox"/> Y <input type="checkbox"/> N	
4			<input type="checkbox"/> Y <input type="checkbox"/> N	
5			<input type="checkbox"/> Y <input type="checkbox"/> N	

(33) ADDITIONAL LOCALLY COLLECTED INFORMATION

**APPENDIX D**

**EMERGENCY NOTIFICATION LOG FORM**

**EMERGENCY NOTIFICATION LOG FORM  
PORT OF OAKLAND**

Agency: Port of Oakland, Environmental Health & Safety Compliance Department      Day: (510) 272-1176  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: Oakland Fire Department/Police Department/Paramedic      Day: 911 or (510) 444-3322  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: State Office of Emergency Services      Day: (800) 852-7550  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: National Response Center      Day: (800) 424-8802  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: U.S. Coast Guard      Day: (510) 437-3073  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: California Department of Fish and Game Regional Headquarters      Day: (707) 944-5500  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: Regional Water Quality Control Board, S.F. Bay Region      Day: (510) 286-1255  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: State Land Division      Day: (213) 590-5201  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: U.S. Environmental Protection Agency      Day: (415) 974-8071  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_

Agency: Bay Area Air Quality Management District      Day: (415) 771-6000  
Time/Date: \_\_\_\_\_      Evening: \_\_\_\_\_  
Contact Person: \_\_\_\_\_




**APPENDIX E**

**SAFE AREA AND BUILDING EGRESS ROUTES, EVACUATION ROUTES**

# SAFE AREA AND SITE EGRESS ROUTES


Figure F-1

DRAFT

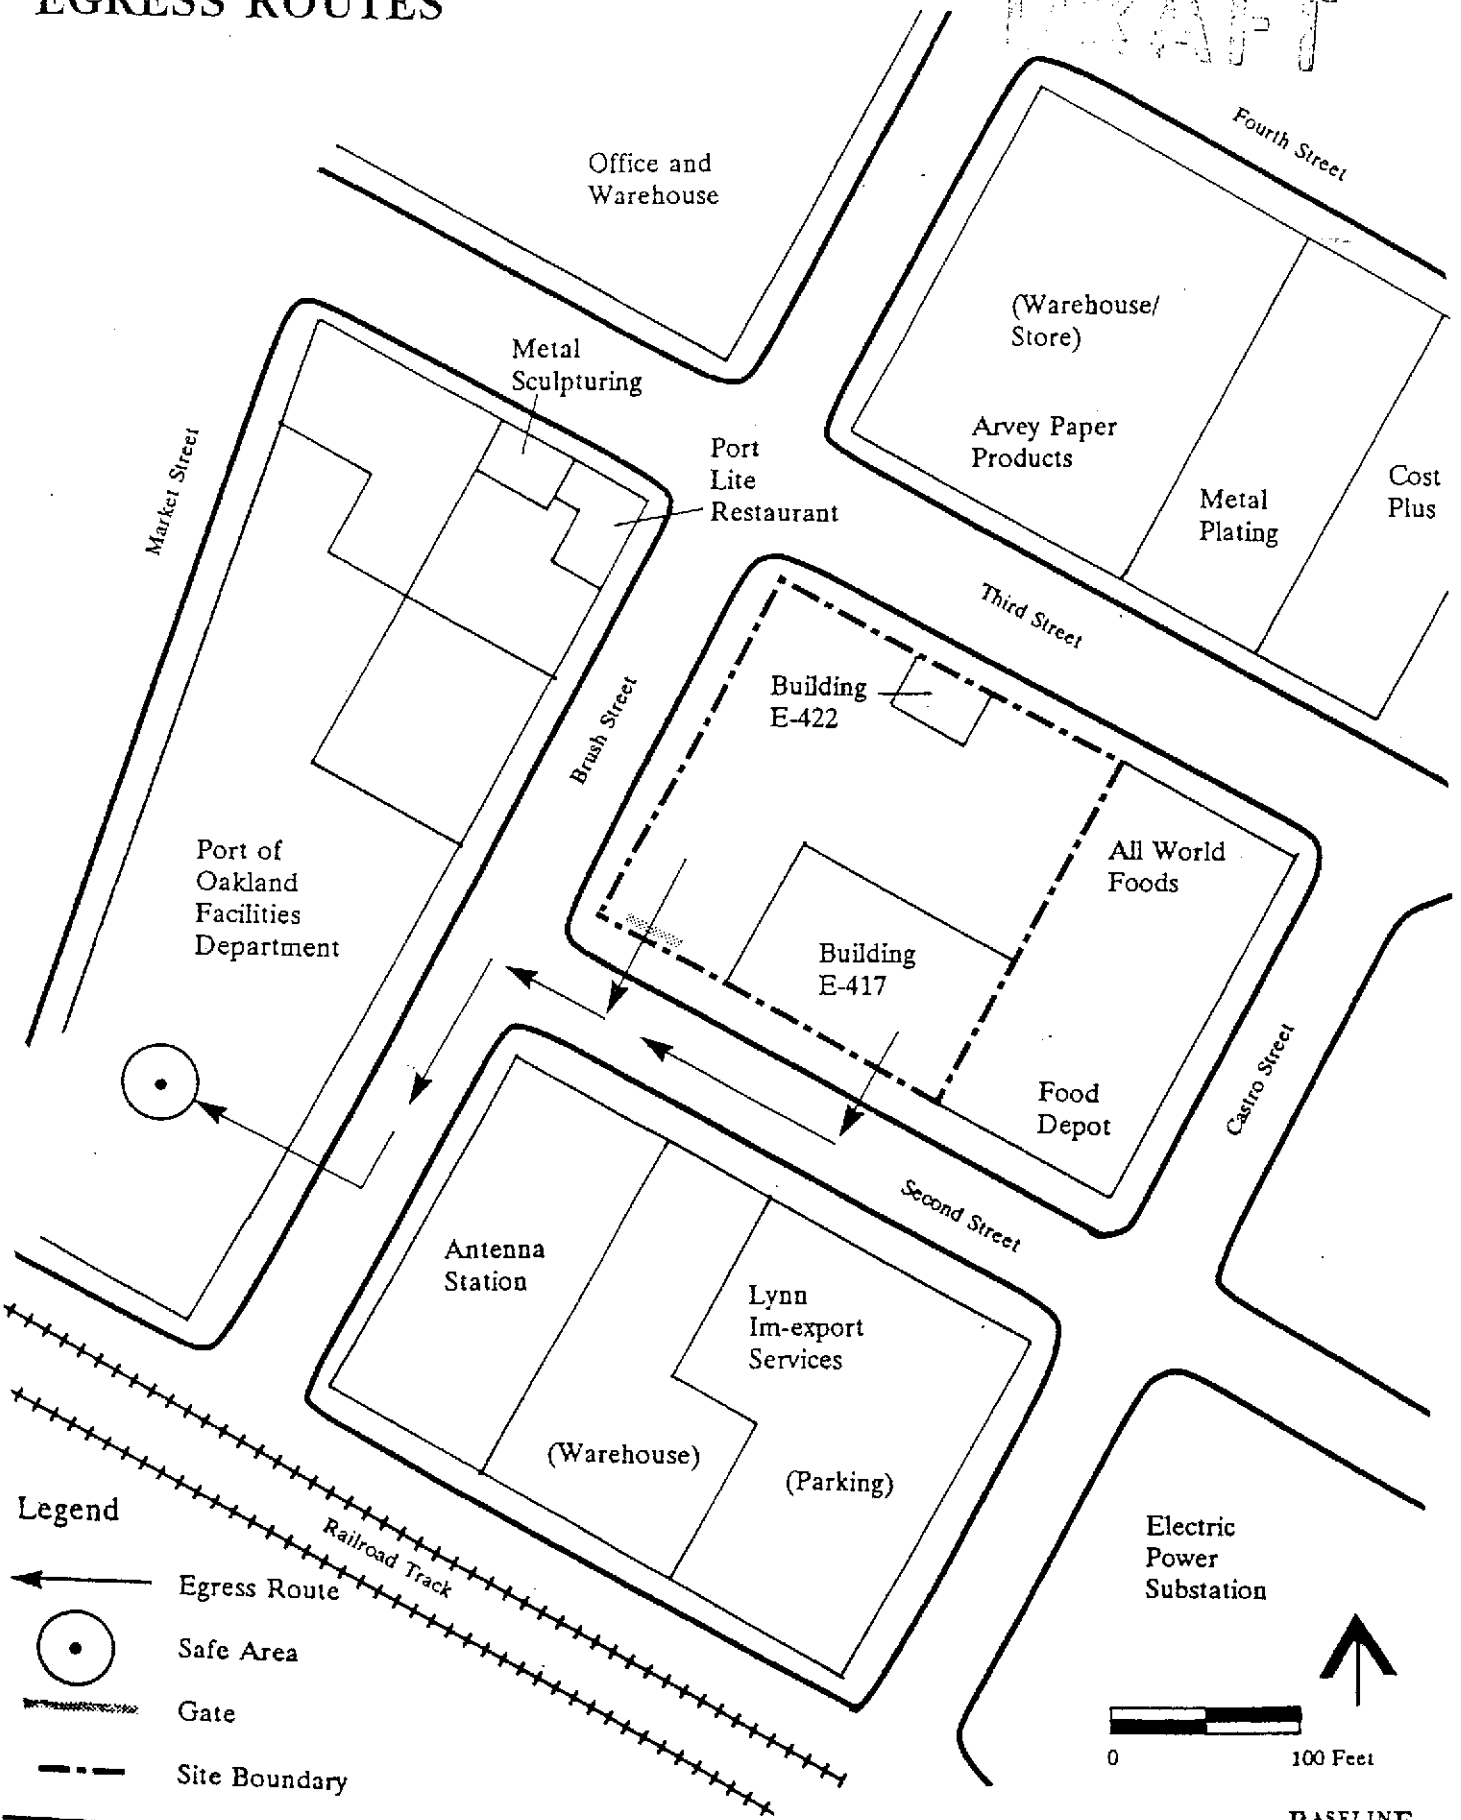

**Legend**


- ← Egress Route
- Safe Area
- ▨ Gate
- - - Site Boundary

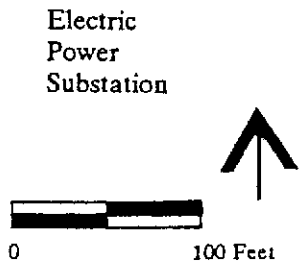

# BUILDING EGRESS ROUTES

Figure F-2


DRAFT

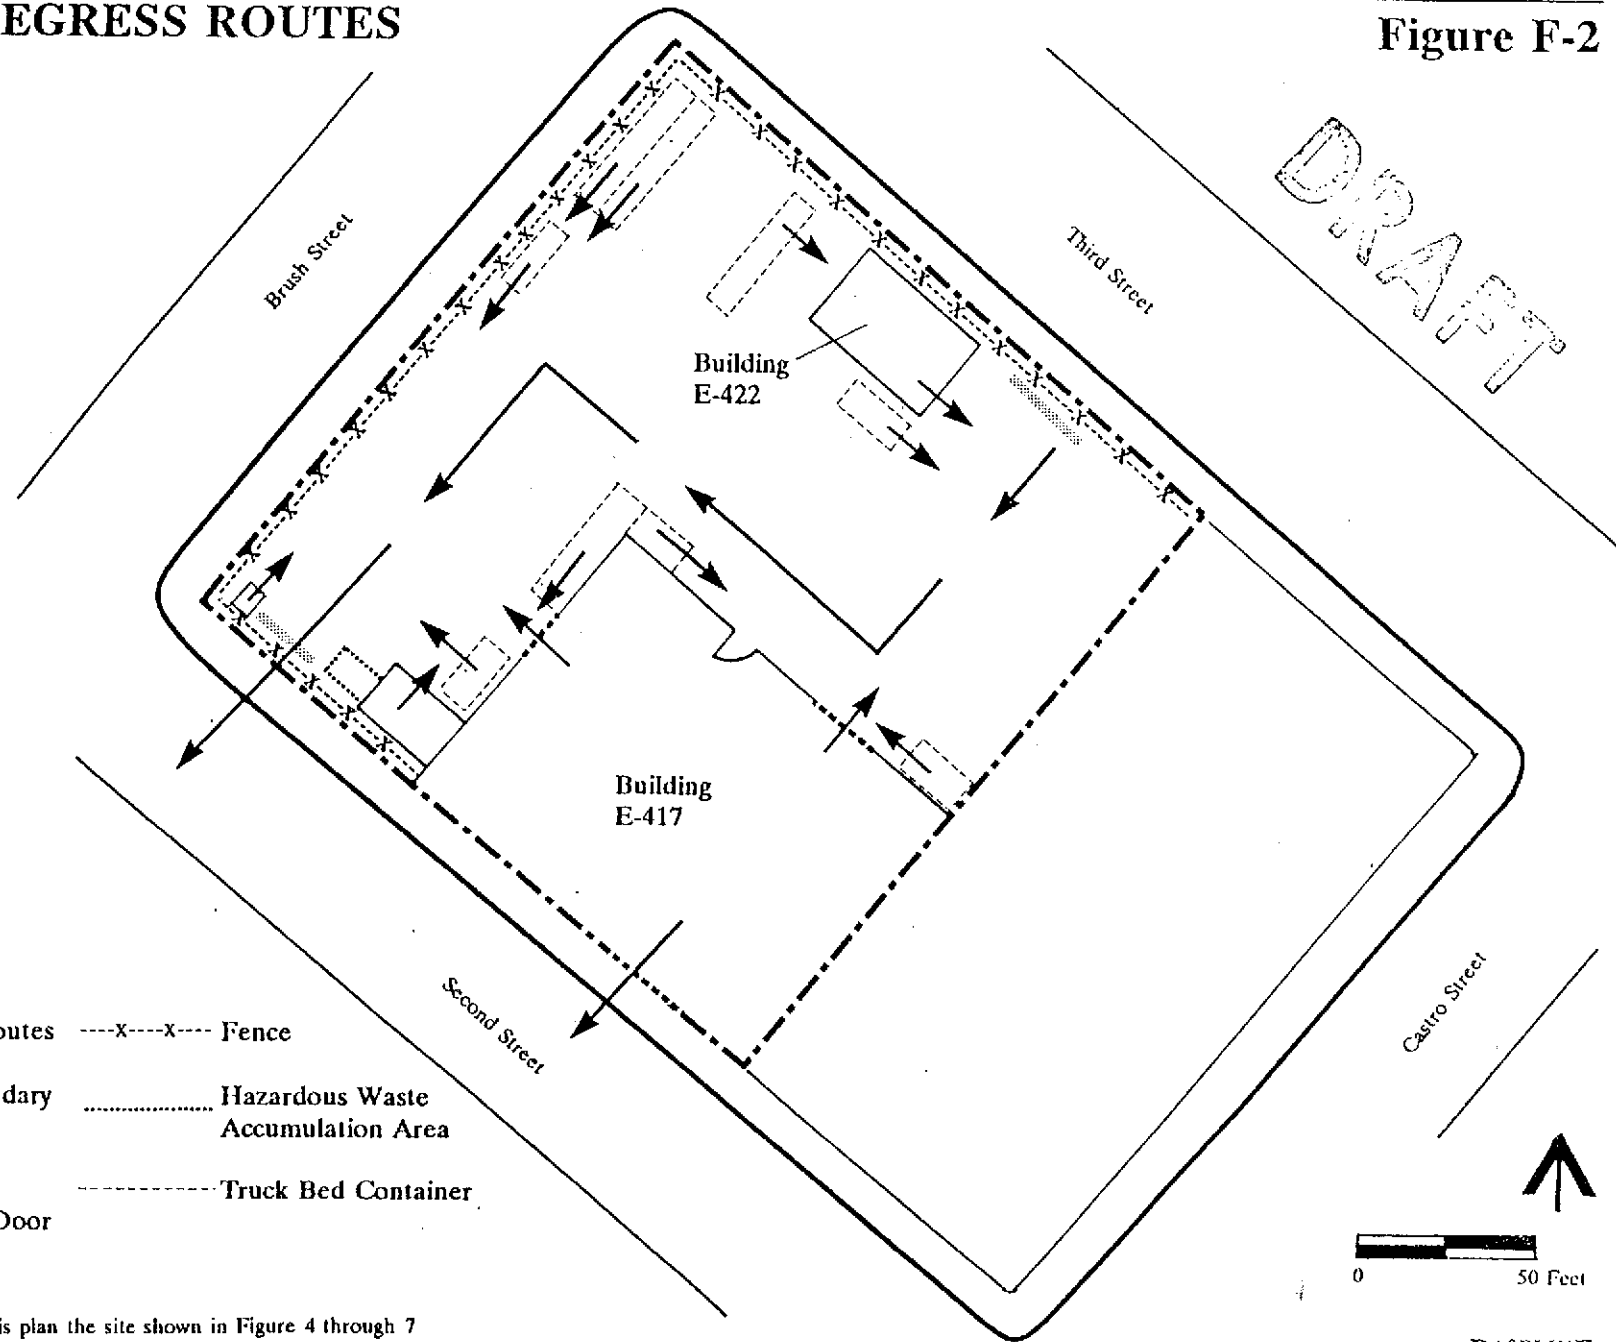

## Legend

- ← Egress Routes
- x---x--- Fence
- Site Boundary
- ..... Hazardous Waste Accumulation Area
- ⌒ Doorway
- Truck Bed Container
- ..... Roll Up Door
- ▨ Gate


Note: For the purposes of this plan the site shown in Figure 4 through 7 according to four areas: Area I, Area II, Area III, and Area IV.



# BUILDING E-417 EVACUATION ROUTES

Figure F-3

DRAFT

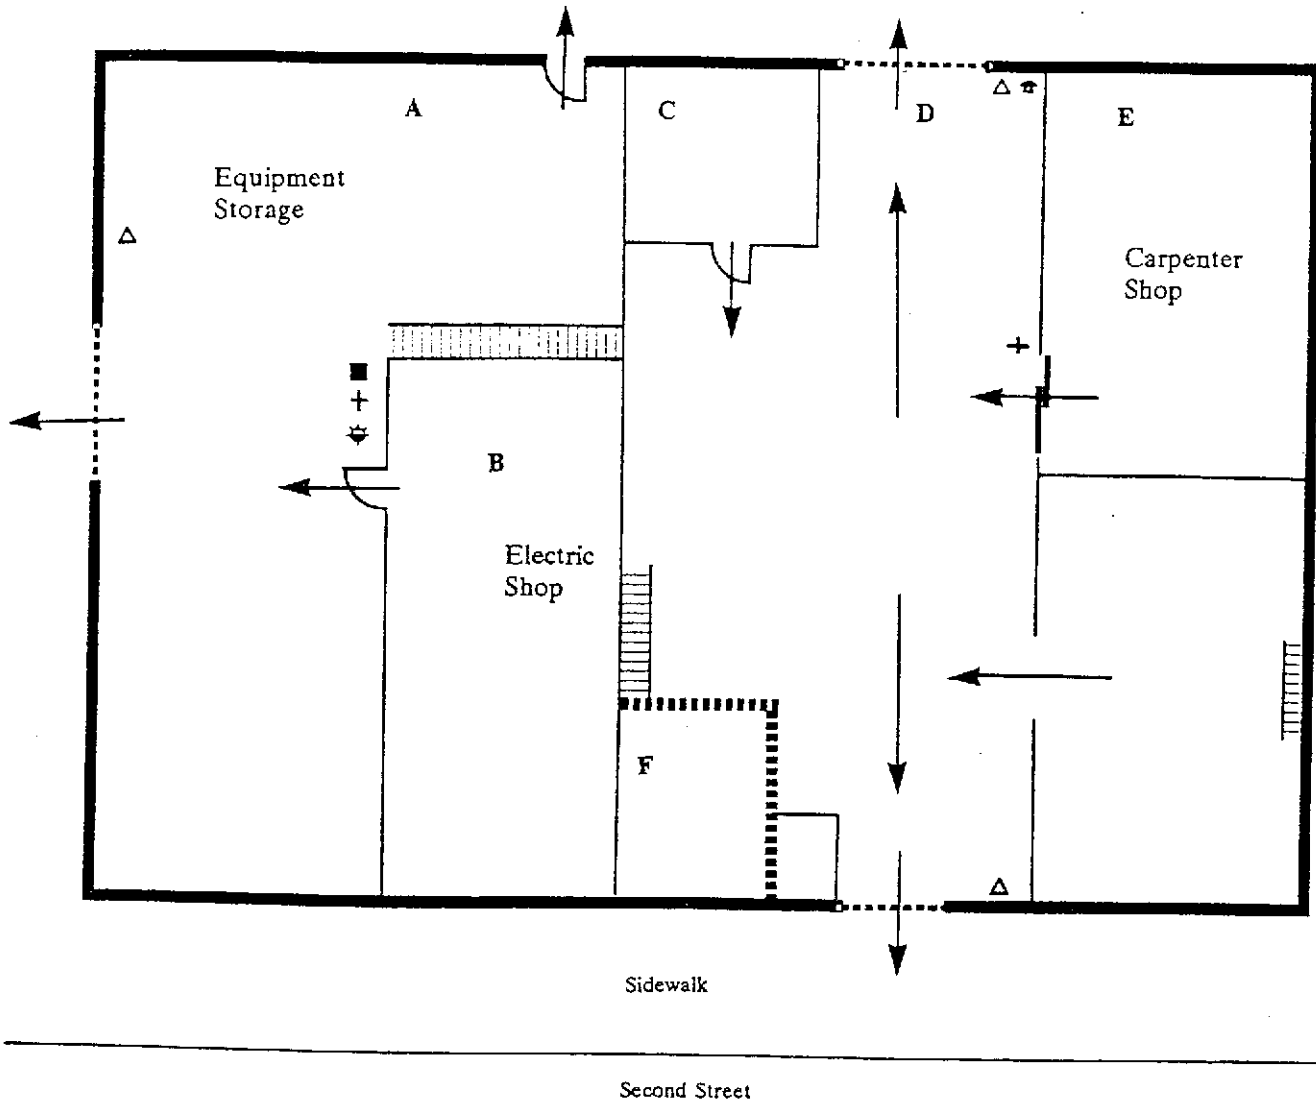

## Legend

← Evacuation Routes

— Doorway

- - - Roll Up Door

Δ Fire Extinguisher

☐ Telephone (for emergency calls only)

▤ Stairs

⚡ MSDS Binder

+ First Aid Kit

■ Emergency Station

⋯ Canopy


— Sliding Door









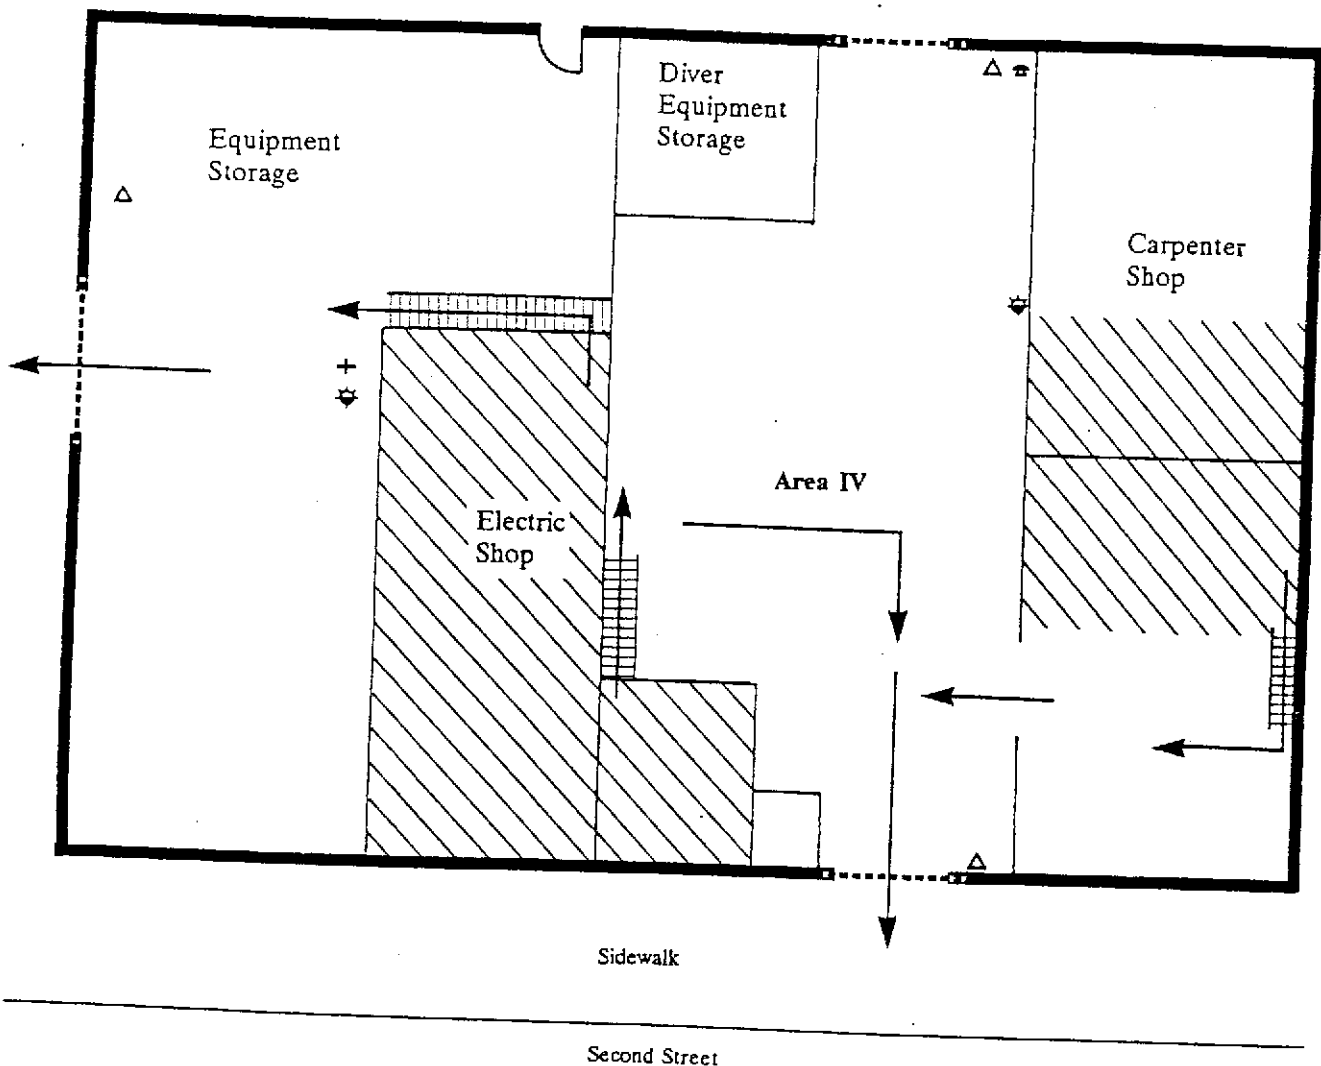


# BUILDING E-417 MEZZANINE LEVEL EVACUATION ROUTES


Figure F-4

DRAFT



Legend

-  Evacuation Routes
-  Doorway
-  Roll Up Door
-  Fire Extinguisher
-  Stairs
-  Telephone (for emergency calls only)
-  MSDS Binder
-  First Aid Kit
-  Mezzanine Levels

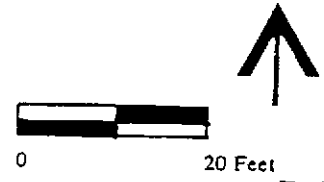

05 2/26/92

BASELINE

**APPENDIX F**

**COMPLETE INVENTORY OF HAZARDOUS AND NON-HAZARDOUS MATERIALS STORED AT  
E-417 AND 2ND STREET YARD**

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	A		ACE Latex Traffic Marking Paint	1	gallons	Liquid	Product	Can	Electrician
E-417	A		AIM Acrylic Core Base	3½	gallons	Liquid	Product	Can	Electrician
E-417	A		American Oleum Dry set Morter	50	pounds	Solid	Product	Bag	Electrician
E-417	A		Burke U-Seal 3203 Primer Part B	1	quart	Liquid	Product	Can	Electrician
E-417	A		Burke U-Seal Joint Sealant 3202 Part A	5	gallon	Liquid	Product	Can	Electrician
E-417	A		Gasoline	3 - 5	gallon	Liquid	Product	Can	Electrician
E-417	A		KAR Kar Coat Red iron Oxide Primer	18.1	ounces	Liquid	Product	Can	Electrician
E-417	A		Mantek Cold Galvanizing	16	ounces	Liquid	Product	Aercan	Electrician
E-417	A		MD Acrylic Latex Driveway repair	30	ounces	Liquid	Product	Aercan	Electrician
E-417	A		MD Multi Purpose Flooring & Carpenteret Adhesive	1	quart	Liquid	Product	Can	Electrician
E-417	A		Mgrville Fiberglass Insulation	9	cubic ft	Solid	Product	Bag	Electrician
E-417	A		Parhand M273 Acrylic Color Base Adhesive	1	gallon	Liquid	Product	Can	Electrician
E-417	A		Quikrete Black Top Patch	180	pound	Solid	Product	Bag	Electrician
E-417	A		Rustoleum High Performance Epoxy 9101 Activator	1	gallon	Liquid	Product	Can	Electrician
E-417	A		Seal Cote 648 CP Grant Liquid	22	pound	Liquid	Product	Can	Electrician
E-417	A		Sentry Fire Extinguisher	1	each	Solid	Product	Cylinder	Electrician
E-417	A		Sep T Sorb Absorbent	15	pound	Solid	Product	Bag	Electrician
E-417	A		Tnemec Enduroshield Part A	1	gallon	Liquid	Product	Can	Electrician
E-417	A		Ultra Last 144 Traffic & Turf Marker	87½	ounces	Liquid	Product	Aercan	Electrician
E-417	A		Zynolyte Superchrome Finish	22	ounces	Liquid	Product	Aercan	Electrician
E-417	B		ACE Late House & Trim Paint	1	gallon	Liquid	Product	Can	Electrician
E-417	B		ACE Latex Traffic Marking Paint	1	gallon	Liquid	Product	Can	Electrician
E-417	B		Aerroe Insulating Epoxy Coating	12½	ounces	Liquid	Product	Aercan	Electrician
E-417	B		AIS Coil-X-A Cooling Coil Cleaner	36	ounces	Liquid	Product	Aercan	Electrician
E-417	B		AIS Sanigel Hand Sanitizer	16	ounces	Liquid	Product	Aersol Spray	Electrician
E-417	B		AIS Tutto-ng, Junior Orange Hand Cleaner	15	ounces	Solid	Product	Can	Electrician

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	B		AIS Invisible Skin Barrier Cream	42	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Appleton Apelo Sealing Cement	1	pounds	Solid	Product	Can	Electrician
E-417	B		Bowman Clear Acrylic Coating	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Cutting Tool Coolant (Conditioner)	84	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Easy Anti-Seize Lubricant	8	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Easy Sealant Adhesive (Parts A & B)	8	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Fluorescent Paint	66	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Galv-Coat	13	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Glass Cleaner	23	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Gloss Black Paint (white)	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Heavy Duty Silicone Lube	9-3/4	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Hi Heat and Header Enamel Paint	24	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Rust Penetrant	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Safety Solvent	15-3/4	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Silicone Easy Gasket Maker (red)	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman White Lube Lithium Grease	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Bowman Windshield Washer Concentrate	1	quart	Liquid	Product	Bottle	Electrician
E-417	B		Calgon Vestal Gas Leak Detector	6	ounces	Liquid	Product	Bottle	Electrician
E-417	B		Cantex PVC Conduit Solvent Cement	1	quart	Liquid	Product	Can	Electrician
E-417	B		Certified Dylek 200	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Certified Free Penetrant	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Certified Kool Spray Chemical Cutting Fluid	13	ounces	Liquid	Product	Aercan	Electrician
E-417	B		CRC 2-22	11	ounces	Liquid	Product	Aercan	Electrician
E-417	B		CRC Lectra Clean (sheild bulk)	38	ounces	Liquid	Product	Aercan	Electrician
E-417	B		CRC Urethane Seal Coat	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Damatex Color Guard Tuff Rubber Coating	1	gallon	Liquid	Product	Can	Electrician



**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	B		Exide 35C-1G Batteries	2	each	Solid	Product	Case	Electrician
E-417	B		Exide Nautilus 12 Volt Solar Batteries	4	each	Solid	Product	Case	Electrician
E-417	B		Extend-A-Life-Tool Coolant	20	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Flood Agnatrol Exterior Wood Finish	1	quart	Liquid	Product	Can	Electrician
E-417	B		GB Ox-Gardner	8	ounces	Liquid	Product	Plastic Tube	Electrician
E-417	B		Granles Fuln' Soap Cable Lubricant	1	quart	Liquid	Product	Plastic Bottle	Electrician
E-417	B		Ideal Duct Seal	10	pounds	Solid	Product	Bag	Electrician
E-417	B		Ideal Woalor Antiorident Joint Compound	8	ounces	Liquid	Product	Bottle	Electrician
E-417	B		Ideal Yellow 77 Wire Pulling Lubricant	2	quart	Liquid	Product	Bottle	Electrician
E-417	B		IPS Wgt' R Dry Pipe Cement	1	quart	Solid	Product	Can	Electrician
E-417	B		Johnstone Zooms Part Oiler	8	ounces	Liquid	Product	Tube	Electrician
E-417	B		Kar Shop Solvent	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		KAR Cold Zinc Galvanizing	14½	ounces	Liquid	Product	Aercan	Electrician
E-417	B		KAR Heavy Duty Glass Cleaner	44	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Karr Karcoat Spray Paint	72	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Klein Wire Pulling Lubricant	2	gallon	Solid	Product	Plastic Container	Electrician
E-417	B		La-Co Stic-Tight Thread Scaling Compound	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Lubriplate 930-2 Multi Purpose Grease	14½	ounces	Solid	Product	Paper Tube	Electrician
E-417	B		Mantek Cycle II Cleaner & Degreaser	32	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Mantek D3C-201	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Mantek Penetron	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Mantek Super Hand to Hand	22	ounces	Liquid	Product	Bottle	Electrician
E-417	B		Mantek Surge	18	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Mantek Zinc 95 Cold Galvanizing Aersol	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Mechanics Choice Starting Fluid-Ether	11	ounces	Liquid	Product	Aercan	Electrician

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	B		Mantek Multi Mist Air-All Adhesive Sealant	3.7	ounces	Solid	Product	Tube	Electrician
E-417	B		Plasti-Kote Water Based Acrylic Enamel	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		PW Pike Pvc Cement	1	quart	Solid	Product	Can	Electrician
E-417	B		Rayovac Lantern Battery (86 volt)	4	each	Solid	Product	Metal Container	Electrician
E-417	B		Rector Seal PVC Primer	8	ounces	Liquid	Product	Can	Electrician
E-417	B		Rotanium Insul Spray Clear	18-3/4	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Rustoleum Brite Coat	11	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Rustoleum Rusty Metal Primer	1	quart	Liquid	Product	Can	Electrician
E-417	B		Rustoleum Thinner/Cleaner 7700	8	ounces	Liquid	Product	Can	Electrician
E-417	B		Scotch Coat Electriciantrical Coating	30	ounces	Liquid	Product	Can	Electrician
E-417	B		Seymour Industrial Protective Coating	16	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Seymour Inverted Tip Marker Paint	30	ounces	Liquid	Product	Aercan	Electrician
E-417	B		T&B Spray-N-Coat Air Dry Vinyl Paint	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		UGL 222 Lite Spackling Paste	1	quart	Solid	Product	Plastic can	Electrician
E-417	B		Walgreens Isopropyl Alcohol	16	ounces	Liquid	Product	Bottle	Electrician
E-417	B		Zinser Bin Primer Sealer	1	gallons	Liquid	Product	Can	Electrician
E-417	B		Zynolyte Aqualyte	12	ounces	Liquid	Product	Aercan	Electrician
E-417	B		Zynolyte Spray Brite Spray Paint	11	ounces	Liquid	Product	Aercan	Electrician
E-417	C		Berke-Plug Hydraulic Cement (Quick Setting)	120	pounds	Solid	Product	Plastic Container	Diver
E-417	C		Heartline Rockrite	5	gallons	Liquid	Product	Pastic Container	Diver
E-417	E		KAR 3M High Strength Adhesive	16.6	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Ace Denatured Alcohol	1	pint	Liquid	Product	Can	Carpenter
E-417	E		Ace Joint Cream	1	quart	Solid	Product	Box	Carpenter
E-417	E		ACE Paint Thinner	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		ACE Thread Cutting Oil	1	quart	Liquid	Product	Can	Carpenter

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		Acetylene	103	cubic ft	GasolidaSolid	Product	Cylinder	Carpenter
E-417	E		AE Concesive Part B	1	quart	Liquid	Product	Container	Carpenter
E-417	E		Aerove Marking Paint <i>all colors</i>	51	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		AIS Hercules Steel Repair Putty	20	ounces	Solid	Product	Tubes	Carpenter
E-417	E		AIS Invisible Skin Barrier Cream	84	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		AIS Starting Fluid	11	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		AIS Tatto - CT Hand Cleaner	48	ounces	Solid	Product	Plastic Tube	Carpenter
E-417	E		AIS Tuff Lube Dry Lubricant (TEF)	39	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		AIS Tuff Lube Dry Lubricant (TEF)	91	ounces	Liquid	Product	Tube	Carpenter
E-417	E		AIS Tuff Stuff CT Hand Cleaner	24	ounces	Liquid	Product	Plastic Tube	Carpenter
E-417	E		AIS Tuffo - G Hand Cleaner	34	ounces	Solid	Product	Tube	Carpenter
E-417	E		AMFLOW #1220-8 Air Tool Oil	1	gallons	Liquid	Product	Plastic Bottle	Carpenter
E-417	E		APOC Plastic Roof Cement	1	gallons	Solid	Product	Can	Carpenter
E-417	E		Bondex Floor Leveler	16	pounds	Liquid	Product	Box	Carpenter
E-417	E		Bondo Fiberglass Resin	3	pint	Liquid	Product	Can	Carpenter
E-417	E		Bondo Liquid Hardener	0.37	ounces	Solid	Product	Tube	Carpenter
E-417	E		Bowman All Purpose Cleaner	13	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman Cutting Tool Coolant (conditioner)	38	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman High Heat Aluminum Enamel (black)	24	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman Marking Paint (red)	13	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman _____ Protective	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman Silicone Lube	9 <sup>3</sup> / <sub>4</sub>		Liquid	Product	Aercan	Carpenter
E-417	E		Bowman Welding Anti-Spatter	16	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Burk BR 321 Part A	1½	gallons	Liquid	Product	Can	Carpenter
E-417	E		Burk BR 321 Part B	1½	gallons	Liquid	Product	Can	Carpenter
E-417	E		Burke Aqua Resin Cure	5	gallons	Liquid	Product	Can	Carpenter

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		Carcoat Aerosol Paint	18	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Colortone Paint Thinner	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Contac Fastener Adhesive	11	ounces	Solid	Product	Plastic Tub	Carpenter
E-417	E		Contech Adhesive	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Contech Ceiling Tile Adhesive	1	quart	Solid	Product	Can	Carpenter
E-417	E		Copper Green Wood Preservative	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		CRC Lectra Motive Electriciantric Parts Cleaner	19	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Crown Upside Down Paint (orange)	17	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Curium Wood & Succio Primer	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Custom Concrete and Plaster Adhesive	1	gallons	Solid	Product	Can	Carpenter
E-417	E		Custom Concrete and Plastic Adhesive	2¼	pounds	Liquid	Product	Bottle	Carpenter
E-417	E		Dalys Seafin Teac Oil	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		DAP 33 Glazing	1	quart	Solid	Product	Can	Carpenter
E-417	E		DAP Panel & Drywall Adhesive	29	ounces	Solid	Product	Tubes	Carpenter
E-417	E		DAP Wellwood Plastic Resin Glue	16	ounces	Solid	Product	Plastic Tub	Carpenter
E-417	E		DAP Wellwood Resorcinol Glue	10	pint	Liquid	Product	Can	Carpenter
E-417	E		DAP Wellwood Resorcinol Waterproof Glue	2	pint	Liquid	Product	Can	Carpenter
E-417	E		DAP Wood Dough Solvent	3	ounces	Liquid	Product	Bottle	Carpenter
E-417	E		DAP Wood Glue	4	ounces	Liquid	Product	Can	Carpenter
E-417	E		Darworth Adhesive Caulk	50	ounces	Solid	Product	Tubes	Carpenter
E-417	E		Dercon Aluminum Repair	3½	ounces	Solid	Product	Tube	Carpenter
E-417	E		Derusto Spray Paint	13	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Dunne Acrylic Latex Paint (white)	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Durhams Water Putty	5	pounds	Solid	Product	Box	Carpenter
E-417	E		Dymond Stainless Steel-In-A-Can	70	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Bowman EC. 7 Epoxy A and Epoxy B	6	ounces	Liquid	Product	Can	Carpenter

**OF HAZARDOUS MATERIALS/WASTE:  
HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		Elmers Wood Glue	1	gallons	Liquid	Product	Plastic Container	Carpenter
E-417	E		Fix Wood Patch	8	ounces	Solid	Product	Can	Carpenter
E-417	E		Forney Glazing Flux	½	pounds	Solid	Product	Can	Carpenter
E-417	E		GB-60 All Purpose Cleaner	16	ounces	Solid	Product	Plastic Can	Carpenter
E-417	E		Glidden Enamel Paint	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Glidden House Paint	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Gunk Liquid Wrench Super Penetrant	4	ounces	Liquid	Product	Can	Carpenter
E-417	E		Hagerty Silver Smiths Polish	8	ounces	Liquid	Product	Bottle	Carpenter
E-417	E		Henry Construction Adhesive	11	ounces	Solid	Product	Tube	Carpenter
E-417	E		Henry Floor Tile Adhesive	2	gallons	Liquid	Product	Can	Carpenter
E-417	E		Henry Multi Purpose Construction Adhesive	156	ounces	Solid	Product	Tube	Carpenter
E-417	E		Henry Wet Patch Roof Cement	44	ounces	Solid	Product	Tubes	Carpenter
E-417	E		Homelite 2 Cycle Engine Oil	2	pint	Liquid	Product	Can	Carpenter
E-417	E		Homelite Bar & Chain Oil	2¼	gallons	Liquid	Product	Can	Carpenter
E-417	E		IPS Weldon 705 PVC Cement	1	quart	Solid	Product	Aercan	Carpenter
E-417	E		Jasco Brush Cleaner	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Jasco Denatured Alcohol	1	quart	Liquid	Product	Bottle	Carpenter
E-417	E		Jasco Wood Filler	1	quart	Solid	Product	Can	Carpenter
E-417	E		Kelly Moore 1610 Satin Sheen	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		LA-CO Slic Tite Thread Sealing Compound	8	ounces	Liquid	Product	Bottle	Carpenter
E-417	E		Mantek Metal Medic	1	quart	Liquid	Product	Plastic Bottle	Carpenter
E-417	E		Mantek PS 70 Lubricant	20	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Mantek Zinc 95 Galvanizing Aersol	16	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		MD 921 Flooring Adhesive	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		MD Butyl Kabba Sealant	10	ounces	Solid	Product	Tubes	Carpenter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		MD Contact Adhesive	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		MD Drywall Panel Construction Adhesive	1	gallons	Solid	Product	Can	Carpenter
E-417	E		MD Polycell Insulating Foam	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		MD Silicone Rubber Sealant	10	ounces	Solid	Product	Plastic Tube	Carpenter
E-417	E		MDR Whip-N-Dip	4	ounces	Liquid	Product	Plastic Tube	Carpenter
E-417	E		Minwax Poly Urethane	1	pint	Solid	Product	Can	Carpenter
E-417	E		Minwax Wood Filler	12	ounces	Solid	Product	Can	Carpenter
E-417	E		Minwax Woodsheen Oil & Finish	12	ounces	Liquid	Product	Plastic Bottle	Carpenter
E-417	E		Murphy Oil Soap Cleaner	32	ounces	Liquid	Product	Bottle	Carpenter
E-417	E		Old English Furniture Polish	1	pint	Liquid	Product	Glass Bottle	Carpenter
E-417	E		OSH Spray Enamel	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Oxygen	90	cubic ft	Gas	Product	Cylinder	Carpenter
E-417	E		PDI Plastic-Dip	16	ounces	Liquid	Product	Can	Carpenter
E-417	E		Pintatrex 300 Wood Preservative	1	gallons	Liquid	Product	Aercan	Carpenter
E-417	E		Pip 405 PVC Cement	8	ounces	Solid	Product	Can	Carpenter
E-417	E		Plasticote Water Based Acrylic Enamel	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Poly Stop Safe Part A	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Poly Stop Safe Part B	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Polyube Lubricant	6	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Polysulfide Rubber	1	pint	Solid	Product	Can	Carpenter
E-417	E		Premier ETP Cutting Fluid	24	ounces	Liquid	Product	Bottle	Carpenter
E-417	E		Protecto Rap #80/1170 Primer	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Rotanium Blue Grease	1	pounds	Solid	Product	Glass Jar	Carpenter
E-417	E		Roy Anders Latex Enamel	1	gallons	Solid	Product	Can	Carpenter
E-417	E		Roy Anderson Latex Enamel	2	gallons	Liquid	Product	Can	Carpenter
E-417	E		Royal Bond Contact Cement	1	quart	Liquid	Product	Can	Carpenter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		Rustoleum 769 Red Primer	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Rustoleum Gloss Paint	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Rustoleum Protective Coating	24	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Rustoleum Rusty Metal Primary	24	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Safety Clean Heavy Duty Compound	1	gallons	Solid	Product	Can	Carpenter
E-417	E		Sandaro Top Cote Surface Sealant	2	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Seymour Traffic Marker Paint	18	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Sikaflex 231 Sealant	10	ounces	Solid	Product	Plastic Tube	Carpenter
E-417	E		Skil Worm Drive Saw Lubricant	8	ounces	Solid	Product	Tube	Carpenter
E-417	E		Smith Epoxy Sealer Part A	5	gallons	Liquid	Product	Can	Carpenter
E-417	E		Solvoil Shellac Thinner	1	gallons	Liquid	Product	Plastic Container	Carpenter
E-417	E		Standard Brands Linseed Oil	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Surstik 760 Vinyl Adhesive	1	gallons	Liquid	Product	Tub	Carpenter
E-417	E		TIF Trintak Spray Adhesive	42	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Travco Grafite Catalyst	4	ounces	Liquid	Product	Can	Carpenter
E-417	E		Travco Grafite Epoxy Waterproof Sealant	1-3/4	pounds	Solid	Product	Can	Carpenter
E-417	E		Tremco Mono Acrylic Sealant	3	pint	Solid	Product	Tubes	Carpenter
E-417	E		Tremco Reglet Joint Sealant	1	pint	Solid	Product	Tubes	Carpenter
E-417	E		UGL 222 Spackling Paste	1	quart	Solid	Product	Can	Carpenter
E-417	E		UPI UI 7009 Black	1	pint	Solid	Product	Can	Carpenter
E-417	E		Varathene X3D Wood Stain	0.5	pint	Liquid	Product	Can	Carpenter
E-417	E		VIP TEK - Polymer Sealant	11	ounces	Solid	Product	Tubes	Carpenter
E-417	E		Watco Danish Oil Finish	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Waterberry Automatic Aerosol Dispenser	2	each	Liquid	Product	Aercan	Carpenter
E-417	E		WD40	1	gallons	Liquid	Product	Can	Carpenter

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	E		Webtex Acoustical Adhesive	1	gallons	Solid	Product	Can	Carpenter
E-417	E		Willard Amyl Acetate	1	gallons	Liquid	Product	Can	Carpenter
E-417	E		Xergon Lube Guard	20	ounces	Solid	Product	Tube	Carpenter
E-417	E		Z Spar Gloss Enamel Paint	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Z-Pro Acrylic Enamel	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Zinolye Aqualyte Urethane Enamel	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Zinolyte Epoxy Paint	12	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Zinolyte Spray Bright Paint	11	ounces	Liquid	Product	Aercan	Carpenter
E-417	E		Zinser Bullseye Shellac	1	quart	Liquid	Product	Can	Carpenter
E-417	E		Zmont Adhesive Morter	1	quart	Solid	Product	Can	Carpenter
E-417	E1		American Okam Acrylic Grant Additive	1	gallons	Liquid	Product	Bottle	Carpenter
E-417	E1		American Oleum A06000 Tile Setting Epoxy	39	pounds	Solid	Product	Can	Carpenter
E-417	E1		Bowman All Purpose Cleaner	13	ounces	Liquid	Product	Aercan	Carpenter
E-417	E1		Ceil Coat 648CP Grant Hardener	1	gallons	Liquid	Product	Bottle	Carpenter
E-417	E1		Custom Colored Tile Grant	50	pounds	Solid	Product	Bag	Carpenter
E-417	E1		Custom Concrete & Plaster Adhesive	1	gallons	Liquid	Product	Bottle	Carpenter
E-417	E1		Custom Sacco Patch	13	pounds	Solid	Product	Box	Carpenter
E-417	E1		Ericon Olean Sanders Floor Grant	25	pounds	Solid	Product	Bag	Carpenter
E-417	E1		Garland White Bondstone Grant Additive	1	pint	Liquid	Product	Bottle	Carpenter
E-417	E1		Garland-White Dri Tile Grant	20	pounds	Solid	Product	Bag	Carpenter
E-417	E1		Hydro-M EEMI Ceramic Tile Grant	25	pounds	Solid	Product	Bag	Carpenter
E-417	E1		MD Water Based Ceiling and Tiling Adhesive	1	gallons	Liquid	Product	Can	Carpenter
E-417	E1		Ri-Tex Patching Compound	25	pounds	Solid	Product	Bag	Carpenter
E-417	E1		Skyco OSPHO	5	gallons	Solid	Product	Can	Carpenter
E-417	E1		State Tuf-Buddy Epoxy Bonding Compound - Hardener	11	pint	Liquid	Product	Can	Carpenter
E-417	E1		State Tuf-Buddy Epoxy Bonding Compound Resin Based	11	pint	Liquid	Product	Can	Carpenter



**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	G		Aerovoc Marking Paint <i>all colors</i>	483	ounces	Liquid	Product	Aercan	Surveyor
E-417	G		Bowman all Purpose Cleaner	13	ounces	Liquid	Product	Aercan	Surveyor
E-417	G		Deft Clear Wood Varnish	12	ounces	Liquid	Product	Aercan	Surveyor
E-417	G		Dunne Exterior Traffic Red Lacquer	1	gallons	Liquid	Product	Can	Surveyor
E-417	G		Dunne Latex Traffic Line Paint	2	gallons	Liquid	Product	Can	Surveyor
E-417	G		Glidden Spread Urethane Floor Enamel	1	quart	Liquid	Product	Can	Surveyor
E-417	G		Marvel Mystery Oil	1	quart	Liquid	Product	Can	Surveyor
E-417	G		Propane Cylinder (Airco)	4 -14	ounces	Gasolid	Product	Cylinder	Surveyor
E-417	G		Sears Paint & Varnish Remover	1	quart	Liquid	Product	Can	Surveyor
E-417	III E		Aerroe Insulating Epoxy Coating	37.5	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		AIS Corrisible Skin Barrier	14	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		AIS Tuffo Ng, Junior Hand Cleaner	15	ounces	Solid	Product	Can	Electrician
E-417	III E		Bowman All Purpose Cleaner	65	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Bowman Bowmagic Rust Remover	15	gallons	Liquid	Product	Plastic Can	Electrician
E-417	III E		Bowman Cutting Tool Coolant (conditioner)	19	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Bowman Red Oxide Primer	12	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Bowman Rust Penetrant	12	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Bowman White lube Lithium Grease	12	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Cardinal Air Dry Enamel Paint	13	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		CO <sub>2</sub>			Gas	Product		Electrician
E-417	III E		Davis Fantastic Cleaner	18	ounces	Liquid	Product	Spray Container	Electrician
E-417	III E		Dow Corning 11 Value Lubricant & Sealant	10	ounces	Solid	Product	Tube	Electrician
E-417	III E		Electriciantra-Safe Solvent	20	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Bowman Heavy-Duty Silicone Lube	9	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Hydroex MT-55 Alccu Lube	14	ounces	Solid	Product	Tube	Electrician
E-417	III E		Ideal Noalox	8	ounces	Liquid	Product	Plastic Can	Electrician

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
E-417 HARBOR FACILITIES CARPENTERS, PAINTERS, AND ELECTRICIANS BUILDING**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity	Units	Physical State	Waste or Product	Container Type	User
E-417	III E		KAR Multi-Purpose Cleaner	20	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Borden - Krylon Interior & Exterior Enamel	11	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Mantek Big Tex Solvent	36	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Mantek Pritron	12	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Mantek Pro-poner Solvent	11	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Rustoleum Insul Spray	18-3/4	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		Ultra Lust 144 Traffic & Turf Marker	35	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		VJC 201 Degreaser	16	ounces	Liquid	Product	Aercan	Electrician
E-417	III E		X-ergon Lube Guard Moly Grease	20	ounces	Solid	Product	Tube	Electrician

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	A		Waste Diesel	110 gallons	Liquid	Waste	Drum	HarFac
2NDYD	A		Waste Oil Solids (i.e. used oil rags, ect.)	55 gallons	Solid	Waste	Drum	HarFac
2NDYD	A		Waste Oil	55 gallons	Liquid	Waste	Drum	HarFac
2NDYD	A		Waste Flammable Liquids (waste lacquer thinner, waste mineral spirits, waste gasoline)	55 gallons	Liquid	Waste	Drum	HarFac
2NDYD	A		Waste Paints	55 gallons	Liquid	Waste	Drum,	HarFac
2NDYD	B	a	Ajax Cleanser	63 ounces	Solid	Product	Can	Janitors
2NDYD	B	a	Boraxo Powdered Hand Soap	50 pounds	Solid	Product	Bags	Janitors
2NDYD	B	a	Clorox Bleach	3 gallons	Liquid	Product	Plastic Bottle	Janitors
2NDYD	B	a	Mantek Lem'n Lift	5 gallons	Liquid	Product	Drum	Janitors
2NDYD	C		Chemsearch Volts Solvent	10 gallons	Liquid	Product	Plastic Bottle	Harbor Utilities
2NDYD	C		Gasoline	15 gallons	Liquid	Product	Can	Harbor Utilities
2NDYD	C		Rusted Poly HD127 Tar & Asphalt Remover	20 gallons	Liquid	Product	Can	Harbor Utilities
2NDYD	C		Skyco OSPHO	5 gallons	Solid	Product	Plastic Can	Harbor Utilities
2NDYD	D		Ace Asphalt Roof Coating	5 gallons		Product	Can	Roofer
2NDYD	D		Ace Premium Roof Coating	5 gallons		Product	Can	Roofer
2NDYD	D		APOC 103 Asphalt Primer	10 gallons		Product	Can	Roofer
2NDYD	D		APOC 105 Lap Cement	5 gallons		Product	Can	Roofer
2NDYD	D		APOC 252 Gunwhite Elastomeric	5 gallons		Product	Can	Roofer
2NDYD	D		APOC Emulsion Roof Coating	10 gallons	Liquid	Product	Can	Roofer
2NDYD	D		APOC Plastic Roof Cement	10 gallons	Liquid	Product	Can	Roofer
2NDYD	D		Burke Burkepoxy	1 gallons	Liquid	Product	Can	Roofer
2NDYD	D		Carboline Rooflex Membrane 145	1 gallons		Product	Can	Roofer
2NDYD	D		Certified Redi-Seal Roof Patching Compound	5 gallons	Solid	Product	Can	Roofer

**VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 ARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	D		CTCO #951 Plastic Roof Cement	10 gallons		Product	Can	Rofer
2NDYD	D		Dixon Railroad #60 Switch Plate Lubricant	1 gallons	Liquid	Product	Can	Rofer
2NDYD	D		Flintcoat Rain Paten Sealer	10 gallons		Product	Can	Rofer
2NDYD	D		Flintcote Flashing Compound	5 gallons		Product	Can	Rofer
2NDYD	D		Genstar Fibrex Cement	10 gallons		Product	Can	Rofer
2NDYD	D		Henry #120 Aluminum Roof Coating	1 gallons		Product	Can	Rofer
2NDYD	D		Henry 104 Asphalt Primer	10 gallons		Product	Can	Rofer
2NDYD	D		Henry Plastic Roof Cement	5 gallons		Product	Can	Rofer
2NDYD	D		Loxon Latex Concrete	45 pounds	Solid	Product	Can	Rofer
2NDYD	D		Loxon Latex Liquid	1 gallons		Product	Can	Rofer
2NDYD	D		Mameco Vulkem 201H	5 gallons	Liquid	Product	Can	Rofer
2NDYD	D		Metacrylics Acrylic White	5 gallons	Liquid	Product	Can	Rofer
2NDYD	D		Philadelphia Chockfast Hardener	1 gallons	Liquid	Product	Can	Rofer
2NDYD	D		Polyguard CA-14 Mastic	1 gallons		Product	Can	Rofer
2NDYD	D		Oregon Research Snowroof Roof Coating	5 gallons		Product	Can	Rofer
2NDYD	D		Tremco Eco Prime	9 gallons		Product	Can	Rofer
2NDYD	D		Tremco Tremlastic	5 gallons		Product	Can	Rofer
2NDYD	D		Tremco Tremprime	1 gallons		Product	Can	Rofer
2NDYD	D		Wards Floor Sealer	10 gallons	Liquid	Product	Can	Rofer
2NDYD	D		Western Colloid Elastahyde - White Reflective Coating	5 gallons	Liquid	Product	Can	Rofer
2NDYD	E-422		Fire Extinguisher	2 each	Gas	Product	Cylinder	Crane Dept.
2NDYD	E-422		Johnson Revert Self-destroying Drilling Fluid Additive	25 pounds	Solid	Product	Bag	Crane Dept.
2NDYD	J		2RC Cold Galvanizing Compound	3 gallons	Solid	Product	Can	Painter
2NDYD	J		Adhesive Engineering Consonvic #1011	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Beadex Drywall Compound	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Benjamin Moore Aquaflo Enamel	5 gallons	Liquid	Product	Can	Painter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Boat Life Teak Oil Sealer	3 gallons	Liquid	Product	Can	Painter
2NDYD	J		Bowman Fluorescent Green Paint	11 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Bowman Marking Paint	13 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Burke Acrylic Bonder	2 gallons	Solid	Product	Can	Painter
2NDYD	J		C. Marcus House & Trim Paint	1 quart	Liquid	Product	Can	Painter
2NDYD	J		California Line Marking Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		California Ti-Coat Concrete Primer Part B	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		California Ti-Coat Concrete Primer-Part A	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Car Carcoat Paint	32 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Carboline Carbomastic 15	10 gallons	Liquid	Product	Can	Painter
2NDYD	J		Carboline Thinner #10	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Karr Striped Marking Spray Paint	3 pint	Liquid	Product	Aercan	Painter
2NDYD	J		Ceramic Tile Latex Grout	5 pounds	Solid	Product	Box	Painter
2NDYD	J		Chabot Decking Stain	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Chabot Stains Wood Brightener	55 gallons	Liquid	Product	Drum	Painter
2NDYD	J		Colorama Stencil Coat Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Colorama Stencil Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Colortite Ceramic Tile Adhesive	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Colortite Latex Additive	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Coronado Silicone Alkyd Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Couprinol Stain & Wood Preservative	3 gallons	Liquid	Product	Can	Painter
2NDYD	J		CRC Zinc Mate	16 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Custom Fix-A-Crete Latex Bonder	1 gallons	Solid	Product	Plastic Bottle	Painter
2NDYD	J		Custom Quick Fix	15 pounds	Solid	Product	Bag	Painter
2NDYD	J		DAP 230 Latex Sealant	10 ounces	Solid	Product	Tube	Painter
2NDYD	J		DAP 33 Glazing	8 ounces	Solid	Product	Can	Painter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Deksolje #2 Gloss Finish	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		DEP Quick Seal	5 ounces	Solid	Product	Tube	Painter
2NDYD	J		Devoe Alkyd Gloss Enamel	15 gallons	Liquid	Product	Can	Painter
2NDYD	J		Devoe Alkyd Gross Enamel Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Devoe Dev Prep 88 Cleaner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Devoe Epoxy Non-Skid Coating 237M	20 gallons	Liquid	Product	Can	Painter
2NDYD	J		Devoe Flight Deck Topping Paint 929	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Devoe T-4 Thinner	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		DFC Deck-O-Weld Adhesive Bonder	1 quart	Solid	Product	Can	Painter
2NDYD	J		Diamond Vogel Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dowmans Fixall	10 pounds	Solid	Product	Bag	Painter
2NDYD	J		Ducksback Waterproofing Sealer	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunn Edwards Latex Enamel Paint 262IW	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunn Gloss Finish Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunn-Edwards Syn Lustra Enamel Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunn-Edwards Vinx L Tex Acrylic Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Acrylic Flat Finish	15 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Acrylic House & Trim	7 1/4 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Acrylic Latex Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Acrylic Mainten Primer & Finish (metal)	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Alkyd Enamel	10 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne All Purpose Gloss Enamel	12 1/4 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne All Purpose Gloss Enamel	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Dunne All Purpose Gloss Enamel Paint	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Clear Latex Finish	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Fence Stain (17 clear wood stain)	5 gallons	Liquid	Product	Can	Painter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 ARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Dunne Lacquer	16 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Latex Enamel	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Latex Flat Enamel Paint	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Latex Flat Wall Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Latex House Trim Paint	10 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Latex Traffic Paint 1451	10 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Liquid Aluminum Paint 1820	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Maintenance Coating Primer	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Rid-Skid Acrylic Latex Floor Paint	9 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Rub-R-Sheen Latex Paint 0931W	29 gallons	Liquid	Product	Plastic Cont	Painter
2NDYD	J		Dunne Semi Gloss Enamel Paint 2731W	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne Stucco & Rustic Flat Finish	22 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dunne-Bar Eggshell Varnish 2381	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Dupont Cintari C8302A	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Durhams Water Putty	0.5 gallons	Solid	Product	Can	Painter
2NDYD	J		Dutchboy All Purpose Enamel	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Equal Low Solvent Paint	12 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Eurapel Water Repellent Finish	6 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fasco Paint Remover (Speed-O-Matic)	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fasco Thinner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fight Back Water Sealer	15 gallons	Liquid	Product	Can	Painter
2NDYD	J		Figon Rubbing Alcohol	1 pint	Liquid	Product	Bottle	Painter
2NDYD	J		Flood CWF-UV Clearwood Finish	10 gallons	Liquid	Product	Can	Painter
2NDYD	J		Flood E-B Bonding Primer	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Flood EB Primer	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Flood Penetrol Paint Conditioner	1 quart	Liquid	Product	Can	Painter

VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Flood Tur Polymer Sealant	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fuller O'Brien Maintenance Coating	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fuller Obrien Blox Rust Latex Metal Primer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fuller Obrien Chromate Metal Primer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Fultek Tek-Na-Film FBR Wall Sealant	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Gibson Homan Lightweight Spackling 76-77	7 quart	Solid	Product	Can	Painter
2NDYD	J		Gibson Homan Wall Paper Adhesive	4 ounces	Solid	Product	Can	Painter
2NDYD	J		Gibson Pine Oil	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Glidden Acrylic Latex	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Glidden Oil Based Alkyd Primer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Glidden Ultra-Hide Primer Sealer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Glidden Urethane Floor Enamel Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Gre-Sof Wall Cleaner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Hamilton Multi-Purpose Joint Compound	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Hamiltons Multi-Purpose Joint Compound	62 pounds	Solid	Product	Can	Painter
2NDYD	J		Hi-Glo Synthetic Enamel Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		High Performance Epoxy	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Home Depot Latex Enamel	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Interlux Fiberglass Bonom Kote Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Interlux Z16 Special Thinner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		International Intervinux VFY 999	5 gallons	Solid	Product	Can	Painter
2NDYD	J		International Intervinux VLE184	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kalguard Rust Inhibitive Enamel	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore 1700-333 Paint	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Acry-Tred Patio & Deck Paint	4 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Acrylic Flat Finish	90% gallons	Liquid	Product	Can	Painter



OF HAZARDOUS MATERIALS/WASTE:  
 R FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Kelly Moore Acrylic Masonry Primer	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Acrylic Semi-Gloss	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Acrylic Semi-Gloss Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Acryhster Semi-Gloss Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Alkyd Semi-Gloss Enamel Paint	7 ½ gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Alkyl Gloss House Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Body & Trim Gloss House Paint	3 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Enamel Under Coat	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Exterior Primer	6 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Flat Paint	26 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Galvanized Iron Primer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Lacquer Thinner #67	55 gallons	Liquid	Product	Drum	Painter
2NDYD	J		Kelly Moore Latex Flat Wall Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Mineral Spirits	55 gallons	Liquid	Product	Drum	Painter
2NDYD	J		Kelly Moore Primer & Surface Conditioner	4 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Rust Inhibitive Enamel Paint	6 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Silver Shield Paint	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Surface Conditioner	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Vinyl Wall Sealer	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Kelly Moore Zinc Chromate Primer	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		L&H Synthetic Gloss Enamel	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		LP Stain Remover	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Maclac Lacquer Thinner	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		MD Drive Way Repair Concrete Patch	20 ounces	Solid	Product	Tube	Painter
2NDYD	J		Morton International Epoxy	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Morton Stencil Guard Paint	3 gallons	Liquid	Product	Can	Painter

Y OF HAZARDOUS MATERIALSWASTE:  
 OR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Morton Street Marking Paint	200 gallons	Liquid	Product	Can	Painter
2NDYD	J		National Chem Search Safe-T-Glow	4 ½ gallons	Liquid	Product	Aercan	Painter
2NDYD	J		Olympic Latex Stain	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Olympic Semi-Transparent Oil Stain	34 gallons	Liquid	Product	Can	Painter
2NDYD	J		Olympic Solid Color Oil Stain	4 gallons	Liquid	Product	Can	Painter
2NDYD	J		Paco P-100 Ceiling Texture	15 pounds	Solid	Product	Bag	Painter
2NDYD	J		Pittsburgh Polyamide Epoxy Coating	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Primer & Surface Conditioner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Propane	50 gallons	Gasas	Product	Cylinder	Painter
2NDYD	J		Rain Guard Vandl Guard	5¼ gallons	Liquid	Product	Can	Painter
2NDYD	J		Rapco Industrial Coating	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rich All Purpose Enamel Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		RPM Plastic Veneer	3 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rusto-Thane	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum 160 Thinner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum 190 Thinner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Acrylic Primer Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Aliphatic Polyurethane Coating	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Alkyd Coating	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Cleaner Degreaser	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Food & Beverage Coating System	2 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Hard Hat Paint	15 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Rustoleum Hardhat Finish Paint	45 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Rustoleum Industrial Enamel	14 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum Water Based Epoxy Floor Coating	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Rustoleum White Primer	5 gallons	Liquid	Product	Can	Painter

**VENTORY OF HAZARDOUS MATERIALSWASTE:  
HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	J		Sacramento Stucco Patch	15 pounds	Solid	Product	Bag	Painter
2NDYD	J		Sequoyah Redwood Stain	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Seymore Traffic Marker Paint	216 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Sherwin Williams Bulletin Color Paint	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		ShurStick Wall Covering UnderCoating 222	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Shurstik Vinyl Wall Covering Adhesive	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Simpson Semi Gloss Enamel	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Solvoil Kerosene	1 quart	Liquid	Product	Can	Painter
2NDYD	J		Solvoil Mineral Spirits	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		T&C Thinner #38	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Te-Ka Teak Wood Cleaner	2 gallons	Liquid	Product	Plastic Bottle	Painter
2NDYD	J		TNEMEC Endura Shield	1 quart	Liquid	Product	Can	Painter
2NDYD	J		TNEMEC Indura-Shield 4	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		VIP Ter-Polymer Sealant	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		VIP Turpolymer Sealant	20 ounces	Solid	Product	Tube	Painter
2NDYD	J		Watco Exterior Wood Primer	5 gallons	Liquid	Product	Can	Painter
2NDYD	J		Westco Paraffine Oil	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Z-Spar A78 Splash Zone Compound	½ gallons	Liquid	Product	Can	Painter
2NDYD	J		ZeroLac Shellac	1 quart	Liquid	Product	Can	Painter
2NDYD	J		ZSpar Marine Enamel Paint	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		ZSpar T-10 Thinner	1 gallons	Liquid	Product	Can	Painter
2NDYD	J		Zynolyte Epoxy Shield	12 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Zynolyte Speed-E-Enamel Paint	26 ounces	Liquid	Product	Aercan	Painter
2NDYD	J		Zynolyte Spray Brite	22 ounces	Liquid	Product	Aercan	Painter
2NDYD	L	T1	AE Concsive Part A 1011	1 gallons	Solid	Product	Bucket	Maint
2NDYD	L	T1	AE Concsive Part B 1011	1 gallons	Solid	Product	Bucket	Maint

**INVENTORY OF HAZARDOUS MATERIALS/WASTE:  
HARBOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	L	T1	Angus Hotrod	5 gallons	Solid	Product	Can	Maint
2NDYD	L	T1	APOC Plastic Roof Cement 100	5 gallons	Solid	Product	Can	Maint
2NDYD	L	T1	APOC Plastic Roof Cement 109	3 gallons	Solid	Product	Can	Maint
2NDYD	L	T1	Bowman Cutting Tool Coolant	19 ounces	Liquid	Product	Aercan	Maint
2NDYD	L	T1	Bowman Flat Black Paint 24707	12 ounces	Liquid	Product	Aercan	Maint
2NDYD	L	T1	Bowman Red Enamel 24733	12 ounces	Liquid	Product	Aercan	Maint
2NDYD	L	T1	Bowman Safety Solvent	15 ounces	Liquid	Product	Aercan	Maint
2NDYD	L	T1	Burke BurkEpoxy Compound A	3 gallons	Solid	Product	Bucket	Maint
2NDYD	L	T1	Burke BurkEpoxy Compound B	4 gallons	Solid	Product	Bucket	Maint
2NDYD	L	T1	Cardinal Paint - Red	13 ounces	Liquid	Product	Aercan	Maint
2NDYD	L	T1	Chemsearch Seal-Sure Sealant	1 gallons	Liquid	Product	Can	Maint
2NDYD	L	T1	Custom Cement and Mortar Color	5 pounds	Solid	Product	Box	Maint
2NDYD	L	T1	GE Silicon Tube Sealant	10 ounces	Solid	Product	Plastic Tube	Maint
2NDYD	L	T1	GEO Plastic Roof Cement No. 951	5 gallons	Solid	Product	Drum	Maint
2NDYD	L	T1	Kliz Powdered Handsoap with Borox	5 pounds	Solid	Product	Box	Maint
2NDYD	L	T1	Manek Fresh Force	5 gallons	Liquid	Product	Plastic	Maint
2NDYD	L	T1	Rainbow Anti Fog Cleaner	256 ounces	Liquid	Product	Plastic Bottle	Maint
2NDYD	L	T1	Ricmar Grout Whitener	1 1/2 gallons	Liquid	Product	Plastic Bottle	Maint
2NDYD	L	T1	Tremco Polyroof AF	2 gallons	Liquid	Product	Can	Maint
2NDYD	L	T2	ACE Paint Thinner	1 gallons	Liquid	Product	Can	Maint
2NDYD	L	T2	Burke Epoxy Resin Component "A"	2/3 gallons	Solid	Product	Plastic Bucket	Maint
2NDYD	L	T2	Carlton - Stuart Magnalube-G	14 ounces	Solid	Product	Plastic Tube	Maint
2NDYD	L	T2	Dowman's Concrete Fixall	25 pounds.	Solid	Product	Bag	Maint
2NDYD	L	T2	Heartline - Rockite	50 pounds	Solid	Product	Plastic Bucket	Maint
2NDYD	L	T2	ITASCA 2 clele Enoivr oil	32 ounces	Liquid	Product	Plastic Bottle	Maint
2NDYD	L	T2	Jasco - Paint Remover 0102	1 quart	Liquid	Product	CAN	Maint

**VENTORY OF HAZARDOUS MATERIALS/WASTE:  
 LABOR FACILITIES CORPORATION YARD (2ND STREET YARD AT BRUSH STREET)**

Bldg No.	Room No. <sup>1</sup>	Room Code <sup>1</sup>	Chemical Brand/Name	Quantity/Units	Physical State	Waste or Product	Container Type	User
2NDYD	L	T2	Lonestar Cement	100 pounds	Solid	Product	Bag	Maint
2NDYD	L	T2	M D Acrylic Caulk	10 ounces	Solid	Product	Plastic Tube	Maint
2NDYD	L	T2	M D Butyl Gutterlap Seal	20 ounces	Solid	Product	Plastic Tube	Maint
2NDYD	L	T2	M D Form Sealant	24 ounces	Liquid	Product	Aerocan	Maint
2NDYD	L	T2	M D Silicone Rubber Sealant	20 ounces	Solid	Product	Plastic Tube	Maint
2NDYD	L	T2	Mantek Derket	2.5 gallons	Liquid	Product	Plastic jug	Maint
2NDYD	L	T2	Mantek - Fresh Force	5 gallons	Liquid	Product	CAN	Maint
2NDYD	L	T2	Manter - Manular Insecticide	16 ounces	Solid	Product	Can	Maint
2NDYD	L	T2	Quickete	140 pounds	Solid	Product	Bag	Maint
2NDYD	L	T2	Royalbond Grip Contact Cement	1 quart	Liquid	Product	Can	Maint
2NDYD	L	T2	Willard Copper-Green Wood preservative	1 gallons	Liquid	Product	Can	Maint

# SANBORN MAP LEGEND

## GLOSSARY

### CODING OF FIRE-RESISTIVE STRUCTURAL UNITS FOR FIREPROOF AND NON-COMBUSTIBLE BUILDINGS

FRAMING		FLOORS		ROOF	
CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT
B.	Reinforced Concrete Frame.	1.	Reinforced Concrete. Reinforced Concrete with Masonry Units. Pre-cast Concrete or Gypsum Slabs or Planks.	a.	Reinforced Concrete. Reinforced Concrete with Masonry Units. Reinforced Gypsum Concrete. Pre-cast Concrete or Gypsum Slabs or Planks.
C.	Protected Steel Frame.	2.	Concrete or Metal Lath. Incombustible Form Boards. Paper-backed Wire Fabric. Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.	b.	Concrete or Gypsum on Metal Lath. Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.
D.	Individually Protected Steel Joists. Columns, Beams, Trusses, Arches.	3.	Open Steel Deck or Grating.	c.	Incombustible Composition Boards with without Insulation, Masonry or Metal Tiles.
E.	Indirectly Protected Steel Frame.			d.	Steel Deck, Corrugated Metal or Asbestos Protected Metal with or without Insulation.
F.	Indirectly Protected Steel Joists. Columns, Beams, Trusses, Arches.				
G.	Unprotected Steel Frame.				
H.	Unprotected Steel Joists. Columns, Beams, Trusses, Arches.				
	Masonry Bearing Walls only.				

The coding to the left, for framing, floor and roof structural units is used in describing the construction of fire-resistive buildings. In addition, reports for fire-resistive buildings will show the date built, wall construction other than brick, and ceilings.

**F.P. - 1962 (CONC.) A-1-d**  
A fireproof building built in 1962 with concrete walls and reinforced concrete frame, floors and roof.

**F.P.X. - 1962 (METAL PANELS) B-2-a**  
A fireproof building built in 1962 with metal panel walls, reinforced concrete columns and beams, concrete walls on metal lath and gypsum slab roof, noncombustible ceilings.

**N.C. - 1962 (C.B.) H-2-d**  
A non-combustible building built in 1962 with concrete block walls; unprotected steel columns, beams and joists; concrete floors on metal lath and steel deck roof.

### MASONRY CONSTRUCTION

Important interior and all exterior masonry walls of all non-residential buildings and residential buildings of five or more dwelling units are shown with weighted (—) lines.

Masonry walls of residential buildings of four dwelling units or less are shown in a standard line and the construction is noted on all buildings diagrammed after July, 1963.

WALLS		PARTITIONS		OPENINGS	
	8" Brick		Mixed Construction of Concrete Blocks, Brick Faced		Wall with No Openings
	12" Concrete		Mixed Construction of Concrete Blocks and Brick		Wall with Double Standard Fire Doors 1st Floor
	18" & 20" Stone		Masonry Walls, Metal Faced		Wall with Standard Fire Door Basement
	12" & 8" Hollow Tile Wall Thicknesses Placed Relative to Respective Floors		Adobe		Wall with Substandard Fire Doors 1st & 3rd Floors
	Cinder, Concrete or Cement Brick		Hollow Cinder or Concrete Block Interior Wall Basement to Roof		Wall with Metal & Wired Glass Fire Doors all Floors
	Hollow Cinder or Concrete Blocks, Plastered		Tile Interior Wall Basement to Roof		Wall with Substandard Fire Doors 1st, 2nd & 3rd Floors & Unprotected Opening 4th Floor
			Cement Brick End Wall		Wall with Small Unprotected Openings only
					Wall with Unprotected Openings all Floors

### NON-MASONRY CONSTRUCTION

Non-masonry walls are shown with fine (—) lines. (Walls construction other than wood and stucco on wood frame is noted)

	Wood & Stucco & Cement Plaster, Etc. on Wood Frame		Wood & Sash Glass		Iron Building with Wood Roof. (Location of Extensive Wood Areas Specifically noted)		Apron Walls with wood Sash and Glass		Asphalt and/or Asbestos Protected Metal on Steel Frame
	Brick Veneered on Wood Frame (Other Types of Veneered on Wood Frame Specifically Noted)		Metal & Sash Glass		Asbestos Clad on Wood Frame. Noted in Non-Residential Structures only.		Stucco, Cement Plaster, Etc. on Steel Frame		Asphalt and/or Asbestos Protected Metal on Wood Frame
	Mixed Masonry & Non-Masonry (Type of Masonry Specifically Noted)		Metal Clad on Wood Frame		Mixed Wall—(9' of CB with Metal Sash Above		Gunite on Steel Frame		Glass Panels
	Wood, Brick Lined, Br. Filled & Brick Nogged		Iron Building		Metal Panels				

### FIRE PROTECTION

	Fire Department Connection		Single Hydrant		Frame Enclosed Elevator with Self Closing Traps		2 Stories & Basement 1st Floor Occupied by Store 2 Residential Units above 1st Auto in Basement Drive or Passageway Wood Shingle Roof.		Brick Chimney
	Automatic Sprinklers throughout contiguous sections of single risk		Double Hydrant		Concrete Block Enclosed Elevator with Traps		Iron Chimney		Gasoline Tank
	Automatic Sprinklers all floor of building		Triple Hydrant		Tile Enclosed Elevator with self closing Traps		Iron Chimney (with spark arrestor)		Fire Pump
	Automatic Sprinklers in part of building only (Note under Symbol indicates protected portion of building)		Quadruple Hydrant of the High Pressure Service		Brick Enclosed Elevator with wired Glass Door		Vertical Steam Boiler		
	Not Sprinklered		Water Pipes of the High Pressure Service as shown on Key Map		Open Hoist		Horizontal Steam Boiler		
	Automatic Chemical Sprinklers		Public Water Service		Hoist with Traps		Width of Street between Block Lines, not Curb Lines		
	Chemical Sprinklers in part of building only (Note under Symbol indicated protected portion of building)		Private Water Service		Open Hoist Basement to 1st		Ground Elevation		
	Vertical Pipe or Stand Pipe		Skylight lighting top story only		Stairs		House numbers nearest to Buildings are Official or Actually up on Buildings. Old house numbers are farthest from Buildings		
	Automatic Fire Alarm		Skylight lighting 3 stories		MISCELLANEOUS		Reference Adjoining Page		Block Number
	Water Tank		Skylight with Wired Glass in Metal Sash		Parapet 6" above Roof		Fire Department as shown on Key Map		
	Outside Vertical Pipe on fire Escape		Open Elevator		Parapet 12" above Roof		Vac. or V. - Vacant		
	Fire Alarm Box Noted "H.P.S." on High Pressure Fire Service		Frame Enclosed Elevator		Parapet 24" above Roof Occupied by Warehouse		Vac. & Op. or V.-O. - Vacant & Open		

LAND USE APPLICABLE TO CHANGES DIAGRAMMED AFTER 1960

R	RESIDENTIAL	M	MANUFACTURING
PT	RESIDENTIAL-TRANSIENT	P	PUBLIC OR INSTITUTIONAL
C	COMMERCIAL	U	UTILITY
W	WAREHOUSE	T	TRANSPORTATION

NUMERICAL PREFIX INDICATES THE NUMBER OF ESTABLISHMENTS IN EACH CATEGORY

24

5

# KEY

**Fire proof construction.**  
(or fire resistive construction)

**Adobe building.**

**Stone building.**

**Concrete, lime, sand or cement brick.**

**Hollow concrete or cement block construction.**

**Concrete or reinforced concrete construction.**

**Tile building.**

**Brick building with frame cornice.**

**Brick veneered building.**

**Brick and frame building.**

**Frame building, brick lined.**

**Frame residential building.**

**Iron building.**

**Tenant building occupied by various manufacturing or occupations.**

**Frame building covered with asbestos.**

**Brick building with brick or metal cornice.**

**Fire wall 6 inches above roof.**

**Wall 12 inches above roof.**

**Wall 18 inches above roof.**

**Wall 36 inches above roof.**

**Figures 8, 12, 18 indicate thickness of wall in inches.**

**Wall without opening and size in inches.**

**Wall with openings on floors as designated.**

**Opening with single iron or tin clad door.**

**Opening with double iron doors.**

**Opening with standard fire doors.**

**Openings with wired glass doors.**

**Drive or passage way.**

**Stable.**

**Auto. House or private garage.**

**Solid brick with interior walls of C.B. or C.B. and brick mixed.**

**Mixed construction of C.B. and brick with one wall of solid brick.**

**Mixed construction of C.B. and brick with one wall faced with 4" brick.**

**Mixed construction of C.B. and brick throughout.**

**Window opening in first story.**

**Window openings in second and third stories.**

**Window openings in second and fourth stories.**

**Windows with wired glass.**

**Windows with iron or tin clad shutters.**

**Window openings tenth to twenty-second stories.**

**Open elevator.**

**Frame enclosed elevator.**

**with traps.**

**self closing traps.**

**Concrete block enclosed elevator with traps.**

**Tile enclosed elevator with self closing traps.**

**Brick enclosed elev. with wired glass door.**

**Block number.**

**Vertical pipe or stand pipe.**

**Automatic fire alarm.**

**Independent electric plant.**

**Automatic sprinklers.**

**Automatic chemical sprinklers.**

**Automatic sprinklers in part of building only.**

**Not sprinklered.**

**Outside vertical pipe on fire escape.**

**Fire alarm box.**

**Single hydrant.**

**Double.**

**Triple.**

**Quadruple hydrant of the High Pressure Fire Service.**

**Fire alarm box of the High Pressure Fire Service.**

**Water pipes of the High Pressure Fire Service and hydrants of the High Pressure Fire Service as shown on key map.**

**Water pipes and size in inches.**

**Water pipes of private supply.**

**House numbers shown nearest to buildings are official or actually up on buildings.**

**Old house numbers shown furthest from buildings.**

**Vertical steam boiler.**

**Gasoline tank.**

**Open under.**

**Siamese fire dept. connection.**

**Single fire dept. connection.**

**Reference to adjoining page.**

**Fire engine house, as shown on key map.**

**Fire pump.**


**Under page number refers to corresponding page of previous edition.**

**NOTE: UNDER SYMBOL INDICATES PROTECTED PORTION OF BUILDING.**

**NOTE: UNDER SYMBOL INDICATES PROTECTED PORTION OF BUILDING.**

**NOTE: UNDER SYMBOL INDICATES PROTECTED PORTION OF BUILDING.**

## TANKS

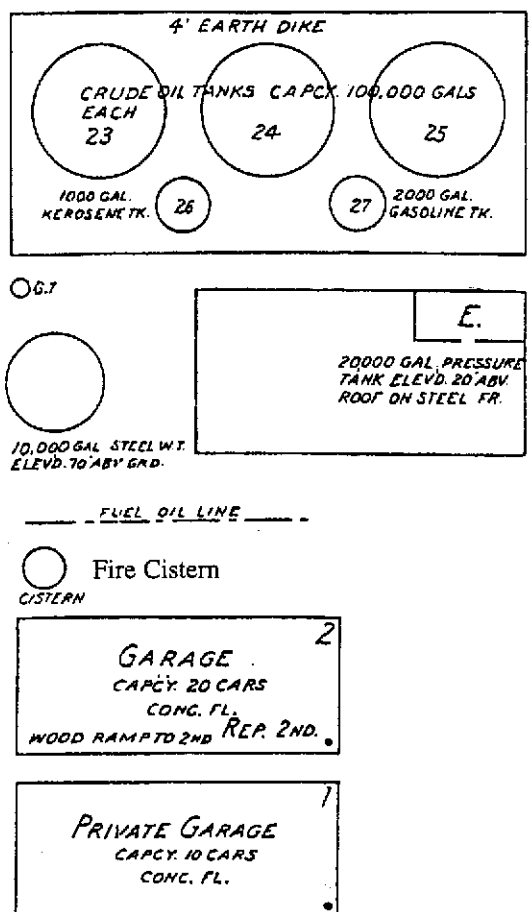

### CODING OF STRUCTURAL UNITS FOR FIREPROOF AND NON-COMBUSTIBLE BUILDINGS

FRAMING		FLOORS		ROOF	
CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT
A.	Reinforced Concrete Frame.	1.	Reinforced Concrete.	a.	Reinforced Concrete.
B.	Reinforced Concrete Joists, Columns, Beams, Trusses, Arches, Masonry Piers.		Reinforced Concrete with Masonry Units.		Reinforced Concrete with Masonry Units.
C.	Protected Steel Frame.		Pre-cast Concrete or Gypsum Slabs or Planks.		Reinforced Gypsum Concrete. Pre-cast Concrete or Gypsum Slabs or Planks.
D.	Individually Protected Steel Joists, Columns, Beams, Trusses, Arches.	2.	Concrete or Metal Lath, Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.	b.	Concrete or Gypsum on Metal Lath, Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.
E.	Indirectly Protected Steel Frame.				
F.	Indirectly Protected Steel Joists, Columns, Beams, Trusses, Arches.	3.	Open Steel Deck or Grating.	c.	Incombustible Composition Boards with or without Insulation. Masonry or Metal Tiles.
G.	Unprotected Steel Frame.				
H.	Unprotected Steel Joists, Columns, Beams, Trusses, Arches.			d.	Steel Deck, Corrugated Metal or Asbestos Protected Metal with or without Insulation.
O.	Masonry Bearing Walls.				

LAND USE APPLICABLE TO CHANGES DIAGRAMMED AFTER 5/69

R	RESIDENTIAL	M	MANUFACTURING
RT	RESIDENTIAL-TRANSIENT	P	PUBLIC OR INSTITUTIONAL
C	COMMERCIAL	U	UTILITY
W	WAREHOUSE	T	TRANSPORTATION

NUMERICAL PREFIX INDICATES THE NUMBER OF ESTABLISHMENTS IN EACH CATEGORY

The coding for framing, floor and roof structural units as shown above is used in describing the construction of fire-resistive buildings. In addition, reports for fire resistive buildings will show the date built and wall construction other than brick.

F P Buildings have masonry floors and roof; concrete and/or directly or indirectly protected steel framing; and clay brick, stone or poured concrete walls.


F P X buildings are F P buildings with inferior walls such as concrete block, cement brick, metal or glass panels, etc.

N C buildings have unprotected steel framing and fire-resistive but non-masonry floors and roof.

**FP-1962 (CONC.) A-1-a**  
A fire-resistive building built in 1962 with concrete walls and reinforced concrete frame, floors, and roof.

**FP-1962 (METAL PANELS) H-2-d**  
A fire-resistive building built in 1962 with metal panel walls, indirectly protected steel frame, concrete floors and roof on metal lath, noncombustible ceilings.


**NC-1962 (C.B.) H-2-d**  
A noncombustible building built in 1962 with concrete block walls; unprotected steel columns and beams; concrete floors on metal lath and steel deck roof.

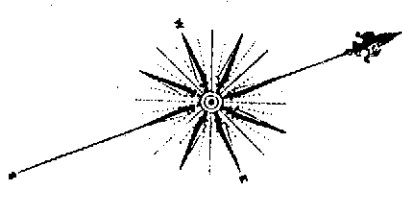


25 I

22


MARKET

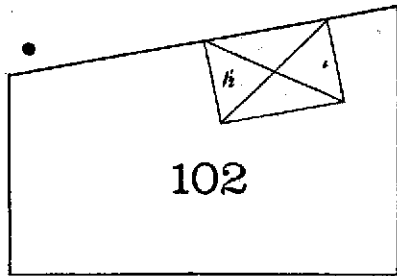




BRUSH

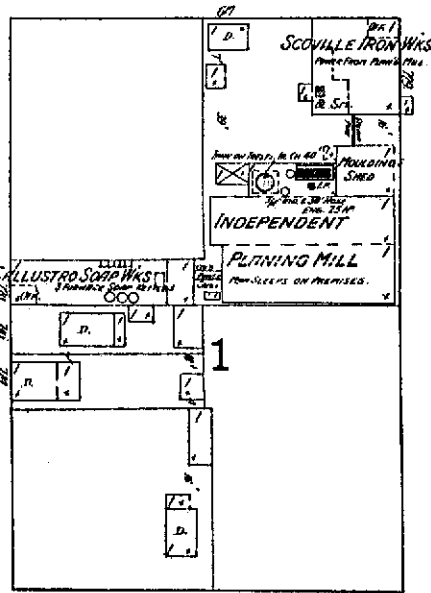

CASTRO

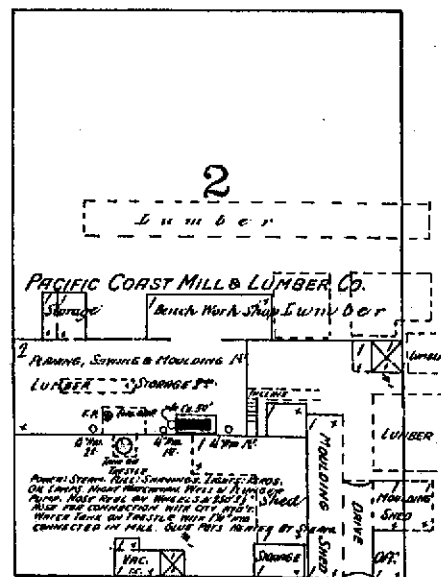

GROVE

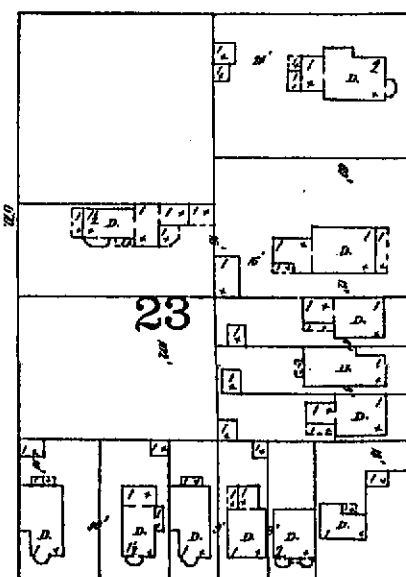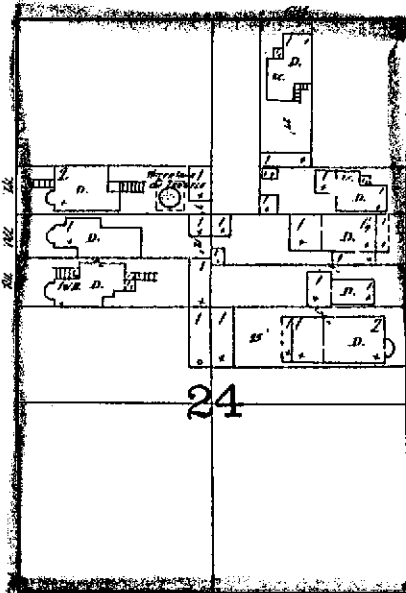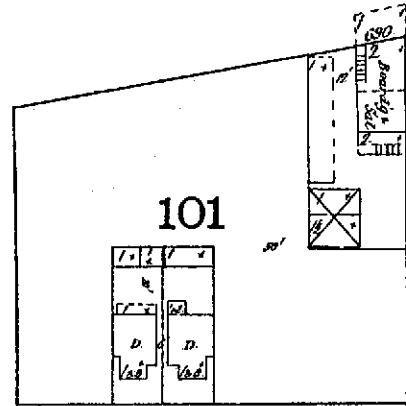

13

12

STREET

STREET

STREET

STREET

WATER

FIRST

SECOND

THIRD

# Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606








THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY BE FURTHER REPRODUCED WITHOUT PERMISSION.



39

Bay of San Francisco

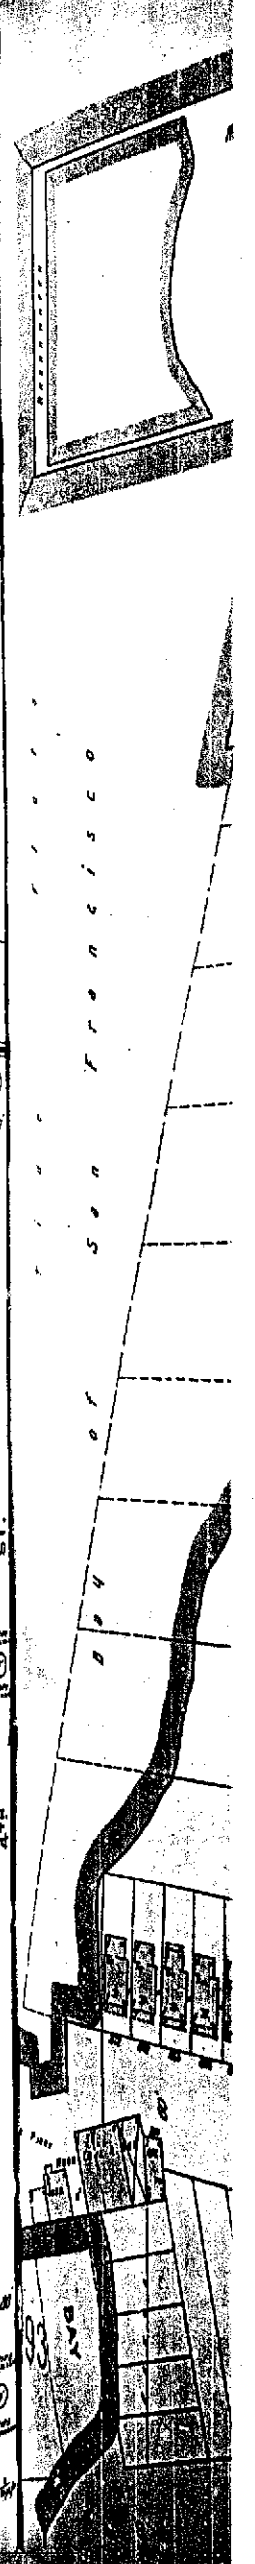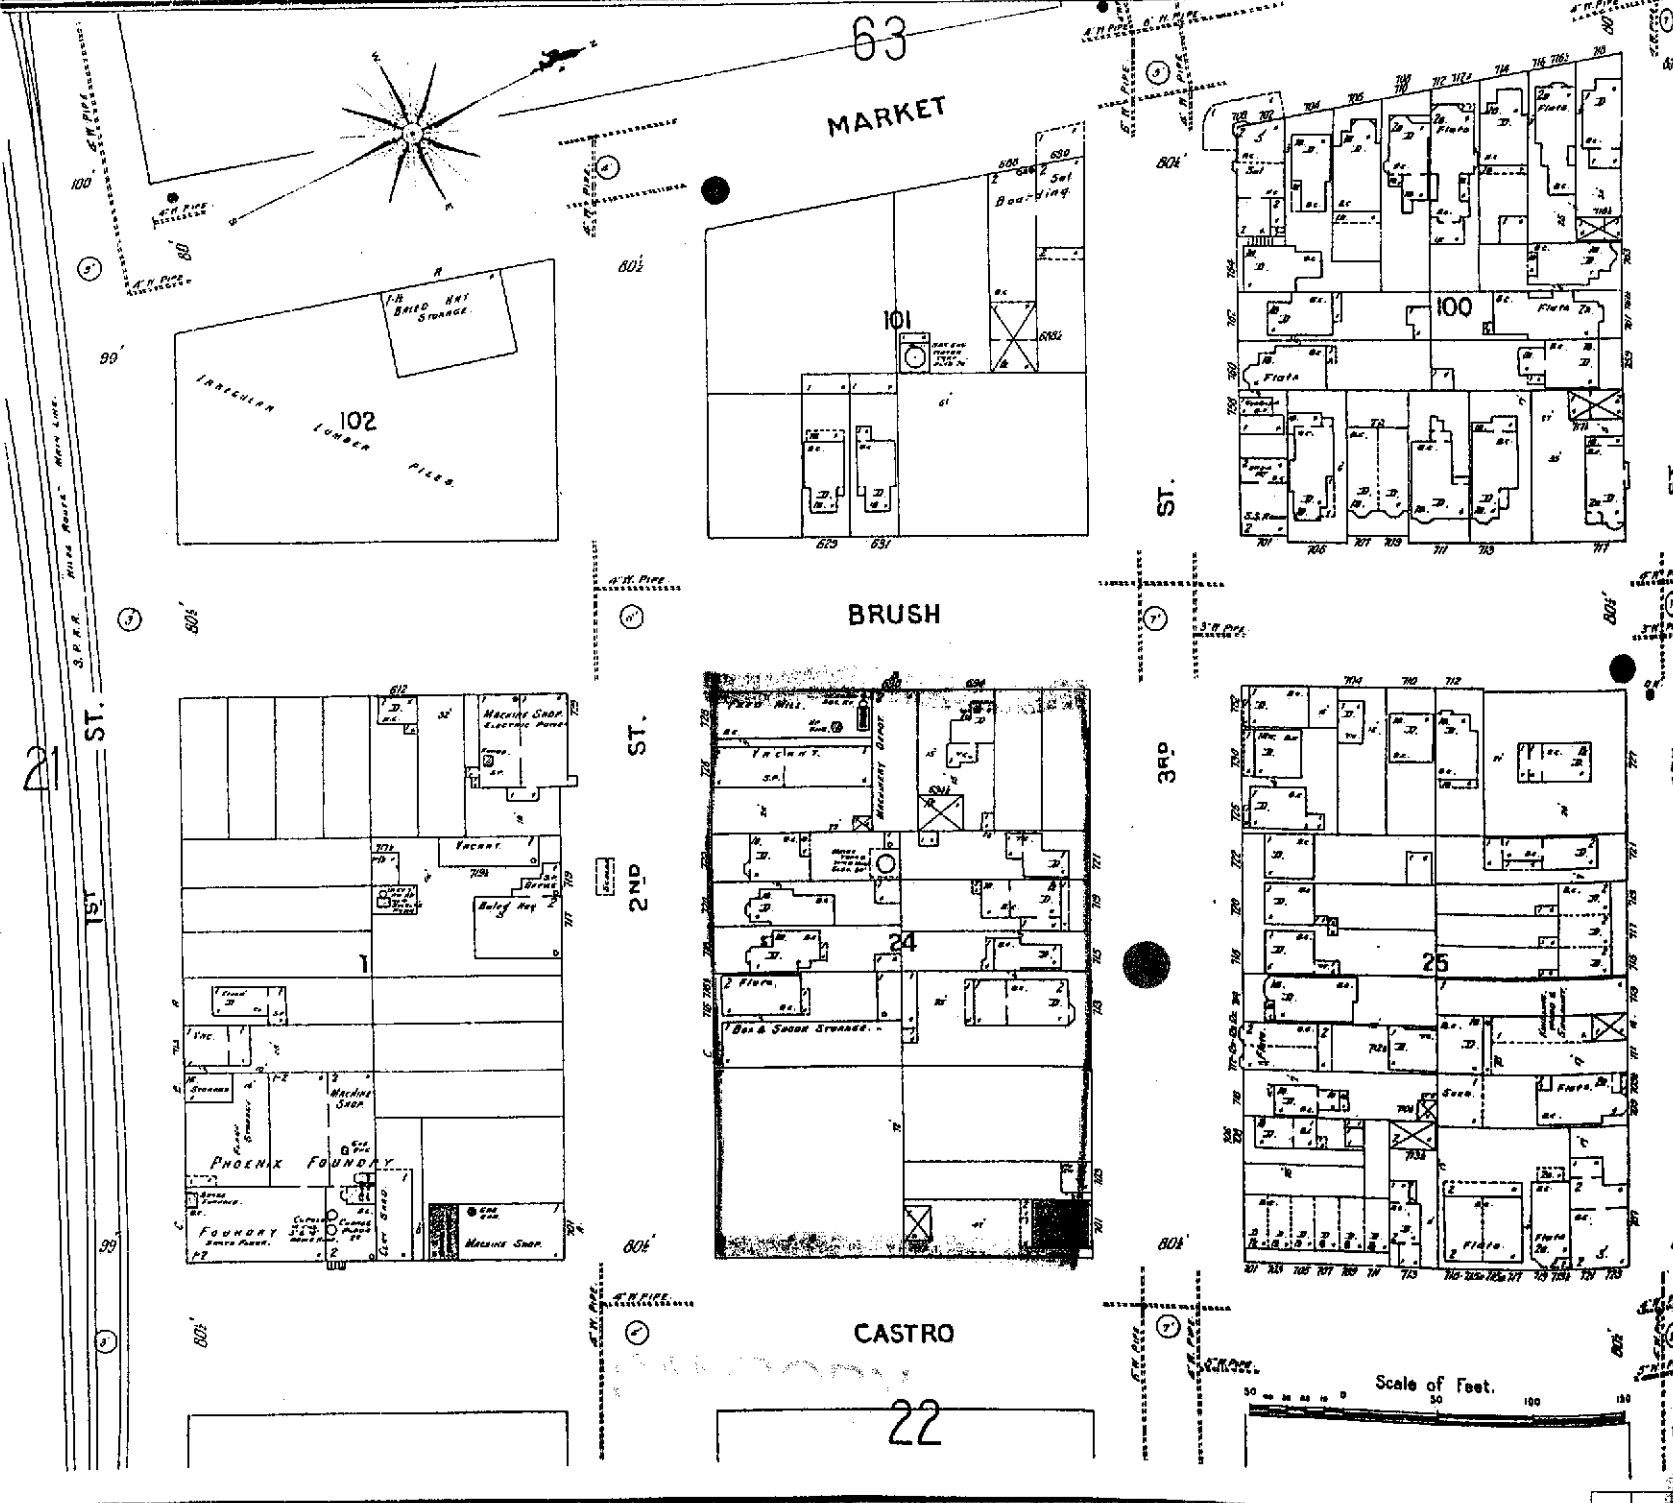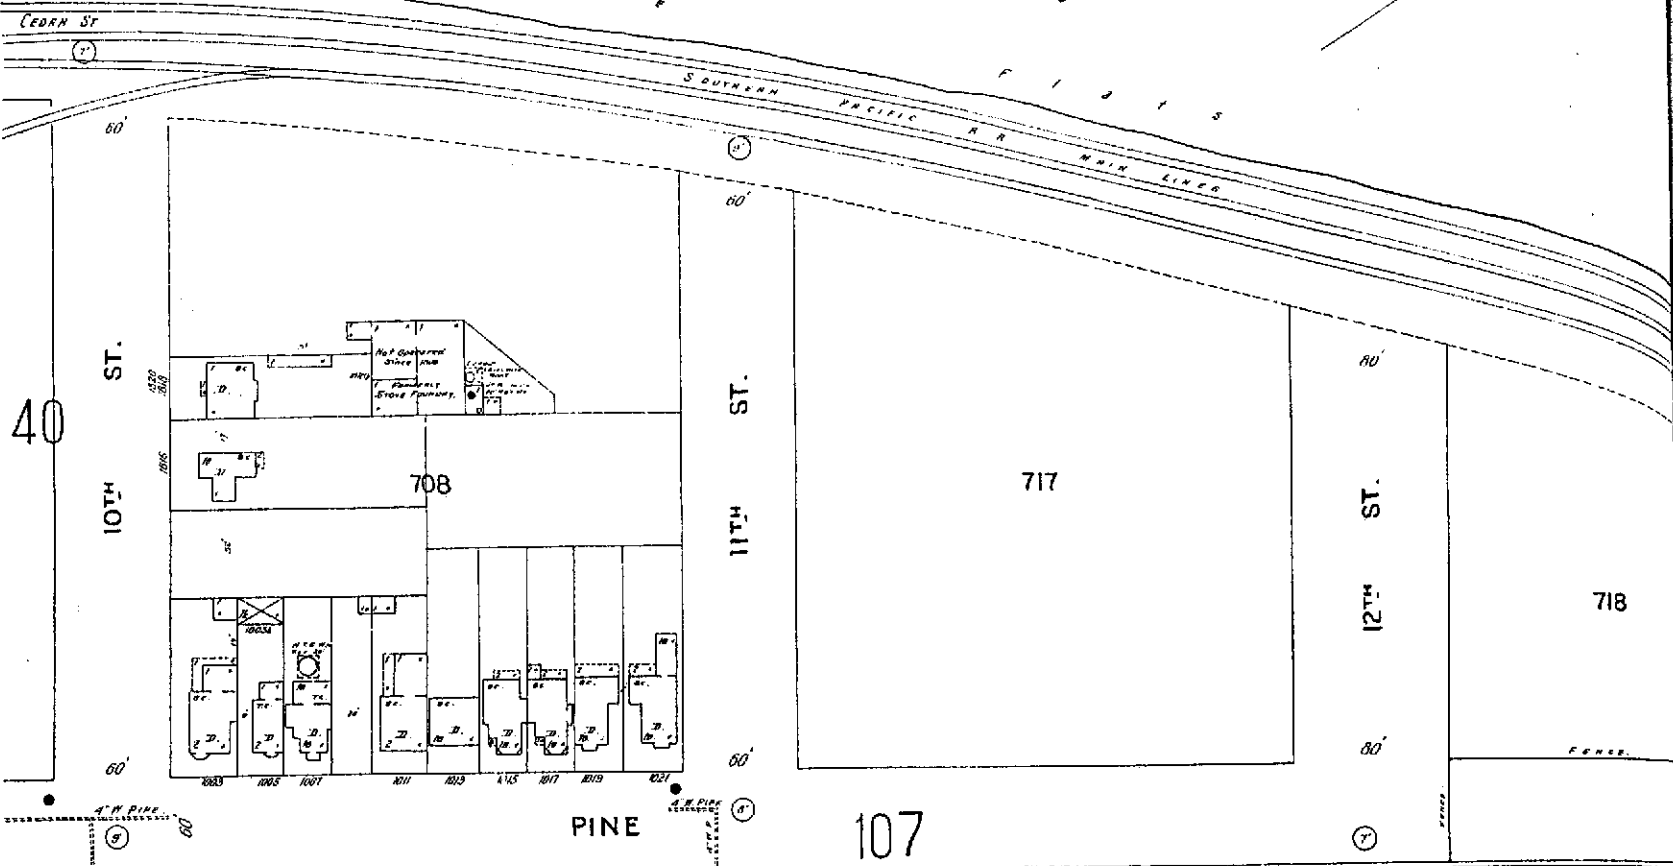

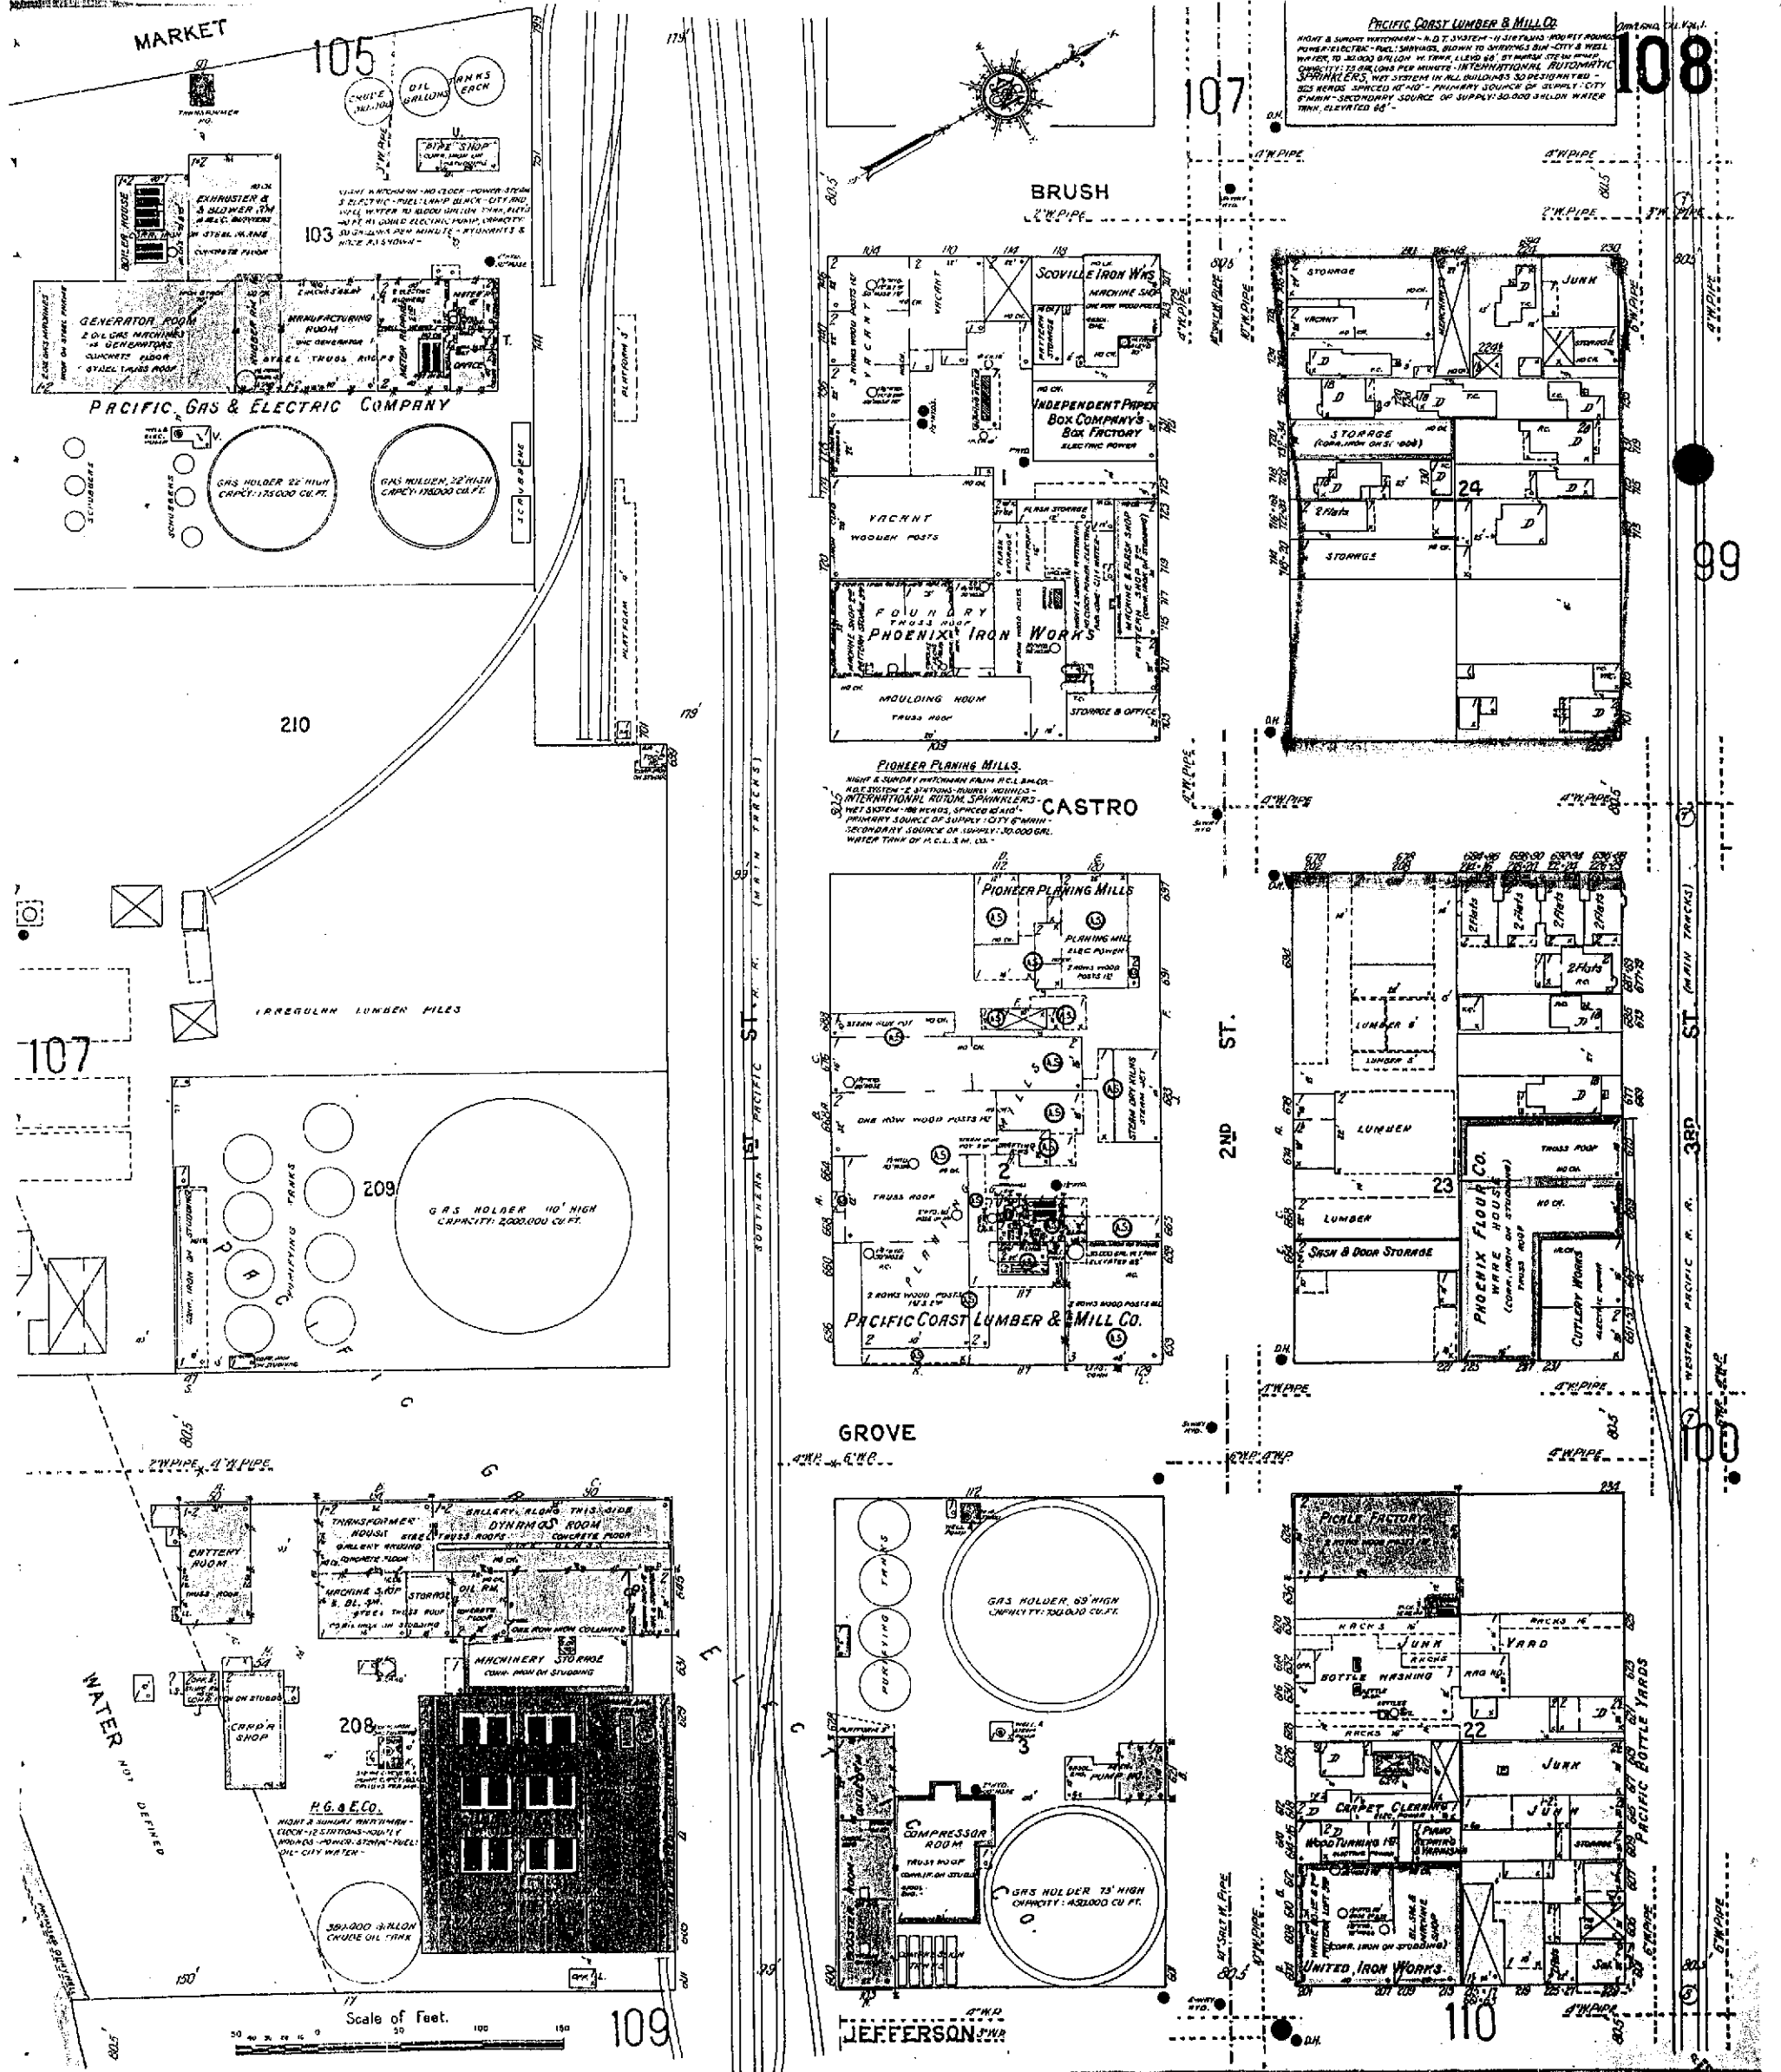

SANBORN


# Environmental Risk Information & Imaging Services



505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606


THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY BE FURTHER REPRODUCED WITHOUT PERMISSION.

1112

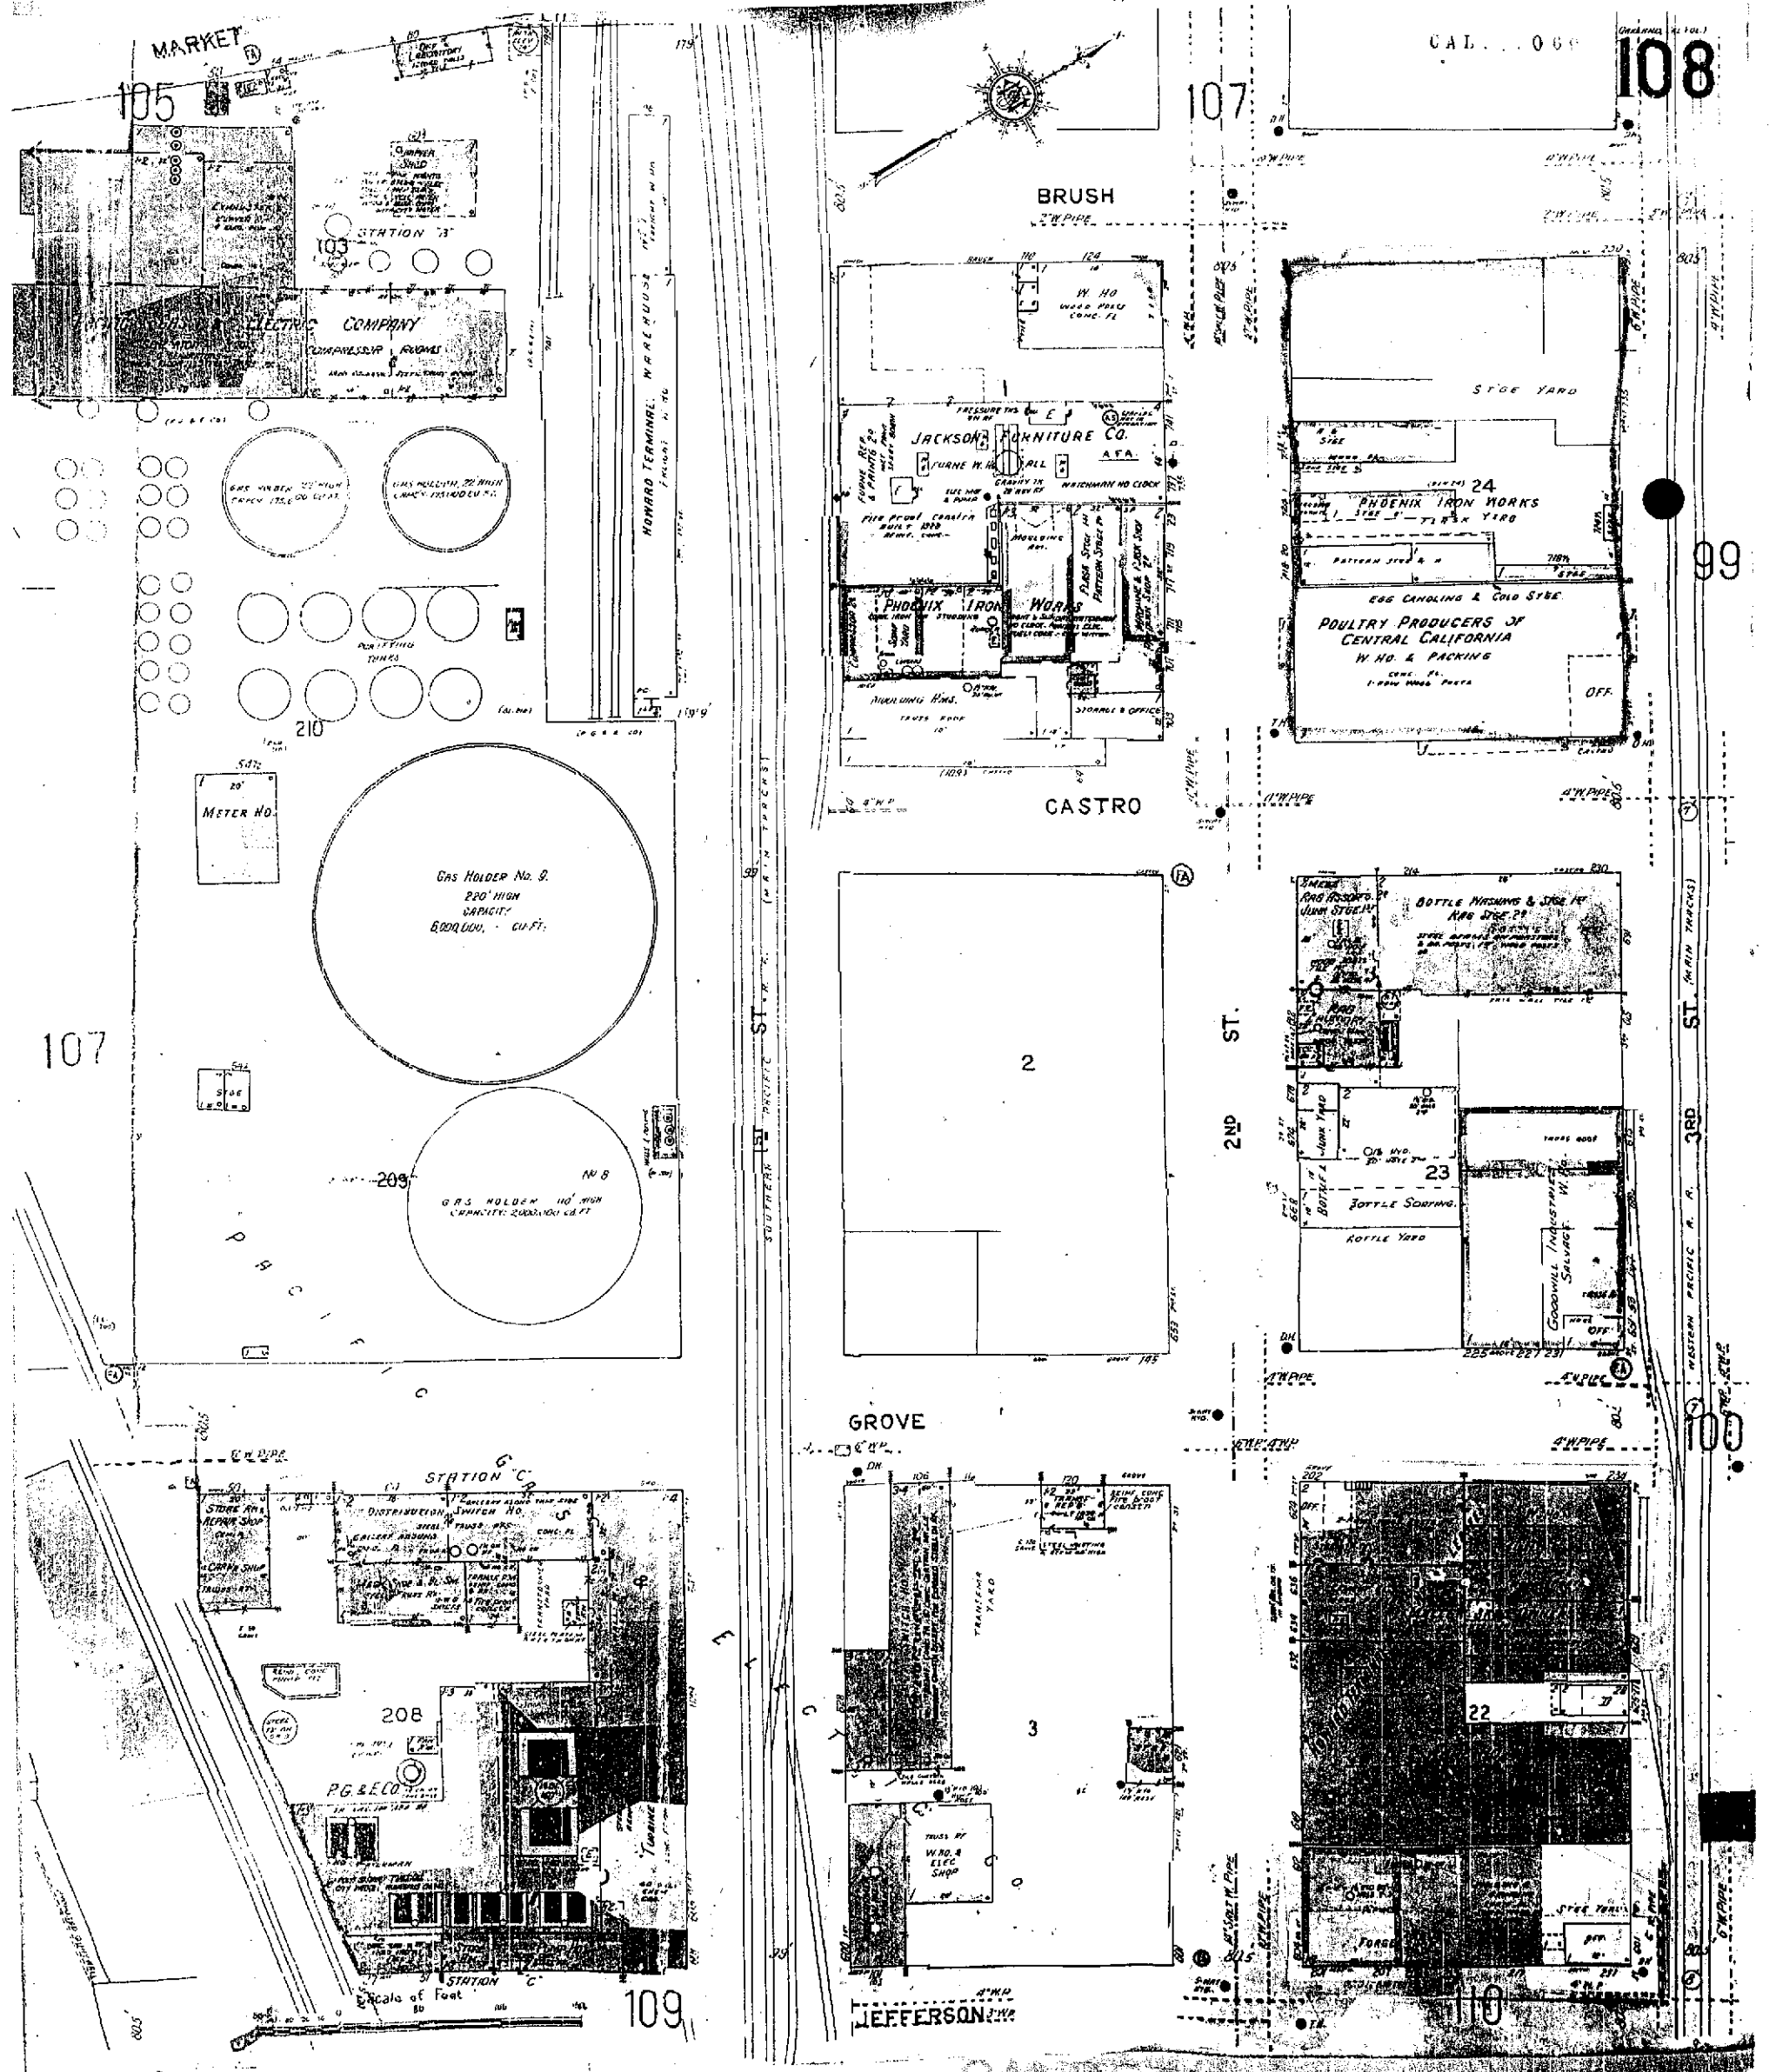

THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND FURTHER REPRODUCED WITHOUT PERMISSION.


1991

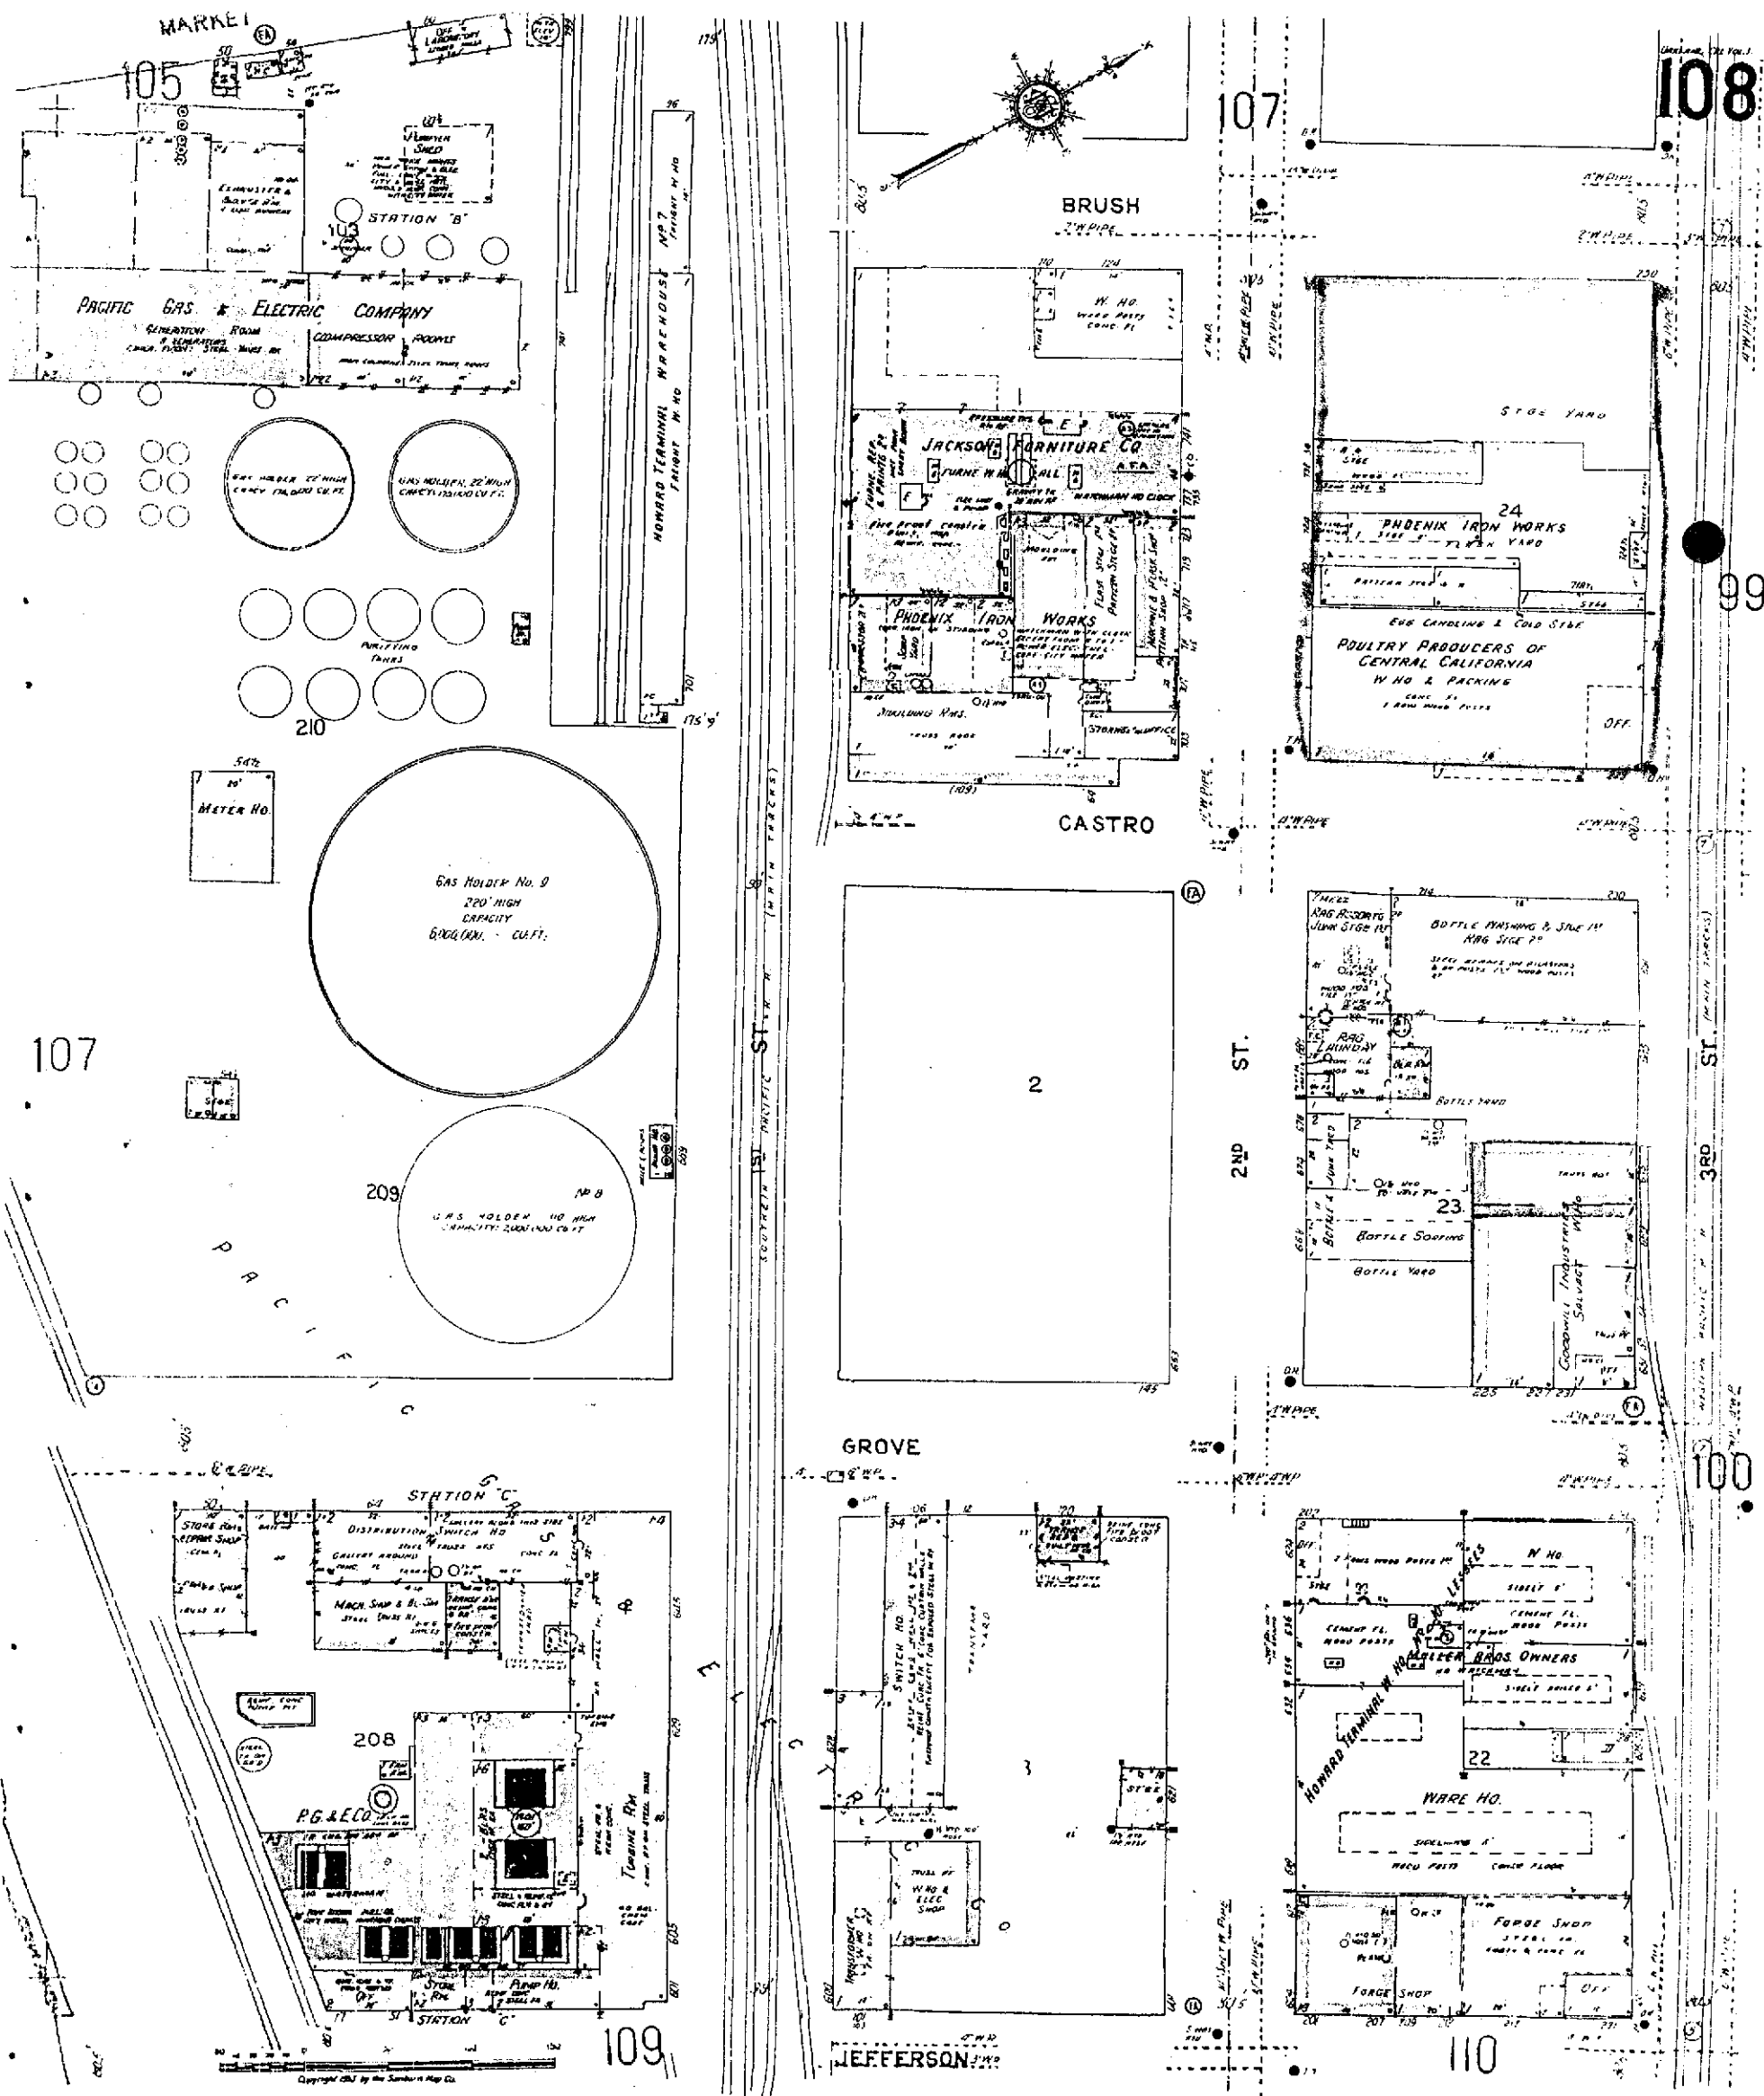

SANBORN


# Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606




THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY BE FURTHER REPRODUCED WITHOUT PERMISSION.

752

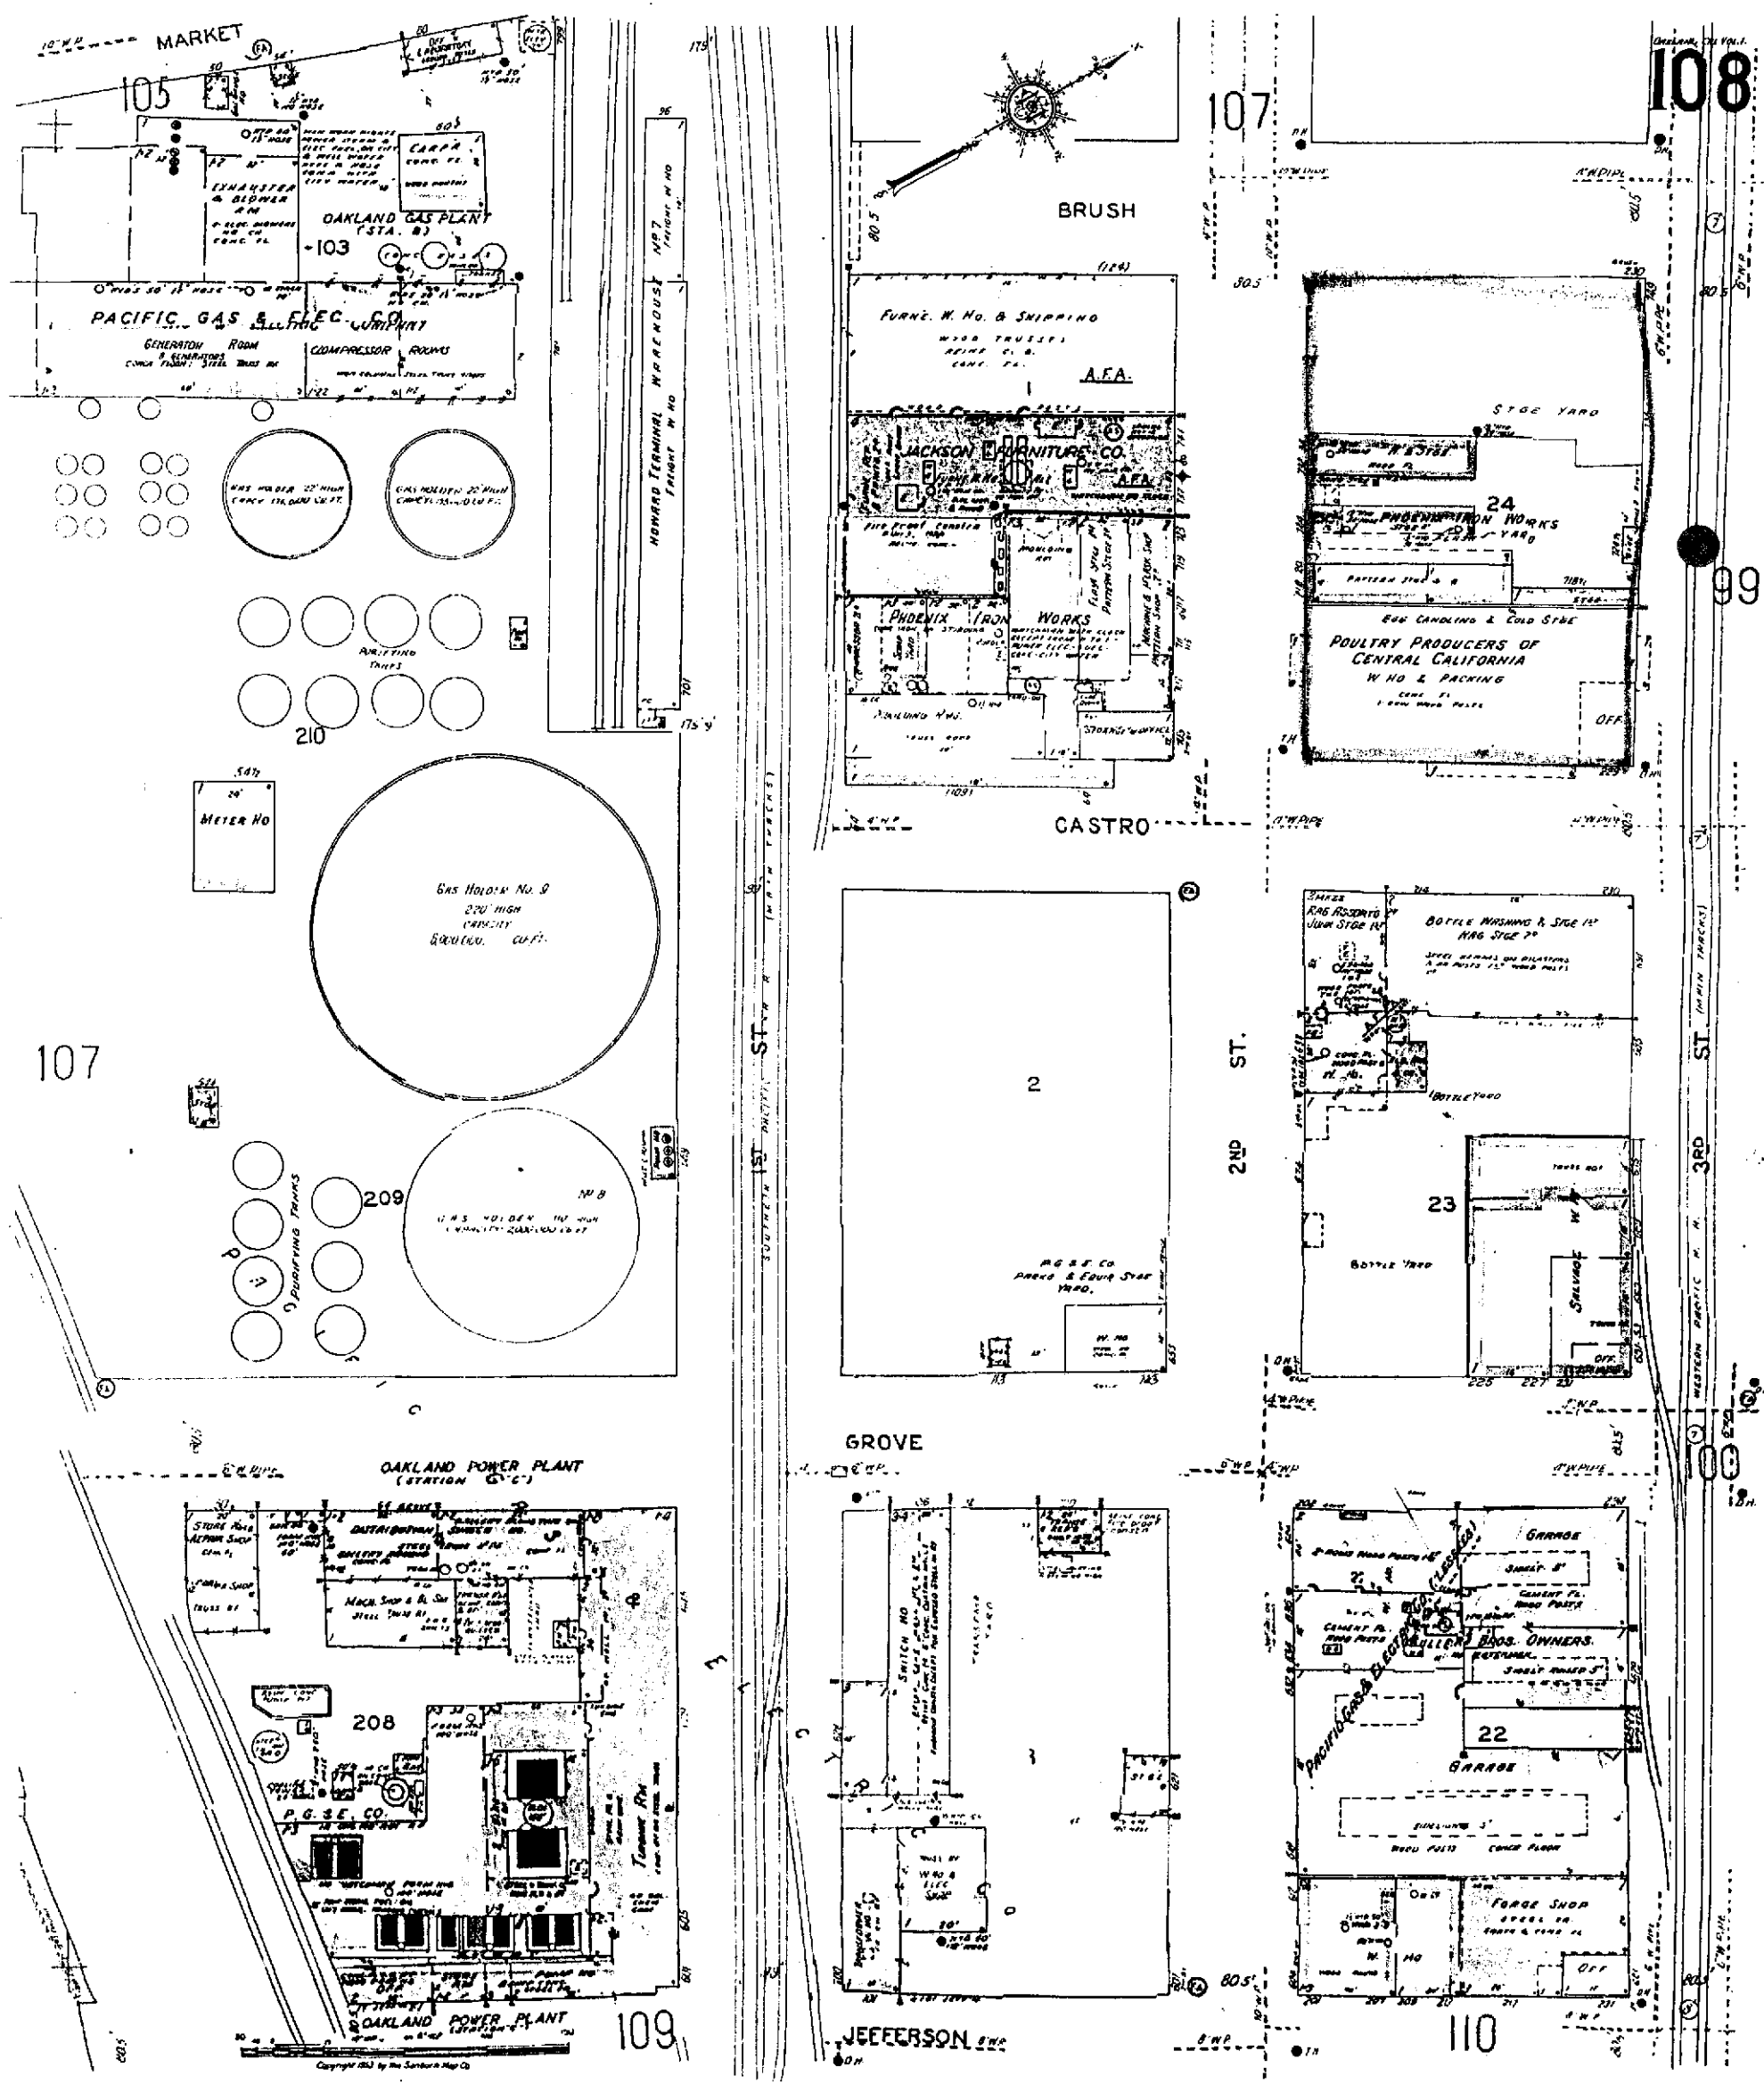

# Environmental Risk Information & Imaging Services









505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606



THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY BE FURTHER REPRODUCED WITHOUT PERMISSION.


1987



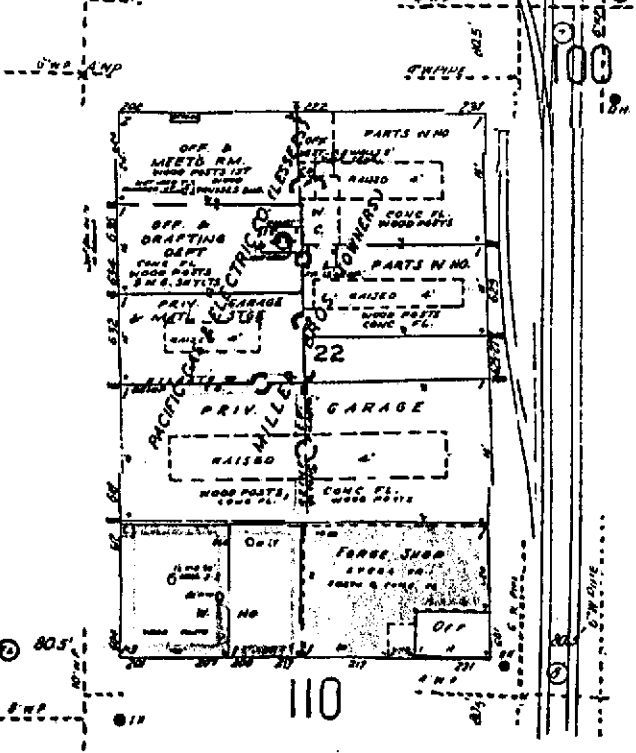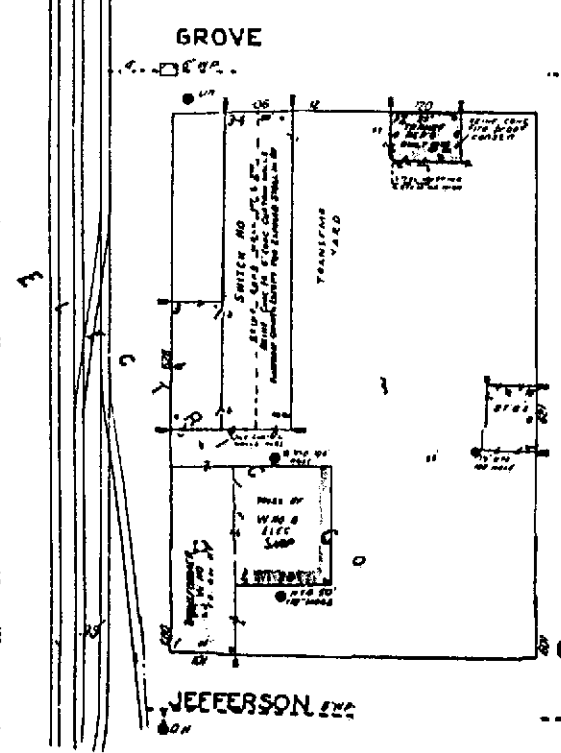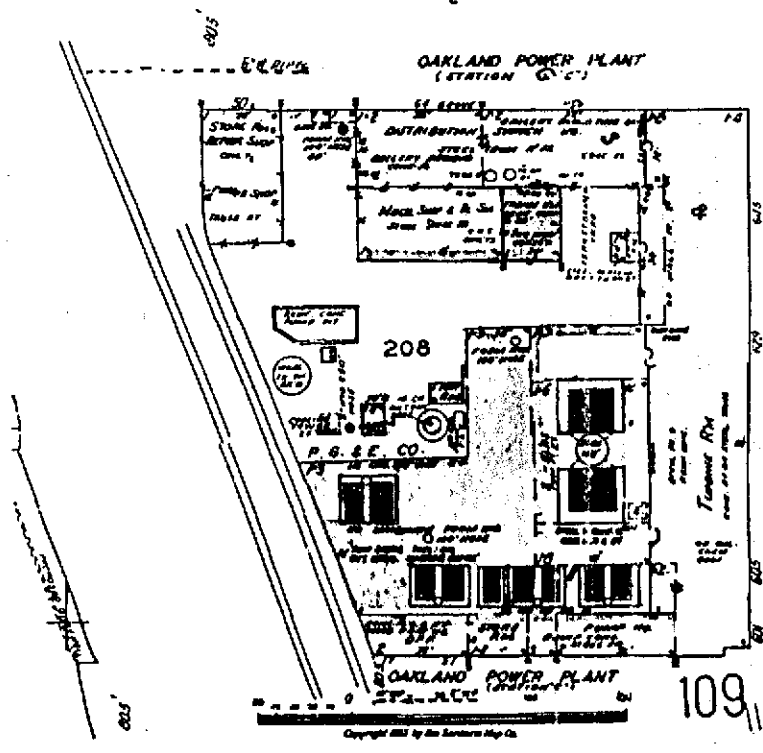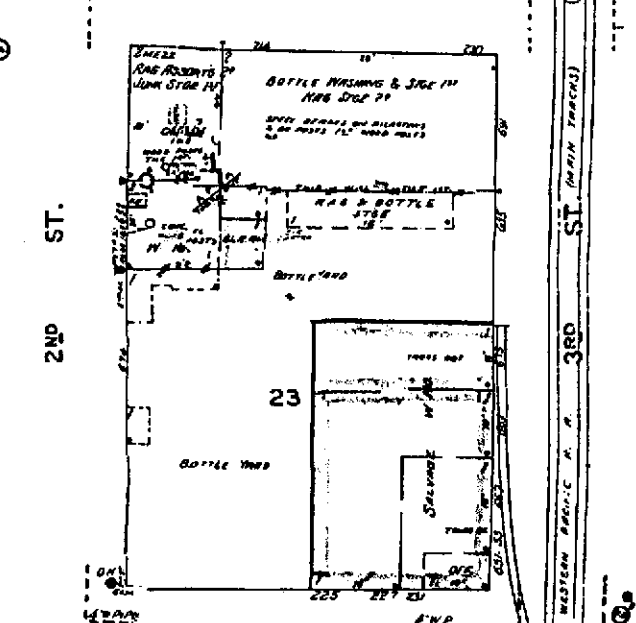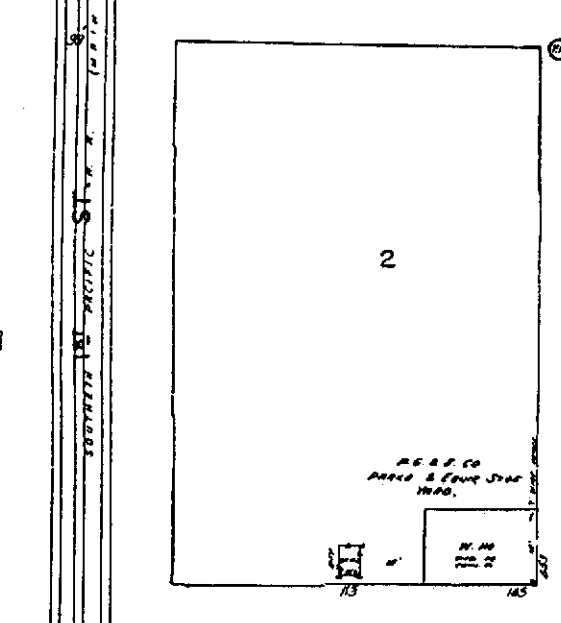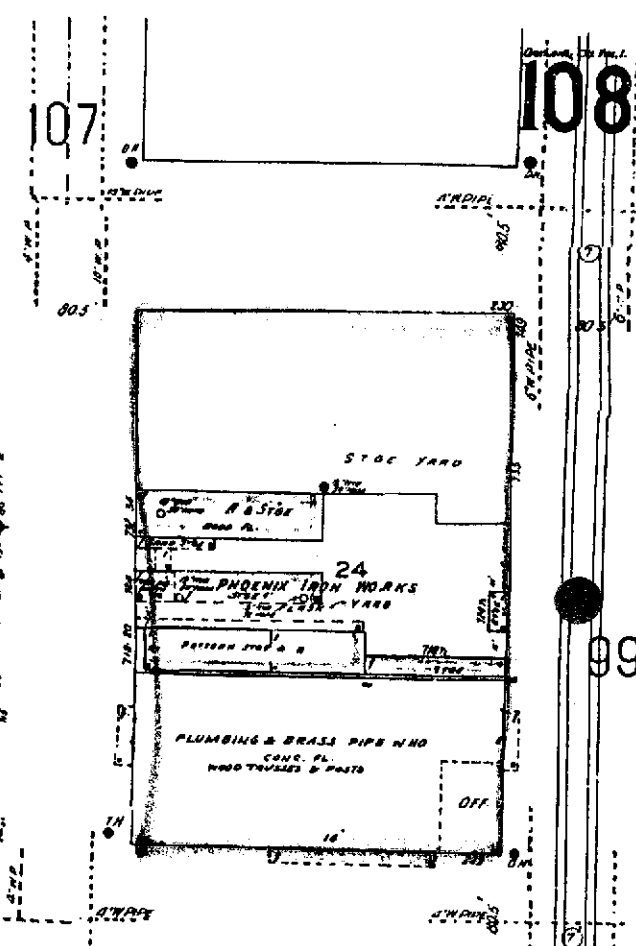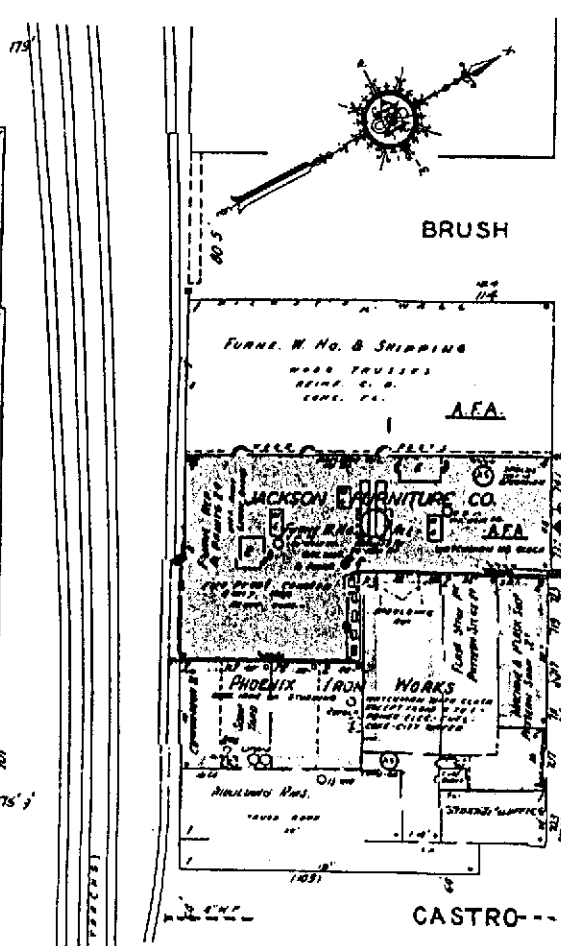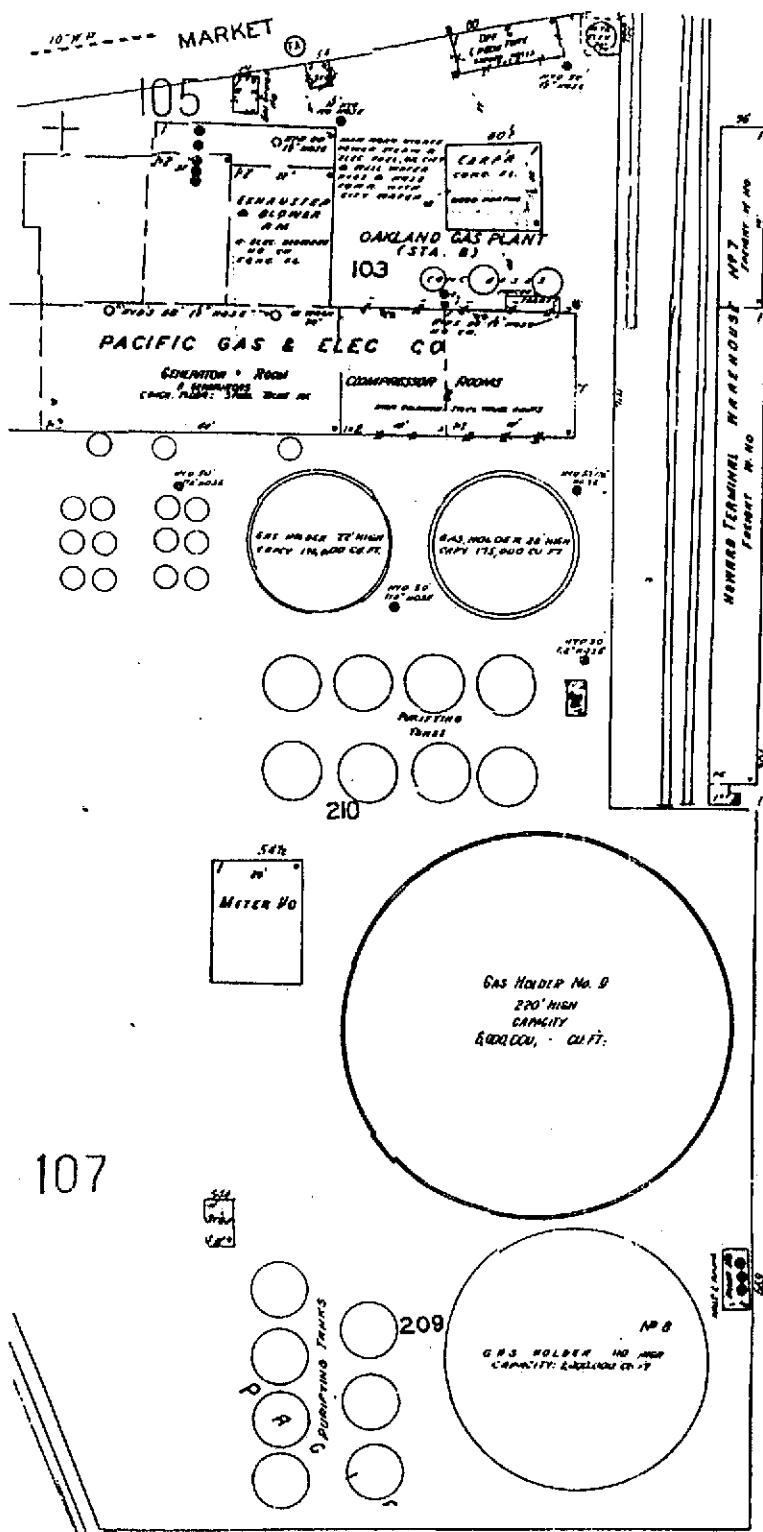


# Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606



THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY BE FURTHER REPRODUCED WITHOUT PERMISSION.


1958

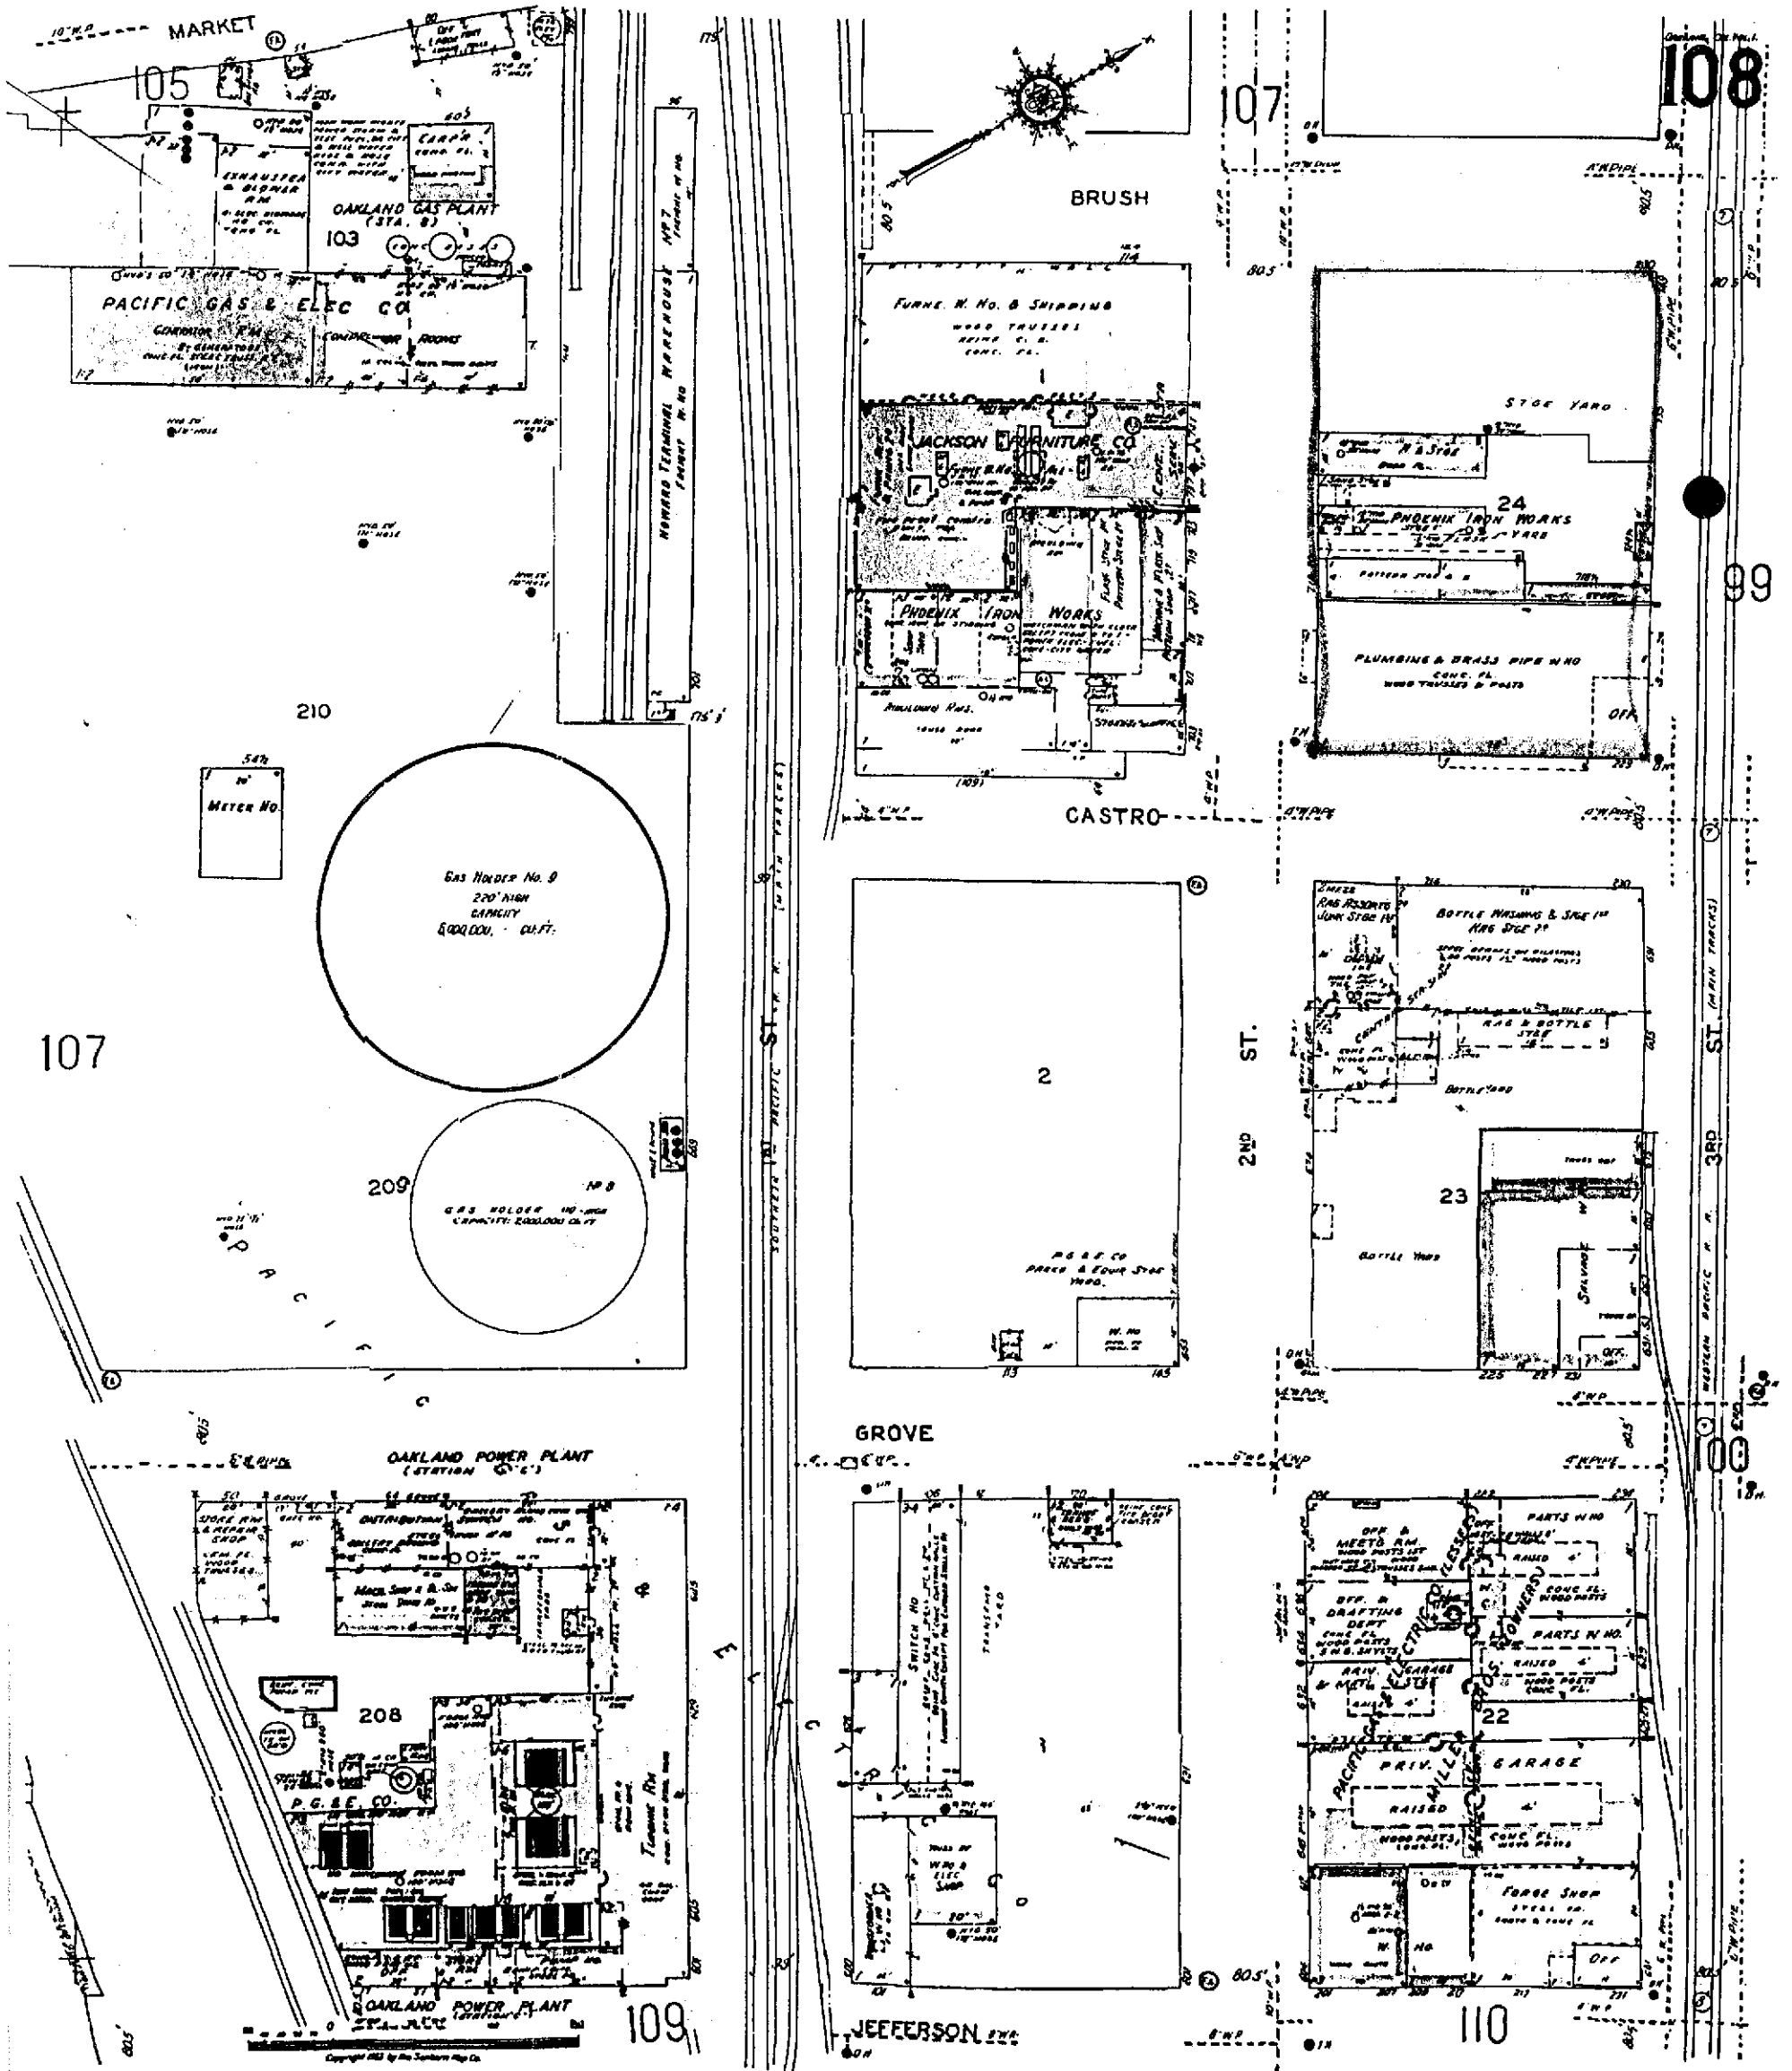

SANBORN


# Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606




THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND FURTHER REPRODUCED WITHOUT PERMISSION.

1961

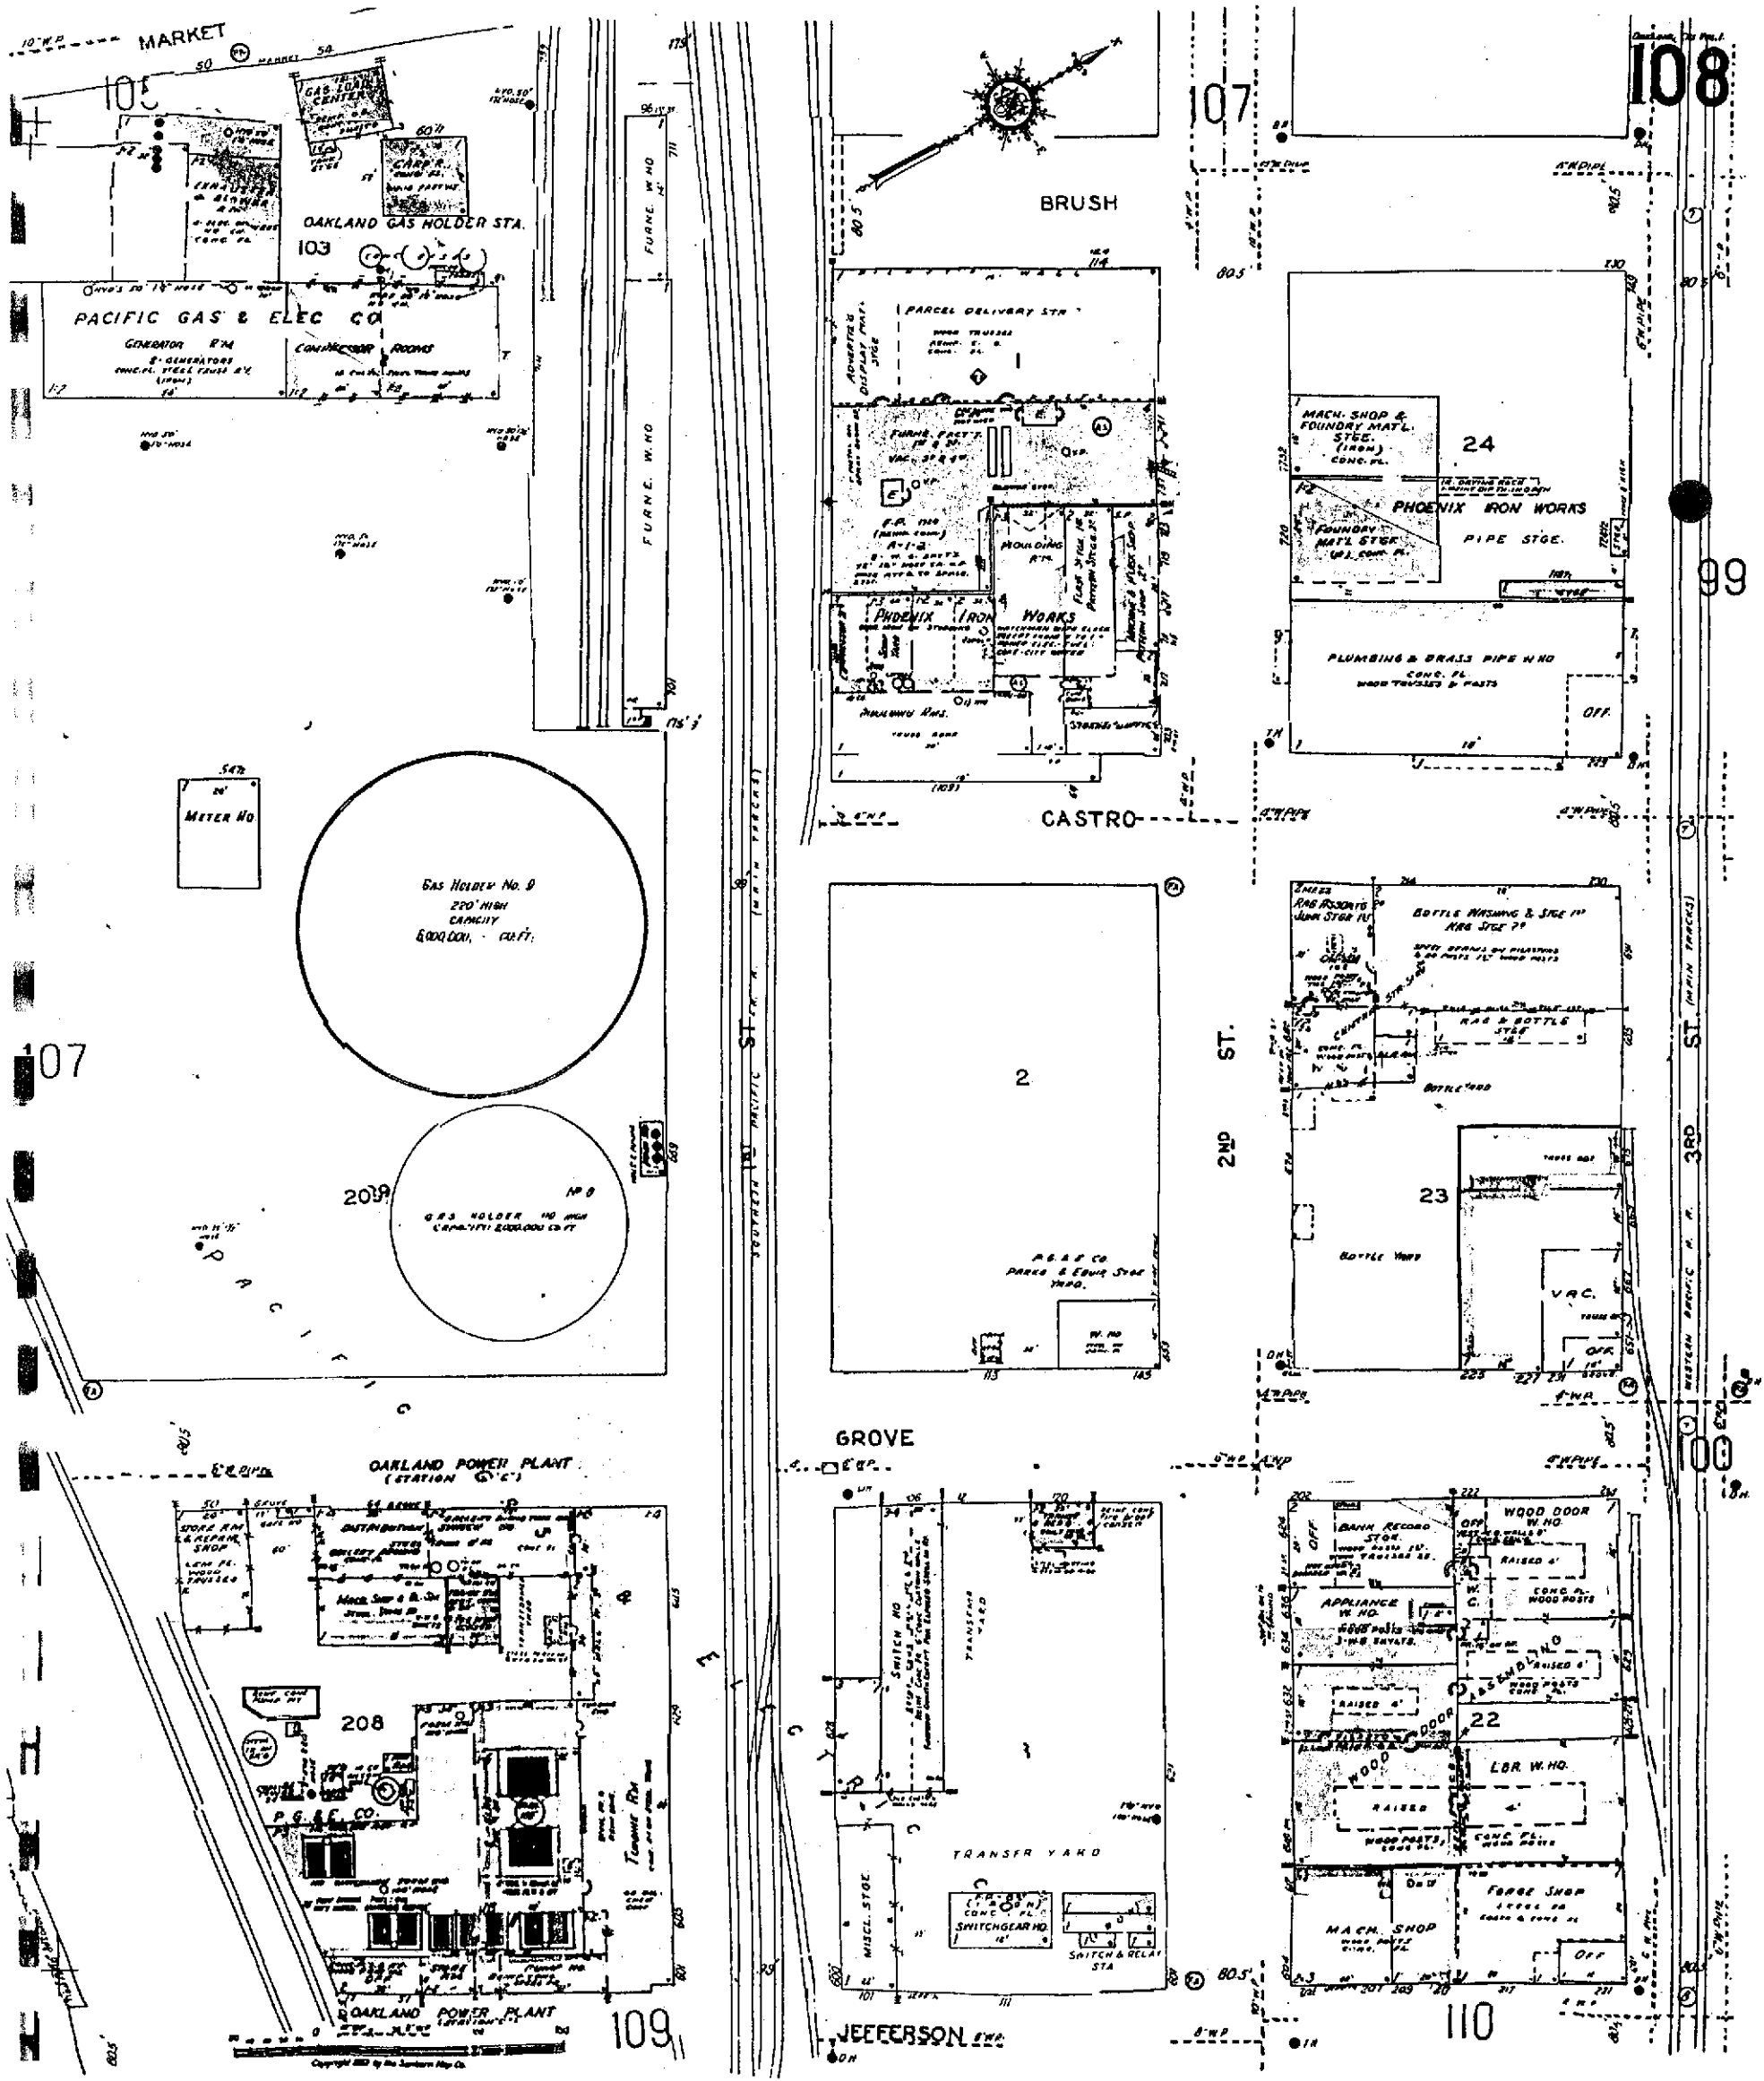

# Environmental Risk Information & Imaging Services




505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606

THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND I FURTHER REPRODUCED WITHOUT PERMISSION.

1967



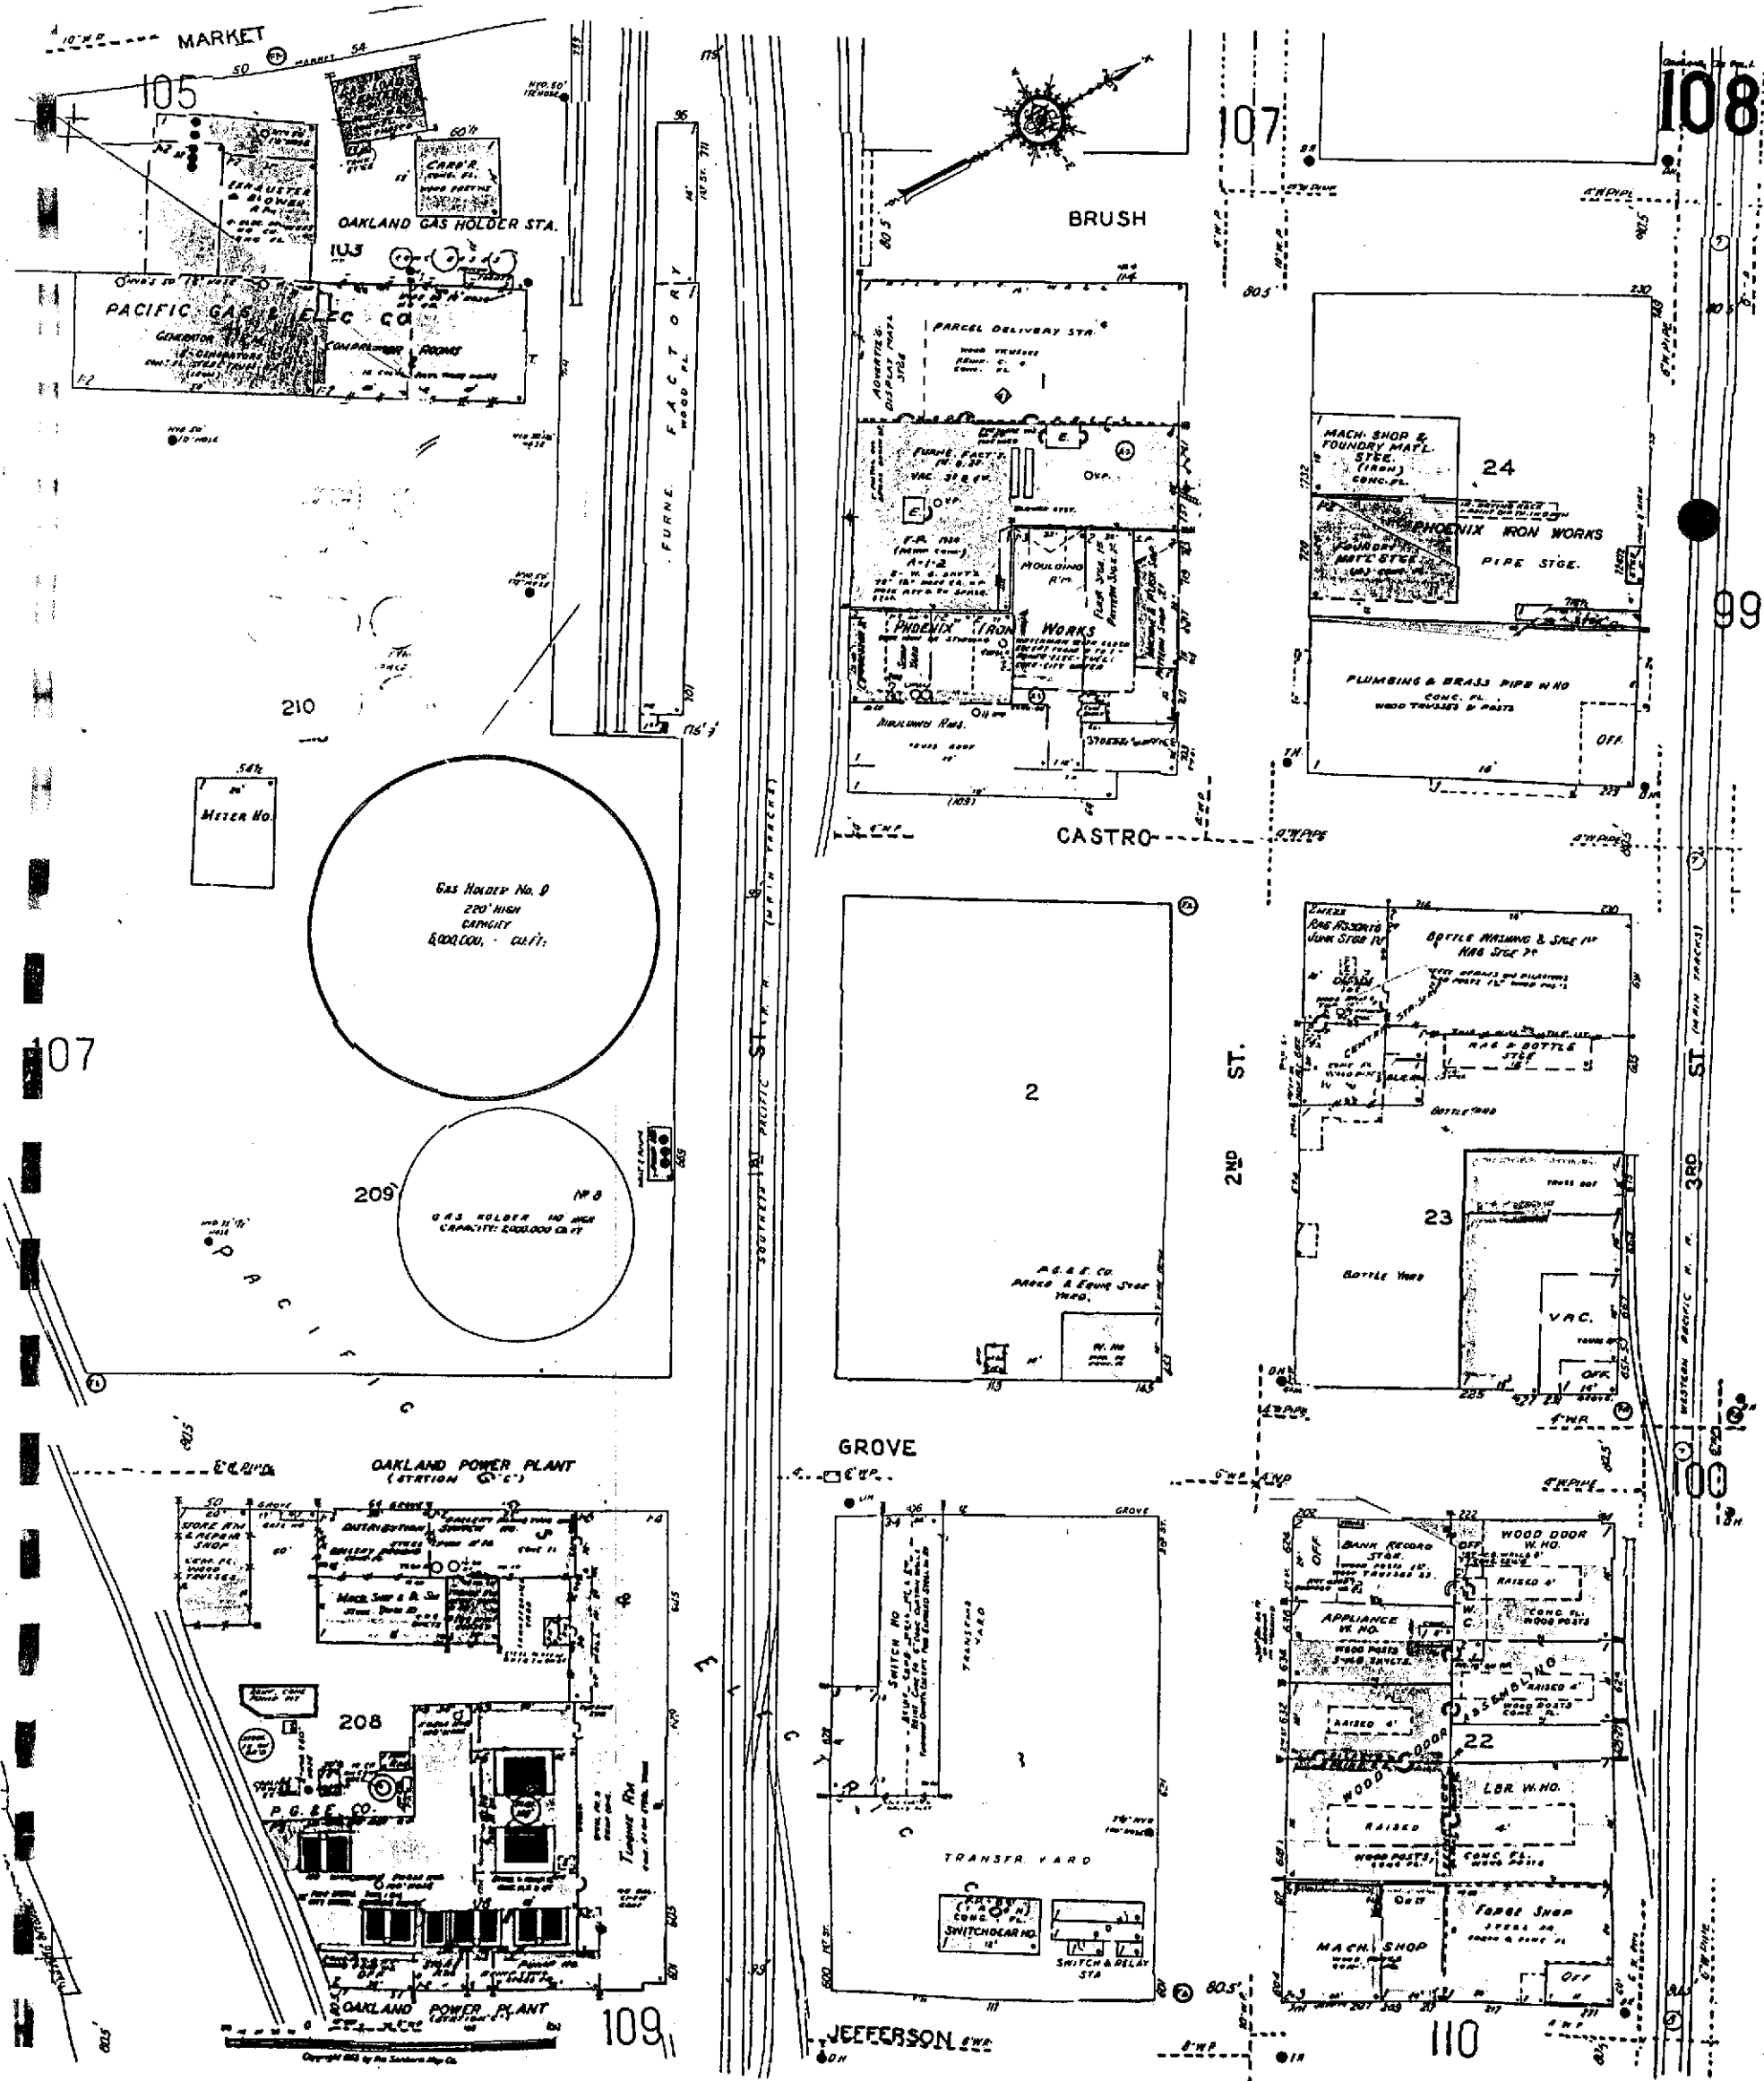


9

SANBORN

# Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606




THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND FURTHER REPRODUCED WITHOUT PERMISSION.

1970

# SITE ASSESSMENT PLUS REPORT

PROPERTY INFORMATION	CLIENT INFORMATION
Project Name/Ref #: 04400006 Proposed Commercial Development 229 Castro St. and 720 2nd St. Oakland, CA 94607 Latitude/Longitude: ( 37.799541, 122.282032 )	Alex Gallego KRAZAN ASSOCIATES - SAN JOSE 550 PARROTT ST SAN JOSE, CA 95112

Site Distribution Summary	<i>within 1/8 mile</i>	<i>1/8 to 1/4 mile</i>	<i>1/4 to 1/2 mile</i>	<i>1/2 to 1 mile</i>
<b>Agency / Database - Type of Records</b>				
<b>A) Databases searched to 1 mile:</b>				
US EPA    NPL            National Priority List	0	0	0	1
US EPA    CORRACTS    RCRA Corrective Actions	1	1	0	2
STATE    SPL            State equivalent priority list	0	0	0	4
<b>B) Databases searched to 1/2 mile:</b>				
STATE    SCL            State equivalent CERCLIS list	1	2	5	-
US EPA    CERCLIS /    Sites currently or formerly under review NFRAP            by US EPA	0	2	3	-
US EPA    TSD            RCRA permitted treatment, storage, disposal facilities	0	0	0	-
STATE REG    LUST            Leaking Underground Storage Tanks CO	7	13	30	-
STATE/    SWLF            Permitted as solid waste landfills, REG/CO            incinerators, or transfer stations	0	0	0	-
STATE    DEED RSTR    Sites with deed restrictions	0	0	0	-
REGIONAL    NORTH BAY    Sites on North Bay Toxic List	1	1	2	-
REGIONAL    SOUTH BAY    Sites on South Bay Toxic List	0	0	0	-
STATE    CORTESE       State index of properties with hazardous waste	5	6	8	-
STATE    TOXIC PITS    Toxic Pits cleanup facilities	0	0	0	-
USGS/STATE    WATER            Federal and State Drinking Water WELLS            Sources	0	0	0	-



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: **882501901**

Version 2.6.1

Date of Report: **January 25, 2000**


Page #1





# SITE ASSESSMENT PLUS REPORT

## Map of Sites within One Mile

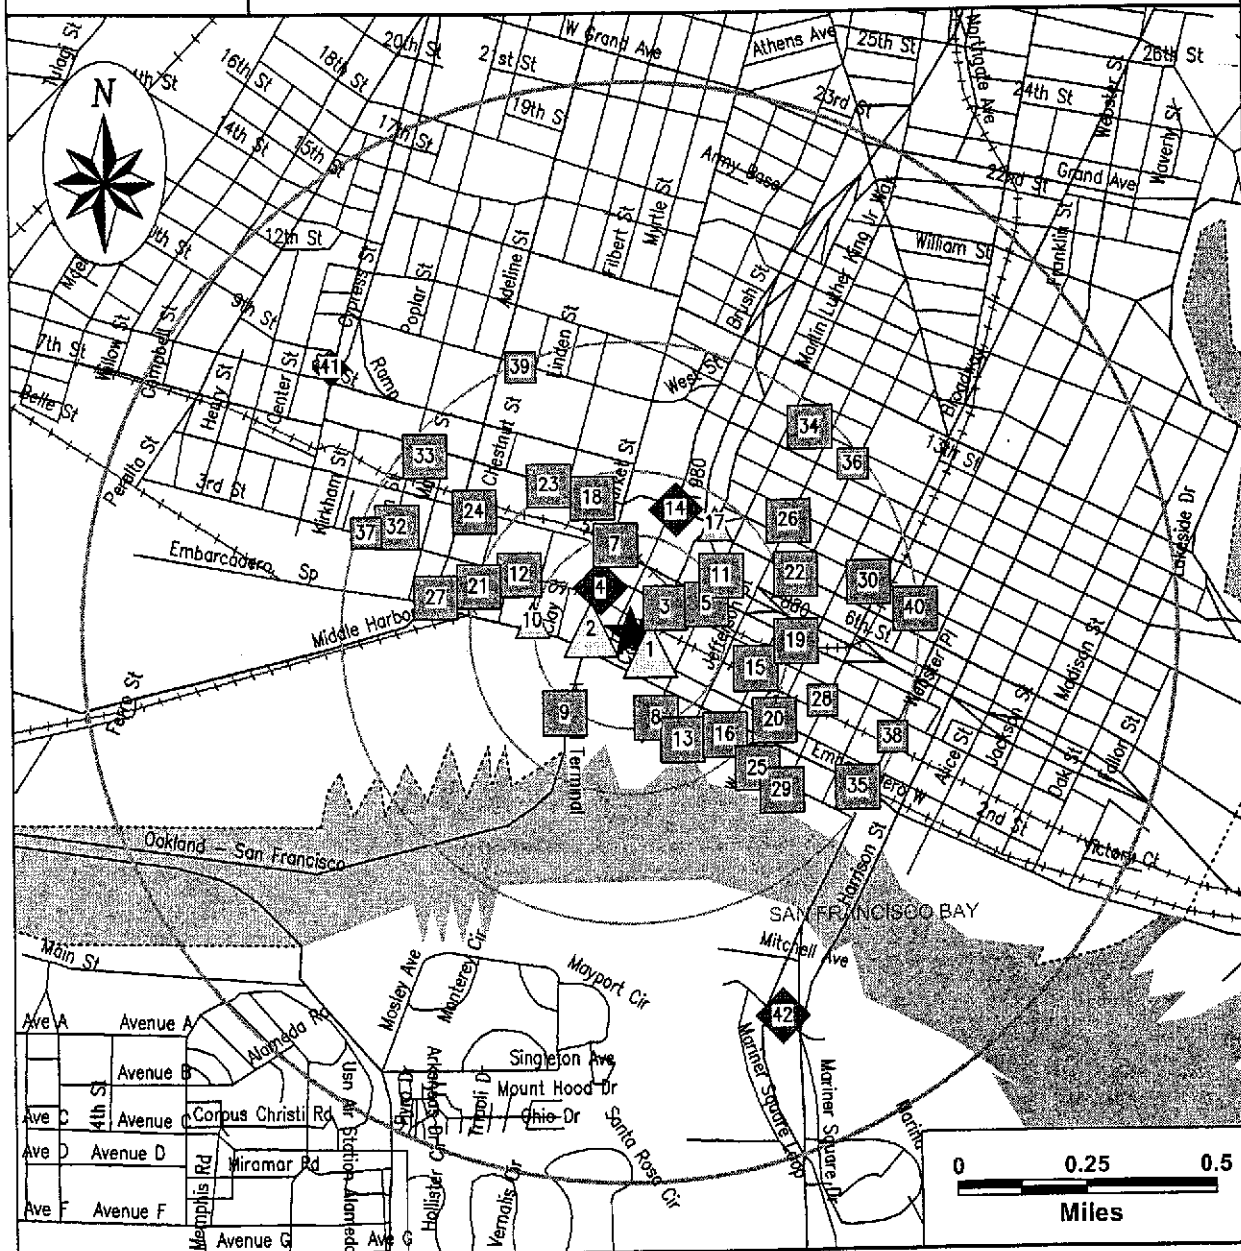


Subject Site	Category:	A	B	C	D
★	Databases Searched to:	1 mi.	1/2 mi.	1/4 mi.	1/8 mi.
	Single Sites	◆	■	▲	○
	Multiple Sites	◆	■	▲	○
Highways and Major Roads Roads Railroads Rivers or Water Bodies Utilities	NPL, SPL, CORRACTS (TSD) CERCLIS, NFRAP, TSD, LUST, SWLF, SCL RCRA VIOL, TRIS, UST ERNS, GENERATORS				

If additional databases are listed in the cover page of the report they are also displayed on this map. The map symbol used corresponds to the database category letter A,B,C,D.


For More Information Call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403  
 Report ID: 882501901

Date of Report: January 25, 2000  
 Page #3



# SITE ASSESSMENT PLUS REPORT


## Map of Sites within Quarter Mile

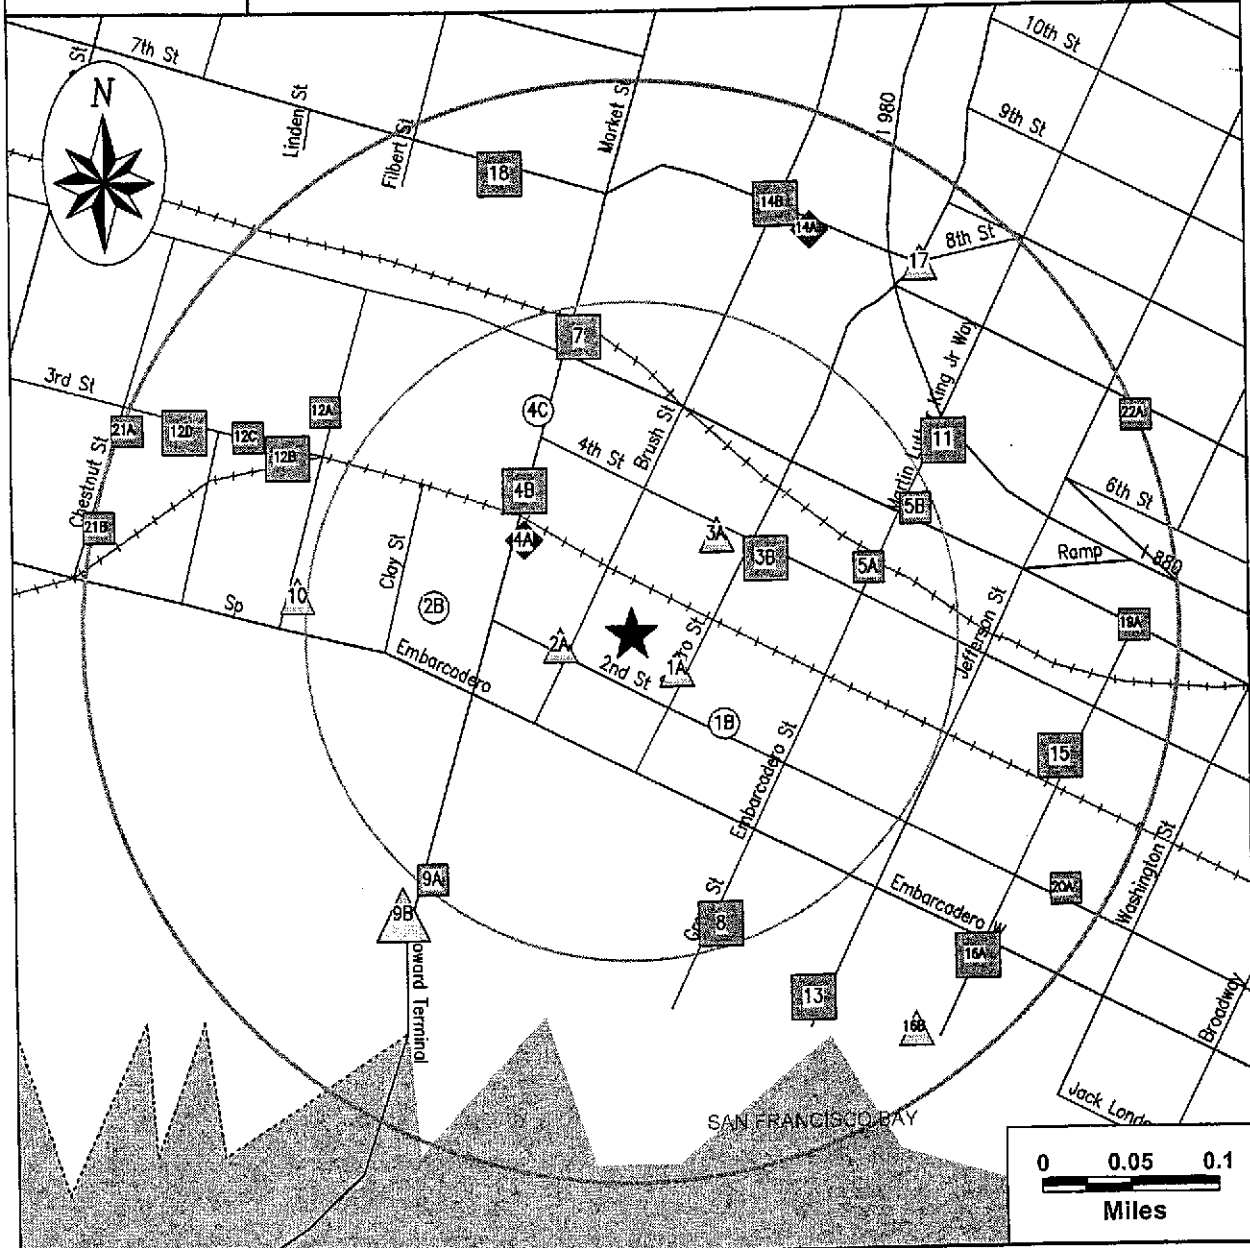

<b>Subject Site</b> 	<b>Category:</b> A 1 mi. 	<b>B</b> 1/2 mi. 	<b>C</b> 1/4 mi. 	<b>D</b> 1/8 mi. 
	<b>Databases Searched to:</b> Single Sites  Multiple Sites 	<b>NPL, SPL, CORRACTS (TSD)</b> 	<b>CERCLIS, NFRAP, TSD, LUST, SWLF, SCL</b> 	<b>RCRA VIOL, TRIS, UST</b> 
Highways and Major Roads Roads Railroads Rivers or Water Bodies Utilities	If additional databases are listed in the cover page of the report they are also displayed on this map. The map symbol used corresponds to the database category letter A,B,C,D.			


For More Information Call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403  
 Report ID: 882501901

Date of Report: January 25, 2000  
 Page #4



# SITE ASSESSMENT PLUS REPORT

## Sites Represented as Polygons

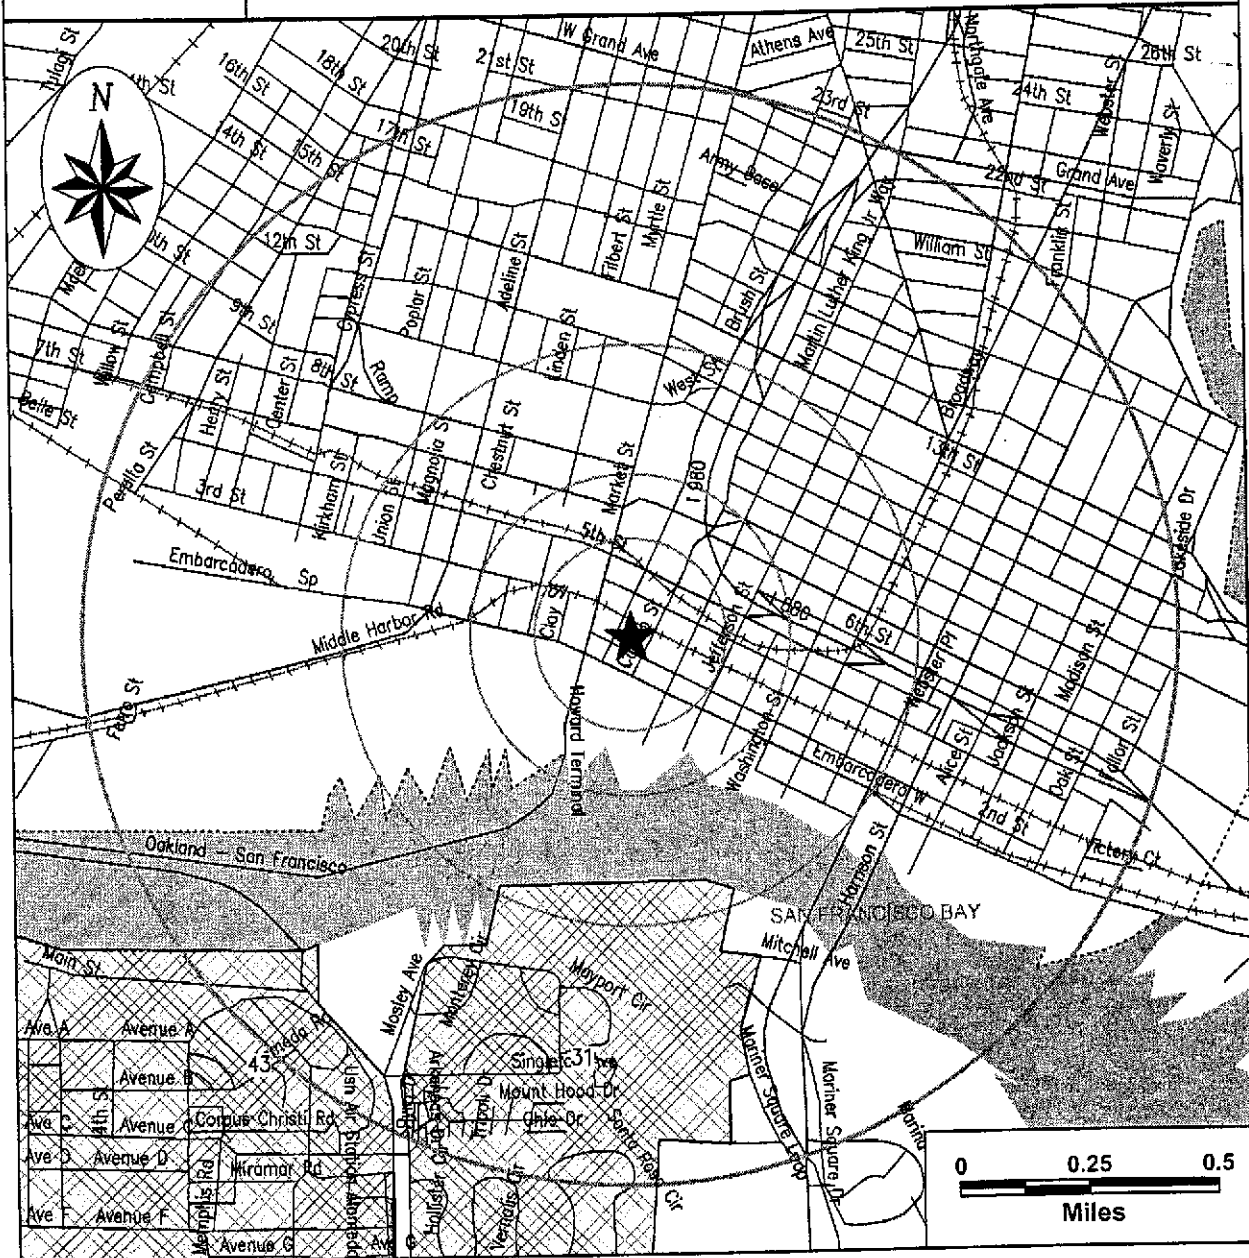


These boundaries are approximated from agency records or other sources such as published maps. They may represent property boundaries, impact zones, or study areas. For more information contact the agency referenced by source number in the site listing.



Subject Site




Highways and Major Roads  
Roads  
Railroads  
Rivers or Water Bodies  
Utilities



# SITE ASSESSMENT PLUS REPORT


## Sites Represented as Radius Buffers

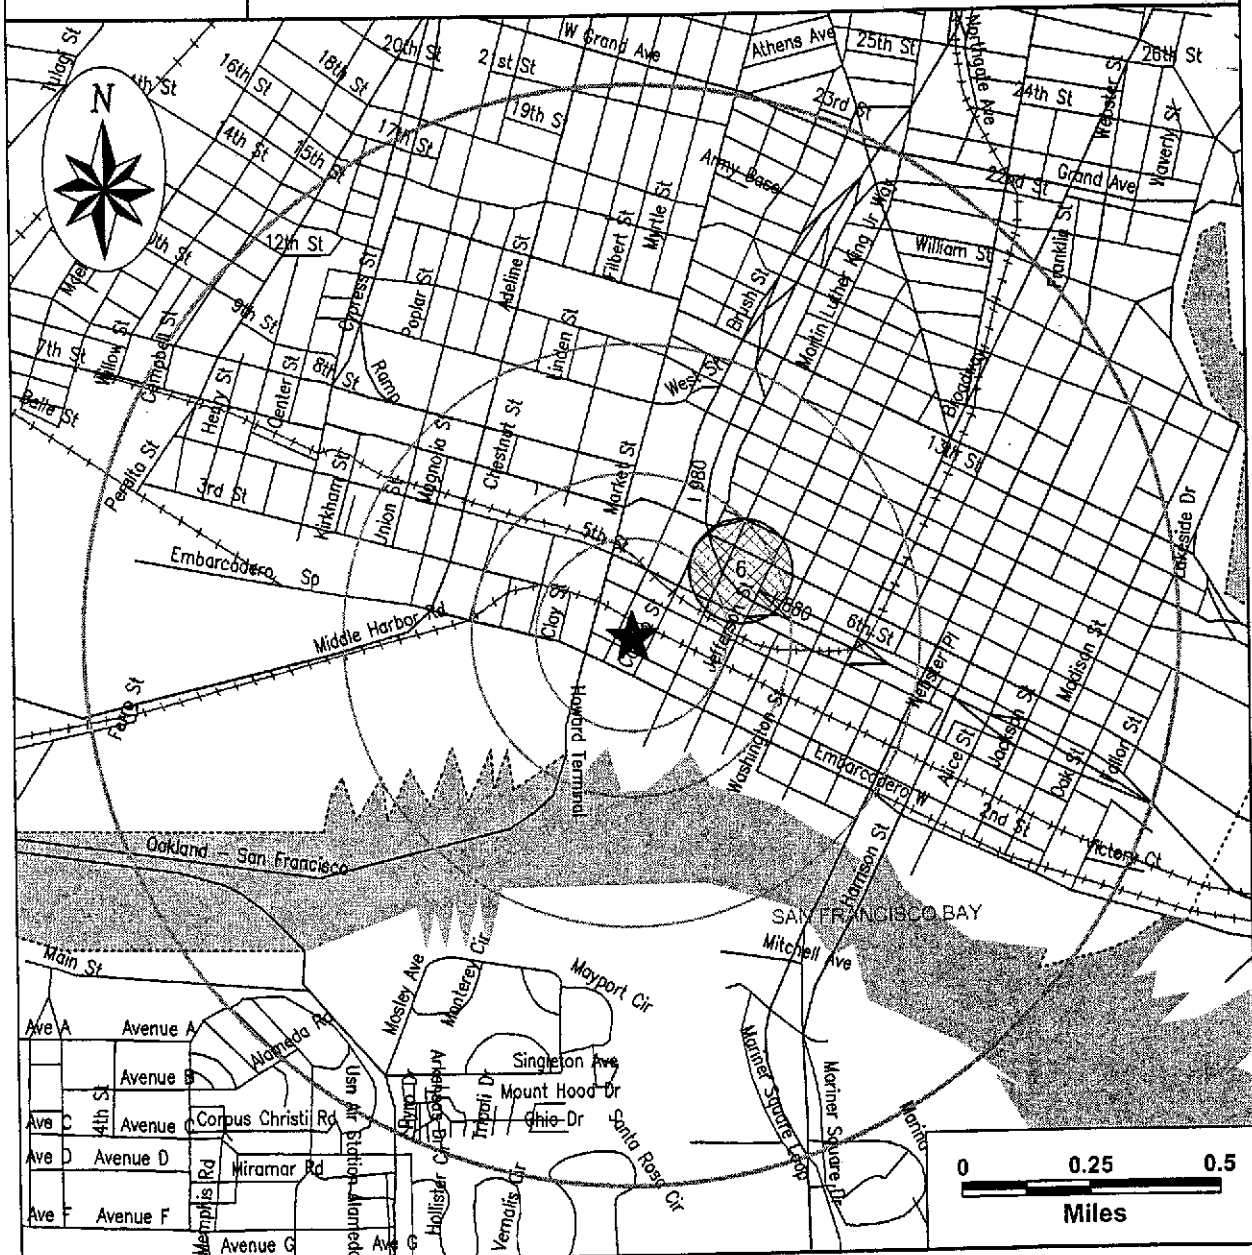


These radii are estimated from agency records or detailed street maps. The radii may be based on the furthest boundary of each property or study area from its center. For more information contact the agency referenced by source number in the site listing.



Subject Site




Highways and Major Roads  
 Roads  
 Railroads  
 Rivers or Water Bodies  
 Utilities



# SITE ASSESSMENT PLUS REPORT

## Street Map

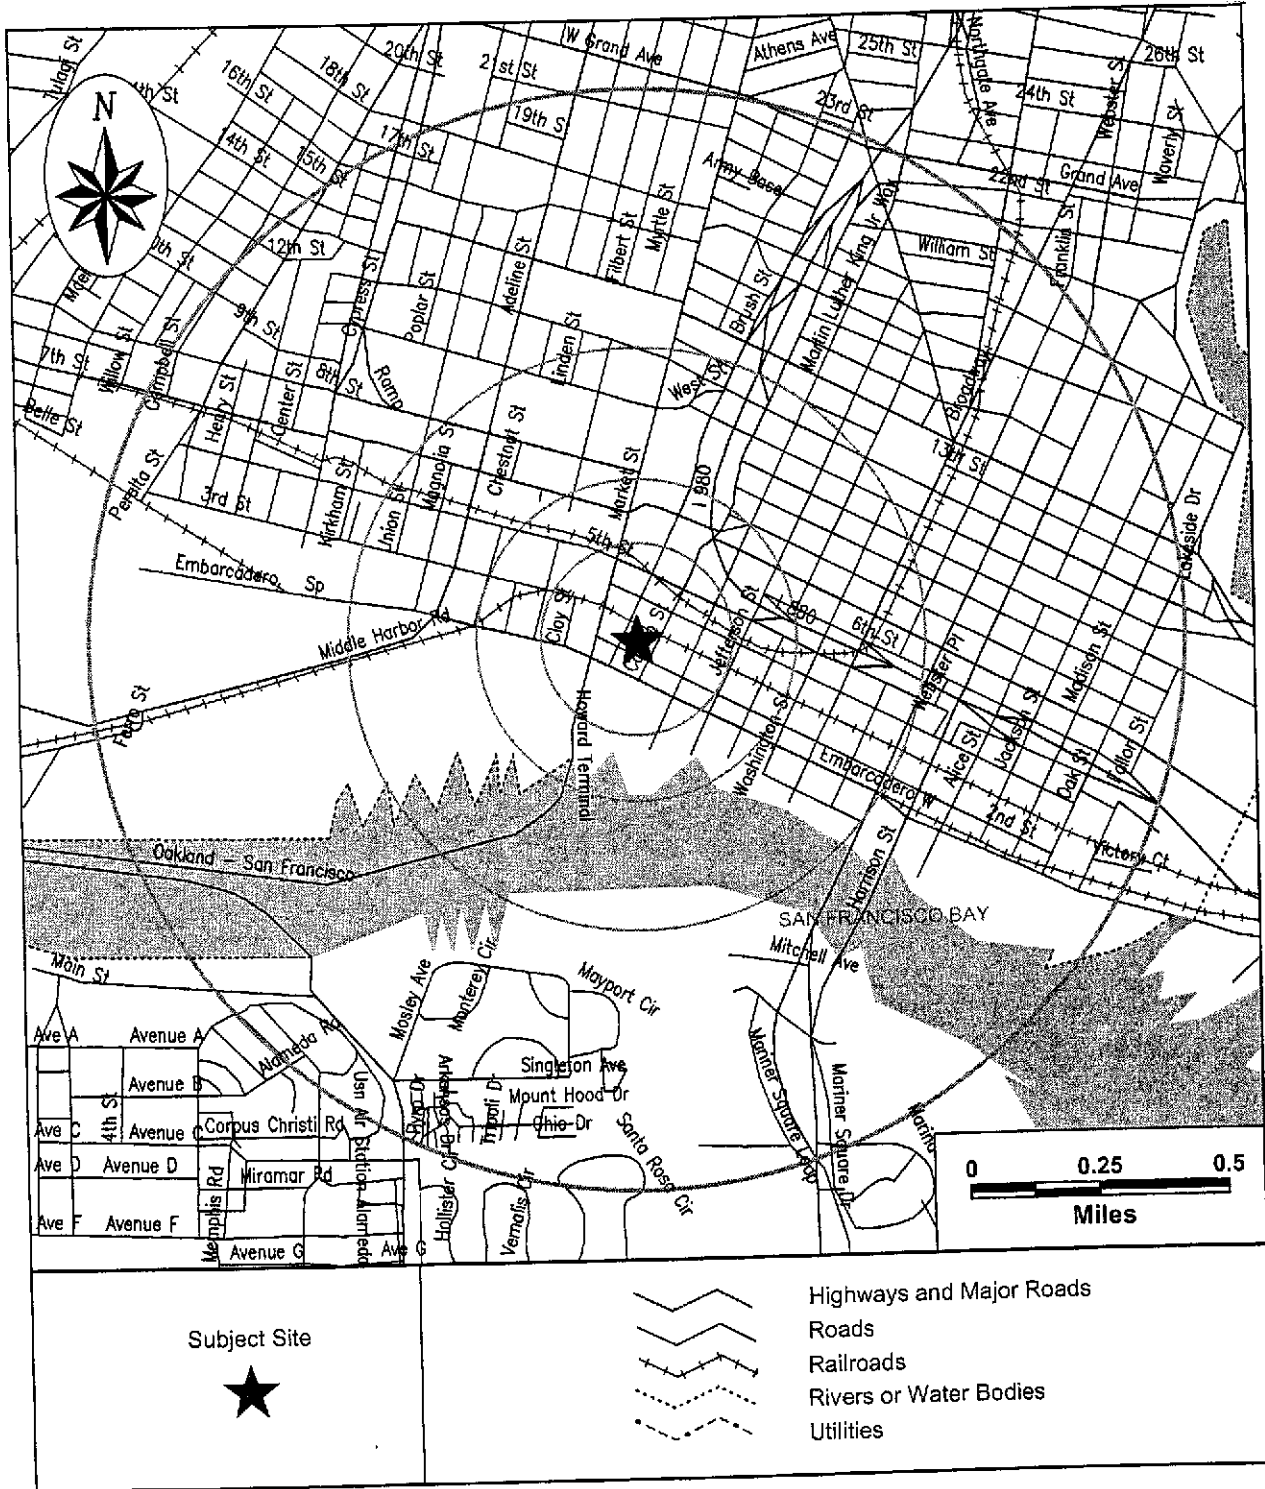




# SITE ASSESSMENT PLUS REPORT

## SITE INVENTORY

MAP ID	PROPERTY AND THE ADJACENT AREA (within 1/8 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D				
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
1A	COST PLUS 303 CASTRO ST OAKLAND, CA 94607	8575247 0.00 MI NA																X		
1B	UNKNOWN 680 2ND ST OAKLAND, CA 94607	8568257 0.01 MI SE																		X
2A	HARBOR FACILITIES GARAGE (BLDG) 205 BRUSH OAKLAND, CA 94607	1252824 0.00 MI NA																X		
2B	MOALS BODY SHOP INC 937 E. 2TH ST OAKLAND, CA 94606	278673 0.05 MI W																		X
3A	E-D COAT INC. 715 4TH ST. OAKLAND, CA 94607	134414 0.01 MI NE														X	X			X
3B	GUARANTEE FORK LIFT INC 699 4TH OAKLAND, CA 94607	1268747 0.03 MI E						X										X		X
3B	GUARANTEE FORKLIFT 699 4TH OAKLAND, CA 94607	7430778 0.03 MI E										X								
4A	SAFETY-KLEEN CORP. 7-178-01 404 MARKET OAKLAND, CA 94607	365214 0.02 MI NW	X					X		X					X		X	X	X	X
4B	MARINE TERMINALS CORP 333 MARKET OAKLAND, CA 94607	930203 0.04 MI NW						X				X						X		
4B	KELLY'S TRUCK REPAIR 425 MARKET ST OAKLAND, CA 94607	3767648 0.04 MI NW																		X
4C	BAY AREA KENWORTH 425 MARKET ST SW SIDE OAKLAND, CA 94607	4866681 0.07 MI NW																		X
5A	MOBIL 5425 GROVE ST OAKLAND, CA 94609	5354893 0.08 MI E						X												
5B	PG E POWER PLANT 510 MARTIN LUTHER KING OAKLAND, CA	3079437 0.11 MI E											X							



X = search criteria; \* = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #8

MAP ID	PROPERTY AND THE ADJACENT AREA (within 1/8 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D					
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
6	CALTRANS 6TH GROVE JEFFERSON OAKLAND, CA 94607	6674488 0.08 MI NA											X								
7	MARKET STREET SHELL 610 MARKET ST OAKLAND, CA 94607	7006074 0.11 MI N																	X		
7	STEGMAN INC. MARKET STREET SHE 610 MARKET OAKLAND, CA 94607	1228603 0.11 MI N																	X		
8	OAKLAND POWER PLANT 50 GROVE OAKLAND, CA 94612	4012805 0.11 MI S																	X		
8	PG AND E OAKLAND 50 GROVE ST OAKLAND, CA 94607	1593748 0.11 MI S																		X	
8	OAKLAND POWER PLANT 50 GROVE ST OAKLAND, CA 94612	1219556 0.11 MI S																	X		
8	OAKLAND POWER PLANT 50 MARTIN LUTHER KING OAKLAND, CA 94607	3767689 0.11 MI S												X							
9A	PGE - OAKLAND 50 MARKET BETWEEN 1ST AND GROVE ST OAKLAND, CA 94607	327833 0.12 MI SW				X			X												X

MAP ID	SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D					
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
9B	HOWARD TERMINAL ONE MARKET ST. OAKLAND, CA 94607	8585950 0.15 MI SW																	X		
9B	STEVEDORING SERVICES OF AMERICA 1 MARKET ST OAKLAND, CA 94607	399703 0.15 MI SW																	X		
9B	STEVEDORING SVCS.HOWARD TERMINAL 1 MARKET ST OAKLAND, CA 94607	006072 0.15 MI SW																	X		
9B	HOWARD TERMINAL 1 MARKET OAKLAND, CA 94607	4034408 0.15 MI SW																	X		



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #9

MAP ID	SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)	VISTA ID DISTANCE DIRECTION	A			B								C			D			
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
10	DEL MONTE CORP, PLANT #550 122 FILBERT OAKLAND, CA 94607	1215691 0.13 MI W																X		
11	PGE 50 MARTIN LEUTHER KING OAKLAND, CA 94607	2141397 0.15 MI NE						X										X	•	•
11	GROVE AUTO REPAIR 424 MARTIN LUTHER KING OAKLAND, CA 94607	11499054 0.15 MI NE						X												
12A	EAST BAY FORD TRUCK SALES 333 FILBERT OAKLAND, CA 94607	131764 0.15 MI NW						X										X	•	
12B	EAST BAY TIRE CO. 225 3RD ST OAKLAND, CA 94607	1223509 0.16 MI W						X										X		
12B	EAST BAY TIRE CO. 225 3RD OAKLAND, CA 94607	7430624 0.16 MI W											X							
12C	JOHNSTON SONS 801 3RD AVE OAKLAND, CA 94607	930123 0.18 MI W						X												
12D	PE O'HAIR COMPANY 339 3RD OAKLAND, CA 94607	7430626 0.22 MI W											X							
12D	PE O'HAIR COMPANY 339 3RD ST OAKLAND, CA 94607	3781172 0.22 MI W						X												
13	BRAMELEA PACIFIC 13TH JEFFERSON ST OAKLAND, CA	1585619 0.17 MI SE											X							
13	CITY OF OAKLAND PARKING S 7TH JEFFERSON ST OAKLAND, CA	7432845 0.17 MI SE											X							
13	PGE GAS PLANT OAKLAND 601 2 1ST BET JEFFERSON MARKET OAKLAND, CA 94607	327867 0.17 MI SE					X													
14A	FRANCIS PLATING, INC. 785 7TH ST OAKLAND, CA 94607	158459 0.19 MI NE		X			X									X			•	•
14B	7TH ST. BRUSH ST. 7TH - BRUSH ST. OAKLAND, CA	1591718 0.19 MI NE										X								
14B	GREYHOUND LINE INC 0 7TH BRUSH OAKLAND, CA 94067	12714033 0.19 MI NE						X												



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #10

MAP ID	SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)	VISTA ID DISTANCE DIRECTION	A			B								C			D			
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
15	ALLIED FOOD SALES 301 CLAY ST OAKLAND, CA 94607	8574108 0.19 MI E																X		
15	ALLIED FOOD SALES 333 CLAY ST OAKLAND, CA 94607	11498632 0.19 MI E						X												
15	ALLIED POULTRY CO. INC. 333 CLAY ST OAKLAND, CA 94607	8574109 0.19 MI E																X		
16A	PORT OF OAKLAND/CINEMA PROJECT CLAY EMBARCADERO OAKLAND, CA 94607	6531981 0.20 MI SE				X														
16A	OAKLAND FIRE STATION #02 100 CLAY ST OAKLAND, CA 94607	7005450 0.21 MI SE																X		
16B	CITY OF OAKLAND #2 ENGINE FIRE CLAY STREET OAKLAND, CA 94607	1254243 0.22 MI SE																X		
17	LAKE MERRITT PUMP STATION 7TH ST AT E 8TH ST E 8TH ST OAKLAND, CA 94606	4043650 0.20 MI NE																X		
18	MICRONESIAN CARGO INTERNATIONAL 955 7TH ST OAKLAND, CA 94607	2006063 0.21 MI N				X														
18	GEORGE GONG PROPERTY 955 7TH ST OAKLAND, CA 94607	8569109 0.21 MI N																X		
19A	OAKLAND POLICE STATION 0 CLAY ST 5TH ST OAKLAND, CA 94607	7430786 0.22 MI E						X												
20A	UNION MACHINE WORKS 534 2ND ST OAKLAND, CA 94607	1591483 0.23 MI SE						X										X		
21A	ARATEX SERVICES 330 CHESTNUT OAKLAND, CA 94607	24870 0.25 MI W						X				X						X		•
21B	LEHAR SALES 150 CHESTNUT OAKLAND, CA 94607	3781249 0.25 MI W						X				X								
22A	OAKLAND CITY OF PARKING STRUCT 0 7TH JEFFERSON ST OAKLAND, CA 94607	7851357 0.25 MI E						X												



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #11

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	A				B							C			D						
		VISTA ID DISTANCE DIRECTION	NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR	
19	ALAMEDA CTY HEALTH HEADQUARTERS 499 5TH ST OAKLAND, CA 94607	293170 0.30 MI E						X														
20	PORT OF OAKLAND LOT 12 475 2ND ST OAKLAND, CA 94607	6531853 0.31 MI SE						X														
22	BART CORPORATION YARD 540 7TH ST E OAKLAND, CA 94607	12666823 0.31 MI E						X														
23	CHANG'S AUTOMOTIVE 1009 7TH ST OAKLAND, CA 94607	5006064 0.25 MI NW				X																
23	VEND MART PROPERTY 1035 7TH ST OAKLAND, CA 94607	12639370 0.26 MI NW						X														
23	MARBLE TECHNICS WEST 1035 7TH ST OAKLAND, CA 94607	5006065 0.26 MI NW				X																
23	VEND MART PROPERTY 1035 7TH ST OAKLAND, CA 94607	4222317 0.26 MI NW						X														
23	VEND MART PROPERTY 1035 7TH OAKLAND, CA 94607	7430948 0.26 MI NW											X									
24	RINO PACIFIC OAKLAND TRUCKSTOP 1107 5TH ST OAKLAND, CA 94607	1498426 0.29 MI NW						X														
24	CALTRANS CYPRESS PROJECT 0 5TH ADELIN OAKLAND, CA 94607	12639400 0.35 MI NW						X														
25	PGE GAS PLANT OAKLAND 601 2A FIRST WASHINGTON OAKLAND, CA 94607	327866 0.29 MI SE				X																
25	KTVU 2 JACK LONDON SQUARE OAKLAND, CA 94607	233437 0.30 MI SE						X														
26	HOUSEWIVES MARKET 818 JEFFERSON ST OAKLAND, CA 94607	13567854 0.30 MI NE						X														
26	HOUSEWIVES MARKET 818 JEFFERSON ST OAKLAND, CA 94607	10829101 0.30 MI NE						X														
26	DOULGAS N SALTER 901 09 JEFFERSON ST OAKLAND, CA 94607	11498920 0.31 MI NE						X														



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #12

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	VISTA ID DISTANCE DIRECTION	A			B								C			D			
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
26	BRAMALEA USA INC 901 999 JEFFERSON OAKLAND, CA 94607	2745770 0.34 MI NE											X							
27	SCHNITZER STEEL PRODUCTS CO. FOOT OF ADELIN ST OAKLAND, CA 94607	1225078 0.32 MI W									X							•		
27	NORCAL METAL FABRICATORS 114 ADELIN ST OAKLAND, CA	5351058 0.32 MI W						X												
27	SCHNITZER STEEL PRODUCTS CO 1101 W. EMBARCADERO OAKLAND, CA 94607	4924144 0.33 MI W						X										•		
28	EXPRESS AUTO SERVICE 333 BROADWAY OAKLAND, CA 94607	8572089 0.34 MI E						X										•		
29	KAISER HOSPITAL 38TH BROADWAY OAKLAND, CA	6531908 0.36 MI SE						X												
29	KAISER HOSPITAL 38TH BROADWAY OAKLAND, CA 94607	3795594 0.36 MI SE								X										
29	EMPORIUM-CAPWELL 20TH AND BROADWAY OAKLAND, CA 94612	1257773 0.36 MI SE						X										•		
29	LIVERMORE CITY OF 1767 PORTOLA AVE OAKLAND, CA 94607	6531852 0.37 MI SE						X												
30	SHELL 461 8TH ST OAKLAND, CA 94607	1176601 0.41 MI E						X												
30	SHELL 461 8TH ST OAKLAND, CA 94607	12639379 0.41 MI E						X												
30	SHELL 461 8TH OAKLAND, CA 94607	7431026 0.41 MI E											X							
31	NAVAL SUPPLY CENTER, ALAMEDA* W. END CITY OF ALAMEDA AN ALAMEDA, CA 94501	3155019 0.42 MI					X													
32	CONDOR FREIGHT LINES 324 UNION OAKLAND, CA 94607	7429134 0.43 MI W											X							
32	CONDON FREIGHT 324 UNION ST OAKLAND, CA 94607	97772 0.43 MI W				X		X										•		



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #13

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D				
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL.	TRIS	UST/AST	ERNS
33	EVERIDGE SERVICE CO 1211 7TH OAKLAND, CA 94607	1238358 0.45 MI NW						X												
33	EVERIDGE SERVICE COMPANY 1211 7TH ST OAKLAND, CA 94607	13567642 0.45 MI NW						X												
33	WESTERN PACIFIC RAILROAD UNION ST OAKLAND, CA 94607	5286414 0.46 MI NW				X														
33	ALL MERCEDES DISMANTLERS 1225 7TH OAKLAND, CA 94607	7430952 0.46 MI NW											X							
33	ALL MERCEDES DISMANTLERS INC 1255 7TH ST OAKLAND, CA 94607	11498440 0.50 MI NW						X												
34	OAKLAND OEDE CITY OF 12TH ST MARTIN LUTHER KING JR WY OAKLAND, CA	13581220 0.46 MI NE						X												
34	CITY CENTER GARAGE WEST SITE 12TH ST JEFFERSON ST OAKLAND, CA	4558440 0.48 MI NE						X												
35	CAPITOL SUPPLY COMPANY 351 EMBARCADERO OAKLAND, CA 94606	1154977 0.47 MI SE				X														
35	PORT OF OAKLAND EMBARCADERO CV MARINA SITE OAKLAND, CA 94606	335893 0.47 MI SE					X	X												
36	PROJECT REPORT 1155 CLAY ST OAKLAND, CA 94607	6531941 0.48 MI NE						X												
37	FIVE CITY CENTER 1300 CLAY OAKLAND, CA 94607	1176262 0.49 MI W						X					X							
38	CITY'S AUTO REPAIR 330 WEBSTER ST OAKLAND, CA 94607	930249 0.49 MI E						X												
39	SAFETY KLEEN 1147 10TH OAKLAND, CA 94607	7430041 0.49 MI NW											X							
40	ALEX SHAW ASSOCIATES 800 FRANKLIN OAKLAND, CA 94607	1142008 0.49 MI E											X							
40	BILL LOUIE'S AUTO SERVICE 800 FRANKLIN ST OAKLAND, CA 94607	11498791 0.49 MI E						X												



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #14

MAP ID	SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile)	A				B							C			D						
		VISTA ID DISTANCE DIRECTION	NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORIESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR	
41	SF BAY AREA RAPID TRANSIT DISTRICT 349 MANDELA PARKWAY OAKLAND, CA 94607	7205875 0.71 MI NW			X																	
42	FLEET INDUSTRIAL SUPPLY CENTER, ALAMEDA 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501	305050 0.74 MI SE		X		•										•						•
42	FLEET INDUSTRIAL SUPPLY C 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501	5286407 0.74 MI SE			X								•									
43	ALAMEDA NAVAL AIR STA W END CITY OF ALAMEDA ALAMEDA, CA 94501	10281 0.79 MI	X			•																
43	ALAMEDA NAVAL AIR STATION 2,616 ACRES IN ALAMEDA, CALIFORNIA ALAMEDA, CA 94501	7005255 0.79 MI			X																	
43	USNAVY ALAMEDA NAVAL SUPPLY CENTER ANNEX W. END CITY OF ALAMEDA AN ALAMEDA, CA 94501	7001878 0.79 MI		X												•						•
43	FLEET INDUSTRIAL SUPPLY CENTER, OAKLAND 541 ACRES EASTERN SHORE OF THE SF ALAMEDA, CA 94501	7005281 0.79 MI			X																	



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #15



UNMAPPED SITES	A				B							C			D				
	NPL	CORRACTS	SPL	SCL	CERCUS/NFRAP	TSD	IUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
CRYER BOAT YARD PORT OF OAKLAND FORMER 1899 DNNISON ST OAKLAND, CA 94607							X												
CALTRANS 0 6TH CASTRO ST OAKLAND, CA 94607							X												
OAKLAND INT'L AIRPORT 530 WATER ST OAKLAND, CA 94607							X												
PORT OF OAKLAND 530 WATER ST OAKLAND, CA 94607								X											
OAKLAND CITY OF REDEV GALLERIA 0 BROADWAY SAN PABLO OAKLAND, CA 94612							X												
EASTSHORE LINES INC 2400 ADELIN ST OAKLAND, CA 94607							X												
PORT OF OAKLAND MID HARBOR RD EXPANSION MIDDLE HARBOR RD OAKLAND, CA 94607							X												
VALLEY TIRE 8029 ATLANTIC ALAMEDA, CA 94501												X							
1X DELTA HS NETHERLANDS RD SCHOOL ST OAKLAND, CA 94612							X												
MACAULAY FOUNDRY INC 811 CARELTON ST OAKLAND, CA 94607							X												
OLD OAKLAND TRIBUNE GARAG VALDEZ 13TH OAKLAND, CA 94612												X							
MARINE TERMINALS CORPORATION 5190 007TH OAKLAND, CA 94607																	X		
CALTRANS RECONSTRUCTION PROJECT 1880 CYPRESS OAKLAND, CA 94607							X												
ASHLAND OIL 0 FERRY PETROLEUM OAKLAND, CA 94607							X												
CYPRESS FREEWAY-3RD STREET SOUNDWALL 2RD STREET BETWEEN CENTER AND PERALT OAKLAND, CA 94607					X														



X = search criteria; \* = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 882501901

Version 2.6.1

Date of Report: January 25, 2000

Page #16

UNMAPPED SITES	VISTA ID	A			B								C			D				
		NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
SF OAKLAND BAY BRIDGE 0 BAY BRIDGE TOLL PLAZ OAKLAND, CA 94607	7850401						X													
MANDELA PARKWAY CORRIDOR MANDELA PARKWAY BETWEEN 34TH AND 8TH OAKLAND, CA 94607	7430994				X															
OAKLAND NATIONAL ENGRAVES 41ST AVE ADELIN ST OAKLAND, CA 94607	6531878						X													
SO. PRESCOTT NEIGHBORHOOD PARK 3RD ST OAKLAND, CA 94607	6531860				X															
VANCANT LOT 11TH ST OAKLAND, CA 94607	5350097						X					X								
PORT OF OAKLAND REDEVELOPMENT PROJECT BERTHS 30 31 OAKLAND, CA 94607	291571						X													
OAKLAND ARMY BASE BLDG 807 OAKLAND, CA 94607	6531771						X													
CFS CORPORATION 5110 007TH OAKLAND, CA 94607	4015449																X			
ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA 94501	12713937						X													
NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA 94501	12713938						X													
EAST BAY SERVICE ROAD TENT SFO BRDG E. BAY TOLL PLZA OAKLAND, CA 94607	8572028																	X		
RAILROAD RIGHT-OF-WAY WOOD ST FOOT OF SOUTH OAKLAND, CA 94607	8598807																	X		
ALAMEDA NAS NAVY ALAMEDA, CA	13580452						X													
CALTRANS WOOD ST 34TH ST OAKLAND, CA 94607	8568702																		X	
FLEET INDUSTRIAL SUPPLY CNTR 7TH MARITIME ST OAKLAND, CA 94625	7006090																		X	
GALLAGHER BURKE INC 7100 BOUNTAIN BLVD OAKLAND, CA 94623	247661						X													



X = search criteria; \* = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1


Page #17

UNMAPPED SITES	VISTA ID	A			B								C		D					
		NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
NAVAL SUPPLY CENTER ALAMEDA ANNEX 28 ALAMEDA, CA	659828						X													
NAS ALAMEDA B 117 AVE G ALAMEDA, CA 94501	7432471											X								
SPT CO LOCO FUEL PLANT WD01 04 0 PINE ST FOOT OF OAKLAND, CA 94607	12640017						X													
HARBOR TRANSPORTATION CENTER 250 EXECUTIVE WAY OAKLAND, CA 94625	12361902																	X		
PORT OF OAKLAND HANGER 6 11007 AIRPORT OAKLAND, CA 94614	7431274											X								
FLEET INDUSTRIAL SUPPLY C 541 ACRES EASTERN SHORE OF TH OAKLAND, CA 94625	7431148											X								
SF-OAK BAY BRIDGE CALTRANS BAY BRIDGE TOLL PLAZA OAKLAND, CA 94623	8573092																	X		
NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA	12666650						X													
NAVY TRANSPORTATION MAINT/SHOP NAVAL SUPPLY CENTER OAKLAND, CA 94623	8587613																	X		
ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA	12666629						X													
ROADWAY EXPRESS, INC 1125 27TH AVE OAKLAND, CA	7291475						X													
ALAMEDA (DISTRICT 7) ALAMEDA, CA	6612672																	X		
OAKLAND ARMY BASE BLDG 812-828-5-POVTAL OAKLAND, CA 94623	8566540																	X		
ANDRADE WAREHOUSE 2914 7TH ST OAKLAND, CA 94607	1244551																	X		
GENERAL ELECTRIC COMPANY 100 WOODLAWN AVENUE OAKLAND, CA	4826802								X											
ROUND TOP RADIO (CAO480) 5.3 MILES NE OAKLAND CIVIC CEN OAKLAND, CA	6613560																	X		



**X = search criteria; \* = tag-along (beyond search criteria).**  
 For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.  
 Report ID: **882501901** Date of Report: **January 25, 2000**  
 Version 2.6.1 Page #18

UNMAPPED SITES	VISTA ID	A				B								C			D		
		NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
OAKLAND FUEL FACILITIES CORP. TANK FARM S - S. FIELD OAKLAND, CA	4924439																X		
OAKLAND ARMY BASE (FORMERLY ASI LEA OAKLAND, CA 94626	4823458									X									
UPTOWN THEATER DISTRICT OAKLAND, CA	13581007						X												
HAYWARD LIMITED 30104 INDUSTRIAL PKWY SW HAYWARD, CA	7291068						X												
OH OLSEN 2220 4TH ST BERKELEY, CA	7291419						X												
OAKLAND INTERNATIONAL AIRPORT OAKLAND INTERNATIONAL AIRPORT OAKLAND, CA	7291755						X												
YERBA BUENA PROJECT OAKLAND, CA	13581050						X												
CROWLEY MARITIME CORPORATION PACIFIC DRY DOCK AND REPAIR YD OAKLAND, CA	4570533									X									
OAKLAND ARMY BASE (FORMERLY ASI LEA OAKLAND, CA	4570445									X									
7 0 L 827 TRACON OAKLAND, CA	12667122						X												
PORT OAKLAND: OAKLAND AIRPORT HANGER #6 OAKLAND, CA	1593878									X									
PORT OF OAKLAND LANA KAI MARINA OAKLAND, CA	1594330									X									
PORT OF OAKLAND - KING INTERESTS SI OAKLAND AIRPORT OAKLAND, CA	1595209									X									
EAST BAY REGIONAL PARK DISTRICT 0 TILDEN PARK OAKLAND, CA	12667445						X												
S SPILL-SCHNITZER STEEL PRODUCT CO. FOOT OF ADELIN ST. OAKLAND, CA	3593659									X									
UNION POINT WATERFRONT PARK 2301 EMBARCADERO OAKLAND, CA	12714405						X												
EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA	12666907						X												



X = search criteria; \* = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #19

# SITE ASSESSMENT PLUS REPORT

## DETAILS

### PROPERTY AND THE ADJACENT AREA (within 1/8 mile)

VISTA Address*:	<b>COST PLUS</b> <b>303 CASTRO ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	8575247
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point
STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		NOT REPORTED	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	
Tank ID:	000001	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

Map ID

**1A**

VISTA Address*:	<b>UNKNOWN</b> <b>680 2ND ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	8568257	
		Distance/Direction:	0.01 MI / SE	
		Plotted as:	Point	
ERNS - Emergency Response Notification System / SRC# 6181		Agency ID:	92-4027	
Agency Address:		SAME AS ABOVE		
Spill Date Time:		MAY 7, 1992 UNKNOWN		
Case Number:		92-4027		
Spill Location:		680 2ND ST		
Source Agency:		E		
Discharger Org:		UNKNOWN		
Material Spilled:		UNKNOWN (GRAY/BLACK SUBSTANCE), 200.00 (LBS)		
Fields Not Reported:		Discharger Name, Discharger Phone, Waterway Affected		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release:	Other Release:
YES	NO	NO	NO	NO

Map ID

**1B**

VISTA Address*:	<b>HARBOR FACILITIES GARAGE (BLDG)</b> <b>205 BRUSH</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	1252824
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point
STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		3	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	

Map ID

**2A**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #20

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Tank ID:	58297.01	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	1000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	58297.01	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	2000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	58297.01	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	8000 (GALLONS)	Tank Material:	UNKNOWN

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	HARBOR FACILITIES GARAGE E412 209 BRUSH ST OAKLAND, CA 94607		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

Tank ID:	58297.01	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE


<b>STATE UST - State Underground Storage Tank / SRC# 6249</b>		EPA/Agency ID:	N/A
Agency Address:	HARBOR FACILITIES GARAGE E412 209 BRUSH ST OAKLAND, CA 94607		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

Tank ID:	58297.01	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	<b>MOALS BODY SHOP INC</b> <b>937 E. 2TH ST</b> <b>OAKLAND, CA 94606</b>	VISTA ID#:	278673
		Distance/Direction:	0.05 MI / W
		Plotted as:	Point

Map ID  
**2B**

<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>		EPA ID:	CAD076560507
Agency Address:	MOALS BODY SHOP INC 937 E 2TH STREET OAKLAND, CA 94606		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		



**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

VISTA Address*:	<b>E-D COAT INC. 715 4TH ST. OAKLAND, CA 94607</b>	VISTA ID#:	134414
		Distance/Direction:	0.01 MI / NE
		Plotted as:	Point

Map ID  
**3A**

<b>TRIS - Toxic Release Inventory System / SRC# 4946</b>	EPA ID:	CAD009200031
Agency Address: <i>SAME AS ABOVE</i>		
<b>Chemical Abstract Service Registry:</b>	<b>Quantity Released:</b>	
<i>"NOT REPORTED"</i>	<i>250.00 (POUNDS)</i>	
<i>NITRIC ACID</i>	<i>10.00 (POUNDS)</i>	
<i>CHLORINE</i>	<i>NOT REPORTED (POUNDS)</i>	

<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>	EPA ID:	CAD009200031
Agency Address: <i>E-D COAT INC 715-21 FOURTH ST OAKLAND, CA 94607</i>		
Generator Class:	<i>Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste</i>	

<b>RCRA-Violations / SRC# 6379</b>	EPA ID:	CAD009200031
Agency Address: <i>E-D COAT INC 715-21 FOURTH ST OAKLAND, CA 94607</i>		
Violation Type:	<i>GENERATOR-OTHER REQUIREMENTS</i>	
Violation Date:	<i>FEBRUARY 8, 1985</i>	
Violation Class:	<i>2</i>	
Actual Compliance Date:	<i>FEBRUARY 8, 1985</i>	
Scheduled Compliance Date:	<i>NOT REPORTED</i>	

VISTA Address*:	<b>GUARANTEE FORK LIFT INC 699 4TH OAKLAND, CA 94607</b>	VISTA ID#:	1268747
		Distance/Direction:	0.03 MI / E
		Plotted as:	Point

Map ID  
**3B**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>	EPA/Agency ID:	N/A
Agency Address: <i>SAME AS ABOVE</i>		
Underground Tanks:	<i>1</i>	
Aboveground Tanks:	<i>NOT REPORTED</i>	
Tanks Removed:	<i>NOT REPORTED</i>	
Tank ID: <i>T001U</i>	Tank Status:	<i>CLOSED REMOVED</i>
Tank Contents: <i>UNLEADED GAS</i>	Leak Monitoring:	<i>Agency Code (')</i>
Tank Age: <i>NOT REPORTED</i>	Tank Piping:	<i>UNKNOWN</i>
Tank Size (Units): <i>550 (GALLONS)</i>	Tank Material:	<i>UNKNOWN</i>

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>	EPA/Agency ID:	N/A
Agency Address: <i>GUARANTEE FORKLIFT, INC. 699 4TH ST OAKLAND, CA 94607</i>		
Underground Tanks:	<i>NOT REPORTED</i>	
Aboveground Tanks:	<i>NOT REPORTED</i>	
Tanks Removed:	<i>NOT REPORTED</i>	
Tank ID: <i>T001U</i>	Tank Status:	<i>REMOVED</i>
Tank Contents: <i>NOT AVAILABLE</i>	Leak Monitoring:	<i>NOT AVAILABLE</i>
Tank Age: <i>NOT REPORTED</i>	Tank Piping:	<i>NOT AVAILABLE</i>
Tank Size (Units): <i>NOT REPORTED (NOT AVAILABLE)</i>	Tank Material:	<i>NOT AVAILABLE</i>



**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>	<b>EPA ID:</b>	<b>CAD982486706</b>
--	----------------	---------------------

<b>Agency Address:</b>	GUARANTEE FORKLIFT INC 699 4TH ST OAKLAND, CA 94607
<b>Generator Class:</b>	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	<b>EPA/Agency ID:</b>	<b>N/A</b>
--	-----------------------	------------

<b>Agency Address:</b>	GUARANTEE FORKLIFT INC 699 4TH ST OAKLAND, CA
<b>Facility ID:</b>	01-0730
<b>Leak Report Date:</b>	3/20/91
<b>Leak Cause:</b>	STRUCTURE FAILURE
<b>Leak Source:</b>	TANK
<b>Substance:</b>	GASOLINE
<b>Remediation Event:</b>	NO ACTION TAKEN
<b>Remediation Event:</b>	STOP DATE: 3/22/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
<b>Remediation Status:</b>	PRELIMINARY SITE ASSESSMENT UNDERWAY
<b>Media Affected:</b>	SOIL ONLY
<b>Lead Agency:</b>	LOCAL AGENCY
<b>Region / District:</b>	SAN FRANCISCO BAY RE
<b>Description / Comment:</b>	COUNTY: ALAMEDA X STREET REVIEW DATE: 1/2/98

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	<b>EPA/Agency ID:</b>	<b>N/A</b>
--	-----------------------	------------


<b>Agency Address:</b>	GUARANTEE FORKLIFT INC 699 4TH ST OAKLAND, CA 94607
<b>Facility ID:</b>	01-0730
<b>Leak Report Date:</b>	03/20/91
<b>Substance:</b>	GASOLINE
<b>Remediation Event:</b>	NO ACTION TAKEN
<b>Remediation Status:</b>	PRELIMINARY SITE ASSESSMENT UNDERWAY
<b>Media Affected:</b>	SOIL ONLY
<b>Lead Agency:</b>	LOCAL AGENCY
<b>Region / District:</b>	SAN FRANCISCO BAY RE
<b>Description / Comment:</b>	COUNTY: ALAMEDA X STREET REVIEW DATE:

<b>VISTA Address*:</b>	<b>GUARANTEE FORKLIFT 699 4TH OAKLAND, CA 94607</b>	<b>VISTA ID#:</b>	<b>7430778</b>
		<b>Distance/Direction:</b>	<b>0.03 MI / E</b>
		<b>Plotted as:</b>	<b>Point</b>

Map ID  
**3B**

<b>CORTESE / SRC# 4840</b>	<b>Agency ID:</b>	<b>01-0730</b>
----------------------------	-------------------	----------------

<b>Agency Address:</b>	SAME AS ABOVE
<b>List Name:</b>	LEAKING TANK
<b>Site ID:</b>	01-0730





**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

VISTA Address*:	<b>SAFETY-KLEEN CORP. 7-178-01 404 MARKET OAKLAND, CA 94607</b>	VISTA ID#:	365214
		Distance/Direction:	0.02 MI / NW
		Plotted as:	Point

Map ID

**4A**

**STATE UST - State Underground Storage Tank / SRC# 1612** EPA/Agency ID: N/A

Agency Address: *SAME AS ABOVE*  
 Underground Tanks: 3  
 Aboveground Tanks: *NOT REPORTED*  
 Tanks Removed: *NOT REPORTED*

Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL

Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	6000 (GALLONS)	Tank Material:	BARE STEEL

Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	6000 (GALLONS)	Tank Material:	BARE STEEL

**STATE UST - State Underground Storage Tank / SRC# 5275** EPA/Agency ID: N/A

Agency Address: *SAFETY - KLEEN CORP. 7-178-01  
400 MARKET ST  
OAKLAND, CA 94607*  
 Underground Tanks: 1  
 Aboveground Tanks: *NOT REPORTED*  
 Tanks Removed: *NOT REPORTED*

Tank ID:	T001U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

**ERNS - Emergency Response Notification System / SRC# 6181** Agency ID: 99236

Agency Address: *SAFETY KLEEN CORP  
400 MARKET STREET  
OAKLAND, CA*  
 Spill Date Time: *DECEMBER 11, 1991 08:55:00 AM*  
 Case Number: 99236  
 Spill Location: *400 MARKET STREET*  
 Source Agency: *N*  
 Discharger Name: *HOOPPELL, ED*  
 Discharger Org: *SAFETY KLEEN CORP*  
 Material Spilled: *MINERAL SPIRITS, 18.00 (GAL)*  
 Waterway Affected: *STORM DRAIN*  
 Fields Not Reported: *Discharger Phone*

Air Release:	Land Release:	Water Release:	Ground Release:	Facility Release:	Other Release:
NO	NO	NO	NO	NO	NO



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #24

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

<b>ERNS - Emergency Response Notification System / SRC# 6181</b>		Agency ID:	149437
Agency Address:	SAFETY KLEEN CORP 400 MARKET STREET OAKLAND, CA 94607		
Spill Date Time:	DECEMBER 16, 1992 08:12:00 AM		
Case Number:	149437		
Spill Location:	400 MARKET STREET		
Source Agency:	N		
Discharger Name:	NESS, VICKY		
Discharger Org:	SAFETY KLEEN CORP		
Material Spilled:	MINERAL SPIRITS, 4.00 (GAL)		
Waterway Affected:	STORM DRAIN		
Fields Not Reported:	Discharger Phone		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release: Other Release:
NO	NO	NO	NO NO NO

<b>ERNS - Emergency Response Notification System / SRC# 6181</b>		Agency ID:	93-1075
Agency Address:	SAFETY KLEEN CORP 400 MARKET STREET OAKLAND, CA 94607		
Spill Date Time:	DECEMBER 16, 1992 08:12:00 AM		
Case Number:	93-1075		
Spill Location:	400 MARKET STREET		
Source Agency:	E		
Discharger Name:	NESS, VICKY		
Discharger Org:	SAFETY KLEEN CORP		
Material Spilled:	MINERAL SPIRITS, 4.00 (GAL)		
Waterway Affected:	STORM DRAIN		
Fields Not Reported:	Discharger Phone		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release: Other Release:
NO	NO	NO	NO NO NO

<b>ERNS - Emergency Response Notification System / SRC# 6181</b>		Agency ID:	253743
Agency Address:	SAFETY KLEEN 400 MARKET ST OAKLAND, CA		
Spill Date Time:	AUGUST 3, 1994 11:00:00 PM		
Case Number:	253743		
Spill Location:	400 MARKET ST		
Source Agency:	N		
Discharger Name:	JENSEN, GREG		
Discharger Org:	SAFETY KLEEN		
Material Spilled:	NOS CLASS 9 HAZARDOUS LIQUID, 4.00 (GAL)		
Waterway Affected:	CONCRETE		
Fields Not Reported:	Discharger Phone		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release: Other Release:
NO	NO	NO	NO NO NO



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #25

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

<b>ERNS - Emergency Response Notification System / SRC# 6181</b>		Agency ID:	94-5297
Agency Address:	SAFETY KLEEN 400 MARKET ST OAKLAND, CA 94607		
Spill Date Time:	AUGUST 3, 1994 11:00:00 PM		
Case Number:	94-5297		
Spill Location:	400 MARKET ST		
Source Agency:	E		
Discharger Name:	JENSEN, GREG		
Discharger Org:	SAFETY KLEEN		
Material Spilled:	NOS CLASS 9 HAZARDOUS LIQUID, 4.00 (GAL)		
Fields Not Reported:	Discharger Phone, Waterway Affected		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release: Other Release:
NO	NO	NO	NO NO NO
<b>STATE UST - State Underground Storage Tank / SRC# 6249</b>		EPA/Agency ID:	N/A
Agency Address:	SAFETY-KLEEN CORP 7-178-01 400 MARKET ST OAKLAND, CA 94607		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE
<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>		EPA ID:	CAD053044053
Agency Address:	SAFETY KLEEN CORP 7 178 01 404 MARKET ST OAKLAND, CA 94607		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #26

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

<b>CORRACTS / SRC# 6379</b>		EPA ID:	CAD053044053
Agency Address:	SAFETY KLEEN CORP 7 178 01 404 MARKET ST OAKLAND, CA 94607		
Prioritization Status:	LOW		
RCRA Facility Assessment Completed:	NO		
Notice of Contamination:	NO		
Determination of need For a RFI (RCRA Facility Investigation):	NO		
RFI Imposed:	YES		
RFI Workplan Notice of Deficiency Issued:	NO		
RFI Workplan Approved:	YES		
RFI Report Received:	NO		
RFI Approved:	YES		
No Further Corrective Action at this Time:	NO		
Stabilization Mesaures Evaluation:	YES		
CMS (Corrective Measure Study) Imposition:	NO		
CMS Workplan Approved:	NO		
CMS Report Received:	NO		
CMS Approved:	NO		
Date for Remedy Selection (CM Imposed):	NO		
Corrective Measures Design Approved:	NO		
Corrective Measures Investigation Workplan Approved:	NO		
Certification of Remedy Completion:	NO		
Stabilization Measures Implementation:	NO		
Stabilization Measures Completed:	NO		
Corrective Action Process Termination:	NO		
<b>RCRA-Violations / SRC# 6379</b>		EPA ID:	CAD053044053
Agency Address:	SAFETY KLEEN CORP 7 178 01 404 MARKET ST OAKLAND, CA 94607		
Enforcement Number:	198805260		
Enforcement Agency:	State		
Action Date:	MAY 26, 1988		
Action Type:	WRITTEN INFORMAL		
Penalty Assessed:	NOT REPORTED		
Penalty Settlement:	NOT REPORTED		
Enforcement Number:	198811300		
Enforcement Agency:	State		
Action Date:	NOVEMBER 30, 1988		
Action Type:	WRITTEN INFORMAL		
Penalty Assessed:	NOT REPORTED		
Penalty Settlement:	NOT REPORTED		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #27

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Enforcement Number:	198906270
Enforcement Agency:	State
Action Date:	JUNE 27, 1989
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199005100
Enforcement Agency:	State
Action Date:	MAY 10, 1990
Action Type:	JUDICIAL ORDERS
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199008080
Enforcement Agency:	State
Action Date:	AUGUST 8, 1990
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199103200
Enforcement Agency:	State
Action Date:	MARCH 20, 1991
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199104300
Enforcement Agency:	State
Action Date:	APRIL 30, 1991
Action Type:	JUDICIAL ORDERS
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199307190
Enforcement Agency:	State
Action Date:	JULY 19, 1993
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Enforcement Number:	199309130
Enforcement Agency:	State
Action Date:	SEPTEMBER 13, 1993
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #28

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Enforcement Number:	199809160
Enforcement Agency:	State
Action Date:	SEPTEMBER 16, 1998
Action Type:	WRITTEN INFORMAL
Penalty Assessed:	NOT REPORTED
Penalty Settlement:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JULY 14, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JUNE 28, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JUNE 24, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MAY 18, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MAY 12, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	APRIL 26, 1994
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	NOVEMBER 15, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #29

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	SEPTEMBER 16, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	AUGUST 16, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	AUGUST 11, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	AUGUST 2, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JUNE 24, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JUNE 16, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MAY 17, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MAY 11, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MARCH 9, 1993
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #30

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>FEBRUARY 24, 1993</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>NOVEMBER 3, 1992</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>OCTOBER 8, 1992</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>MARCH 27, 1992</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>MARCH 24, 1992</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>MARCH 19, 1992</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>JUNE 19, 1991</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>MARCH 29, 1991</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--OTHER REQUIREMENTS</i>
Violation Date:	<i>MARCH 28, 1991</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>NOT REPORTED</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000


Version 2.6.1

Page #31




**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MARCH 26, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MARCH 21, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MARCH 14, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	FEBRUARY 26, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	FEBRUARY 25, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	FEBRUARY 20, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	FEBRUARY 19, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	FEBRUARY 14, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JANUARY 23, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JANUARY 17, 1991
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	AUGUST 22, 1990
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	MAY 16, 1990
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	TSD--FINANCIAL RESPONSIBILITY REQ.
Violation Date:	SEPTEMBER 26, 1991
Violation Class:	1
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)
Violation Date:	SEPTEMBER 16, 1998
Violation Class:	2
Actual Compliance Date:	NOT REPORTED
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JULY 27, 1993
Violation Class:	2
Actual Compliance Date:	OCTOBER 22, 1993
Scheduled Compliance Date:	DECEMBER 9, 1993
Violation Type:	GENERATOR--OTHER REQUIREMENTS
Violation Date:	JULY 19, 1993
Violation Class:	2
Actual Compliance Date:	JULY 30, 1993
Scheduled Compliance Date:	JULY 31, 1993
Violation Type:	TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)
Violation Date:	OCTOBER 2, 1990
Violation Class:	1
Actual Compliance Date:	JULY 30, 1993
Scheduled Compliance Date:	NOT REPORTED
Violation Type:	TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)
Violation Date:	OCTOBER 2, 1990
Violation Class:	1
Actual Compliance Date:	JULY 30, 1993
Scheduled Compliance Date:	NOT REPORTED



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #33

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Violation Type:	<i>TSD--CLOSURE/POST-CLOSURE REQ.</i>
Violation Date:	<i>OCTOBER 2, 1990</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)</i>
Violation Date:	<i>FEBRUARY 27, 1990</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--FINANCIAL RESPONSIBILITY REQ.</i>
Violation Date:	<i>FEBRUARY 23, 1990</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--LAND BAN REQUIREMENTS</i>
Violation Date:	<i>FEBRUARY 17, 1989</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>SEPTEMBER 26, 1991</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>GENERATOR--LAND BAN REQUIREMENTS</i>
Violation Date:	<i>FEBRUARY 17, 1989</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)</i>
Violation Date:	<i>FEBRUARY 17, 1989</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--CLOSURE/POST-CLOSURE REQ.</i>
Violation Date:	<i>FEBRUARY 17, 1989</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>JULY 30, 1993</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)</i>
Violation Date:	<i>AUGUST 23, 1988</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>NOVEMBER 15, 1988</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--FINANCIAL RESPONSIBILITY REQ.</i>
Violation Date:	<i>JULY 6, 1988</i>
Violation Class:	<i>1</i>
Actual Compliance Date:	<i>NOVEMBER 15, 1988</i>
Scheduled Compliance Date:	<i>NOT REPORTED</i>



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #34

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Violation Type:	TSD--FINANCIAL RESPONSIBILITY REQ.
Violation Date:	MAY 19, 1988
Violation Class:	1
Actual Compliance Date:	JULY 2, 1988
Scheduled Compliance Date:	NOT REPORTED

<b>RCRA-TSD CORRACTS / SRC# 6379</b>	EPA ID:	CAD053044053
--------------------------------------	---------	--------------

Agency Address:	SAFETY KLEEN CORP 7 178 01 404 MARKET ST OAKLAND, CA 94607
Off-Site Waste Received:	NO
Land Disposal:	NO
Incinerator:	NO
Storage/Treatment:	YES

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	SAFETY KLEEN 400 MARKET ST OAKLAND, CA 01S0064
Facility ID:	01S0064
Remediation Status:	REFERRED
Description / Comment:	FAC COUNTY: ALAMEDA

VISTA Address*:	<b>MARINE TERMINALS CORP</b> <b>333 MARKET</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	930203
		Distance/Direction:	0.04 MI / NW
		Plotted as:	Point

Map ID  
**4B**

<b>CORTESE / SRC# 4840</b>	Agency ID:	01-0940
----------------------------	------------	---------


Agency Address:	SAME AS ABOVE
List Name:	LEAKING TANK
Site ID:	01-0940

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>	EPA/Agency ID:	N/A
---	----------------	-----

Agency Address:	FORMER MARINE TERMINALS CORP 333 MARKET ST OAKLAND, CA 94607		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	MARINE TERMINALS CORP 333 MARKET ST OAKLAND, CA
Facility ID:	01-0940
Leak Report Date:	5/1/87
Site Assessment Plan Submitted:	8/5/87
Site Assessment Began:	9/26/87
Pollution Characterization Date:	2/20/88
Case Closed Date:	1/9/97



**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Leak Cause:	OVERFILL
Leak Source:	UNKNOWN
Substance:	GASOLINE
Remediation Event:	EXCAVATE AND TREAT
Remediation Event:	STOP DATE: 4/21/87HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE: 1/13/97

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	MARINE TERMINALS CORP 333 MARKET ST OAKLAND, CA 94607		
Facility ID:	01-0940		
Leak Report Date:	05/01/87		
Site Assessment Plan Submitted:	08/05/87		
Site Assessment Began:	09/26/87		
Pollution Characterization Date:	02/20/88		
Case Closed Date:	01/09/97		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND TREAT		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE:		

VISTA Address*:	<b>KELLY'S TRUCK REPAIR</b> 425 MARKET ST OAKLAND, CA 94607	VISTA ID#:	3767648
		Distance/Direction:	0.04 MI / NW
		Plotted as:	Point
<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>		EPA ID:	CAD073926685
Agency Address:	KELLYS TRUCK REPAIR INC 425 MARKET ST OAKLAND, CA 94607		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		

Map ID  
**4B**

VISTA Address*:	<b>BAY AREA KENWORTH</b> 425 MARKET ST SW SIDE OAKLAND, CA 94607	VISTA ID#:	4866681
		Distance/Direction:	0.07 MI / NW
		Plotted as:	Point
<b>RCRA-SmGen - RCRA-Small Generator / SRC# 6379</b>		EPA ID:	CA0000084624
Agency Address:	SAME AS ABOVE		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		

Map ID  
**4C**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #36

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

VISTA Address*:	<b>MOBIL</b> 5425 GROVE ST OAKLAND, CA 94609	VISTA ID#:	5354893
		Distance/Direction:	0.08 MI / E
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1005		
Leak Report Date:	12/07/87		
Substance:	GASOLINE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:		

Map ID

**5A**

VISTA Address*:	<b>PG E POWER PLANT</b> 510 MARTIN LUTHER KING OAKLAND, CA	VISTA ID#:	3079437
		Distance/Direction:	0.11 MI / E
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1175
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1175		

Map ID


**5B**

VISTA Address*:	<b>CALTRANS</b> 6TH GROVE JEFFERSON OAKLAND, CA 94607	VISTA ID#:	6674488
		Distance/Direction:	0.08 MI / NA
		Plotted as:	Radius
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0269
Agency Address:	CALTRANS 6TH GROVE JEFFERSON BERKELEY, CA 94704		
List Name:	LEAKING TANK		
Site ID:	01-0269		

Map ID

**6**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	CALTRANS 0 6TH GROVE JEFFERSON BERKELEY, CA		
Facility ID:	01-0269		
Leak Report Date:	5/10/84		
Case Closed Date:	1/1/99		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	MISC MOTOR VEHICLE FUELS		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 5/10/84 HOW STOPPED: CLOSE TANK ENFORCEMENT; NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	CRWQCB ACTIVE CASE		
Region / District:	SAN FRANCISCO BAY RE		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #37

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

<b>Description / Comment:</b>		COUNTY: ALAMEDA STREET REVIEW DATE: 7/17/90	
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	CALTRANS 0 8TH GROVE JEFFERSON BERKELEY, CA 94704		
<b>Facility ID:</b>	01-0269		
<b>Leak Report Date:</b>	05/10/84		
<b>Case Closed Date:</b>	01/01/99		
<b>Substance:</b>	MISC MOTOR VEHICLE FUELS		
<b>Remediation Event:</b>	EXCAVATE AND DISPOSE		
<b>Remediation Status:</b>	CASE CLOSED		
<b>Media Affected:</b>	OTHER GROUND WATER		
<b>Lead Agency:</b>	CRWQCB ACTIVE CASE		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>		COUNTY: ALAMEDA STREET REVIEW DATE:	


<b>VISTA Address*:</b>	<b>MARKET STREET SHELL</b> 610 MARKET ST OAKLAND, CA 94607	<b>VISTA ID#:</b>	7006074
		<b>Distance/Direction:</b>	0.11 MI / N
		<b>Plotted as:</b>	Point

Map ID  
**7**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	SAME AS ABOVE		
<b>Underground Tanks:</b>	3		
<b>Aboveground Tanks:</b>	NOT REPORTED		
<b>Tanks Removed:</b>	NOT REPORTED		
<b>Tank ID:</b>	T001U	<b>Tank Status:</b>	OTHER
<b>Tank Contents:</b>	NOT AVAILABLE	<b>Leak Monitoring:</b>	NOT AVAILABLE
<b>Tank Age:</b>	NOT REPORTED	<b>Tank Piping:</b>	NOT AVAILABLE
<b>Tank Size (Units):</b>	NOT REPORTED (NOT AVAILABLE)	<b>Tank Material:</b>	NOT AVAILABLE

<b>STATE UST - State Underground Storage Tank / SRC# 6249</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	STEGMAC SHELL #204-5508-5751 610 MARKET ST OAKLAND, CA 94607		
<b>Underground Tanks:</b>	3		
<b>Aboveground Tanks:</b>	NOT REPORTED		
<b>Tanks Removed:</b>	NOT REPORTED		
<b>Tank ID:</b>	T001U	<b>Tank Status:</b>	ACTIVE/IN SERVICE
<b>Tank Contents:</b>	NOT AVAILABLE	<b>Leak Monitoring:</b>	NOT AVAILABLE
<b>Tank Age:</b>	NOT REPORTED	<b>Tank Piping:</b>	NOT AVAILABLE
<b>Tank Size (Units):</b>	NOT REPORTED (NOT AVAILABLE)	<b>Tank Material:</b>	NOT AVAILABLE

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	SHELL 610 MARKET ST OAKLAND, CA		
<b>Facility ID:</b>	01-2306		
<b>Leak Report Date:</b>	8/17/95		
<b>Contamination Confirmed Date:</b>	3/16/98		
<b>Leak Cause:</b>	UNKNOWN		
<b>Leak Source:</b>	UNKNOWN		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #38

**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

Substance:	GASOLINE
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 8/14/95 HOW STOPPED: OTHER MEANS ENFORCEMENT. ENFORCEMENT DATE:
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: 7TH ST REVIEW DATE: 8/5/98

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SHELL 610 MARKET ST OAKLAND, CA 94607		
Facility ID:	01-2306		
Leak Report Date:	08/17/95		
Contamination Confirmed Date:	03/16/98		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: 7TH ST REVIEW DATE:		

VISTA Address*:	<b>STEGMAN INC. MARKET STREET SHE 610 MARKET OAKLAND, CA 94607</b>	VISTA ID#:	1228603
		Distance/Direction:	0.11 MI / N
		Plotted as:	Point

Map ID  
**7**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #39



**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

VISTA Address*:	<b>OAKLAND POWER PLANT</b> 50 GROVE OAKLAND, CA 94612	VISTA ID#:	4012805
		Distance/Direction:	0.11 MI / S
		Plotted as:	Point

Map ID  
**8**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>	EPA/Agency ID:	N/A
---	----------------	-----

Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	NOT REPORTED (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	NOT REPORTED (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	NOT REPORTED (GALLONS)	Tank Material:	BARE STEEL


VISTA Address*:	<b>PG AND E OAKLAND</b> 50 GROVE ST OAKLAND, CA 94607	VISTA ID#:	1593748
		Distance/Direction:	0.11 MI / S
		Plotted as:	Point

Map ID  
**8**

<b>ERNS - Emergency Response Notification System / SRC# 6181</b>	Agency ID:	93-0210
--	------------	---------

Agency Address:	PGE EUCLID AND GRAND AVE OAKLAND, CA 94610				
Spill Date Time:	OCTOBER 14, 1992 01:00:00 PM				
Case Number:	93-0210				
Spill Location:	EUCLID AND GRAND AVE				
Source Agency:	E				
Discharger Org:	PGE				
Material Spilled:	GASOLINE, 0.00 (UNK)				
Fields Not Reported:	Discharger Name, Discharger Phone, Waterway Affected				

Air Release:	Land Release:	Water Release:	Ground Release:	Facility Release:	Other Release:
NO	NO	NO	NO	NO	NO



**PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.**

VISTA Address*:	<b>OAKLAND POWER PLANT</b> 50 GROVE ST OAKLAND, CA 94612	VISTA ID#:	1219556
		Distance/Direction:	0.11 MI / S
		Plotted as:	Point

Map ID  
**8**

<b>AST - Above Ground Storage Tank / SRC# 5513</b>		EPA/Agency ID:	N/A
Agency Address:	OAKLAND POWER PLANT 50 GROVE ST. OAKLAND, CA 94607		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

VISTA Address*:	<b>OAKLAND POWER PLANT</b> 50 MARTIN LUTHER KING OAKLAND, CA 94607	VISTA ID#:	3767689
		Distance/Direction:	0.11 MI / S
		Plotted as:	Point

Map ID  
**8**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1075
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1075		

VISTA Address*:	<b>PGE - OAKLAND</b> 50 MARKET BETWEEN 1ST AND GROVE ST OAKLAND, CA 94607	VISTA ID#:	327833
		Distance/Direction:	0.12 MI / SW
		Plotted as:	Point

Map ID  
**9A**

<b>RCRA-LqGen - RCRA-Large Generator / SRC# 6379</b>		EPA ID:	CAD981370117
Agency Address:	P G AND E FORMER GAS PLANT 50 MARKET ST OAKLAND, CA 94607		
Generator Class:	Generates at least 1000 kg./month of non-acutely hazardous waste ( or 1 kg./month of acutely hazardous waste).		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	P G E OAKLAND MGP SITE 2 SITES 50 630 MARKET ST EMBARCADERO OAKLAND, CA		
Facility ID:	01S0288		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01490012
Agency Address:	PGE - OAKLAND 50 MARKET BETWEEN FIRST AND GROVE ST OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	VOLUNTARY CLEANUP		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #41

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)**

VISTA Address*:	<b>HOWARD TERMINAL ONE MARKET ST. OAKLAND, CA 94607</b>	VISTA ID#:	8585950
		Distance/Direction:	0.15 MI / SW
		Plotted as:	Point
<b>AST - Above Ground Storage Tank / SRC# 5513</b>		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		NOT REPORTED	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	

Map ID  
**9B**

VISTA Address*:	<b>STEVEDORING SERVICES OF AMERICA 1 MARKET ST OAKLAND, CA 94607</b>	VISTA ID#:	399703
		Distance/Direction:	0.15 MI / SW
		Plotted as:	Point
<b>AST - Above Ground Storage Tank / SRC# 5513</b>		EPA/Agency ID:	N/A
Agency Address:		STEVE-DORING SERV. OF AMERICA 1 MARKET STREET OAKLAND, CA	
Underground Tanks:		NOT REPORTED	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	

Map ID  
**9B**

VISTA Address*:	<b>STEVEDORING SVCS. HOWARD TERMIN 1 MARKET ST OAKLAND, CA 94607</b>	VISTA ID#:	7006072
		Distance/Direction:	0.15 MI / SW
		Plotted as:	Point
<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		1	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	
Tank ID:	1001U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

Map ID  
**9B**

VISTA Address*:	<b>HOWARD TERMINAL 1 MARKET OAKLAND, CA 94607</b>	VISTA ID#:	4034408
		Distance/Direction:	0.15 MI / SW
		Plotted as:	Point
<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		1	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	
Tank ID:	1001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	12000 (GALLONS)	Tank Material:	FIBERGLASS

Map ID  
**9B**



**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>DEL MONTE CORP, PLANT #550</b> <b>122 FILBERT</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	1215691
		Distance/Direction:	0.13 MI / W
		Plotted as:	Point

Map ID  
**10**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	8000 (GALLONS)	Tank Material:	BARE STEEL


<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	DEL MONTE CORP. PLANT #550 122 FILBERT ST OAKLAND, CA 94607		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	<b>PGE</b> <b>50 MARTIN LEUTHER KING</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	2141397
		Distance/Direction:	0.15 MI / NE
		Plotted as:	Point

Map ID  
**11**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	PG E POWER PLANT 50 MARTIN L KING WAY OAKLAND, CA 94607		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	PG E OAKLAND POWER PLANT 50 MARTIN LUTHER KING OAKLAND, CA		
Facility ID:	01-1075		
Leak Report Date:	11/22/91		
Site Assessment Plan Submitted:	8/31/92		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	DIESEL		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #43

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**


Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 11/16/90HOW STOPPED: REPAIR TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 3/9/92
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE: 8/22/97

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	PG E OAKLAND POWER PLANT 50 MARTIN LUTHER KING OAKLAND, CA 94607		
Facility ID:	01-1075		
Leak Report Date:	11/22/91		
Site Assessment Plan Submitted:	08/31/92		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE:		

VISTA Address*:	<b>GROVE AUTO REPAIR</b> <b>424 MARTIN LUTHER KING</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	11499054
		Distance/Direction:	0.15 MI / NE
		Plotted as:	Point

Map ID:  
**11**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	GROVE AUTO REPAIR 424 MARTIN LUTHER KING OAKLAND, CA		
Facility ID:	01-1462		
Leak Report Date:	10/15/88		
Site Assessment Plan Submitted:	4/22/88		
Site Assessment Began:	8/30/87		
Contamination Confirmed Date:	3/23/92		
Pollution Characterization Date:	7/27/88		
Remediation Plan Date:	9/26/86		
Remediation Start Date:	12/1/88		
Post Remediation Monitoring Began:	7/31/89		
Case Closed Date:	11/15/93		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 10/15/88HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 3/23/92		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		



**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>Description / Comment:</b>		COUNTY: ALAMEDA STREET REVIEW DATE: 11/15/93	
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	SAME AS ABOVE		
<b>Facility ID:</b>	01-1462		
<b>Leak Report Date:</b>	10/15/88		
<b>Site Assessment Plan Submitted:</b>	04/22/88		
<b>Site Assessment Began:</b>	08/30/87		
<b>Contamination Confirmed Date:</b>	03/23/92		
<b>Pollution Characterization Date:</b>	07/27/88		
<b>Remediation Plan Date:</b>	09/26/86		
<b>Remediation Start Date:</b>	12/01/88		
<b>Post Remediation Monitoring Began:</b>	07/31/89		
<b>Case Closed Date:</b>	11/15/93		
<b>Substance:</b>	GASOLINE		
<b>Remediation Status:</b>	CASE CLOSED		
<b>Media Affected:</b>	OTHER GROUND WATER		
<b>Lead Agency:</b>	LOCAL AGENCY		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>		COUNTY: ALAMEDA STREET REVIEW DATE:	

<b>VISTA Address*:</b>	<b>EAST BAY FORD TRUCK SALES</b> 333 FILBERT OAKLAND, CA 94607	<b>VISTA ID#:</b>	131764
		<b>Distance/Direction:</b>	0.15 MI / NW
		<b>Plotted as:</b>	Point

Map ID

**12A**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> SAME AS ABOVE			
<b>Underground Tanks:</b> 1			
<b>Aboveground Tanks:</b> NOT REPORTED			
<b>Tanks Removed:</b> NOT REPORTED			
<b>Tank ID:</b>	T001U	<b>Tank Status:</b>	CLOSED REMOVED
<b>Tank Contents:</b>	OIL (NOT SPECIFIED)	<b>Leak Monitoring:</b>	Agency Code (')
<b>Tank Age:</b>	NOT REPORTED	<b>Tank Piping:</b>	UNKNOWN
<b>Tank Size (Units):</b>	400 (GALLONS)	<b>Tank Material:</b>	BARE STEEL

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> EASTBAY FORD TRUCK SALES, INC. 333 FILBERT ST OAKLAND, CA 94607			
<b>Underground Tanks:</b> NOT REPORTED			
<b>Aboveground Tanks:</b> NOT REPORTED			
<b>Tanks Removed:</b> NOT REPORTED			
<b>Tank ID:</b>	T001U	<b>Tank Status:</b>	REMOVED
<b>Tank Contents:</b>	NOT AVAILABLE	<b>Leak Monitoring:</b>	NOT AVAILABLE
<b>Tank Age:</b>	NOT REPORTED	<b>Tank Piping:</b>	NOT AVAILABLE
<b>Tank Size (Units):</b>	NOT REPORTED (NOT AVAILABLE)	<b>Tank Material:</b>	NOT AVAILABLE

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> EAST BAY FORD TRUCK 333 FILBERT ST OAKLAND, CA			
<b>Facility ID:</b> 01-0531			



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #45

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**


Leak Report Date:	8/23/88
Site Assessment Plan Submitted:	1/4/89
Contamination Confirmed Date:	3/9/92
Case Closed Date:	8/1/94
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	WASTE OIL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 10/26/88HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 3/9/92
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 12/13/94

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	EAST BAY FORD TRUCK 333 FILBERT ST OAKLAND, CA 94607		
Facility ID:	01-0531		
Leak Report Date:	08/23/88		
Site Assessment Plan Submitted:	01/04/89		
Contamination Confirmed Date:	03/09/92		
Case Closed Date:	08/01/94		
Substance:	WASTE OIL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>EAST BAY TIRE CO.</b> <b>225 3RD ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	1223509
		Distance/Direction:	0.16 MI / W
		Plotted as:	Point

Map ID  
**12B**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE



**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	EAST BAY TIRE COMPANY 225 3RD ST OAKLAND, CA		
Facility ID:	01-2227		
Leak Report Date:	3/25/87		
Contamination Confirmed Date:	6/5/97		
Case Closed Date:	5/30/97		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 3/25/87HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 6/18/97		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	EAST BAY TIRE COMPANY 225 3RD ST OAKLAND, CA 94607		
Facility ID:	01-2227		
Leak Report Date:	03/25/87		
Contamination Confirmed Date:	06/05/97		
Case Closed Date:	05/30/97		
Substance:	GASOLINE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>EAST BAY TIRE CO. 225 3RD OAKLAND, CA 94607</b>	VISTA ID#:	7430624
		Distance/Direction:	0.16 MI / W
		Plotted as:	Point


Map ID  
**12B**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-2227
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-2227		

VISTA Address*:	<b>JOHNSTON SONS 801 3RD AVE OAKLAND, CA 94607</b>	VISTA ID#:	930123
		Distance/Direction:	0.18 MI / W
		Plotted as:	Point

Map ID  
**12C**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	JOHNSTON SONS 801 3RD AVE OAKLAND, CA		
Facility ID:	01-0826		
Leak Report Date:	6/30/87		
Case Closed Date:	5/18/93		





**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 6/30/87HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 9/8/94

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	JOHNSTON SONS 801 3RD AVE OAKLAND, CA 94606		
Facility ID:	01-0826		
Leak Report Date:	06/30/87		
Case Closed Date:	05/18/93		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>PE O'HAIR COMPANY</b> 339 3RD OAKLAND, CA 94607	VISTA ID#:	7430626
		Distance/Direction:	0.22 MI / W
		Plotted as:	Point


Map ID  
**12D**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0838
Agency Address:	PE O'HAIR COMPANY 339 3RD OAKLAND, CA		
List Name:	LEAKING TANK		
Site ID:	01-0838		

VISTA Address*:	<b>PE O'HAIR COMPANY</b> 339 3RD ST OAKLAND, CA 94607	VISTA ID#:	3781172
		Distance/Direction:	0.22 MI / W
		Plotted as:	Point

Map ID  
**12D**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	PE O'HAIR COMPANY 339 3RD ST OAKLAND, CA		
Facility ID:	01-0838		
Leak Report Date:	1/20/90		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #48

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

Remediation Event:	STOP DATE: 1/20/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TANK ENFORCEMENT DATE:
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE: 9/8/94

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0838		
Leak Report Date:	01/20/90		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE:		

VISTA Address*:	<b>BRAMELEA PACIFIC 13TH JEFFERSON ST OAKLAND, CA</b>	VISTA ID#:	1585619
		Distance/Direction:	0.17 MI / SE
		Plotted as:	Point

Map ID  
**13**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0234
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-0234		

VISTA Address*:	<b>CITY OF OAKLAND PARKING S 7TH JEFFERSON ST OAKLAND, CA</b>	VISTA ID#:	7432845
		Distance/Direction:	0.17 MI / SE
		Plotted as:	Point

Map ID  
**13**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1139
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1139		

VISTA Address*:	<b>PGE GAS PLANT OAKLAND 601 2 1ST BET JEFFERSON MARKET OAKLAND, CA 94607</b>	VISTA ID#:	327867
		Distance/Direction:	0.17 MI / SE
		Plotted as:	Point

Map ID  
**13**

<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD981415169
Agency Address:	SAME AS ABOVE		

<b>Regional Utility Description:</b>	NEW CERCLIS SITE		
--------------------------------------	------------------	--	--

<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD981415169
Agency Address:	SAME AS ABOVE		

<b>Regional Utility Description:</b>	PGE GAS PLANT SITE		
--------------------------------------	--------------------	--	--



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #49

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>NFRAP / SRC# 6475</b>		<b>EPA ID:</b>	<b>CAD981415169</b>
<b>Agency Address:</b>	SAME AS ABOVE		
<b>EPA Region:</b>	9		
<b>Congressional District:</b>	0		
<b>Federal Facility:</b>	Agency Code ( )		
<b>Facility Ownership:</b>	UNKNOWN		
<b>Site Incident Category:</b>	unknown		
<b>Federal Facility Docket:</b>	SITE IS NOT INCLUDED ON THE DOCKET		
<b>NPL Status:</b>	NOT ON NPL		
<b>Incident Type:</b>	Unknown		
<b>Proposed NPL Update #:</b>	0		
<b>Final NPL Update #:</b>	0		
<b>Financial Management System ID:</b>	NOT REPORTED		
<b>Latitude:</b>	0		
<b>Longitude:</b>	0		
<b>Lat/Long Source:</b>	Agency Code ( )		
<b>Lat/Long Accuracy:</b>	Unknown		
<b>Dioxin Tier:</b>	Unknown		
<b>USGS Hydro Unit:</b>	18050004		
<b>RCRA Indicator:</b>	Unknown		
<b>Unit Id:</b>	0		
<b>Unit Name:</b>	ENTIRE SITE		
<b>Type:</b>	DISCOVERY	<b>Lead Agency:</b>	OTHER
<b>Qualifier:</b>	UNKNOWN	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN
<b>Type:</b>	PRELIMINARY ASSESSMENT	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	LOWER PRIORITY	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN
<b>Type:</b>	SCREENING SITE INSPECTION	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	NO FURTHER REMEDIAL ACTION PLANNED	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #50

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>FRANCIS PLATING, INC. 785 7TH ST OAKLAND, CA 94607</b>	VISTA ID#:	158459
		Distance/Direction:	0.19 MI / NE
		Plotted as:	Point

Map ID  
**14A**

<b>CORRACTS / SRC# 6379</b>	EPA ID:	CAD009206160
-----------------------------	---------	--------------

Agency Address:	<i>FRANCIS PLATING OF OAKLAND INC 785 7TH ST OAKLAND, CA 94607</i>
Prioritization Status:	<i>LOW</i>
RCRA Facility Assessment Completed:	<i>NO</i>
Notice of Contamination:	<i>NO</i>
Determination of need For a RFI (RCRA Facility Investigation):	<i>NO</i>
RFI Imposed:	<i>NO</i>
RFI Workplan Notice of Deficiency Issued:	<i>NO</i>
RFI Workplan Approved:	<i>NO</i>
RFI Report Received:	<i>NO</i>
RFI Approved:	<i>NO</i>
No Further Corrective Action at this Time:	<i>NO</i>
Stabilization MESAURES Evaluation:	<i>NO</i>
CMS (Corrective Measure Study) Imposition:	<i>NO</i>
CMS Workplan Approved:	<i>NO</i>
CMS Report Received:	<i>NO</i>
CMS Approved:	<i>NO</i>
Date for Remedy Selection (CM Imposed):	<i>NO</i>
Corrective Measures Design Approved:	<i>NO</i>
Corrective Measures Investigation Workplan Approved:	<i>NO</i>
Certification of Remedy Completion:	<i>NO</i>
Stabilization Measures Implementation:	<i>NO</i>
Stabilization Measures Completed:	<i>NO</i>
Corrective Action Process Termination:	<i>NO</i>

<b>RCRA-Violations / SRC# 6379</b>	EPA ID:	CAD009206160
------------------------------------	---------	--------------

Agency Address:	<i>FRANCIS PLATING OF OAKLAND INC 785 7TH ST OAKLAND, CA 94607</i>
Enforcement Number:	<i>198708130</i>
Enforcement Agency:	<i>State</i>
Action Date:	<i>AUGUST 13, 1987</i>
Action Type:	<i>WRITTEN INFORMAL</i>
Penalty Assessed:	<i>NOT REPORTED</i>
Penalty Settlement:	<i>NOT REPORTED</i>
Violation Type:	<i>TSD--OTHER REQUIREMENTS (OVERSITE LEVEL)</i>
Violation Date:	<i>APRIL 28, 1987</i>
Violation Class:	<i>2</i>
Actual Compliance Date:	<i>SEPTEMBER 17, 1987</i>
Scheduled Compliance Date:	<i>SEPTEMBER 17, 1987</i>



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #51

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>CERCLIS / SRC# 6474</b>		<b>EPA ID:</b>	<b>CAD009206160</b>
<b>Agency Address:</b>	FRANCIS PLATING OF OAKLAND INC 785 7TH ST OAKLAND, CA 94607		
<b>EPA Region:</b>	9		
<b>Congressional District:</b>	0		
<b>Federal Facility:</b>	Agency Code ( )		
<b>Facility Ownership:</b>	PRIVATE		
<b>Site Incident Category:</b>	unknown		
<b>Federal Facility Docket:</b>	SITE IS NOT INCLUDED ON THE DOCKET		
<b>NPL Status:</b>	NOT ON NPL		
<b>Incident Type:</b>	Unknown		
<b>Proposed NPL Update #:</b>	0		
<b>Final NPL Update #:</b>	0		
<b>Financial Management System ID:</b>	096Q		
<b>Latitude:</b>	0		
<b>Longitude:</b>	0		
<b>Lat/Long Source:</b>	Agency Code ( )		
<b>Lat/Long Accuracy:</b>	Unknown		
<b>Dioxin Tier:</b>	Unknown		
<b>USGS Hydro Unit:</b>	18050004		
<b>RCRA Indicator:</b>	ENVIRONMENTAL PRIORITY INITIATIVE		
<b>Unit Id:</b>	0		
<b>Unit Name:</b>	SITEWIDE		
<b>Name:</b>	<b>Lead Agency:</b>	<b>Actual Start Date:</b>	<b>Actual Completion Date:</b>
NOT REPORTED	FEDERAL ENFORCEMENT	NOT REPORTED	UNKNOWN
NOT REPORTED	FEDERAL ENFORCEMENT	UNKNOWN	UNKNOWN
NOT REPORTED	FEDERAL ENFORCEMENT	UNKNOWN	UNKNOWN
<b>Type:</b>	DISCOVERY	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	UNKNOWN	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	JUNE 12, 1990
<b>Type:</b>	PRELIMINARY ASSESSMENT	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	DEFERRED TO RCRA (SUBTITLE C) OR NRC	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	AUGUST 28, 1990
<b>Type:</b>	REMOVAL COMMUNITY RELATIONS	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	UNKNOWN	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOVEMBER 18, 1992
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	DECEMBER 28, 1992



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #52

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>GREYHOUND LINE INC</b> <b>0 7TH BRUSH</b> <b>OAKLAND, CA 94067</b>	VISTA ID#:	12714033
		Distance/Direction:	0.19 MI / NE
		Plotted as:	Point

Map ID  
**14B**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0721		
Leak Report Date:	10/16/87		
Site Assessment Began:	03/16/87		
Case Closed Date:	07/12/95		
Substance:	WASTE OIL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		

VISTA Address*:	<b>ALLIED FOOD SALES</b> <b>301 CLAY ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	8574108
		Distance/Direction:	0.19 MI / E
		Plotted as:	Point


Map ID  
**15**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	000001	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	<b>ALLIED FOOD SALES</b> <b>333 CLAY ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	11498632
		Distance/Direction:	0.19 MI / E
		Plotted as:	Point

Map ID  
**15**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	ALLIED FOOD SALES 333 CLAY ST OAKLAND, CA		
Facility ID:	01-1174		
Leak Report Date:	1/16/92		
Case Closed Date:	10/30/96		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 1/16/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #53

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

**Media Affected:** OTHER GROUND WATER  
**Lead Agency:** LOCAL AGENCY  
**Region / District:** SAN FRANCISCO BAY RE  
**Description / Comment:** COUNTY: ALAMEDA STREET; REVIEW DATE: 4/16/97

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A
<b>Agency Address:</b>	SAME AS ABOVE	
<b>Facility ID:</b>	01-1174	
<b>Leak Report Date:</b>	01/16/92	
<b>Case Closed Date:</b>	10/30/96	
<b>Substance:</b>	GASOLINE	
<b>Remediation Event:</b>	NO ACTION TAKEN	
<b>Remediation Status:</b>	CASE CLOSED	
<b>Media Affected:</b>	OTHER GROUND WATER	
<b>Lead Agency:</b>	LOCAL AGENCY	
<b>Region / District:</b>	SAN FRANCISCO BAY RE	
<b>Description / Comment:</b>	COUNTY: ALAMEDA STREET; REVIEW DATE:	

<b>VISTA Address*:</b>	<b>ALLIED POULTRY CO. INC.</b> 333 CLAY ST OAKLAND, CA 94607	<b>VISTA ID#:</b>	8574109	<b>Map ID</b> <b>15</b>
		<b>Distance/Direction:</b>	0.19 MI / E	
		<b>Plotted as:</b>	Point	

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>	EPA/Agency ID:	N/A	
<b>Agency Address:</b>	SAME AS ABOVE		
<b>Underground Tanks:</b>	NOT REPORTED		
<b>Aboveground Tanks:</b>	NOT REPORTED		
<b>Tanks Removed:</b>	NOT REPORTED		
<b>Tank ID:</b>	000001	<b>Tank Status:</b>	REMOVED
<b>Tank Contents:</b>	NOT AVAILABLE	<b>Leak Monitoring:</b>	NOT AVAILABLE
<b>Tank Age:</b>	NOT REPORTED	<b>Tank Piping:</b>	NOT AVAILABLE
<b>Tank Size (Units):</b>	NOT REPORTED (NOT AVAILABLE)	<b>Tank Material:</b>	NOT AVAILABLE

<b>VISTA Address*:</b>	<b>PORT OF OAKLAND/CINEMA PROJECT</b> CLAY EMBARCADERO OAKLAND, CA 94607	<b>VISTA ID#:</b>	6531981	<b>Map ID</b> <b>16A</b>
		<b>Distance/Direction:</b>	0.20 MI / SE	
		<b>Plotted as:</b>	Point	

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>	Agency ID:	01730099
<b>Agency Address:</b>	PORT OF OAKLAND/CINEMA PROJECT CLAY EMBARCADERO OAKLAND, CA 94706	
<b>Status:</b>	UNKNOWN	
<b>Facility Type:</b>	NOT AVAILABLE	
<b>Lead Agency:</b>	DEPT OF TOXIC SUBSTANCES CONTROL	
<b>State Status:</b>	CERTIFIED/OPERATION AND MAINTENANCE	
<b>Pollutant 1:</b>	UNKNOWN	
<b>Pollutant 2:</b>	UNKNOWN	
<b>Pollutant 3:</b>	UNKNOWN	



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #54

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>OAKLAND FIRE STATION #02</b> 100 CLAY ST OAKLAND, CA 94607	VISTA ID#:	7005450
		Distance/Direction:	0.21 MI / SE
		Plotted as:	Point

Map ID

**16A**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	<b>CITY OF OAKLAND #2 ENGINE FIRE</b> CLAY STREET OAKLAND, CA 94607	VISTA ID#:	1254243
		Distance/Direction:	0.22 MI / SE
		Plotted as:	Point

Map ID

**16B**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	1000 (GALLONS)	Tank Material:	UNKNOWN

VISTA Address*:	<b>LAKE MERRITT PUMP STATION</b> 7TH ST AT E 8TH ST E 8TH ST OAKLAND, CA 94606	VISTA ID#:	4043650
		Distance/Direction:	0.20 MI / NE
		Plotted as:	Point

Map ID

**17**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	STAINLESS STEEL
Tank Size (Units):	4000 (GALLONS)	Tank Material:	FIBERGLASS



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #55



**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>MICRONESIAN CARGO INTERNATIONAL</b> 955 7TH ST OAKLAND, CA 94607	VISTA ID#:	5006063
		Distance/Direction:	0.21 MI / N
		Plotted as:	Point

Map ID

**18**

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01420129
Agency Address:	MICRONESIAN CARGO INTERNATIONAL 955 7TH STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	NO FURTHER ACTION FOR DTSC		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>GEORGE GONG PROPERTY</b> 955 7TH ST OAKLAND, CA 94607	VISTA ID#:	8569109
		Distance/Direction:	0.21 MI / N
		Plotted as:	Point

Map ID

**18**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	000001	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	<b>OAKLAND POLICE STATION</b> 0 CLAY ST 5TH ST OAKLAND, CA 94607	VISTA ID#:	7430786
		Distance/Direction:	0.22 MI / E
		Plotted as:	Point

Map ID

**19A**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	OAKLAND POLICE STATION 0 CLAY ST 5TH ST OAKLAND, CA 01-1831		
Facility ID:	01-1831		
Leak Report Date:	6/24/93		
Contamination Confirmed Date:	7/16/93		
Case Closed Date:	1/21/98		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 2/16/93 HOW STOPPED: CLOSE TANK ENFORCEMENT; WARNING ENFORCEMENT DATE: 7/16/93		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #56

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**


Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; 5TH ST REVIEW DATE: 2/5/98
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID: N/A
Agency Address:	SAME AS ABOVE
Facility ID:	01-1831
Leak Report Date:	06/24/93
Contamination Confirmed Date:	07/16/93
Case Closed Date:	01/21/98
Substance:	GASOLINE
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; 5TH ST REVIEW DATE:

VISTA Address*:	<b>UNION MACHINE WORKS</b> <b>534 2ND ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	1591483
		Distance/Direction:	0.23 MI / SE
		Plotted as:	Point

Map ID:  
**20A**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>	EPA/Agency ID: N/A		
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	00035300	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	EPA/Agency ID: N/A
Agency Address:	UNION MACHINE WORKS OF OAKLAND 534 2ND ST OAKLAND, CA
Facility ID:	01-1537
Leak Report Date:	8/20/90
Case Closed Date:	4/24/97
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 8/20/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 5/14/97



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #57

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	UNION MACHINE WORKS OF OAKLAND 534 2ND ST OAKLAND, CA 94607		
Facility ID:	01-1537		
Leak Report Date:	08/20/90		
Case Closed Date:	04/24/97		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:		


VISTA Address*:	<b>ARATEX SERVICES</b> <b>330 CHESTNUT</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	24870
		Distance/Direction:	0.25 MI / W
		Plotted as:	Point

Map ID

**21A**

<b>STATE UST - State Underground Storage Tank / SRC# 1612</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	4		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	12000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code (')
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	1 (GALLONS)	Tank Material:	BARE STEEL

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0086
Agency Address:	ARATEX SERVICES 330 CHESTNUT OAKLAND, CA 974360000		
List Name:	LEAKING TANK		
Site ID:	01-0086		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.5.1

Page #58

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

<b>STATE UST - State Underground Storage Tank / SRC# 5275</b>		EPA/Agency ID:	N/A
Agency Address:	ARATEX SERVICES 330 CHESTNUT ST OAKLAND, CA 94607		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	ARATEX SERVICES 330 CHESTNUT ST OAKLAND, CA		
Facility ID:	01-0086		
Leak Report Date:	12/16/88		
Site Assessment Plan Submitted:	6/7/89		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	DIESEL		
Remediation Event:	REMOVE FREE PRODUCT		
Remediation Event:	STOP DATE: 8/24/89 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 3/4/92		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE: 8/3/98		
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	ARATEX SERVICES 330 CHESTNUT ST OAKLAND, CA 94607		
Facility ID:	01-0086		
Leak Report Date:	12/16/88		
Site Assessment Plan Submitted:	06/07/89		
Substance:	DIESEL		
Remediation Event:	REMOVE FREE PRODUCT		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #59

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**


VISTA Address*:	<b>LEHAR SALES 150 CHESTNUT OAKLAND, CA 94607</b>	VISTA ID#:	3781249
		Distance/Direction:	0.25 MI / W
		Plotted as:	Point

Map ID  
**21B**

<b>CORTESE / SRC# 4840</b>	Agency ID:	01-1268
Agency Address:	LEHAR SALES 150 CHESTNUT OAKLAND, CA 946070000	
List Name:	LEAKING TANK	
Site ID:	01-1268	

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	EPA/Agency ID:	N/A
Agency Address:	LEHAR SALES 150 CHESTNUT ST OAKLAND, CA 01-1268	
Facility ID:	01-1268	
Leak Report Date:	1/20/91	
Site Assessment Plan Submitted:	5/14/97	
Case Closed Date:	5/29/98	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Event:	STOP DATE: 1/20/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 7/21/98	

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A
Agency Address:	LEHAR SALES 150 CHESTNUT ST OAKLAND, CA 94607 01-1268	
Facility ID:	01-1268	
Leak Report Date:	01/20/91	
Site Assessment Plan Submitted:	05/14/97	
Case Closed Date:	05/29/98	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:	



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #60

**SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.**

VISTA Address*:	<b>OAKLAND CITY OF PARKING STRUCT</b> <b>0 7TH JEFFERSON ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	7851357
		Distance/Direction:	0.25 MI / E
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	OAKLAND CITY OF PARKING STRUCT 0 7TH JEFFERSON ST OAKLAND, CA		
Facility ID:	01-1139		
Leak Report Date:	6/17/88		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	UNLEADED GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 6/17/88HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 1/24/96		

Map ID

**22A**


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1139		
Leak Report Date:	06/17/88		
Substance:	UNLEADED GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)**

VISTA Address*:	<b>ALAMEDA CTY HEALTH HEADQUARTERS</b> <b>499 5TH ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	10793110
		Distance/Direction:	0.30 MI / E
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA CTY HEALTH HEADQUARTERS 499 5TH ST OAKLAND, CA		
Facility ID:	01-1720		
Leak Report Date:	2/19/90		
Site Assessment Plan Submitted:	1/15/93		
Contamination Confirmed Date:	12/3/92		
Case Closed Date:	1/8/97		

Map ID

**19**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #61

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>Leak Cause:</b>	STRUCTURE FAILURE
<b>Leak Source:</b>	TANK
<b>Substance:</b>	GASOLINE
<b>Remediation Event:</b>	EXCAVATE AND DISPOSE
<b>Remediation Event:</b>	STOP DATE: 2/12/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TANK ENFORCEMENT DATE: 2/3/92
<b>Remediation Status:</b>	CASE CLOSED
<b>Media Affected:</b>	SOIL ONLY
<b>Lead Agency:</b>	LOCAL AGENCY
<b>Region / District:</b>	SAN FRANCISCO BAY RE
<b>Description / Comment:</b>	COUNTY: ALAMEDA STREET: REVIEW DATE: 5/18/99


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	ALAMEDA CTY HEALTH HEADQUARTER 499 5TH ST OAKLAND, CA 94607		
<b>Facility ID:</b>	01-1720		
<b>Leak Report Date:</b>	02/19/90		
<b>Site Assessment Plan Submitted:</b>	01/15/93		
<b>Contamination Confirmed Date:</b>	12/03/92		
<b>Case Closed Date:</b>	01/08/97		
<b>Substance:</b>	GASOLINE		
<b>Remediation Event:</b>	EXCAVATE AND DISPOSE		
<b>Remediation Status:</b>	CASE CLOSED		
<b>Media Affected:</b>	SOIL ONLY		
<b>Lead Agency:</b>	LOCAL AGENCY		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>	COUNTY: ALAMEDA STREET: REVIEW DATE:		

<b>VISTA Address*:</b>	<b>PORT OF OAKLAND LOT 12</b> 475 2ND ST OAKLAND, CA 94607	<b>VISTA ID#:</b>	6531853
		<b>Distance/Direction:</b>	0.31 MI / SE
		<b>Plotted as:</b>	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	PORT OF OAKLAND LOT 12 475 2ND ST OAKLAND, CA		
<b>Facility ID:</b>	01S0360		
<b>Remediation Status:</b>	INACTIVE		
<b>Description / Comment:</b>	FAC COUNTY: ALAMEDA		

Map ID  
**20**

<b>VISTA Address*:</b>	<b>BART CORPORATION YARD</b> 540 7TH ST E OAKLAND, CA 94607	<b>VISTA ID#:</b>	12666823
		<b>Distance/Direction:</b>	0.31 MI / E
		<b>Plotted as:</b>	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	BART CORPORATION YARD 540 7TH ST E OAKLAND, CA		
<b>Facility ID:</b>	01-0149		
<b>Leak Report Date:</b>	6/6/88		
<b>Case Closed Date:</b>	9/29/95		

Map ID  
**22**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #62

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 6/6/88HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 9/29/95

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	BART CORPORATION YARD 540 7TH ST E OAKLAND, CA 96920		
Facility ID:	01-0149		
Leak Report Date:	06/06/88		
Case Closed Date:	09/29/95		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>CHANG'S AUTOMOTIVE</b> 1009 7TH ST OAKLAND, CA 94607	VISTA ID#:	5006064
		Distance/Direction:	0.25 MI / NW
		Plotted as:	Point


Map ID  
**23**

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01750019
Agency Address:	CHANG'S AUTOMOTIVE 1009 7TH STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	CERTIFIED		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>VEND MART PROPERTY</b> 1035 7TH ST OAKLAND, CA 94607	VISTA ID#:	12639370
		Distance/Direction:	0.26 MI / NW
		Plotted as:	Point

Map ID  
**23**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1778		
Leak Report Date:	06/21/88		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #63



**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Site Assessment Plan Submitted:	10/17/88
Substance:	GASOLINE
Remediation Event:	EXCAVATE AND TREAT
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE:

VISTA Address*:	<b>MARBLE TECHNICS WEST</b> 1035 7TH ST OAKLAND, CA 94607	VISTA ID#:	5006065
		Distance/Direction:	0.26 MI / NW
		Plotted as:	Point


Map ID  
**23**

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01990012
Agency Address:	MARBLE TECHNICS WEST 1035 7TH STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	CERTIFIED		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>VEND MART PROPERTY</b> 1035 7TH ST OAKLAND, CA 94607	VISTA ID#:	4222317
		Distance/Direction:	0.26 MI / NW
		Plotted as:	Point

Map ID  
**23**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	VEND MART PROPERTY 1035 7TH ST OAKLAND, CA		
Facility ID:	01-1778		
Leak Report Date:	6/21/88		
Site Assessment Plan Submitted:	10/17/88		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND TREAT		
Remediation Event:	STOP DATE: 6/21/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET REVIEW DATE: 10/25/96		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #64

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**


VISTA Address*:	<b>VEND MART PROPERTY</b> 1035 7TH OAKLAND, CA 94607	VISTA ID#:	7430948
		Distance/Direction:	0.26 MI / NW
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1778
Agency Address:	VEND MART PROPERTY 1035 7TH OAKLAND, CA 946070000		
List Name:	LEAKING TANK		
Site ID:	01-1778		

Map ID  
**23**

VISTA Address*:	<b>RINO PACIFIC OAKLAND TRUCKSTOP</b> 1107 5TH ST OAKLAND, CA 94607	VISTA ID#:	11498426
		Distance/Direction:	0.29 MI / NW
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	RINO PACIFIC OAKLAND TRUCKSTOP 1107 5TH ST OAKLAND, CA		
Facility ID:	01-2322		
Leak Report Date:	2/17/95		
Contamination Confirmed Date:	3/20/98		
Leak Cause:	UNKNOWN		
Leak Source:	PIPING		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 2/16/95 HOW STOPPED: CLOSE TANK ENFORCEMENT ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 8/14/98		

Map ID  
**24**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2322		
Leak Report Date:	02/17/95		
Contamination Confirmed Date:	03/20/98		
Substance:	GASOLINE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #65

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address*:	<b>CALTRANS CYPRESS PROJECT</b> <b>0 5TH ADELINE</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	12639400
		Distance/Direction:	0.35 MI / NW
		Plotted as:	Point


Map ID  
**24**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	<i>CALTRANS CYPRESS PROJECT 0 5TH ADELINE OAKLAND, CA</i>		
Facility ID:	<i>01-2398</i>		
Leak Report Date:	<i>11/1/95</i>		
Contamination Confirmed Date:	<i>11/2/95</i>		
Leak Cause:	<i>UNKNOWN</i>		
Leak Source:	<i>UNKNOWN</i>		
Substance:	<i>DIESEL</i>		
Remediation Event:	<i>STOP DATE:HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:</i>		
Remediation Status:	<i>LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF</i>		
Media Affected:	<i>SOIL ONLY</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET REVIEW DATE: 9/28/98</i>		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	<i>SAME AS ABOVE</i>		
Facility ID:	<i>01-2398</i>		
Leak Report Date:	<i>11/01/95</i>		
Contamination Confirmed Date:	<i>11/02/95</i>		
Substance:	<i>DIESEL</i>		
Remediation Status:	<i>LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF</i>		
Media Affected:	<i>SOIL ONLY</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET REVIEW DATE:</i>		

VISTA Address*:	<b>PGE GAS PLANT OAKLAND 601 2A</b> <b>FIRST WASHINGTON</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	327866
		Distance/Direction:	0.29 MI / SE
		Plotted as:	Point
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD981416191
Agency Address:	<i>SAME AS ABOVE</i>		
Regional Utility Description:	<i>NEW CERCLIS SITE</i>		
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD981416191
Agency Address:	<i>SAME AS ABOVE</i>		
Regional Utility Description:	<i>PGE GAS PLANT SITE</i>		

Map ID  
**25**




**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>NFRAP / SRC# 6475</b>		<b>EPA ID:</b>	CAD981416191
<b>Agency Address:</b>	SAME AS ABOVE		
<b>EPA Region:</b>	9		
<b>Congressional District:</b>	0		
<b>Federal Facility:</b>	Agency Code ( )		
<b>Facility Ownership:</b>	UNKNOWN		
<b>Site Incident Category:</b>	unknown		
<b>Federal Facility Docket:</b>	SITE IS NOT INCLUDED ON THE DOCKET		
<b>NPL Status:</b>	NOT ON NPL		
<b>Incident Type:</b>	Unknown		
<b>Proposed NPL Update #:</b>	0		
<b>Final NPL Update #:</b>	0		
<b>Financial Management System ID:</b>	NOT REPORTED		
<b>Latitude:</b>	0		
<b>Longitude:</b>	0		
<b>Lat/Long Source:</b>	Agency Code ( )		
<b>Lat/Long Accuracy:</b>	Unknown		
<b>Dioxin Tier:</b>	Unknown		
<b>USGS Hydro Unit:</b>	18050004		
<b>RCRA Indicator:</b>	Unknown		
<b>Unit Id:</b>	0		
<b>Unit Name:</b>	ENTIRE SITE		
<b>Type:</b>	DISCOVERY	<b>Lead Agency:</b>	OTHER
<b>Qualifier:</b>	UNKNOWN	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN
<b>Type:</b>	PRELIMINARY ASSESSMENT	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	NO FURTHER REMEDIAL ACTION PLANNED	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN

<b>VISTA Address*:</b>	<b>KTVU</b> 2 JACK LONDON SQUARE OAKLAND, CA 94607	<b>VISTA ID#:</b>	233437
		<b>Distance/Direction:</b>	0.30 MI / SE
		<b>Plotted as:</b>	Point

Map ID  
**25**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	KTVU 2 JACK LONDON SQUARE OAKLAND, CA		
<b>Facility ID:</b>	01-1793		
<b>Leak Report Date:</b>	8/5/93		
<b>Case Closed Date:</b>	4/3/96		
<b>Leak Cause:</b>	UNKNOWN		
<b>Leak Source:</b>	TANK		
<b>Substance:</b>	DIESEL		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #67

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Remediation Event:	STOP DATE: 8/4/93HOW STOPPED: REPAIR TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 8/5/93
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE: 8/7/96

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-1793	
Leak Report Date:	08/05/93	
Case Closed Date:	04/03/96	
Substance:	DIESEL	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE:	

VISTA Address*:	<b>HOUSEWIVES MARKET</b> <b>818 JEFFERSON ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	13567854
		Distance/Direction:	0.30 MI / NE
		Plotted as:	Point


Map ID  
**26**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-2432	
Leak Report Date:	12/12/97	
Contamination Confirmed Date:	01/29/98	
Substance:	GASOLINE	
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF	
Media Affected:	DRINKING WATER WELLS	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE:	

VISTA Address*:	<b>HOUSEWIVES MARKET</b> <b>818 JEFFERSON ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	10829101
		Distance/Direction:	0.30 MI / NE
		Plotted as:	Point

Map ID  
**26**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	EPA/Agency ID:	N/A
Agency Address:	HOUSEWIVES MARKET 818 JEFFERSON ST OAKLAND, CA	
Facility ID:	01-2432	
Leak Report Date:	12/12/97	
Contamination Confirmed Date:	1/29/98	
Leak Cause:	UNKNOWN	
Leak Source:	UNKNOWN	
Substance:	GASOLINE	



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #68

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF
Media Affected:	DRINKING WATER WELLS
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 3/2/99

VISTA Address*:	<b>DOULGAS N SALTER 901 09 JEFFERSON ST OAKLAND, CA 94607</b>	VISTA ID#:	11498920
		Distance/Direction:	0.31 MI / NE
		Plotted as:	Point

Map ID  
**26**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	DOULGAS N SALTER 901 09 JEFFERSON ST OAKLAND, CA		
Facility ID:	01-0236		
Leak Report Date:	4/19/89		
Site Assessment Plan Submitted:	1/11/91		
Case Closed Date:	11/5/96		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 3/19/91HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 12/30/96		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0236		
Leak Report Date:	04/19/89		
Site Assessment Plan Submitted:	01/11/91		
Case Closed Date:	11/05/96		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #69

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**


VISTA Address*:	<b>BRAMALEA USA INC 901 999 JEFFERSON OAKLAND, CA 94607</b>	VISTA ID#:	2745770
		Distance/Direction:	0.34 MI / NE
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0236
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-0236		

Map ID  
**26**

VISTA Address*:	<b>NORCAL METAL FABRICATORS 114 ADELINE ST OAKLAND, CA</b>	VISTA ID#:	5351058
		Distance/Direction:	0.32 MI / W
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1636		
Leak Report Date:	8/30/90		
Site Assessment Began:	2/16/93		
Case Closed Date:	2/14/94		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 8/30/90HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 2/17/94		

Map ID  
**27**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	NORCAL METAL FABRICATORS 114 ADELINE ST OAKLAND, CA 94607		
Facility ID:	01-1636		
Leak Report Date:	08/30/90		
Site Assessment Began:	02/16/93		
Case Closed Date:	02/14/94		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #70

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address*:	<b>SCHNITZER STEEL PRODUCTS CO</b> 1101 W. EMBARCADERO OAKLAND, CA 94607	VISTA ID#:	4924144
		Distance/Direction:	0.33 MI / W
		Plotted as:	Point

Map ID

**27**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SCHNITZER STEEL PRODUCTS COMPANY 1101 EMBARCADERO W OAKLAND, CA		
Facility ID:	01-1798		
Leak Report Date:	11/8/88		
Site Assessment Began:	1/16/95		
Contamination Confirmed Date:	2/3/92		
Case Closed Date:	2/10/96		
Leak Cause:	UNKNOWN		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 11/8/88HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 2/3/92		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 8/7/96		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SCHNITZER STEEL PRODUCTS COMPA 1101 EMBARCADERO W OAKLAND, CA 94607		
Facility ID:	01-1798		
Leak Report Date:	11/08/88		
Site Assessment Began:	01/16/95		
Contamination Confirmed Date:	02/03/92		
Case Closed Date:	02/10/96		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>EXPRESS AUTO SERVICE</b> 333 BROADWAY OAKLAND, CA 94607	VISTA ID#:	8572089
		Distance/Direction:	0.34 MI / E
		Plotted as:	Point

Map ID

**28**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	EXPRESS AUTO SERVICE 333 BROADWAY OAKLAND, CA		
Facility ID:	01-0017		
Leak Report Date:	7/15/92		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #71



**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Site Assessment Began:	7/14/93
Contamination Confirmed Date:	7/15/92
Case Closed Date:	8/27/96
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	WASTE OIL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 7/15/92HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 7/15/92
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 9/3/96

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0017		
Leak Report Date:	07/15/92		
Site Assessment Began:	07/14/93		
Contamination Confirmed Date:	07/15/92		
Case Closed Date:	08/27/96		
Substance:	WASTE OIL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>KAISER HOSPITAL 38TH BROADWAY OAKLAND, CA</b>	VISTA ID#:	6531908
		Distance/Direction:	0.36 MI / SE
		Plotted as:	Point


Map ID  
**29**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0209		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>EMPORIUM-CAPWELL 20TH AND BROADWAY OAKLAND, CA 94612</b>	VISTA ID#:	1257773
		Distance/Direction:	0.36 MI / SE
		Plotted as:	Point

Map ID  
**29**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	EMPORIUM CAPWELL 0 20TH BROADWAY OAKLAND, CA		
Facility ID:	01-0560		
Leak Report Date:	6/6/87		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #72

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Case Closed Date:	10/14/92
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 6/6/87HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 1/26/93


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	EMPORIUM CAPWELL 0 20TH BROADWAY OAKLAND, CA 94612		
Facility ID:	01-0560		
Leak Report Date:	06/06/87		
Case Closed Date:	10/14/92		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>LIVERMORE CITY OF</b> <b>1767 PORTOLA AVE</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	6531852
		Distance/Direction:	0.37 MI / SE
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	LIVERMORE CITY OF 1767 PORTOLA AVE LIVERMORE, CA		
Facility ID:	01S0254		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

Map ID  
**29**

VISTA Address*:	<b>SHELL</b> <b>461 8TH ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	1176601
		Distance/Direction:	0.41 MI / E
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SHELL 461 8TH ST OAKLAND, CA		
Facility ID:	01-1368		
Leak Report Date:	4/16/87		
Site Assessment Began:	1/31/79		
Pollution Characterization Date:	10/31/88		

Map ID  
**30**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #73

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	REMOVE FREE PRODUCT
Remediation Event:	STOP DATE: 4/16/87 HOW STOPPED: CLOSE TANK ENFORCEMENT; WARNING ENFORCEMENT DATE: 7/21/92
Remediation Status:	POLLUTION CHARACTERIZATION
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 1/7/98

VISTA Address*:	<b>SHELL</b> <b>461 8TH ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	12639379
		Distance/Direction:	0.41 MI / E
		Plotted as:	Point


Map ID  
**30**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1368		
Leak Report Date:	04/16/87		
Site Assessment Began:	01/31/79		
Pollution Characterization Date:	10/31/88		
Substance:	GASOLINE		
Remediation Event:	REMOVE FREE PRODUCT		
Remediation Status:	POLLUTION CHARACTERIZATION		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:		

VISTA Address*:	<b>SHELL</b> <b>461 8TH</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	7431026
		Distance/Direction:	0.41 MI / E
		Plotted as:	Point

Map ID  
**30**

<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1368
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1368		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000


Version 2.6.1

Page #74

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address:	<b>NAVAL SUPPLY CENTER, ALAMEDA* W. END CITY OF ALAMEDA AN ALAMEDA, CA 94501</b>	VISTA ID#:	3155019
		Distance	0.42 MI
		Plotted as:	Polygon
CERCLIS / SRC# 6474		EPA ID:	CA4170090597
Agency Address:	NAVAL SUPPLY CENTER, ALAMEDA ANNEX W. END CITY OF ALAMEDA, ANNEX SITE ALAMEDA, CA 94501		
EPA Region:	9		
Congressional District:	0		
Federal Facility:	Agency Code ( )		
Facility Ownership:	FEDERALLY OWNED		
Site Incident Category:	unknown		
Federal Facility Docket:	SITE IS INCLUDED ON THE DOCKET		
NPL Status:	NOT ON NPL		
Incident Type:	Unknown		
Proposed NPL Update #:	0		
Final NPL Update #:	0		
Financial Management System ID:	098K		
Latitude:	0		
Longitude:	0		
Lat/Long Source:	Agency Code ( )		
Lat/Long Accuracy:	Unknown		
Dioxin Tier:	Unknown		
USGS Hydro Unit:	18050004		
RCRA Indicator:	Unknown		
Unit Id:	0		
Unit Name:	SITEWIDE		
Type:	DISCOVERY	Lead Agency:	FEDERAL FACILITIES
Qualifier:	UNKNOWN	Category:	Unknown
Name:	NOT REPORTED	Actual Start Date:	NOT REPORTED
Plan Status:	Unknown	Actual Completion Date:	AUGUST 31, 1991
Type:	PRELIMINARY ASSESSMENT	Lead Agency:	FEDERAL FACILITIES
Qualifier:	LOWER PRIORITY	Category:	Unknown
Name:	NOT REPORTED	Actual Start Date:	NOT REPORTED
Plan Status:	Unknown	Actual Completion Date:	JUNE 16, 1992
Type:	SCREENING SITE INSPECTION	Lead Agency:	FEDERAL FACILITIES
Qualifier:	LOWER PRIORITY	Category:	Unknown
Name:	NOT REPORTED	Actual Start Date:	NOT REPORTED
Plan Status:	Unknown	Actual Completion Date:	JUNE 16, 1992

Map ID  
**31**



**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address*:	<b>CONDOR FREIGHT LINES 324 UNION OAKLAND, CA 94607</b>	VISTA ID#:	7429134
		Distance/Direction:	0.43 MI / W
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1305
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1305		


Map ID  
**32**

VISTA Address*:	<b>CONDON FREIGHT 324 UNION ST OAKLAND, CA 94607</b>	VISTA ID#:	97772
		Distance/Direction:	0.43 MI / W
		Plotted as:	Point

Map ID  
**32**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	CONDOR FREIGHT LINES 324 UNION ST OAKLAND, CA 01-1305		
Facility ID:	01-1305		
Leak Report Date:	4/12/93		
Site Assessment Began:	6/14/95		
Case Closed Date:	11/6/97		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 4/12/93 HOW STOPPED: ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 12/17/98		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	CONDOR FREIGHT LINES 324 UNION ST OAKLAND, CA 94607 01-1305		
Facility ID:	01-1305		
Leak Report Date:	04/12/93		
Site Assessment Began:	06/14/95		
Case Closed Date:	11/06/97		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		



**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01420126
Agency Address:	CONDOR FREIGHT 324 UNION STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	NO FURTHER ACTION FOR DTSC		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>EVERIDGE SERVICE CO</b> 1211 7TH OAKLAND, CA 94607	VISTA ID#:	1238358
		Distance/Direction:	0.45 MI / NW
		Plotted as:	Point

Map ID

**33**


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	EVERIDGE SERVICE COMPANY 1211 7TH ST OAKLAND, CA 01-0741		
Facility ID:	01-0741		
Leak Report Date:	12/1/92		
Leak Cause:	CORROSION		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 10/20/92 HOW STOPPED: CLOSE TANK ENFORCEMENT; WARNING ENFORCEMENT DATE: 3/16/93		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 3/2/98		

VISTA Address*:	<b>EVERIDGE SERVICE COMPANY</b> 1211 7TH ST OAKLAND, CA 94607	VISTA ID#:	13567642
		Distance/Direction:	0.45 MI / NW
		Plotted as:	Point

Map ID

**33**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0741		
Leak Report Date:	12/01/92		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #77

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address*:	<b>WESTERN PACIFIC RAILROAD UNION ST OAKLAND, CA 94607</b>	VISTA ID#:	5286414
		Distance/Direction:	0.46 MI / NW
		Plotted as:	Point

Map ID  
**33**

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01400008
Agency Address:	WESTERN PACIFIC RAILROAD UNION STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	REGIONAL WATER QUALITY CONTROL BOARD		
State Status:	VOLUNTARY CLEANUP		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>ALL MERCEDES DISMANTLERS 1225 7TH OAKLAND, CA 94607</b>	VISTA ID#:	7430952
		Distance/Direction:	0.46 MI / NW
		Plotted as:	Point

Map ID  
**33**


<b>CORTESE / SRC# 4840</b>		Agency ID:	01-1266
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1266		

VISTA Address*:	<b>ALL MERCEDES DISMANTLERS INC 1255 7TH ST OAKLAND, CA 94607</b>	VISTA ID#:	11498440
		Distance/Direction:	0.50 MI / NW
		Plotted as:	Point

Map ID  
**33**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	ALL MERCEDES DISMANTLERS INC 1255 7TH ST OAKLAND, CA		
Facility ID:	01-1266		
Leak Report Date:	10/27/92		
Contamination Confirmed Date:	3/25/93		
Case Closed Date:	6/6/97		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 10/20/92 HOW STOPPED: CLOSE TANK ENFORCEMENT; WARNING ENFORCEMENT DATE: 3/25/93		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 6/18/97		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1266		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #78

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Leak Report Date:	10/27/92
Contamination Confirmed Date:	03/25/93
Case Closed Date:	06/06/97
Substance:	GASOLINE
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:

VISTA Address*:	<b>OAKLAND OEDE CITY OF 12TH ST MARTIN LUTHER KING JR WY OAKLAND, CA</b>	VISTA ID#:	13581220
		Distance/Direction:	0.46 MI / NE
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0375		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		


Map ID  
**34**

VISTA Address*:	<b>CITY CENTER GARAGE WEST SITE 12TH ST JEFFERSON ST OAKLAND, CA</b>	VISTA ID#:	4558440
		Distance/Direction:	0.48 MI / NE
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0343		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

Map ID  
**34**

VISTA Address*:	<b>CAPITOL SUPPLY COMPANY 351 EMBARCADERO OAKLAND, CA 94606</b>	VISTA ID#:	1154977
		Distance/Direction:	0.47 MI / SE
		Plotted as:	Point
<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01500086
Agency Address:	CAPITOL SUPPLY COMPANY 351 EMBARCADERO OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	UNKNOWN		
State Status:	FORMER ANNUAL WORKPLAN SITE, REFERRED TO RCRA		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

Map ID  
**35**






**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

VISTA Address*:	<b>PORT OF OAKLAND EMBARCADERO CV MARINA SITE OAKLAND, CA 94606</b>	VISTA ID#:	335893
		Distance/Direction:	0.47 MI / SE
		Plotted as:	Point
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>PRESTICIDES</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>DRUMS</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>TANKS (NOW DEMOLISHED)</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>NEEDS ACTION</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>WOOD PRESERVING WASTES</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>NOTIS SITE</i>			
<b>Regional CERCLIS / SRC# 2462</b>		EPA ID:	CAD980638670
Agency Address: <i>SAME AS ABOVE</i>			
Regional Utility Description: <i>LOW PRIORITY LSI</i>			
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address: <i>PORT OF OAKLAND 1755 EMBARCADERO E OAKLAND, CA 01-1193</i>			
Facility ID: <i>01-1193</i>			
Leak Report Date: <i>4/11/91</i>			
Leak Cause: <i>STRUCTURE FAILURE</i>			
Leak Source: <i>TANK</i>			
Substance: <i>WASTE OIL</i>			
Remediation Event: <i>NO ACTION TAKEN</i>			
Remediation Event: <i>STOP DATE: 2/14/89HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:</i>			
Remediation Status: <i>PRELIMINARY SITE ASSESSMENT UNDERWAY</i>			
Media Affected: <i>OTHER GROUND WATER</i>			
Lead Agency: <i>LOCAL AGENCY</i>			
Region / District: <i>SAN FRANCISCO BAY RE</i>			
Description / Comment: <i>COUNTY: ALAMEDAXSTREET:REVIEW DATE: 8/8/97</i>			

Map ID

**35**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #80

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>NFRAP / SRC# 6475</b>		<b>EPA ID:</b>	CAD980638670
<b>Agency Address:</b>		SAME AS ABOVE	
<b>Alias Name:</b>		PORT OF OAKLAND	
<b>Alias Street:</b>		VARIOUS LOCATIONS AT PORT	
<b>Alias City:</b>	OAKLAND	<b>Alias Latitude:</b>	0
<b>Alias Zip:</b>	94604	<b>Alias Longitude:</b>	0
<b>Alias State:</b>	CA		
<b>Alias Description:</b>		NOT REPORTED	
<b>EPA Region:</b>	9		
<b>Congressional District:</b>	0		
<b>Federal Facility:</b>	Agency Code ( )		
<b>Facility Ownership:</b>	UNKNOWN		
<b>Site Incident Category:</b>	unknown		
<b>Federal Facility Docket:</b>	SITE IS NOT INCLUDED ON THE DOCKET		
<b>NPL Status:</b>	NOT ON NPL		
<b>Incident Type:</b>	Unknown		
<b>Proposed NPL Update #:</b>	0		
<b>Final NPL Update #:</b>	0		
<b>Financial Management System ID:</b>	NOT REPORTED		
<b>Latitude:</b>	0		
<b>Longitude:</b>	0		
<b>Lat/Long Source:</b>	Agency Code ( )		
<b>Lat/Long Accuracy:</b>	Unknown		
<b>Dioxin Tier:</b>	Unknown		
<b>USGS Hydro Unit:</b>	18050004		
<b>RCRA Indicator:</b>	Unknown		
<b>Unit id:</b>	0		
<b>Unit Name:</b>	ENTIRE SITE		
<b>Type:</b>	DISCOVERY	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	UNKNOWN	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN
<b>Type:</b>	PRELIMINARY ASSESSMENT	<b>Lead Agency:</b>	STATE, FUND FINANCED
<b>Qualifier:</b>	LOWER PRIORITY	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	UNKNOWN
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN
<b>Type:</b>	SCREENING SITE INSPECTION	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	HIGHER PRIORITY	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	UNKNOWN



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #81

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>Type:</b>	SCREENING SITE INSPECTION	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	HIGHER PRIORITY	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	JULY 1, 1990
<b>Type:</b>	SCREENING SITE INSPECTION	<b>Lead Agency:</b>	EPA FUND-FINANCED
<b>Qualifier:</b>	NO FURTHER REMEDIAL ACTION PLANNED	<b>Category:</b>	Unknown
<b>Name:</b>	NOT REPORTED	<b>Actual Start Date:</b>	NOT REPORTED
<b>Plan Status:</b>	Unknown	<b>Actual Completion Date:</b>	OCTOBER 1, 1991

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	PORT OF OAKLAND 1755 EMBARCADERO E OAKLAND, CA 94606		
<b>Facility ID:</b>	01-1193		
<b>Leak Report Date:</b>	04/11/91		
<b>Substance:</b>	WASTE OIL		
<b>Remediation Event:</b>	NO ACTION TAKEN		
<b>Remediation Status:</b>	PRELIMINARY SITE ASSESSMENT UNDERWAY		
<b>Media Affected:</b>	OTHER GROUND WATER		
<b>Lead Agency:</b>	LOCAL AGENCY		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>	COUNTY: ALAMEDA STREET: REVIEW DATE:		

<b>VISTA Address*:</b>	<b>PROJECT REPORT 1155 CLAY ST OAKLAND, CA 94607</b>	<b>VISTA ID#:</b>	6531941
		<b>Distance/Direction:</b>	0.48 MI / NE
		<b>Plotted as:</b>	Point

Map ID  
**36**


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	PROJECT REPORT 1155 CLAY ST OAKLAND, CA		
<b>Facility ID:</b>	0150312		
<b>Remediation Status:</b>	INACTIVE		
<b>Description / Comment:</b>	FAC COUNTY: ALAMEDA		

<b>VISTA Address*:</b>	<b>FIVE CITY CENTER 1300 CLAY OAKLAND, CA 94607</b>	<b>VISTA ID#:</b>	1176262
		<b>Distance/Direction:</b>	0.49 MI / W
		<b>Plotted as:</b>	Point

Map ID  
**37**

<b>CORTESE / SRC# 4840</b>		<b>Agency ID:</b>	01-0642
<b>Agency Address:</b>	FIVE CITY CENTER 1300 CLAY OAKLAND, CA		
<b>List Name:</b>	LEAKING TANK		
<b>Site ID:</b>	01-0642		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	FIVE CITY CENTER 1300 CLAY ST OAKLAND, CA		
<b>Facility ID:</b>	01-0642		
<b>Leak Report Date:</b>	12/8/88		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #82

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Case Closed Date:	6/16/98
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 12/8/88HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 6/16/98

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	FIVE CITY CENTER 1300 CLAY ST OAKLAND, CA 94612		
Facility ID:	01-0642		
Leak Report Date:	12/08/88		
Case Closed Date:	06/16/98		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		

VISTA Address*:	<b>CITY'S AUTO REPAIR</b> <b>330 WEBSTER ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	930249
		Distance/Direction:	0.49 MI / E
		Plotted as:	Point

Map ID  
**38**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	CITY AUTO REPAIR 330 WEBSTER ST OAKLAND, CA		
Facility ID:	01-0421		
Leak Report Date:	5/23/86		
Case Closed Date:	1/10/97		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 5/23/86HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 10/1/97		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #83

**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	CITY AUTO REPAIR 330 WEBSTER ST OAKLAND, CA 94607		
Facility ID:	01-0421		
Leak Report Date:	05/23/86		
Case Closed Date:	01/10/97		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		

VISTA Address*:	<b>SAFETY KLEEN</b> 1147 10TH OAKLAND, CA 94607	VISTA ID#:	7430041
		Distance/Direction:	0.49 MI / NW
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	43-1919
Agency Address:	SAFETY KLEEN 1147 10TH SAN JOSE, CA 94607		
List Name:	LEAKING TANK		
Site ID:	43-1919		


Map ID  
**39**

VISTA Address*:	<b>ALEX SHAW ASSOCIATES</b> 800 FRANKLIN OAKLAND, CA 94607	VISTA ID#:	1142008
		Distance/Direction:	0.49 MI / E
		Plotted as:	Point
<b>CORTESE / SRC# 4840</b>		Agency ID:	01-0056
Agency Address:	ALEX SHAW ASSOCIATES 800 FRANKLIN OAKLAND, CA		
List Name:	LEAKING TANK		
Site ID:	01-0056		

Map ID  
**40**

VISTA Address*:	<b>BILL LOUIE'S AUTO SERVICE</b> 800 FRANKLIN ST OAKLAND, CA 94607	VISTA ID#:	11498791
		Distance/Direction:	0.49 MI / E
		Plotted as:	Point
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	BILL LOUIE'S AUTO SERVICE 800 FRANKLIN ST OAKLAND, CA		
Facility ID:	01-0056		
Leak Report Date:	7/6/89		
Site Assessment Began:	9/12/89		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		

Map ID  
**40**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #84


**SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.**

Remediation Event:	<i>STOP DATE: 7/16/89 SHOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 3/5/92</i>		
Remediation Status:	<i>PRELIMINARY SITE ASSESSMENT UNDERWAY</i>		
Media Affected:	<i>OTHER GROUND WATER</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET: REVIEW DATE: 11/24/97</i>		
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A	
Agency Address:	<i>SAME AS ABOVE</i>		
Facility ID:	<i>01-0056</i>		
Leak Report Date:	<i>07/06/89</i>		
Site Assessment Began:	<i>09/12/89</i>		
Substance:	<i>GASOLINE</i>		
Remediation Event:	<i>EXCAVATE AND DISPOSE</i>		
Remediation Status:	<i>PRELIMINARY SITE ASSESSMENT UNDERWAY</i>		
Media Affected:	<i>OTHER GROUND WATER</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET: REVIEW DATE:</i>		

**SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile)**

VISTA Address*:	<b>SF BAY AREA RAPID TRANSIT DISTRICT 349 MANDELA PARKWAY OAKLAND, CA 94607</b>	VISTA ID#:	7205875
		Distance/Direction:	0.71 MI / NW
		Plotted as:	Point
<b>SPL - State Equivalent Priority List / SRC# 6599</b>		Agency ID:	01750021
Agency Address:	<i>SAME AS ABOVE</i>		
Status:	<i>UNKNOWN</i>		
Facility Type:	<i>NOT AVAILABLE</i>		
Lead Agency:	<i>DEPT OF TOXIC SUBSTANCES CONTROL</i>		
State Status:	<i>ANNUAL WORK PLAN</i>		
Pollutant 1:	<i>UNKNOWN</i>		
Pollutant 2:	<i>UNKNOWN</i>		
Pollutant 3:	<i>UNKNOWN</i>		

Map ID  
**41**



**SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile) CONT.**

VISTA Address*:	<b>FLEET INDUSTRIAL SUPPLY CENTER, ALAMEDA 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501</b>	VISTA ID#:	305050
		Distance/Direction:	0.74 MI / SE
		Plotted as:	Point

Map ID


**42**

<b>CORRACTS / SRC# 6379</b>	EPA ID:	CA1170090012
-----------------------------	---------	--------------

<b>Agency Address:</b>	<i>USNAVY OAKLAND NAVAL SUPPLY CTR ALAMEDA 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501</i>
<b>Prioritization Status:</b>	<i>MEDIUM</i>
<b>RCRA Facility Assessment Completed:</b>	<i>YES</i>
<b>Notice of Contamination:</b>	<i>NO</i>
<b>Determination of need For a RFI (RCRA Facility Investigation):</b>	<i>NO</i>
<b>RFI Imposed:</b>	<i>YES</i>
<b>RFI Workplan Notice of Deficiency Issued:</b>	<i>NO</i>
<b>RFI Workplan Approved:</b>	<i>YES</i>
<b>RFI Report Received:</b>	<i>NO</i>
<b>RFI Approved:</b>	<i>YES</i>
<b>No Further Corrective Action at this Time:</b>	<i>NO</i>
<b>Stabilization Mesasures Evaluation:</b>	<i>YES</i>
<b>CMS (Corrective Measure Study) Imposition:</b>	<i>NO</i>
<b>CMS Workplan Approved:</b>	<i>NO</i>
<b>CMS Report Received:</b>	<i>NO</i>
<b>CMS Approved:</b>	<i>NO</i>
<b>Date for Remedy Selection (CM Imposed):</b>	<i>NO</i>
<b>Corrective Measures Design Approved:</b>	<i>NO</i>
<b>Corrective Measures Investigation Workplan Approved:</b>	<i>NO</i>
<b>Certification of Remedy Completion:</b>	<i>NO</i>
<b>Stabilization Measures Implementation:</b>	<i>YES</i>
<b>Stabilization Measures Completed:</b>	<i>NO</i>
<b>Corrective Action Process Termination:</b>	<i>NO</i>

<b>RCRA-TSD CORRACTS / SRC# 6379</b>	EPA ID:	CA1170090012
--------------------------------------	---------	--------------

<b>Agency Address:</b>	<i>USNAVY OAKLAND NAVAL SUPPLY CTR ALAMEDA 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501</i>
<b>Off-Site Waste Received:</b>	<i>NO</i>
<b>Land Disposal:</b>	<i>NO</i>
<b>Incinerator:</b>	<i>NO</i>
<b>Storage/Treatment:</b>	<i>YES</i>



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #86

**SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile) CONT.**

VISTA Address*:	<b>FLEET INDUSTRIAL SUPPLY C 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501</b>	VISTA ID#:	5286407
		Distance/Direction:	0.74 MI / SE
		Plotted as:	Point
<b>SPL - State Equivalent Priority List / SRC# 6599</b>		Agency ID:	01970007
<b>Agency Address:</b>		<i>FLEET INDUSTRIAL SUPPLY CENTER, ALAM 2155 MARINER SQUARE LOOP ALAMEDA, CA 94501</i>	
<b>Status:</b>		<i>UNKNOWN</i>	
<b>Facility Type:</b>		<i>NOT AVAILABLE</i>	
<b>Lead Agency:</b>		<i>DEPT OF TOXIC SUBSTANCES CONTROL</i>	
<b>State Status:</b>		<i>ANNUAL WORK PLAN</i>	
<b>Pollutant 1:</b>		<i>UNKNOWN</i>	
<b>Pollutant 2:</b>		<i>UNKNOWN</i>	
<b>Pollutant 3:</b>		<i>UNKNOWN</i>	

Map ID

**42**

VISTA Address*:	<b>ALAMEDA NAVAL AIR STA W END CITY OF ALAMEDA ALAMEDA, CA 94501</b>	VISTA ID#:	10281
		Distance	0.79 MI
		Plotted as:	Polygon
<b>NPL - National Priority List / SRC# 6558</b>		EPA ID:	CA2170023236
<b>Agency Address:</b>		<i>ALAMEDA NAVAL AIR STATION CA</i>	
<b>EPA Region:</b>		<i>0</i>	
<b>Congressional District:</b>		<i>0</i>	
<b>Federal Facility:</b>		<i>Agency Code ()</i>	
<b>Facility Ownership:</b>		<i>NOT AVAILABLE</i>	
<b>Site Incident Category:</b>		<i>unknown</i>	
<b>Federal Facility Docket:</b>		<i>Agency Code ()</i>	
<b>NPL Status:</b>		<i>UNKNOWN</i>	
<b>Incident Type:</b>		<i>Unknown</i>	
<b>Proposed NPL Update #:</b>		<i>0</i>	
<b>Final NPL Update #:</b>		<i>0</i>	
<b>Financial Management System ID:</b>		<i>NOT REPORTED</i>	
<b>Latitude:</b>		<i>0</i>	
<b>Longitude:</b>		<i>0</i>	
<b>Lat/Long Source:</b>		<i>Agency Code ()</i>	
<b>Lat/Long Accuracy:</b>		<i>Unknown</i>	
<b>Dioxin Tier:</b>		<i>Unknown</i>	
<b>USGS Hydro Unit:</b>		<i>0</i>	
<b>RCRA Indicator:</b>		<i>Unknown</i>	

Map ID

**43**



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #87



**SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile) CONT.**

VISTA Address*:	<b>ALAMEDA NAVAL AIR STATION 2,616 ACRES IN ALAMEDA, CALIFORNIA ALAMEDA, CA 94501</b>	VISTA ID#:	7005255
		Distance	0.79 MI
		Plotted as:	Polygon

Map ID  
**43**

<b>SPL - State Equivalent Priority List / SRC# 6599</b>		Agency ID:	01970005
Agency Address:	<i>SAME AS ABOVE</i>		
Status:	<i>CURRENTLY ON FINAL NPL</i>		
Facility Type:	<i>NOT AVAILABLE</i>		
Lead Agency:	<i>DEPT OF TOXIC SUBSTANCES CONTROL</i>		
State Status:	<i>ANNUAL WORK PLAN</i>		
Pollutant 1:	<i>UNKNOWN</i>		
Pollutant 2:	<i>UNKNOWN</i>		
Pollutant 3:	<i>UNKNOWN</i>		

VISTA Address*:	<b>USNAVY ALAMEDA NAVAL SUPPLY CENTER ANNEX W. END CITY OF ALAMEDA AN ALAMEDA, CA 94501</b>	VISTA ID#:	4061878
		Distance	0.79 MI
		Plotted as:	Polygon

Map ID  
**43**

<b>CORRACTS / SRC# 6379</b>		EPA ID:	CA2170023236
-----------------------------	--	---------	--------------

Agency Address:	<i>USNAVY ALAMEDA NAVAL AIR STATION W END CITY OF ALAMEDA ALAMEDA, CA 94501</i>		
Prioritization Status:	<i>HIGH</i>		
RCRA Facility Assessment Completed:	<i>YES</i>		
Notice of Contamination:	<i>NO</i>		
Determination of need For a RFI (RCRA Facility Investigation):	<i>NO</i>		
RFI Imposed:	<i>YES</i>		
RFI Workplan Notice of Deficiency Issued:	<i>NO</i>		
RFI Workplan Approved:	<i>YES</i>		
RFI Report Received:	<i>NO</i>		
RFI Approved:	<i>NO</i>		
No Further Corrective Action at this Time:	<i>YES</i>		
Stabilization Mesaures Evaluation:	<i>YES</i>		
CMS (Corrective Measure Study) Imposition:	<i>NO</i>		
CMS Workplan Approved:	<i>YES</i>		
CMS Report Received:	<i>NO</i>		
CMS Approved:	<i>NO</i>		
Date for Remedy Selection (CM Imposed):	<i>NO</i>		
Corrective Measures Design Approved:	<i>NO</i>		
Corrective Measures Investigation Workplan Approved:	<i>NO</i>		
Certification of Remedy Completion:	<i>NO</i>		
Stabilization Measures Implementation:	<i>YES</i>		
Stabilization Measures Completed:	<i>YES</i>		
Corrective Action Process Termination:	<i>NO</i>		




**SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile) CONT.**

<b>RCRA-TSD CORRACTS / SRC# 6379</b>		<b>EPA ID:</b>	<b>CA2170023236</b>
<b>Agency Address:</b>	<i>USNAVY ALAMEDA NAVAL AIR STATION W END CITY OF ALAMEDA ALAMEDA, CA 94501</i>		
<b>Off-Site Waste Received:</b>	<i>NO</i>		
<b>Land Disposal:</b>	<i>NO</i>		
<b>Incinerator:</b>	<i>NO</i>		
<b>Storage/Treatment:</b>	<i>YES</i>		

<b>VISTA Address*:</b>	<b>FLEET INDUSTRIAL SUPPLY CENTER, OAKLAND 541 ACRES EASTERN SHORE OF THE SF ALAMEDA, CA 94501</b>	<b>VISTA ID#:</b>	<b>7005281</b>
		<b>Distance</b>	<b>0.79 MI</b>
		<b>Plotted as:</b>	<b>Polygon</b>

Map ID  
**43**

<b>SPL - State Equivalent Priority List / SRC# 6599</b>		<b>Agency ID:</b>	<b>01420124</b>
<b>Agency Address:</b>	<i>FLEET INDUSTRIAL SUPPLY CENTER, OAKL 541 ACRES; EASTERN SHORE OF THE SF B OAKLAND, CA 94625</i>		
<b>Status:</b>	<i>UNKNOWN</i>		
<b>Facility Type:</b>	<i>NOT AVAILABLE</i>		
<b>Lead Agency:</b>	<i>DEPT OF TOXIC SUBSTANCES CONTROL</i>		
<b>State Status:</b>	<i>ANNUAL WORK PLAN</i>		
<b>Pollutant 1:</b>	<i>UNKNOWN</i>		
<b>Pollutant 2:</b>	<i>UNKNOWN</i>		
<b>Pollutant 3:</b>	<i>UNKNOWN</i>		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #89

**UNMAPPED SITES**

VISTA Address*:	<b>CRYER BOAT YARD PORT OF OAKLAND FORMER</b> 1899 DNNISON ST OAKLAND, CA 94607	VISTA ID#:	7291508
-----------------	---	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	CRYER BOAT YARD PORT OF OAKLAND FORMER 1899 DNNISON ST OAKLAND, CA		
Facility ID:	0150478		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	PORT OF OAKLAND EAST BASIN MARINA 0 JACK LONDON SQUARE OAKLAND, CA		
Facility ID:	0150508		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>CALTRANS</b> 0 6TH CASTRO ST OAKLAND, CA 94607	VISTA ID#:	11498671
-----------------	---	------------	----------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	CALTRANS 0 6TH CASTRO ST OAKLAND, CA		
Facility ID:	01-2345		
Leak Report Date:	8/13/98		
Contamination Confirmed Date:	8/13/98		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 5/12/98		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2345		
Leak Report Date:	08/13/98		
Contamination Confirmed Date:	08/13/98		
Substance:	GASOLINE		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #90

**UNMAPPED SITES CONT.**

VISTA Address*:	<b>OAKLAND INT'L AIRPORT</b> <b>530 WATER ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	6532203
-----------------	---	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	<i>PORT OF OAKLAND HANGER 9 530 WATER ST OAKLAND, CA 01S0300</i>		
Facility ID:	<i>01S0300</i>		
Remediation Status:	<i>INACTIVE</i>		
Description / Comment:	<i>FAC COUNTY: ALAMEDA</i>		

VISTA Address*:	<b>PORT OF OAKLAND</b> <b>530 WATER ST</b> <b>OAKLAND, CA 94607</b>	VISTA ID#:	3205291
-----------------	---	------------	---------

<b>STATE SWLF - Solid Waste Landfill / SRC# 6544</b>		Agency ID:	01-AA-0278
Agency Address:	<i>PORT OF OAKLAND 530 WATER ST. OAKLAND, CA</i>		
Facility Type:	<i>TREATMENT PROCESSING</i>		
Facility Status:	<i>PROPOSED</i>		
Permit Status:	<i>PROPOSED/PLANNED</i>		

VISTA Address*:	<b>OAKLAND CITY OF REDEV GALLERIA</b> <b>0 BROADWAY SAN PABLO</b> <b>OAKLAND, CA 94612</b>	VISTA ID#:	7852664
-----------------	--	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	<i>OAKLAND CITY OF REDEV GALLERIA 0 BROADWAY SAN PABLO OAKLAND, CA</i>		
Facility ID:	<i>01-1076</i>		
Leak Report Date:	<i>9/26/91</i>		
Leak Cause:	<i>STRUCTURE FAILURE</i>		
Leak Source:	<i>TANK</i>		
Substance:	<i>GASOLINE</i>		
Remediation Event:	<i>NO ACTION TAKEN</i>		
Remediation Event:	<i>STOP DATE: 9/26/91 HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:</i>		
Remediation Status:	<i>NO ACTION</i>		
Media Affected:	<i>OTHER GROUND WATER</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET; REVIEW DATE: 1/24/96</i>		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	<i>SAME AS ABOVE</i>		
Facility ID:	<i>01-1076</i>		
Leak Report Date:	<i>09/26/91</i>		
Substance:	<i>GASOLINE</i>		
Remediation Event:	<i>NO ACTION TAKEN</i>		
Remediation Status:	<i>NO ACTION</i>		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #91

**UNMAPPED SITES CONT.**

<b>Media Affected:</b>	OTHER GROUND WATER
<b>Lead Agency:</b>	LOCAL AGENCY
<b>Region / District:</b>	SAN FRANCISCO BAY RE
<b>Description / Comment:</b>	COUNTY: ALAMEDA X STREET: REVIEW DATE:

<b>VISTA Address*:</b>	<b>EASTSHORE LINES INC</b> 2400 ADELINE ST OAKLAND, CA 94607	<b>VISTA ID#:</b>	12639401
------------------------	--	-------------------	----------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	EASTSHORE LINES INC 2400 ADELINE ST OAKLAND, CA		
<b>Facility ID:</b>	01-2413		
<b>Leak Report Date:</b>	6/14/94		
<b>Contamination Confirmed Date:</b>	5/23/94		
<b>Case Closed Date:</b>	3/2/99		
<b>Leak Cause:</b>	SPILL		
<b>Substance:</b>	GASOLINE		
<b>Remediation Event:</b>	EXCAVATE AND DISPOSE		
<b>Remediation Event:</b>	STOP DATE: HOW STOPPED: ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
<b>Remediation Status:</b>	CASE CLOSED		
<b>Media Affected:</b>	OTHER GROUND WATER		
<b>Lead Agency:</b>	LOCAL AGENCY		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>	COUNTY: ALAMEDA X STREET: REVIEW DATE: 4/1/99		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	SAME AS ABOVE		
<b>Facility ID:</b>	01-2413		
<b>Leak Report Date:</b>	06/14/94		
<b>Contamination Confirmed Date:</b>	05/23/94		
<b>Case Closed Date:</b>	03/02/99		
<b>Substance:</b>	GASOLINE		
<b>Remediation Event:</b>	EXCAVATE AND DISPOSE		
<b>Remediation Status:</b>	CASE CLOSED		
<b>Media Affected:</b>	OTHER GROUND WATER		
<b>Lead Agency:</b>	LOCAL AGENCY		
<b>Region / District:</b>	SAN FRANCISCO BAY RE		
<b>Description / Comment:</b>	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

<b>VISTA Address*:</b>	<b>PORT OF OAKLAND MID HARBOR RD</b> EXPANSION MIDDLE HARBOR RD OAKLAND, CA 94607	<b>VISTA ID#:</b>	6532064
------------------------	--	-------------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b>	PORT OF OAKLAND MID HARBOR RD EXPANSION MIDDLE HARBOR RD OAKLAND, CA		
<b>Facility ID:</b>	01S0366		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #92

**UNMAPPED SITES CONT.**

**Remediation Status:** *INACTIVE*  
**Description / Comment:** *FAC COUNTY: ALAMEDA*

<b>VISTA Address*:</b>	<b>1X DELTA HS NETHERLANDS RD SCHOOL ST OAKLAND, CA 94612</b>	<b>VISTA ID#:</b>	1225089


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6443</b>	<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> <i>DELTA HIGH SCHOOL NEATHERLANDS RD CLARKSBURG, CA</i>		
<b>Substance:</b> <i>GASOLINE</i>		
<b>Remediation Status:</b> <i>CASE CLOSED</i>		
<b>Media Affected:</b> <i>SOIL ONLY</i>		
<b>Description / Comment:</b> <i>COUNTY: YOLO</i>		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> <i>DELTA HIGH SCHOOL NEATHERLANDS RD CLARKSBURG, CA 94612</i>		
<b>Facility ID:</b> <i>570123</i>		
<b>Leak Report Date:</b> <i>07/24/90</i>		
<b>Case Closed Date:</b> <i>08/18/88</i>		
<b>Substance:</b> <i>GASOLINE</i>		
<b>Remediation Status:</b> <i>CASE CLOSED</i>		
<b>Media Affected:</b> <i>SOIL ONLY</i>		
<b>Lead Agency:</b> <i>LOCAL AGENCY</i>		
<b>Region / District:</b> <i>CENTRAL VALLEY REGIO</i>		
<b>Description / Comment:</b> <i>COUNTY: YOLO STREET: REVIEW DATE:</i>		

<b>VISTA Address*:</b>	<b>MACAULAY FOUNDRY INC 811 CARELTON ST OAKLAND, CA 94607</b>	<b>VISTA ID#:</b>	5707592

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>	<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> <i>MACAULAY FOUNDRY INC 811 CARELTON ST BERKELEY, CA</i>		
<b>Facility ID:</b> <i>01S0066</i>		
<b>Remediation Status:</b> <i>INACTIVE</i>		
<b>Description / Comment:</b> <i>FAC COUNTY: ALAMEDA</i>		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>	<b>EPA/Agency ID:</b>	N/A
<b>Agency Address:</b> <i>SCHNITZER STEEL PRDCTS HOWARD TERMINAL ADELINE ST OAKLAND, CA</i>		
<b>Facility ID:</b> <i>01S0067</i>		
<b>Remediation Status:</b> <i>ACTIVE</i>		
<b>Description / Comment:</b> <i>FAC COUNTY: ALAMEDA</i>		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #93

**UNMAPPED SITES CONT.**


VISTA Address*:	<b>CALTRANS RECONSTRUCTION PROJECT</b> 1 880 CYPRESS OAKLAND, CA 94607	VISTA ID#:	6531956
-----------------	--	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	CALTRANS RECONSTRUCTION PROJECT 1 880 CYPRESS OAKLAND, CA		
Facility ID:	0150372		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>ASHLAND OIL</b> 0 FERRY PETROLEUM OAKLAND, CA 94607	VISTA ID#:	7852188
-----------------	--	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	ASHLAND OIL 0 FERRY PETROLEUM OAKLAND, CA		
Facility ID:	01-2327		
Leak Report Date:	7/6/87		
Site Assessment Began:	4/25/88		
Case Closed Date:	5/19/93		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND TREAT		
Remediation Event:	STOP DATE: 8/1/87HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 8/7/96		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2327		
Leak Report Date:	07/06/87		
Site Assessment Began:	04/25/88		
Case Closed Date:	05/19/93		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND TREAT		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #94

**UNMAPPED SITES CONT.**


VISTA Address*:	<b>CYPRESS FREEWAY-3RD STREET SOUNDWALL 2RD STREET BETWEEN CENTER AND PERALT OAKLAND, CA 94607</b>	VISTA ID#:	7006266

<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01400012
Agency Address:	SAME AS ABOVE		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	CERTIFIED		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		

VISTA Address*:	<b>SF OAKLAND BAY BRIDGE 0 BAY BRIDGE TOLL PLAZ OAKLAND, CA 94607</b>	VISTA ID#:	7850401

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SF OAKLAND BAY BRIDGE 0 BAY BRIDGE TOLL PLAZ OAKLAND, CA		
Facility ID:	01-2286		
Leak Report Date:	9/11/96		
Contamination Confirmed Date:	3/16/98		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 4/19/95HOW STOPPED: NEW TANKENFORCEMENT:ENFORCEMENT DATE:		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 11/20/96		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SF OAKLAND BAY BRIDGE 0 BAY BRIDGE TOLL PLAZ OAKLAND, CA 94623		
Facility ID:	01-2286		
Leak Report Date:	09/11/96		
Contamination Confirmed Date:	03/16/98		
Substance:	GASOLINE		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #95



**UNMAPPED SITES CONT.**

VISTA Address*:	<b>MANDELA PARKWAY CORRIDOR MANDELA PARKWAY BETWEEN 34TH AND 8TH OAKLAND, CA 94607</b>	VISTA ID#:	7430994
<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01410118
Agency Address:	SAME AS ABOVE		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	VOLUNTARY CLEANUP		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		
VISTA Address*:	<b>OAKLAND NATIONAL ENGRAVES 41ST AVE ADELINE ST OAKLAND, CA 94607</b>	VISTA ID#:	6531878
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	OAKLAND NATIONAL ENGRAVES 41ST AVE ADELINE ST OAKLAND, CA		
Facility ID:	01S0332		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	PACIFIC STATES STEEL 35124 ALVARADO NLES RD UNION CITY, CA		
Facility ID:	01S0331		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
VISTA Address*:	<b>SO. PRESCOTT NEIGHBORHOOD PARK 3RD ST OAKLAND, CA 94607</b>	VISTA ID#:	6531860
<b>SCL - State Equivalent CERCLIS List / SRC# 6598</b>		Agency ID:	01990019
Agency Address:	SO. PRESCOTT NEIGHBORHOOD PARK 3RD STREET OAKLAND, CA 94607		
Status:	UNKNOWN		
Facility Type:	NOT AVAILABLE		
Lead Agency:	DEPT OF TOXIC SUBSTANCES CONTROL		
State Status:	VOLUNTARY CLEANUP		
Pollutant 1:	UNKNOWN		
Pollutant 2:	UNKNOWN		
Pollutant 3:	UNKNOWN		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901


Date of Report: January 25, 2000

Version 2.6.1

Page #96

**UNMAPPED SITES CONT.**

VISTA Address*:	<b>VANCANT LOT 11TH ST OAKLAND, CA 94607</b>	VISTA ID#:	5350097
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	VANCANT LOT 0 11TH ST OAKLAND, CA		
Facility ID:	01-1549		
Leak Report Date:	2/16/88		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 2/16/88HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 1/24/96		
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	VANCANT LOT 0 11TH ST OAKLAND, CA 94607		
Facility ID:	01-1549		
Leak Report Date:	02/16/88		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		
VISTA Address*:	<b>PORT OF OAKLAND REDEVELOPMENT PROJET BERTHS 30 31 OAKLAND, CA 94607</b>	VISTA ID#:	7291571
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	PORT OF OAKLAND REDEVELOPMENT PROJET BERTHS 30 31 OAKLAND, CA		
Facility ID:	01S0224		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	PORT OF OAKLAND LANA KAI MARINA LANA KAI MARINA OAKLAND, CA		
Facility ID:	01S0225		
Remediation Status:	INACTIVE		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #97

**UNMAPPED SITES CONT.**

Description / Comment: *FAC COUNTY: ALAMEDA*

VISTA Address*:	<b>OAKLAND ARMY BASE BLDG 807 OAKLAND, CA 94607</b>	VISTA ID#:	6531771
-----------------	---	------------	---------

**STATE LUST - State Leaking Underground Storage Tank / SRC# 6596** EPA/Agency ID: N/A

Agency Address: *OAKLAND ARMY BASE  
BLDG 807  
OAKLAND, CA  
01S0239*

Facility ID: *01S0239*

Remediation Status: *INACTIVE*

Description / Comment: *FAC COUNTY: ALAMEDA*

VISTA Address*:	<b>ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA 94501</b>	VISTA ID#:	12713937
-----------------	--	------------	----------

**STATE LUST - State Leaking Underground Storage Tank / SRC# 6545** EPA/Agency ID: N/A

Agency Address: *SAME AS ABOVE*

Facility ID: *01-0050*

Leak Report Date: *07/27/87*

Substance: *MISC MOTOR VEHICLE FUELS*

Remediation Event: *NO ACTION TAKEN*

Remediation Status: *NO ACTION*

Media Affected: *UNDEFINED*

Lead Agency: *LOCAL AGENCY*

Region / District: *SAN FRANCISCO BAY RE*

Description / Comment: *COUNTY: ALAMEDA X STREET REVIEW DATE:*

VISTA Address*:	<b>NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA 94501</b>	VISTA ID#:	12713938
-----------------	---	------------	----------

**STATE LUST - State Leaking Underground Storage Tank / SRC# 6545** EPA/Agency ID: N/A

Agency Address: *SAME AS ABOVE*

Facility ID: *01-1035*

Leak Report Date: *07/28/86*

Site Assessment Began: *12/30/85*

Substance: *MISC MOTOR VEHICLE FUELS*

Remediation Event: *NO ACTION TAKEN*


Remediation Status: *PRELIMINARY SITE ASSESSMENT UNDERWAY*

Media Affected: *OTHER GROUND WATER*

Lead Agency: *LOCAL AGENCY*

Region / District: *SAN FRANCISCO BAY RE*

Description / Comment: *COUNTY: ALAMEDA X STREET REVIEW DATE:*



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1


Page #98

**UNMAPPED SITES CONT.**

VISTA Address*:	<b>ALAMEDA NAS NAVY</b> <b>ALAMEDA, CA</b>	VISTA ID#:	13580452
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0001		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>GALLAGHER BURKE INC</b> <b>7100 BOUNTAIN BLVD</b> <b>OAKLAND, CA 94623</b>	VISTA ID#:	247661
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	GALLAGHER BURKE 7100 MOUNTAIN BLVD OAKLAND, CA		
Facility ID:	01-1236		
Leak Report Date:	10/22/92		
Contamination Confirmed Date:	12/23/92		
Case Closed Date:	6/1/95		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 10/22/93HOW STOPPED: CLOSE TANKENFORCEMENT. WARNINGENFORCEMENT DATE: 12/23/92		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 7/3/95		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	GALLAGHER BURKE 7100 MOUNTAIN BLVD OAKLAND, CA 94605		
Facility ID:	01-1236		
Leak Report Date:	10/22/92		
Contamination Confirmed Date:	12/23/92		
Case Closed Date:	06/01/95		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #99


**UNMAPPED SITES CONT.**

VISTA Address*:	<b>NAVAL SUPPLY CENTER ALAMEDA ANNEX DOD ALAMEDA, CA</b>	VISTA ID#:	13580828
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0196		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>SPT CO LOCO FUEL PLANT WD01 04 0 PINE ST FOOT OF OAKLAND, CA 94607</b>	VISTA ID#:	12640017
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SPT CO LOCO FUEL PLANT WD01 04 0 PINE ST FOOT OF OAKLAND, CA		
Facility ID:	01-2426		
Leak Report Date:	6/28/88		
Contamination Confirmed Date:	1/28/98		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	DRINKING WATER WELLS		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 9/30/98		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2426		
Leak Report Date:	06/28/88		
Contamination Confirmed Date:	01/28/98		
Substance:	GASOLINE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	DRINKING WATER WELLS		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	<b>NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA</b>	VISTA ID#:	12666650
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1035		
Leak Report Date:	7/28/86		
Site Assessment Began:	12/30/85		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #100

**UNMAPPED SITES CONT.**

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	MISC MOTOR VEHICLE FUELS
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 7/28/86HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE: 8/24/94

VISTA Address*:	<b>ALAMEDA NAVAL AIR STATION</b> <b>0 UNKNOWN</b> <b>ALAMEDA, CA</b>	VISTA ID#:	12666629
-----------------	--	------------	----------


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0050		
Leak Report Date:	7/27/87		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	MISC MOTOR VEHICLE FUELS		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 7/27/87HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDAXSTREET.REVIEW DATE: 8/24/94		

VISTA Address*:	<b>ROADWAY EXPRESS,INC</b> <b>1125 27TH AVE</b> <b>OAKLAND, CA</b>	VISTA ID#:	7291475
-----------------	--	------------	---------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0449		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	<b>UPTOWN THEATER DISTRICT</b> <b>OAKLAND, CA</b>	VISTA ID#:	13581007
-----------------	--	------------	----------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0520		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #101

**UNMAPPED SITES CONT.**

VISTA Address*:	<b>HAYWARD LIMITED</b> 30104 INDUSTRIAL PKWY SW HAYWARD, CA	VISTA ID#:	7291068
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0493		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
VISTA Address*:	<b>OH OLSEN</b> 2220 4TH ST BERKELEY, CA	VISTA ID#:	7291419
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0490		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
VISTA Address*:	<b>OAKLAND INTERNATIONAL AIRPORT</b> OAKLAND INTERNATIONAL AIRPORT OAKLAND, CA	VISTA ID#:	7291755
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0487		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
VISTA Address*:	<b>YERBA BUENA PROJECT</b> OAKLAND, CA	VISTA ID#:	13581050
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0347		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		
VISTA Address*:	<b>7</b> 0 L 827 TRACON OAKLAND, CA	VISTA ID#:	12667122
<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0606		
Leak Report Date:	7/30/91		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #102

**UNMAPPED SITES CONT.**

Remediation Event:	STOP DATE: 7/30/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TANK ENFORCEMENT DATE:
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 10/9/91


<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>	EPA/Agency ID:	N/A
Agency Address:	7 0 L 827 TRACON OAKLAND, CA 94621	
Facility ID:	01-0606	
Leak Report Date:	07/30/91	
Substance:	DIESEL	
Remediation Event:	NO ACTION TAKEN	
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:	

VISTA Address*:	<b>EAST BAY REGIONAL PARK DISTRICT</b> <b>0 TILDEN PARK</b> <b>OAKLAND, CA</b>	VISTA ID#:	12667445
-----------------	--	------------	----------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-0534	
Leak Report Date:	3/24/88	
Case Closed Date:	7/26/88	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	MISC MOTOR VEHICLE FUELS	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 3/24/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TANK ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	UNDEFINED	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 7/26/88	

VISTA Address*:	<b>UNION POINT WATERFRONT PARK</b> <b>2301 EMBARCADERO</b> <b>OAKLAND, CA</b>	VISTA ID#:	12714405
-----------------	---	------------	----------

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6596</b>	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01S0521	
Remediation Status:	ACTIVE	



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.5.1

Page #103




**UNMAPPED SITES CONT.**

**Description / Comment:** FAC COUNTY: ALAMEDA

VISTA Address*:	EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA	VISTA ID#:	12666907

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6428</b>		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1990		
Leak Report Date:	8/10/94		
Contamination Confirmed Date:	1/25/96		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	KEROSENE		
Remediation Event:	STOP DATE: 7/22/94 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 2/24/98		

<b>STATE LUST - State Leaking Underground Storage Tank / SRC# 6545</b>		EPA/Agency ID:	N/A
Agency Address:	EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA 94607		
Facility ID:	01-1990		
Leak Report Date:	08/10/94		
Contamination Confirmed Date:	01/25/96		
Substance:	KEROSENE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		



\* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Date of Report: January 25, 2000

Version 2.6.1

Page #104

# SITE ASSESSMENT PLUS REPORT

## DESCRIPTION OF DATABASES SEARCHED

### A) DATABASES SEARCHED TO 1 MILE

**NPL**  
**SRC#: 6558** VISTA conducts a database search to identify all sites within 1 mile of your property.  
**The agency release date for NPL was December, 1999.**

The National Priorities List (NPL) is the EPA's database of uncontrolled or abandoned hazardous waste sites identified for priority remedial actions under the Superfund program. A site must meet or surpass a predetermined hazard ranking system score, be chosen as a state's top priority site, or meet three specific criteria set jointly by the US Dept of Health and Human Services and the US EPA in order to become an NPL site.

**SPL**  
**SRC#: 6599** VISTA conducts a database search to identify all sites within 1 mile of your property.  
**The agency release date for Calsites Database: Annual Workplan Sites was October, 1999.**

This database is provided by the Cal. Environmental Protection Agency, Dept. of Toxic Substances Control. The agency may be contacted at: 916-323-3400.

**CORRACTS**  
**SRC#: 6379** VISTA conducts a database search to identify all sites within 1 mile of your property.  
**The agency release date for HWDMS/RCRIS was September, 1999.**

The EPA maintains this database of RCRA facilities which are undergoing "corrective action". A "corrective action order" is issued pursuant to RCRA Section 3008 (h) when there has been a release of hazardous waste or constituents into the environment from a RCRA facility. Corrective actions may be required beyond the facility's boundary and can be required regardless of when the release occurred, even if it predates RCRA.

### B) DATABASES SEARCHED TO 1/2 MILE

**CERCLIS**  
**SRC#: 6474** VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for CERCLIS was October, 1999.**

The CERCLIS List contains sites which are either proposed to or on the National Priorities List(NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL. The information on each site includes a history of all pre-remedial, remedial, removal and community relations activities or events at the site, financial funding information for the events, and unrestricted enforcement activities.

**Cal Cerclis**  
**SRC#: 2462** VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for Ca Cerclis w/Regional Utility Description was June, 1995.**

This database is provided by the U.S. Environmental Protection Agency, Region 9. The agency may be contacted at: . These are regional utility descriptions for California CERCLIS sites.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Version 2.6.1

Date of Report: January 25, 2000

Page #105

**NFRAP**  
**SRC#: 6475**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for CERCLIS-NFRAP was October, 1999.**

NFRAP sites may be sites where, following an initial investigation, no contamination was found, contamination was removed quickly, or the contamination was not serious enough to require Federal Superfund action or NPL consideration.

**SCL**  
**SRC#: 6598**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for Calsites Database: All Sites except Annual Workplan Sites (incl. ASPIS) was October, 1999.**

This database is provided by the Department of Toxic Substances Control. The agency may be contacted at: .

The CalSites database includes both known and potential sites. Two-thirds of these sites have been classified, based on available information, as needing "No Further Action" (NFA) by the Department of Toxic Substances Control. The remaining sites are in various stages of review and remediation to determine if a problem exists at the site. Several hundred sites have been remediated and are considered certified. Some of these sites may be in long term operation and maintenance.

**RCRA-TSD**  
**SRC#: 6379**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for HWDMS/RCRIS was September, 1999.**

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA TSDs are facilities which treat, store and/or dispose of hazardous waste.

**SWLF**  
**SRC#: 5945**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for City of Los Angeles Landfills was April, 1999.**


This database is provided by the City of Los Angeles, Environmental Affairs Department. The agency may be contacted at: 213-580-1070.

**SWLF**  
**SRC#: 6544**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for Ca Solid Waste Information System (SWIS) was November, 1999.**

This database is provided by the Integrated Waste Management Board. The agency may be contacted at: 916-255-4021.

The California Solid Waste Information System (SWIS) database consists of both open as well as closed and inactive solid waste disposal facilities and transfer stations pursuant to the Solid Waste Management and Resource Recovery Act of 1972, Government Code Section 2.66790(b). Generally, the California Integrated Waste Management Board learns of locations of disposal facilities through permit applications and from local enforcement agencies.



**WMUDS**  
**SRC#: 5857**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Waste Management Unit Database System (WMUDS) was February, 1999.**

This database is provided by the State Water Resources Control Board. The agency may be contacted at: 916-892-0323. This is used for program tracking and inventory of waste management units. This system contains information from: Facility, Waste Management Unit, SWAT Program and Report Summary Information, Chapter 15 (formerly Subchapter 15), TPCA and RCRA Program Information, Closure Information; also some information from the WDS (Waste Discharge System).

The WMUDS system also accesses information from the following databases from the Waste Discharge System (WDS): Inspections, Violations, and Enforcements. The sites contained in these databases are subject to the California Code of Regulations - Title 23. Waters.

**LUST RG6**  
**SRC#: 6275**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Lahontan Region LUST List was August, 1999.**

This database is provided by the Lahontan Region Six South Lake Tahoe. The agency may be contacted at: 530-542-5400.

**LUST RG2**  
**SRC#: 6428**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Region #2-San Francisco Bay Fuel Leaks List was September, 1999.**

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: 510-286-1269.

**LUST RG5**  
**SRC#: 6443**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Region #5-Central Valley Underground Tank Tracking System was September, 1999.**

This database is provided by the Regional Water Quality Control Board, Region #5. The agency may be contacted at: 916-255-3125.

**LUST**  
**SRC#: 6527**


VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Region #5-Central Valley SLIC\DOD\DOE List was September, 1999.**

This database is provided by the Regional Water Quality Control Board, Region #5. The agency may be contacted at: 916-255-3000.

**LUST**  
**SRC#: 6545**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Lust Information System (LUSTIS) was October, 1999.**

This database is provided by the California Environmental Protection Agency. The agency may be contacted at: 916-445-6532.



**LUST**  
**SRC#: 6596**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Region #2-North and South Bay SLIC Report was November, 1999.**

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: 510-286-1269.

**CORTESE**  
**SRC#: 4840**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Cortese List-Hazardous Waste Substance Site List was April, 1998.**

This database is provided by the Office of Environmental Protection, Office of Hazardous Materials. The agency may be contacted at: 916-445-6532.

The California Governor's Office of Planning and Research annually publishes a listing of potential and confirmed hazardous waste sites throughout the State of California under Government Code Section 65962.5. This database (CORTESE) is based on input from the following: (1)CALSTES-Department of Toxic Substances Control, Abandoned Sites Program Information Systems; (2)SARA Title III Section III Toxic Chemicals Release Inventory for 1987, 1988, 1989, and 1990; (3)FINDS; (4)HWIS-Department of Toxic Substances Control, Hazardous Waste Information System. Vista has not included one time generator facilities from Cortese in our database.; (5)SWRCB-State Water Resources Control Board; (6)SWIS-Integrated Waste Management Control Board (solid waste facilities); (7)AGT25-Air Resources Board, dischargers of greater than 25 tons of criteria pollutants to the air; (8)A1025-Air Resources Board, dischargers of greater than 10 and less than 25 tons of criteria pollutants to the air; (9)LTANK-SWRCB Leaking Underground Storage Tanks; (10)UTANK-SWRCB Underground tanks reported to the SWEEPS systems; (11)IUR-Inventory Update Rule (Chemical Manufacturers); (12)WB-LF- Waste Board - Leaking Facility, site has known migration; (13)WDSE-Waste Discharge System - Enforcement Action; (14)DTSCD-Department of Toxic Substance Control Docket.

**Deed**  
**Restrictions**  
**SRC#: 1703**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for Deed Restriction Properties Report was April, 1994.**

This database is provided by the Department of Health Services-Land Use and Air Assessment. The agency may be contacted at: 916-255-2014. These are voluntary deed restriction agreements with owners of property who propose building residences, schools, hospitals, or day care centers on property that is "on or within 2,000 feet of a significant disposal of hazardous waste".

California has a statutory and administrative procedure under which the California Department of Health Services (DHS) may designate real property as either a "Hazardous Waste Property" or a "Border Zone Property" pursuant to California Health Safety Code Sections 25220-25241. Hazardous Waste Property is land at which hazardous waste has been deposited, creating a significant existing or potential hazard to public health and safety. A Border Zone Property is one within 2,000 feet of a hazardous waste deposit. Property within either category is restricted in use, unless a written variance is obtained from DHS. A Hazardous Waste Property designation results in a prohibition of new uses, other than a modification or expansion of an industrial or manufacturing facility on land previously owned by the facility prior to January 1, 1981. A Border Zone Property designation results in prohibition of a variety of uses involving human habitation, hospitals, schools and day care center.



For more information call VISTA Information Solutions, Inc. at **1 - 800 - 767 - 0403.**

Report ID: **882501901**

Date of Report: **January 25, 2000**

Version 2.6.1

Page #108

**Toxic Pits**  
**SRC#: 2229**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for Summary of Toxic Pits Cleanup Facilities was February, 1995.**

This database is provided by the Water Quality Control Board, Division of Loans Grants.  
The agency may be contacted at: 916-227-4396.

**North Bay**  
**SRC#: 1718**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for North Bay County Toxic List-Region #2 Surface Spills was April, 1994.**

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: .

**South Bay**  
**SRC#: 1719**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for South Bay Site Management System was April, 1994.**

This database is provided by the San Francisco Bay Region. The agency may be contacted at: .

**Water Wells**  
**SRC#: 5384**

VISTA conducts a database search to identify all sites within 1/2 mile of your property.  
**The agency release date for USGS WATER WELLS was March, 1998.**

The Ground Water Site Inventory (GWSI) database was provided by the United States Geological Survey (USGS). The database contains information for over 1,000,000 wells and other sources of groundwater which the USGS has studied, used, or otherwise had reason to document through the course of research. The agency may be contacted at 703-648-6819.

#### **C) DATABASES SEARCHED TO 1/4 MILE**


**RCRA-Viols/Enf** VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for HWDMS/RCRIS was September, 1999.**

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Violators are facilities which have been cited for RCRA Violations at least once since 1980. RCRA Enforcements are enforcement actions taken against RCRA violators.

**UST's**  
**SRC#: 1612**

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for Underground Storage Tank Registrations Database was January, 1994.**

This database is provided by the State Water Resources Control Board, Office of Underground Storage Tanks. The agency may be contacted at: 916-227-4364;  
Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 882501901

Version 2.6.1

Date of Report: January 25, 2000

Page #109

UST's  
SRC#: 5275

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for Alameda County UST List was September, 1998.**

This database is provided by the Department of Environmental Health. The agency may be contacted at: 510-567-6700; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 5674

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of San Leandro UST Listing was January, 1999.**

This database is provided by the San Leandro Fire Department. The agency may be contacted at: 510-577-3331; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 6115

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of Union Underground Storage Tanks List was July, 1999.**

This database is provided by the Union City Fire Department. The agency may be contacted at: 510-471-1424; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 6249

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of Oakland Underground Storage Tank List was April, 1999.**

This database is provided by the City of Oakland Fire Department, Office of Emergency Services. The agency may be contacted at: 510-238-3938; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 6430

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of Berkeley UST List was August, 1999.**

This database is provided by the City of Berkeley. The agency may be contacted at: 510-705-8152; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 6529

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of Hayward UST Report was September, 1999.**

This database is provided by the City of Hayward Fire Department. The agency may be contacted at: 510-583-4900; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's  
SRC#: 6535

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for City of Livermore and City of Pleasanton UST List was October, 1999.**

This database is provided by the City of Livermore Fire Department. The agency may be contacted at: 925-454-2361; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.



AST's  
SRC#: 5513

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for Aboveground Storage Tank Database was December, 1998.**

This database is provided by the State Water Resources Control Board. The agency may be contacted at: 916-227-4364.

TRIS  
SRC#: 4946

VISTA conducts a database search to identify all sites within 1/4 mile of your property.  
**The agency release date for TRIS was January, 1998.**

Section 313 of the Emergency Planning and Community Right-to-Know Act (also known as SARA Title III) of 1986 requires the EPA to establish an inventory of Toxic Chemicals emissions from certain facilities (Toxic Release Inventory System). Facilities subject to this reporting are required to complete a Toxic Chemical Release Form (Form R) for specified chemicals.

#### D) DATABASES SEARCHED TO 1/8 MILE

ERNS  
SRC#: 6181

VISTA conducts a database search to identify all sites within 1/8 mile of your property.  
**The agency release date for ERNS was August, 1999.**

The Emergency Response Notification System (ERNS) is a national database containing records from October 1986 to the release date above and is used to collect information for reported releases of oil and hazardous substances. The database contains information from spill reports made to federal authorities including the EPA, the US Coast Guard, the National Response Center and the Department of Transportation. The ERNS hotline number is (202) 260-2342.

RCRA-LgGen  
SRC#: 6379

VISTA conducts a database search to identify all sites within 1/8 mile of your property.  
**The agency release date for HWDMS/RCRIS was September, 1999.**


The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Large Generators are facilities which generate at least 1000 kg./month of non-acutely hazardous waste (or 1 kg./month of acutely hazardous waste).

RCRA-SmGen  
SRC#: 6379

VISTA conducts a database search to identify all sites within 1/8 mile of your property.  
**The agency release date for HWDMS/RCRIS was September, 1999.**

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Small and Very Small generators are facilities which generate less than 1000 kg./month of non-acutely hazardous waste.

End of Report





### **Additional Regulatory Agency Lists Information**

**U.S. EPA, Federal Superfund Liens List and the U.S. EPA California Liens:** The Liens Lists identify properties for which liens have been filed pursuant to CERCLA. The Liens Lists were reviewed to determine if the subject site or properties within a mile radius of the subject site are listed.

**California Environmental Protection Agency (Cal-EPA), Voluntary Clean-up Program:** This list locates and describe contaminated sites within California that are undergoing voluntary remediation. The Voluntary Clean-up Program List was reviewed to determine if the subject site or properties within a mile radius of the subject site are listed.

**Cal-EPA, Recorded Deed Restriction List (RDR):** Environmental Science and Support Unit of the Cal-EPA, DTSC has compiled a list, last published in April 1994, of properties for which land use restrictions have been recorded. The RDR was reviewed to determine if the subject site or properties within a mile radius of the subject site are listed.

**The Munger Map Book California - Alaska Oil and Gas Fields Munger Maps:** The Munger Map Book shows the location of producing oil and gas wells as well as the location of plugged and abandoned dry holes. The Munger map was reviewed to determine if producing oil and gas wells or plugged and abandoned dry holes are located on or within a half mile radius of the subject site.