



May 18, 1998

Mr. Edward E. Phillips, P.E.
Law Offices of HPS&S: Oliver Properties
22320 Foothill Blvd., suite 620
Hayward, CA 94541

Subject: UNDERGROUND STORAGE TANK CLOSURE REPORT
LOCATED AT 28905 HESPERIAN BOULEVARD, HAYWARD, CA, 94545

This report presents the results of underground storage tank (UST) removal activities performed by DECON Environmental Services, Inc., (DECON) at the Farm Equipment Maintenance Building located 28905 Hesperian Blvd., Hayward, CA. (the Site). The following sections of this report include descriptions of Site background information, field activities, and the results of laboratory analysis of soil samples collected during field activities. Attached to this report are diagrams illustrating the location of UST, other Site features, and soil samples. Additional attachments include: UST removal permit, UST waste manifest, and laboratory analytical results.

SITE BACKGROUND INFORMATION

The background information presented here was provided by Mr. Ed Phillips, P.E. Operations at the Farm Equipment Maintenance Building at the Site included, dispensing unleaded gasoline. The site is currently operational. In April 1998, DECON was retained by the Law Offices of HPS&P to excavate and dispose of one UST-1 (500 gallon capacity) at the Site, previously contained unleaded gasoline. The location of the UST is illustrated on the attached enclosures.

FIELD ACTIVITIES

Prior to commencing field activities, DECON applied for and received Underground Storage Tank Removal Permit from the Alameda County Fire Department, (ACFD).

DECON performed field activities during April, 1998. DECON mobilized a qualified field crew and equipment, including a backhoe. Prior to beginning excavating operations all remaining unleaded gasoline was removed from UST-1. Approximately 15 gallons of unleaded gasoline was pumped from UST-1 into DOT approved drums for shipping off-Site for disposal. The inside of UST-1 was cleaned using a biodegradable degreasing agent and a pressure washer. Approximately 70 gallons of rinseate was collected in DOT approved drums. All liquid waste drums were shipped off-site for hazardous waste recycling. The concrete surface above the UST was demolished with a jackhammer and stockpiled using the backhoe. The soil above UST-1 was excavated with the backhoe and the tops of the UST was exposed. The excavated soil was placed on and covered with black plastic sheeting (visqueen).

Prior to removal the atmosphere inside UST-1 was inerted with 15 lb. of dry ice to displace oxygen and flammable vapors that may have been present in the UST. Under observation of the Alameda County Fire Department, represented by Mr. Nick Chimento, Fire Inspector, DECON measured the Lower Explosive Limit (LEL) and oxygen content (O₂) using a portable GASTECH, model 3220. The LEL and O₂ were within the limits set by the ACFD.

On April 30, 1998, with ACFD approval, UST-1 was removed from the excavation with the backhoe and loaded onto a flatbed truck, licensed to haul hazardous waste in California.

FIELD ACTIVITIES: continued

The one 500 gallon unleaded gasoline tank, UST-1 was given a new tank tracking number (#22541). Tank #22541 was shipped under California Hazardous Waste Manifest #96839665 to the disposal facility operated by Erickson Inc., in Richmond, California. The Erickson facility is a Transport, Storage and Disposal Facility (TSDF) licensed to receive hazardous tanks for demolition. The final disposition of the tank was metal reclamation.

Petroleum odors and soil staining were observed in the excavations beneath the UST. Bulk samples of the native soil material were obtained from the bottom of the excavations using a backhoe bucket. Upon retrieval, soil samples were immediately sealed with aluminum foil and polyurethane caps. Each sample was then placed in a cooler with synthetic ice and kept at approximately 4 degrees Celsius (°C) prior to and during transport to a California certified laboratory for analysis. Chain of custody documentation was completed in the field and accompanied the samples to the laboratory.

LABORATORY ANALYTICAL RESULTS

TPH as Gasoline

Prep. Method: LUFT

Analysis Method: California DHS LUFT

Sample Name	Date Analyzed	Result Units: mg/Kg (ppm)	Result Notes
28905 EX	30-April	1	--
28905 Pile	30-April	6	--

*no BTEX
for excavation
sample*

BETX

Sample Name: 28905 Pile

Analyte	Date Analyzed	Result Units: mg/Kg (ppm)	Result Notes
Benzene	30-April	ND	--
Toluene	30-April	0.031	--
Ethylbenzene	30-April	0.064	--
Xylenes, Total	30-April	0.44	--
Methyl-tert-butyl ether	30-April	ND	--

*SEE: lab report
for BTEX/WTEBE results*

Closure

All soil located at the Site remains on and covered with visqueen until the Alameda County Environmental Health Department, gives written authorization to DECON to backfill with the excavated pile.

I will contact you as soon as I receive information from the Alameda County Environmental Health Department on the disposition of the soil pile.

If you have any questions, please contact me at 510-732-6444.

Sincerely,


A handwritten signature in cursive script, appearing to read "Ray Maiden".

Ray Maiden, Project Superintendent

enclosures

cc: Mr. Robert Weston, Alameda County Environmental Health Services
Mr. Nick Chimento, Alameda County Fire Department

Site Map of 28905 Hesperian Blvd.

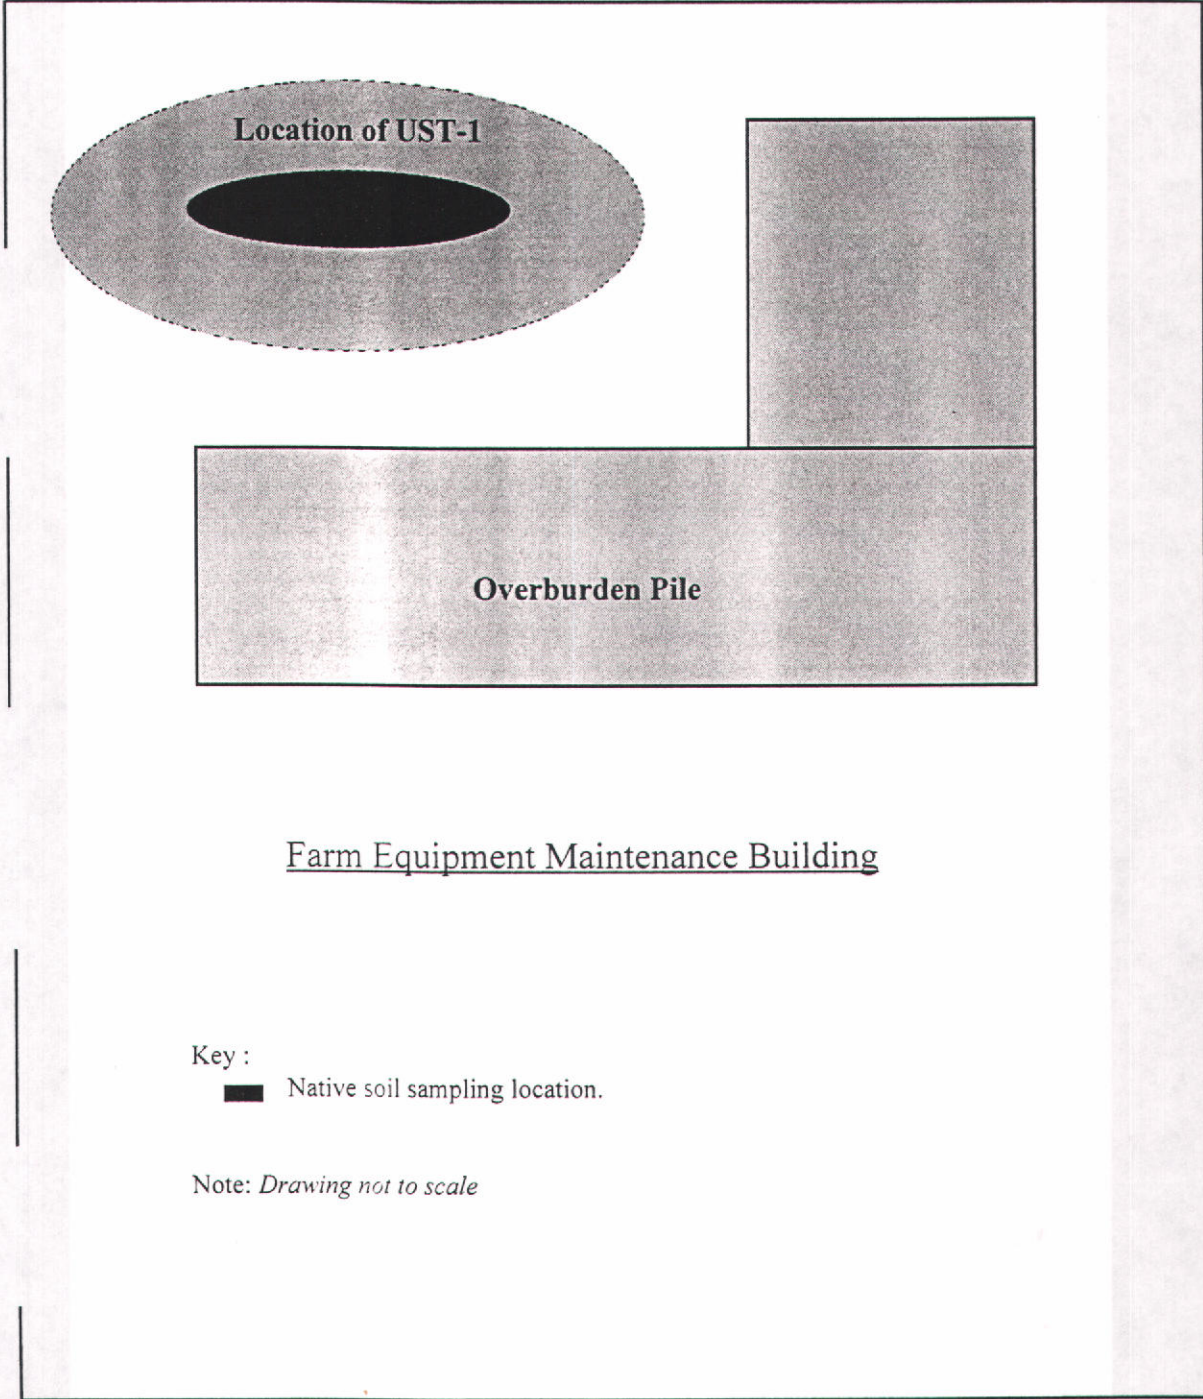

Farm Equipment Maintenance Building

Key :
■ Native soil sampling location.

Note: *Drawing not to scale*



28905 Hesperian Blvd.



28905 Hesperian Blvd

IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802. WITHIN CALIFORNIA, CALL 1-800-852-7550

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No. CAC001416144		Manifest Document No. CAC001416144 39665		2. Page 1 of 1		Information in the shaded areas is not required by Federal law.			
3. Generator's Name and Mailing Address OLIVER TRUST LAW OFFICE HP+S 22320 FOOTBALL BLVD. SUITE 620, HAYWARD, CA. 94541						A. State Manifest Document Number 96839665					
4. Generator's Phone (510) 538-6400						B. State Generator's ID					
5. Transporter 1 Company Name BYERS TRUCKING 94511						C. State Transporter's ID 2443					
6. US EPA ID Number P.O. Box 1469 Bethel Island, CA. CAD 982346210V						D. Transporter's Phone (925) 664-3719					
7. Transporter 2 Company Name						E. State Transporter's ID					
8. US EPA ID Number						F. Transporter's Phone					
9. Designated Facility Name and Site Address Erickson, Inc. 255 Parr Blvd. Richmond, CA. 94801						G. State Facility's ID					
10. US EPA ID Number CAD009466392						H. Facility's Phone (510) 235-1393					
11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number) a. NON-RCRA Hazardous Waste Solid Waste Empty Storage Tank.						12. Containers No. Type		13. Total Quantity		14. Unit Wt/Vol	
						0101 T P		01100		P	
b.								State		Waste Number	
c.								State		EPA/Other	
d.								State		EPA/Other	
J. Additional Descriptions for Materials Listed Above Qty. 1 Empty Storage Tank(s) # 22591 Tank(s) have been inerted with 15 lbs Dry Ice Per 1000 Gallon Capacity.						K. Handling Codes for Wastes Listed Above					
15. Special Handling Instructions and Additional Information Keep away from sources of ignition. Always wear hardhats when working around U.G.S.T.'s 24 Hr. Contact Name. STEVE COREY & Phone 510-887-855 SITE ADDRESS: 28905 HESPERIAN BLVD. HAYWARD, CA. 94545											
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.											
Printed/Typed Name STEVE COREY				Signature <i>[Signature]</i>		Month		Day		Year	
17. Transporter 1 Acknowledgement of Receipt of Materials Printed/Typed Name Bill D'Alleso				Signature <i>[Signature]</i>		Month		Day		Year	
18. Transporter 2 Acknowledgement of Receipt of Materials Printed/Typed Name				Signature		Month		Day		Year	
19. Discrepancy Indication Space											
20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19: Printed/Typed Name						Signature		Month		Day	

DO NOT WRITE BELOW THIS LINE.

9/30/98
 WITHIN CALIFORNIA, CALL 1-800-852-7550
 IN CASE OF EMERGENCY OR SPILL, CALL THE NATIONAL RESPONSE CENTER 1-800-424-8802

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No. C A C 0 0 1 4 1 6 1 4 4		Manifest Document No. 2 7 6 4 A		2. Page 1 of 1		Information in the shaded areas is not required by Federal law.					
3. Generator's Name and Mailing Address Oliver Trusts - Law Offices of HPS&S 22320 Foothill Blvd., Suite# 620 Hayward, CA 94541				A. State Manifest Document Number 97340367		B. State Generator's ID							
4. Generator's Phone (510) 538-6400				C. State Transporter's ID		D. Transporter's Phone (510) 732-6444							
5. Transporter 1 Company Name DECON Environmental Services, Inc.		6. US EPA ID Number C A D 9 8 2 4 6 8 1 8 3		E. State Transporter's ID		F. Transporter's Phone (800) 821-0424							
7. Transporter 2 Company Name Crosby and Overton, Inc.		8. US EPA ID Number C A D 9 8 2 5 2 4 4 9 0		G. State Facility's ID		H. Facility's Phone (562) 432-5445							
9. Designated Facility Name and Site Address Crosby and Overton 1630 W. 17th Street Long Beach CA 90813		10. US EPA ID Number C A D 0 2 9 4 0 9 0 1 9		11. US DOT Description (including Proper Shipping Name, Hazard Class, and ID Number)		12. Containers No. Type		13. Total Quantity		14. Unit Wi/Vol			
a. Waste gasoline, mixture, 3, UN1203, PGII				C 0 2 D T		00/00		G		1. Waste Number State 343 EPA/Other D001 D018			
b.										State EPA/Other			
c.										State EPA/Other			
d.										State EPA/Other			
J. Additional Descriptions for Materials Listed Above a. C60-13246K: ERG-128				K. Handling Codes for Wastes Listed Above a. b. c. d.									
15. Special Handling Instructions and Additional Information 40hr OSHA trained handlers should use NIOSH approved safety equipment. 24hr ER# (510) 475-2901 Site: 28905 Hisperian Blvd., Hayward, CA													
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.													
Printed/Typed Name Steve Buckingham				Signature <i>Steve Buckingham</i>				Month 05		Day 18		Year 98	
17. Transporter 1 Acknowledgement of Receipt of Materials Printed/Typed Name Richard Feyn				Signature <i>Richard Feyn</i>				Month 05		Day 18		Year 98	
18. Transporter 2 Acknowledgement of Receipt of Materials Printed/Typed Name				Signature				Month		Day		Year	
19. Discrepancy Indication Space													
20. Facility Owner or Operator Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19. Printed/Typed Name													
Signature				Month		Day		Year					

DO NOT WRITE BELOW THIS LINE.

RECEIVED MAY 05 1998

**Columbia
Analytical
Services^{inc.}**

May 4, 1998

Service Request No.: S9801096

Mr. Roy Maiden
Decon Environmental Services, Inc.
23490 Connecticut Street
Hayward, CA 94545

RE: Oliver Trust - UST Removal/2764

Dear Mr. Maiden:

The following pages contain analytical results for sample(s) received by the laboratory on April 30, 1998. Results of sample analyses are followed by Appendix A which contains sample custody documentation and quality assurance deliverables requested for this project. The work requested has been assigned the Service Request No. listed above. To help expedite our service, please refer to this number when contacting the laboratory.

Analytical results were produced by procedures consistent with Columbia Analytical Services' (CAS) Quality Assurance Manual (with any deviations noted). Signature of this CAS Analytical Report below confirms that pages 2 through 4, following, have been thoroughly reviewed and approved for release in accord with CAS Standard Operating Procedure ADM-DatRev3.

Please feel welcome to contact me should you have questions or further needs.

Sincerely,



Bernadette T. Cox
Project Chemist

COLUMBIA ANALYTICAL SERVICES, Inc.

Acronyms

A2LA	American Association for Laboratory Accreditation
ASTM	American Society for Testing and Materials
BOD	Biochemical Oxygen Demand
BTEX	Benzene, Toluene, Ethylbenzene, Xylenes
CAM	California Assessment Metals
CARB	California Air Resources Board
CAS Number	Chemical Abstract Service registry Number
CFC	Chlorofluorocarbon
CFU	Colony-Forming Unit
COD	Chemical Oxygen Demand
DEC	Department of Environmental Conservation
DEQ	Department of Environmental Quality
DHS	Department of Health Services
DLCS	Duplicate Laboratory Control Sample
DMS	Duplicate Matrix Spike
DOE	Department of Ecology
DOH	Department of Health
EPA	U. S. Environmental Protection Agency
ELAP	Environmental Laboratory Accreditation Program
GC	Gas Chromatography
GC/MS	Gas Chromatography/Mass Spectrometry
IC	Ion Chromatography
ICB	Initial Calibration Blank sample
ICP	Inductively Coupled Plasma atomic emission spectrometry
ICV	Initial Calibration Verification sample
J	Estimated concentration. The value is less than the MRL, but greater than or equal to the MDL. If the value is equal to the MRL, the result is actually <MRL before rounding.
LCS	Laboratory Control Sample
LUFT	Leaking Underground Fuel Tank
M	Modified
MBAS	Methylene Blue Active Substances
MCL	Maximum Contaminant Level. The highest permissible concentration of a substance allowed in drinking water as established by the U. S. EPA.
MDL	Method Detection Limit
MPN	Most Probable Number
MRL	Method Reporting Limit
MS	Matrix Spike
MTBE	Methyl tert-Butyl Ether
NA	Not Applicable
NAN	Not Analyzed
NC	Not Calculated
NCASI	National Council of the paper industry for Air and Stream Improvement
ND	Not Detected at or above the method reporting/detection limit (MRL/MDL)
NIOSH	National Institute for Occupational Safety and Health
NTU	Nephelometric Turbidity Units
ppb	Parts Per Billion
ppm	Parts Per Million
PQL	Practical Quantitation Limit
QA/QC	Quality Assurance/Quality Control
RCRA	Resource Conservation and Recovery Act
RPD	Relative Percent Difference
SIM	Selected Ion Monitoring
SM	Standard Methods for the Examination of Water and Wastewater, 18th Ed., 1992
STLC	Solubility Threshold Limit Concentration
SW	Test Methods for Evaluating Solid Waste, Physical/Chemical Methods, SW-846, 3rd Ed., 1986 and as amended by Updates I, II, IIA, and IIB.
TCLP	Toxicity Characteristic Leaching Procedure
TDS	Total Dissolved Solids
TPH	Total Petroleum Hydrocarbons
tr	Trace level. The concentration of an analyte that is less than the PQL but greater than or equal to the MDL. If the value is equal to the PQL, the result is actually <PQL before rounding.
TRPH	Total Recoverable Petroleum Hydrocarbons
TSS	Total Suspended Solids
TTLC	Total Threshold Limit Concentration
VOA	Volatile Organic Analyte(s)

COLUMBIA ANALYTICAL SERVICES, INC.

Analytical Report

Client: Decon Enviromental Services, Inc.
Project: Oliver Trust - UST Removal/2764
Sample Matrix: Soil

Service Request: S9801096
Date Collected: 4/30/98
Date Received: 4/30/98

Total Metals
Lead

Prep Method: EPA 3050BM
Analysis Method: 6010A
Test Notes:

Units: mg/Kg (ppm)
Basis: Wet

Sample Name	Lab Code	MRL	Dilution Factor	Date Prepared	Date Analyzed	Result	Result Notes
28905-Ex	S9801096-001	5	1	5/1/98	5/1/98	10	
28905-Pile	S9801096-002	5	1	5/1/98	5/1/98	8	
Method Blank	S980501-MB	5	1	5/1/98	5/1/98	ND	

RECEIVED MAY 02 1998



May 1, 1998

Service Request No.: S9801092

Mr. Ray Maiden
Decon Environmental Services, Inc.
23490 Connecticut Street
Hayward, CA 94545

RE: Oliver Trust - UST Removal/2764

Dear Mr. Maiden:

The following pages contain analytical results for sample(s) received by the laboratory on April 30, 1998. Results of sample analyses are followed by Appendix A which contains sample custody documentation and quality assurance deliverables requested for this project. The work requested has been assigned the Service Request No. listed above. To help expedite our service, please refer to this number when contacting the laboratory.

Analytical results were produced by procedures consistent with Columbia Analytical Services' (CAS) Quality Assurance Manual (with any deviations noted). Signature of this CAS Analytical Report below confirms that pages 2 through 7, following, have been thoroughly reviewed and approved for release in accord with CAS Standard Operating Procedure ADM-DatRev3.

Please feel welcome to contact me should you have questions or further needs.

Sincerely,

A handwritten signature in cursive script that reads "Bernadette T. Cox".

Bernadette T. Cox
Project Chemist

COLUMBIA ANALYTICAL SERVICES, Inc.

Acronyms

A2LA	American Association for Laboratory Accreditation
ASTM	American Society for Testing and Materials
BOD	Biochemical Oxygen Demand
BTEX	Benzene, Toluene, Ethylbenzene, Xylenes
CAM	California Assessment Metals
CARB	California Air Resources Board
CAS Number	Chemical Abstract Service registry Number
CFC	Chlorofluorocarbon
CFU	Colony-Forming Unit
COD	Chemical Oxygen Demand
DEC	Department of Environmental Conservation
DEQ	Department of Environmental Quality
DHS	Department of Health Services
DLCS	Duplicate Laboratory Control Sample
DMS	Duplicate Matrix Spike
DOE	Department of Ecology
DOH	Department of Health
EPA	U. S. Environmental Protection Agency
ELAP	Environmental Laboratory Accreditation Program
GC	Gas Chromatography
GC/MS	Gas Chromatography/Mass Spectrometry
IC	Ion Chromatography
ICB	Initial Calibration Blank sample
ICP	Inductively Coupled Plasma atomic emission spectrometry
ICV	Initial Calibration Verification sample
J	Estimated concentration. The value is less than the MRL, but greater than or equal to the MDL. If the value is equal to the MRL, the result is actually <MRL before rounding.
LCS	Laboratory Control Sample
LUFT	Leaking Underground Fuel Tank
M	Modified
MBAS	Methylene Blue Active Substances
MCL	Maximum Contaminant Level. The highest permissible concentration of a substance allowed in drinking water as established by the U. S. EPA.
MDL	Method Detection Limit
MPN	Most Probable Number
MRL	Method Reporting Limit
MS	Matrix Spike
MTBE	Methyl tert-Butyl Ether
NA	Not Applicable
NAN	Not Analyzed
NC	Not Calculated
NCASI	National Council of the paper industry for Air and Stream Improvement
ND	Not Detected at or above the method reporting/detection limit (MRL/MDL)
NIOSH	National Institute for Occupational Safety and Health
NTU	Nephelometric Turbidity Units
ppb	Parts Per Billion
ppm	Parts Per Million
PQL	Practical Quantitation Limit
QA/QC	Quality Assurance/Quality Control
RCRA	Resource Conservation and Recovery Act
RPD	Relative Percent Difference
SIM	Selected Ion Monitoring
SM	Standard Methods for the Examination of Water and Wastewater, 18th Ed., 1992
STLC	Solubility Threshold Limit Concentration
SW	Test Methods for Evaluating Solid Waste, Physical/Chemical Methods, SW-846, 3rd Ed., 1986 and as amended by Updates I, II, IIA, and IIB.
TCLP	Toxicity Characteristic Leaching Procedure
TDS	Total Dissolved Solids
TPH	Total Petroleum Hydrocarbons
tr	Trace level. The concentration of an analyte that is less than the PQL but greater than or equal to the MDL. If the value is equal to the PQL, the result is actually <PQL before rounding.
TRPH	Total Recoverable Petroleum Hydrocarbons
TSS	Total Suspended Solids
TTLC	Total Threshold Limit Concentration
VOA	Volatile Organic Analyte(s)

COLUMBIA ANALYTICAL SERVICES, INC.

Analytical Report

Client: Decon Environmental Services, Inc.
Project: Oliver Trust - UST Removal/2764
Sample Matrix: Soil

Service Request: S9801092
Date Collected: 4/30/98
Date Received: 4/30/98

BTEX, MTBE and TPH as Gasoline

Sample Name: 28905-Ex
Lab Code: S9801092-001
Test Notes:

Units: mg/Kg (ppm)
Basis: Wet

Analyte	Prep Method	Analysis Method	MRL	Dilution Factor	Date Extracted	Date Analyzed	Result	Result Notes
TPH as Gasoline	EPA 5030	CA/LUFT	1	1	4/30/98	4/30/98	1	
Benzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Toluene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.03	
Ethylbenzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.016	
Xylenes, Total	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.094	
Methyl-tert-butyl ether	EPA 5030	8020	0.05	1	4/30/98	4/30/98	ND	

COLUMBIA ANALYTICAL SERVICES, INC.

Analytical Report

Client: Decon Environmental Services, Inc.
Project: Oliver Trust - UST Removal/2764
Sample Matrix: Soil

Service Request: S9801092
Date Collected: 4/30/98
Date Received: 4/30/98

BTEX, MTBE and TPH as Gasoline

Sample Name: 28905-Pile
Lab Code: S9801092-002
Test Notes:

Units: mg/Kg (ppm)
Basis: Wet

Analyte	Prep Method	Analysis Method	MRL	Dilution Factor	Date Extracted	Date Analyzed	Result	Result Notes
TPH as Gasoline	EPA 5030	CA/LUFT	1	1	4/30/98	4/30/98	6	
Benzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Toluene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.031	
Ethylbenzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.064	
Xylenes, Total	EPA 5030	8020	0.005	1	4/30/98	4/30/98	0.44	
Methyl-tert-butyl ether	EPA 5030	8020	0.05	1	4/30/98	4/30/98	ND	

COLUMBIA ANALYTICAL SERVICES, INC.

Analytical Report

Client: Decon Environmental Services, Inc.
Project: Oliver Trust - UST Removal/2764
Sample Matrix: Soil

Service Request: S9801092
Date Collected: NA
Date Received: NA

BTEX, MTBE and TPH as Gasoline

Sample Name: Method Blank
Lab Code: S980430-SB1
Test Notes:

Units: mg/Kg (ppm)
Basis: Wet

Analyte	Prep Method	Analysis Method	MRL	Dilution Factor	Date Extracted	Date Analyzed	Result	Result Notes
TPH as Gasoline	EPA 5030	CA/LUFT	1	1	4/30/98	4/30/98	ND	
Benzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Toluene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Ethylbenzene	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Xylenes, Total	EPA 5030	8020	0.005	1	4/30/98	4/30/98	ND	
Methyl-tert-butyl ether	EPA 5030	8020	0.05	1	4/30/98	4/30/98	ND	

NICK CHAMMENTO - INSPECTOR

670-5853

Alameda County Fire Department

Fire Prevention Bureau

4/30 TH. 1 PM 22341 Redwood Road • Castro Valley, CA 94546

TENT (510) 670-5853

BOUMEN -

DEPUTY FIRE MARSHALL

FLAMMABLE AND COMBUSTIBLE LIQUID

UNDERGROUND STORAGE TANK REMOVAL GUIDELINE

Revised 12/30/91

PERMITS

Article 4 - Uniform Fire Code - Section 4.101-18

Permit is required and shall be obtained from the Fire Prevention Bureau to remove, abandon, place temporarily out of service, or otherwise dispose of any combustible or flammable liquid storage tank. In addition, the contractor shall have passed the hazardous substance removal certification examination in accordance with Senate Bill 2004. Contact Contractors State License Board for more information.

Permit application can be obtained from Alameda County Fire Prevention Bureau, 22341 Redwood Road, Castro Valley, CA 94546, Phone No. 510-670-5853.

NOTE: In addition to a completed permit application, a copy of your closure plan approved by the Alameda County Environmental Health Department shall be submitted for review.

PRIOR TO REMOVAL

1. Notify the Fire Prevention Bureau a minimum of 48 hours in advance to schedule an inspection for removal.

REF./
A/C. NO.

COUNTY OF ALAMEDA
OFFICE OF THE AUDITOR-CONTROLLER

DATE: 4/27/98

No 782409

MISCELLANEOUS RECEIPT

\$ 80⁰⁰/₁₀₀ DOLLARS


EIGHTY AND 00/100

RECEIVED FROM:	DECON ENVIRONMENTAL SERVICES	
FOR:	28905 HESPERIAN BLVD.	
	HAYWARD, CA. 94545	
RECEIVED BY:	DV	DEPT. NO.: 503

CASH PERSONAL/CASHIER'S CHECK/M. O. #38539 OTHER: _____

110-1 (Rev 10/85) [0134E (08)] 3-Part Distribution: White - Payor Yellow & Pink - Depart.

THIS RECEIPT SHOULD BE ON SITE AND READILY ACCESSIBLE.



**BAY AREA AIR QUALITY
MANAGEMENT DISTRICT**

939 ELLIS STREET
SAN FRANCISCO, CALIFORNIA 94109
(415) 771-5000

REGULATION 8, RULE 40
Aeration of Contaminated Soil and
Removal of Underground Storage Tanks

NOTIFICATION FORM

- Removal or Replacement of Tanks
- Excavation of Contaminated Soil

SITE INFORMATION

SITE ADDRESS 28905 Hesperian Blvd.
 CITY, STATE, ZIP HAYWARD, CA 94545
 OWNER NAME Oliver Trust - Law Offices of HPS&S
 SPECIFIC LOCATION OF PROJECT 28905 Hesperian Blvd

<p><u>TANK REMOVAL</u></p> <p>SCHEDULED STARTUP DATE <u>April 30, 1998</u></p> <p>VAPORS REMOVED BY:</p> <p><input checked="" type="checkbox"/> WATER WASH</p> <p><input checked="" type="checkbox"/> VAPOR FREEING (CO²)</p> <p><input type="checkbox"/> VENTILATION</p>	<p><u>CONTAMINATED SOIL EXCAVATION</u></p> <p>SCHEDULED STARTUP DATE _____</p> <p>STOCKPILES WILL BE COVERED? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/></p> <p>ALTERNATIVE METHOD OF AERATION (DESCRIBE BELOW):</p> <p>_____</p> <p style="text-align: center;">(MAY REQUIRE PERMIT)</p>
---	---

CONTRACTOR INFORMATION

NAME Decon Environmental Services CONTACT Ray Maiden
 ADDRESS 23490 Connecticut St. PHONE (510) 732-6444
 CITY, STATE, ZIP HAYWARD, CA 94545

**CONSULTANT INFORMATION
(IF APPLICABLE)**

NAME _____ CONTACT _____
 ADDRESS _____ PHONE () _____
 CITY, STATE, ZIP _____

FOR OFFICE USE ONLY

DATE RECEIVED _____ BY _____ (INIT.)
 CC: INSPECTOR NO. _____ DATE _____ BY _____ (INIT.)
 TELEPHONE UPDATE: CALLER _____ CHANGE MADE _____
 BAAQMD N # _____