

TOXICHEM Management Systems, Inc.

Environmental & Occupational Health Services

1562 44th Avenue
San Francisco, California 94122
(415) 681-8816 / Fax (415) 681-8132

Industrial Hygiene - Exposure Assessment
Quantitative Risk Assessment
Compliance Audits
Real Property Environmental Assessments
Remedial Investigations
Air, Soil, and Groundwater Sampling
Remedial Engineering and Construction
Regulatory Compliance and Negotiation
Litigation Support Services

May 1, 2000
Project EQ-36.1A

Ms. Karen Petryna, P.E.
Equiva Services LLC
P. O. Box 7869
Burbank, California 91510-7869

Re: **Site Assessment Report**
Former Shell Service Station
2301-2307 Lincoln Avenue, Alameda, California

Dear Ms. Petryna:

On behalf of Equiva Services LLC (Equiva), Toxicchem Management Systems, Inc. (TOXICHEM) has prepared this report to document the findings of site assessment activities recently performed at the above referenced site (Figures 1 and 2). The purpose of the investigation was to assess the source of petroleum hydrocarbons that were detected in the soil and groundwater beneath the site in July 1999. The current investigation consisted of reviewing available site-related investigative documents, aerial photographs, Alameda County Assessor's Office (ACAO) records, Alameda County Health Care Services Agency (ACHCSA) files, City of Alameda Fire Department (AFD) files, and Sanborn Maps. Included in this letter is a discussion of the site description and background, findings, and conclusions and recommendations.

Vista Environmental Information, Inc. was contracted to provide a *Site Assessment Plus* (SAP) Report, which identifies potential sources of environmental impact in the vicinity of the site, and Sanborn Maps. Copies of these documents are presented as Attachment A. The SAP Report identified 36 properties with environmental concerns within a ¼-mile radius of the site, of which 24 properties are listed on a *Leaking Underground Storage Tank* (LUST) list. The SAP Report also identified 18 additional properties with environmental concerns that are located between a ¼ and ½-mile radius of the site, all of which are listed on a LUST list.

In accordance with Section 25297.15(a) of Chapter 6.7 of the State of California Health and Safety Code, Equiva has notified the current record owner of fee title, Allan and Beverly Sebanic, of this work.

SITE DESCRIPTION AND BACKGROUND

The site is located at 2301-2307 Lincoln Avenue in a predominantly mixed commercial and residential area of Alameda, California.

Historical information indicates that three residential dwellings occupied the site as early as 1897. In 1926, the 2301 Lincoln Avenue property was developed as a gasoline station. It's believed that the remainder of the site was occupied by two residential dwellings until the 1980's. In 1970, Shell replaced the underground storage tanks (USTs). In 1982, the gasoline service station was closed and one 8,000-gallon capacity, two 2,000-gallon capacity, and one 1,000-gallon capacity USTs were removed. During the 1980's, the site was redeveloped as a retail center. The site is currently occupied by a retail center.

Previous Investigations

In July 1999, six soil borings (SB-1 through SB-6) were drilled to assess the potential subsurface environmental impacts from past gasoline service and automotive maintenance activities at the site. Soil samples were collected from each boring at 5 or 7.5 feet below ground surface (bgs). The soil samples were analyzed for total purgeable petroleum hydrocarbons (TPPH) by EPA Method 8015 (modified), and benzene, toluene, ethylbenzene, xylenes (BTEX compounds) and methyl-tertiary-butyl ether (MtBE) by EPA Method 8020. TPPH and ethylbenzene were detected in only one soil sample (Boring SB-3 at 7.5 feet bgs), at concentrations of 40 and 0.012 milligrams per kilogram (mg/kg), respectively. Benzene, toluene, xylenes, and MtBE were not detected in any soil sample. Grab groundwater samples were also collected from each boring, and were analyzed for TPPH, BTEX compounds, MtBE, and volatile organic compounds (VOCs) by EPA Method 8260. TPPH was detected in two groundwater samples, at 4,500 micrograms per liter ($\mu\text{g/L}$) in Boring SB-3 and 160 $\mu\text{g/L}$ in Boring SB-6. Toluene, ethylbenzene, and xylenes were detected in groundwater only from Boring SB-3, at concentrations of 4.4, 2.7, and 4.0 $\mu\text{g/L}$, respectively. Benzene and MtBE were not detected in any groundwater sample. The following VOCs were detected in Boring SB-3: n-butyl benzene at 10 $\mu\text{g/L}$, sec-butyl benzene at 14 $\mu\text{g/L}$, isopropyl benzene at 45 $\mu\text{g/L}$, n-propyl benzene at 60 $\mu\text{g/L}$, and vinyl acetate at 26 $\mu\text{g/L}$; and in Boring SB-6: n-butyl benzene at 160 $\mu\text{g/L}$. No other VOCs were detected in the groundwater samples.

FINDINGS

Task 1 – Review Available Site-Related Investigative Documents

TOXICHEM obtained and reviewed the report titled *Limited Phase II Environmental Site Investigation* that was prepared by Basics Environmental on August 12, 1999. That report is summarized in the preceding section.

Task 2 – Review Available Aerial Photographs

TOXICHEM contracted with Pacific Aerial Surveys to review available historical aerial photographs of the site. A total of five photographs were reviewed from the years: 1950, 1959, 1969, 1981, and 1990. A summary of observations for each photograph follows.

Photograph AV28-15-27, April 14, 1950

Four buildings can be observed at the site, but their use cannot be determined. The surrounding area is completely developed and is a mixture of residential and commercial properties. A gasoline station appears to be operating at the intersection of Park Street and Lincoln Avenue.

Photograph AV337-06-35, July 3, 1959

The site appears to be occupied by a gasoline station. A single building is located in the center of the site. What appears to be a canopy extends from the station building southwesterly towards Lincoln Avenue. ~~What appears to be an UST complex can be seen in the southeastern corner of the site.~~ Automobile parking can be observed along the northeasterly and southeasterly property boundaries. The surrounding area is completely developed and is a mixture of residential and commercial properties. New additional commercial properties can be observed to the south and southwest of the site. A gasoline station appears to be operating at the intersection of Park and Lincoln.

Photograph AV902-05-20, May 2, 1969

The observations are the generally the same as the previous photograph, except that a gasoline station appears to be occupying the northeastern corner of the intersection of Lincoln Avenue and Oak Street. Fewer residential homes and additional commercial properties can be observed in the area surrounding the site.

Photograph AV2040-05-19, June 22, 1981

The observations are the generally the same as the previous photograph.

Photograph AV3845-9-33, June 12, 1990

The site appears to be occupied by a strip mall. The surrounding area is completely developed and is a mixture of residential and commercial properties. A gasoline station appears to be occupying the northwestern corner of the intersection of Lincoln Avenue and Oak Street (the site is located on the northeastern corner of the same intersection).

Task 3 – Review ACAO Records

The Alameda County Assessor's Number for the site is 71-201-12-1. The following list summarizes ownership of the site.

Summary of Site Ownership

Grantee (Buyer)	Grantor (Seller)	Date Recorded
Allan and Beverly Sebanc	C&H Development	12/22/98
C&H Development	Shell Oil Company	7/6/82
Shell Oil Company	General Electric Pension	4/26/79
General Electric Pension	Unknown	Unknown

Task 4 – Review ACHCSA Files

TOXICHEM reviewed ACHCSA files for the following available sites, and a summary of the findings follows.

Alameda City Unified School District, 2200 Central Avenue, Alameda

In December 1991, two heating oil USTs (one 4,000-gallon and one 2,000-gallon) were removed from the property. TEPH and BTEX compounds were not detected in the soil, however, 0.6 µg/L of toluene, 1.2 µg/L of ethylbenzene, and 1.8 µg/L of xylenes were detected in groundwater from the UST excavation. In June 1992, three groundwater monitoring wells (MW-1 through MW-3) were installed at the property. The analysis of the soil samples collected during the installation of these wells did not identify any contaminants above detection limits. Groundwater samples were collected from these wells for four consecutive quarters, and no contaminants were ever detected over detection limits except for in the first quarter at 170 µg/L TEPH. On July 2, 1993, the ACHCSA recommended case closure, which was approved by the California Regional Water Quality Control Board on August 11, 1993. The groundwater monitoring wells were subsequently destroyed on August 13, 1993.

Stahl Woodridge, 2428 Central Avenue, Alameda

The property is a former Chevron station. A *Risk Management Plan* recommending case closure was filed on April 19, 1999, and is currently pending review.

Celia Harris Trust, 2521 Central Avenue, Alameda

On April 29, 1993, a 1,500-gallon heating oil UST was removed from the property, which is an apartment complex. Two soil samples and one groundwater sample were collected from the excavation, and analyzed for TEPH and BTEX compounds. No contaminants were detected in the soil samples, however, 1,300 µg/L TEPH, 0.7 µg/L toluene, 0.4 µg/L ethylbenzene, and 2 µg/L xylenes were detected in the groundwater sample. As it appeared that source removal was conducted at the property to the extent feasible the ACHCSA recommended case closure, which the RWQCB approved on June 26, 1993.

Clement Avenue Project, 2241 Clement Avenue, Alameda

In a letter dated December 21, 1995, the ACHCSA denied a request for closure pending submittal of additional information, including determination of the groundwater gradient.

Vacant Building, 1347 Park Street, Alameda

In November 1995, a 1,500-gallon heating oil UST was removed from the property. Elevated concentrations of diesel range hydrocarbons were detected. The excavation was subsequently over-excavated and resampled. Elevated diesel range hydrocarbons were detected following over-excavation. In September 1989, three borings (IB-1 through IB-3) were hand augered and elevated petroleum hydrocarbon concentrations were detected in the soil and groundwater samples collected. TEPH was detected in the soil and groundwater at maximum concentrations of 4,900 mg/kg and 730 µg/L, respectively. On February 7, 2000, the ACHCSA approved a work plan for installation of additional groundwater monitoring wells. The report of that work was not in ACHCSA files.

Former BP, 1541 Park Street, Alameda

Four USTs (one 5,000-gallon gasoline, one 6,000-gallon gasoline, one 8,000-gallon gasoline, and one 250-gallon waste oil) were removed in September 1987, and soil and groundwater contamination was encountered. Three groundwater monitoring wells (MW-1 through MW-3) were installed in March 1988, and three additional wells (MW-4 through MW-6) were installed in March 1989. Site remediation consisting of extracting groundwater from Well RW-1 was performed between September 1992 and October 1994. The system was shutdown because MtBE concentrations saturated the system. Groundwater flow is easterly at an approximate gradient of 0.007. Groundwater monitoring and sampling continues at the property.

Good Chevrolet, 1630 Park Street, Alameda

In January 2000, a *Revised Passive Remedial Action Work Plan*, which proposed the injection of oxygen release compounds in 25 to 30 locations, was approved by the ACHCSA. Implementation of this work plan was not documented in ACHCSA files.

Cavanaugh Motors, Inc., 1700 Park Street, Alameda

In December 1989 and August 1990, one gasoline UST and one waste oil UST were removed from the property. In April 1990 and January 1991, accessible impacted soils were excavated. Approximately 120 cubic yards of soil was removed. Six groundwater monitoring wells (MW-1 through MW-6) and four soil vapor extraction (SVE) wells (VW-1 through VW-4) were subsequently installed. Depth to groundwater ranged from 5.13 to 8.96 feet bgs. The groundwater flow direction was measured to be north-northwest at an average gradient of 0.008. A SVE system operated at the site between 1993 and 1994 until the extracted soil vapor concentrations declined and stabilized at approximately 40 parts per million. Approximately 1,000 pounds of hydrocarbons were removed by the SVE system during operation. On August 22, 1996, the ACHCSA closed the environmental case.

Ztra Oil, 1701 Park Street, Alameda

In April 1994, four 10,000-gallon USTs (3 gasoline and 1 diesel) and one 110-gallon fuel oil UST were removed from the property. Soil and groundwater contamination was encountered. Soil types encountered at the property consist of sand, silt, and clay. Four groundwater monitoring wells (MW-1 through MW-4) have been installed to a depth ranging from 15 to 20 feet bgs. Depth to groundwater ranges from approximately 11 to 14 feet bgs, and groundwater flows from the northwest to east. Separate phase hydrocarbons (SPH) has been detected at the property. A utility survey identified a 10-inch diameter sanitary sewer along the centerline of Park Street at a depth of approximately 11 feet bgs and a 6-inch diameter sanitary sewer along the centerline of Buena Vista Avenue and Eagle Avenue.

In December 1999, a *Corrective Action Plan (CAP)*, which proposed air sparging and vapor extraction with thermal treatment, was approved by the ACHCSA. Implementation of this CAP was not documented in the files.

Ron Goode Toyota, Inc., 1825 Park Street, Alameda

Two USTs (one 500-gallon gasoline and one 300-gallon waste oil) were removed from the property in December 1990. Four groundwater monitoring wells (MW-1 through MW-4) were installed at the property. Groundwater elevation ranged from 2.16 to 4.72 feet bgs, and the

groundwater flow direction was north-northwesterly to north-northeasterly. On January 10, 1977, ACHCSA closed the environmental case.

Alameda Collision Repair, 1911 Park Street, Alameda

Two USTs (one 750-gallon gasoline and one 200-gallon) were removed from the property in June 1988. Soil samples from the excavation did not detect TPPH. Water samples collected from the excavation detected 1,700 µg/L TPPH and concentrations of BTEX compounds up to 4.3 µg/L, 300 µg/L, 500 µg/L, and less than 100 µg/L, respectively. One groundwater monitoring well (MW-1) was installed in December 1992. The depth to groundwater was measured at approximately 4 to 5 feet bgs over four quarters. On June 2, 1994, the ACHCSA closed the environmental case.

Fowler Anderson Mortuary, 2244 Santa Clara Avenue, Alameda

Three USTs (one 50-gallon fuel oil, one 250-gallon fuel oil, and one 50-gallon hydraulic oil) were removed in January 1991. TPPH was detected beneath the hydraulic oil UST at a concentration of 1,400 mg/kg. Impacted soil was excavated to non-detectable concentrations. Three groundwater monitoring wells (MW-1 through MW-3) were installed in February 1991 and sampled for four quarters. Depth to groundwater was approximately 8 to 9 feet bgs and the groundwater flow direction was northeasterly. The analytical results for all four sampling events indicated there were no detectable concentrations of TPPH or BTEX compounds present. The environmental case is closed according to ACHCSA records, but no closure documents were on-file.

City of Alameda, 2263 Santa Clara Avenue, Alameda

Three USTs (one 1,500-gallon gasoline, one 1,000-gallon gasoline, and one 280-gallon heating oil) were removed from the property in June 1994. Three groundwater monitoring wells (MW-1 through MW-3) were installed at the site. The historical range of groundwater elevation ranged from 8.15 to 10.33 feet bgs, and the direction of groundwater flow varied from northeast to southeast. On June 18, 1996, the ACHCSA closed the environmental case.

Former Shell, 2300 Santa Clara Avenue, Alameda

The property is a former Shell that ceased operation approximately 50 years ago and is currently a parking lot for a Longs Drug Store. In January 1998, seven soil borings (GP-A through GP-H) were drilled at the property. The site subsurface consisted of fine sands with silt of moderate to high estimated permeability to the total explored depth of 13 feet bgs. Groundwater was encountered at approximately 8.5 feet bgs. Selected soil samples were analyzed for lead, TPPH, TEPH, BTEX compounds, MtBE, and VOCs. Only TEPH at a maximum concentration of 6.9 mg/kg was detected. Lead and TEPH were detected in groundwater in most of the borings, at maximum concentrations of 400 and 1,500 µg/L, respectively. Toluene and acetone were also detected at concentrations of 0.58 and 56 µg/L, respectively. No MtBE, benzene, ethylbenzene, xylenes, or other VOCs were detected. Given the period of operation for the former Shell station and its proximity to the adjacent Bill Chun's Texaco station, Cambria Environmental Technology, Inc. concluded that the former Shell station is not the source of hydrocarbons detected in Well MW-8 at this property.

Bill Chun's Texaco, 2301 Santa Clara Avenue, Alameda

In July 1992, three USTs (two 550-gallon and one 285-gallon) were removed from the property. During removal, it was discovered that the 285-gallon UST had leaked. Several assessments have been completed to determine the extent of petroleum hydrocarbon-impacted soil and groundwater at the property. Six groundwater monitoring wells were installed in 1993; three wells (MW-1 through MW-3) in January, and three wells (MW-4 through MW-6) in September. Four additional monitoring wells (MW-8 through MW-11) were installed in November 1995. As of the *Second Quarter 1998 Groundwater Monitoring Report* (ENSR, June 30, 1998), SPH had been detected at the property since November 1993. Groundwater at the property is generally encountered between 8 and 10 feet bgs and generally flows in a north to northeasterly direction with occasional flow variation to the northwest. The gradient is flat and generally ranges from 0.002 to 0.005. A *Remedial Action Plan* (GeoSolv, LLC, January 24, 2000) has been submitted to ACHCSA and is awaiting approval.

Task 5 – Review AFD Files

TOXICHEM reviewed AFD files for the following available sites, and a summary of findings follows.

Automotive Auto, 2425 Central Avenue, Alameda

This property was a former Union 76 gasoline station where three USTs were discovered in during an AFD inspection. The USTs were removed in October 1987. There was no analytical data in AFD files. No other records were in AFD files.

Former Metal Fabricator, 2235 Clement Avenue, Alameda

One 550-gallon leaded gasoline was removed in May 1989 and soil contamination was found. ACHCSA requested additional investigation, however, no other records were in AFD files.

Union Oil, 2267 Lincoln Avenue, Alameda

Two 10,000-gallon gasoline and one 520-gallon waste oil UST were removed in July 1998. No other records were in AFD files.

Alameda Auto Enhancers, 2327 Lincoln Avenue, Alameda

In January 1990, an AFD inspection discovered contaminated soil surrounding a steam cleaning and undercoating pad, oily water runoff from a hydraulic lift pad area, and other violations. In July 1990, ACHCSA requested removal of the contaminated soil. No other records were in AFD files.

Alameda Police Department, 1555 Oak Street, Alameda

There were only AFD inspection records in the AFD files; no UST records were in the AFD files.

Winner Ford, 1650 Park Street, Alameda

One 550-gallon gasoline UST was removed in November 1994 and one 250-gallon waste oil UST was removed in August 1985. Soil contamination was discovered. No other records were in AFD files.

Former ARCO, 1725 Park Street, Alameda

In November 1985, four USTs (one 8,000-gallon, two 5,000-gallon, and one 10,000-gallon) were removed. In August 1992, ACHCSA requested additional investigation. In September 1992, a work plan for groundwater extraction, soil vapor extraction, and air sparging was submitted. No other records were in AFD files.

John Henry Estate/Alameda Foreign Auto, 1726 Park Street, Alameda

This property is a former Texaco service station. All USTs were removed from the property in the 1970's and 1980's. In August 1991, soil contamination was encountered. In December 1995, the hydraulic lifts were removed and additional soil contamination was encountered. No other records were in AFD files.

Former Arco/Chevron, 1800 Park Street, Alameda

A *Notice of Citation Hearing* dated August 19, 1991 is on file for improperly abandoning an UST. In January 1992, two 7,500-gallon gasoline and one 1,000-gallon waste oil UST were removed. Soil and groundwater samples were collected, but no analytical data was in AFD files. No other records were in AFD files.

Goodman Property, 2501 Santa Clara Avenue, Alameda

This property is a former Shell. In August 1992, one 6,000-gallon gasoline UST, two 5,000-gallon gasoline UST, and one 280-gallon waste oil UST were removed. Soil and groundwater contamination was encountered at the property. No other records were in AFD files.

TOXICHEM also obtained a copy of the City of Alameda Fire Department's master UST list for all properties located in the City of Alameda. According to this list, there are approximately 50 former or existing USTs within an approximate 500-foot radius of the site. This radius is defined as the street addresses: 2235 through 2408 Lincoln Avenue, 1512 through 1721 Park Street, 2235 through 2325 Pacific Avenue, 1510 through 1630 Park Street, and 2241 through 2300 Santa Clara Avenue.

Task 6 – Review Sanborn Maps

Sanborn maps for the years 1948, 1950, 1987, and 1997 were reviewed. A gasoline service station is identified at the site in the 1948 and 1950 maps. Gasoline service stations are identified at 2332 Lincoln Avenue and 2301 Santa Clara Avenue on the maps from 1948 through 1987.

CONCLUSIONS AND RECOMMENDATIONS

Based on the findings of this investigation, TOXICHEM concludes that:

- TPPH was detected at a maximum concentration of 40 mg/kg TPPH in only Boring SB-3, which is located at the extreme southwest corner of the site, adjacent to the Lincoln Avenue and Oak Street intersection. Benzene and MtBE were not detected in any soil samples collected at the site.
- TPPH was detected at concentrations of 4,500 and 160 µg/L in Borings SPB-3 and SB-6, respectively. Boring SB-6 is located in the southwest center of the site. Benzene and MtBE were not detected in any groundwater samples

collected at the site, though benzene isomers and vinyl acetate were detected in Boring SB-3 and/or SB-6.


- The distribution of soil and groundwater impact detected at the site is not representative of an on-site release based on the locations of the former USTs and dispensers.
- Multiple sources of petroleum hydrocarbon-impacted groundwater exist within a ¼-mile radius of the site, as documented by aerial photographs, ACHCSA and AFD files, and Sanborn Maps. At least six of these sources are located within 500 feet of the site, including the former Union 76 station and Alameda Fire Department sites that are located directly across the Oak Street and Lincoln Avenue intersection to the northwest and southwest, respectively.
- Utilities are known to exist in Lincoln Avenue and Oak Street, and at a depth below grade that is within the range of groundwater elevation. This suggests that existing utilities could serve as preferential flow pathways for petroleum hydrocarbon-impacted groundwater from off-site sources.
- The direction of groundwater flow recorded at surrounding properties ranges from northwesterly to southeasterly. The direction of groundwater flow supports the conclusion that the distribution of petroleum hydrocarbons detected at the site is not representative of an on-site release.
- Boring SB-3 was located upgradient of the location of the former USTs at the site, downgradient of the former Union 76 service station and Alameda Police Department LUST sites, and adjacent to existing utilities in Oak Street and Lincoln Avenue.

Based on these conclusions, TOXICHEM recommends no further environmental investigation at the site because the petroleum hydrocarbons detected during the July 1999 investigation result from an off-site source or sources. Furthermore, TOXICHEM recommends that an unauthorized release form not be completed or reported to the ACHCSA because the evidence does not support that an unauthorized release has occurred at the site.

If you have any questions regarding this report, please contact me at your convenience at (415) 681-8816.

Sincerely,

Toxichem Management Systems, Inc.




Keith Winemiller, P.E.
Senior Engineer



Attachments: Figure 1 - Site Location Map
Figure 2 - Site Map
Attachment A - Vista Environmental Information, Inc. Documents

cc: Mr. Allan Seabanc, 10 Stacey Court, Hillsborough, CA 94010

DATE 8/10/99
REVIEWED BY
DGT
PREPARED BY

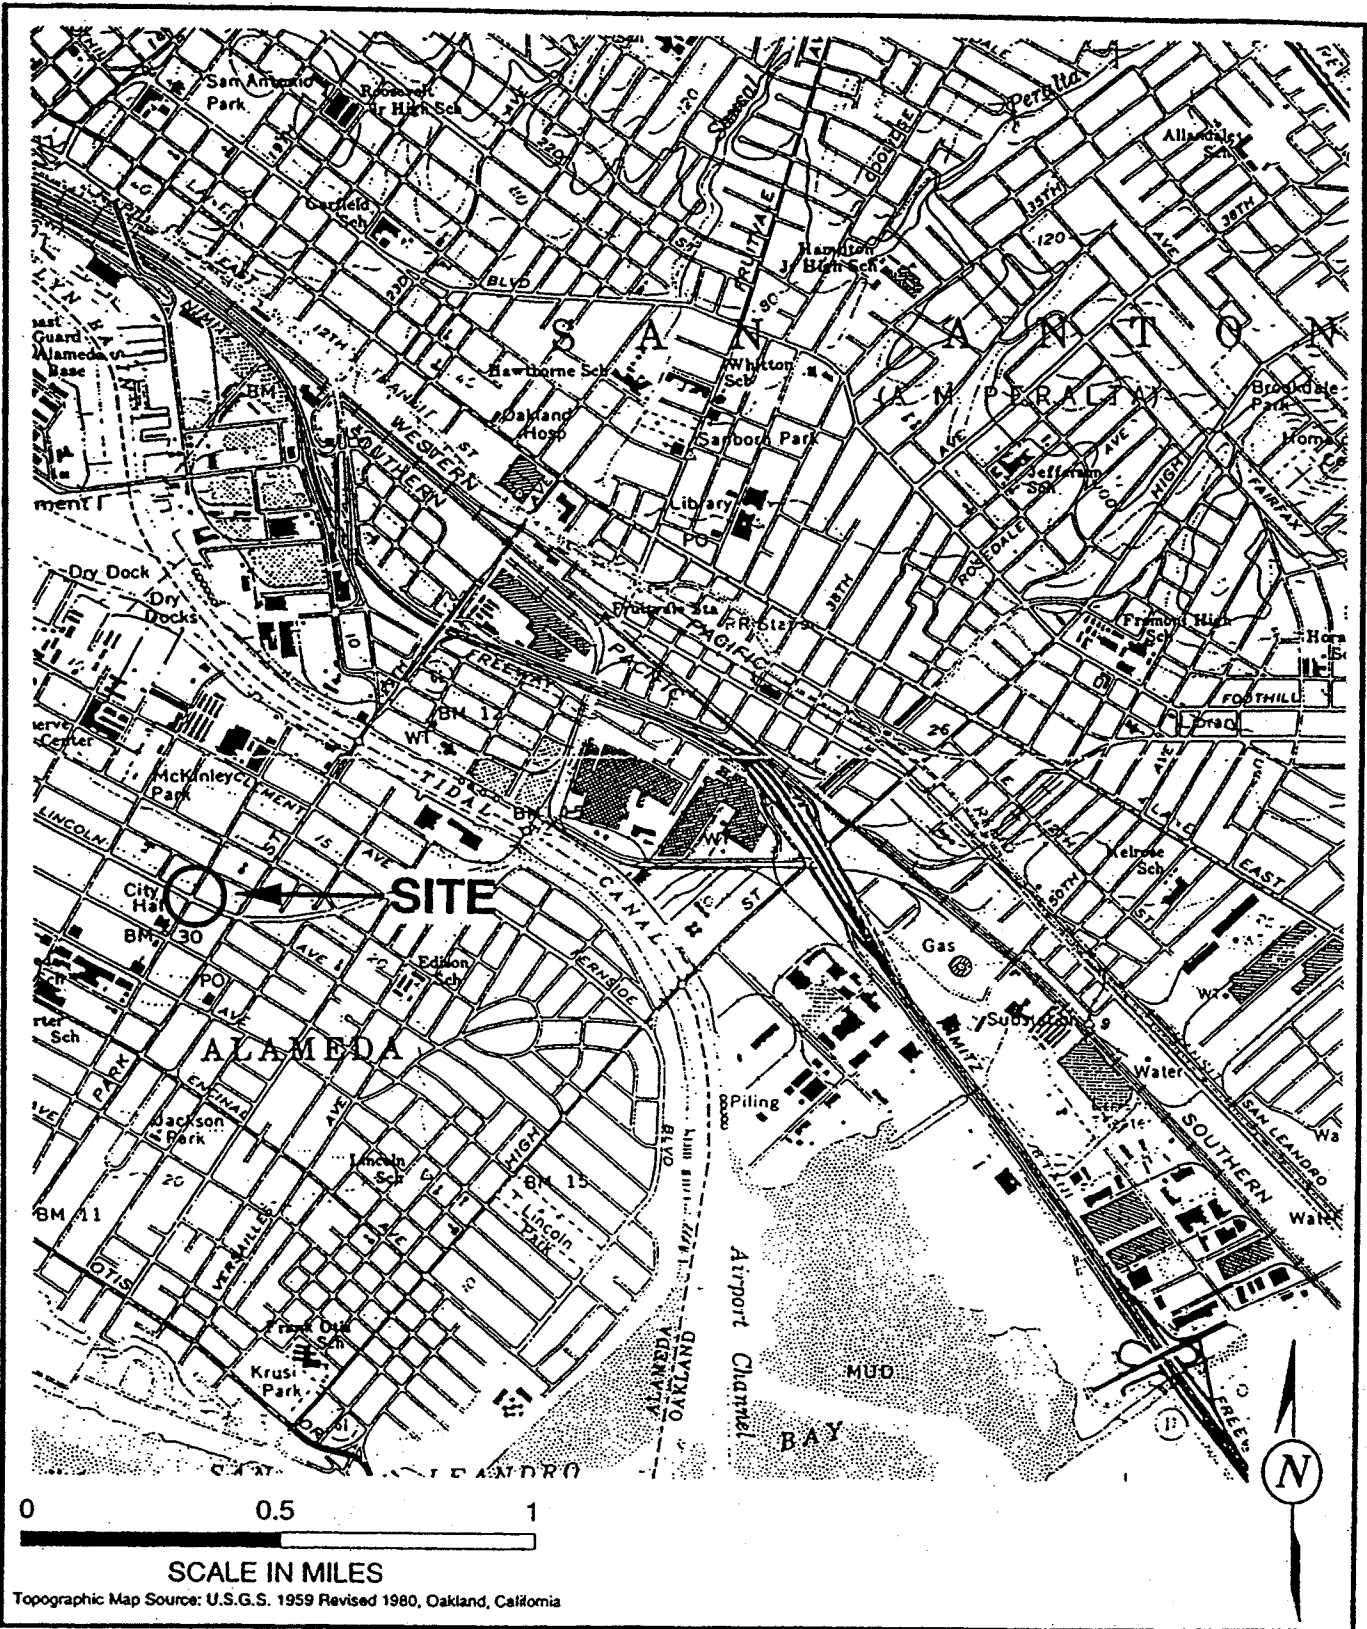

Site Location



Limited Phase II Environmental Site Investigation
2301-2307 Lincoln Avenue
Alameda, California

PROJECT NO.
99-ENV168A


DRAWING NO.

1

DATE 8/10/99

REVIEWED BY

PREPARED BY DGT

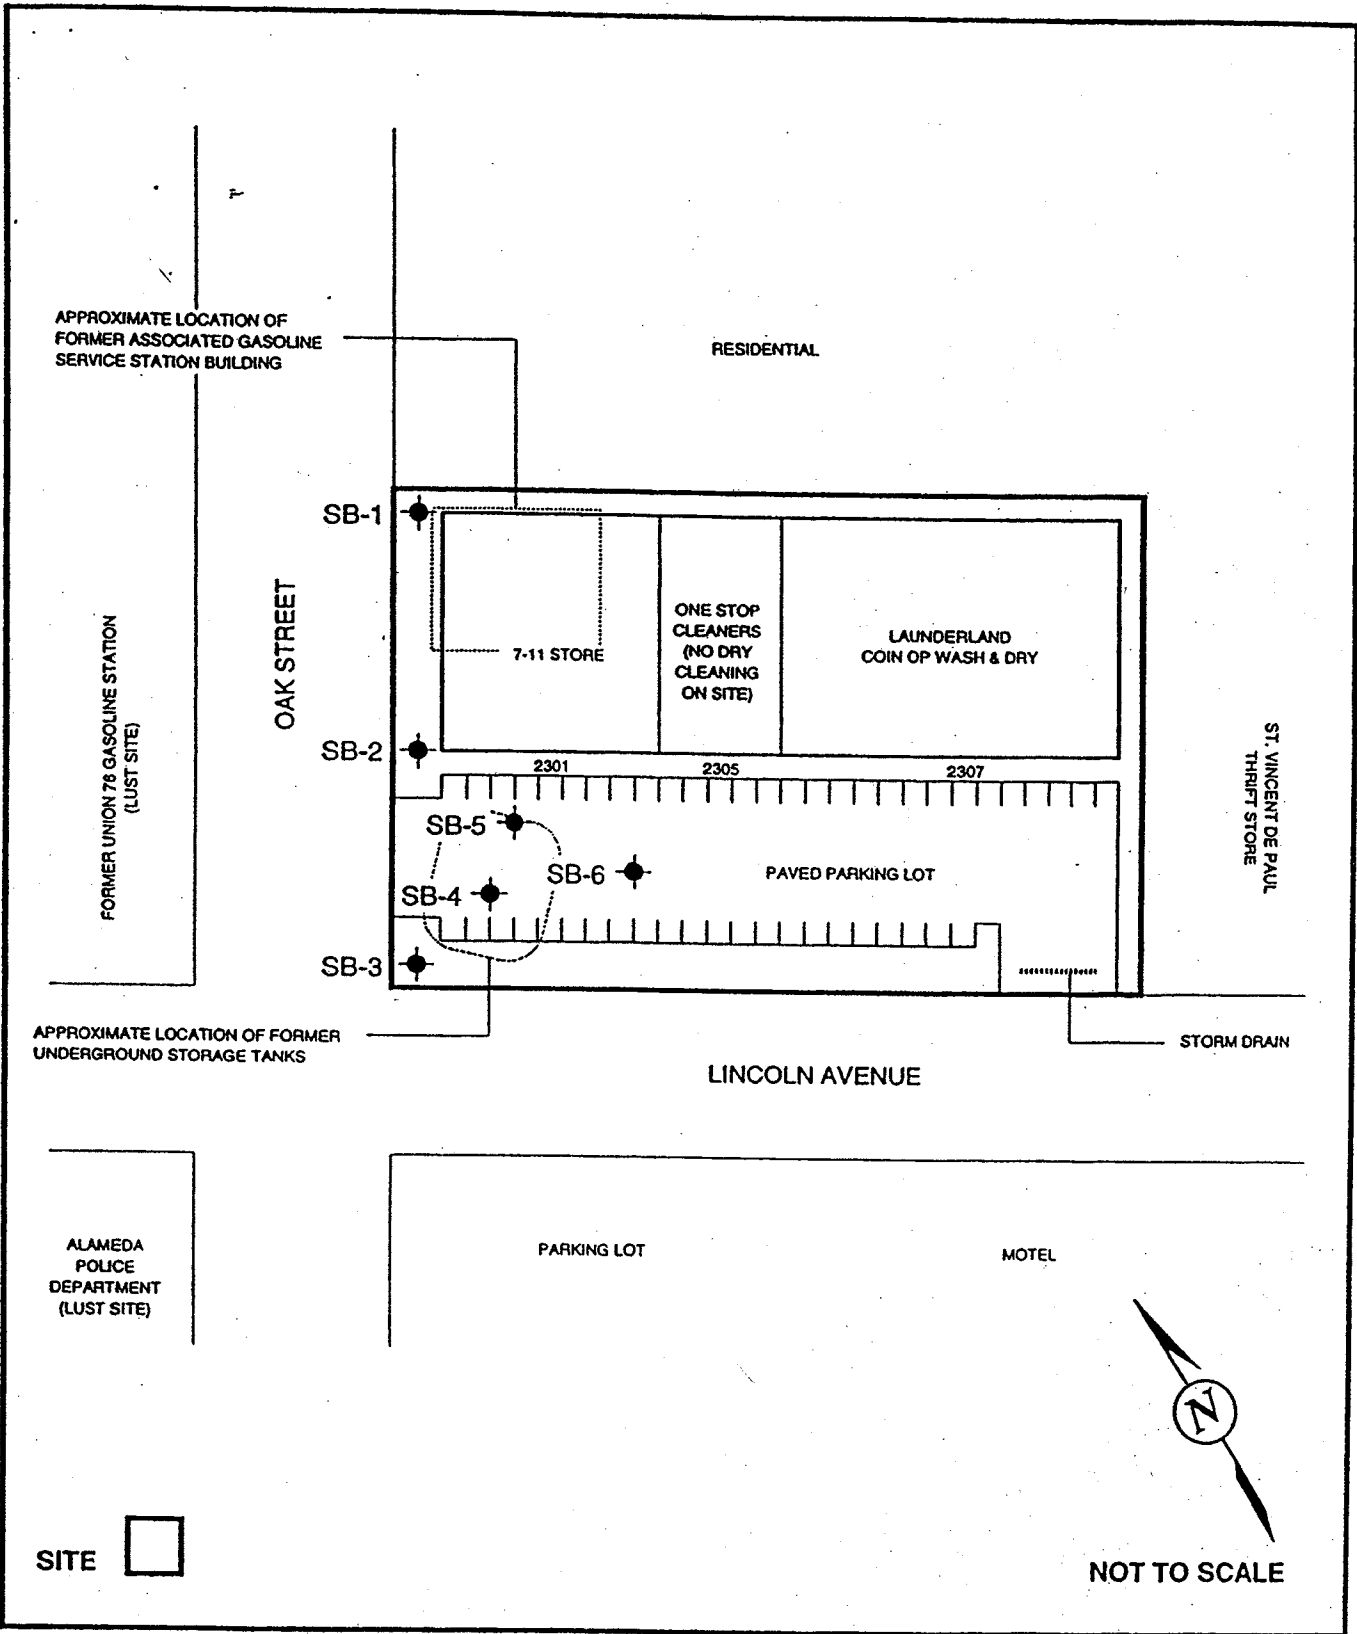

Soil Test Boring Locations



Limited Phase II Environmental Site Investigation
2301-2307 Lincoln Avenue
Alameda, California

PROJECT NO.
99-ENV168A

DRAWING NO.
2

TRCLK (5/20/02)


ATTACHMENT A

**VISTA ENVIRONMENTAL INFORMATION, INC.
DOCUMENTS**

SITE ASSESSMENT PLUS REPORT


PROPERTY INFORMATION	CLIENT INFORMATION
Project Name/Ref #: 2301-2307 Linco Former Shell Service Station 2301 Lincoln Avenue Alameda, CA 94501 Cross Street: Oak Street Latitude/Longitude: (37.766923, 122.241122)	Keith Winemiller Toxicchem Management Systems, I 1562 44th Avenue San Francisco, CA 94122

Site Distribution Summary	within 1/8 mile	1/8 to 1/4 mile	1/4 to 1/2 mile	1/2 to 1 mile
Agency / Database - Type of Records				
A) Databases searched to 1 mile:				
US EPA NPL National Priority List	0	0	0	0
US EPA CORRACTS RCRA Corrective Actions	0	0	0	1
STATE SPL State equivalent priority list	0	0	0	0
B) Databases searched to 1/2 mile:				
STATE SCL State equivalent CERCLIS list	0	0	0	-
US EPA CERCLIS / NFRAP Sites currently or formerly under review by US EPA	0	0	0	-
US EPA TSD RCRA permitted treatment, storage, disposal facilities	0	0	0	-
STATE REG CO LUST Leaking Underground Storage Tanks	14	11	19	-
STATE/REG/CO SWLF Permitted as solid waste landfills, incinerators, or transfer stations	0	0	0	-
STATE DEED RSTR Sites with deed restrictions	0	0	0	-
REGIONAL NORTH BAY Sites on North Bay Toxic List	1	0	3	-
REGIONAL SOUTH BAY Sites on South Bay Toxic List	0	0	0	-
STATE CORTESE State Index of properties with hazardous waste	7	2	6	-
STATE TOXIC PITS Toxic Pits cleanup facilities	0	0	0	-
USGS/STATE WATER WELLS Federal and State Drinking Water Sources	0	0	0	-



SITE ASSESSMENT PLUS REPORT


Map of Sites within One Mile

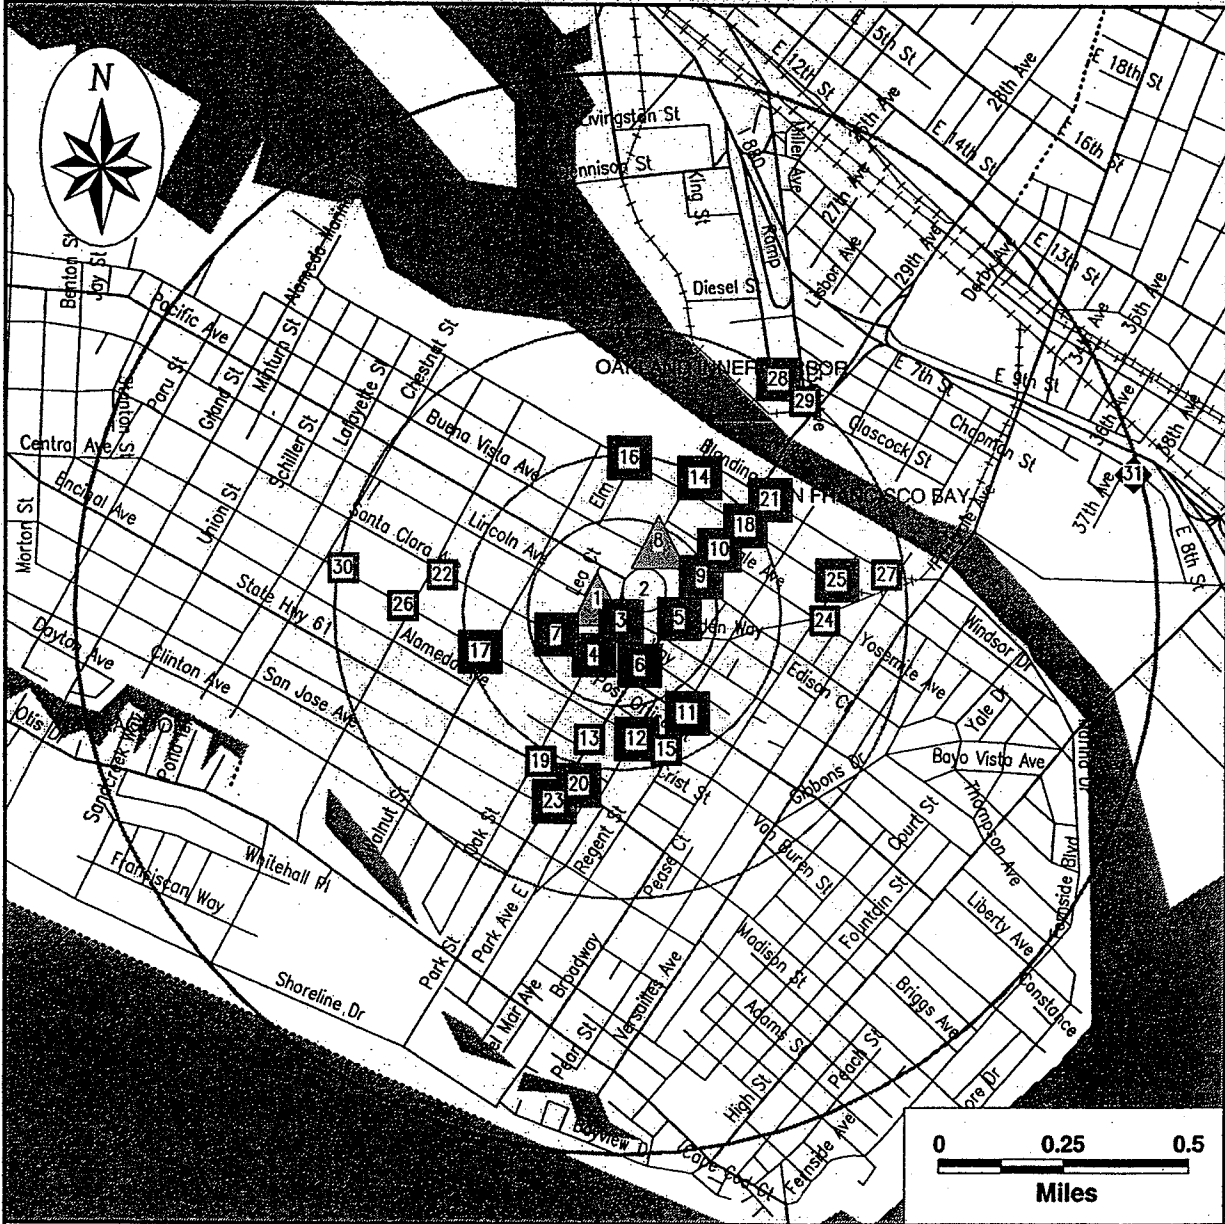

Subject Site	Category:	A	B	C	D
★	Databases Searched to:	1 mi.	1/2 mi.	1/4 mi.	1/8 mi.
	Single Sites	◆	■	▲	○
	Multiple Sites	◆	■	▲	○
Highways and Major Roads Roads Railroads Rivers or Water Bodies Utilities		NPL, SPL, CORRACTS (TSD)	CERCLIS\NFRAP, TSD, LUST, SWLF, SCL	RCRA VIOL, TRIS, UST	ERNS, GENERATORS
<p>If additional databases are listed in the cover page of the report they are also displayed on this map. The map symbol used corresponds to the database category letter A,B,C,D.</p>					


For More Information Call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403
 Report ID: 839301903

Date of Report: January 21, 2000



SITE ASSESSMENT PLUS REPORT

Map of Sites within Quarter Mile

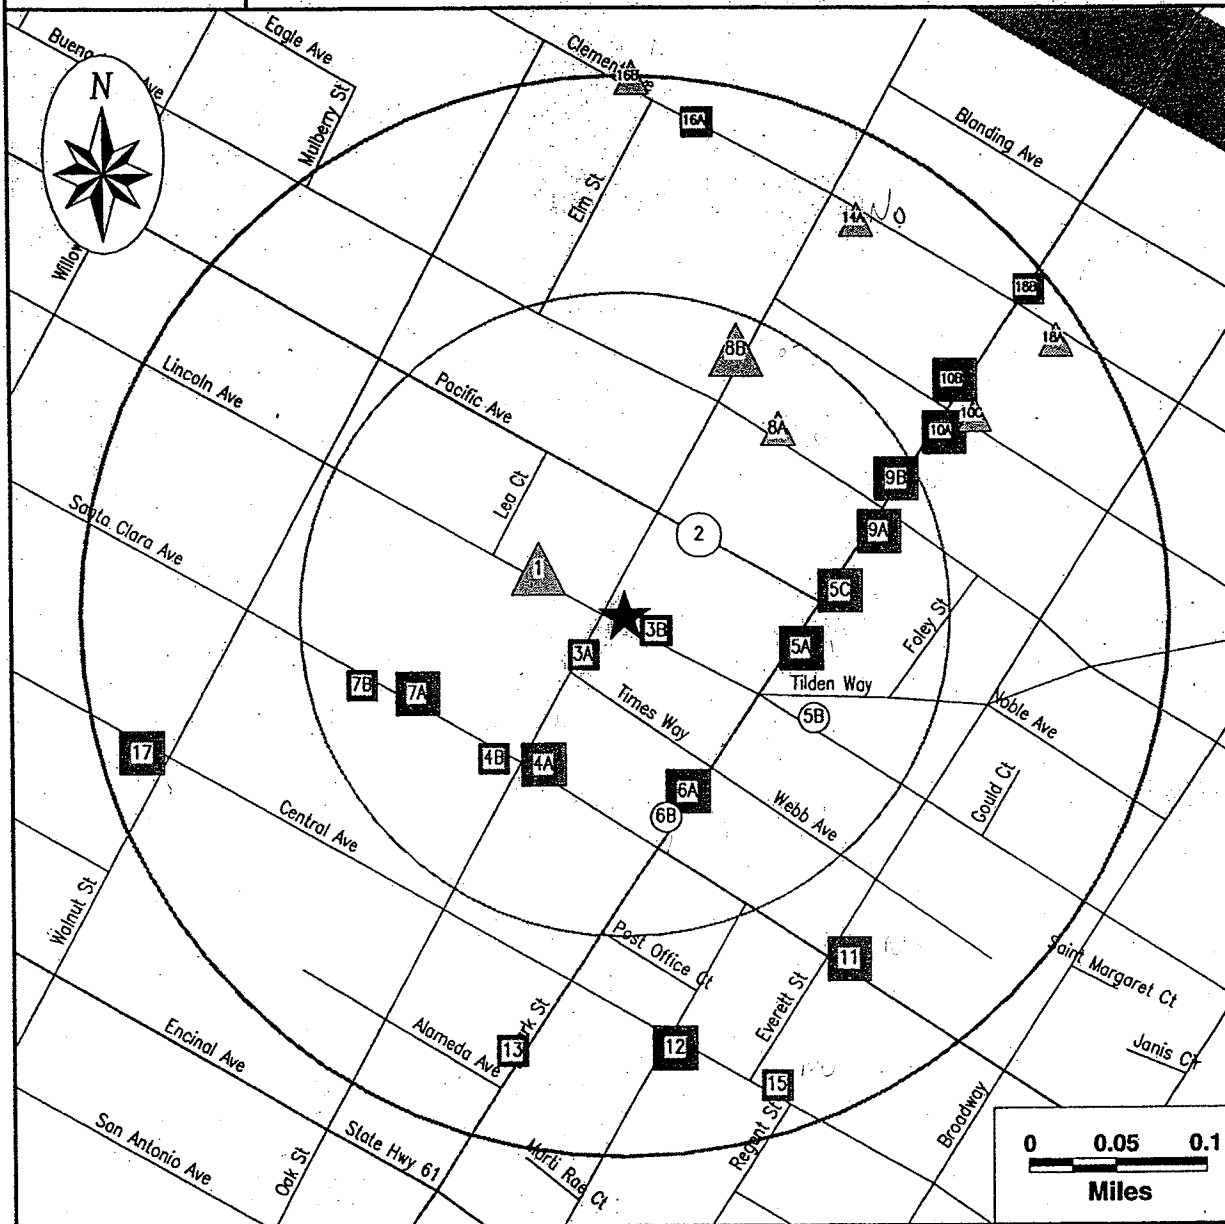


Subject Site 	Category: Databases Searched to:	A 1 mi. 	B 1/2 mi. 	C 1/4 mi. 	D 1/8 mi.
	Single Sites Multiple Sites	 	 	NPL, SPL, CORRACTS (TSD)	CERCLIS/ NFRAP, TSD, LUST, SWLF, SCL
Highways and Major Roads Roads Railroads Rivers or Water Bodies Utilities		If additional databases are listed in the cover page of the report they are also displayed on this map. The map symbol used corresponds to the database category letter A,B,C,D.			

For More Information Call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403

Report ID: 839301903


Date of Report: January 21, 2000

Page #4




SITE ASSESSMENT PLUS REPORT

Street Map

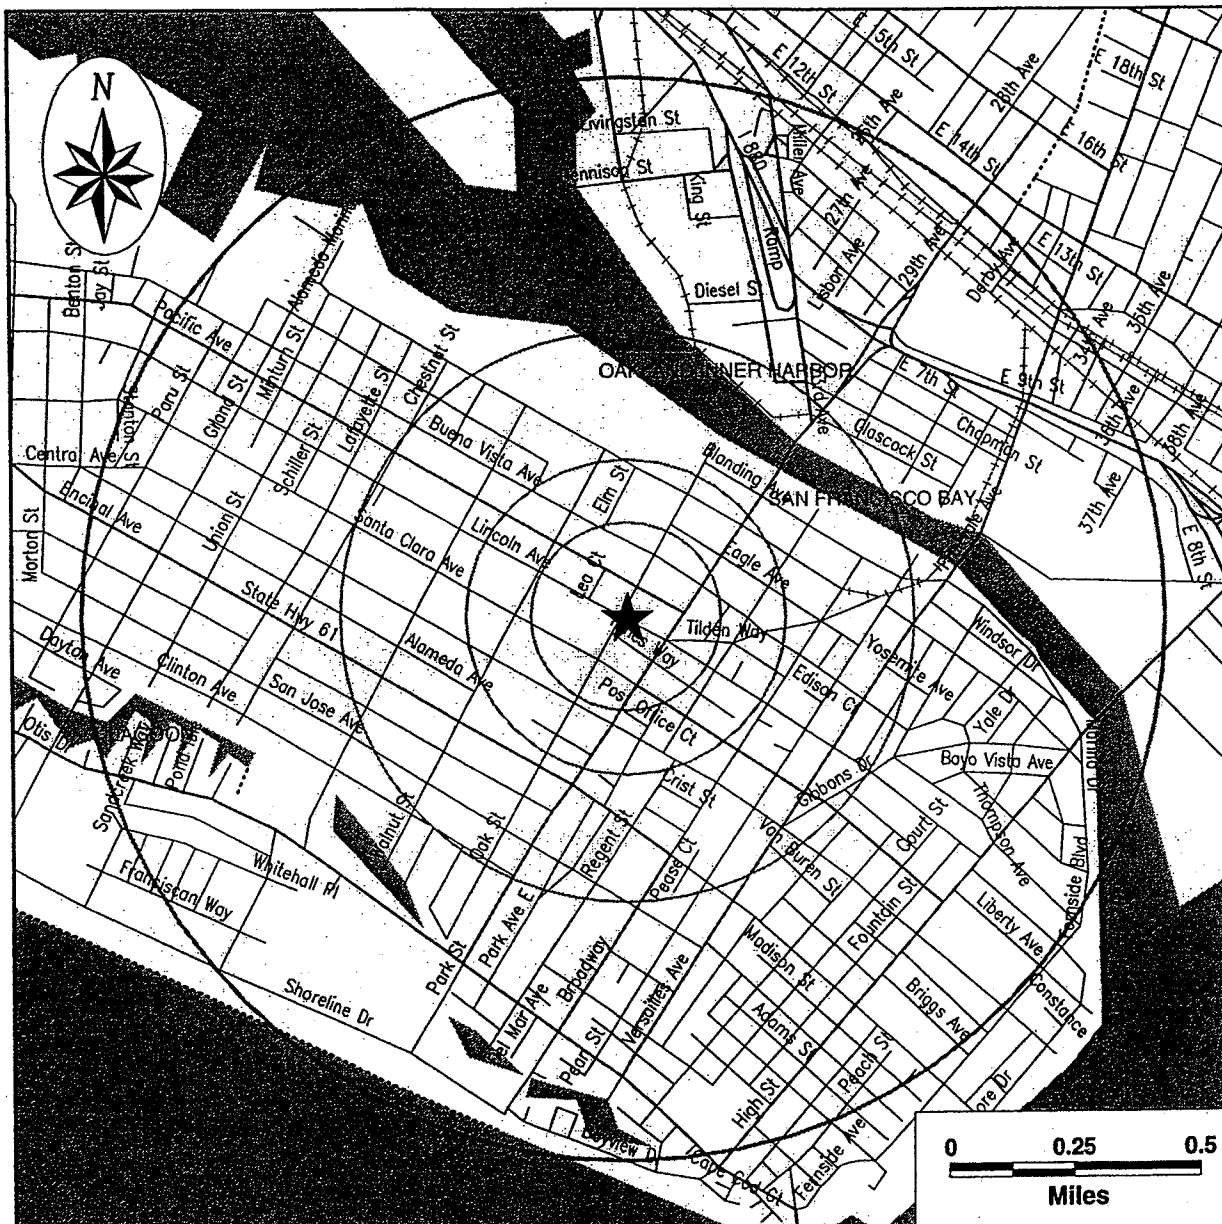

Subject Site




Highways and Major Roads
Roads
Railroads
Rivers or Water Bodies
Utilities

SITE ASSESSMENT PLUS REPORT

SITE INVENTORY

MAP ID	PROPERTY AND THE ADJACENT AREA (within 1/8 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D				
			NPL	CORRACS	SPL	SCL	CERGLIS/NFRAP	TSD	IUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORIESE	TOXIC PIIS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
1	LINCOLN-OAKS UNION #5394 2267 LINCOLN AVE ALAMEDA, CA 94501	8581869 0.00 MI NA																X		
1	UNION OIL SS #5394 2267 LINCOLN ALAMEDA, CA 94501	1255000 0.00 MI NA																X		
2	ROY L BURGE INC 2310 PACIFIC AVE ALAMEDA, CA 94501	362149 0.00 MI NA																		X
2	GOOD CHEVROLET 2329 PACIFIC AVE ALAMEDA, CA 94501	4866779 0.01 MI NE																		X
3A	ALAMEDA POLICE DEPARTMENT 1555 OAK ALAMEDA, CA 94501	929696 0.00 MI NA							X				X					X		
3B	ALAMEDA AUTO ENHANCERS 2327 LINCOLN AVE ALAMEDA, CA 94501	1594302 0.00 MI NA							X		X									
4A	BILL CHUN'S TEXACO SERVICE 2301 SANTA CLARA AVE ALAMEDA, CA 94501	1223579 0.04 MI SW																X		
4A	BILL CHUN'S SERVICE 2301 SANTA CLARA ALAMEDA, CA 94501	3781480 0.04 MI SW							X				X					X		
4B	SHELL 2300 SANTA CLARA AVE ALAMEDA, CA 94501	12640155 0.05 MI SW							X											
5A	GOOD CHEVROLET 1630 PARK ALAMEDA, CA 94501	1590942 0.04 MI E																X		
5A	GOOD CHEVROLET 1630 PARK ALAMEDA, CA 94501	7429364 0.04 MI E											X							
5A	GOOD CHEVROLET 1630 PARK ST ALAMEDA, CA 94501	174748 0.04 MI E							X									X		
5B	OIL CHANGERS 2425 LINCOLN AVE ALAMEDA, CA 94501	307503 0.06 MI SE																		X



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #6

MAP ID	PROPERTY AND THE ADJACENT AREA (within 1/8 mile)	VISTA ID DISTANCE DIRECTION	A			B							C		D					
			NPL	CORRAGIS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEEDIRSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
5C	WINNER FORD 1650 PARK ST ALAMEDA, CA 94501	278169 0.06 MI E																X		X
5C	WINNER FORD 1650 PARK ALAMEDA, CA 94501	7429366 0.06 MI E											X							
5C	WINNER FORD 1650 PARK ALAMEDA, CA 94501	4013342 0.06 MI E																X		
6A	TOSCO NORTHWEST CO NO 11266 1541 PARK ST ALAMEDA, CA 94501	5521403 0.05 MI SE																		X
6A	BP OIL CO FACILITY #11266 1541 PARK ALAMEDA, CA 94501	4013305 0.05 MI SE																X		
6A	BP 1541 PARK ALAMEDA, CA 94501	7429352 0.05 MI SE											X							
6A	BP OIL CO FACILITY #11266 1541 PARK ST ALAMEDA, CA 94501	1595478 0.05 MI SE							X									X		
6A	OWNER/OPERATOR 1522 PARK ST ALAMEDA, CA 94501	8590395 0.06 MI SE																X		
6B	ACTION DESIGN 1511 PARK ST ALAMEDA, CA 94501	3201124 0.06 MI S																		X
7A	PUBLIC WORKS DEPARTMENT 2263 SANTA CLARA ALAMEDA, CA 94501	1259127 0.07 MI W																X		
7A	CITY OF ALAMEDA 2263 SANTA CLARA AVE ALAMEDA, CA 94501	6605317 0.07 MI W							X											
7B	FOWLER ANDERSON MORTUARY 2244 SANTA CLARA ST ALAMEDA, CA 94501	1596248 0.10 MI W							X											
8A	RESIDENCE 2329 BUENA VISTA ALAMEDA, CA 94501	8571733 0.08 MI NE																X		
8B	WINNER FORD INC 1835 OAK ST ALAMEDA, CA 94501	5209723 0.10 MI NE																		X
8B	SKS DIE CASTING INC. 1849 OAK ST. ALAMEDA, CA 94501	4244392 0.11 MI NE															X			X



X = search criteria; * = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #7

MAP ID	PROPERTY AND THE ADJACENT AREA (within 1/8 mile)	VISTA ID DISTANCE DIRECTION	A			B							C		D					
			NPL	CORRACTS	SPL	SCI	CERCLIS/NIRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
8B	ALAMEDA PLANT 1849 OAK ALAMEDA, CA 94501	1262173 0.11 MI NE																X		
9A	CAVANAUGH MOTORS, INC. 1700 PARK ST ALAMEDA, CA 94501	73893 0.09 MI E						X										X		
9A	CAVANAUGH MOTORS, INC. 1700 PARK ALAMEDA, CA 94501	4013353 0.09 MI E																X		
9A	CAVANAUGH MOTORS CHRYSLER PLYM 1700 PARK ST ALAMEDA, CA 94501	778146 0.09 MI E																		X
9B	XTRA OIL CO. DBA SHELL OIL 1701 PARK ST ALAMEDA, CA 94501	4558636 0.11 MI E																X		
9B	XTRA OIL COMPANY 1701 PARK ALAMEDA, CA 94501	7429374 0.11 MI E											X							
9B	XTRA OIL CO DBA SHELL OIL 1701 PARK ALAMEDA, CA 94501	4013356 0.11 MI E																X		
9B	XTRA OIL COMPANY 1701 PARK ST ALAMEDA, CA 94501	1226876 0.11 MI E						X												
9B	EXXON REGAL 1725 PARK ALAMEDA, CA 94501	7429380 0.12 MI NE											X							
9B	EXXON # 70104 #405 1725 PARK ALAMEDA, CA 94501	4013369 0.12 MI NE																X		
9B	EXXON REGAL 1725 PARK ST ALAMEDA, CA 94501	929700 0.12 MI NE						X										X	X	
9B	EXXON REGAL 1725 PARK ST ALAMEDA, CA 94501	12640032 0.12 MI NE						X												
9B	ALAMEDA FOREIGN AUTO 1726 PARK ALAMEDA, CA 94501	4013371 0.12 MI E																X		
9B	JOHN B HENRY ESTATE 1726 PARK ST ALAMEDA, CA 94501	11499173 0.12 MI E						X												
9B	ALAMEDA FOREIGN AUTO REPAIR 1726 PARK ST ALAMEDA, CA 94501	8590396 0.12 MI E																X		



X = search criteria; * = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #8

MAP ID	SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)	VISTA ID DISTANCE DIRECTION	A			B								C		D				
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SIWF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS
10A	GONSALVES SONS 1800 PARK ST ALAMEDA, CA 94501	8590397 0.15 MI NE																X		
10A	UNKNOWN 1800 PARK ST ALAMEDA, CA 94501	3781437 0.15 MI NE						X												
10B	CHEVRON #4463 1801 PARK ST ALAMEDA, CA 94501	7032728 0.17 MI NE						X										X		
10B	FORMER CHEVRON STATION #9 1801 PARK ALAMEDA, CA 94501	7429392 0.17 MI NE										X								
10B	CHEVRON #4463 1801 PARK ALAMEDA, CA 94501	4013385 0.17 MI NE																X		
10B	RON GOODE TOYOTA INC 1825 PARK ALAMEDA, CA 94501	4013392 0.18 MI NE																X		
10B	RON GOODE TOYOTA INC 1825 PARK AVE ALAMEDA, CA 94501	360009 0.18 MI NE						X										X		•
10C	ROCKYS AUTO BODY 2405 EAGLE AVE ALAMEDA, CA 94501	486927 0.17 MI NE													X					•
11	MERRITT TIRE 2501 SANTA CLARA ALAMEDA, CA 94501	929701 0.17 MI SE																X		
11	GOODMAN PROPERTY 2501 SANTA CLARA AVE ALAMEDA, CA 94501	11499307 0.17 MI SE						X												
12	AUTOMOTIVE AUTO REPAIR 2425 CENTRAL AVE ALAMEDA, CA 94501	929686 0.19 MI S						X												
12	STAHL WOODRIDGE CONSTRUCTION 2428 CENTRAL AVE ALAMEDA, CA 94501	5353490 0.19 MI S						X												
12	CHEVRON 2428 CENTRAL ALAMEDA, CA 94501	5353489 0.19 MI S										X								
13	VACANT BUILDING 1347 PARK ST ALAMEDA, CA 94501	8590393 0.20 MI S						X										X		
14A	OWNER/OPERATOR SCHILLER CLEMENT ALAMEDA, CA 94501	8573845 0.20 MI NE																X		



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903


Date of Report: January 21, 2000

Version 2.6.1

Page #9

MAP ID	SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)	VISTA ID DISTANCE DIRECTION	A			B							C		D							
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORIESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR	
15	CELIA HARRIS TRUST 2521 CENTRAL ALAMEDA, CA 94501	4222471 0.22 MI S																		X		
16A	CLEMENT AVENUE PROJECT 2235 CLEMENT AVE ALAMEDA, CA 94501	1145638 0.23 MI N																			X	
16B	RELIANCE SHEET STRIP COMPANY 2235 CLEMENT ALAMEDA, CA 94501	1228566 0.25 MI N																			X	
17	ALAMEDA CITY UNIFIED SCH DIST 2200 CENTRAL AVE ALAMEDA, CA 94501	10274 0.23 MI W																			X	
17	HISTORIC ALAMEDA HIGH SCHOOL 2200 CENTRAL AVE ALAMEDA, CA 94501	8574503 0.23 MI W																			X	
17	HISTORIC ALAMEDA HIGH SCHOOL 2200 CENTRAL ALAMEDA, CA 94501	3781271 0.23 MI W																			X	
18A	RON GOODE TOYOTA 2424 CLEMENT ALAMEDA, CA 94501	4022257 0.23 MI NE																			X	•
18B	ALAMEDA COLLISION REPAIR INC 1911 PARK ST ALAMEDA, CA 94501	10268 0.24 MI NE																			X	•

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	VISTA ID DISTANCE DIRECTION	A			B							C		D							
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORIESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR	
14	PARK ST LANDING 2301 BLANDING ALAMEDA, CA 94501	4222386 0.29 MI NE																			X	
16	FOX PROPERTY 2229 CLEMENT AVE ALAMEDA, CA 94501	6531934 0.25 MI N																			X	
16	2229 CLEMENT AVENUE 2229 CLEMENT AVE ALAMEDA, CA 94501	3781264 0.25 MI N																			X	
19	ALAMEDA LOCK GLASS 2301 ENCINAL AVE ALAMEDA, CA 94501	8576918 0.27 MI SW																			X	•



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #10

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	VISTA ID DISTANCE DIRECTION	A			B								C		D							
			NPL	CORRACTS	SPL	SCL	CERCLIS/INFRAP	TSD	IUST	SWIF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR		
20	ALAMEDA FIRE DEPARTMENT 2401 ENCINAL AVE ALAMEDA, CA 94501	4222555 0.28 MI S																		X			
20	ALAMEDA CELLARS 2425 ENCINAL ALAMEDA, CA 94501	1584361 0.29 MI S												X									
21	ALLIED ENGINEERING AND PROD CO 2421 BLANDING AVE ALAMEDA, CA 94501	13043 0.30 MI NE																			X		
21	ALAMEDA ELECTRIC 2420 BLANDING ALAMEDA, CA 94501	3781216 0.31 MI NE																					X
21	DOLLRES STAUDENRAUS 2424 BLANDING AVE ALAMEDA, CA 94501	6669292 0.31 MI NE																					X
22	GHIDELLA RESIDENCE 2110 SANTA CLARA AVE ALAMEDA, CA 94501	11499306 0.30 MI W																					X
23	ARCO 1260 PARK ST ALAMEDA, CA 94501	1587496 0.33 MI SW																					X
23	ARCO 1260 PARK ALAMEDA, CA 94501	7429314 0.33 MI SW																					X
24	ALAMEDA UNIFIED SCHOOL DISTRICT 2615 EAGLE AVE ALAMEDA, CA 94501	1254196 0.34 MI E																					X
25	CAMISA BROS ROOFING 1901 BROADWAY ALAMEDA, CA 94501	11498549 0.37 MI E																					X
25	CAMISA BROS ROOFING 1901 BROADWAY ALAMEDA, CA 94501	5520262 0.37 MI E																					X
26	PACIFIC BELL (Q3-004) 2100 CENTRAL ALAMEDA, CA 94501	315062 0.37 MI W																					X
27	ALPHA BETA 2691 BLANDING ALAMEDA, CA 94501	5352029 0.46 MI E																					X
28	RIGHT AWAY REDY MIX, INC. 401 KENNEDY OAKLAND, CA 94606	3078920 0.48 MI NE																					X
28	RHODES JAMIESON BATCH PLANT 333 KENNEDY OAKLAND, CA 94606	1585693 0.50 MI NE																					X



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903


Date of Report: January 21, 2000

Version 2.6.1

Page #11

MAP ID	SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D					
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRIR
29	CHEVRON 333 23RD AVE OAKLAND, CA 94606	3867311 0.49 MI NE						X			X										
30	GOLDEN WEST ENVIRONMENTAL SER 2017 CENTRAL AVE ALAMEDA, CA 94501	4222470 0.49 MI W						X													

MAP ID	SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile)	VISTA ID DISTANCE DIRECTION	A			B							C			D					
			NPL	CORRACTS	SPL	SCL	CERCLIS/NFRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRIR
31	AMERICAN NATIONAL CAN CO. 3801 E. 8TH ST OAKLAND, CA 94601	481033 0.99 MI E	X				•	•								•					•



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #12

UNMAPPED SITES	VISTA ID	A			B								C		D					
		NPL	CORRAGS	SPL	SCL	GERCLIS/N/FRAP	TSD	LUST	SWLF	DEED RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRR
OWNER/OPERATOR WALNUT ST ALAMEDA, CA 94501	8599186																	X		
OWNER/OPERATOR NORTH END OF EVERETT ALAMEDA, CA 94501	8577197																	X		
BETHLEHEM STEEL WEBSTER NORTH END ALAMEDA, CA 94501	8598743																	X		
NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA 94501	12713938						X													
ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA 94501	12713937						X													
FLEET INDUSTRIAL SUPPLY CNTR 7TH MARITIME ST OAKLAND, CA 94625	7006090																	X		
XTRA OIL CO. (SHELL) 03RD ST ALAMEDA, CA 94501	6848371																	X		
ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA	12666629						X													
OAKLAND ARMY BASE BLDG 812-828-5-POVTAL OAKLAND, CA 94623	8566540																		X	
ROADWAY EXPRESS, INC 1125 27TH AVE OAKLAND, CA	7291475						X													
NAS ALAMEDA B 117 AVE G ALAMEDA, CA 94501	7432471											X								
NAVY TRANSPORTATION MAINT/SHOP NAVAL SUPPLY CENTER OAKLAND, CA 94623	8587613																	X		
NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA	12666650						X													
GALLAGHER BURKE INC 7100 BOUNTAIN BLVD OAKLAND, CA 94623	247661						X													
PORT OF OAKLAND HANGER 6 11007 AIRPORT OAKLAND, CA 94614	7431274											X								



X = search criteria; * = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #13

UNMAPPED SITES	VISTA ID	A				B								C			D			
		NPL	CORRACTS	SPL	SCL	CERCLIS/INFRAP	TSD	LUIS	SWLF	DEED/RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRTR
FLEET INDUSTRIAL SUPPLY C 541 ACRES EASTERN SHORE OF TH OAKLAND, CA 94625	7431148																			
SF-OAK BAY BRIDGE CALTRANS BAY BRIDGE TOLL PLAZA OAKLAND, CA 94623	8573092																	X		
HARBOR TRANSPORTATION CENTER 250 EXECUTIVE WAY OAKLAND, CA 94625	12361902																	X		
ALAMEDA (DISTRICT 7) ALAMEDA, CA	6612672																	X		
OAKLAND FUEL FACILITIES CORP. TANK FARM S - S. FIELD OAKLAND, CA	4924439																	X		
GENERAL ELECTRIC COMPANY 100 WOODLAWN AVENUE OAKLAND, CA	4826802								X											
EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA	12666907							X												
OAKLAND ARMY BASE (FORMERLY ASI LEA OAKLAND, CA 94626	4823458									X										
EAST BAY REGIONAL PARK DISTRICT 0 TILDEN PARK OAKLAND, CA	12667445							X												
7 0 L 827 TRACON OAKLAND, CA	12667122							X												
CROWLEY MARITIME CORPORATION PACIFIC DRY DOCK AND REPAIR YD OAKLAND, CA	4570533									X										
OAKLAND ARMY BASE (FORMERLY ASI LEA OAKLAND, CA	4570445									X										
PORT OAKLAND: OAKLAND AIRPORT HANGER #6 OAKLAND, CA	1593878									X										
ROUND TOP RADIO (CAO480) 5.3 MILES NE OAKLAND CIVIC CEN OAKLAND, CA	6613560																	X		
S SPILL-SCHNITZER STEEL PRODUCT CO. FOOT OF ADELIN ST. OAKLAND, CA	3593659									X										
HAYWARD LIMITED 30104 INDUSTRIAL PKWY SW HAYWARD, CA	7291068							X												



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.


Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #14

UNMAPPED SITES	VISTA ID	A				B							C			D				
		NPL	CORRACTS	SPL	SCL	GERCLIS/NFRAP	TSD	LUST	SWLF	DEED/RSTR	NORTH BAY	SOUTH BAY	CORTESE	TOXIC PITS	WATER WELLS	RCRA VIOL	TRIS	UST/AST	ERNS	GNRR
UPTOWN THEATER DISTRICT UNKNOWN OAKLAND, CA	12714497						X													
OH OLSEN 2220 4TH ST BERKELEY, CA	7291419						X													
OAKLAND INTERNATIONAL AIRPORT OAKLAND INTERNATIONAL AIRPORT OAKLAND, CA	7291755						X													
UNION POINT WATERFRONT PARK 2301 EMBARCADERO ST OAKLAND, CA	12714405						X													
PORT OF OAKLAND LANA KAI MARINA OAKLAND, CA	1594330									X										
PORT OF OAKLAND - KING INTERESTS SI OAKLAND AIRPORT OAKLAND, CA	1595209									X										



X = search criteria; • = tag-along (beyond search criteria).

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #15

SITE ASSESSMENT PLUS REPORT

DETAILS


PROPERTY AND THE ADJACENT AREA (within 1/8 mile)

VISTA Address*	LINCINN-OAKS UNION #5394 2267 LINCOLN AVE ALAMEDA, CA 94501	VISTA ID#:	8581869
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point
STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	1001U	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

Map ID
1

VISTA Address*	UNION OIL SS #5394 2267 LINCOLN ALAMEDA, CA 94501	VISTA ID#:	1255000
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point
STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	14	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	280 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	14	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	14	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL

Map ID
1



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #16

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	ROY L BURGE INC 2310 PACIFIC AVE ALAMEDA, CA 94501	VISTA ID#:	362149
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point

Map ID
2

RCRA-SmGen - RCRA-Small Generator / SRC# 6379		EPA ID:	CAD028779304
Agency Address:	SAME AS ABOVE		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		

VISTA Address*:	GOOD CHEVROLET 2329 PACIFIC AVE ALAMEDA, CA 94501	VISTA ID#:	4866779
		Distance/Direction:	0.01 MI / NE
		Plotted as:	Point

Map ID
2

RCRA-SmGen - RCRA-Small Generator / SRC# 6379		EPA ID:	CA0000033514
Agency Address:	GOOD CHEVROLET PAINT SHOP 2329 PACIFIC AVE ALAMEDA, CA 94501		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		


VISTA Address*:	ALAMEDA POLICE DEPARTMENT 1555 OAK ALAMEDA, CA 94501	VISTA ID#:	929696
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point

Map ID
3A

STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	6000 (GALLONS)	Tank Material:	OTHER DESCRIPTIONS

CORTESE / SRC# 4840		Agency ID:	01-0051
Agency Address:	ALAMEDA POLICE DEPARTMENT 1555 OAK ALAMEDA, CA		
List Name:	LEAKING TANK		
Site ID:	01-0051		

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA POLICE DEPARTMENT 1555 OAK ST ALAMEDA, CA 94501		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #17

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.


STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA POLICE DEPARTMENT 1555 OAK ST ALAMEDA, CA 01-0051		
Facility ID:	01-0051		
Leak Report Date:	7/2/86		
Site Assessment Began:	6/4/86		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 7/2/86 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TANK ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/24/94		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA POLICE DEPARTMENT 1555 OAK ST ALAMEDA, CA 94501 01-0051		
Facility ID:	01-0051		
Leak Report Date:	07/02/86		
Site Assessment Began:	06/04/86		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	ALAMEDA AUTO ENHANCERS 2327 LINCOLN AVE ALAMEDA, CA 94501	VISTA ID#:	1594302
		Distance/Direction:	0.00 MI / NA
		Plotted as:	Point

Map ID
3B

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA AUTO ENHANCERS 2327 LINCOLN AVE ALAMEDA, CA 0150234		
Facility ID:	0150234		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #18

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	BILL CHUN'S TEXACO SERVICE 2301 SANTA CLARA AVE ALAMEDA, CA 94501	VISTA ID#:	1223579
		Distance/Direction:	0.04 MI / SW
		Plotted as:	Point

Map ID
4A

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE


VISTA Address*:	BILL CHUN'S SERVICE 2301 SANTA CLARA ALAMEDA, CA 94501	VISTA ID#:	3781480
		Distance/Direction:	0.04 MI / SW
		Plotted as:	Point

Map ID
4A

STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	285 (GALLONS)	Tank Material:	SEC. CONTAINMENT
Tank ID:	T001U	Tank Status:	OTHER
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	550 (GALLONS)	Tank Material:	SEC. CONTAINMENT
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	550 (GALLONS)	Tank Material:	SEC. CONTAINMENT

CORTESE / SRC# 4840	Agency ID:	01-1063
Agency Address:	BILL CHUN SERVICE STATION 2301 SANTA CLARA ALAMEDA, CA 94501	
List Name:	LEAKING TANK	
Site ID:	01-1063	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	BILL CHUN SERVICE STATION 2301 SANTA CLARA AVE ALAMEDA, CA 01-1063		
Facility ID:	01-1063		
Leak Report Date:	7/31/92		
Site Assessment Plan Submitted:	1/4/93		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #19

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 7/31/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/3/98


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	BILL CHUN SERVICE STATION 2301 SANTA CLARA AVE ALAMEDA, CA 94501		
Facility ID:	01-1063		
Leak Report Date:	07/31/92		
Site Assessment Plan Submitted:	01/04/93		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	SHELL 2300 SANTA CLARA AVE ALAMEDA, CA 94501	VISTA ID#:	12640155
		Distance/Direction:	0.05 MI / SW
		Plotted as:	Point

Map ID
4B

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	SHELL 2300 SANTA CLARA AVE ALAMEDA, CA		
Facility ID:	01-2387		
Leak Report Date:	11/29/95		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: HOW STOPPED: ENFORCEMENT: ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 1/21/98		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2387		
Leak Report Date:	11/29/95		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #20

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Substance:	GASOLINE
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:

VISTA Address*:	GOOD CHEVROLET 1630 PARK ALAMEDA, CA 94501	VISTA ID#:	1590942
		Distance/Direction:	0.04 MI / E
		Plotted as:	Point

Map ID
5A

STATE UST - State Underground Storage Tank / SRC# 1612

Agency Address:	SAME AS ABOVE
Underground Tanks:	5
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED


Tank ID:	00035300	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	550 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	00035300	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	00035300	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	4000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	00035300	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	OTHER DESCRIPTIONS
Tank Size (Units):	4000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	00035300	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	300 (GALLONS)	Tank Material:	UNKNOWN

VISTA Address*:	GOOD CHEVROLET 1630 PARK ALAMEDA, CA 94501	VISTA ID#:	7429364
		Distance/Direction:	0.04 MI / E
		Plotted as:	Point

Map ID
5A

CORTESE / SRC# 4840

Agency Address:	SAME AS ABOVE
List Name:	LEAKING TANK
Site ID:	01-0711



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address:	GOOD CHEVROLET 1630 PARK ST ALAMEDA, CA 94501	VISTA ID#:	174748
		Distance/Direction:	0.04 MI / E
		Plotted as:	Point

Map ID
5A

STATE UST - State Underground Storage Tank / SRC# 5275 EPA/Agency ID: N/A


Agency Address:	SAME AS ABOVE		
Underground Tanks:	3		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	000001	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428 EPA/Agency ID: N/A

Agency Address:	GOOD CHEVROLET 1630 PARK ST ALAMEDA, CA 01-0711		
Facility ID:	01-0711		
Leak Report Date:	1/15/87		
Site Assessment Began:	4/29/87		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 5/21/87 HOW STOPPED: CLOSE TANK ENFORCEMENT; WARNING ENFORCEMENT DATE: 12/12/91		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 7/9/98		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A

Agency Address:	SAME AS ABOVE		
Facility ID:	01-0711		
Leak Report Date:	01/15/87		
Site Assessment Began:	04/29/87		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #22

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	OIL CHANGERS 2425 LINCOLN AVE ALAMEDA, CA 94501	VISTA ID#:	307503
		Distance/Direction:	0.06 MI / SE
		Plotted as:	Point

Map ID

5B

ERNS - Emergency Response Notification System / SRC# 6181		Agency ID:	487173
Agency Address:	OIL CHANGER 2425 LINCOLN AVE ALAMEDA, CA		
Spill Date Time:	JUNE 10, 1999 05:30:00 PM		
Case Number:	487173		
Spill Location:	2425 LINCOLN AVE		
Discharger Name:	OIL CHANGER		
Discharger Org:	OIL CHANGER		
Material Spilled:	OIL MIXED WITH WATER, 0.00 (UNK)		
Waterway Affected:	STORM DRAINS		
Fields Not Reported:	Source Agency, Discharger Phone		
Air Release:	Land Release:	Water Release:	Ground Release: Facility Release:
NO	NO	NO	NO
			Other Release: NO

VISTA Address*:	WINNER FORD 1650 PARK ST ALAMEDA, CA 94501	VISTA ID#:	278169
		Distance/Direction:	0.06 MI / E
		Plotted as:	Point


Map ID

5C

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

RCRA-SmGen - RCRA-Small Generator / SRC# 6379		EPA ID:	CAD981581309
Agency Address:	ALAMEDA FORD 1650 PARK ST ALAMEDA, CA 94501		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	WINNER FORD 1650 PARK ST ALAMEDA, CA		
Facility ID:	01-2193		
Leak Report Date:	8/10/95		
Contamination Confirmed Date:	11/11/96		
Remediation Start Date:	1/22/98		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 2/1/94 HOW STOPPED: REMOVE CONTENTS ENFORCEMENT: ENFORCEMENT DATE:		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1


Page #23

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Remediation Status:	REMEDIAL ACTION UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 4/22/99
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A	
Agency Address:	SAME AS ABOVE
Facility ID:	01-2193
Leak Report Date:	08/10/95
Contamination Confirmed Date:	11/11/96
Remediation Start Date:	01/22/98
Substance:	GASOLINE
Remediation Status:	REMEDIAL ACTION UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:

VISTA Address*:	WINNER FORD 1650 PARK ALAMEDA, CA 94501	VISTA ID#:	7429366	Map ID 5C
		Distance/Direction:	0.06 MI / E	
		Plotted as:	Point	
CORTESE / SRC# 4840		Agency ID:	01-2193	
Agency Address:	SAME AS ABOVE			
List Name:	LEAKING TANK			
Site ID:	01-2193			

VISTA Address*:	WINNER FORD 1650 PARK ALAMEDA, CA 94501	VISTA ID#:	4013542	Map ID 5C
		Distance/Direction:	0.06 MI / E	
		Plotted as:	Point	
STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A	
Agency Address:	SAME AS ABOVE			
Underground Tanks:	2			
Aboveground Tanks:	NOT REPORTED			
Tanks Removed:	NOT REPORTED			
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE	
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()	
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN	
Tank Size (Units):	150 (GALLONS)	Tank Material:	UNKNOWN	
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE	
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()	
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN	
Tank Size (Units):	500 (GALLONS)	Tank Material:	UNKNOWN	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #24

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*	TOSCO NORTHWEST CO NO 11266 1541 PARK ST ALAMEDA, CA 94501	VISTA ID#:	5521403
		Distance/Direction:	0.05 MI / SE
		Plotted as:	Point
RCRA-SmGen - RCRA-Small Generator / SRC# 6379		EPA ID:	CA0001036995
Agency Address:		SAME AS ABOVE	
Generator Class:		Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste	

Map ID
6A

VISTA Address*	BP OIL CO FACILITY #11266 1541 PARK ALAMEDA, CA 94501	VISTA ID#:	4013305
		Distance/Direction:	0.05 MI / SE
		Plotted as:	Point


Map ID
6A

STATE-UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		4	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	600 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	12000 (GALLONS)	Tank Material:	FIBERGLASS

VISTA Address*	BP 1541 PARK ALAMEDA, CA 94501	VISTA ID#:	7429352
		Distance/Direction:	0.05 MI / SE
		Plotted as:	Point

Map ID
6A

CORTESE / SRC# 4840		Agency ID:	01-0221
Agency Address:		SAME AS ABOVE	
List Name:		LEAKING TANK	
Site ID:		01-0221	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #25

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address:	BP OIL CO FACILITY #11266 1541 PARK ST ALAMEDA, CA 94501	VISTA ID#:	1595478
		Distance/Direction:	0.05 MI / SE
		Plotted as:	Point

Map ID
6A

STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
---	----------------	-----


Agency Address:	BP OIL CO. SITE #11266 1541 PARK ST ALAMEDA, CA 94501		
Underground Tanks:	4		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	00035300	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	BP 1541 PARK ST ALAMEDA, CA 01-0221		
Facility ID:	01-0221		
Leak Report Date:	10/19/87		
Site Assessment Plan Submitted:	10/12/87		
Site Assessment Began:	2/9/88		
Pollution Characterization Date:	3/22/89		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 9/15/87 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	POLLUTION CHARACTERIZATION		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 9/29/95		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	BP 1541 PARK ST ALAMEDA, CA 94501		
Facility ID:	01-0221		
Leak Report Date:	10/19/87		
Site Assessment Plan Submitted:	10/12/87		
Site Assessment Began:	02/09/88		
Pollution Characterization Date:	03/22/89		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	POLLUTION CHARACTERIZATION		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #26

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Description / Comment: COUNTY: ALAMEDA STREET: REVIEW DATE:

VISTA Address*:	OWNER/OPERATOR 1522 PARK ST ALAMEDA, CA 94501	VISTA ID#:	8590395
		Distance/Direction:	0.06 MI / SE
		Plotted as:	Point

Map ID
6A

STATE UST - State Underground Storage Tank / SRC# 5275 EPA/Agency ID: N/A

Agency Address: SAME AS ABOVE
 Underground Tanks: NOT REPORTED
 Aboveground Tanks: NOT REPORTED
 Tanks Removed: NOT REPORTED

Tank ID:	U001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	ACTION DESIGN 1511 PARK ST ALAMEDA, CA 94501	VISTA ID#:	3201124
		Distance/Direction:	0.06 MI / S
		Plotted as:	Point

Map ID
6B

RCRA-SmGen - RCRA-Small Generator / SRC# 6379 EPA ID: CAD983636374

Agency Address: SAME AS ABOVE
 Generator Class: Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste

VISTA Address*:	PUBLIC WORKS DEPARTMENT 2263 SANTA CLARA ALAMEDA, CA 94501	VISTA ID#:	1259127
		Distance/Direction:	0.07 MI / W
		Plotted as:	Point

Map ID
7A

STATE UST - State Underground Storage Tank / SRC# 1612 EPA/Agency ID: N/A


Agency Address: SAME AS ABOVE
 Underground Tanks: 2
 Aboveground Tanks: NOT REPORTED
 Tanks Removed: NOT REPORTED

Tank ID:	U001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	GALVANIZED STEEL
Tank Size (Units):	280 (GALLONS)	Tank Material:	BARE STEEL

Tank ID:	U001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	GALVANIZED STEEL
Tank Size (Units):	1000 (GALLONS)	Tank Material:	UNKNOWN

STATE UST - State Underground Storage Tank / SRC# 5275 EPA/Agency ID: N/A

Agency Address: PUBLIC WORKS DEPARTMENT
 2263 SANTA CLARA AVE
 ALAMEDA, CA 94501
 Underground Tanks: NOT REPORTED
 Aboveground Tanks: NOT REPORTED
 Tanks Removed: NOT REPORTED



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Tank ID:	U001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE


VISTA Address*:	CITY OF ALAMEDA 2263 SANTA CLARA AVE ALAMEDA, CA 94501	VISTA ID#:	6605317	Map ID 7A
		Distance/Direction:	0.07 MI / W	
		Plotted as:	Point	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA CITY OF 2263 SANTA CLARA AVE ALAMEDA, CA	
Facility ID:	01-2152	
Leak Report Date:	6/24/94	
Contamination Confirmed Date:	6/11/96	
Case Closed Date:	6/18/96	
Leak Cause:	UNKNOWN	
Leak Source:	UNKNOWN	
Substance:	GASOLINE	
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/7/96	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA CITY OF 2263 SANTA CLARA AVE ALAMEDA, CA 94501	
Facility ID:	01-2152	
Leak Report Date:	06/24/94	
Contamination Confirmed Date:	06/11/96	
Case Closed Date:	06/18/96	
Substance:	GASOLINE	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:	

VISTA Address*:	FOWLER ANDERSON MORTUARY 2244 SANTA CLARA ST ALAMEDA, CA 94501	VISTA ID#:	1596248	Map ID 7B
		Distance/Direction:	0.10 MI / W	
		Plotted as:	Point	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	FOWLER ANDERSON MORTUARY 2244 SANTA CLARA AVE ALAMEDA, CA	
Facility ID:	01-0657	
Leak Report Date:	1/11/91	



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Site Assessment Began:	2/28/91
Case Closed Date:	9/3/92
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	STOP DATE: 1/11/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 1/26/93

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	FOWLER ANDERSON MORTUARY 2244 SANTA CLARA AVE ALAMEDA, CA 94501		
Facility ID:	01-0657		
Leak Report Date:	01/11/91		
Site Assessment Began:	02/28/91		
Case Closed Date:	09/03/92		
Substance:	GASOLINE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	RESIDENCE 2329 BUENA VISTA ALAMEDA, CA 94501	VISTA ID#:	8571733
		Distance/Direction:	0.08 MI / NE
		Plotted as:	Point


Map ID
8A

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	1001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	WINNER FORD INC 1835 OAK ST ALAMEDA, CA 94501	VISTA ID#:	5209723
		Distance/Direction:	0.10 MI / NE
		Plotted as:	Point

Map ID
8B

RCRA-SmGen - RCRA-Small Generator / SRC# 6379		EPA ID:	CA0000384495
Agency Address:	ALLSTAR FORD INC 1835 OAK ST ALAMEDA, CA 94501		
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #29

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	SKS DIE CASTING INC. 1849 OAK ST. ALAMEDA, CA 94501	VISTA ID#:	4244392
		Distance/Direction:	0.11 MI / NE
		Plotted as:	Point

Map ID
8B

TRIS - Toxic Release Inventory System / SRC# 4946	EPA ID:	CAD00019303N
--	---------	--------------

Agency Address:	SAME AS ABOVE
Chemical Abstract Service Registry:	Quantity Released:
1,1,1-TRICHLOROETHANE	8822.00 (POUNDS)

RCRA-SmGen - RCRA-Small Generator / SRC# 6379	EPA ID:	CAD009205048
--	---------	--------------

Agency Address:	<i>SKS DIE CASTING AND MACHINING 1849 OAK ST ALAMEDA, CA 94501</i>
Generator Class:	<i>Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste</i>

VISTA Address*:	ALAMEDA PLANT 1849 OAK ALAMEDA, CA 94501	VISTA ID#:	1262173
		Distance/Direction:	0.11 MI / NE
		Plotted as:	Point

Map ID
8B

STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A
---	----------------	-----

Agency Address:	SAME AS ABOVE
Underground Tanks:	1
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED

Tank ID:	001U	Tank Status:	CLOSED REMOVED
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	250 (GALLONS)	Tank Material:	BARE STEEL

STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
---	----------------	-----

Agency Address:	<i>ALAMEDA PLANT 1849 OAK ST ALAMEDA, CA 94501</i>
Underground Tanks:	NOT REPORTED
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED


Tank ID:	001U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	CAVANAUGH MOTORS, INC. 1700 PARK ST ALAMEDA, CA 94501	VISTA ID#:	73893
		Distance/Direction:	0.09 MI / E
		Plotted as:	Point

Map ID
9A


STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
---	----------------	-----

Agency Address:	SAME AS ABOVE
Underground Tanks:	NOT REPORTED
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Tank ID:	<i>T001U</i>	Tank Status:	<i>REMOVED</i>
Tank Contents:	<i>NOT AVAILABLE</i>	Leak Monitoring:	<i>NOT AVAILABLE</i>
Tank Age:	<i>NOT REPORTED</i>	Tank Piping:	<i>NOT AVAILABLE</i>
Tank Size (Units):	<i>NOT REPORTED (NOT AVAILABLE)</i>	Tank Material:	<i>NOT AVAILABLE</i>
STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	<i>N/A</i>
Agency Address:	<i>CAVANAUGH MOTORS 1700 PARK ST ALAMEDA, CA 01-0291</i>		
Facility ID:	<i>01-0291</i>		
Leak Report Date:	<i>12/15/89</i>		
Site Assessment Plan Submitted:	<i>4/13/90</i>		
Site Assessment Began:	<i>6/8/90</i>		
Pollution Characterization Date:	<i>4/15/91</i>		
Case Closed Date:	<i>12/9/96</i>		
Leak Cause:	<i>STRUCTURE FAILURE</i>		
Leak Source:	<i>TANK</i>		
Substance:	<i>GASOLINE</i>		
Remediation Event:	<i>STOP DATE: 4/16/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:</i>		
Remediation Status:	<i>CASE CLOSED</i>		
Media Affected:	<i>OTHER GROUND WATER</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET: REVIEW DATE: 12/9/96</i>		
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	<i>N/A</i>
Agency Address:	<i>CAVANAUGH MOTORS 1700 PARK ST ALAMEDA, CA 94501 01-0291</i>		
Facility ID:	<i>01-0291</i>		
Leak Report Date:	<i>12/15/89</i>		
Site Assessment Plan Submitted:	<i>04/13/90</i>		
Site Assessment Began:	<i>06/08/90</i>		
Pollution Characterization Date:	<i>04/15/91</i>		
Case Closed Date:	<i>12/09/96</i>		
Substance:	<i>GASOLINE</i>		
Remediation Status:	<i>CASE CLOSED</i>		
Media Affected:	<i>OTHER GROUND WATER</i>		
Lead Agency:	<i>LOCAL AGENCY</i>		
Region / District:	<i>SAN FRANCISCO BAY RE</i>		
Description / Comment:	<i>COUNTY: ALAMEDA X STREET: REVIEW DATE:</i>		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #31

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	CAVANAUGH MOTORS, INC. 1700 PARK ALAMEDA, CA 94501	VISTA ID#:	4013353
		Distance/Direction:	0.09 MI / E
		Plotted as:	Point

Map ID
9A

STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	SAME AS ABOVE
Underground Tanks:	2
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED

Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	550 (GALLONS)	Tank Material:	UNKNOWN

Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	OIL(NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	300 (GALLONS)	Tank Material:	UNKNOWN

VISTA Address*:	CAVANAUGH MOTORS CHRYSLER PLYM 1700 PARK ST ALAMEDA, CA 94501	VISTA ID#:	3778146
		Distance/Direction:	0.09 MI / E
		Plotted as:	Point

Map ID
9A

RCRA-SmGen - RCRA-Small Generator / SRC# 6379	EPA ID:	CAD981417447
---	---------	--------------

Agency Address:	CAVANAUGH MOTOR CHRYSLER PLYMOUTH 1700 PARK ST ALAMEDA, CA 945011416
Generator Class:	Generates 100 kg./month but less than 1000 kg./month of non-acutely hazardous waste

VISTA Address*:	XTRA OIL CO. DBA SHELL OIL 1701 PARK ST ALAMEDA, CA 94501	VISTA ID#:	4558636
		Distance/Direction:	0.11 MI / E
		Plotted as:	Point

Map ID
9B

STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	SAME AS ABOVE
Underground Tanks:	3
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED


Tank ID:	T001U	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	XTRA OIL COMPANY 1701 PARK ALAMEDA, CA 94501	VISTA ID#:	7429374
		Distance/Direction:	0.11 MI / E
		Plotted as:	Point

Map ID
9B

CORTESE / SRC# 4840	Agency ID:	01-1950
---------------------	------------	---------

Agency Address:	SAME AS ABOVE
List Name:	LEAKING TANK
Site ID:	01-1950



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #32

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	XTRA OIL CO DBA SHELL OIL 1701 PARK ALAMEDA, CA 94501	VISTA ID#:	4013356
		Distance/Direction:	0.11 MI / E
		Plotted as:	Point

Map ID
9B

STATE UST - State Underground Storage Tank / SRC# 1612 EPA/Agency ID: N/A


Agency Address:	SAME AS ABOVE		
Underground Tanks:	4		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	DIESEL	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	BARE STEEL

VISTA Address*:	XTRA OIL COMPANY 1701 PARK ST ALAMEDA, CA 94501	VISTA ID#:	1226876
		Distance/Direction:	0.11 MI / E
		Plotted as:	Point

Map ID
9B

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428 EPA/Agency ID: N/A

Agency Address:	XTRA OIL COMPANY 1701 PARK ST ALAMEDA, CA
Facility ID:	01-1950
Leak Report Date:	4/8/94
Contamination Confirmed Date:	7/5/94
Remediation Start Date:	1/29/98
Leak Cause:	UNKNOWN
Leak Source:	UNKNOWN
Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE: 4/8/94 HOW STOPPED: REMOVE CONTENTS ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	REMEDIAL ACTION UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: BUENA VISTA REVIEW DATE: 5/25/99



PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-1950	
Leak Report Date:	04/08/94	
Contamination Confirmed Date:	07/05/94	
Remediation Start Date:	01/29/98	
Substance:	GASOLINE	
Remediation Event:	NO ACTION TAKEN	
Remediation Status:	REMEDIAL ACTION UNDERWAY	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: BUENA VISTA REVIEW DATE:	

VISTA Address*:	EXXON REGAL 1725 PARK ALAMEDA, CA 94501	VISTA ID#:	7429380
		Distance/Direction:	0.12 MI / NE
		Plotted as:	Point


Map ID
9B

CORTESE / SRC# 4840	Agency ID:	01-0602
Agency Address:	SAME AS ABOVE	
List Name:	LEAKING TANK	
Site ID:	01-0602	

VISTA Address*:	EXXON # 70104 #405 1725 PARK ALAMEDA, CA 94501	VISTA ID#:	4013369
		Distance/Direction:	0.12 MI / NE
		Plotted as:	Point

Map ID
9B

STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A	
Agency Address:	SAME AS ABOVE		
Underground Tanks:	5		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	NOT REPORTED (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	5000 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #34

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (*)
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS

VISTA Address:	EXXON REGAL 1725 PARK ST ALAMEDA, CA 94501	VISTA ID#:	929700
		Distance/Direction:	0.12 MI / NE
		Plotted as:	Point

Map ID

9B

STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
---	-----------------------	-----

Agency Address:	EXXON R/S #7-0104 1725 PARK ST ALAMEDA, CA 94501
Underground Tanks:	3
Aboveground Tanks:	NOT REPORTED
Tanks Removed:	NOT REPORTED

Tank ID:	T001U	Tank Status:	CURRENT
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE


ERNS - Emergency Response Notification System / SRC# 6181	Agency ID:	91-5278
--	-------------------	---------

Agency Address:	EXXON 1725 PARK ST. WELL #7-0104 ALAMEDA, CA 94501
Spill Date Time:	JULY 26, 1991 08:30:00 AM
Case Number:	91-5278
Spill Location:	1725 PARK ST. WELL #7-0104
Source Agency:	E
Discharger Org:	EXXON
Material Spilled:	GASOLINE, 0.00 (UNK)
Waterway Affected:	NONE
Fields Not Reported:	Discharger Name, Discharger Phone

Air Release:	Land Release:	Water Release:	Ground Release:	Facility Release:	Other Release:
NO	NO	NO	NO	NO	NO

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
--	-----------------------	-----

Agency Address:	EXXON REGAL 1725 PARK ST ALAMEDA, CA 01-0602
Facility ID:	
Leak Report Date:	7/25/91
Site Assessment Began:	6/24/88
Pollution Characterization Date:	3/21/89
Remediation Plan Date:	9/23/91
Remediation Start Date:	3/24/98
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	GASOLINE
Remediation Event:	PUMP AND TREAT GROUND WATER



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #35

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.


Remediation Event:	STOP DATE: 8/9/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 12/12/91
Remediation Status:	REMEDIAL ACTION UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 5/17/99

VISTA Address*:	EXXON REGAL 1725 PARK ST ALAMEDA, CA 94501	VISTA ID#:	12640032	Map ID 9B
		Distance/Direction:	0.12 MI / NE	
		Plotted as:	Point	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0602		
Leak Report Date:	07/25/91		
Site Assessment Began:	06/24/88		
Pollution Characterization Date:	03/21/89		
Remediation Plan Date:	09/23/91		
Remediation Start Date:	03/24/98		
Substance:	GASOLINE		
Remediation Event:	PUMP AND TREAT GROUND WATER		
Remediation Status:	REMEDIAL ACTION UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:		

VISTA Address*:	ALAMEDA FOREIGN AUTO 1726 PARK ALAMEDA, CA 94501	VISTA ID#:	4013371	Map ID 9B
		Distance/Direction:	0.12 MI / E	
		Plotted as:	Point	

STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	150 (GALLONS)	Tank Material:	BARE STEEL



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #36

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

VISTA Address*:	JOHN B HENRY ESTATE 1726 PARK ST ALAMEDA, CA 94501	VISTA ID#:	11499173
		Distance/Direction:	0.12 MI / E
		Plotted as:	Point

Map ID

9B

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	JOHN B HENRY ESTATE 1726 PARK ST ALAMEDA, CA		
Facility ID:	01-0008		
Leak Report Date:	5/12/92		
Site Assessment Plan Submitted:	5/12/92		
Case Closed Date:	10/23/96		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 5/12/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 10/24/96		


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0008		
Leak Report Date:	05/12/92		
Site Assessment Plan Submitted:	05/12/92		
Case Closed Date:	10/23/96		
Substance:	GASOLINE		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	ALAMEDA FOREIGN AUTO REPAIR 1726 PARK ST ALAMEDA, CA 94501	VISTA ID#:	8590396
		Distance/Direction:	0.12 MI / E
		Plotted as:	Point

Map ID

9B

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #37

PROPERTY AND THE ADJACENT AREA (within 1/8 mile) CONT.

Tank ID:	TU	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE


SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile)

VISTA Address*:	GONSALVES SONS 1800 PARK ST ALAMEDA, CA 94501	VISTA ID#:	8590397
		Distance/Direction:	0.15 MI / NE
		Plotted as:	Point
STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Underground Tanks:		NOT REPORTED	
Aboveground Tanks:		NOT REPORTED	
Tanks Removed:		NOT REPORTED	
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

Map ID
10A

VISTA Address*:	UNKNOWN 1800 PARK ST ALAMEDA, CA 94501	VISTA ID#:	3781437
		Distance/Direction:	0.15 MI / NE
		Plotted as:	Point
STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:		UNKNOWN 1800 PARK ST ALAMEDA, CA 01-1559	
Facility ID:		01-1559	
Leak Report Date:		2/16/92	
Case Closed Date:		11/3/95	
Leak Cause:		STRUCTURE FAILURE	
Leak Source:		TANK	
Substance:		GASOLINE	
Remediation Event:		NO ACTION TAKEN	
Remediation Event:		STOP DATE: 2/16/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:		CASE CLOSED	
Media Affected:		SOIL ONLY	
Lead Agency:		LOCAL AGENCY	
Region / District:		SAN FRANCISCO BAY RE	
Description / Comment:		COUNTY: ALAMEDA STREET: REVIEW DATE: 8/24/94	
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:		SAME AS ABOVE	
Facility ID:		01-1559	
Leak Report Date:		02/16/92	
Case Closed Date:		11/03/95	

Map ID
10A



SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Substance:	GASOLINE
Remediation Event:	NO ACTION TAKEN
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:


VISTA Address*:	CHEVRON #4463 1801 PARK ST ALAMEDA, CA 94501	VISTA ID#:	7032728
		Distance/Direction:	0.17 MI / NE
		Plotted as:	Point

Map ID
10B

STATE UST - State Underground Storage Tank / SRC# 5275	EPA/Agency ID:	N/A
Agency Address:	CHEVRON STN. #94463 1801 PARK ST ALAMEDA, CA 94501	
Underground Tanks:	NOT REPORTED	
Aboveground Tanks:	NOT REPORTED	
Tanks Removed:	NOT REPORTED	
Tank ID:	600018U	Tank Status: REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring: NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping: NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material: NOT AVAILABLE

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	CHEVRON 1801 PARK ST ALAMEDA, CA 01-2119	
Facility ID:	01-2119	
Leak Report Date:	10/18/95	
Contamination Confirmed Date:	6/5/97	
Case Closed Date:	3/4/98	
Leak Cause:	UNKNOWN	
Leak Source:	UNKNOWN	
Substance:	GASOLINE	
Remediation Event:	STOP DATE: 10/18/95 HOW STOPPED: CLOSE TANK ENFORCEMENT ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 3/6/98	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	CHEVRON 1801 PARK ST ALAMEDA, CA 94501	
Facility ID:	01-2119	
Leak Report Date:	10/18/95	
Contamination Confirmed Date:	06/05/97	
Case Closed Date:	03/04/98	
Substance:	GASOLINE	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #39

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:

VISTA Address*:	FORMER CHEVRON STATION #9 1801 PARK ALAMEDA, CA 94501	VISTA ID#:	7429392
		Distance/Direction:	0.17 MI / NE
		Plotted as:	Point

Map ID
10B

CORTESE / SRC# 4840	Agency ID:	01-2219
Agency Address:	SAME AS ABOVE	
List Name:	LEAKING TANK	
Site ID:	01-2219	

VISTA Address*:	CHEVRON #4463 1801 PARK ALAMEDA, CA 94501	VISTA ID#:	4013385
		Distance/Direction:	0.17 MI / NE
		Plotted as:	Point

Map ID
10B


STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Underground Tanks:	3	
Aboveground Tanks:	NOT REPORTED	
Tanks Removed:	NOT REPORTED	

Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	FIBERGLASS
Tank Size (Units):	10000 (GALLONS)	Tank Material:	FIBERGLASS

VISTA Address*:	RON GOODE TOYOTA INC 1825 PARK ALAMEDA, CA 94501	VISTA ID#:	4013392
		Distance/Direction:	0.18 MI / NE
		Plotted as:	Point

Map ID
10B

STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Underground Tanks:	2	
Aboveground Tanks:	NOT REPORTED	
Tanks Removed:	NOT REPORTED	



SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Tank ID:	<i>T001U</i>	Tank Status:	<i>CLOSED REMOVED</i>
Tank Contents:	<i>UNLEADED GAS</i>	Leak Monitoring:	<i>Agency Code ()</i>
Tank Age:	<i>NOT REPORTED</i>	Tank Piping:	<i>UNKNOWN</i>
Tank Size (Units):	<i>550 (GALLONS)</i>	Tank Material:	<i>UNKNOWN</i>
Tank ID:	<i>T001U</i>	Tank Status:	<i>CLOSED REMOVED</i>
Tank Contents:	<i>OIL(NOT SPECIFIED)</i>	Leak Monitoring:	<i>Agency Code ()</i>
Tank Age:	<i>NOT REPORTED</i>	Tank Piping:	<i>UNKNOWN</i>
Tank Size (Units):	<i>200 (GALLONS)</i>	Tank Material:	<i>UNKNOWN</i>

VISTA Address*:	RON GOODE TOYOTA INC 1825 PARK AVE ALAMEDA, CA 94501	VISTA ID#:	360009
		Distance/Direction:	0.18 MI / NE
		Plotted as:	Point

Map ID
10B

STATE UST - State Underground Storage Tank / SRC# 5275 EPA/Agency ID: N/A


Agency Address:	<i>RON GOODE TOYOTA</i> <i>1825 PARK ST</i> <i>ALAMEDA, CA 94501</i>
Underground Tanks:	<i>NOT REPORTED</i>
Aboveground Tanks:	<i>NOT REPORTED</i>
Tanks Removed:	<i>NOT REPORTED</i>
Tank ID:	<i>14</i>
Tank Status:	<i>REMOVED</i>
Tank Contents:	<i>NOT AVAILABLE</i>
Leak Monitoring:	<i>NOT AVAILABLE</i>
Tank Age:	<i>NOT REPORTED</i>
Tank Piping:	<i>NOT AVAILABLE</i>
Tank Size (Units):	<i>NOT REPORTED (NOT AVAILABLE)</i>
Tank Material:	<i>NOT AVAILABLE</i>

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428 EPA/Agency ID: N/A

Agency Address:	<i>RON GOODE TOYOTA</i> <i>1825 PARK ST</i> <i>ALAMEDA, CA</i> <i>01-1258</i>
Facility ID:	<i>01-1258</i>
Leak Report Date:	<i>12/27/90</i>
Site Assessment Began:	<i>12/31/91</i>
Case Closed Date:	<i>1/10/97</i>
Leak Cause:	<i>STRUCTURE FAILURE</i>
Leak Source:	<i>TANK</i>
Substance:	<i>WASTE OIL</i>
Remediation Event:	<i>NO ACTION TAKEN</i>
Remediation Event:	<i>STOP DATE: 12/27/90HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:</i>
Remediation Status:	<i>CASE CLOSED</i>
Media Affected:	<i>OTHER GROUND WATER</i>
Lead Agency:	<i>LOCAL AGENCY</i>
Region / District:	<i>SAN FRANCISCO BAY RE</i>
Description / Comment:	<i>COUNTY: ALAMEDAXSTREET:REVIEW DATE: 8/18/97</i>

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A

Agency Address:	<i>RON GOODE TOYOTA</i> <i>1825 PARK ST</i> <i>ALAMEDA, CA 94501</i>
Facility ID:	<i>01-1258</i>
Leak Report Date:	<i>12/27/90</i>
Site Assessment Began:	<i>12/31/91</i>



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #41

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Case Closed Date:	01/10/97
Substance:	WASTE OIL
Remediation Event:	NO ACTION TAKEN
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:

VISTA Address*:	ROCKYS AUTO BODY 2405 EAGLE AVE ALAMEDA, CA 94501	VISTA ID#:	486927
		Distance/Direction:	0.17 MI / NE
		Plotted as:	Point

Map ID
10C


RCRA-Violations / SRC# 6379	EPA ID:	CAD981159163
Agency Address:	SAME AS ABOVE	
Violation Type:	GENERATOR-OTHER REQUIREMENTS	
Violation Date:	JUNE 23, 1986	
Violation Class:	2	
Actual Compliance Date:	NOT REPORTED	
Scheduled Compliance Date:	NOT REPORTED	

VISTA Address*:	MERRITT TIRE 2501 SANTA CLARA ALAMEDA, CA 94501	VISTA ID#:	929701
		Distance/Direction:	0.17 MI / SE
		Plotted as:	Point

Map ID
11

STATE UST - State Underground Storage Tank / SRC# 1612	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Underground Tanks:	4	
Aboveground Tanks:	NOT REPORTED	
Tanks Removed:	NOT REPORTED	

Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (*)
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	5000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNLEADED GAS	Leak Monitoring:	Agency Code (*)
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	5000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code (*)
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	5000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code (*)
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	250 (GALLONS)	Tank Material:	UNKNOWN



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #42

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.


STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	MERRITT TIRE OF ALAMEDA 2501 SANTA CLARA AVE ALAMEDA, CA 94501		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	GOODMAN PROPERTY 2501 SANTA CLARA AVE ALAMEDA, CA 94501	VISTA ID#:	11499307
		Distance/Direction:	0.17 MI / SE
		Plotted as:	Point

Map ID
11

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	GOODMAN PROPERTY 2501 SANTA CLARA AVE ALAMEDA, CA		
Facility ID:	01-0964		
Leak Report Date:	8/17/92		
Contamination Confirmed Date:	9/23/92		
Case Closed Date:	5/28/97		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 5/25/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 9/23/92		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 6/3/97		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0964		
Leak Report Date:	08/17/92		
Contamination Confirmed Date:	09/23/92		
Case Closed Date:	05/28/97		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #43

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

VISTA Address*:	AUTOMOTIVE AUTO REPAIR 2425 CENTRAL AVE ALAMEDA, CA 94501	VISTA ID#:	929686
		Distance/Direction:	0.19 MI / S
		Plotted as:	Point

Map ID
12


STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	AUTOMOTIVE AUTO REPAIR 2425 CENTRAL AVE ALAMEDA, CA 01-0139	
Facility ID:	01-0139	
Leak Report Date:	10/27/88	
Site Assessment Plan Submitted:	1/29/88	
Site Assessment Began:	2/8/88	
Case Closed Date:	3/6/96	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	GASOLINE	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 2/3/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 8/7/96	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-0139	
Leak Report Date:	10/27/88	
Site Assessment Plan Submitted:	01/29/88	
Site Assessment Began:	02/08/88	
Case Closed Date:	03/06/96	
Substance:	GASOLINE	
Remediation Event:	NO ACTION TAKEN	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:	

VISTA Address*:	STAHL WOODRIDGE CONSTRUCTION 2428 CENTRAL AVE ALAMEDA, CA 94501	VISTA ID#:	5353490
		Distance/Direction:	0.19 MI / S
		Plotted as:	Point

Map ID
12

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	STAHL WOODRIDGE CONSTRUCTION 2428 CENTRAL AVE ALAMEDA, CA 01-1845	
Facility ID:	01-1845	
Leak Report Date:	6/21/93	
Site Assessment Began:	6/16/93	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #44

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Leak Cause:	UNKNOWN
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	NO ACTION TAKEN
Remediation Event:	STOP DATE:HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 8/6/93
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 1/15/99

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1845		
Leak Report Date:	06/21/93		
Site Assessment Began:	06/16/93		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address:	CHEVRON 2428 CENTRAL ALAMEDA, CA 94501	VISTA ID#:	5353489
		Distance/Direction:	0.19 MI / S
		Plotted as:	Point


Map ID
12

CORTESE / SRC# 4840		Agency ID:	01-1845
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-1845		

VISTA Address:	VACANT BUILDING 1347 PARK ST ALAMEDA, CA 94501	VISTA ID#:	8590393
		Distance/Direction:	0.20 MI / S
		Plotted as:	Point

Map ID
13

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE



SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	VACANT BUILDING 1347 PARK ST ALAMEDA, CA 01-2386		
Facility ID:	01-2386		
Leak Report Date:	11/21/95		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	DIESEL		
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 7/7/98		


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2386		
Leak Report Date:	11/21/95		
Substance:	DIESEL		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address:	OWNER/OPERATOR SCHILLER CLEMENT ALAMEDA, CA 94501	VISTA ID#:	8573845
		Distance/Direction:	0.20 MI / NE
		Plotted as:	Point

Map ID
14A

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	010060U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	OWNER/OPERATOR MULBERRY ST CLEMENT ALAMEDA, CA 94501		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #46

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Tank ID:	010060U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	OWNER/OPERATOR 2310 CLEMENT AVE ALAMEDA, CA 94501		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

Tank ID:	010060U	Tank Status:	OTHER
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

VISTA Address*:	CELIA HARRIS TRUST 2521 CENTRAL ALAMEDA, CA 94501	VISTA ID#:	4222471
		Distance/Direction:	0.22 MI / S
		Plotted as:	Point

Map ID
15


STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

Tank ID:	510062U	Tank Status:	CLOSED REMOVED
Tank Contents:	OIL (NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	1500 (GALLONS)	Tank Material:	BARE STEEL

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	CELIA HARRIS TRUST 2521 CENTRAL AVE ALAMEDA, CA 94501		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		

Tank ID:	510062U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	CELIA HARRIS TRUST 2521 CENTRAL AVE ALAMEDA, CA		
Facility ID:	01-1750		
Leak Report Date:	4/30/93		
Contamination Confirmed Date:	5/4/93		
Case Closed Date:	6/26/93		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #47

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Leak Cause:	UNKNOWN
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 4/3/93 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 5/4/93
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/18/93


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	CELIA HARRIS TRUST 2521 CENTRAL AVE ALAMEDA, CA 94501		
Facility ID:	01-1750		
Leak Report Date:	04/30/93		
Contamination Confirmed Date:	05/04/93		
Case Closed Date:	06/26/93		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	CLEMENT AVENUE PROJECT 2235 CLEMENT AVE ALAMEDA, CA 94501	VISTA ID#:	1145638
		Distance/Direction:	0.23 MI / N
		Plotted as:	Point

Map ID
16A

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	CLEMENT AVENUE PROPERTY 2241 CLEMENT AVE ALAMEDA, CA 94501		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	CLEMENT AVENUE PROJECT 2241 CLEMENT AVE ALAMEDA, CA		
Facility ID:	01-0429		
Leak Report Date:	5/11/89		
Case Closed Date:	3/16/96		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #48

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	WASTE OIL
Remediation Event:	STOP DATE: 5/19/89 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/7/96

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	CLEMENT AVENUE PROJECT 2241 CLEMENT AVE ALAMEDA, CA 94501 01-0429		
Facility ID:			
Leak Report Date:	05/11/89		
Case Closed Date:	03/16/96		
Substance:	WASTE OIL		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*	RELIANCE SHEET STRIP COMPANY 2235 CLEMENT ALAMEDA, CA 94501	VISTA ID#:	1228566
		Distance/Direction:	0.25 MI / N
		Plotted as:	Point


Map ID
16B

STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	1		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	LEADED GAS	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	1 (GALLONS)	Tank Material:	BARE STEEL

VISTA Address*	ALAMEDA CITY UNIFIED SCH DIST 2200 CENTRAL AVE ALAMEDA, CA 94501	VISTA ID#:	10274
		Distance/Direction:	0.23 MI / W
		Plotted as:	Point

Map ID
17

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA UNIFIED SCHOOL DISTRICT 2200 CENTRAL AVE ALAMEDA, CA 01-0043		
Facility ID:			
Leak Report Date:	7/10/92		
Site Assessment Began:	7/24/92		
Contamination Confirmed Date:	8/31/92		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #49

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.


Case Closed Date:	8/11/93
Leak Cause:	CORROSION
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 1/10/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 8/31/92
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 11/18/93

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA UNIFIED SCHOOL DISTRICT 2200 CENTRAL AVE ALAMEDA, CA 94501 01-0043		
Facility ID:	01-0043		
Leak Report Date:	07/10/92		
Site Assessment Began:	07/24/92		
Contamination Confirmed Date:	08/31/92		
Case Closed Date:	08/11/93		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address:	HISTORIC ALAMEDA HIGH SCHOOL	VISTA ID#:	8574503
	2200 CENTRAL AVE	Distance/Direction:	0.23 MI / W
	ALAMEDA, CA 94501	Plotted as:	Point

Map ID
17

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #50

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

VISTA Address*:	HISTORIC ALAMEDA HIGH SCHOOL 2200 CENTRAL ALAMEDA, CA 94501	VISTA ID#:	3781271
		Distance/Direction:	0.23 MI / W
		Plotted as:	Point

Map ID
17


STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	OIL(NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	2500 (GALLONS)	Tank Material:	BARE STEEL
Tank ID:	T001U	Tank Status:	CLOSED REMOVED
Tank Contents:	OIL(NOT SPECIFIED)	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	BARE STEEL
Tank Size (Units):	2500 (GALLONS)	Tank Material:	BARE STEEL

VISTA Address*:	RON GOODE TOYOTA 2424 CLEMENT ALAMEDA, CA 94501	VISTA ID#:	4022257
		Distance/Direction:	0.23 MI / NE
		Plotted as:	Point

Map ID
18A

STATE UST - State Underground Storage Tank / SRC# 1612		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Underground Tanks:	2		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	3000 (GALLONS)	Tank Material:	UNKNOWN
Tank ID:	T001U	Tank Status:	ACTIVE/IN SERVICE
Tank Contents:	UNKNOWN	Leak Monitoring:	Agency Code ()
Tank Age:	NOT REPORTED	Tank Piping:	UNKNOWN
Tank Size (Units):	4000 (GALLONS)	Tank Material:	UNKNOWN

STATE UST - State Underground Storage Tank / SRC# 5275		EPA/Agency ID:	N/A
Agency Address:	RON GOODE TOYOTA, INC. 2424 CLEMENT AVE ALAMEDA, CA 94501		
Underground Tanks:	NOT REPORTED		
Aboveground Tanks:	NOT REPORTED		
Tanks Removed:	NOT REPORTED		
Tank ID:	T001U	Tank Status:	REMOVED
Tank Contents:	NOT AVAILABLE	Leak Monitoring:	NOT AVAILABLE
Tank Age:	NOT REPORTED	Tank Piping:	NOT AVAILABLE
Tank Size (Units):	NOT REPORTED (NOT AVAILABLE)	Tank Material:	NOT AVAILABLE



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #51

SITES IN THE SURROUNDING AREA (within 1/8 - 1/4 mile) CONT.

VISTA Address*:	ALAMEDA COLLISION REPAIR INC 1911 PARK ST ALAMEDA, CA 94501	VISTA ID#:	10268
		Distance/Direction:	0.24 MI / NE
		Plotted as:	Point

Map ID
18B

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA COLLISION 1911 PARK ST ALAMEDA, CA	
Facility ID:	01-0042	
Leak Report Date:	6/20/88	
Site Assessment Plan Submitted:	12/18/92	
Case Closed Date:	6/2/94	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	GASOLINE	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 6/20/88HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 12/13/94	


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA COLLISION 1911 PARK ST ALAMEDA, CA 94501	
Facility ID:	01-0042	
Leak Report Date:	06/20/88	
Site Assessment Plan Submitted:	12/18/92	
Case Closed Date:	06/02/94	
Substance:	GASOLINE	
Remediation Event:	NO ACTION TAKEN	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:	

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile)

VISTA Address*:	PARK ST LANDING 2301 BLANDING ALAMEDA, CA 94501	VISTA ID#:	4222386
		Distance/Direction:	0.29 MI / NE
		Plotted as:	Point

Map ID
14

CORTESE / SRC# 4840	Agency ID:	01-1703
Agency Address:	SAME AS ABOVE	
List Name:	LEAKING TANK	
Site ID:	01-1703	



SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	PARK ST LANDING 2301 BLANDING AVE ALAMEDA, CA 01-1703		
Facility ID:	01-1703		
Leak Report Date:	6/25/90		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	WASTE OIL		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 6/25/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 7/13/93		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	PARK ST LANDING 2301 BLANDING AVE ALAMEDA, CA 94501 01-1703		
Facility ID:	01-1703		
Leak Report Date:	06/25/90		
Substance:	WASTE OIL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		

VISTA Address*:	FOX PROPERTY 2229 CLEMENT AVE ALAMEDA, CA 94501	VISTA ID#:	6531934
		Distance/Direction:	0.25 MI / N
		Plotted as:	Point


Map ID
16

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	FOX PROPERTY 2229 CLEMENT AVE ALAMEDA, CA 01S0274		
Facility ID:	01S0274		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	ALAMEDA LOCK GLASS 2301 ENCINAL AVE ALAMEDA, CA 94501	VISTA ID#:	8576918
		Distance/Direction:	0.27 MI / SW
		Plotted as:	Point

Map ID
19

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA LOCK GLASS 2301 ENCINAL AVE ALAMEDA, CA 01-2384		
Facility ID:	01-2384		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #53

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Leak Report Date:	5/2/96
Leak Cause:	UNKNOWN
Leak Source:	UNKNOWN
Substance:	GASOLINE
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT:ENFORCEMENT DATE:
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 12/12/97


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2384		
Leak Report Date:	05/02/96		
Substance:	GASOLINE		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address:	ALAMEDA FIRE DEPARTMENT 2401 ENCINAL AVE ALAMEDA, CA 94501	VISTA ID#:	4222555
		Distance/Direction:	0.28 MI / S
		Plotted as:	Point

Map ID
20

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA FIRE DEPARTMENT 2401 ENCINAL AVE ALAMEDA, CA		
Facility ID:	01-1708		
Leak Report Date:	8/22/90		
Contamination Confirmed Date:	4/27/92		
Case Closed Date:	6/9/93		
Leak Cause:	UNKNOWN		
Leak Source:	TANK		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND TREAT		
Remediation Event:	STOP DATE: 6/1/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 4/27/92		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/18/93		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1708		
Leak Report Date:	08/22/90		



SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Contamination Confirmed Date:	04/27/92
Case Closed Date:	06/09/93
Substance:	DIESEL
Remediation Event:	EXCAVATE AND TREAT
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:


VISTA Address*:	ALAMEDA CELLARS 2425 ENCINAL ALAMEDA, CA 94501	VISTA ID#:	1584361
		Distance/Direction:	0.29 MI / S
		Plotted as:	Point

Map ID
20

CORTESE / SRC# 4840	Agency ID:	01-0039
Agency Address:	ALAMEDA CELLARS 2425 ENCINAL ALAMEDA, CA	
List Name:	LEAKING TANK	
Site ID:	01-0039	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA CELLARS 2425 ENCINAL AVE ALAMEDA, CA	
Facility ID:	01-0039	
Leak Report Date:	11/1/95	
Contamination Confirmed Date:	4/27/92	
Case Closed Date:	8/12/99	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Event:	STOP DATE: 3/1/90 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 4/27/92	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 9/8/99	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA CELLARS 2425 ENCINAL AVE ALAMEDA, CA 94501	
Facility ID:	01-0039	
Leak Report Date:	11/01/95	
Contamination Confirmed Date:	04/27/92	
Case Closed Date:	08/12/99	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Status:	CASE CLOSED	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #55

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:

VISTA Address*:	ALLIED ENGINEERING AND PROD CO 2421 BLANDING AVE ALAMEDA, CA 94501	VISTA ID#:	13043
		Distance/Direction:	0.30 MI / NE
		Plotted as:	Point

Map ID:
21


STATE LUST - State Leaking Underground Storage Tank / SRC# 6271	EPA/Agency ID:	N/A
Agency Address:	ALLIED ENGINEERING PRODUCT CORP 2421 BLANDING AVE ALAMEDA, CA 01S0055	
Facility ID:	01S0055	
Remediation Status:	INACTIVE	
Description / Comment:	FAC COUNTY: ALAMEDA	

VISTA Address*:	ALAMEDA ELECTRIC 2420 BLANDING ALAMEDA, CA 94501	VISTA ID#:	3781216
		Distance/Direction:	0.31 MI / NE
		Plotted as:	Point

Map ID:
21

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA ELECTRIC 2420 BLANDING AVE ALAMEDA, CA 01-0294	
Facility ID:	01-0294	
Leak Report Date:	6/2/92	
Contamination Confirmed Date:	12/16/92	
Case Closed Date:	6/2/93	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Event:	STOP DATE: 6/2/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 12/16/92	
Remediation Status:	CASE CLOSED	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 8/18/93	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	ALAMEDA ELECTRIC 2420 BLANDING AVE ALAMEDA, CA 94501 01-0294	
Facility ID:	01-0294	
Leak Report Date:	06/02/92	
Contamination Confirmed Date:	12/16/92	
Case Closed Date:	06/02/93	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Status:	CASE CLOSED	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #56

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.


Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:

VISTA Address:	DOLLRES STAUNDENRAUS 2424 BLANDING AVE ALAMEDA, CA 94501	VISTA ID#:	6669292
		Distance/Direction:	0.31 MI / NE
		Plotted as:	Point

Map ID
21

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	DOLORES STAUNDENRAUS 2424 BLANDING AVE ALAMEDA, CA	
Facility ID:	01-2169	
Leak Report Date:	4/26/95	
Contamination Confirmed Date:	9/24/96	
Case Closed Date:	10/29/96	
Leak Cause:	UNKNOWN	
Leak Source:	UNKNOWN	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Event:	STOP DATE: 2/23/93 HOW STOPPED: CLOSE TANK ENFORCEMENT: ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 11/6/96	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	DOLORES STAUNDENRAUS 2424 BLANDING AVE ALAMEDA, CA 94501	
Facility ID:	01-2169	
Leak Report Date:	04/26/95	
Contamination Confirmed Date:	09/24/96	
Case Closed Date:	10/29/96	
Substance:	GASOLINE	
Remediation Event:	EXCAVATE AND DISPOSE	
Remediation Status:	CASE CLOSED	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:	



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #57

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

VISTA Address*:	GHI DELLA RESIDENCE 2110 SANTA CLARA AVE ALAMEDA, CA 94501	VISTA ID#:	11499306
		Distance/Direction:	0.30 MI / W
		Plotted as:	Point

Map ID

22

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	GHI DELLA RESIDENCE 2110 SANTA CLARA AVE ALAMEDA, CA
Facility ID:	01-1992
Leak Report Date:	5/5/94
Site Assessment Plan Submitted:	12/29/94
Case Closed Date:	6/27/95
Leak Source:	UNKNOWN
Substance:	DIESEL
Remediation Event:	STOP DATE:HOW STOPPED:ENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 7/3/95

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	SAME AS ABOVE
Facility ID:	01-1992
Leak Report Date:	05/05/94
Site Assessment Plan Submitted:	12/29/94
Case Closed Date:	06/27/95
Substance:	DIESEL
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:


VISTA Address*:	ARCO 1260 PARK ST ALAMEDA, CA 94501	VISTA ID#:	1587496
		Distance/Direction:	0.33 MI / SW
		Plotted as:	Point

Map ID

23

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
--	----------------	-----

Agency Address:	ARCO 1260 PARK ST ALAMEDA, CA
Facility ID:	01-0090
Leak Report Date:	7/31/90
Site Assessment Plan Submitted:	1/2/91
Leak Cause:	SPILL
Leak Source:	UNKNOWN
Substance:	GASOLINE
Remediation Event:	STOP DATE: 11/30/93 HOW STOPPED: OTHER MEANS ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	POST REMEDIAL ACTION UNDERWAY



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #58

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.


Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: ENCINAL REVIEW DATE: 3/30/99
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A	
Agency Address:	SAME AS ABOVE
Facility ID:	01-0090
Leak Report Date:	07/31/90
Site Assessment Plan Submitted:	01/02/91
Substance:	GASOLINE
Remediation Status:	POST REMEDIAL ACTION UNDERWAY
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET: ENCINAL REVIEW DATE:

VISTA Address:	ARCO 1260 PARK ALAMEDA, CA 94501	VISTA ID#:	7429314
		Distance/Direction:	0.33 MI / SW
		Plotted as:	Point
CORTESE / SRC# 4840		Agency ID:	01-0090
Agency Address:	SAME AS ABOVE		
List Name:	LEAKING TANK		
Site ID:	01-0090		

Map ID
23

VISTA Address:	ALAMEDA UNIFIED SCHOOL DISTRICT 2615 EAGLE AVE ALAMEDA, CA 94501	VISTA ID#:	1254196
		Distance/Direction:	0.34 MI / E
		Plotted as:	Point
STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	ALAMEDA UNIFIED SCHOOL DISTRICT 2615 EAGLE AVE ALAMEDA, CA		
Facility ID:	01-0797		
Leak Report Date:	12/31/91		
Contamination Confirmed Date:	7/7/92		
Case Closed Date:	8/11/93		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Event:	STOP DATE: 12/31/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 7/7/92		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE: 11/18/93		

Map ID
24



SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0797		
Leak Report Date:	12/31/91		
Contamination Confirmed Date:	07/07/92		
Case Closed Date:	08/11/93		
Substance:	GASOLINE		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	SOIL ONLY		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:		

VISTA Address*:	CAMISA BROS ROOFING 1901 BROADWAY ALAMEDA, CA 94501	VISTA ID#:	11498549
		Distance/Direction:	0.37 MI / E
		Plotted as:	Point


Map ID
25

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-2087		
Leak Report Date:	04/29/94		
Case Closed Date:	08/09/95		
Substance:	GASOLINE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:		

VISTA Address*:	CAMISA BROS ROOFING 1901 BROADWAY ALAMEDA, CA 94501	VISTA ID#:	5520262
		Distance/Direction:	0.37 MI / E
		Plotted as:	Point

Map ID
25

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	CAMISA BROS ROOFING 1901 BROADWAY ALAMEDA, CA		
Facility ID:	01-2087		
Leak Report Date:	4/29/94		
Case Closed Date:	8/19/95		
Leak Cause:	UNKNOWN		
Leak Source:	UNKNOWN		
Substance:	GASOLINE		
Remediation Event:	STOP DATE: 4/28/94 HOW STOPPED: OTHER MEANS ENFORCEMENT: ENFORCEMENT DATE:		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #60

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 8/7/96


VISTA Address:	PACIFIC BELL (Q3-004) 2100 CENTRAL ALAMEDA, CA 94501	VISTA ID#:	315062
		Distance/Direction:	0.37 MI / W
		Plotted as:	Point

Map ID
26

CORTESE / SRC# 4840	Agency ID:	01-1135
Agency Address:	PACIFIC BELL 2100 CENTRAL ALAMEDA, CA	
List Name:	LEAKING TANK	
Site ID:	01-1135	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	PACIFIC BELL 2100 CENTRAL AVE ALAMEDA, CA	
Facility ID:	01-1135	
Leak Report Date:	8/7/86	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	DIESEL	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 8/7/86 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 2/3/93	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	EPA/Agency ID:	N/A
Agency Address:	PACIFIC BELL 2100 CENTRAL AVE ALAMEDA, CA 94501	
Facility ID:	01-1135	
Leak Report Date:	08/07/86	
Substance:	DIESEL	
Remediation Event:	NO ACTION TAKEN	
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF	
Media Affected:	SOIL ONLY	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:	



SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Site Assessment Plan Submitted:	1/24/92
Case Closed Date:	6/29/94
Leak Cause:	STRUCTURE FAILURE
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 11/6/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 7/20/92
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: 7TH ST E REVIEW DATE: 7/8/94


STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	RIGHT AWAY READY MIX INC 401 KENNEDY ST OAKLAND, CA 94606		
Facility ID:	01-1241		
Leak Report Date:	11/01/91		
Site Assessment Plan Submitted:	01/24/92		
Case Closed Date:	06/29/94		
Substance:	DIESEL		
Remediation Event:	EXCAVATE AND DISPOSE		
Remediation Status:	CASE CLOSED		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: 7TH ST E REVIEW DATE:		

VISTA Address**:	RHODES JAMIESON BATCH PLA 333 KENNEDY OAKLAND, CA 94606	VISTA ID#:	1585693
		Distance/Direction:	0.50 MI / NE
		Plotted as:	Point

Map ID
28

CORTESE / SRC# 4840		Agency ID:	01-1238
Agency Address:	RHODES JAMIESON BATCH PLA 333 KENNEDY OAKLAND, CA		
List Name:	LEAKING TANK		
Site ID:	01-1238		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	RHODES JAMIESON BATCH PLANT 333 KENNEDY ST OAKLAND, CA		
Facility ID:	01-1238		
Leak Report Date:	8/8/85		
Site Assessment Began:	10/30/85		
Pollution Characterization Date:	11/30/85		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	DIESEL		



SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Remediation Event:	STOP DATE: 8/8/85 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:
Remediation Status:	POLLUTION CHARACTERIZATION
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 9/13/94

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	RHODES JAMIESON BATCH PLANT 333 KENNEDY ST. OAKLAND, CA 94612		
Facility ID:	01-1238		
Leak Report Date:	08/08/85		
Site Assessment Began:	10/30/85		
Pollution Characterization Date:	11/30/85		
Substance:	DIESEL		
Remediation Status:	POLLUTION CHARACTERIZATION		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		


VISTA Address*:	CHEVRON 333 23RD AVE OAKLAND, CA 94606	VISTA ID#:	3867311	Map ID 29
		Distance/Direction:	0.49 MI / NE	
		Plotted as:	Point	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	LIVERMORE ARCADE SHOPPING CENTER 1ST P ST LIVERMORE, CA		
Facility ID:	01S0216		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	CHEVRON 333 23RD AVE OAKLAND, CA		
Facility ID:	01S0218		
Remediation Status:	INACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	GOLDEN WEST ENVIRONMENTAL SERV 2017 CENTRAL AVE ALAMEDA, CA 94501	VISTA ID#:	4222470	Map ID 30
		Distance/Direction:	0.49 MI / W	
		Plotted as:	Point	

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	GOLDEN WEST ENV SERVICES 2017 CENTRAL AVE ALAMEDA, CA		
Facility ID:	01-1746		
Leak Report Date:	6/25/92		
Contamination Confirmed Date:	5/4/93		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903


Date of Report: January 21, 2000

Version 2.6.1

Page #64

SITES IN THE SURROUNDING AREA (within 1/4 - 1/2 mile) CONT.

Case Closed Date:	1/28/94
Leak Cause:	UNKNOWN
Leak Source:	TANK
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 6/25/92 HOW STOPPED: CLOSE TANK ENFORCEMENT: WARNING ENFORCEMENT DATE: 5/4/93
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE: 12/13/94
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545	
EPA/Agency ID:	N/A
Agency Address:	GOLDEN WEST ENV SERVICES 2017 CENTRAL AVE ALAMEDA, CA 94501 01-1746
Facility ID:	
Leak Report Date:	06/25/92
Contamination Confirmed Date:	05/04/93
Case Closed Date:	01/28/94
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Status:	CASE CLOSED
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET REVIEW DATE:



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #65


SITES IN THE SURROUNDING AREA (within 1/2 - 1 mile)

VISTA Address*:	AMERICAN NATIONAL CAN CO. 3801 E. 8TH ST OAKLAND, CA 94601	VISTA ID#:	481033
		Distance/Direction:	0.99 MI / E
		Plotted as:	Point

Map ID
31

CORRACTS / SRC# 6379		EPA ID:	CAD009162116
Agency Address:	AMERICAN CAN PACKAGING INC 3801 E 8TH ST OAKLAND, CA 94604		
Prioritization Status:	MEDIUM		
RCRA Facility Assessment Completed:	YES		
Notice of Contamination:	NO		
Determination of need For a RFI (RCRA Facility Investigation):	NO		
RFI Imposed:	YES		
RFI Workplan Notice of Deficiency Issued:	NO		
RFI Workplan Approved:	NO		
RFI Report Received:	NO		
RFI Approved:	YES		
No Further Corrective Action at this Time:	NO		
Stabilization Mesasures Evaluation:	YES		
CMS (Corrective Measure Study) Imposition:	NO		
CMS Workplan Approved:	NO		
CMS Report Received:	NO		
CMS Approved:	NO		
Date for Remedy Selection (CM Imposed):	NO		
Corrective Measures Design Approved:	NO		
Corrective Measures Investigation Workplan Approved:	NO		
Certification of Remedy Completion:	NO		
Stabilization Measures Implementation:	YES		
Stabilization Measures Completed:	YES		
Corrective Action Process Termination:	NO		

RCRA-TSD CORRACTS / SRC# 6379		EPA ID:	CAD009162116
Agency Address:	AMERICAN CAN PACKAGING INC 3801 E 8TH ST OAKLAND, CA 94604		
Off-Site Waste Received:	NO		
Land Disposal:	NO		
Incinerator:	NO		
Storage/Treatment:	NO		




UNMAPPED SITES

VISTA Address*:	NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA 94501	VISTA ID#:	12713938
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-1035		
Leak Report Date:	07/28/86		
Site Assessment Began:	12/30/85		
Substance:	MISC MOTOR VEHICLE FUELS		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA 94501	VISTA ID#:	12713937
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0050		
Leak Report Date:	07/27/87		
Substance:	MISC MOTOR VEHICLE FUELS		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA X STREET: REVIEW DATE:		

VISTA Address*:	ALAMEDA NAVAL AIR STATION 0 UNKNOWN ALAMEDA, CA	VISTA ID#:	12666629
STATE LUST - State Leaking Underground Storage Tank / SRC# 6428		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01-0050		
Leak Report Date:	7/27/87		
Leak Cause:	STRUCTURE FAILURE		
Leak Source:	TANK		
Substance:	MISC MOTOR VEHICLE FUELS		
Remediation Event:	NO ACTION TAKEN		
Remediation Event:	STOP DATE: 7/27/87 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:		
Remediation Status:	NO ACTION		
Media Affected:	UNDEFINED		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #67

UNMAPPED SITES CONT.

Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 8/24/94

VISTA Address*:	ROADWAY EXPRESS, INC 1125 27TH AVE OAKLAND, CA	VISTA ID#:	7291475
------------------------	---	-------------------	---------


STATE LUST - State Leaking Underground Storage Tank / SRC# 6271	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01S0449	
Remediation Status:	INACTIVE	
Description / Comment:	FAC COUNTY: ALAMEDA	

VISTA Address*:	NCPA TODD SHIPYARD 0 UNKNOWN ALAMEDA, CA	VISTA ID#:	12666650
------------------------	---	-------------------	----------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-1035	
Leak Report Date:	7/28/86	
Site Assessment Began:	12/30/85	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	MISC MOTOR VEHICLE FUELS	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 7/28/86 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE: 8/24/94	

VISTA Address*:	GALLAGHER BURKE INC 7100 BOUNTAIN BLVD OAKLAND, CA 94623	VISTA ID#:	247661
------------------------	---	-------------------	--------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	GALLAGHER BURKE 7100 MOUNTAIN BLVD OAKLAND, CA	
Facility ID:	01-1236	
Leak Report Date:	10/22/92	
Contamination Confirmed Date:	12/23/92	
Case Closed Date:	6/1/95	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	DIESEL	




UNMAPPED SITES CONT.

Remediation Event:	EXCAVATE AND DISPOSE
Remediation Event:	STOP DATE: 10/22/93HOW STOPPED: CLOSE TANKENFORCEMENT: WARNINGENFORCEMENT DATE: 12/23/92
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 7/3/95
STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A	
Agency Address:	GALLAGHER BURKE 7100 MOUNTAIN BLVD OAKLAND, CA 94605
Facility ID:	01-1236
Leak Report Date:	10/22/92
Contamination Confirmed Date:	12/23/92
Case Closed Date:	06/01/95
Substance:	DIESEL
Remediation Event:	EXCAVATE AND DISPOSE
Remediation Status:	CASE CLOSED
Media Affected:	OTHER GROUND WATER
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE:

VISTA Address*:	EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA	VISTA ID#:	12666907
------------------------	---	-------------------	----------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428 EPA/Agency ID: N/A	
Agency Address:	SAME AS ABOVE
Facility ID:	01-1990
Leak Report Date:	8/10/94
Contamination Confirmed Date:	1/25/96
Leak Cause:	UNKNOWN
Leak Source:	UNKNOWN
Substance:	KEROSENE
Remediation Event:	STOP DATE: 7/22/94HOW STOPPED: CLOSE TANKENFORCEMENT: NONE TAKENENFORCEMENT DATE:
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDAXSTREET:REVIEW DATE: 2/24/98

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545 EPA/Agency ID: N/A	
Agency Address:	EAST BAY SERVICE ROAD TENT 0 BAY BRIDGE TOLL PLZ OAKLAND, CA 94607
Facility ID:	01-1990
Leak Report Date:	08/10/94
Contamination Confirmed Date:	01/25/96



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #69

UNMAPPED SITES CONT.


Substance:	KEROSENE
Remediation Status:	PRELIMINARY SITE ASSESSMENT UNDERWAY
Media Affected:	SOIL ONLY
Lead Agency:	LOCAL AGENCY
Region / District:	SAN FRANCISCO BAY RE
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE:

VISTA Address:	EAST BAY REGIONAL PARK DISTRICT	VISTA ID#:	12667445
	0 TILDEN PARK		
	OAKLAND, CA		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-0534	
Leak Report Date:	3/24/88	
Case Closed Date:	7/26/88	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	MISC MOTOR VEHICLE FUELS	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 3/24/88 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	CASE CLOSED	
Media Affected:	UNDEFINED	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 7/26/88	

VISTA Address:	7	VISTA ID#:	12667122
	0 L 827 TRACON		
	OAKLAND, CA		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6428	EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE	
Facility ID:	01-0606	
Leak Report Date:	7/30/91	
Leak Cause:	STRUCTURE FAILURE	
Leak Source:	TANK	
Substance:	DIESEL	
Remediation Event:	NO ACTION TAKEN	
Remediation Event:	STOP DATE: 7/30/91 HOW STOPPED: CLOSE TANK ENFORCEMENT: NONE TAKEN ENFORCEMENT DATE:	
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF	
Media Affected:	OTHER GROUND WATER	
Lead Agency:	LOCAL AGENCY	
Region / District:	SAN FRANCISCO BAY RE	
Description / Comment:	COUNTY: ALAMEDA X STREET; REVIEW DATE: 10/9/91	



UNMAPPED SITES CONT.

STATE LUST - State Leaking Underground Storage Tank / SRC# 6545		EPA/Agency ID:	N/A
Agency Address:	7 01 827 TRACON OAKLAND, CA 94621		
Facility ID:	01-0606		
Leak Report Date:	07/30/91		
Substance:	DIESEL		
Remediation Event:	NO ACTION TAKEN		
Remediation Status:	LEAK IS SUSPECTED AT SIGHT, BUT NOT CONF		
Media Affected:	OTHER GROUND WATER		
Lead Agency:	LOCAL AGENCY		
Region / District:	SAN FRANCISCO BAY RE		
Description / Comment:	COUNTY: ALAMEDA STREET: REVIEW DATE:		

VISTA Address*:	HAYWARD LIMITED 30104 INDUSTRIAL PKWY SW HAYWARD, CA	VISTA ID#:	7291068
-----------------	---	------------	---------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0493		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	UPTOWN THEATER DISTRICT UNKNOWN OAKLAND, CA	VISTA ID#:	12714497
-----------------	--	------------	----------


STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0520		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	OH OLSEN 2220 4TH ST BERKELEY, CA	VISTA ID#:	7291419
-----------------	--	------------	---------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0490		
Remediation Status:	ACTIVE		
Description / Comment:	FAC COUNTY: ALAMEDA		

VISTA Address*:	OAKLAND INTERNATIONAL AIRPORT OAKLAND INTERNATIONAL AIRPORT OAKLAND, CA	VISTA ID#:	7291755
-----------------	--	------------	---------

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271		EPA/Agency ID:	N/A
Agency Address:	SAME AS ABOVE		
Facility ID:	01S0487		



* VISTA address includes enhanced city and ZIP.

For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1


Page #71

UNMAPPED SITES CONT.

Remediation Status:	<i>INACTIVE</i>
Description / Comment:	<i>FAC COUNTY: ALAMEDA</i>

VISTA Address*:	UNION POINT WATERFRONT PARK	VISTA ID#:	12714405
	2301 EMBARCADERO ST		
	OAKLAND, CA		

STATE LUST - State Leaking Underground Storage Tank / SRC# 6271	EPA/Agency ID:	N/A
Agency Address:	<i>SAME AS ABOVE</i>	
Facility ID:	<i>01S0521</i>	
Remediation Status:	<i>ACTIVE</i>	
Description / Comment:	<i>FAC COUNTY: ALAMEDA</i>	



SITE ASSESSMENT PLUS REPORT

DESCRIPTION OF DATABASES SEARCHED

A) DATABASES SEARCHED TO 1 MILE

NPL
SRC#: 6476 VISTA conducts a database search to identify all sites within 1 mile of your property.
The agency release date for NPL was November, 1999.

The National Priorities List (NPL) is the EPA's database of uncontrolled or abandoned hazardous waste sites identified for priority remedial actions under the Superfund program. A site must meet or surpass a predetermined hazard ranking system score, be chosen as a state's top priority site, or meet three specific criteria set jointly by the US Dept of Health and Human Services and the US EPA in order to become an NPL site.

SPL
SRC#: 6282 VISTA conducts a database search to identify all sites within 1 mile of your property.
The agency release date for Calsites Database: Annual Workplan Sites was July, 1999.

This database is provided by the Cal. Environmental Protection Agency, Dept. of Toxic Substances Control. The agency may be contacted at: 916-323-3400.

CORRACTS
SRC#: 6379 VISTA conducts a database search to identify all sites within 1 mile of your property.
The agency release date for HWDMS/RCRIS was September, 1999.

The EPA maintains this database of RCRA facilities which are undergoing "corrective action". A "corrective action order" is issued pursuant to RCRA Section 3008 (h) when there has been a release of hazardous waste or constituents into the environment from a RCRA facility. Corrective actions may be required beyond the facility's boundary and can be required regardless of when the release occurred, even if it predates RCRA.


B) DATABASES SEARCHED TO 1/2 MILE

CERCLIS
SRC#: 6474 VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for CERCLIS was October, 1999.

The CERCLIS List contains sites which are either proposed to or on the National Priorities List (NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL. The information on each site includes a history of all pre-remedial, remedial, removal and community relations activities or events at the site, financial funding information for the events, and unrestricted enforcement activities.

Cal Cerclis
SRC#: 2462 VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Ca Cerclis w/Regional Utility Description was June, 1995.

This database is provided by the U.S. Environmental Protection Agency, Region 9. The agency may be contacted at: . These are regional utility descriptions for California CERCLIS sites.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #73

NFRAP
SRC#: 6475

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for CERCLIS-NFRAP was October, 1999.

NFRAP sites may be sites where, following an initial investigation, no contamination was found, contamination was removed quickly, or the contamination was not serious enough to require Federal Superfund action, or NPL consideration.

SCL
SRC#: 6281

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Calsites Database: All Sites except Annual Workplan Sites (incl. ASPIS) was July, 1999.

This database is provided by the Department of Toxic Substances Control. The agency may be contacted at:

The CalSites database includes both known and potential sites. Two-thirds of these sites have been classified, based on available information, as needing "No Further Action" (NFA) by the Department of Toxic Substances Control. The remaining sites are in various stages of review and remediation to determine if a problem exists at the site. Several hundred sites have been remediated and are considered certified. Some of these sites may be in long term operation and maintenance.

RCRA-TSD
SRC#: 6379

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for HWDMS/RCRIS was September, 1999.

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA TSDs are facilities which treat, store and/or dispose of hazardous waste.

SWLF
SRC#: 5945

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for City of Los Angeles Landfills was April, 1999.


This database is provided by the City of Los Angeles, Environmental Affairs Department. The agency may be contacted at: 213-580-1070.

SWLF
SRC#: 6544

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Ca Solid Waste Information System (SWIS) was November, 1999.

This database is provided by the Integrated Waste Management Board. The agency may be contacted at: 916-255-4021.

The California Solid Waste Information System (SWIS) database consists of both open as well as closed and inactive solid waste disposal facilities and transfer stations pursuant to the Solid Waste Management and Resource Recovery Act of 1972, Government Code Section 2.66790(b). Generally, the California Integrated Waste Management Board learns of locations of disposal facilities through permit applications and from local enforcement agencies.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #74

WMUDS
SRC#: 5857

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Waste Management Unit Database System (WMUDS) was February, 1999.

This database is provided by the State Water Resources Control Board. The agency may be contacted at: 916-892-0323. This is used for program tracking and inventory of waste management units. This system contains information from: Facility, Waste Management Unit, SWAT Program and Report Summary Information, Chapter 15 (formerly Subchapter 15), TPCA and RCRA Program Information, Closure Information; also some information from the WDS (Waste Discharge System).

The WMUDS system also accesses information from the following databases from the Waste Discharge System (WDS): Inspections, Violations, and Enforcements. The sites contained in these databases are subject to the California Code of Regulations - Title 23. Waters.

LUST
SRC#: 6271

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Region #2-North and South Bay SLIC Report was July, 1999.

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: 510-286-1269.

LUST RG6
SRC#: 6275

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Lahontan Region LUST List was August, 1999.

This database is provided by the Lahontan Region Six South Lake Tahoe. The agency may be contacted at: 530-542-5400.

LUST RG2
SRC#: 6428

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Region #2-San Francisco Bay Fuel Leaks List was September, 1999.

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: 510-286-1269.

LUST RG5
SRC#: 6443

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Region #5-Central Valley Underground Tank Tracking System was September, 1999.

This database is provided by the Regional Water Quality Control Board, Region #5. The agency may be contacted at: 916-255-3125.

LUST
SRC#: 6527


VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Region #5-Central Valley SLIC\DOD\DOE List was September, 1999.

This database is provided by the Regional Water Quality Control Board, Region #5. The agency may be contacted at: 916-255-3000.

LUST
SRC#: 6545

VISTA conducts a database search to identify all sites within 1/2 mile of your property. The agency release date for Lust Information System (LUSTIS) was October, 1999.

This database is provided by the California Environmental Protection Agency. The agency may be contacted at: 916-445-6532.



CORTESE
SRC#: 4840

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Cortese List-Hazardous Waste Substance Site List was April, 1998.

This database is provided by the Office of Environmental Protection, Office of Hazardous Materials. The agency may be contacted at: 916-445-6532.

The California Governor's Office of Planning and Research annually publishes a listing of potential and confirmed hazardous waste sites throughout the State of California under Government Code Section 65962.5. This database (CORTESE) is based on input from the following: (1)CALSITES-Department of Toxic Substances Control, Abandoned Sites Program Information Systems; (2)SARA Title III Section III Toxic Chemicals Release Inventory for 1987, 1988, 1989, and 1990; (3)FINDS; (4)HWIS-Department of Toxic Substances Control, Hazardous Waste Information System. Vista has not included one time generator facilities from Cortese in our database.; (5)SWRCB-State Water Resources Control Board; (6)SWIS-Integrated Waste Management Control Board (solid waste facilities); (7)AGT25-Air Resources Board, dischargers of greater than 25 tons of criteria pollutants to the air; (8)A1025-Air Resources Board, dischargers of greater than 10 and less than 25 tons of criteria pollutants to the air; (9)LTANK-SWRCB Leaking Underground Storage Tanks; (10)UTANK-SWRCB Underground tanks reported to the SWEEPS systems; (11)IUR-Inventory Update Rule (Chemical Manufacturers); (12)WB-LF- Waste Board - Leaking Facility, site has known migration; (13)WDSE-Waste Discharge System - Enforcement Action; (14)DTSCD-Department of Toxic Substance Control Docket.

Deed
Restrictions
SRC#: 1703

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Deed Restriction Properties Report was April, 1994.


This database is provided by the Department of Health Services-Land Use and Air Assessment. The agency may be contacted at: 916-255-2014. These are voluntary deed restriction agreements with owners of property who propose building residences, schools, hospitals, or day care centers on property that is "on or within 2,000 feet of a significant disposal of hazardous waste".

California has a statutory and administrative procedure under which the California Department of Health Services (DHS) may designate real property as either a "Hazardous Waste Property" or a "Border Zone Property" pursuant to California Health Safety Code Sections 25220-25241. Hazardous Waste Property is land at which hazardous waste has been deposited, creating a significant existing or potential hazard to public health and safety. A Border Zone Property is one within 2,000 feet of a hazardous waste deposit. Property within either category is restricted in use, unless a written variance is obtained from DHS. A Hazardous Waste Property designation results in a prohibition of new uses, other than a modification or expansion of an industrial or manufacturing facility on land previously owned by the facility prior to January 1, 1981. A Border Zone Property designation results in prohibition of a variety of uses involving human habitation, hospitals, schools and day care center.

Toxic Pits
SRC#: 2229

VISTA conducts a database search to identify all sites within 1/2 mile of your property.
The agency release date for Summary of Toxic Pits Cleanup Facilities was February, 1995.

This database is provided by the Water Quality Control Board, Division of Loans Grants. The agency may be contacted at: 916-227-4396.



**North Bay
SRC#: 1718**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for North Bay County Toxic List-Region #2 Surface Spills was April, 1994.**

This database is provided by the Regional Water Quality Control Board, Region #2. The agency may be contacted at: .

**South Bay
SRC#: 1719**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for South Bay Site Management System was April, 1994.**

This database is provided by the San Francisco Bay Region. The agency may be contacted at: .

**Water Wells
SRC#: 5384**

VISTA conducts a database search to identify all sites within 1/2 mile of your property. **The agency release date for USGS WATER WELLS was March, 1998.**

The Ground Water Site Inventory (GWSI) database was provided by the United States Geological Survey (USGS). The database contains information for over 1,000,000 wells and other sources of groundwater which the USGS has studied, used, or otherwise had reason to document through the course of research. The agency may be contacted at 703-648-6819.

© DATABASES SEARCHED TO 1/4 MILE

RCRA-Viols/Enf VISTA conducts a database search to identify all sites within 1/4 mile of your property. **The agency release date for HWDMS/RCRIS was September, 1999.**

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Violators are facilities which have been cited for RCRA Violations at least once since 1980. RCRA Enforcements are enforcement actions taken against RCRA violators.

**UST's
SRC#: 1612**


VISTA conducts a database search to identify all sites within 1/4 mile of your property. **The agency release date for Underground Storage Tank Registrations Database was January, 1994.**

This database is provided by the State Water Resources Control Board, Office of Underground Storage Tanks. The agency may be contacted at: 916-227-4364; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

**UST's
SRC#: 5275**

VISTA conducts a database search to identify all sites within 1/4 mile of your property. **The agency release date for Alameda County UST List was September, 1998.**

This database is provided by the Department of Environmental Health. The agency may be contacted at: 510-567-6700; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #77

UST's
SRC#: 5674

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of San Leandro UST Listing was January, 1999.

This database is provided by the San Leandro Fire Department. The agency may be contacted at: 510-577-3331; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's
SRC#: 6115

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of Union Underground Storage Tanks List was July, 1999.

This database is provided by the Union City Fire Department. The agency may be contacted at: 510-471-1424; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's
SRC#: 6249

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of Oakland Underground Storage Tank List was April, 1999.

This database is provided by the City of Oakland Fire Department, Office of Emergency Services. The agency may be contacted at: 510-238-3938; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's
SRC#: 6430

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of Berkeley UST List was August, 1999.

This database is provided by the City of Berkeley. The agency may be contacted at: 510-705-8152; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's
SRC#: 6529

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of Hayward UST Report was September, 1999.

This database is provided by the City of Hayward Fire Department. The agency may be contacted at: 510-583-4900; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

UST's
SRC#: 6535


VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for City of Livermore and City of Pleasanton UST List was October, 1999.

This database is provided by the City of Livermore Fire Department. The agency may be contacted at: 925-454-2361; Caution-Many states do not require registration of heating oil tanks, especially those used for residential purposes.

AST's
SRC#: 5513

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for Aboveground Storage Tank Database was December, 1998.

This database is provided by the State Water Resources Control Board. The agency may be contacted at: 916-227-4364.



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #78

TRIS
SRC#: 4946

VISTA conducts a database search to identify all sites within 1/4 mile of your property.
The agency release date for TRIS was January, 1998.

Section 313 of the Emergency Planning and Community Right-to-Know Act (also known as SARA Title III) of 1986 requires the EPA to establish an inventory of Toxic Chemicals emissions from certain facilities (Toxic Release Inventory System). Facilities subject to this reporting are required to complete a Toxic Chemical Release Form (Form R) for specified chemicals.

D) DATABASES SEARCHED TO 1/8 MILE

ERNS
SRC#: 6181

VISTA conducts a database search to identify all sites within 1/8 mile of your property.
The agency release date for ERNS was August, 1999.

The Emergency Response Notification System (ERNS) is a national database containing records from October 1986 to the release date above and is used to collect information for reported releases of oil and hazardous substances. The database contains information from spill reports made to federal authorities including the EPA, the US Coast Guard, the National Response Center and the Department of Transportation. The ERNS hotline number is (202) 260-2342.

RCRA-LgGen
SRC#: 6379

VISTA conducts a database search to identify all sites within 1/8 mile of your property.
The agency release date for HWDMS/RCRIS was September, 1999.


The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Large Generators are facilities which generate at least 1000 kg./month of non-acutely hazardous waste (or 1 kg./month of acutely hazardous waste).

RCRA-SmGen
SRC#: 6379

VISTA conducts a database search to identify all sites within 1/8 mile of your property.
The agency release date for HWDMS/RCRIS was September, 1999.

The EPA's Resource Conservation and Recovery Act (RCRA) Program identifies and tracks hazardous waste from the point of generation to the point of disposal. The RCRA Facilities database is a compilation by the EPA of facilities which report generation, storage, transportation, treatment or disposal of hazardous waste. RCRA Small and Very Small generators are facilities which generate less than 1000 kg./month of non-acutely hazardous waste.

End of Report



For more information call VISTA Information Solutions, Inc. at 1 - 800 - 767 - 0403.

Report ID: 839301903

Date of Report: January 21, 2000

Version 2.6.1

Page #79

SANBORN MAP LEGEND

CODING OF FIRE-RESISTIVE STRUCTURAL UNITS FOR FIREPROOF AND NON-COMBUSTIBLE BUILDINGS

FRAMING	FLOORS	ROOF
DE STRUCTURAL UNIT	CODE STRUCTURAL UNIT	CODE STRUCTURAL UNIT
Reinforced Concrete Frame. Reinforced Concrete Joists, Columns, Beams, Trusses, Arches, Masonry Piers.	1. Reinforced Concrete. Reinforced Concrete with Masonry Units. Pre-cast Concrete or Gypsum Slabs or Planks.	a. Reinforced Concrete. Reinforced Concrete with Masonry Units. Reinforced Gypsum Concrete, Pre-cast Concrete or Gypsum Slabs or Planks.
Protected Steel Frame. Individually Protected Steel Joists, Columns, Beams, Trusses, Arches.	2. Concrete or Metal Lath. Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.	b. Concrete or Gypsum on Metal Lath. Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.
Indirectly Protected Steel Frame. Indirectly Protected Steel Joists, Columns, Beams, Trusses, Arches.	3. Open Steel Deck or Grating.	c. Incombustible Composition Boards with without Insulation, Masonry or Metal Tiles.
Unprotected Steel Frame. Unprotected Steel Joists, Columns, Beams, Trusses, Arches.		d. Steel Deck, Corrugated Metal or Asbestos Protected Metal with or without Insulation.
Masonry Bearing Walls only.		

The coding to the left, for framing, floor and roof structural units is used in describing the construction of fire-resistive buildings. In addition, reports for fire-resistive buildings will show the date built, wall construction other than brick, and ceilings.

FP-1962 (CONC.) A-1-a
A fireproof building built in 1962 with concrete walls and reinforced concrete frame, floors and roof.

FPX-1962 (CONC.) B-2-a (NON-COMB. CEILING)
A fireproof building built in 1962 with metal panel walls, reinforced concrete columns and beams, concrete walls on metal lath and gypsum slab roof; noncombustible ceilings.

NC-1962 (C.B.) H-2-d
A non combustible building built in 1962 with concrete block walls; unprotected steel columns, beams and joists; concrete floors on metal lath and steel deck roof.

MASONRY CONSTRUCTION

Important interior and all exterior masonry walls of all non-residential buildings and residential buildings of five or more dwelling units are shown with weighted (—) lines.

Masonry walls of residential buildings of four dwelling units or less are shown in a standard line and the construction is noted on all buildings diagrammed after July, 1963.

WALLS	PARTITIONS	OPENINGS
8" Brick	Frame	(Interior) Wall with No Openings
12" Concrete	Tile from Foundation to Top Ceiling only	Wall with Double Standard Fire Doors 1st Floor
18" & 20" Stone	Concrete First Floor only	Wall with Standard Fire Door Basement
12" & 8" Hollow Tile Wall Thicknesses Placed Relative to Respective Floors	Hollow Cinder or Concrete Block 1st Floor only	Wall with Substandard Fire Doors 1st & 3rd Floors
Cinder, Concrete or Cement Brick	Brick 2nd Floor only	Wall with Metal & Wired Glass Fire Doors all Floors
Hollow Cinder or Concrete Blocks, Pilastered	Tile 1st & 3rd Floor only	Wall with Substandard Fire Doors 1st, 2nd & 3rd Floors & Unprotected Opening 4th Floor
Mixed Construction of Concrete Blocks, Brick Faced		Wall with Small Unprotected Openings only
Mixed Construction of Concrete Blocks and Brick		Wall with Unprotected Openings all Floors
Masonry Walls, Metal Faced		(Exterior) 1st Floor
Adobe		1st & 2nd Floors
Hollow Cinder or Concrete Block Interior Wall Basement to Roof		3rd Floor
Tile Interior Wall Basement to Roof		1st & 4th Fl. with Metal Shutter 1st.
Cement Brick End Wall		10th & 22nd only
		10th & 22nd Fl.
		Glass Block
		Wired Glass in Metal Sash 2nd & 3rd Fl.

NON-MASONRY CONSTRUCTION

Non-masonry walls are shown with fine (—) lines. (Walls construction other than wood and stucco on wood frame is noted)

Wood & Stucco & Cement Plaster, Etc. on Wood Frame	Wood & Glass	Wood & Sash Glass	Iron Building with Wood Roof. (Location of Extensive Wood Areas Specifically noted)	Apron Walls with wood Sash and Glass	Asphalt and/or Asbestos Protected Metal on Steel Frame
Brick Veneered on Wood Frame (Other Types of Veneered on Wood Frame Specifically Noted)	IR & GLASS	Metal & Sash Glass	Asbestos Clad on Wood Frame. Noted in Non-Residential Structures only.	Stucco, Cement Plaster, Etc. on Steel Frame	Asphalt and/or Asbestos Protected Metal on Wood Frame
Mixed Masonry & Non-Masonry Type of Masonry Specifically Noted)	(IR. CL.)	Metal Clad on Wood Frame	Mixed Wall—(9' of CB with Metal Sash Above	Guniting on Steel Frame	GLASS PANELS
Wood, Brick Lined, Br. Filled & Brick Nogged	(IRON)	Iron Building	Metal Panels		

FIRE PROTECTION

Fire Department Connection	Single Hydrant	Frame Enclosed Elevator with Self Closing Traps	2 Stories & Basement 1st Floor Occupied by Store 3 Residential Units above 1st Auto in Basement Drive or Passageway Wood Shingle Roof.
Automatic Sprinklers throughout contiguous sections of single risk	D.H. ● Double Hydrant	Concrete Block Enclosed Elevator with Traps	IR CN Iron Chimney
Automatic Sprinklers all floors of building	T.H. ● Triple Hydrant	Tile Enclosed Elevator with self closing Traps	IR CN, S.A. Iron Chimney (with spark arrester)
Automatic Sprinklers in part of building only (Note under Symbol indicates protected portion of building)	Q.H. ● Quadruple Hydrant of the High Pressure Service	Brick Enclosed Elevator with wired Glass Door	UP B Vertical Steam Boiler
Not Sprinklered	W.P.S. Water Pipes of the High Pressure Service	[] Open Hoist	Horizontal Steam Boiler
Automatic Chemical Sprinklers	W.P.S. Water Pipes of the High Pressure Service as shown on Key Map	[] Hoist with Traps	Width of Street between Black Lines, not Curb Lines
Chemical Sprinklers in part of building only (Note under Symbol indicated protected portion of building)	P.W.S. Public Water Service	[] Open Hoist Basement to 1st	Ground Elevation
V.P. Vertical Pipe or Stand Pipe	P.W.S. Private Water Service	[] Stairs	House numbers nearest to Buildings are Official or Actually up on Buildings. Old house numbers are farthest from Buildings
A.F.A. Automatic Fire Alarm	SKL 1 Skylight lighting top story only	MISCELLANEOUS	24 Reference Adjoining Page
W.T. Water Tank	SKL 3 Skylight lighting 3 stories	[] Number of stories, Height in Feet Composition Roof Covering	5 Black Number
O.V.P. Outside Vertical Pipe on fire Escape	SKL W.G. Skylight with Wired Glass in Metal Sash	[] Parapet 6" above Roof Frame Curbs	Fire Department as shown on Key Map
F.A.B. Fire Alarm Box	[] Open Elevator	[] Parapet 12" above Roof	Vac. or V. - Vacant
H.P.S. Noted 'H.P.S.' on High Pressure Fire Service	[] Frame Enclosed Elevator	[] Parapet 24" above Roof Occupied by Warehouse Metal, Slate, Tile or Asbestos Shingle Roof Covering	Vac. or Op. or V. - O. - Vacant & Open
	[] Frame Enclosed Elevator with Traps	W.H.O.	

GLOSSARY

- A.B. Lines An arbitrary boundary between adjoining sheets.
- A Private garage
- ABY Above
- A.E.A. Equipped with fire detecting devices which automatically signal a central fire department.
- AIR COND Air cooling system employing ducts-through floors
- APRON WALL A masonry wall extending 5' or less above foundation
- ASSOC RISK Risk not underwritten by stock Fire Ins. Companies.
- BASEMENT A story having its floor below ground and its ceiling at least 4' above ground
- Cook County Ill.: A floor of a building next below the first floor. Shown by the symbol H following story height. Sub-basements or sub-cellars, located below the first basement, are shown by the symbol SB following basement symbol.
- CHIMNEYS (Applicable to maps in Rocky Mountain & Pacific Coast States.)
- BC, Brick, stone, concrete brick & concrete chimneys.
- C.B.L.C. Concrete block chimney
- C.C. Non-standard concrete chimney
- T.C. Tile Chimney
- P.C. Patent chimney
- IR, CH. Iron chimneys
- S.P. Stove pipe
- S.P.V. Stove pipe with patent ventilator.

RESIDENTIAL OCCUPANCY SYMBOLS

- D Single family unit or as qualified by a numeral.
- E.A.P.T.S. A multi-family residential building corresponding with local Rating Bureau definition in family units per floor, story height, & separation of entrance.
- ROOMS A residential building normally occupied by a single family but with 10 or more rooms rented for lodging purposes.
- EXCEPTIONS: 6 rooms in Arizona, California, Nevada, Utah & Montana; 5 rooms in Oregon & Washington; 4 rooms in Idaho & Hawaii.

FIRE RESISTIVE CONSTRUCTION SYMBOLS

- EE Approved masonry walls, floors & roof, interior supports of approved masonry, concrete and/or protected steel.
- EXP. F.P. qualifications except inferior or sub-standard walls.
- N.C. Fire resistive with unprotected structural steel units
- HOLLOW WALL A bonded masonry wall having a continuous air space within.
- I.E.P. Independent Electric Plant.
- IMPASSABLE Not traversable due to condition of terrain
- LEDGED WALL A masonry bearing wall with extended edges to support floors.
- LOFT Tenanted by industrial occupancies.
- M.L. & P. Concrete or plaster applied to metal lath on wood studs.
- M.S. & G. Metal sash & glass.
- NOT OPEN Streets appearing on records but not open on ground.
- O.L. Windows overlooking the roof above the corresponding floor of an adjoining building
- O.L.L. Open between ground and first floor.
- P.L.A.S.T.D. Masonry reinforcing columns in walls.
- SKYTS. Skylights.
- SL, CL. Slate attached to wood siding.
- SM, HO. Smoke House.
- STABLE Shown by crossing or diagonal lines on diagram.
- SUSP'D Suspended Ceilings below floor and/or roof beams.
- SYST. System.
- TRANS. Transformer.
- WD. Wood.

LAND USE APPLICABLE TO CHANGES DIAGRAMMED AFTER 1960

RESIDENTIAL	MANUFACTURING
RESIDENTIAL-TRANSIENT	PUBLIC OR INSTITUTIONAL
COMMERCIAL	UTILITY
WAREHOUSE	TRANSPORTATION

NUMERICAL PREFIX INDICATES THE NUMBER OF ESTABLISHMENTS IN EACH CATEGORY

KEY

Fire proof construction. (See fire-resistive construction)

Adobe building.

Stone building.

Concrete, lime, cinder or cement brick

Hollow concrete or cement block construction

Concrete or reinforced concrete construction

Tile building.

Brick building with frame cornice

Brick building with frame side (concealed by frame plan finish)

Brick veneered building and frame building

Frame building, brick lined

Frame building, metal clad

Frame residential building.

Iron building

Tenant building occupied by various manufacturing or occupancies

Frame building covered with asbestos

Brick building with brick or metal cornice

Fire wall 6 inches above roof.

12

18

36

Figures 6, 12, 18 indicate thickness of wall in inches.

Wall without opening and size in inches

Wall with openings on floors as designated.

Opening with single iron or tin clad door.

double iron doors.

standard fire doors.

Openings with wired glass doors.

Drive or passage way

Stable.

Auto. House or private garage.

Solid brick with interior walls of C.B. or C.B. and brick mixed.

Mixed construction of C.B. and brick with one wall of solid brick.

Mixed construction of C.B. and brick with one wall faced with 4" brick.

Mixed construction of C.B. and brick throughout.

Window opening in first story.

Window openings in second and third stories.

Window openings in second and fourth stories.

Windows with wired glass.

Windows with iron or tin clad shutters

Window openings length to twenty-second stories.

Open elevator.

Frame enclosed elevator.

with traps.

self closing traps.

Concrete block enclosed elevator with traps.

Iron chimney

Brick chimney.

Brick chimney.

Ground elevation.

Vertical steam boiler.

Gasoline tank.

Open under

Siamese fire dept. connection

Single fire dept. connection

Block number.

Vertical pipe or stand pipe.

Automatic fire alarm.

Independent electric plant.

Automatic sprinklers.

Automatic chemical sprinklers.

Automatic sprinklers in part of building only. (NOTE UNDER SYMBOL INDICATES PROTECTED PORTION OF BUILDING)

Not sprinklered.

Outside vertical pipe on fire escape.

Fire alarm box.

Single hydrant.

Double

Triple

Quadruple hydrant of the High Pressure Fire Service

Fire alarm box of the High Pressure Fire Service

Water pipes of the High Pressure Fire Service and hydrants of the High Pressure Fire Service as shown on key map.

Water pipes and size in inches.

Water pipes of private supply

House numbers shown nearest to buildings are official or actually up on buildings.

Old house numbers shown furthest from buildings.

TANKS

G.T. Gasoline Tank

4' EARTH DIKE

CRUDE OIL TANKS CAPCY. 100,000 GALS EACH

23

24

25

1000 GAL. KEROSENE TK. 26

2000 GAL. GASOLINE TK. 27

G.T.

10,000 GAL. STEEL W.T. ELEV'D. TO 'ABV' GAD.

FUEL OIL LINE

Fire Cistern

CISTERN

GARAGE CAPCY. 20 CARS CONC. FL. WOOD RAMP TO 2ND REP. 2ND.

PRIVATE GARAGE CAPCY. 10 CARS CONC. FL.

CODING OF STRUCTURAL UNITS FOR FIREPROOF AND NON-COMBUSTIBLE BUILDINGS

FRAMING		FLOORS		ROOF	
CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT	CODE	STRUCTURAL UNIT
A.	Reinforced Concrete Frame.	1.	Reinforced Concrete.	a.	Reinforced Concrete.
B.	Reinforced Concrete Joists, Columns, Beams, Trusses, Arches, Masonry Piers.		Reinforced Concrete with Masonry Units.		Reinforced Concrete with Masonry Units.
C.	Protected Steel Frame.		Pre-cast Concrete or Gypsum Slabs or Planks.		Reinforced Gypsum Concrete. Pre-cast Concrete or Gypsum Slabs or Planks.
D.	Individually Protected Steel Joists, Columns, Beams, Trusses, Arches.	2.	Concrete or Metal Lath, Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.	b.	Concrete or Gypsum on Metal Lath, Incombustible Form Boards, Paper-backed Wire Fabric, Steel Deck, and Cellular, Ribbed or Corrugated Steel Units.
E.	Indirectly Protected Steel Frame.				
F.	Indirectly Protected Steel Joists, Columns, Beams, Trusses, Arches.	3.	Open Steel Deck or Grating.	c.	Incombustible Composition Boards with or without Insulation. Masonry or Metal Tiles.
G.	Unprotected Steel Frame.				
H.	Unprotected Steel Joists, Columns, Beams, Trusses, Arches.			d.	Steel Deck, Corrugated Metal or Asbestos Protected Metal with or without Insulation.
O.	Masonry Bearing Walls.				

LAND USE APPLICABLE TO CHANGES DIAGRAMMED AFTER 5/69

R	RESIDENTIAL	M	MANUFACTURING
RT	RESIDENTIAL-TRANSIENT	P	PUBLIC OR INSTITUTIONAL
C	COMMERCIAL	U	UTILITY
W	WAREHOUSE	T	TRANSPORTATION

NUMERICAL PREFIX INDICATES THE NUMBER OF ESTABLISHMENTS IN EACH CATEGORY

The coding for framing, floor and roof structural units as shown above is used in describing the construction of fire-resistive buildings. In addition, reports for fire resistive buildings will show the date built and wall construction other than brick.

F P Buildings have masonry floors and roof; concrete and/or directly or indirectly protected steel framing; and clay brick, stone or poured concrete walls.

F P X buildings are F P buildings with inferior walls such as concrete block, cement brick, metal or glass panels, etc.

N C buildings have unprotected steel framing and fire-resistive but non-masonry floors and roof.

F.P.-1962 (CONC.) A-1-a


A fire-resistive building built in 1962 with concrete walls and reinforced concrete frame, floors, and roof.

F.P.-1962 METAL PANELS W-2-b


A fire-resistive building built in 1962 with metal panel walls, indirectly protected steel frame, concrete floors and roof on metal lath, noncombustible ceilings.

NC-1962 (C.B.) H-2-d

A noncombustible building built in 1962 with concrete block walls; unprotected steel columns and beams; concrete floors on metal lath and steel deck roof.

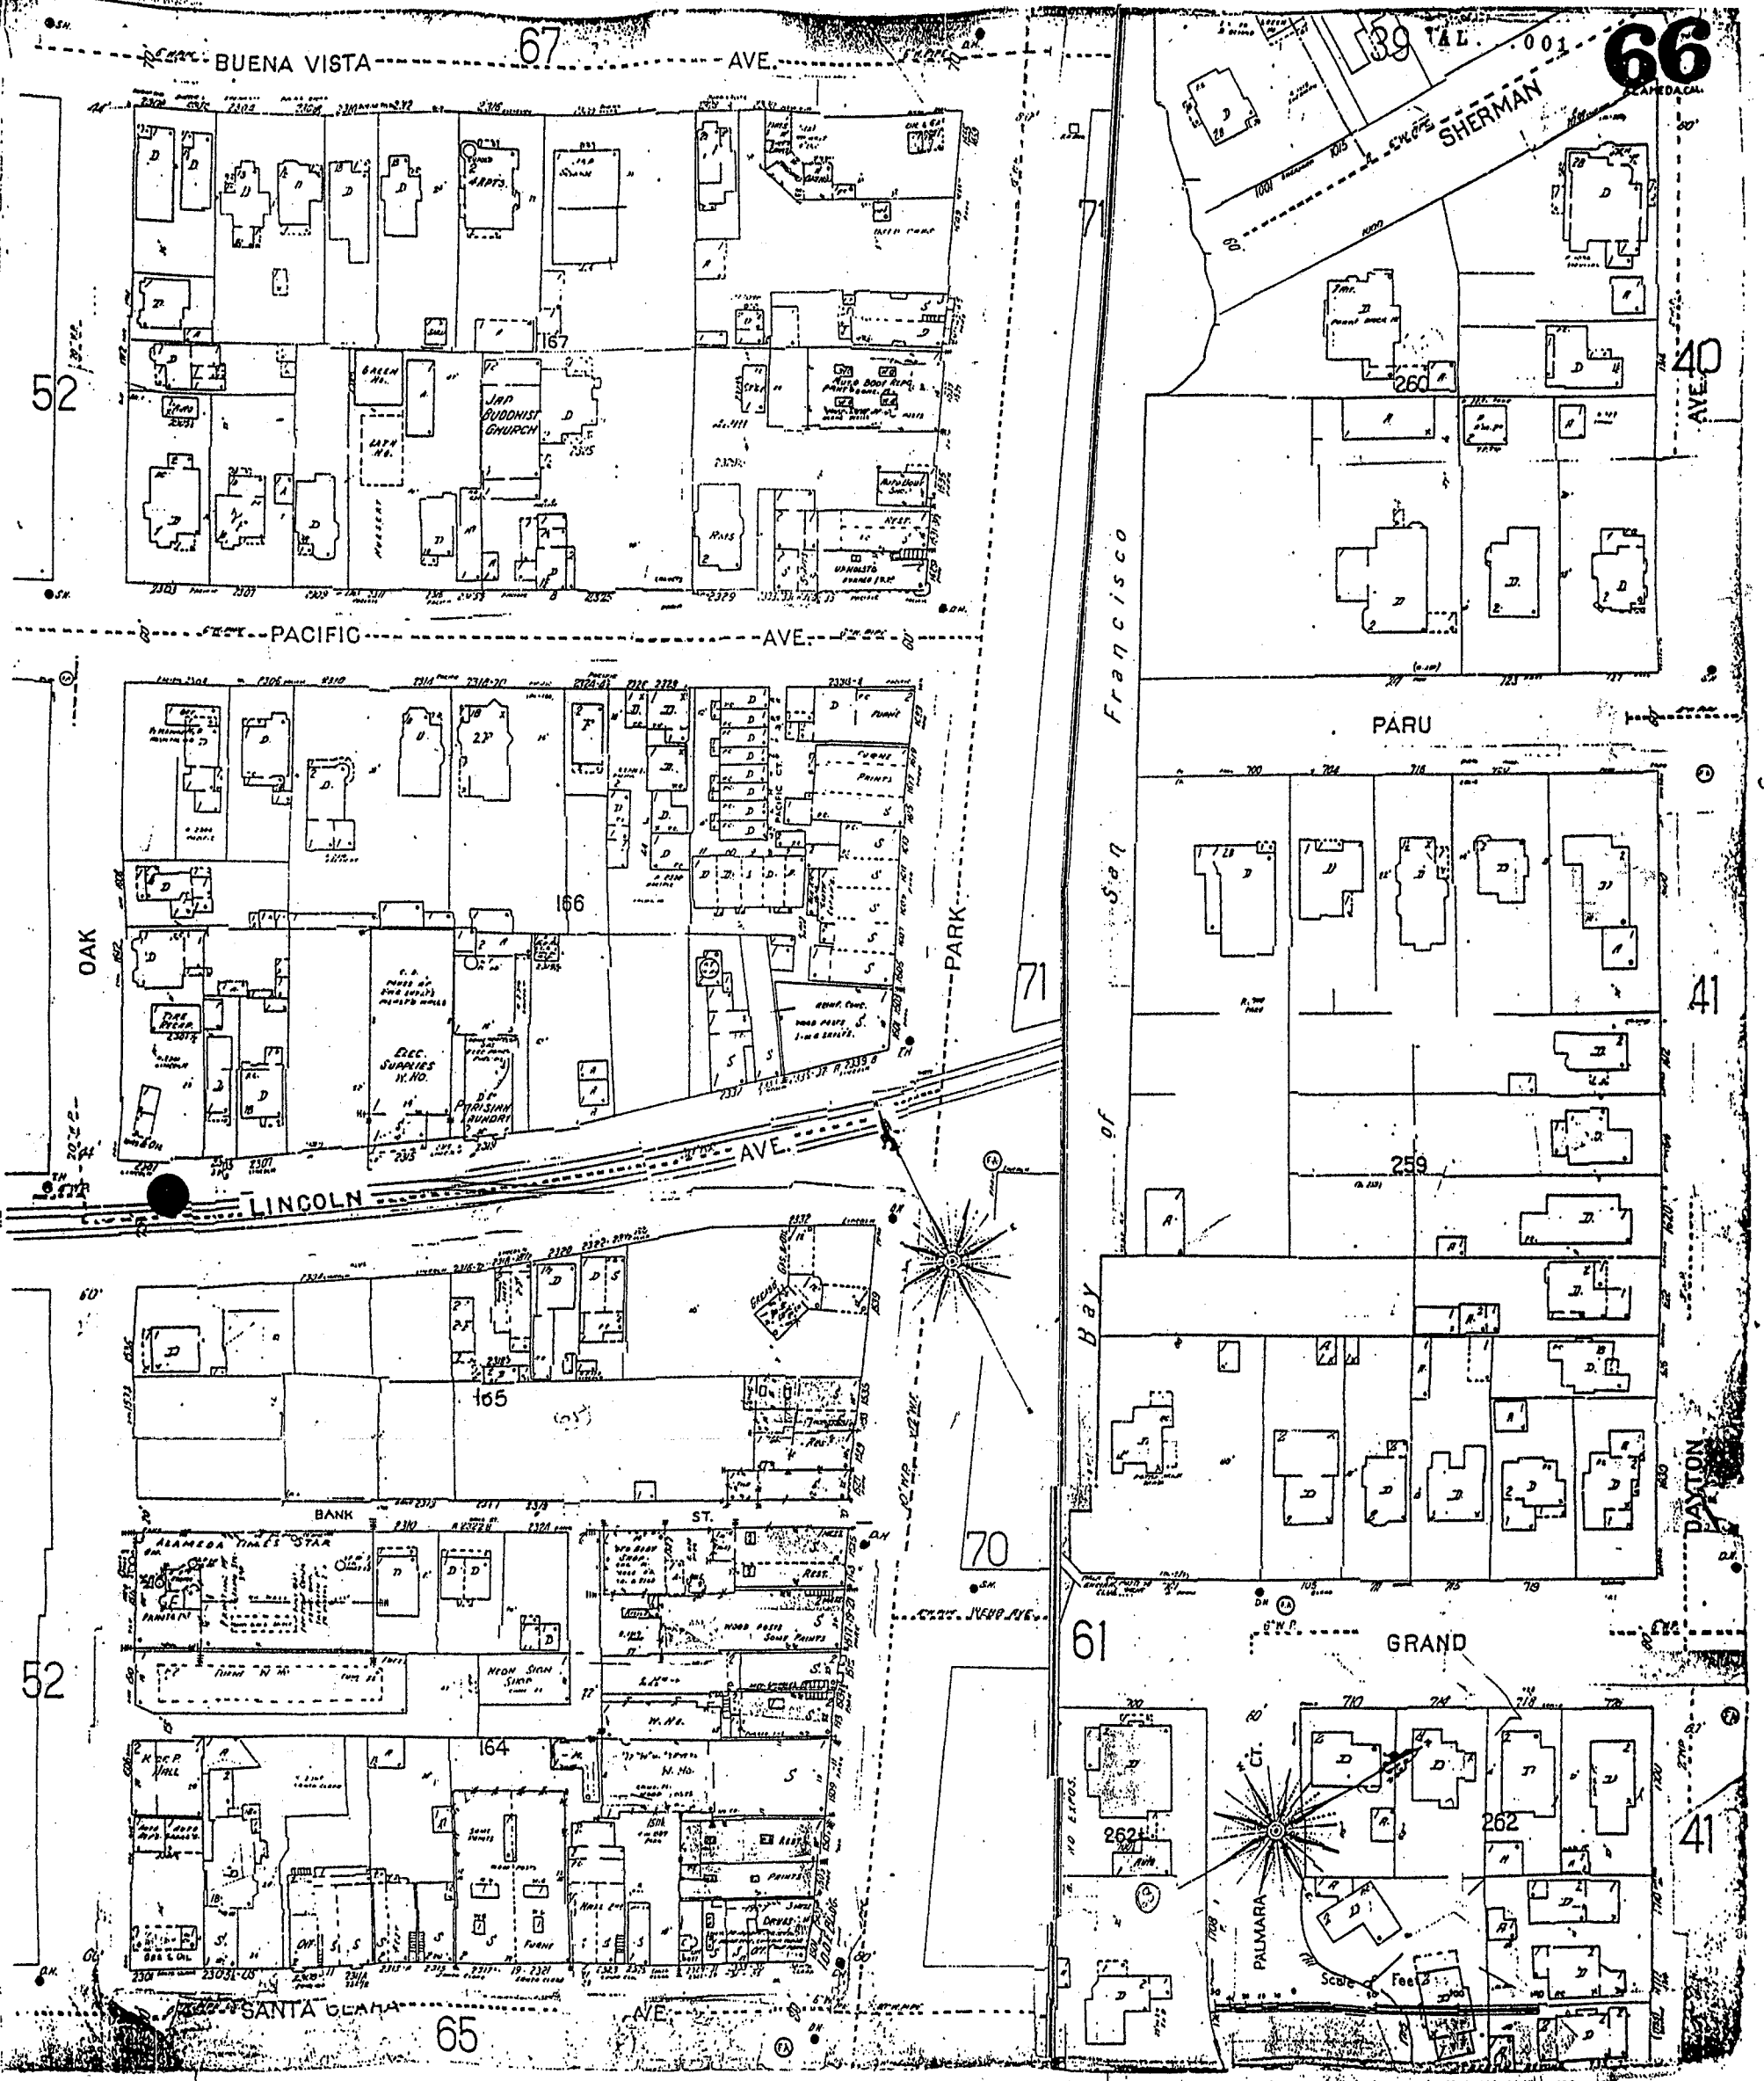


Environmental Risk Information & Imaging Services
 505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606




THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY NOT BE FURTHER REPRODUCED WITHOUT PERMISSION.

SANBORN 1950

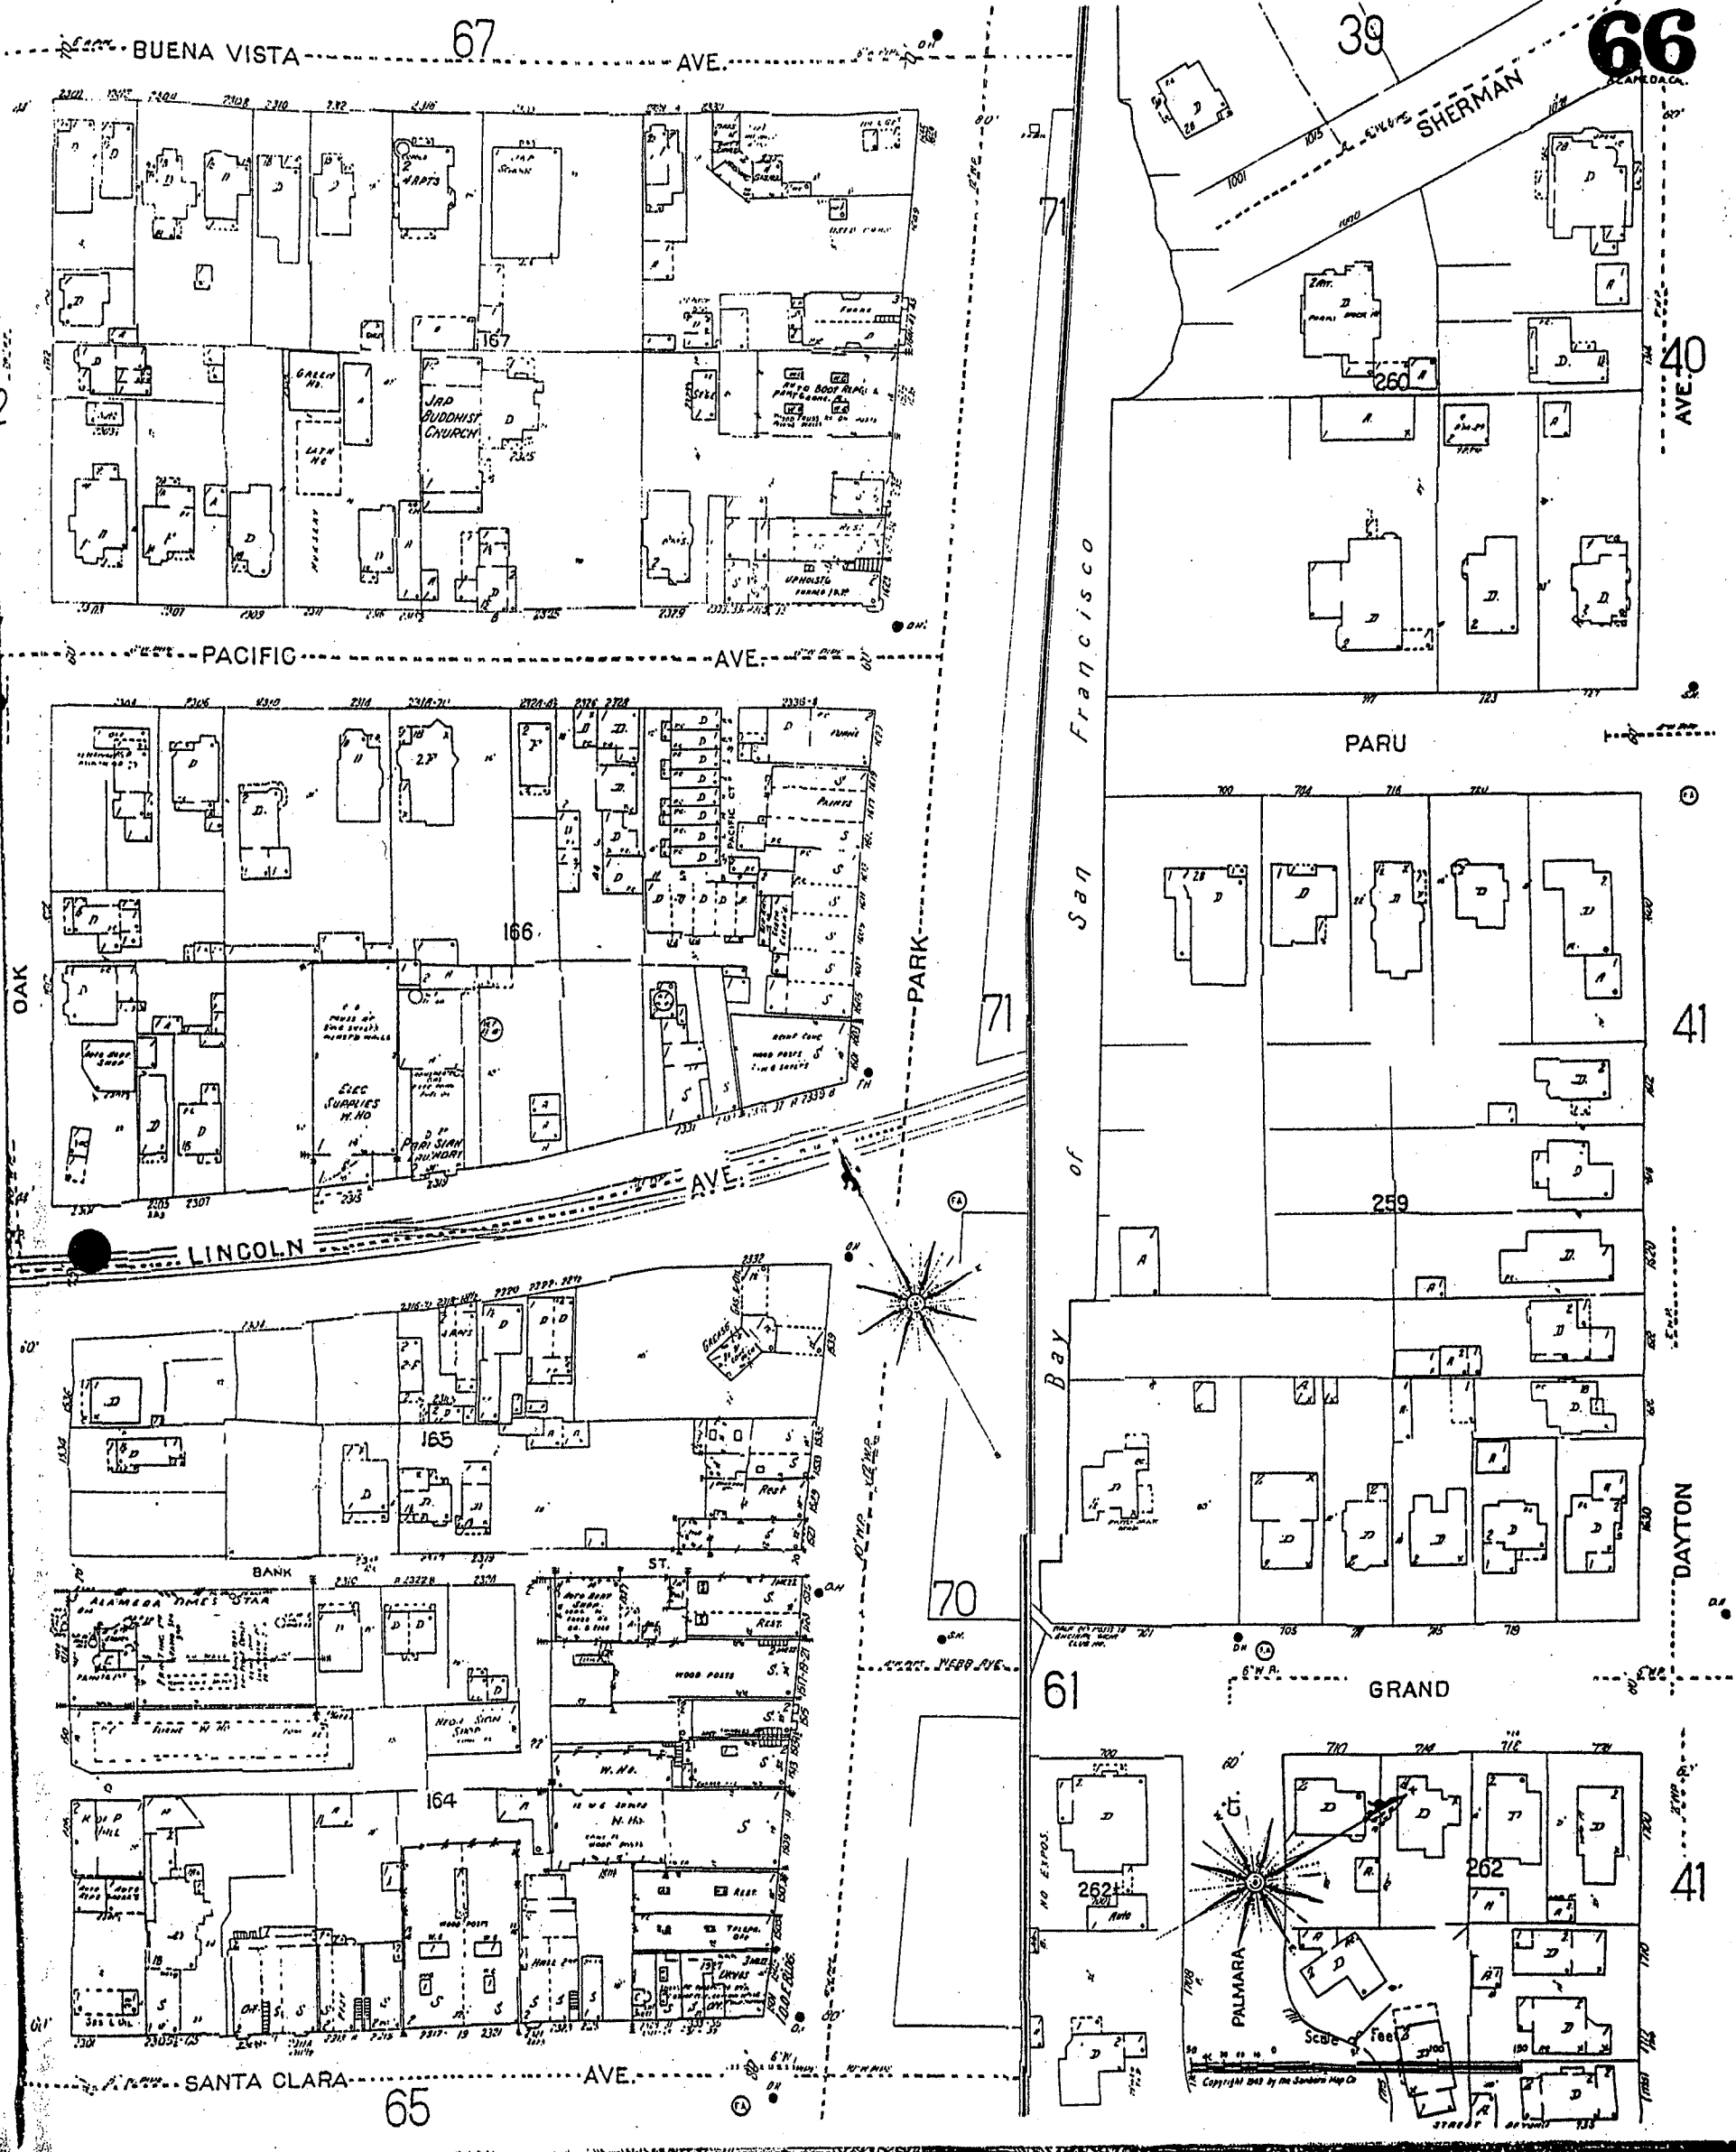

Environmental Risk Information & Imaging Services


505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606



THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY NOT BE FURTHER REPRODUCED WITHOUT PERMISSION.


SANBORN

1948

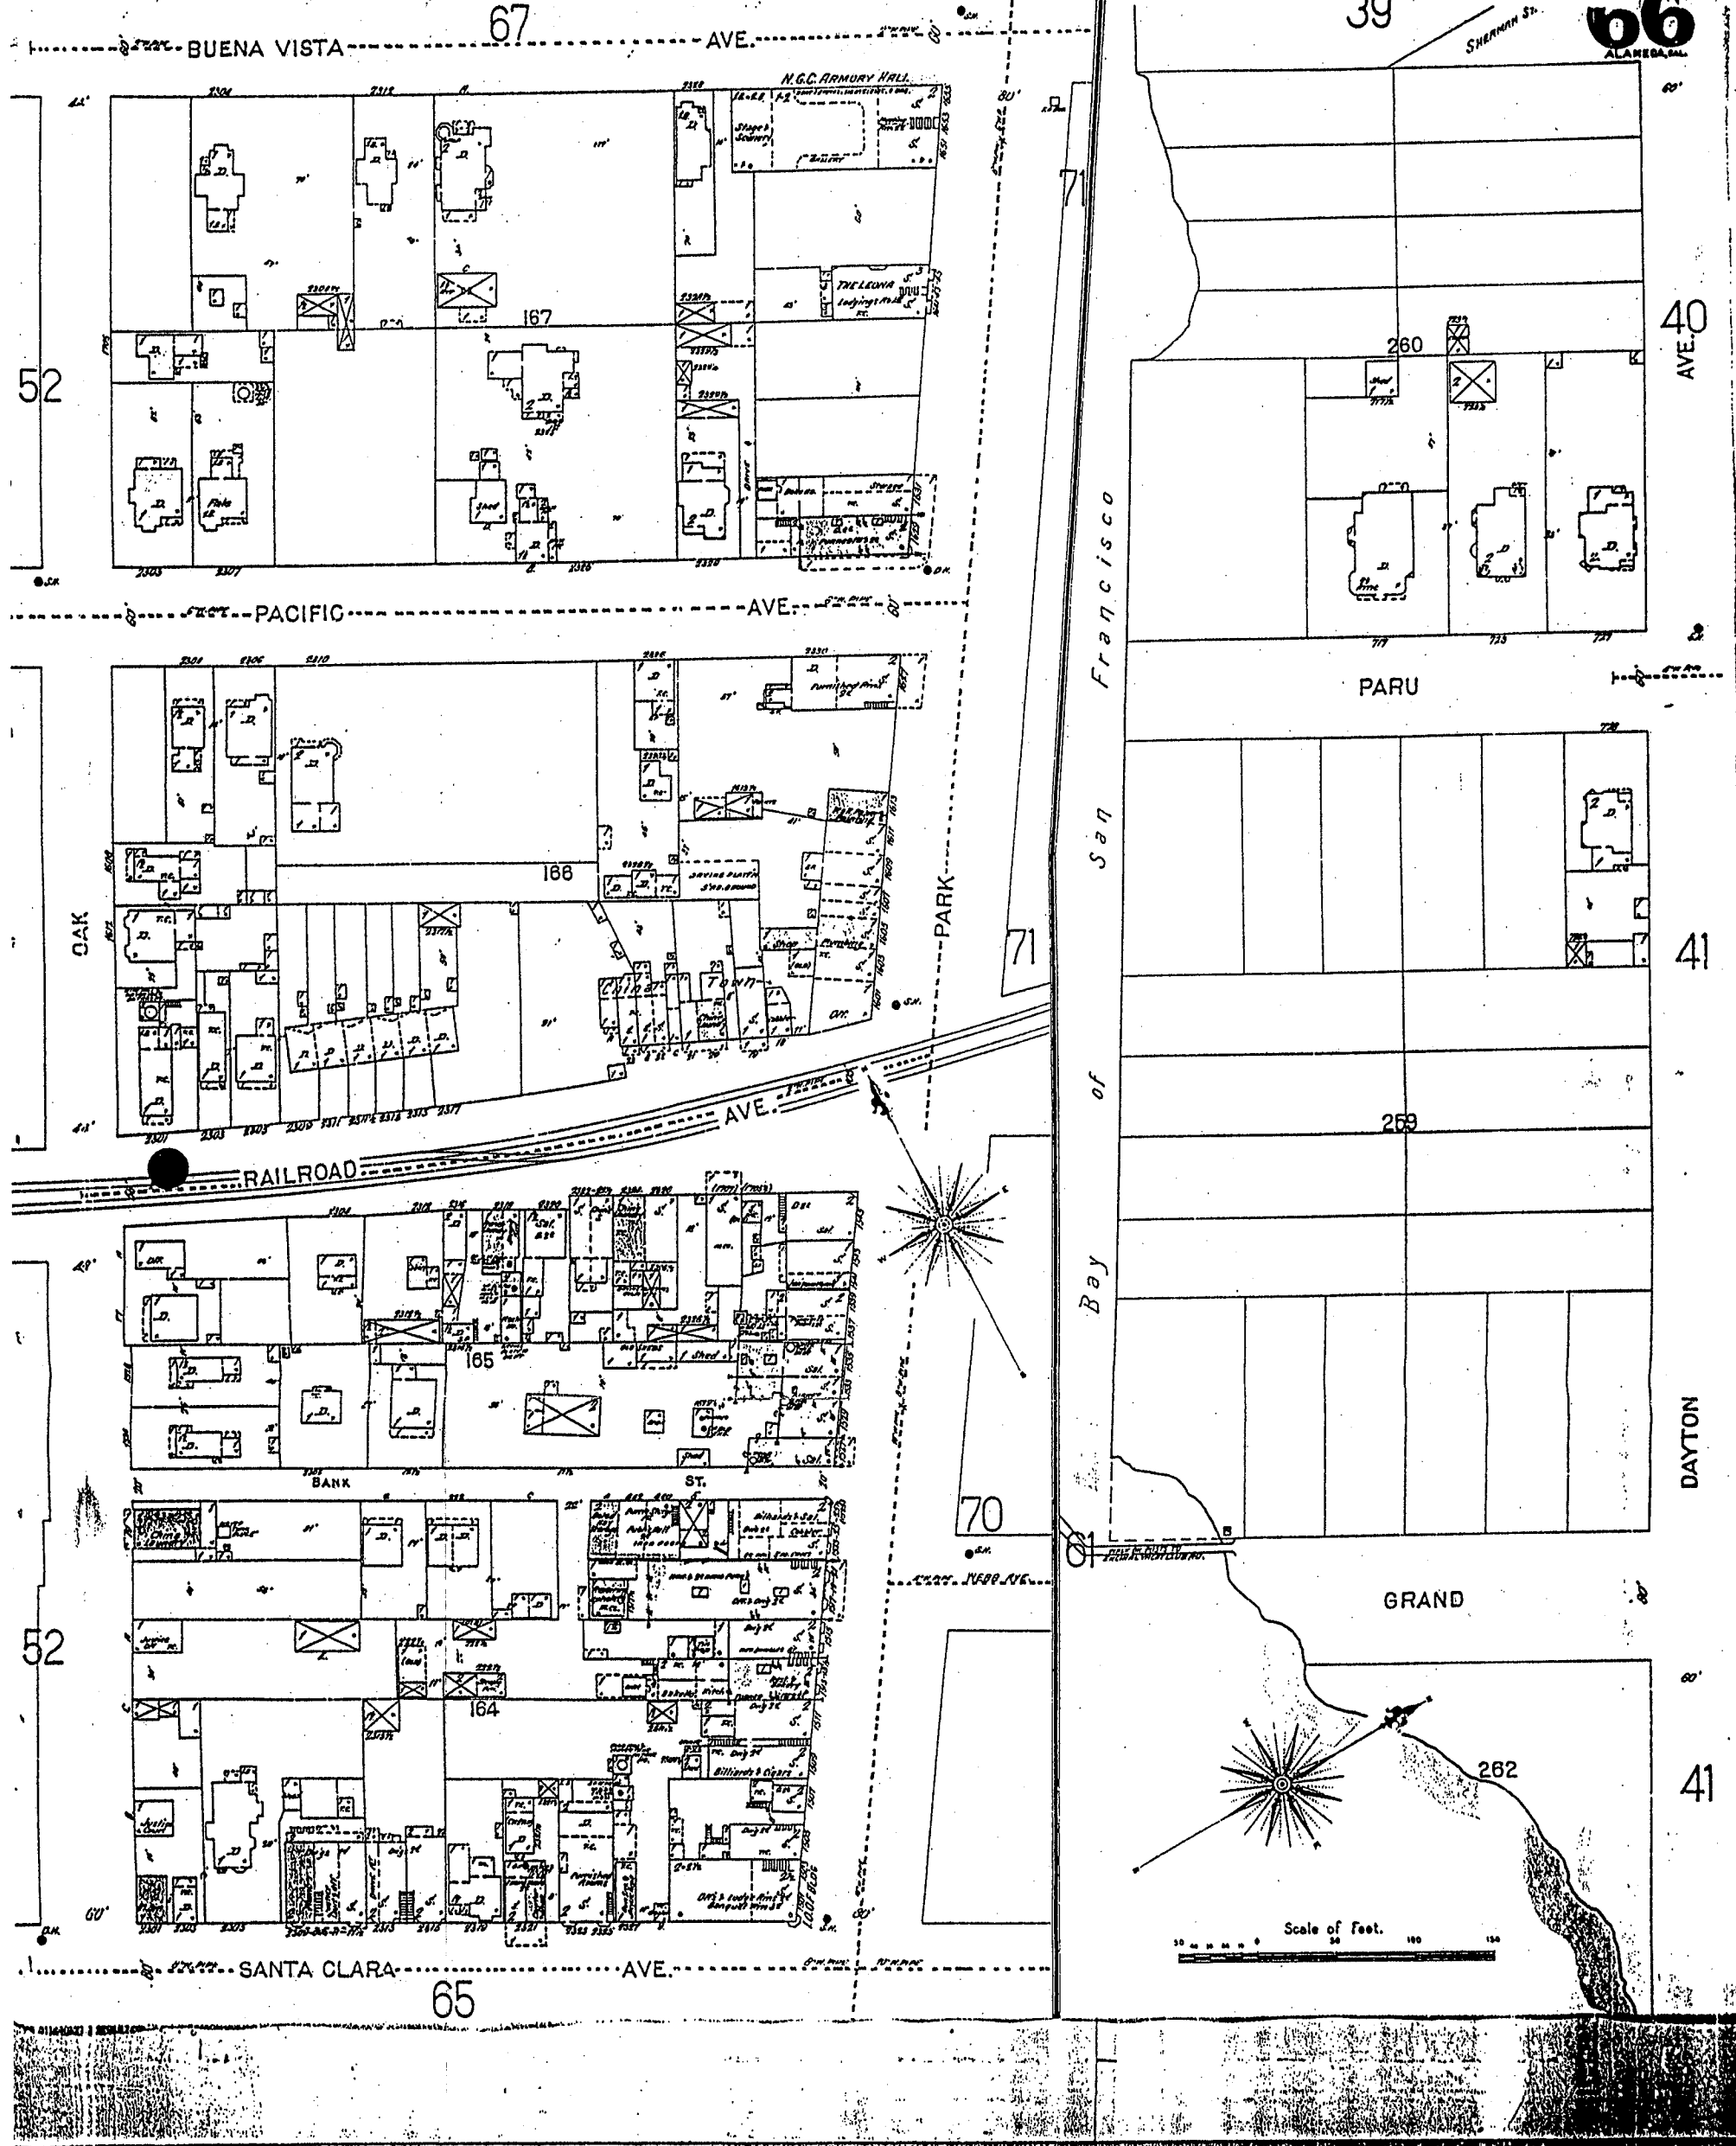

Environmental Risk Information & Imaging Services


505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606



THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY NOT BE FURTHER REPRODUCED WITHOUT PERMISSION.


SANBORN

1997

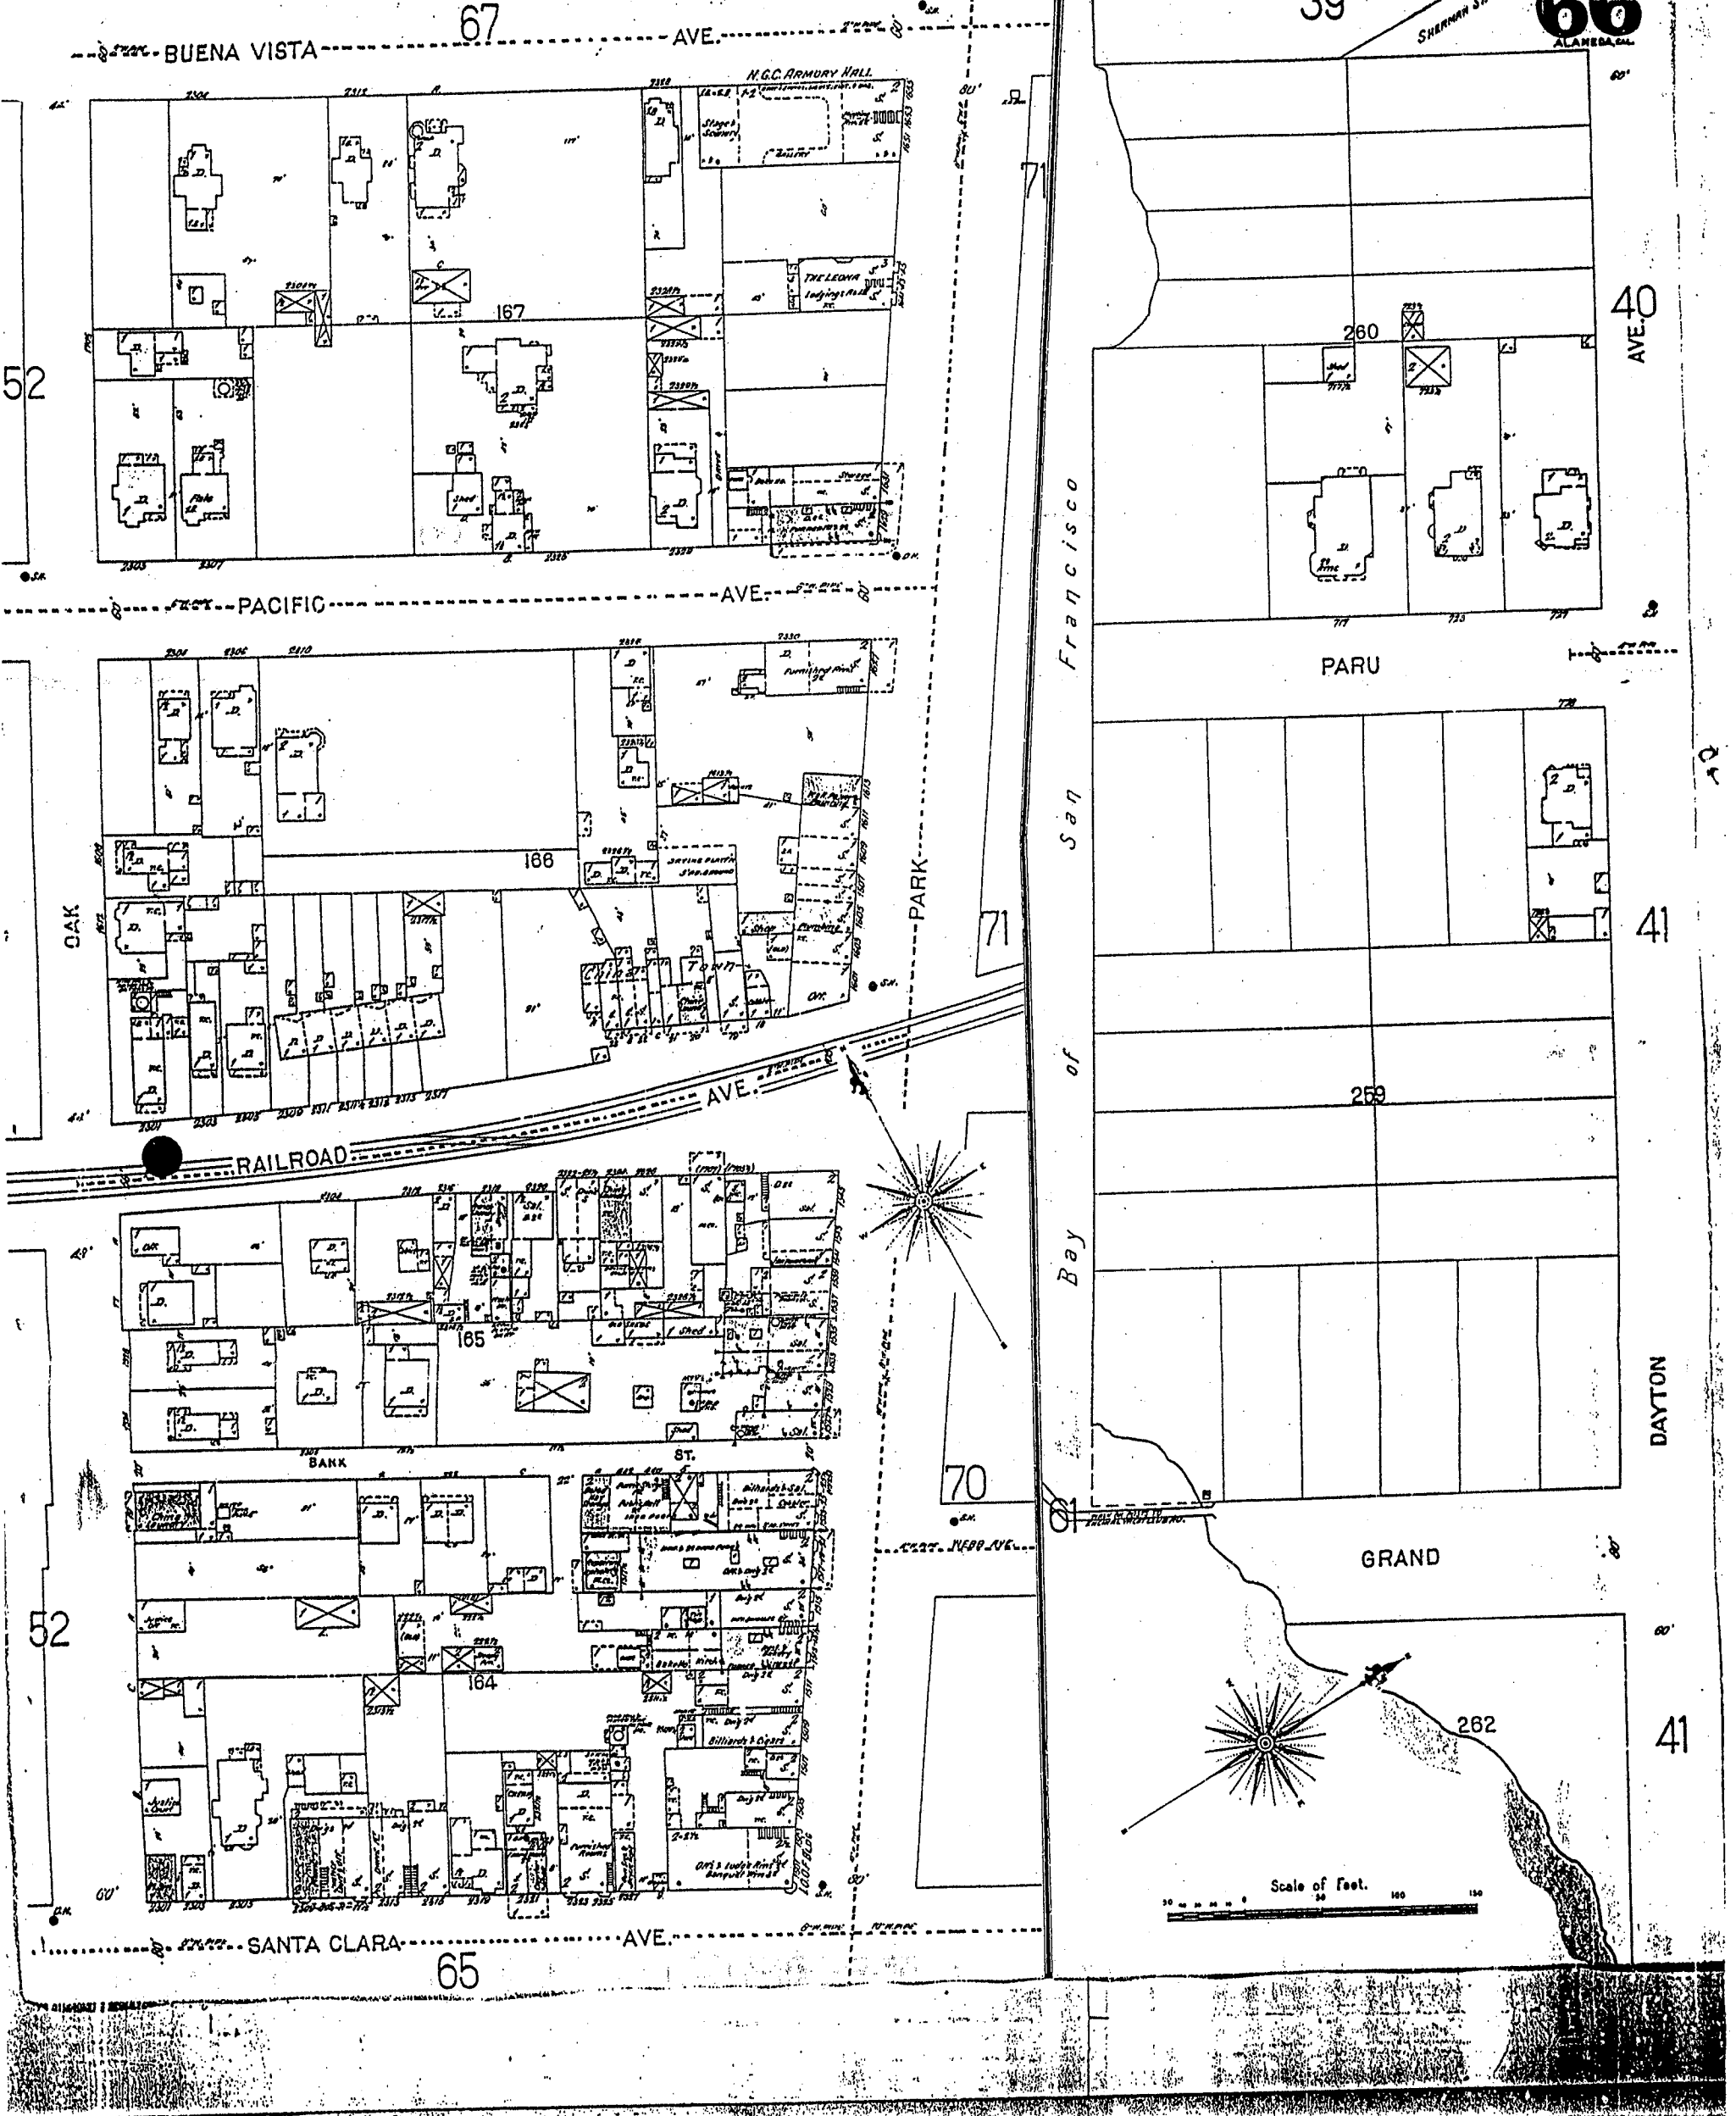

Environmental Risk Information & Imaging Services

505 HUNTMAR PARK DRIVE, SUITE 200 • HERNDON, VA 20170 • 703-834-0600 • 1-800-989-0403 • FAX: 703-834-0606



THE REPRODUCTION OF THE SANBORN FIRE INSURANCE MAPS HAS BEEN MADE BY PERMISSION OF EDR SANBORN, INC., THE COPYRIGHT HOLDER, IN ACCORDANCE WITH THE TERMS AND CONDITIONS OF AN AGREEMENT BETWEEN ENVIRONMENTAL RISK INFORMATION & IMAGING SERVICES AND EDR SANBORN, INC. DATED AUGUST 1, 1991. EDR SANBORN, INC. MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THE SANBORN MAPS, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SANBORN AND SANBORN MAPS ARE TRADEMARKS OF EDR SANBORN, INC. THE MANUFACTURERS' MUTUAL MAPS ARE THE PROPERTY OF THE EDISON INSTITUTE, DEARBORN, MICHIGAN, AND MAY NOT BE FURTHER REPRODUCED WITHOUT PERMISSION.

SANBORN

1897