



RECEIVED

2:20 pm, Sep 19, 2008

Alameda County
Environmental Health

WALTER J. BISHOP
MANAGER OF WASTEWATER

September 3, 1992

C E R T I F I E D M A I L
(Return Receipt Requested)
Certified Mail No. P 790 283 147

Mr. Edgar Howell
Hazardous Materials Division
Alameda County Health Agency
80 Swan Way, Suite 200
Oakland, CA 94621

Dear Mr. Howell:

Re: Annual Precision Test Results for East Bay Municipal Utility District's Underground Storage Tanks

East Bay Municipal Utility District owns and operates two single-walled (SW) underground storage tanks in Alameda County which are monitored by groundwater analysis of monitoring wells. Annual precision testing is a required part of this monitoring method. Precision test results for these tanks are enclosed. Both tanks tested "tight".


Facilities for which precision test results enclosed are as follows:

<u>Facility</u>	<u>Address</u>	<u>No. of tanks</u>
Water Pollution Control Pl	2020 Wake Ave. Oakland, CA	1-15,000 gal diesel 1- 2,000 gal slop oil

The District is in the process of replacing these two single-walled tanks with double-walled tanks within the next few months.

If you have any questions regarding the test results, please contact Molly Ong at (510) 287-1618.

Sincerely,

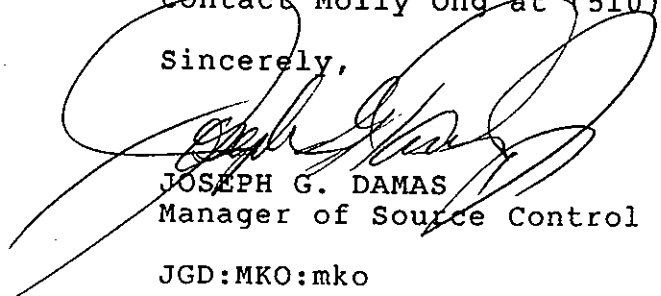
JOSEPH G. DAMAS
Manager of Source Control

JGD:MKO:mko

Enclosures

bcc: Gil Spurr (without enclosures)



Champion

Precision Tank Testing
License No. 73848



RECEIVED

AUG 17 1992

SOURCE CONTROL DIVISION

P.O. Box 13059

Sacramento, CA 95813-3059

CA 800-660-9443

NEV 800-949-9443

(916) 927-1557

Fax: (916) 927-7345

COTTLE INDUSTRIES
% DAVE COTTLE
P.O. BOX 163
ANTIOCH, CALIF. 94509

6-15-92

RE: STORAGE TANK TEST RESULTS FOR: EAST BAY MUD, SANITATION DIST. #1/OAKLAND, CALIF.

TEST DATE: 6-08-92

JOB #: 92CC1724

DEAR SIR:

THIS LETTER IS TO ADVISE YOU THAT WE HAVE COMPLETED THE TESTING FOR THE STORAGE TANKS INDICATED AT THE ABOVE DATE AND LOCATION. THE RESULTS OF THIS TEST (S) ATTACHED WITH THIS LETTER FOR YOUR REVIEW AND INFORMATION.

WE HAVE ALSO SENT A SET OF THESE TEST RESULTS TO THE APPROPRIATE REGULATORY AGENCIES.

IF YOU SHOULD HAVE ANY QUESTIONS PERTAINING TO THE DATA MATERIAL ENCLOSED THEN PLEASE CALL THE OFFICE AND I WILL BE GLAD TO ASSIST YOU IN EVERYWAY I CAN.

THANK YOU FOR ALLOWING US TO SERVE YOU AND I HOPE IN THE FUTURE WE WILL BE ABLE TO PROVIDE FOR YOU THE SERVICE THAT YOU REQUIRE.

THANK YOU FOR YOU COOPERATION IN THIS MATTER.

SINCERELY,

Chet Champion

CHET CHAMPION
CC/pg

CALIFORNIA STATE LICENSED TANK TECHNICIANS
William Campbell 92-1324 Alvin Milburn 92-1409 David Reeves 93-1125
TANK TECHNICIANS ASSISTANTS:
Linda Campbell & Alan Miller

****TANK CERTIFICATION REPORT****

CHAMPIONS PRECISION TANK TESTING
 P.O. BOX 13059
 SACRAMENTO, CALIF. 95815

(916)649-3677
 CALIF. 1-800-660-9443 FAX: (916) 725-7345
 NEVADA 1-800-949-9443

This certificate shows the dates and Technician that the Tank's system was worked on. (nose regulated) (1991) (Champion) (phampjet 329.)
 Criteria established by the National Fire Assoc.

OWNERS NAME *ATTN: M. SPURK*
 NAME: *EAST BAY MUD SANITATION DIST* PHONE: *(510) 287-1439*
 PROPERTY
 TANK(S)
 ADDRESS: *2020 WAKE AVE*
 CITY: *OAKLAND* STATE: *CA* ZIP: *94607*
 NAME OF LOCATION
 NAME: *EAST BAY MUD SANITATION DIST* PHONE: *(510) 287-1439*
 ADDRESS: *2020 WAKE AVE*
 CITY: *OAKLAND* STATE: *CA* ZIP: *94607*

RECORD OF FILING
 NOTICE TO OWNER: A copy of all tests results have been filled with the proper regulatory agency governing underground storage systems.
 N If not filed, see explanation below.
 Location of agency where filed. _____

REASON FOR TEST
 (explain fully)
 NOTICE: It is the owner's responsibility to contact the environmental health department of any failures within (24) hrs. of the final results.

WHO REQUESTED TEST AND WHEN?
 NAME: _____ PHONE: ()
 ADDRESS: _____
 CITY: _____ STATE: _____ ZIP: _____

ITEM OR SYSTEM TEST	Identify by Owner ID#	Capacity	Brand/Supplier	Grade	Apx. Age if known	Steel	Fiberglass
TANK ONLY <input checked="" type="checkbox"/>	<i>Slop Oil</i>	<i>2000</i>	<i>-</i>	<i>WATER</i>		<input checked="" type="checkbox"/>	
PRODUCT LINE <input checked="" type="checkbox"/>							
VENT LINE <input checked="" type="checkbox"/>							
VAPOR LINE <input type="checkbox"/>							
ALL OF THE ABOVE <input type="checkbox"/>							

FILL - UP ARRANGEMENTS
 Tanks to be filed. *0700* for *6-8-92* Date
 Distributor *OWNER* Name
 Extra Product to 'top off' Y N

OTHER INFORMATION OR REMARKS
 Additional information on any testing above. Official's or others to be advised when testing is in progress or completed. Visitors or observers present during the test.

TEST RESULTS TANKS PRODUCT LINES VENT & VAPOR LINES INCLUDED Y N




Tank ID#	Tight Tank	Tight Lines	Leak/Per Hr. Ind. Tank	Leak/Per Hr. Detected Line	Date Tested
<i>Slop Oil</i>	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	<input type="checkbox"/> Y <input type="checkbox"/> N	<i>1.00%</i>		<i>6-8-92</i>
	<input type="checkbox"/> Y <input type="checkbox"/> N	<input type="checkbox"/> Y <input type="checkbox"/> N			
	<input type="checkbox"/> Y <input type="checkbox"/> N	<input type="checkbox"/> Y <input type="checkbox"/> N			
	<input type="checkbox"/> Y <input type="checkbox"/> N	<input type="checkbox"/> Y <input type="checkbox"/> N			

JOB PLAN
 JOBSITE LOCATION

Invoice # 1724

Jobsite # 92001724

EAST BAY M40 SANITATION DIST #1
END OF WAKE AVE
OAKLAND

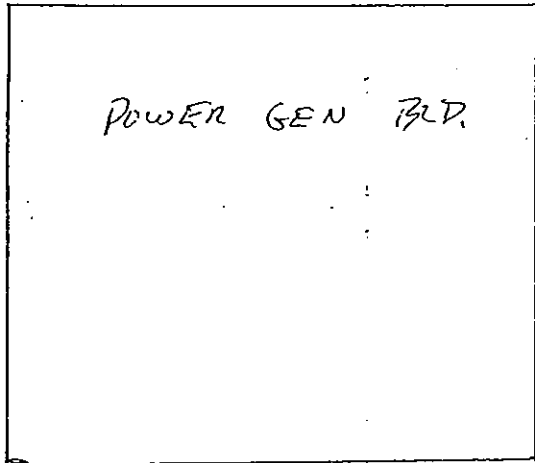

TANKS

(JOBSITE DESCRIPTION)

LEGEND

<u>TANKS</u>	(JOBSITE DESCRIPTION)	<u>LEGEND</u>
#1 SLOP OIL - 2000	F - FILL	V - VAPOR DROP
#2	T - TURBINE	V - VENTS
#3	F - OVERSPILL CONTAINER/ON FILL RISER	
#4	E - EXTRACTOR VALVE	
#5	M - MONITOR SYSTEM	
#6	S - SIPHON SYSTEM	
#7	V - VAPOR DROP W/OVERSPILL CONTAINER	

LEVEL START	LEVEL END	GAIN + LOSS -	x(A) FACTOR	LEVEL RESULT	TEMP. START	TEMP. END	GAIN + LOSS -	x(B) FACTOR	TEMP. RESULT	FINAL RESULT	TIME	
45	45	∅	X	.0018	∅	036	- 036	= ∅ X	.2744	= ∅	= ∅	1405
45	46	+ 1	X	"	+ .0018	036	- 037	= +.001 X	"	= +.0003	= +.0015	1410
46	48	+ 2	X	"	+ .0036	037	- 038	= +.001 X	"	+ .0003	= +.0033	1415
48	48	∅	X	"	= ∅	038	- 038	= ∅ X	"	= ∅	= ∅	1420
48	49	+ 1	X	"	+ .0018	038	- 038	= ∅ X	"	= ∅	+ .0018	1425
49	49	∅	X	"	= ∅	038	- 039	= ∅ X	"	= ∅	= ∅	1430
49	49	∅	X	"	= ∅	038	- 039	= ∅ X	"	= ∅	= ∅	1435
49	49	∅	X	"	= ∅	038	- 038	= ∅ X	"	= ∅	= ∅	1440
49	49	∅	X	"	= ∅	039	- 039	= +.001 X	"	+ .0003	= -.0003	1445
49	49	∅	X	"	= ∅	039	- 039	= ∅ X	"	= ∅	= ∅	1450
49	50	+ 1	X	"	+ .0018	039	- 040	= +.001 X	"	+ .0003	= +.0015	1455
50	50	∅	X	"	= ∅	040	- 040	= ∅ X	"	= ∅	= ∅	1500
			X	"	=			= X	"	REST	+ .0079	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	
			X	"	=			= X	"	=	=	

Technicians; *Alvin Milburn*
 S/P = .0011

Alvin Milburn #92-1409

RESULTS +.0078/hr (PASS)

